

New Plates for Different Types of Plate Heat Exchangers

Carla S. Fernandes^a, Ricardo P. Dias*^{b,c} and João M. Maia^d

^aDepartment of Mathematics, Escola Superior de Tecnologia e de Gestão, Instituto Politécnico de Bragança, Campus de Santa Apolónia, 5301-854 Bragança, Portugal, ^bDepartment of Chemical and Biological Technology, Escola Superior de Tecnologia e de Gestão, Instituto Politécnico de Bragança, Campus de Santa Apolónia, 5301-854 Bragança, Portugal, ^cCEFT - Centro de Estudos de Fenómenos de Transporte, Faculdade de Engenharia da Universidade do Porto, Rua Dr. Roberto Frias, 4200-465 Porto, Portugal, ^dIPC - Institute for Polymers and Composites, Departamento de Engenharia de Polímeros, Universidade do Minho, 4800-058 Guimarães, Portugal

Received: August 21, 2008; Accepted: September 4, 2008; Revised: September 11, 2008

Abstract: The first patent for a plate heat exchanger was granted in 1878 to Albretch Dracke, a German inventor. The commercial embodiment of these equipments has become available in 1923. However, the plate heat exchanger development race began in the 1930's and these gasketed plate and frame heat exchangers were mainly used as pasteurizers (e.g. for milk and beer). Industrial plate heat exchangers were introduced in the 1950's and initially they were converted dairy models. Brazed plate heat exchangers were developed in the late 1970's. However, copper brazed units did not start selling until the early 80's. Nickel brazing came to market around ten years later, since copper presents compatibility problems with some streams (e.g. ammonia). All-welded and semi-welded (laser weld) plate heat exchangers were developed during the 1980's and early 90's. Shell and plate heat exchangers were recently introduced in the market and can withstand relatively high pressures and temperatures, as the shell and tube does. The fusion bonded plate heat exchangers (100% stainless steel) are a technology from the 21st century, these equipments being more durable than brazed plate heat exchangers. The plates are the most important elements from the different plate heat exchangers mentioned above. This paper initially introduces the gasketed plate and frame heat exchanger and common chevron-type plates. Resorting to computer fluid dynamics techniques, the complex 3D flow in cross-corrugated chevron-type plate heat exchanger passages is visualized. Recent patents related with the plates from different plate heat exchangers are then outlined.

Keywords: Gasketed plate heat exchangers, brazed plate heat exchangers, all-welded plate heat exchangers, semi-welded plate heat exchangers, double-wall plate heat exchangers, shell and plate heat exchangers, fusion plate heat exchangers, computer fluid dynamics.

1. INTRODUCTION

Around 1850, French wine producers invited Louis Pasteur to solve a problem related with wine deterioration. Comparing samples of good wine with samples of deteriorated wine, Pasteur found several strains of micro-organisms. Some of them were predominant in the wines with good quality, while other strains were abundant in the wines with low quality. Hence, Pasteur concluded that a proper selection of micro-organisms could guarantee a consistent high quality production. In order to do that, he destroyed the micro-organisms present in the new wine of the grapes by heating it between 50° and 60°C and re-inoculated the new wine with wine of high quality, the latter wine containing the desirable micro-organisms. These experiments were useful to understand the role of micro-organisms in fermentations and showed that it was possible - using temperature - to control infestations provoked by harmful micro-organisms. Therefore, pasteurization was invented, this operation being widely used nowadays in the dairy and food industries. Later on, Pasteur broaden his studies to beer and, in 1857, he published one work showing

that milk sours due to the presence of some micro-organisms [1].

The bacteria *Mycobacterium tuberculosis* can be present in raw milk and catalysed (in the late years of the 19th century) the development of plate heat exchangers, since they are very efficient and can be easily disassembled for cleaning and sterilization to meet health and sanitation requirements [2, 3]. The first patent for a plate heat exchanger was granted, in 1878, to Albretch Dracke, a German inventor, but the commercial embodiment of these equipments has become available from APV International, England, in 1923 [3]. Around 1930, the company Alfa Laval, Sweden, launched an analogous commercial plate heat exchanger [3].

In 1996, the total market for heat exchangers in Europe amounted to USD 3.6 billion and the plate heat exchanger had a market share of 13% (second position after the conventional shell-and-tube heat exchanger) [4]. Modern plate heat exchangers provide higher working temperatures, larger working pressures, higher resistance to chemicals, etc.. Due to this, different types of plate heat exchangers are nowadays applied in a very broad range of industrial heat exchanger needs [2-6].

2. GASKETED PLATE AND FRAME HEAT EXCHANGERS

Gasketed plate and frame heat exchangers Fig. (1) are widely used in chemical, pharmaceutical, food, dairy, pulp

*Address correspondence to this author at the Department of Chemical and Biological Technology, Escola Superior de Tecnologia e de Gestão, Instituto Politécnico de Bragança, Campus de Santa Apolónia, 5301-854 Bragança, Portugal; Tel: +351273303150; Fax: +351273313051; E-mail: ricardod@ipb.pt

and paper industries, as well as in air conditioning and refrigeration systems (HVAC&R) and offshore gas and oil applications [2-10], to name a few, due to the low space requirement, low fouling tendency (high shearing forces), high efficiency, easy disassembly of the heat exchanger for cleaning and sterilization and flexibility on account of modular design, i.e., the heat transfer area can be easily varied by removing or introducing plates and the plate pattern can also be easily changed [4].

The heat transfer surface from a gasketed plate and frame heat exchanger is constituted by a series of plates, see Figs. (1) and (2a) containing portholes, for fluid entry and exit, in the four corners. When the plates are pressed together, the portholes form continuous tunnels, leading two fluids (for instance) from the inlet into the plate package, the different fluids being distributed to alternate narrow passages, always in counter-current flow. The presence of gaskets prevents the leakage of fluid from the passages to the surrounding atmosphere [2].

The most used gasketed plate and frame heat exchangers consist of plates with chevron-type corrugations [11] that have a sinusoidal shape [7-10] Figs. (1) and (2). The thermal-hydraulic performance of plate heat exchangers is strongly dependent on the geometrical properties of the chevron plates [2, 5, 12], namely on the corrugation angle, β , area enlargement factor, ϕ , defined as the ratio between the effective plate area and projected plate area, and channel aspect ratio Fig. (2).

The channel aspect ratio, γ , can be defined by [9]:

$$\gamma = \frac{2b}{p_x}, \tag{1}$$

p_x being the corrugation pitch in the main flow direction and b the inter-plates distance Fig. (2).

The area enlargement factor can be estimated by [9]:

$$\phi = \frac{1}{6} \left\{ 1 + \left[1 + \left(\frac{\pi}{2 \cos(\beta)} \right)^2 \gamma^2 \right]^{0.5} + 4 \left[1 + \left(\frac{\pi}{2\sqrt{2} \cos(\beta)} \right)^2 \gamma^2 \right]^{0.5} \right\} \tag{2}$$

Typically, the area enlargement factor assumes values between 1.1 and 1.5, b normally lies in the range 2-5 mm and β is typically located in the range 22-65° [2-10, 12]. The length of the plates may vary between 0.3 and 4.3 m [2, 3], the minimum value of the ratio length/width being of the order of 1.8 [2].

The thermal-hydraulic performance of the channels formed by cross-corrugated chevron-type plates can be studied making use of computational fluid dynamics techniques [7-10]. Due to the periodicity of the flow along the width of the channel zz axis in Fig (2) the referred study can be carried out using unitary cells Fig. (3) [9, 10]. It is important to note that in order to obtain thermal and

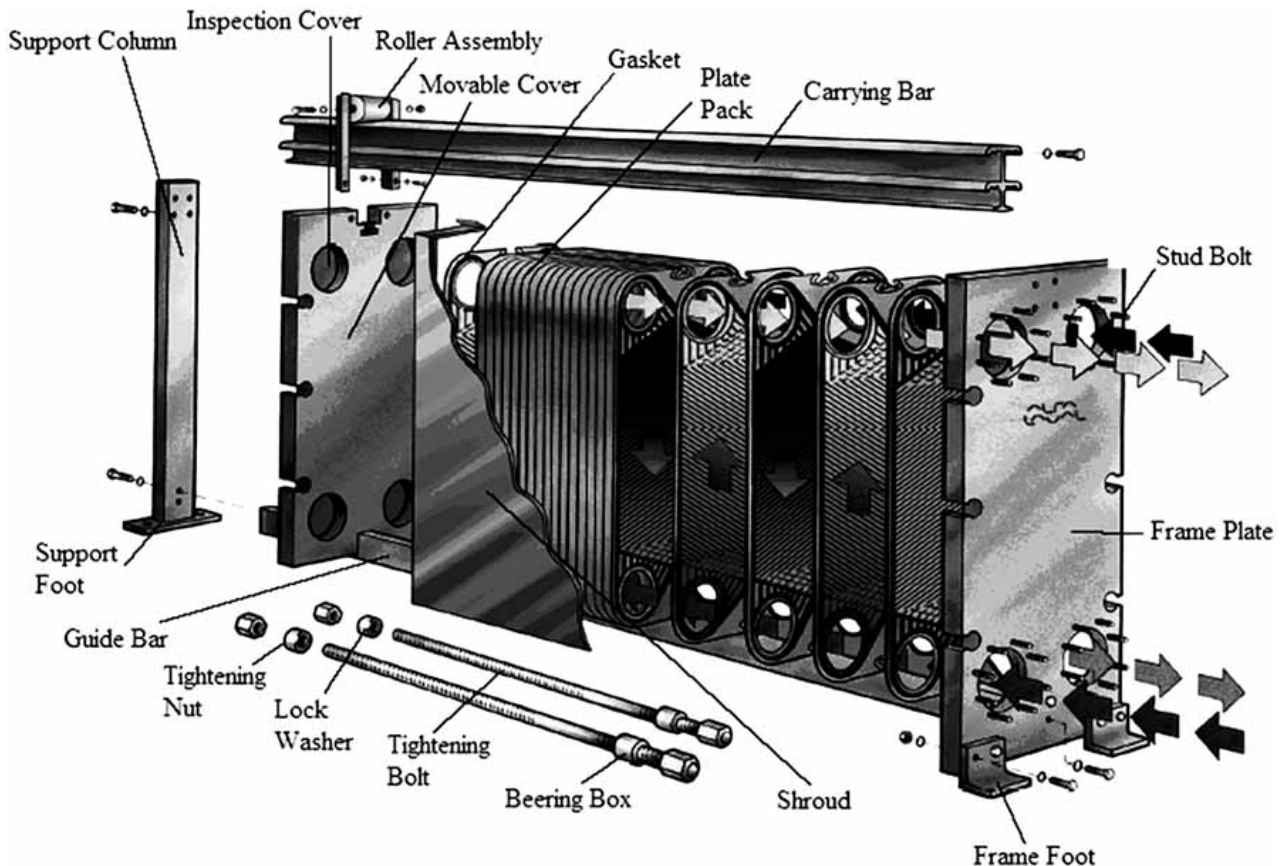


Fig. (1). Gasketed plate and frame heat exchanger (courtesy from Alfa Laval).

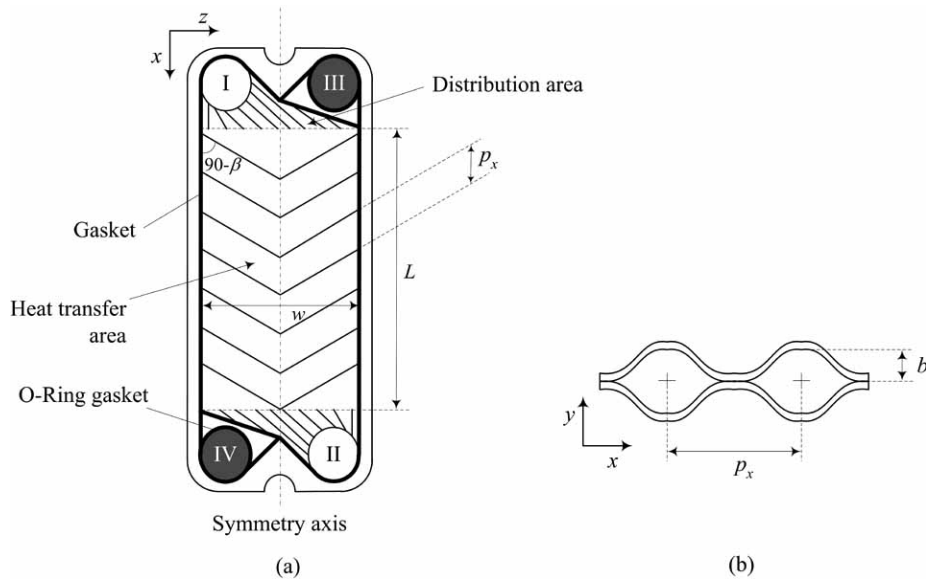


Fig. (2). (a) Schematic representation of a chevron plate. I, II, III and IV: portholes; (b) corrugation dimensions.

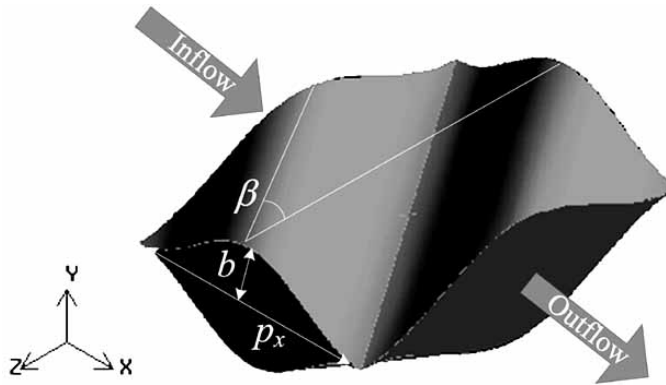


Fig. (3). Unitary cell from a channel containing chevron-type plates. The corrugation angle is 31°, $\gamma = 0.474$ and $\phi = 1.17$.

hydraulic fully developed flows in the main flow direction (xx axis), consecutive unitary cells must be used [9,10].

The complex laminar flow inside a cross-corrugated chevron-type plate heat exchanger channel can be observed in Fig. (4). In Fig. (4), the velocity field for different values of the normalized length x^* is presented. The inlet and outlet of the unitary cell, Fig. (3) is represented by $x^* = 0$ and 1, respectively (Fig. (4)). The plan $x^* = 0.5$ Fig. (4c) includes a contact point between the plates (located in the centre of the unitary cell). The maximum of the average interstitial velocity is observed for $x^* = 0.25$ and 0.75 Figs. (4b) and (4d) [10]. Detailed information about the numerical simulations (code used, mesh type, grid independence test, model validation, etc.) performed with the passage shown in Figs. (3) and (4) can be found elsewhere [10]. In the referred work [10], the name of the channel shown in Figs. (3) and (4) was channel P1.

As happens in granular beds [13-16], the flow in chevron-type passages is highly tortuous, see Fig. (4). Fernandes et al. [9] estimated the tortuosity coefficient in chevron-type plate heat exchanger passages. The tortuosity coefficient was estimated (in fully developed laminar flow)

using the ratio between the average interstitial velocity Fig. (4) in a unitary cell Fig. (3) and mean velocity, u [9, 10]:

$$u = \frac{M_v}{wb} \tag{3}$$

M_v being the volumetric flow rate. The influence of γ and β on the tortuosity coefficient, τ , was translated by the following relation [9]:

$$\tau = 1 + 0.5 \sqrt{\left(\frac{1}{\sin(\beta)}\right)^\gamma - 1} \tag{4}$$

The coefficient K from the Fanning friction curves equations $f Re = K$ (laminar flow) were easily determined [9], f and Re being the Fanning friction factor and Reynolds number [9, 10], respectively. Using coefficient K and τ , the shape factor, K_0 , was estimated since K is given by [9]:

$$K = K_0 \tau^2 \tag{5}$$

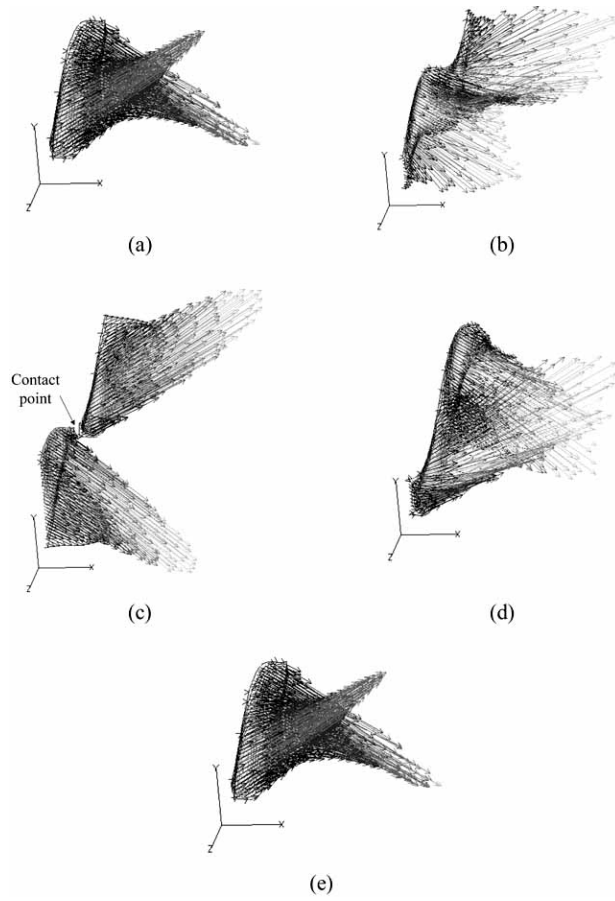


Fig. (4). Velocity vectors in different planes. (a) $x^* = 0$; (b) $x^* = 0.25$; (c) $x^* = 0.5$; (d) $x^* = 0.75$; (e) $x^* = 1$.

The shape factor was related with γ and β using the following expression [9]:

$$K_0 = 16 \left(\frac{90}{\beta} \right)^{0.6554 - 0.0929\gamma} \quad (6)$$

Analysing equations (4) and (6), it is possible to conclude that K_0 and τ increase with the decrease of the value of β . The tortuosity coefficient increases with the increase of γ , K_0 being weakly influenced by this parameter. Due to this, coefficient K (see Eq. (5)) increases with the decrease of β and increase of γ [9].

The tortuosity coefficient is used by plate heat exchanger producers (CIAT) [17] in order to determine friction factors and convective heat transfer coefficients. It is important to note that the model from CIAT [17] was developed resorting to an analogy [18] developed for fixed beds and that the complex $K = K_0 \tau^2$ (Eq. (5)) is well known in the granular beds area [13-16] as Kozeny's coefficient. The similitude between the flow and heat transfer in chevron-type plate heat exchangers passages and granular beds was also emphasized by Edwards *et al.* [19]. The heat transfer and pressure drop correlations from Edwards *et al.* [19] are present in the extensive literature survey recently performed by Ayub [5],

this literature survey including heat transfer and pressure drop correlations for different flow regimes.

3. NEW PLATES FOR PLATE HEAT EXCHANGERS

In order to obtain a higher number of transfer units (NTU-VALUE) than that from conventional chevron-type plates Figs. (2) and (3), Bojesen [20] disclosed the inclusion of a series of dents/indents, recesses/protrusions and/or additional corrugations in the surface of conventional chevron plates Fig. (5). In Fig. (5), it shows the location of protrusions (16) and recesses (17) and contact points (15), these points being generated by the conventional corrugations ((12) and (13)) when two plates are pressed together to form a channel. The projections (16) and recessions (17) are located between the contact points (15).

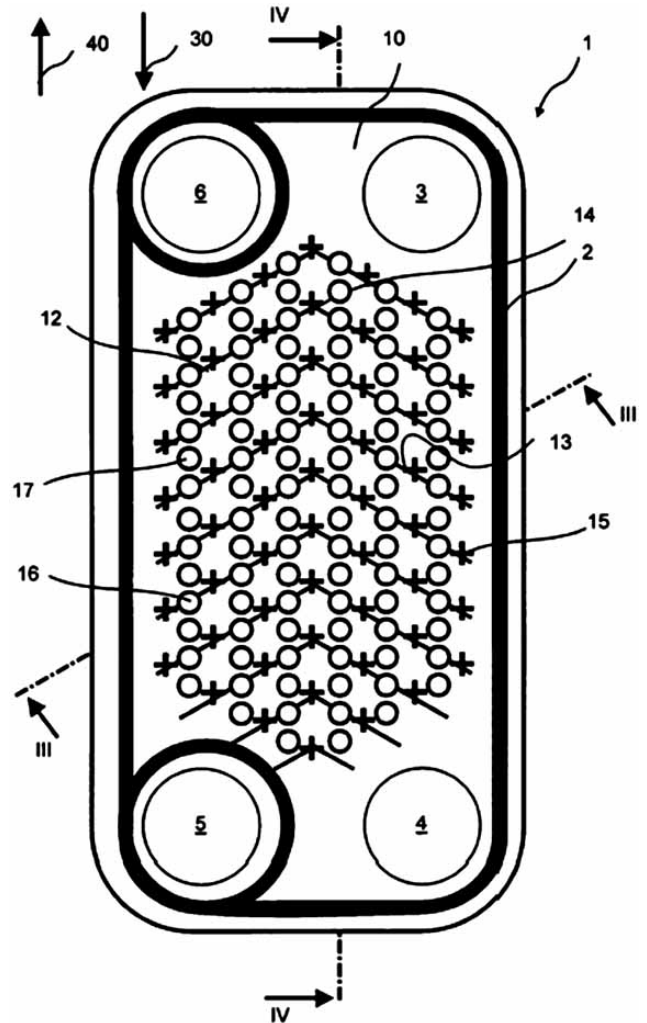


Fig. (5). Schematic top view of a heat exchanger plate (for the complete description of the numbers see [20]).

The difference between conventional chevron-type plate heat exchangers channels and the channels obtained with the disclosed plates may be better seen in Fig. (6), these figures showing a schematic sectional view in the direction of arrow 30 (main flow direction), along line IV-IV (Fig. (5)). Observing Fig. (6c) it can be induced that the fluid passing through the disclosed passage Fig. (6a) has to change its flow direction much more (higher tortuosity coefficient [9])

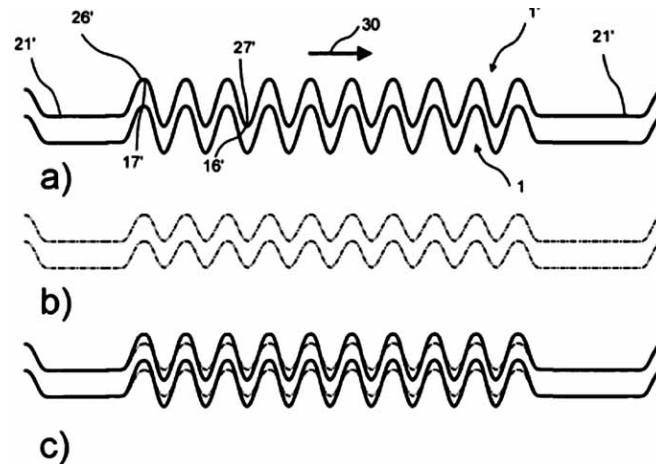


Fig. (6). Schematic sectional view along line IV-IV from Fig. (5). (a) embodiment of the invention; (b) conventional chevron-type passage; (c) difference between the embodiment of the invention and the conventional chevron-type passage (for the complete description of the numbers see [20]).

than by flowing through a conventional passage Fig. (6b). This happens due to the presence, in the disclosed passage, of protrusions (26') and recesses (27'). In the patent [20] it is referred that by providing modifications as shown in Fig. (6), the NTU-VALUE can be surprisingly increased (more than 5%). The NTU-VALUE is a measure of the heat transfer surface area requirements for a given heat duty or size of the heat exchanger [3] and can be calculated by UA/C_{min} ; U , A and C_{min} being the overall heat transfer coefficient, heat transfer surface area and minimum fluid stream heat capacity, respectively.

In order to promote the production of a turbulent flow through all, or the major part, of a passage defined by two heat exchanger plates, Rausing [21] disclosed the use, see Fig. (7), of turbulent-promoting protrusions (spherical, ellipsoid, waves or grooves), these protrusions (4) containing a surface profile (6) that also promotes turbulence. The surface profile consists of spherical or ellipsoid segments, concavely or convexly arranged relative to the protrusions. When the protrusions are hemispherical and the surface profile is concavely arranged, this complex may be compared to the surface of a golf ball [21].

The fact that the surface profile consists of spherical or ellipsoid segments contributes to the heat exchanger plate not having any sharp edges or corners that can create dead spaces which conventional cleaning methods cannot reach [21]. The author emphasizes that soft geometric transition is most important from the aspect of hygiene since plate heat exchangers when used in the food industry require frequent and very careful cleaning. Any sharp geometric transitions can form growth zones for bacteria and other organisms. Due to this, the author also recommends the use of a smooth geometrical transition between the flat part of the plate (1) in Fig. (7) and the protrusions (4). Besides promoting turbulence, the presence of a surface profile generates higher plates surface area [21].

In distilleries, sugar mills, paper industry, textile industry, food industry, pharmaceutical industry, etc., the

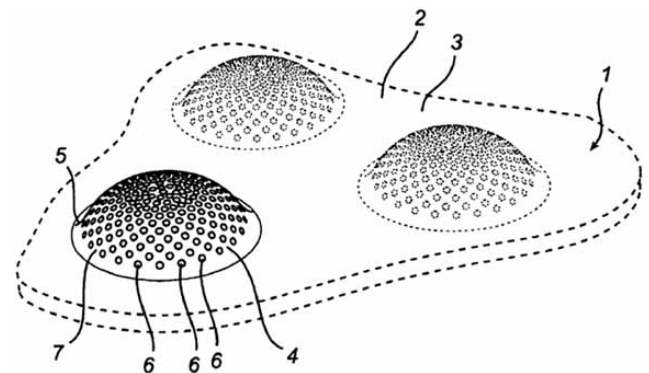


Fig. (7). Schematic protruberances (4) and turbulent-promoting surface profile (6) (for the complete description of the numbers see [21]).

fluids processed in plate heat exchangers can be very viscous and contain particles, fibres or other difficult components [22]. Due to this, Gustafsson [22] developed a porthole, see Figs. (2) and (8), that mitigates the attachment of particles or fibres to the porthole edge (19) in Fig. (8). Close to the porthole (18), in the area between the gasket groove (23) and the porthole edge there is a corrugation which forms a wall towards the gasket groove which ensures that the gasket is held in place in the gasket groove. It is important to note that the referred corrugations are, normally, also present in the portholes without O-Ring gasket porthole I and II in Fig. (2), and that conventional portholes contain the referred corrugation in the entire perimeter. In order to reduce the risk that particles or fibres get attached to the porthole edge, Gustafsson [22] designed a porthole which is characterized in that the first edge portion (19') in Fig. (8) has a corrugation and that the second edge portion (19'') has a substantially flat shape.

After the introduction of a heat exchange fluid from the inlet porthole (porthole I in Fig. (2a), for instance), the distribution area promotes the expansion of the flow to the entire width of the heat transfer area [23]. When the fluid is

heating in heat recovery systems, refrigeration interchangers, and heaters of organic chemicals, vegetable oil, steam, and batch reactors [3].

In the semi-welded plate heat exchangers it is built a sealed (laser beam) passage (a plate cassette [5] containing two welded plates) for the aggressive media while the service medium flows outside the welded plate cassette, in a conventional gasketed plate heat exchanger passage. In the plate cassettes the ports have to be sealed with O-Ring gaskets, but despite of this, there is a reduction of 90% of the gasket length necessary for the aggressive media [4, 5]. The semi-welded plate heat exchanger is therefore partially dismantlable, the maximum operating temperatures and pressures being at the same level of the conventional gasketed plate and frame heat exchangers [3-5]. In the chemical industries, these equipments are usually preferred for fluids which are aggressive, toxic, inflammable, environmentally harmful, and/or for critical operating conditions because of the drastic reduction of the gasket length required [4]. Typical applications of all-welded plate heat exchangers in the chemical industry are coolers of acetic acid, sulphuric acid and organic solutions, thermal oil coolers and, cooling of polymers as well as condensers of steam, ammonia, or hydrocarbons mixtures arranged as head condenser of distillation columns [4]. Other applications include evaporation and condensation in refrigeration and air-conditioning systems [3].

The double-wall plate heat exchanger contains double plates, sealed by conventional gaskets, which replace the single plate that usually separates two streams. They are many times designed for a reacting media and if this aggressive media reacts with the surface of the double-wall plates, the leakage is directed in the passages between the double plates [3]. Other applications of double-wall plate heat exchanger include, among others, heating and cooling of drinking water, pharmaceutical media, lubricating oil, and transformer oil [3].

In the invention from Rehberg [40], it is disclosed a plate heat exchanger comprising a stack of double-walled heat exchanger plates with which the search for leaks is facilitated, see Fig. (10). The two plate members ((33) and (34)) are in close mutual engagement in the heat transfer area (35) and this is continued in an edge portion (36) which is upwardly bent with the respect of the heat transfer area (35). Neighbouring double-plates ((31) and (32), for instance) are connected by soldering material (39) in the area of their upwardly bent portions (36). Since there is a spacing (37) between the outer edges ((33a) and (34a)) of a double-plate, any fluid getting between the two plate members ((33) and (34)) will become visible (region (38)) from outside and, therefore, be seen by monitoring or operating staff [40].

4. CURRENT & FUTURE DEVELOPMENTS

Shell and plate heat exchangers [5, 41-43] were recently introduced in the market, being composed by round welded plates inserted in a shell [5, 41-43]. These equipments combine the advantages of shell and tube and plate and frame technologies, i.e., the high mechanical integrity of shell and tube (up to and beyond 400 bar and 800°C [44])

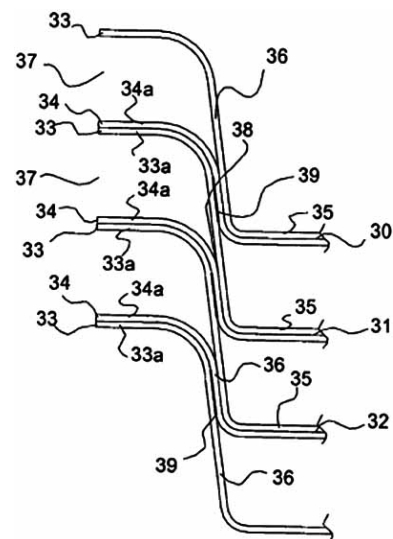


Fig. (10). Schematic sectional view of an edge portion of a plate heat exchanger (for the complete description of the numbers see [40]).

and the superior thermal performances of plate and frame [5, 41]. Kontu and Virtanen [42] disclosed several new uses for shell and plate heat exchangers. In order to achieve that, the referred authors suggested the use of plates, shell and inlet/outlet passages made of carbon steel, a cheap and abundant material.

The already rich selection guides [3] of plate heat exchangers will continue to be enriched with products such as the 100% stainless steel fusion bonded plate heat exchangers, these equipments being much more durable compared to brazed plate heat exchangers. During the manufacture of fusion bonded plate heat exchangers, two plates of stainless steel are fused together at a temperature close to their melting point. This allows the new stainless steel filler material (used in the bond) to fuse with the metal [45]. In this way, a final product is produced that is made of 100% stainless steel [45], the properties (maximum operating temperatures and pressures, corrosion resistance, etc.) of these new heat exchangers being similar to all-welded units. This technology also opens doors to applications where neither copper nor nickel (used in conventional brazed plate heat exchangers) can be used for health or environmental reasons.

In years to come, with increased choice of better heat exchange equipment, the impetus of adopting equipment that a different industry already uses will decrease [44].

5. ACKNOWLEDGEMENTS

The kind assistance provided by Mr. Johan Persson (Alfa Laval, Lund, Sweden) is greatly appreciated.

REFERENCES

- [1] Mota M, Empis J, Teixeira J. Biotechnology in the food industry. Lisbon, Federation of the Portuguese food industries 1999: 1-38.
- [2] Kakaç S, Liu H. Heat exchangers selection, rating, and thermal design. Florida, CRC Press 2002: 373-412.
- [3] Wang L, Sundén B, Manglik RM. Plate heat exchangers: Design, applications and performance. Southampton, WIT Press 2007: 1-6.

- [4] Reppich M. Use of high performance plate heat exchangers in chemical and process industries. *Int J Thermal Sci* 1999; 38: 999-1008.
- [5] Ayub ZH. Plate heat exchanger survey and new heat transfer and pressure drop correlations for refrigerant evaporators. *Heat Transfer Eng* 2003; 24: 3-16.
- [6] Palm B, Claesson J. Plate heat exchangers: Calculation methods for single-and two-phase flow. *Heat Transfer Eng* 2006; 27: 88-98.
- [7] Fernandes CS, Dias RP, Nóbrega JM, Afonso IM, Melo LF, Maia JM. Simulation of stirred yoghurt processing in plate heat exchangers. *J Food Eng* 2005; 69: 281-290.
- [8] Fernandes CS, Dias RP, Nóbrega JM, Afonso IM, Melo LF, Maia JM. Thermal behaviour of stirred yoghurt during cooling in plate heat exchangers. *J Food Eng* 2006; 76: 433-439.
- [9] Fernandes CS, Dias RP, Nóbrega JM, Maia JM. Laminar flow in chevron-type plate heat exchangers: CFD analysis of tortuosity, shape factor and friction factor. *Chem Eng Proc* 2007; 46: 825-833.
- [10] Fernandes CS, Dias RP, Nóbrega JM, Maia JM. Friction factors of power-law fluids in chevron-type plate heat exchangers. *J Food Eng* 2008; 89: 441-447.
- [11] Heggs PJ, Sandham P, Hallam RA, Walton C. Local heat transfer coefficients in corrugated plate heat exchanger channels. *Trans Inst Chem Eng* 1997; 75: 641-645.
- [12] Kumar H. The plate heat exchanger: Construction and design. *Proceedings 1st UK National Conference on Heat Transfer*, United Kingdom (1984).
- [13] Dias RP, Fernandes CS, Teixeira JA, Mota M, Yelshin A. Permeability analysis in bi-sized porous media: Wall effect between particles of different size. *J Hydrol* 2008; 349: 470-474.
- [14] Dias RP, Fernandes CS, Teixeira JA, Mota M, Yelshin A. Permeability and effective thermal conductivity of bi-sized porous media. *Int J Heat Mass Transfer* 2007; 50: 1295-1301.
- [15] Dias RP, Teixeira JA, Mota M, Yelshin A. Tortuosity variation in low density binary particulate bed. *Sep Purif Technol* 2006; 51: 180-184.
- [16] Dias RP. Size fractionation by slalom chromatography and hydrodynamic chromatography. *Recent Patents on Engineering* 2008; 2: 95-103.
- [17] Charre O, Jurkowski R, Bailly A, Meziani S, Altazin M. General model for plate heat exchanger performance prediction. *J Enhanced Heat Transfer* 2002; 9: 181-186.
- [18] Carman PC. Fluid flow through granular beds. *Trans Inst Chem Eng* 1937; 15: 150-166.
- [19] Edwards MF, Vaie AAC, Parrott DL. Heat transfer and pressure drop characteristics of a plate heat exchanger using Newtonian and non-Newtonian liquids. *Chem Eng* 1974; 293: 286-288.
- [20] Bojesen, C.: WO08071356A1 (2008).
- [21] Rausing, H.: US20070144711A1 (2007).
- [22] Gustafsson, H.: WO07142590A1 (2007).
- [23] Matsuzaki, T., Tagata-Gun, S.-K.: EP1813901A2 (2007).
- [24] Kho TK, Müller-Steinhagen H. An experimental and numerical investigation of heat transfer fouling and fluid flow in flat plate heat exchangers. *Trans Inst Chem Eng* 1999; 77: 124-130.
- [25] Thonon B, Grandgeorge S, Jallut, C. Effect of geometry and flow conditions on particulate fouling in plate heat exchangers. *Heat Transfer Eng* 1999; 20: 12-24.
- [26] Blomgren, R., Krantz, J.: WO07004939A1 (2007).
- [27] Brown, D.C., Murray, R.: US4046305 (1977).
- [28] Wagner, N.: US4140266 (1979).
- [29] Wagner, N.: US4231508 (1980).
- [30] Rassmus, J.E.J., Sjodin, P.E.: US20080127494A1 (2008).
- [31] Martin, M.A., Vanderwees, D.: US20087404434B2 (2008).
- [32] Mathur, A.P., Gu, C., Fulmer, J.M.: US20036516874B2 (2003).
- [33] Stewart, R.C., Johnson, C.K., Bonville, L.J.: US4606495 (1986).
- [34] Jha, S.C., Forster, J.A.: US5553770 (1996).
- [35] Johansson, B.: US4359087 (1982).
- [36] Berntell, J.O., Jennfors, R.W., Kihlberg, Y.R.: US4396057 (1983).
- [37] Bond, M.P.: US4372375 (1983).
- [38] Martin, J.J.: US4431050 (1984).
- [39] Blomgren, R., Anderson, J., Nilsson, M.: WO9315369 (1993).
- [40] Rehberg, P.: US20077204297B2 (2007).
- [41] Ayub ZH. Are we on the right track? *Heat Transfer Eng* 2003; 24: 1-2.
- [42] Kontu, M.O., Virtanen, M.: WO08046952A1 (2008).
- [43] Mathur, A.P., Fulmer, J.M.: US20067004237B2 (2006).
- [44] Stehlik P, Wadekar VV. Different strategies to improve industrial heat exchange. *Heat Transfer Eng* 2002; 23: 36-48.
- [45] Sjodin, P., Rassmus, J.: US20080199718A1 (2008).