

RI-30
Loan Copy
3
extra
INVESTIGATION NO. 30

1956

STATE OF ILLINOIS

WILLIAM G. STRATTON, *Governor**Handwritten signature or initials, possibly "H.A."***TRENDS IN
RESIDENTIAL WATER USE**

BY

ROSS HANSON

H. E. HUDSON, JR.

DEPARTMENT OF REGISTRATION AND EDUCATION

VERA M. BINKS, *Director*

STATE WATER SURVEY DIVISION

WILLIAM C. ACKERMANN, *Chief*

URBANA, ILLINOIS

[Printed by the authority of the State of Illinois]

STATE OF ILLINOIS

WILLIAM G. STRATTON, GOVERNOR



TRENDS IN RESIDENTIAL WATER USE

BY

ROSS HANSON

H.E. HUDSON, JR

DEPARTMENT OF REGISTRATION AND EDUCATION

VERA M. BINKS, DIRECTOR

STATE WATER SURVEY DIVISION

WILLIAM C. ACKERMANN, CHIEF

URBANA, ILLINOIS

TABLE OF CONTENTS

| | <u>Page</u> |
|-----------------------------------------------------------------------|-------------|
| SUMMARY. | 7 |
| ACKNOWLEDGMENTS.. . . . | 7 |
| INTRODUCTION. | 9 |
| COLLECTION OF DATA. | 9 |
| POPULATION AND HOUSING. | 11 |
| Persons Per Household. | 11 |
| Number of Households. | 11 |
| Proportion of Population Served. | 12 |
| Projections of Urban Population and Households. | 12 |
| RESIDENTIAL WATER USE. | 14 |
| Water-Use Data in Some Illinois Communities. | 14 |
| A and C. | 14 |
| D and E. | 14 |
| F, G and I. | 15 |
| H and J. | 17 |
| Public Reaction to Restrictions in Some Illinois Communities. | 17 |
| Water-Using Appliances in the Home. | 18 |
| Residential Water Use - Effective Family Buying Income | 18 |
| Projections of Residential Water Use in Illinois Communities. | 19 |
| REFERENCES. | 22 |

TABLE OF CONTENTS (Continued)

ILLUSTRATIONS

| | <u>Page</u> |
|-------------------------------------------------------------------------------------------------------------------------|-------------|
| <u>Figure</u> | |
| 1 State of Illinois. | .8 |
| 2 Persons per household - United States and Illinois | .10 |
| 3 Persons per household - D, K, and J. | .10 |
| 4 Persons per household, and numbers of households, United States and Illinois. | .11 |
| 5 Per cent of dwelling units with piped running water in United States and Illinois - Urban and Rural. | .11 |
| 6 Projections Population and Households - United States | .12 |
| 7 Projections Population and Households - Illinois | .13 |
| 8 Residential gallons-per-service, gallons-per-capita and per cent of population served - Communities A and C. | .13 |
| 9 Residential gallons-per-service, gallons-per-capita and per cent of population served - Communities D and E. | .14 |
| 10 Residential gallons-per-service, gallons-per-capita and per cent of population served - Community F. | .15 |
| 11 Residential gallons-per-service, gallons-per-capita and per cent of population served - Communities G and I. | .15 |
| 12 Residential gallons-per-service, gallons-per-capita and per cent of population served - Communities H and J. | .16 |
| 13 Effective family buying income _ Residential gallons-per-service per day. | .18 |
| 14 Residential water use _ Four Illinois towns 15,000-50,000 population. | .20 |
| 15 Residential water use - Five Illinois towns less than 10,000 population. | .21 |

TABLE OF CONTENTS (Continued)

TABLES

| | <u>Page</u> |
|------------------------------------------------------------------------------------|-------------|
| <u>Number</u> | |
| 1 Projections - persons per household and urban households in United States. . . . | 13 |
| 2 Projections - persons per household and urban households in Illinois | .13 |
| 3 Per cent of total pumpage - Community D. | .15 |
| 4 Per cent of total pumpage - Community F. | .16 |
| 5 Per cent of total pumpage - Community G. | .16 |
| 6 Per cent of total pumpage - Community I. | .16 |
| 7 Per cent of total pumpage - Community H. | .17 |
| 8 Per cent of total pumpage - Community J. | .17 |
| 9 Electrical water-using appliances in United States and Illinois homes | .18 |
| 10 Effective family buying income - Residential water use. | .18 |

APPENDIX

| | |
|------------------|----|
| <u>Community</u> | |
| A | 24 |
| C | 25 |
| D | 26 |
| E | 27 |
| F | 28 |
| G | 29 |
| H | 30 |
| I | 31 |
| J | 32 |

SUMMARY

In addition to the changing number of persons-per-household unit, which has undoubtedly resulted in a changed pattern of water use, and in addition to the increasing proportion of the urban population that has running water service, there are other factors to be considered in future planning of public water-supply systems.

A very important factor is the increasing installation of appliances that cause more water to be used in homes. These include dishwashers, food waste disposers, water heaters, and automatic and conventional washing machines. The installation of these units has been concentrated mainly in the higher-income communities, which are generally the larger communities of Illinois. These communities have frequently displayed large increases in residential water use over the past 15 years in spite of the fact that there was no material increase in the proportion of the population served with running water. It is believed that these water-using devices have not yet come into wide use in the smaller communities in which incomes may be lower. Per capita residential uses have therefore commenced to increase as a result of the installation of these devices in the larger communities, but have not yet been observed in the lower-income communities. Further increases in residential water use in these communities may possibly be expected in the future as a result of this trend.

It is evident that in the larger cities, where the proportion of the population served by public water supply system has steadily approached 100 per cent, the declining number of persons per household indicates an even greater per capita use of water. While the amount of water pumped per service connection over the past several decades has not risen substantially, the actual number of persons per service has continued to decline, so that there has actually been an increase in per capita residential use of water in these cases.

It seems plausible that a method could be devised for estimating water use in communities on a more rational basis than the now-popular 100 gallons-per-capita per day. Such a method might include the adoption of a residential per-capita and/or per-service figure

plus a commercial water-use figure on a per-service basis. There appears to be no merit in compiling industrial-use figures on a per-capita basis since they will depend altogether on the types and methods of operation of the particular industries concerned in each community.

Of the nine Illinois communities studied in this report, five of them with less than 10,000 population had an average residential water use of 38 gallons-per-capita per day and 110 gallons-per-service per day.

Four of the communities with populations ranging from 15,000 to 50,000 had an average residential water use of 45 gallons-per-capita and 140 gallons-per-service.

Projecting the residential water-use requirements of these communities to 1970, the graphs indicate that towns of less than 10,000 population may reach water-use demands of as high as 50 gallons-per-capita per day and 155 gallons-per-service per day.

For communities of 15,000 to 50,000 population the residential water-use demands may reach 75 gallons-per-capita per day and 220 gallons-per-service per day.

ACKNOWLEDGMENTS

This report was prepared mainly during the administration of Dr. T. E. Larson, Acting Chief of the State Water Survey Division, and completed following the appointment of William C. Ackermann as Chief, who made helpful comments and suggestions in his review of the manuscript. Acknowledgment is given to Dr. Max Suter, H. F. Smith and Jack Bruin for their counsel and technical advice during the preparation of the report.

The authors take this opportunity to express their appreciation to water works officials of the many municipalities visited in the search for water-use data. In all cases the water records were made available and office assistance given in the collection of data from the records.

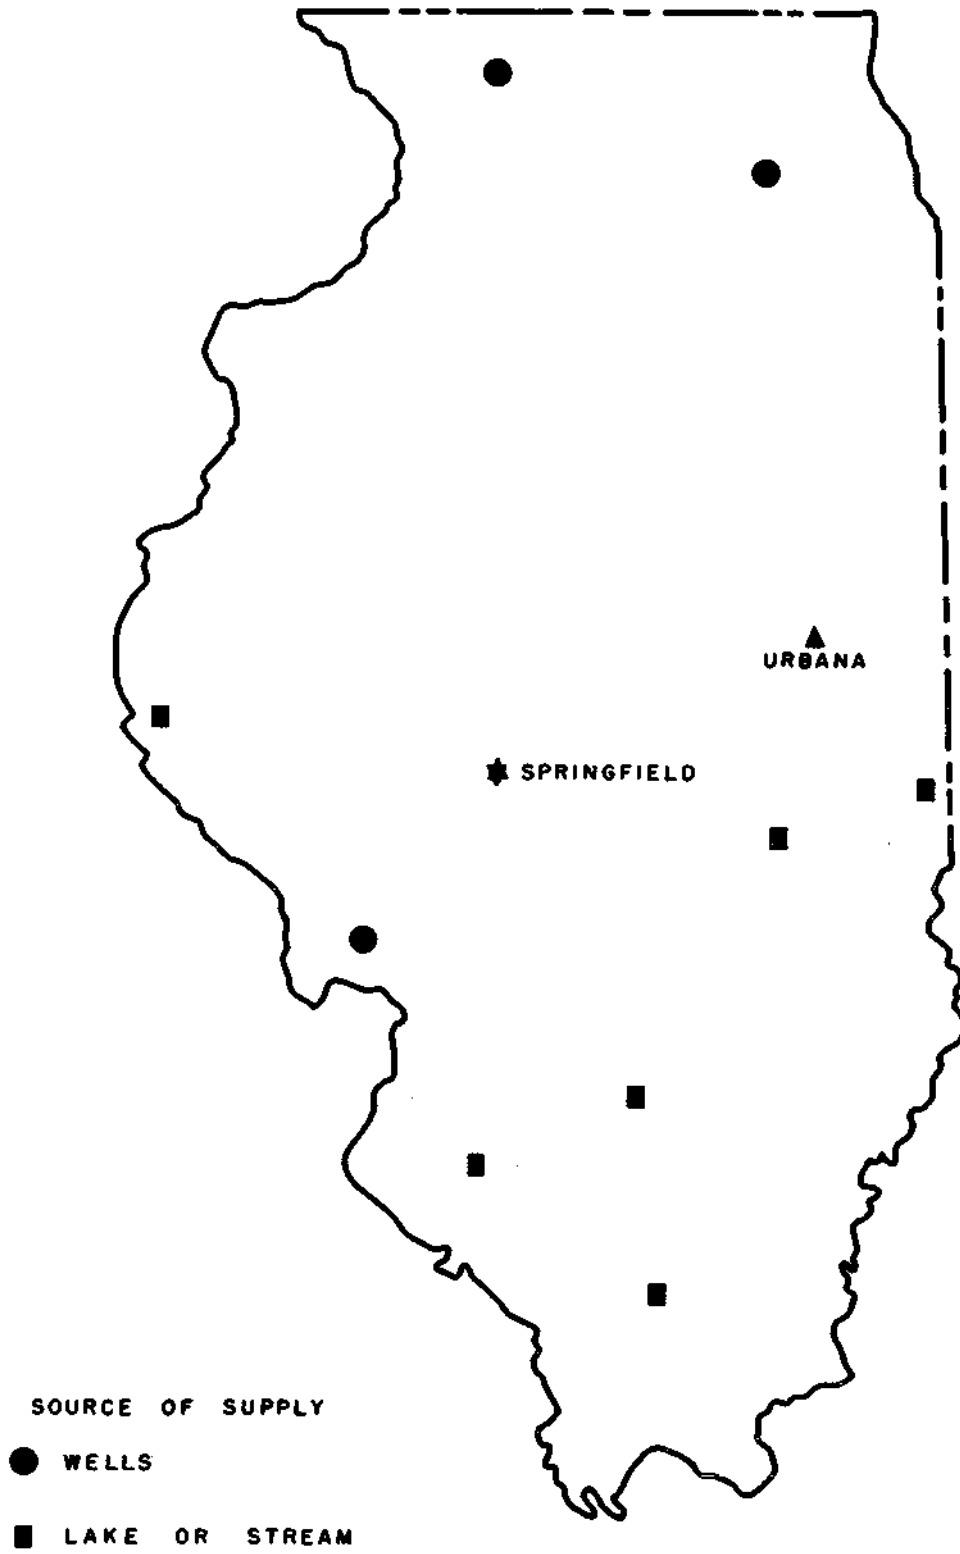


FIGURE 1

TRENDS IN RESIDENTIAL WATER USE

by

Ross Hanson, Associate Engineer, and H. E. Hudson, Jr., formerly Head, Engineering Subdivision

INTRODUCTION

It is common practice to express per capita water consumption for a given community as the quotient of the total pumpage and the census population. This method assumes that all of the water pumped gets to the users, and assumes further that all persons counted in the census are served with water from the system. The resultant figure, called per capita consumption or gallons-per-capita, may at times be completely misleading when the population served differs from the census population or when the total water used differs materially from the total pumpage. The per capita consumption figure obtained in this way is undoubtedly a useful figure, but there is accumulated under its broad cloak a variety of considerations of such importance that each should be evaluated separately.

It is the thesis of this report that water use can be better established on the basis of sales per water-service connection; that the per capita consumption can be expressed as the amount of water sold through residential users divided by the product of the number of services and the number of persons per service connection. Such figures need to be assembled for residential users separate from commercial and industrial users. There appears to be no merit in compiling industrial-use figures on a per capita basis, since they will depend altogether on the types, numbers, and methods of operation of the particular industries concerned in each community.

Data gathered by the Illinois State Water Survey in 1954 indicated that declines in water consumption per service connection were taking place in certain Illinois communities over the period 1920 to 1953. Compared to reports from other parts of the country this indication seemed so unreasonable that further study was initiated. The study showed that changes in per capita consumption had been masked by two factors: (1) the declining number of persons per household, and (2) the increasing proportion of the community population served. The study also indicated that several other factors heretofore omitted from consideration play a role in the estimation of water use in homes served by public water supplies.

For the 1954 study, information was gathered

from a number of communities in Illinois that were encountering difficulty with water supply adequacy, presumably due to the drought. A preliminary report on this work was given in a separate publication⁽¹⁾, but the data from the 1954 study were, in some respects, incomplete in extent and in detail, lacking sufficiency for a reasonable analysis. Accordingly, information was sought from other communities selected throughout the State where fairly adequate records were thought to be available. These were later sifted down to the nine communities distributed over the State, as shown in Figure 1, which also indicates the type of source of supply used. Four of the communities relied on groundwater, and five of them on surface water. The communities are identified in the text and in the Appendix by a letter of the alphabet.

Of the 819 public water systems in Illinois in 1955, approximately 7 per cent are privately owned. This study does not cover any of the privately-owned water systems.

There may be some bias in the sampling, for all of the communities finally selected had water supply administrations that had maintained reasonably detailed records in recent years, which indicates that they were probably better operated than the general average. Data for the years 1940 to 1955 were available in most cases, and some earlier records were available.

In the Appendix at the end of this report, each tabulation, under an identification letter, shows the census and physical data collected for each municipality, together with the results obtained from analysis of the data.

COLLECTION OF DATA

The information sought from each community's water supply operation included the total pumpage, the number of services, and the sales of water to each of the following categories: (1) total, (2) residential, (3) commercial, (4) industrial. In addition, information was sought on sales to water haulers, and on "free" water to municipal offices, parks, playgrounds, drinking fountains, etc. Little information was obtained on sprinkling and air-conditioning loads.

In all cases the communities metered the sales of water to almost all accounts, so that a breakdown of sales into the several categories could be obtained. The available data also made possible the determination of gallons-per-day per service in each of the various categories.

In addition, master-metering of the entire pumpage was considered an important item in order to enable the determination of "unaccounted-for" water, but data on unaccounted-for water were not always available. In some cases estimates were applied for this.

For each community, the census population statistics were available, together with census values for 1940 and 1950 on the number of occupied dwelling units. These figures could be compared with total residential services.

Wherever a substantial proportion of the water-service connections were outside the corporate limits of the community, these were added to those facilities within the corporate limits. In such cases, the total number of

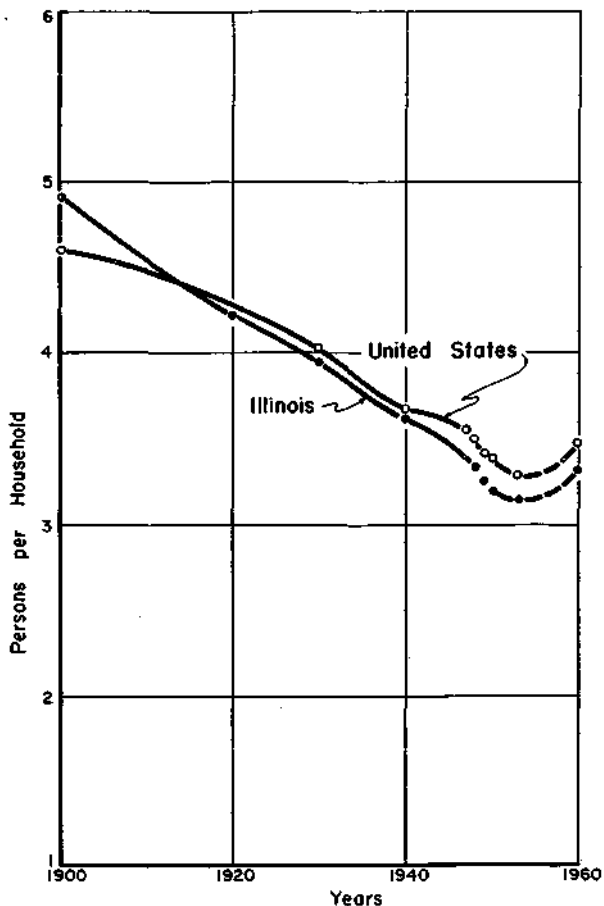


FIGURE 2

services shown for the water system include the services outside the community; and the population, total pumpage, and sales figures also include the number of persons and the quantities of water involved outside the corporate limits. In several instances this was an important factor since several of the systems furnished water to subdivisions outside the corporate limits. Others furnished water to nearby municipalities of considerable size.

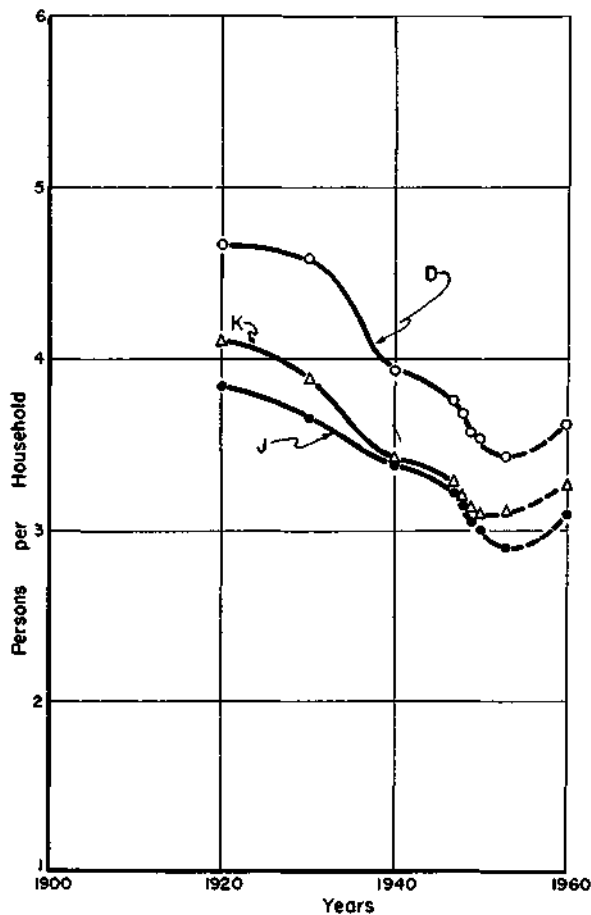


FIGURE 3

Data from census publications from the United States and the State of Illinois proved very useful. Whereas, prior to the 1950 census, dwelling units in unincorporated places outside corporate limits had been classified as "rural"⁽²⁾ in the 1950 census, dwellings in urban fringe areas were classified as "urban." The census reports gave information on the number of persons per household (size of family), the number of households, trends in population, the relationship between urban and rural populations, the proportion of the urban population served by public water supplies, and the number of dwelling units in the community that had running water inside the household.

POPULATION AND HOUSING

Persons Per Household

The very rapid increase in household formation in the late forties leads to curiosity about the size of family units. Beginning with the 1940 decennial report, the United States Bureau of the Census provided information on the number of persons per household. The values given seem to compare reasonably well

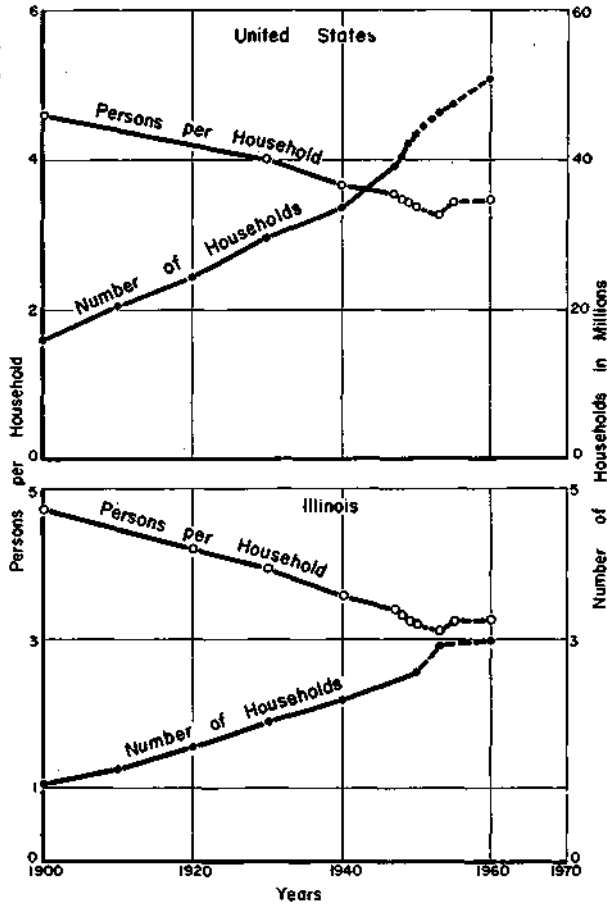


FIGURE 4

with the data available in earlier censuses on persons per family^{(3) (4)}.

Figure 2 gives the number of persons per household for the period 1900 to 1960, for the entire nation as enumerated and projected by the Bureau of the Census. The data show a very marked decline in the number of persons per household for the period 1900 to 1953. The greatest rates of change are shown to have occurred in the period after 1946. It will be noted that the number of persons per household in the United States as a whole declined 30 per cent in the period 1900 to 1953. In the corresponding period, the decline in Illinois was 35 per cent.

Data on persons per household were also available through 1950 for the several communities in Illinois which are the basis of this study. The curves for these communities have been prepared from data available in the decennial census reports from 1920 to 1950, and the subsequent projections were drawn from predictions in inter-censal reports of the Bureau of the Census for the State of Illinois. Figure 3 shows the graphs for three of the communities. They reveal trends similar to the national and state trends. Studies of other communities within the State reveal even more marked variation.

Number of Households

One of the biggest problems facing public water-supply systems is furnishing service to new accounts. The Bureau of the Census decennial census reports and certain special inter-censal publications on populations^{(5) (6)} contain pertinent information on trends in the number of households. They reveal that the number of private households in the United States increased at a much more rapid rate

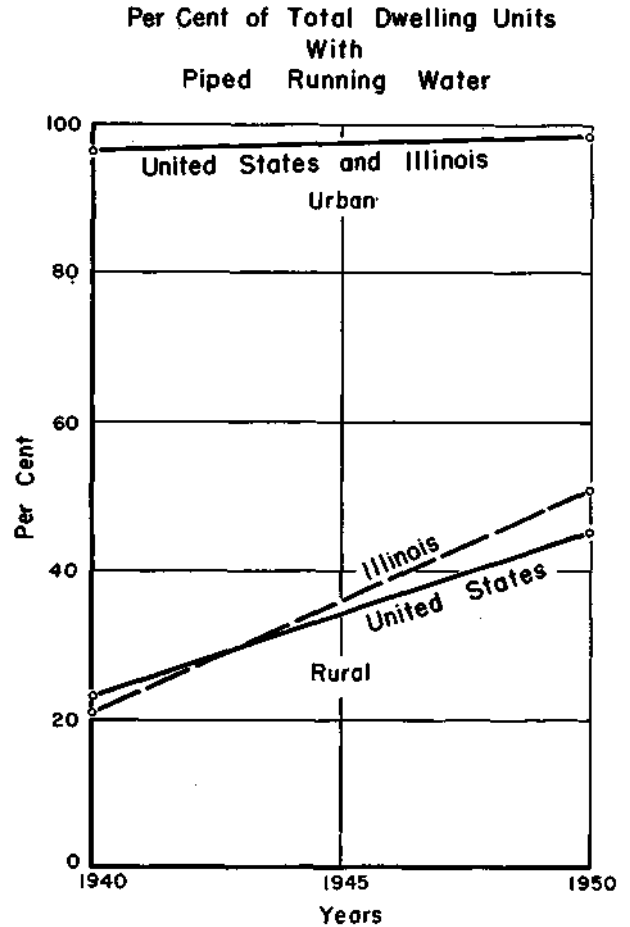


FIGURE 5

than the population from 1940 to 1950 and the average size of household consequently showed a substantial decline⁽⁷⁾⁽⁸⁾.

The decline in household size occurred despite the high birth rate during the 10-year period. The effects of a high birth rate were more than offset by the effects of the high marriage rate and other factors that tended to increase the number of households⁽⁸⁾. In 1950, about 5.6 per cent of the married couples had not established their own households but were sharing the living quarters of other persons or were living in hotels, rooming houses, or other quasi-households. Corresponding percentages for earlier years were 6.8 per cent in 1940 and 6.1 per cent in 1930⁽⁸⁾. Taking into account low birth rates during the depression years of the 1930s, the increasing average length of life and the growing tendency for older persons to maintain their own households into old age, the Bureau of the Census observed that, "The indicated trend in household and family formation is generally downward for the 1950s"⁽⁹⁾. Extraordinary increases in establishment of new households were observed during the postwar years 1947 to 1950, and those increases brought on many of today's water-service problems. Increases were smaller subsequently and are not expected to be as high in the near future.

The census projections indicate (Figure 4) the number of households in the United States will rise from 45.5 million in April 1952 to 47.7 million in July 1955 and to 50.8 million in July 1960⁽⁹⁾. Subsequent census studies give additional information on rates of establishment of households⁽¹⁰⁾⁽¹¹⁾.

For Illinois the census projections indicate (Figure 4) the number of households will rise from 2.5 million in 1950 to 2.9 million in 1955 and to 3.0 million in 1960.

Proportion of Population Served

Prior to World War II, many water systems in Illinois were installed on a basis of serving only part of the population within the incorporated limits of the municipality. In some instances, the proportion served ranged from 10 to 25 per cent of the entire population. This has increased rapidly in many small communities, but in some this development is quite incomplete.

In 1940 (Figure 5), of all the urban dwelling units in the United States, 96.0 per cent had

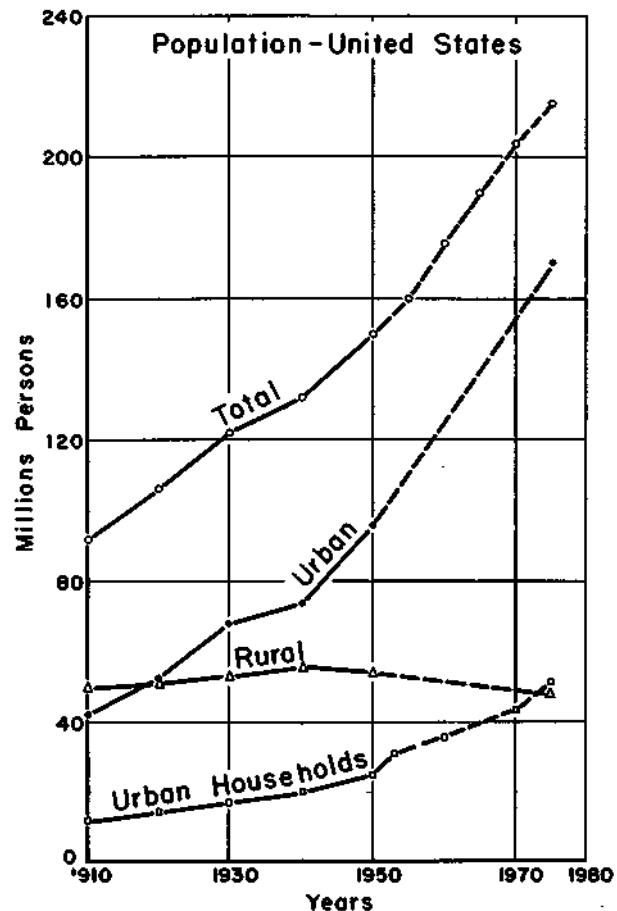


FIGURE 6

running water inside the home; in 1950, the ratio was 97.2 per cent. Most of this rise was due to increases in extension of service in communities less than 10,000 in population. This change is obviously no national problem, but it has caused grave difficulties for many small communities.

For rural homes, the picture is different. In 1940, there were 20.7 per cent of rural homes in Illinois with piped running water, and 22.7 per cent over the entire United States. In 1950, there were 51.2 per cent of Illinois rural homes equipped with piped running water, and 45.5 per cent for the United States. Here is a rapidly changing aspect of the national scene.

Projections of Urban Population and Households

The Bureau of the Census has made illustrative projections of the population of the United States (Figure 6) and of Illinois (Figure 7)⁽¹²⁾. While events of the last two decades

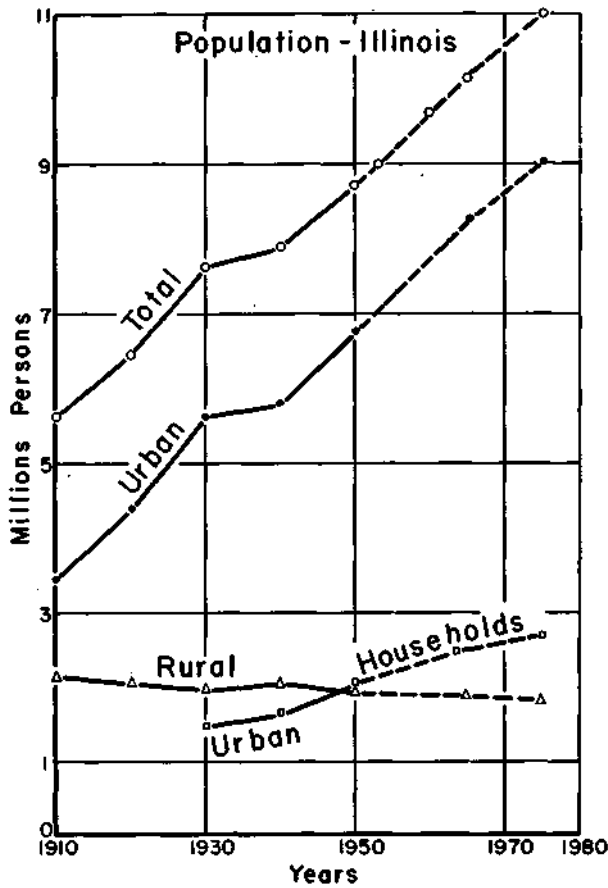


FIGURE 7

have given demographers less confidence in their forecasts than they once had, these projections are still among the best available. Estimates based on several anticipated fertility rates are provided. In addition, projections have been made both by the "component" method and the "ratio" method. The writers have used the highest of these estimates in order to provide assurance that the most demanding situation will receive consideration. Using these data, together with urban and rural total ratios projected by the writers, the urban and rural populations for the United States have been estimated to 1975.

Figures 6 and 7 indicate that an increasing proportion of the population will be living under urban conditions and will expect service from public water-supply systems.

The population forecasts can be combined with estimates of household size to yield forecasts of urban households in the United States and Illinois as shown in Tables 1 and 2 respectively.

TABLE 1

Projections - Persons per Household and Urban Households For United States

| Year | Projected Urban Population (millions) | Estimated Persons per Household | Estimated Urban Households (millions) |
|------|---------------------------------------|---------------------------------|---------------------------------------|
| 1960 | 126.0 | 3.5 | 35.0 |
| 1970 | 156.0 | 3.6 | 43.4 |
| 1975 | 170.0 | 3.6 | 47.2 |

TABLE 2

For Illinois

| Year | Projected Urban Population (millions) | Estimated Persons per Household | Estimated Urban Households (millions) |
|------|---------------------------------------|---------------------------------|---------------------------------------|
| 1960 | 7.7 | 3.3 | 2.3 |
| 1970 | 8.6 | 3.4 | 2.5 |
| 1975 | 9.0 | 3.4 | 2.6 |

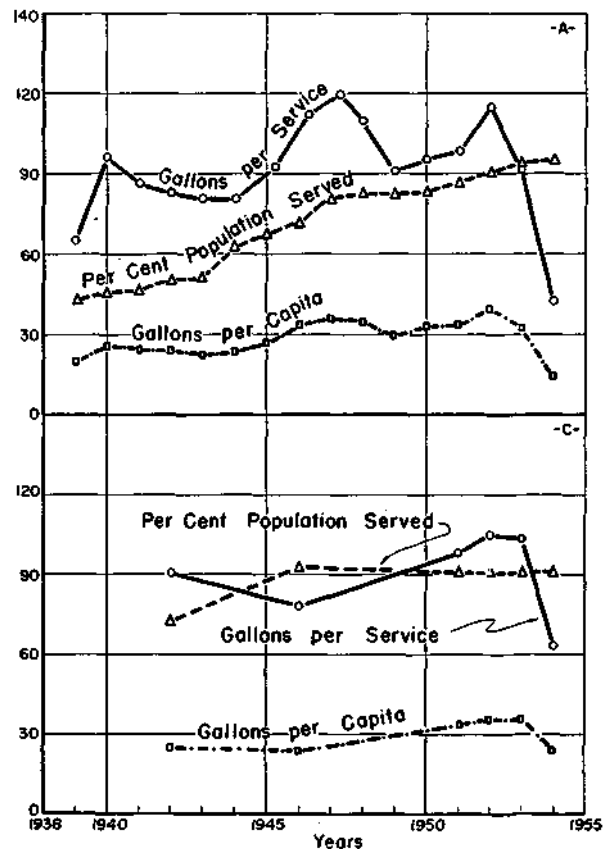


FIGURE 8

These estimates are also shown in Figures 6 and 7 together with census data on urban households for earlier years. The estimates indicate a reduced rate of increase in the number of urban households to be served by public water supplies in the coming two decades, but they also indicate a continuing growth.

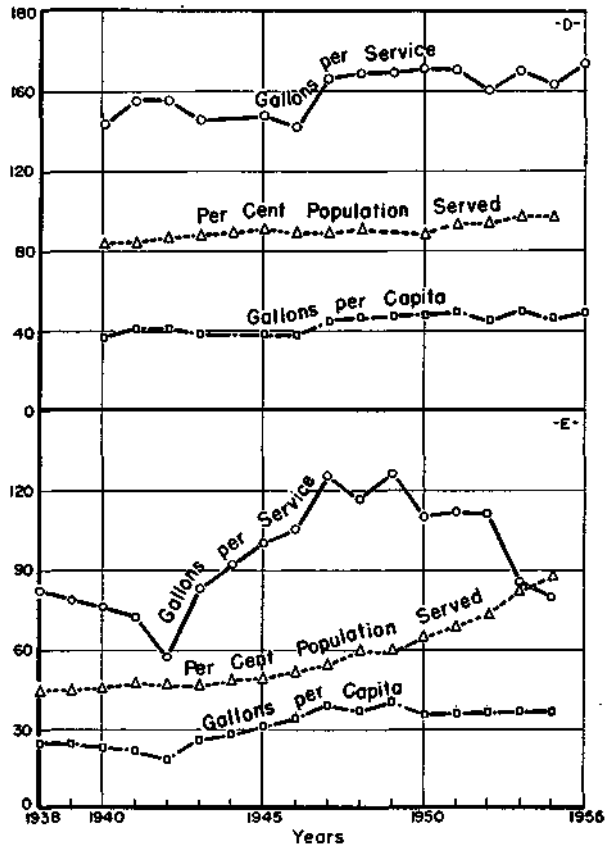


FIGURE 9

RESIDENTIAL WATER USE

Water-Use Data in Some Illinois Communities

The Bureau of the Census data and the water-use data collected from each community are tabulated on the data sheets. Appendix A, C, D, E, F, G, H, I and J include calculations of residential daily use in gallons-per-service and gallons-per-capita. A brief description of the water use in each community follows.

A and C

Figure 8 shows the results of the analysis of residential water-use data collected at two Illinois municipalities as tabulated in Appendix A and C. A and C, with populations 1600 and 5600, respectively, receive water from im-

pounding reservoirs. At A, there were slight overall increases in gallons-per-capita and gallons-per-service from the earliest records to 1952, in which year restrictions in water use were initiated due to the drought. The per cent of population served showed a gradual increase from 46 per cent of the population in 1939 to 93 per cent in 1954.

Town C showed slight increases in gallons-per-capita and gallons-per-service from 1942 to 1953. In 1953 restrictions were initiated. The per cent of population served increased sharply from 1942 to 1946 and then remained fairly level at 91 per cent to 1954. This town, a thriving coal mining community prior to 1930, suffered a population loss of 35 per cent from 1920 to 1950 because of the mines being worked out. In 1920 the number of persons per household was 4.67 or 10 per cent higher than for Illinois and the United States, but in 1950 the average was about 2.9 or 12 per cent below the Illinois and United States' averages.

Contrary to the general experience in towns where the water-use restrictions have been lifted, the residents of C discovered they could get along with the water shortage. When the reservoir began spilling over, they were not inclined to return to the basis of pre-drought use of water and the water department, with increased expenses, became plagued with an unanticipated shortage in revenue.

D and E

Figure 9 shows the results of the analysis of residential water-use data collected for municipalities D and E, (Appendix D and E), having populations at 5100 and 5700, respectively.

Town D, a residential and industrial community, receives its water supply from deep rock wells and furnishes considerable water to an adjoining municipality. The neighbor town is supplied from one meter and therefore is not included in the data on the graphs in Figure 9.

This municipal supply was installed about 1896 and by 1940 about 85 per cent of the population was being served and by 1954 about 98 per cent was using city water; and correspondingly a steady normal increase is shown in the gallons-per-service and gallons-per-capita. From 1940 to 1954 the total pumpage demand increased 160 per cent (Appendix D) and the residential consumption increased 140 per cent. Total sales increased 190 per cent. A breakdown of the total pumpage in 1940 and 1954 is shown in Table 3.

F, G, and I

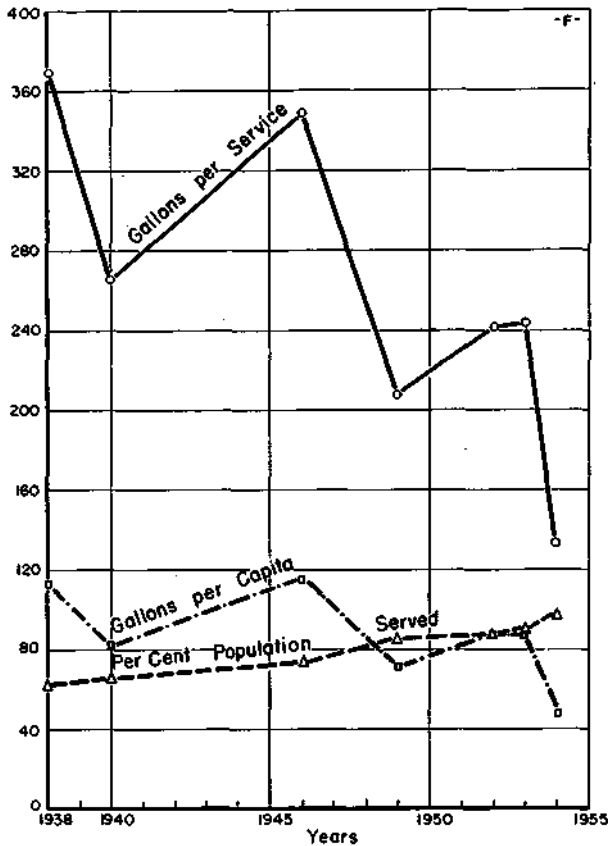


FIGURE 10

TABLE 3

| Year | Total Pumpage mgd | Residential Sales % | Per cent of Total Pumpage | | |
|------|----------------------|---------------------------|---------------------------|--------------------------|---------------------------------|
| | | | Commercial Sales % | Industrial Sales % | Unaccounted- for Losses % |
| 1940 | 0.386 | 34 | 17 | 18 | 31 |
| 1954 | 1.062 | 24 | 17 | 35 | 24 |

Restrictions were not instituted in D.

Town E is located in a prosperous agricultural area with water supply from wells and springs. The curves for residential use show gallons-per-capita and gallons-per-service comparable to those of other Illinois towns in the same population bracket. In 1952 to 1953, a noticeable decline in gallons-per-service occurred at the same time with a gradual increase in per cent of population served. However, as high as 27 per cent of the pumpage is lost through leaks in corroded water mains. In November 1953 a consulting engineer was retained and in 1954 the losses through leaks were reduced to 18 per cent. Subsequent losses were apparently not considered serious enough to warrant repair.

Figure 10 shows the water-use data analysis for F, a town of 9500 population largely composed of retired farm folks with its water supply obtained from a surface reservoir. In the early 1930s, when the customers were charged on a flat-rate basis, a record of 2.25 million gallons was pumped for one day and the annual average rate of pumping was 1.5 million gallons per day. Eight months after meters had been installed on all the services the summer peak was 0.6 mgd and the January-July average was 0.46 mgd, a drop of 66 per cent. By 1946 there was another runaway in residential water use, with an average in July of 1.1 mgd. Thereafter rates were increased 20 per cent. Again the pumpage dropped to 0.6 mgd, 45 per cent below the July 1946 average. In December 1953, full restrictions were instituted because the reservoir was depleted, not only due to the drought but also because customers were allowing water to drip to waste to prevent freezing of water pipes.

A breakdown of the total pumpage for 1940, 1946 and 1953 (before restrictions were imposed due to water shortage) is shown in Table 4.

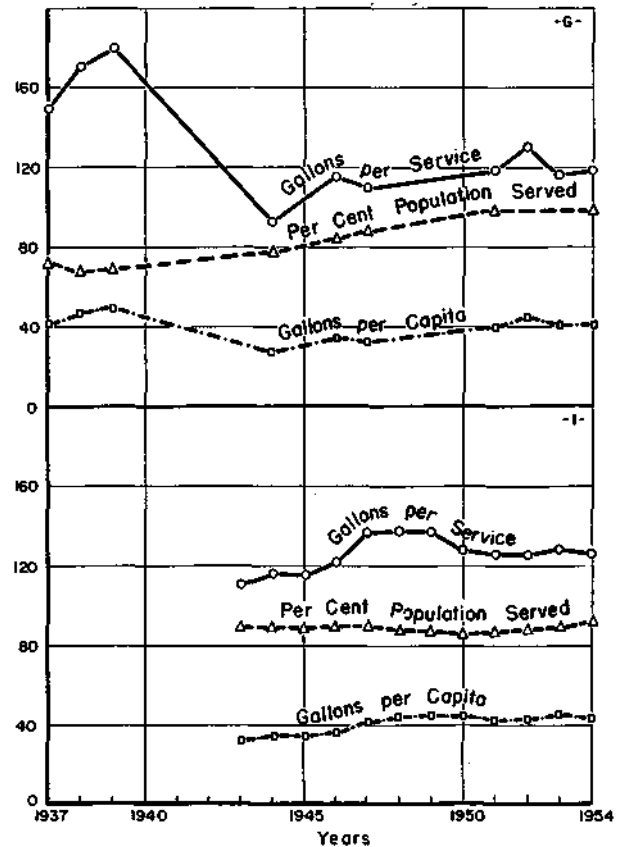


FIGURE 11

TABLE 4

| Year | Total Pumpage mgd | Per cent of Total Pumpage | | |
|------|----------------------|-----------------------------|----------------------------|--------------------------|
| | | Residen- tial Sales % | Commer- cial Sales % | Industrial Sales % |
| 1940 | 0.72 | 71 | 4 | 25 |
| 1946 | 1.03 | 80 | 3 | 17 |
| 1953 | 0.80 | 91 | 4 | 5 |

gallons-per-service dropped rapidly although there was a steady increase in the pumpage and in the number of services (Appendix G). Since 1944, the pumpage and number of services have continued to climb but the gallons-per-service and per-capita have increased only slightly.

A breakdown of the total pumpage and per cent of sales is shown in Table 5.

TABLE 5

| Year | Total Pumpage mgd | Per cent of Total Pumpage | | | |
|------|----------------------|-----------------------------|----------------------------|--------------------------|---------------------------------|
| | | Residen- tial Sales % | Commer- cial Sales % | Industrial Sales % | Unaccounted- for Losses % |
| 1937 | 1.15 | 38 | 5 | 55 | 2 |
| 1939 | 1.58 | 35 | 20 | 39 | 6 |
| 1944 | 1.94 | 20 | 21 | 57 | 2 |
| 1953 | 2.24 | 27 | 21 | 32 | 20 |

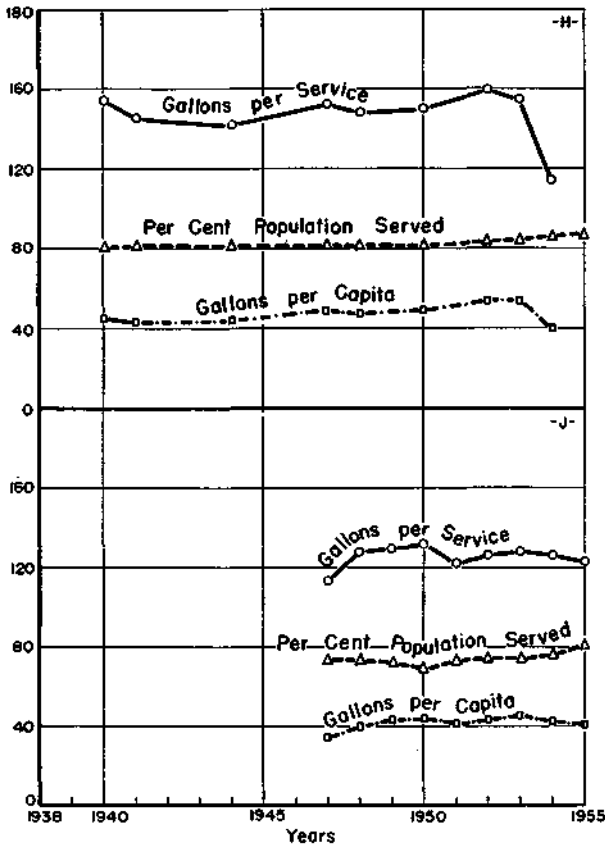


FIGURE 12

Apparently all water was charged to consumers, as no "unaccounted-for losses" were reported. About 1948 to 1950 the railroads changed from steam to diesel power, thus explaining the large reduction in industrial sale of water by the municipality.

Figure 11 shows the results of the analysis of water-use data for G and I.

G has a population of 14,000 and receives its water supply from artificial lakes. It is a railroad center and is located in the midst of a large area of coal mines, oil and gas fields.

Following 1938 and until 1944 when meters were installed on practically all services, the

The gradual decline in residential consumption to 1939 was accompanied by an increase in commercial consumption and decrease in industrial. This was followed by a further decline in residential consumption accompanied by a leveling-off of commercial and an increase to an all-time high in industrial (railroads) use during the war years. By 1953 the railroads had changed over to steam power and the industrial consumption reached an all-time low. Unaccounted-for losses mounted due to leaks in an old wooden stave pipe line. G supplies water to four small neighboring communities.

I, a manufacturing town, has a population of 23,000 which has remained approximately the same for the past twenty years after a normal growth during previous years. The water supply, obtained from an unconsolidated material and also shallow rock wells, has been adequate. Many of the industries have their own supplies for boiler purposes.

A breakdown of the total pumpage and per cent of sales is shown in Table 6.

TABLE 6

| Year | Total Pumpage mgd | Per cent of Total Pumpage | | | | |
|------|----------------------|-----------------------------|----------------------------|-------------------------------|------------------------------|------------------------------------|
| | | Residen- tial Sales % | Commer- cial Sales % | Indus- trial Sales % | Free (Public Use) % | Unaccounted- for Losses % |
| 1943 | 1.60 | 41 | 15 | 19 | 15 | 10 |
| 1947 | 2.03 | 41 | 15 | 24 | 12 | 8 |
| 1950 | 1.97 | 42 | 15 | 23 | 12 | 8 |
| 1953 | 2.18 | 41 | 15 | 30 | 8 | 6 |

Appendix I shows the residential and commercial water-consumption increase to be about 50 per cent over the period. The commercial consumption gained about 100 per cent, due to increased use of city water in preference to their own supplies. "Free" (or public use) water and unaccounted-for losses remained at the same levels during the period.

No restrictions on water use were imposed during the 1952 to 1955 period of water shortages elsewhere in the State.

H and J

Figure 12 shows the results of the analysis of the residential water-use data for H and J, towns of 18,000 and 41,000 population, respectively, and both with considerable commercial and industrial water use. H obtains water from a surface reservoir supplemented by a limited groundwater supply.

The reservoir supply was depleted about 1953 and full dependence was placed on the groundwater supply. However, this became inadequate, even with the construction of additional shallow wells, and restrictions, started partially in 1951, were rigidly enforced. The desperate situation brought about plans for laying a seven-mile pipe line from a stream. Before the pipe was laid, the rains came.

A breakdown of the total pumpage and per cent of sales taken from Appendix H, is shown in Table 7.

TABLE 7

| Year | Total Pumpage mgd | Per cent of Total Pumpage | | | |
|------|----------------------|---------------------------|-------------------------------|--------------------------|------------------------------------|
| | | Residential Sales % | Commer- cial Sales % | Industrial Sales % | Unaccounted- for Losses % |
| 1940 | 1.48 | 40 | 7 | 40 | 13 |
| 1944 | 1.72 | 35 | 12 | 41 | 12 |
| 1948 | 2.46 | 28 | 17 | 40 | 15 |
| 1953 | 2.25 | 35 | 19 | 33 | 13 |

J obtains its water supply from the Mississippi River. Since 1946, due to improved accounting, the water records are quite complete (Appendix J). A breakdown of the total pumpage and per cent of sales is shown in Table 8.

This community has always been and continues to be in a good position as to its current water supply and management problems,

TABLE 8

| Year | Total Pumpage mgd | Per cent of Total Pumpage | | | |
|------|----------------------|--------------------------------|-------------------------------|--------------------------|------------------------------------|
| | | Residen- tial Sales % | Commer- cial Sales % | Industrial Sales % | Unaccounted- for Losses % |
| 1947 | 3.63 | 29 | 29 | 23 | 19 |
| 1949 | 3.82 | 33 | 33 | 20 | 14 |
| 1951 | 3.42 | 36 | 36 | 19 | 9 |
| 1955 | 4.33 | 32 | 32 | 23 | 13 |

however, obsolescence of the plant and mains due to short term planning is weakening the entire water works structure.

Public Reaction to Restrictions in Some Illinois Communities

When a municipally-owned groundwater system encounters a water shortage due to a failing supply, it frequently becomes necessary to impose restrictions. When such restrictions as prohibition of lawn sprinkling and washing of cars do not meet the emergency, it becomes necessary to shut off water use for allnight periods and later on for intermittent periods in daytime "while the tank is being filled." When such extreme measures are necessary, the customers generally become inured to the unsatisfactory operation and gradually develop a tolerant attitude toward the water works officials.

The officials of a municipally-owned surface water system may find it difficult, as a drought period becomes extended, to convince the customers that the capacity of their lake is becoming critically low; that the broad water surface of the lake which they see may be only a very few feet above the bed of the lake.

In one of the communities studied but not discussed herein, city officials instituted restrictions during 1953, prohibiting the washing of cars and the sprinkling of lawns. A reduction in residential use of approximately 26 per cent ensued. These restrictions had to be continued through 1954, and by the end of that year, it was found that the water revenue had declined so severely that the water system was running into debt at a rapid rate. Officials thereupon reported this fact to the community and recommended a substantial increase in water rates to rectify the financial situation. The response of the citizenry was to elect new officials who, by drastic curtailment of both essential and nonessential expenditures, managed to bring the water department books into a current operating balance.

Water-Using Appliances in the Home

The most serious likelihood of increased residential use of water may result from the installation of water-using appliances in the home.

Table 9 shows the extent of water-using appliances installed in homes during the years 1949 to 1955 inclusive, as given by Electrical Merchandising magazine for Illinois and for the United States. Installations prior to 1949 are not known.

Residential Water Use - Effective Family Buying Income

An earlier study by the Water Survey⁽¹³⁾ indicated residential water-use in 1948 to be related to the family income of the community.

Sales Management magazine's "Survey of Buying Power" of May 1956 gives data on the effective net family income buying power for all communities over 10,000 population. Table 10 gives data from this magazine for the Illinois communities discussed herein. Because

TABLE 9

Electric Water-Using Appliances in United States and Illinois Homes

| | <u>Index of Saturation</u> | | | | | <u>December 31, 1955*</u> | | | |
|----------------------|----------------------------------|----------------|--------------|-------------|----------------|----------------------------------|--------------|------------|----------------|
| | <u>Millions Wired Homes With</u> | | | | | <u>Per cent Wired Homes With</u> | | | |
| | <u>Millions</u> | <u>Food</u> | | | <u>Wash-**</u> | <u>Food</u> | | | <u>Wash-**</u> |
| <u>Wired</u> | <u>Dish</u> | <u>Waste</u> | <u>Water</u> | <u>Dish</u> | | <u>Waste</u> | <u>Water</u> | | |
| <u>Homes</u> | <u>Wash-</u> | <u>Dispos-</u> | <u>Heat-</u> | <u>ers</u> | <u>Wash-</u> | <u>Dispos-</u> | <u>Heat-</u> | <u>ers</u> | |
| | <u>ers</u> | <u>ers</u> | <u>ers</u> | <u>ers</u> | <u>ers</u> | <u>ers</u> | <u>ers</u> | <u>ers</u> | |
| United States | 46.0 | 1.84 | 2.55 | 7.50 | 38.70 | 4.0 | 5.6 | 16.3 | 84.1 |
| Illinois | 2.0 | 0.042 | 0.062 | 0.093 | 0.994 | | 3.2 | 4.8 | 51.0 |

* For years 1949-1955 inclusive.

** Includes automatic and conventional types.

The data indicate that, while the market had been fairly well saturated with home washing machines, comparatively few dishwashers, food waste disposers and electric water heaters had been installed. A continuing trend toward increased installation of automatic and conventional washing machines can be expected. Only electric water heater sales are shown in the data. No information has been made available on gas water heater sales.

It may also be assumed that nearly all the newer water-using devices have been installed in higher-income urban centers. Therefore large increases in water use in small communities can be expected, and the small saturation indices for dishwashers and food waste disposers point toward considerable increases in per capita use in the larger communities. It is reasonable to assume that there may be a trend towards the air-cooled home air conditioner in preference to the water-cooled type.

three of the communities A, C, and D are less than 10,000 population, the county average was used.

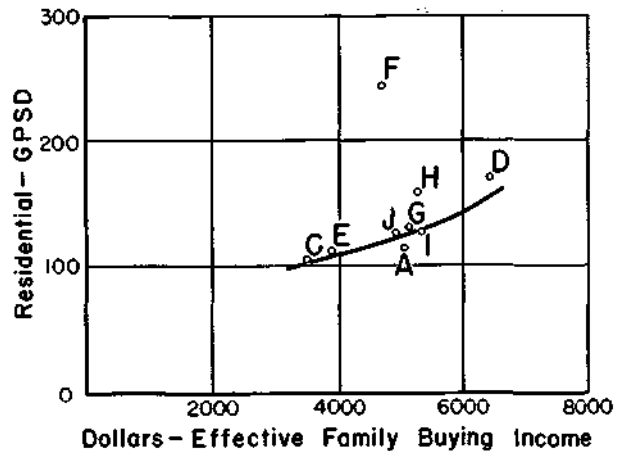


FIGURE 13

Also shown in Table 10 are the gallons-per-service per day and the gallons-per-capita per day as taken from the data sheets in the

TABLE 10

Effective Family Buying Income -
Residential Water Use

| <u>Community</u> | <u>Family</u> <u>Buying</u> <u>Income</u> <u>(dollars)</u> | <u>Residential</u> | |
|------------------|---------------------------------------------------------------------|------------------------------------------------------------------|-----------------------------------------------------------------|
| | | <u>Gallons-</u> <u>Per-</u> <u>Service</u> <u>(gpd)</u> | <u>Gallons-</u> <u>Per-</u> <u>Capita</u> <u>(gpd)</u> |
| A* | 5035 | 116 | 34 |
| C* | 3517 | 105 | 36 |
| D* | 6412 | 171 | 46 |
| E | 3958 | 112 | 36 |
| F | 4743 | 244 | 87 |
| G | 5179 | 131 | 45 |
| H | 5250 | 160 | 55 |
| I | 5325 | 129 | 45 |
| J | 4941 | 128 | 45 |

* County average

Appendix. Figure 13 is a graphical relationship of residential daily use per service and net effective family buying income. Gallons-per-service are used in the graph because this figure more closely represents the use per family. (Incidentally, in plotting gallons-per-capita and net family income, a similar straight line correlation is produced.) In this graph the data for F are not given weight because of the poor record of residential water use by this community (Appendix F). The data for H are lightly considered because the record of the number of services for that community was occasionally interpolated. The data for D were given strong consideration because the water records (Appendix D) were well-kept and the water use per capita as well as per service is keeping pace with the higher family income of this community.

The communities used in this report are none of those used in the earlier⁽¹³⁾ study, but the correlation between residential water use and family buying income corresponds very well.

Projections of Residential Water Use in Illinois Communities

The data from 9 Illinois towns in which the water records were found to be fairly comprehensive have been assembled in two groups. Group one is composed of 4 towns in the population range of 15,000 to 50,000. In group two are 5 towns having populations of less than 10,000. By inspection of the per-capita graphs for the individual towns, it was seen that the residential consumption in 1952 for the towns in group one averaged about 48 gallons-per-capita. For the group two towns the residential consumption in 1952 averaged 35 gallons-per-capita.

Figure 14 has been prepared from the weighted averages for residential consumption of gallons-per-capita and gallons-per-service for group one. Figure 15 shows the weighted averages of gallons-per-capita and gallons-per-service for group two. The data for both groups were plotted for 1951 and prior years, as the 1952 to 1954 records reflected the effect of the restrictions instituted during the drought.

In designing the projections for residential gallons-per-capita, Figure 14, consideration has been given to the slope of the curve for the period just prior to 1952 when homes in cities of this size were being equipped with water-using appliances. A saturation of less than 50 per cent had been reached by 1956, and this was considered a good reason for extending the maximum projection at this same slope to 1970. The minimum projection has been extended with very little increase in slope from 1952 to 1970.

For group two, Figure 15, consideration was given to the fact that up to 1952, a negligible number of homes, in towns of this population range were equipped with water-using appliances. However, by 1956, the economic status of these towns was improved and the net family buying income was up. Giving consideration to these factors, the maximum projection to 1970 was designed on the same slope as for the towns in group one.

The gallons-per-service graphs represent the family use of water and a fairly close check of the projections is observed when multiplying any point on the gallons-per-capita curve by the Bureau of the Census' estimated average of 3.03 persons per family.

There is need to consider other factors in future planning. One of these other factors is the availability of public sewer service, which in many small communities did not become available until after 1930, and which undoubtedly stimulated the increasing installation of water-borne waste disposal methods.

It seems obvious that both per-capita and per-service demands will rise in these communities. Conservative planning dictates the necessity of estimating future trends generously. Although maximum, medium and minimum estimates are plotted, it is recommended that the maximum projections be used.

Because these projections are based on residential consumption only, they are not apt to be greatly influenced by changes in the commercial and industrial life of a community.

Residential Use
4 Illinois Towns
15,000 — 50,000 Population

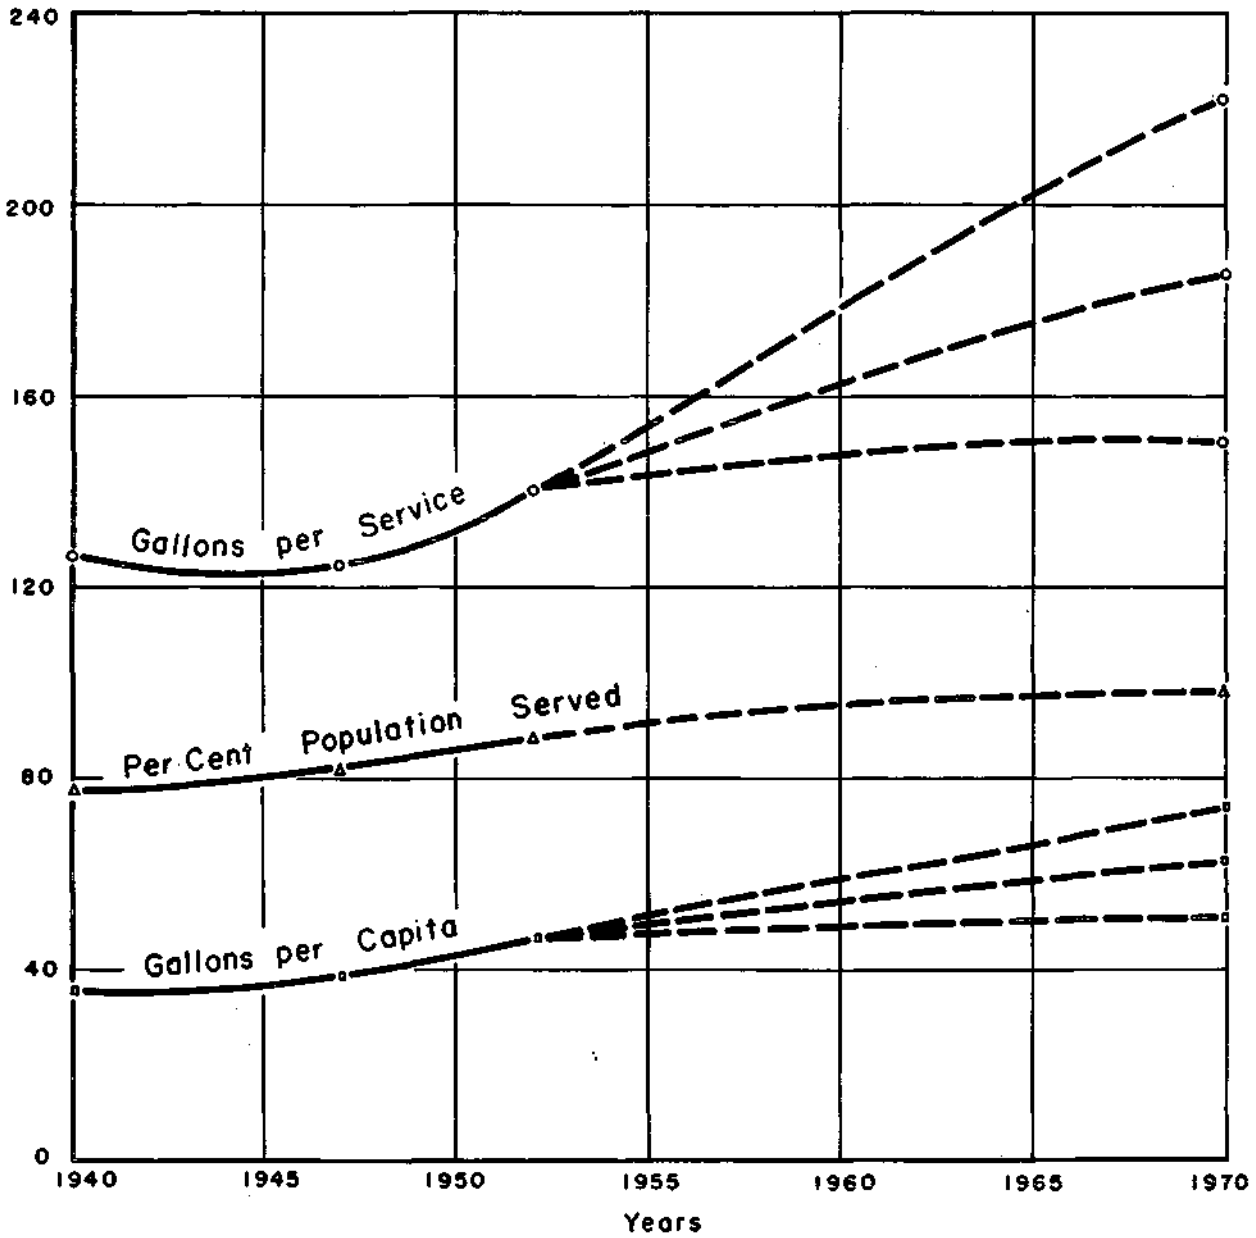


FIGURE 14.

Residential Use
5 Illinois Towns
Less Than 10,000 Population

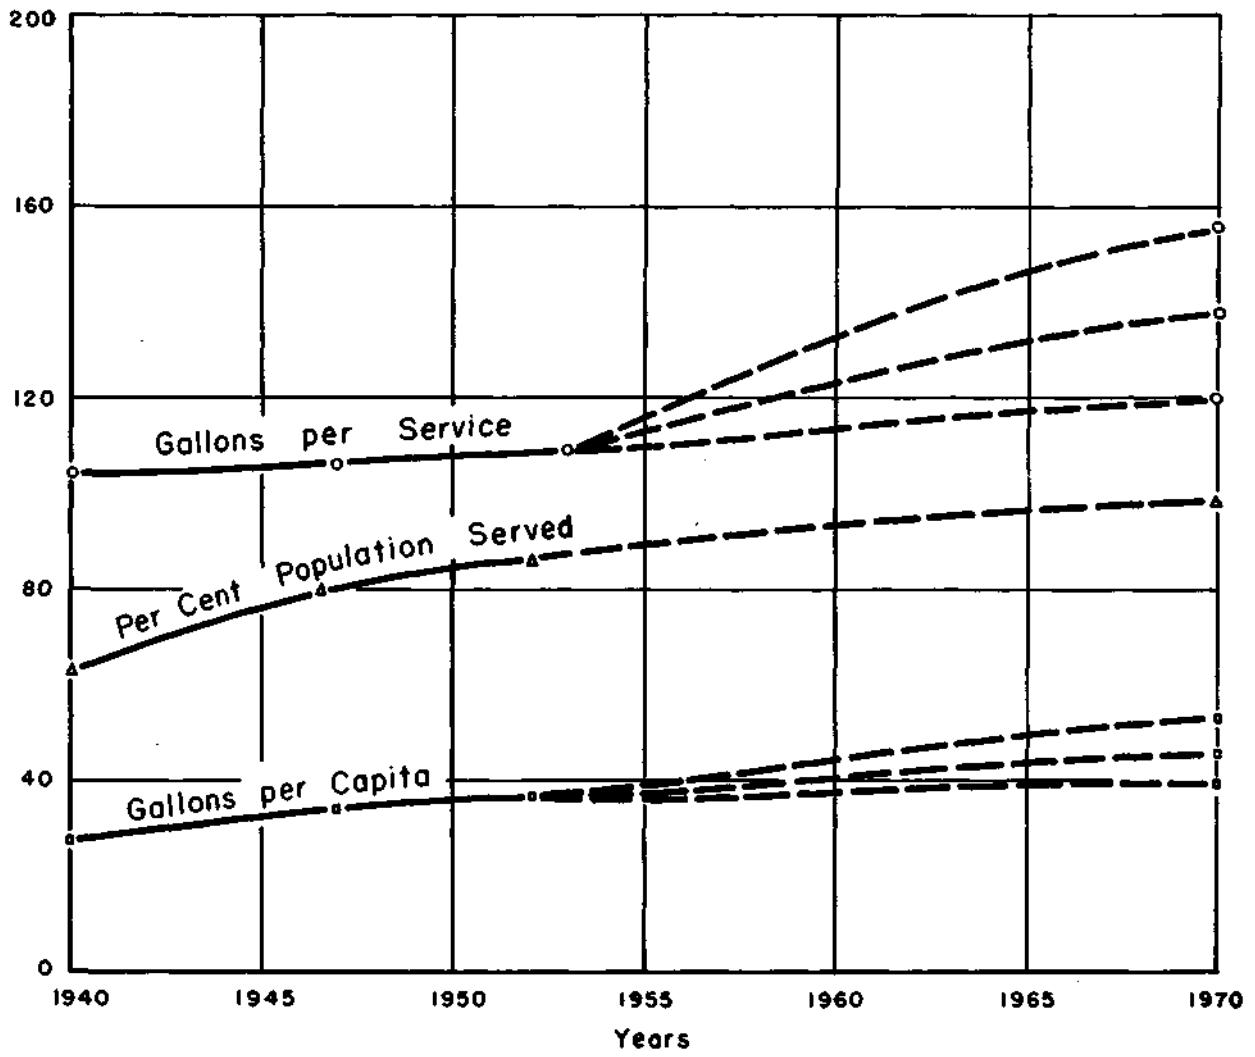


FIGURE 15

REFERENCES

1. Hudson, H. E., Jr., and Roberts, W. J., 1952-55 Illinois Drought with Special Reference to Impounding Reservoir Design, State Water Survey Bulletin No. 43, Urbana, 1956.
2. Brunsman, Howard G., United States Census of Population 1950. General Characteristics, "New and Old Definitions Urban and Rural Areas," Volume 1, pp, XV, XVII, Bureau of the Census, U. S. Department of Commerce, United States Government Printing Office, 1952.
3. Truesdell, Leon E., Housing, General Characteristics Illinois. 1940, Second Series, Bureau of the Census, U. S. Department of Commerce, United States Government Printing Office, 1942.
4. Brunsman, Howard G., United States Census of Housing, General Characteristics, Illinois. 1950 Housing Census Report H-A13, Preprint of Volume 1, p. VII, Chapter 13, Bureau of the Census, U. S. Department of Commerce, United States Government Printing Office 1952.
5. Anon. Current Population Reports, Population Characteristics, Bureau of the Census, U. S. Department of Commerce, Series P-20.
6. Anon. Current Population Reports, Population Estimates, Bureau of the Census, U. S. Department of Commerce, Series P-25.
7. Anon. "Changes in Number of Households and in Martial Status 1940 to 1947," Current Population Reports, Bureau of the Census, U. S. Department of Commerce, Series P-20, No. 3, September 16, 1947.
8. Anon. "American Households Continue Decline in Size," Current Population Reports, Bureau of the Census, U. S. Department of Commerce, Series P-20, No. 31, September 27, 1950.
9. Glick, Dr. Paul C, Larmon, Elizabeth A., and Landau, Emanuel, "Projections of the Number of Households and Families 1955 and 1960," Current Population Reports, Population Characteristics, Bureau of the Census, U. S. Department of Commerce, Series P-20, No. 42, December 28, 1952.
10. Anon. Current Population Reports, Bureau of the Census, U. S. Department of Commerce, Series P-20, No. 53, April 11, 1954.
11. Anon. Current Population Reports, Bureau of the Census, U. S. Department of Commerce, Series P-20, No. 55, February 13, 1955.
12. Current Population Reports, Population Estimates, Bureau of the Census, U. S. Department of Commerce, Series P-25, Nos. 78 and 110.
13. Larson, B. O., and Hudson, H. E., Jr., "Residential Water Use and Family Income," Illinois State Water Survey Circular No. 33, Urbana, Illinois, 1951. (Reprint from Journal AWWA, Volume 43, No. 8, August 1951, p. 603.)

APPENDIX

C

| Year | Population | Occupied dwelling units | Persons per household | Services | | | Population served | Per cent of total population served | Consumption | | | | | Free | Losses unaccounted for | Per cent of pumpage | Piped running water | | Residential | |
|------|------------|-------------------------|-----------------------|----------|-------------|------------|-------------------|-------------------------------------|-------------|---------------|-------------|------------|------------|------|------------------------|---------------------|---------------------|-------------------|----------------------------------|--------------------|
| | | | | Total | Residential | Commercial | | | Industrial | Total pumpage | Residential | Commercial | Industrial | | | | Total sales | in dwelling units | per cent of total dwelling units | Gallons per capita |
| | | no. | no. | no. | no. | no. | no. | % | mgd | mgd | mgd | mgd | mgd | mgd | mgd | % | no. | % | gpd | gpd |
| 1930 | 5955 | 1455 | 4.08 | | | | | | | | | | | | | | | | | |
| 1940 | 5418 | 1551 | 3.49 | 1140 | | | | | | | | | | | | | | | | |
| 1941 | | | | 1140 | | | | | | | | | | | | | | | | |
| 1942 | | | | 1151 | 1111 | 34 | 6 | 3800 | 73 | 0.13 | 0.10 | 0.02 | 0.01 | 0.13 | | | 1177 | 75.4 | 26 | 91 |
| 1943 | | | | 1199 | | | | | | | | | | | | | | | | |
| 1944 | | | | 1312 | | | | | | | | | | | | | | | | |
| 1945 | | | | 1411 | | | | | | | | | | | | | | | | |
| 1946 | | | | 1444 | 1406 | 32 | 6 | 4620 | 93 | 0.14 | 0.11 | 0.02 | 0.01 | 0.14 | | | | | 24 | 78 |
| 1947 | | | | 1469 | | | | | | | | | | | | | | | | |
| 1948 | | | | 1462 | | | | | | | | | | | | | | | | |
| 1949 | | | | 1479 | | | | | | | | | | | | | | | | |
| 1950 | 4605 | 1520 | 2.94 | 1480 | | | | | | | | | | | | | 1440 | 92.5 | | |
| 1951 | | | | 1472 | 1429 | 35 | 8 | 4175 | 91 | 0.17 | 0.14 | 0.02 | 0.01 | 0.17 | | | | | 34 | 98 |
| 1952 | | | | 1471 | 1428 | 35 | 8 | 4160 | 91 | 0.18 | 0.15 | 0.02 | 0.01 | 0.18 | | | | | 36 | 105 |
| 1953 | | | | 1492 | 1449 | 35 | 8 | 4150 | 91 | 0.18 | 0.15 | 0.01 | 0.01 | 0.17 | | | | | 36 | 104 |
| 1954 | | | | 1482 | 1436 | 38 | 8 | 4130 | 91 | 0.12 | 0.09 | 0.02 | 0.01 | 0.12 | | | | | 24 | 63 |

D

| Year | Population | Occupied dwelling units | Persons per household | Services | | | Population served | Per cent of total population served | Total pumpage | Consumption | | | Total sales | Free | Losses unaccounted for | Per cent of pumpage | Piped running water | | Residential | | | |
|------|------------|-------------------------|-----------------------|----------|-------------|------------|-------------------|-------------------------------------|---------------|-------------|-------------|------------|-------------|-------|------------------------|---------------------|---------------------|-------------------|----------------------------------|--------------------|---------------------|-----|
| | | | | Total | Residential | Commercial | | | | Industrial | Residential | Commercial | | | | | Industrial | in dwelling units | per cent of total dwelling units | Gallons per capita | Gallons per service | |
| | | no. | no. | no. | no. | no. | no. | % | mgd | mgd | mgd | mgd | mgd | mgd | mgd | % | no. | % | gpd | gpd | | |
| 1940 | 4101 | 1041 | 3.94 | 1000 | | | | | 3380 | 83 | 0.386 | 0.123 | 0.067 | 0.070 | 0.260 | 0.03 | 0.096 | 24 | 1061 | 99.4 | 36 | 143 |
| 1941 | | | 3.91 | 1047 | | | | | 3540 | 84 | 0.512 | 0.140 | 0.086 | 0.125 | 0.351 | 0.03 | 0.131 | 26 | | | 40 | 155 |
| 1942 | | | 3.88 | 1094 | | | | | 3700 | 86 | 0.565 | 0.148 | 0.091 | 0.280 | 0.519 | 0.04 | 0.006 | 1 | | | 40 | 155 |
| 1943 | | | 3.85 | 1141 | | | | | 3850 | 87 | 0.830 | 0.147 | 0.093 | 0.572 | 0.812 | 0.012 | 0.006 | 1- | | | 38 | 146 |
| 1944 | | | 3.83 | 1188 | | | | | 4000 | 89 | 1.020 | | | | | 0.04 | 0.005 | 1- | | | | |
| 1945 | | | | 1234 | 1094 | 126 | 14 | 4170 | 91 | 1.095 | 0.160 | 0.138 | 0.584 | 0.882 | 0.04 | 0.178 | 16 | | | 38 | 147 | |
| 1946 | | | | 1242 | 1097 | 130 | 15 | 4140 | 88 | 0.818 | 0.155 | 0.115 | 0.232 | 0.502 | 0.04 | 0.176 | 22 | | | 38 | 142 | |
| 1947 | | | | 1286 | 1118 | 150 | 17 | 4210 | 88 | 0.820 | 0.185 | 0.114 | 0.295 | 0.594 | 0.06 | 0.166 | 20 | | | 44 | 166 | |
| 1948 | | | | 1363 | 1207 | 139 | 17 | 4450 | 91 | 0.910 | 0.203 | 0.103 | 0.406 | 0.712 | 0.06 | 0.138 | 15 | | | 46 | 168 | |
| 1949 | | | | | | | | | | | 0.923 | 0.208 | 0.122 | 0.409 | 0.740 | 0.06 | 0.123 | 13 | | | 47 | 168 |
| 1950 | 5139 | 1455 | 3.53 | 1461 | 1273 | 171 | 17 | 4500 | 88 | 1.030 | 0.218 | 0.163 | 0.409 | 0.790 | 0.07 | 0.170 | 16 | 1543 | 99.5 | 48 | 171 | |
| 1951 | | | | 1558 | 1373 | 170 | 15 | 4800 | 93 | 1.242 | 0.235 | 0.154 | 0.622 | 1.010 | 0.07 | 0.160 | 13 | | | 49 | 171 | |
| 1952 | | | | 1589 | 1397 | 176 | 16 | 4850 | 94 | 1.015 | 0.223 | 0.144 | 0.447 | 0.815 | 0.07 | 0.130 | 13 | | | 46 | 160 | |
| 1953 | | | | 1651 | 1458 | 171 | 22 | 5010 | 98 | 0.846 | 0.248 | 0.161 | 0.262 | 0.672 | 0.08 | 0.094 | 11 | | | 50 | 171 | |
| 1954 | | | | 1786 | 1566 | 197 | 23 | 5500 | | 1.062 | 0.255 | 0.185 | 0.369 | 0.808 | 0.07 | 0.184 | 17 | | | 46 | 163 | |
| 1955 | | | | 1809 | 1684 | 202 | 23 | 6025 | | 1.039 | 0.294 | 0.167 | 0.284 | 0.744 | 0.08 | 0.215 | 21 | | | 49 | 174 | |

F

| Year | Population | Occupied dwelling units | Persons per household | Services | | | Consumption | | | | | | | Piped running water | | Residential | | | | | |
|------|------------|-------------------------|-----------------------|----------|-------------|------------|-------------|-------------------|-------------------------------------|---------------|-------------|------------|------------|---------------------|------|------------------------|---------------------|-------------------|----------------------------------|--------------------|---------------------|
| | | | | Total | Residential | Commercial | Industrial | Population served | Per cent of total population served | Total pumpage | Residential | Commercial | Industrial | Total sales | Free | Losses unaccounted for | Per cent of pumpage | in dwelling units | per cent of total dwelling units | Gallons per capita | Gallons per service |
| | | no. | no. | no. | no. | no. | no. | % | mgd | mgd | mgd | mgd | mgd | mgd | mgd | % | no. | % | gpd | gpd | |
| 1930 | 4309 | 1228 | 3.51 | | | | | | | | | | | | | | | | | | |
| 1938 | | | | 763 | 612 | 151 | | 2020 | 44 | 0.17 | 0.05 | 0.05 | 0.03 | 0.13 | | 0.04 | 23 | | 25 | 82 | |
| 1939 | | | | 770 | 634 | 136 | | 2075 | 44 | 0.16 | 0.05 | 0.05 | 0.03 | 0.13 | | 0.03 | 19 | | 24 | 79 | |
| 1940 | 4809 | 1470 | 3.27 | 793 | 657 | 136 | | 2145 | 45 | 0.15 | 0.05 | 0.05 | 0.03 | 0.13 | | 0.02 | 13 | 778 | 52.0 | 23 | 76 |
| 1941 | | | | 829 | 700 | 129 | | 2290 | 47 | 0.16 | 0.05 | 0.05 | 0.03 | 0.13 | | 0.03 | 19 | | 22 | 72 | |
| 1942 | | | | 850 | 700 | 150 | | 2285 | 46 | 0.18 | 0.04 | 0.04 | 0.03 | 0.11 | | 0.07 | 39 | | 18 | 57 | |
| 1943 | | | | 870 | 720 | 150 | | 2340 | 46 | 0.19 | 0.06 | 0.05 | 0.03 | 0.14 | | 0.05 | 26 | | 26 | 83 | |
| 1945 | | | | 963 | 800 | 163 | | 2580 | 49 | 0.23 | 0.08 | 0.05 | 0.03 | 0.16 | | 0.07 | 30 | | 31 | 100 | |
| 1946 | | | | 1039 | 859 | 180 | | 2765 | 51 | 0.22 | 0.09 | 0.05 | 0.03 | 0.17 | | 0.05 | 23 | | 33 | 105 | |
| 1947 | | | | 1151 | 960 | 191 | | 3075 | 54 | 0.24 | 0.12 | 0.05 | 0.03 | 0.20 | | 0.04 | 17 | | 39 | 125 | |
| 1948 | | | | 1235 | 1035 | 200 | | 3300 | 58 | 0.27 | 0.12 | 0.05 | 0.03 | 0.20 | | 0.07 | 26 | | 36 | 116 | |
| 1949 | | | | 1238 | 1033 | 205 | | 3270 | 58 | 0.25 | 0.13 | 0.06 | 0.03 | 0.22 | | 0.03 | 12 | | 40 | 126 | |
| 1950 | 5792 | 1841 | 3.14 | 1393 | 1183 | 210 | | 3720 | 64 | 0.27 | 0.13 | 0.06 | 0.03 | 0.22 | | 0.05 | 19 | 1339 | 71.0 | 35 | 110 |
| 1951 | | | | 1465 | 1250 | 215 | | 3900 | 68 | 0.29 | 0.14 | 0.06 | 0.03 | 0.23 | | 0.06 | 21 | | 36 | 112 | |
| 1952 | | | | 1576 | 1358 | 218 | | 4200 | 73 | 0.32 | 0.15 | 0.06 | 0.03 | 0.24 | | 0.08 | 25 | | 36 | 111 | |
| 1953 | | | | 1756 | 1526 | 230 | | 4730 | 82 | 0.30 | 0.13 | 0.06 | 0.03 | 0.22 | | 0.08 | 27 | | 37 | 85 | |
| 1954 | | | | 1855 | 1620 | 235 | | 5010 | 87 | 0.28 | 0.13 | 0.07 | 0.03 | 0.23 | | 0.05 | 18 | | 36 | 80 | |

F

| Year | Population | Persons per household | Persons per O. D. U. | Services | | | Population served | Per cent of total population served | Consumption | | | Total sales | Free | Losses unaccounted for | Per cent of pumpage | Piped running water | | Residential | | |
|------|------------|-----------------------|----------------------|----------|-------------|------------|-------------------|-------------------------------------|-------------|-------------|------------|-------------|------|------------------------|---------------------|---------------------|-------------------|----------------------------------|--------------------|---------------------|
| | | | | Total | Residential | Commercial | | | Industrial | Residential | Commercial | | | | | Industrial | in dwelling units | per cent of total dwelling units | Gallons per capita | Gallons per service |
| | | no. | no. | no. | no. | no. | no. | % | mgd | mgd | mgd | mgd | mgd | mgd | mgd | % | no. | % | gpd | gpd |
| 1930 | 8781 | 2552 | 3.44 | | | | | | | | | | | | | | | | | |
| 1938 | | | | 1800 | 1783 | 15 | 2 | 5800 | 63 | 0.88 | 0.66 | 0.04 | 0.18 | | | | | | 114 | 370 |
| 1940 | 9281 | 2893 | 3.21 | 1940 | 1923 | 15 | 2 | 6160 | 66 | 0.72 | 0.51 | 0.03 | 0.18 | | | | 1961 | 66.0 | 83 | 266 |
| 1946 | | | | 2360 | 2343 | 15 | 2 | 7040 | 75 | 1.03 | 0.82 | 0.03 | 0.18 | | | | | | 116 | 350 |
| 1949 | | | | 2800 | 2783 | 15 | 2 | 8060 | 85 | 0.79 | 0.58 | 0.03 | 0.18 | | | | | | 72 | 208 |
| 1950 | 9460 | 3314 | 2.85 | | | | 2 | | | | | | | | | | 2610 | 79.0 | | |
| 1952 | | | | 2900 | 2883 | 15 | 2 | 8090 | 86 | 0.77 | 0.70 | 0.03 | 0.04 | | | | | | 87 | 242 |
| 1953 | | | | 3000 | 2983 | 15 | 2 | 8360 | 89 | 0.80 | 0.73 | 0.03 | 0.04 | | | | | | 87 | 244 |
| 1954 | | | | 3300 | 3283 | 15 | 2 | 9200 | 97 | 0.51 | 0.44 | 0.03 | 0.04 | | | | | | 48 | 134 |

G

| Year | Population | Occupied dwelling units | Persons per household | Services | | | | Consumption | | | | | | Piped running water | | Residential | | | | | | |
|------|------------|-------------------------|-----------------------|----------|-------------|------------|------------|-------------------|-------------------------------------|-----------------|-------------|------------|------------|---------------------|------|------------------------|---------------------|-------------------|----------------------------------|--------------------|---------------------|--|
| | | | | Total | Residential | Commercial | Industrial | Population served | Per cent of total population served | Total pumpage * | Residential | Commercial | Industrial | Total sales * | Free | Losses unaccounted for | Per cent of pumpage | in dwelling units | per cent of total dwelling units | Gallons per capita | Gallons per service | |
| | | no. | no. | no. | no. | no. | no. | % | mgd | mgd | mgd | mgd | mgd | mgd | mgd | mgd | % | no. | % | gpd | gpd | |
| 1930 | 12583 | 3502 | 3.61 | | | | | | | | | | | | | | | | | | | |
| 1937 | | | | 3165 | 2900 | | | 10300 | 73 | 1.15 | 0.43 | 0.06 | 0.62 | 1.14 | | 0.01 | 1 | | | 42 | 150 | |
| 1938 | | | | 3270 | 3000 | | | 10600 | 68 | 1.41 | 0.51 | 0.19 | 0.67 | 1.40 | | 0.01 | 1 | | | 47 | 171 | |
| 1939 | | | | 3374 | 3150 | | | 11000 | 69 | 1.58 | 0.55 | 0.32 | 0.61 | 1.56 | | 0.02 | 1 | | | 50 | 175 | |
| 1940 | 16343 | 4718 | 3.50 | | | | | | | | | | | | | | | 4012 | 84.2 | | | |
| 1944 | | | 3.3 | 3895 | 3624 | 265 | | 11975 | 78 | 1.94 | 0.34 | 0.41 | 1.05 | 1.93 | | 0.01 | 1 | | | 28 | 93 | |
| 1946 | | | 3.2 | 4145 | 3873 | 266 | | 12400 | 84 | 1.93 | 0.45 | 0.50 | 0.86 | 1.92 | | 0.01 | 1 | | | 36 | 116 | |
| 1947 | | | | 4324 | 4051 | 267 | | 12750 | 88 | 2.08 | 0.45 | 0.60 | 0.87 | 2.05 | | 0.03 | 2 | | | 35 | 111 | |
| 1950 | 13863 | 4609 | 3.00 | | | | | | | | | | | | | | | 4546 | 95.0 | | | |
| 1951 | | | | 4851 | 4563 | 282 | | 13700 | 99 | 2.23 | 0.54 | 0.45 | 0.83 | 1.98 | | 0.25 | 11 | | | 40 | 119 | |
| 1952 | | | | 5003 | 4732 | 269 | | 14200 | 99 | 2.15 | 0.62 | 0.45 | 0.62 | 1.87 | | 0.28 | 13 | | | 45 | 131 | |
| 1953 | | | | 5162 | 4780 | 376 | | 14350 | 99 | 2.24 | 0.56 | 0.46 | 0.59 | 1.83 | | 0.41 | 18 | | | 41 | 117 | |
| 1954 | | | | | 4800 | | | 14400 | 99 | 2.10 | 0.57 | 0.45 | 0.46 | 1.66 | | 0.44 | 21 | | | 41 | 119 | |

* Total pumpage and total sales includes small towns but number of meters and dwelling units for small towns are not known.

Gallons per capita and gallons per service are computed for G only.

H

| Year | Population | Occupied dwelling units | Persons per household | Services | | | | Consumption | | | | | | | Piped running water | | Residential | | | | |
|------|------------|-------------------------|-----------------------|----------|-------------|------------|------------|-------------------|-------------------------------------|---------------|-------------|------------|------------|-------------|---------------------|------------------------|---------------------|-------------------|----------------------------------|--------------------|---------------------|
| | | | | Total | Residential | Commercial | Industrial | Population served | Per cent of total population served | Total pumpage | Residential | Commercial | Industrial | Total sales | Free | Losses unaccounted for | Per cent of pumpage | in dwelling units | per cent of total dwelling units | Gallons per capita | Gallons per service |
| | | | | no. | no. | no. | no. | no. | no. | no. | no. | no. | no. | no. | no. | no. | no. | no. | no. | no. | gpd |
| 1930 | 14631 | 3854 | 3.80 | | | | | | | | | | | | | | | | | | |
| 1936 | | | | 3700 | | | | | | | | | | | | | | | | | |
| 1940 | 15827 | 4648 | 3.41 | 4100 | 3821 | 275 | 4 | 13050 | 82 | 1.48 | 0.59 | 0.10 | 0.59 | 1.28 | | 0.20 | 13 | 3596 | 75.5 | 45 | 155 |
| 1941 | | | | 4200 | 3921 | 275 | 4 | 13200 | 82 | 1.47 | 0.57 | 0.10 | 0.60 | 1.27 | | 0.20 | 14 | | | 43 | 146 |
| 1942 | | | | | | | | | | | | | | | | | | | | | |
| 1943 | | | | | | | | | | | | | | | | | | | | | |
| 1944 | | | | 4500 | 4220 | 275 | 5 | 13700 | 82 | 1.72 | 0.60 | 0.22 | 0.70 | 1.52 | | 0.20 | 12 | | | 44 | 142 |
| 1945 | | | | | | 275 | 5 | | | | | | | | | | | | | | |
| 1946 | | | | | | | | | | | | | | | | | | | | | |
| 1947 | | | | 4800 | 4520 | 275 | 5 | 14050 | 82 | 2.42 | 0.69 | 0.43 | 0.98 | 2.10 | | 0.32 | 13 | | | 49 | 153 |
| 1948 | | | | 4900 | 4620 | 275 | 5 | 14250 | 82 | 2.46 | 0.69 | 0.43 | 0.98 | 2.10 | | 0.36 | 15 | | | 48 | 149 |
| 1949 | | | | | | | | | | | | | | | | | | | | | |
| 1950 | 17547 | 5712 | 3.00 | 5100 | 4795 | 300 | 5 | 14300 | 82 | 2.28 | 0.72 | 0.43 | 0.95 | 2.10 | | 0.18 | 8 | 5450 | 94.0 | 50 | 151 |
| 1951 | | | | | | | | | | | | | | | | | | | | | |
| 1952 | | | | 5300 | 4995 | 300 | 5 | 14675 | 84 | 2.36 | 0.80 | 0.43 | 0.78 | 2.01 | | 0.35 | 15 | | | 55 | 160 |
| 1953 | | | | 5400 | 5095 | 300 | 5 | 14900 | 85 | 2.25 | 0.80 | 0.43 | 0.73 | 1.96 | | 0.29 | 13 | | | 54 | 156 |
| 1954 | | | | 5500 | 5195 | 300 | 5 | 15200 | 87 | 1.52 | 0.60 | 0.31 | 0.29 | 1.20 | | 0.32 | 21 | | | 40 | 116 |
| 1955 | | | | 5600 | 5295 | 300 | 5 | 15475 | 88 | | | | | | | | | | | | |

| Year | Population | Occupied dwelling units | Persons per household | Services | | | Consumption | | | | | | | | | | Piped running water | | Residential | | |
|------|------------|-------------------------|-----------------------|----------|-------------|------------|-------------|-------------------|-------------------------------------|---------------|-------------|------------|------------|-------------|------|------------------------|---------------------|-------------------|----------------------------------|--------------------|---------------------|
| | | | | Total | Residential | Commercial | Industrial | Population served | Per cent of total population served | Total pumpage | Residential | Commercial | Industrial | Total sales | Free | Losses unaccounted for | Per cent of pumpage | in dwelling units | per cent of total dwelling units | Gallons per capita | Gallons per service |
| | | | | no. | no. | no. | no. | no. | % | mgd | mgd | mgd | mgd | mgd | mgd | mgd | mgd | % | no. | % | gpd |
| 1940 | 22366 | 6622 | 3.48 | | | | | 1.43 | | | | | | | | | 6443 | 97.2 | | | |
| 1941 | | | | 6398 | 5828 | 570 | | 1.50 | | | | | | | | | | | | | |
| 1942 | | | | 6446 | 5876 | 570 | | 1.64 | | | | | | | | | | | | | |
| 1943 | | | | 6458 | 5888 | 570 | 19900 | 89 | 1.60 | 0.66 | 0.24 | 0.30 | 1.20 | 0.24 | 0.16 | 10 | | | 33 | 111 | |
| 1944 | | | | 6520 | 5950 | 570 | 20000 | 89 | 1.71 | 0.69 | 0.25 | 0.37 | 1.31 | 0.24 | 0.16 | 9 | | | 35 | 116 | |
| 1945 | | | | 6567 | 5967 | 570 | 19850 | 89 | 1.70 | 0.69 | 0.25 | 0.36 | 1.30 | 0.24 | 0.15 | 9 | | | 35 | 116 | |
| 1946 | | | | 6622 | 6052 | 570 | 20000 | 89 | 1.81 | 0.74 | 0.28 | 0.39 | 1.41 | 0.24 | 0.16 | 9 | | | 37 | 122 | |
| 1947 | | | | 6711 | 6141 | 570 | 20200 | 90 | 2.03 | 0.84 | 0.31 | 0.48 | 1.63 | 0.24 | 0.16 | 8 | | | 42 | 137 | |
| 1948 | | | | 6813 | 6243 | 570 | 19750 | 88 | 2.13 | 0.86 | 0.31 | 0.51 | 1.68 | 0.27 | 0.18 | 8 | | | 44 | 138 | |
| 1949 | | | | 6923 | 6353 | 570 | 19350 | 87 | 2.17 | 0.87 | 0.32 | 0.58 | 1.77 | 0.24 | 0.16 | 7 | | | 45 | 137 | |
| 1950 | 22467 | 7092 | 3.00 | 7015 | 6445 | 570 | 19250 | 86 | 1.97 | 0.83 | 0.30 | 0.46 | 1.59 | 0.23 | 0.15 | 8 | 7042 | 98.0 | 45 | 128 | |
| 1951 | | | | 7076 | 6516 | 570 | 19500 | 87 | 1.98 | 0.82 | 0.30 | 0.51 | 1.63 | 0.23 | 0.15 | 8 | | | 42 | 126 | |
| 1952 | | | | 7254 | 6684 | 570 | 19700 | 88 | 1.93 | 0.84 | 0.31 | 0.50 | 1.65 | 0.23 | 0.15 | 8 | | | 43 | 126 | |
| 1953 | | | | 7446 | 6874 | 572 | 19900 | 89 | 2.18 | 0.89 | 0.33 | 0.65 | 1.87 | 0.13 | 0.08 | 4 | | | 45 | 129 | |
| 1954 | | | | 7524 | 6952 | 572 | 20550 | 92 | 2.07 | 0.88 | 0.33 | 0.59 | 1.80 | 0.17 | 0.10 | 5 | | | 43 | 126 | |
| 1955 | | | | | | | | | 2.52 | | | | | | | | | | | | |

J

| Year | Population | Occupied dwelling units | Persons per household | Total | Services. | | | Population served | Per cent of total population served | Total pumpage | Consumption | | | | Free | Losses unaccounted for | Per cent of pumpage | Piped running water | | Residential | |
|------|------------|-------------------------|-----------------------|-------|-------------|------------|------------|-------------------|-------------------------------------|---------------|-------------|------------|------------|-------------|------|------------------------|---------------------|---------------------|----------------------------------|--------------------|---------------------|
| | | | | | Residential | Commercial | Industrial | | | | Residential | Commercial | Industrial | Total sales | | | | in dwelling units | per cent of total dwelling units | Gallons per capita | Gallons per service |
| | | no. | no. | no. | no. | no. | no. | % | mgd | mgd | mgd | mgd | mgd | mgd | mgd | % | no. | % | gpc | gpd | |
| 1930 | 39241 | 10756 | 3.65 | | | | | | | | | | | | | | | | | | |
| 1939 | | | | | | | | | | | | | | | | | | | | | |
| 1940 | 40469 | 11974 | 3.38 | 9973 | | | | | 3.40 | | | | | | | | 11944 | 97.4 | | | |
| 1942 | | | | 10078 | | | | | 2.72 | | | | | | | | | | | | |
| 1943 | | | | 9989 | | | | | 2.79 | | | | | | | | | | | | |
| 1944 | | | | 10069 | | | | | 3.03 | | | | | | | | | | | | |
| 1945 | | | | 10102 | | | | | 3.06 | | | | | | | | | | | | |
| 1947 | | | | 10361 | 9379 | 904 | 78 | 30200 | 73 | 3.63 | 1.07 | 1.06 | 0.82 | 2.95 | 0.68 | 19 | | | 35 | 114 | |
| 1948 | | | | 10517 | 9535 | 904 | 78 | 30000 | 73 | 3.77 | 1.22 | 1.21 | 0.82 | 3.25 | 0.52 | 14 | | | 40 | 128 | |
| 1949 | | | | 10714 | 9732 | 904 | 78 | 29600 | 72 | 3.82 | 1.26 | 1.25 | 0.76 | 3.27 | 0.55 | 14 | | | 43 | 130 | |
| 1950 | 41450 | 13557 | 3.00 | 10955 | 9773 | 904 | 78 | 29300 | 70 | 3.58 | 1.29 | 1.29 | 0.70 | 3.28 | 0.30 | 6 | 13327 | 98.5 | 44 | 132 | |
| 1951 | | | | 11272 | 10290 | 904 | 78 | 30500 | 74 | 3.42 | 1.25 | 1.25 | 0.63 | 3.13 | 0.29 | 9 | | | 41 | 122 | |
| 1952 | | | | 11495 | 10513 | 904 | 78 | 30900 | 74 | 3.82 | 1.32 | 1.31 | 0.70 | 3.33 | 0.49 | 13 | | | 43 | 126 | |
| 1953 | | | | 11534 | 10552 | 904 | 78 | 30700 | 74 | 3.90 | 1.37 | 1.36 | 0.76 | 3.49 | 0.41 | 10 | | | 45 | 128 | |
| 1954 | | | | 11807 | 10825 | 904 | 78 | 32250 | 77 | 4.00 | 1.36 | 1.35 | 0.88 | 3.59 | 0.41 | 10 | | | 42 | 126 | |
| 1955 | | | | 12137 | 11155 | 904 | 78 | 34000 | 81 | 4.33 | 1.37 | 1.38 | 1.00 | 3.75 | 0.58 | 13 | | | 41 | 123 | |

STATE WATER SURVEY DIVISION

Urbana

REPORTS OF INVESTIGATION

- No. 1. Temperature and Turbidity of Some River Waters in Illinois. By Max Suter (1948).
- No. 2. Groundwater Resources in Winnebago County, with Specific Reference to Conditions at Rockford. By H. F. Smith and T. E. Larson (1948).
- No. 3. Radar and Rainfall. By G. E. Stout and F. A. Huff (1949). Out of print.
- No. 4. The Silt Problem of Spring Lake, Macomb, Illinois. By J. B. Stall, L. C. Gottschalk, A. A. Klingebiel, E. L. Sauer, and E. E. DeTurk (1949). Out of print.
- No. 5. Infiltration of Soils in the Peoria Area. By G. A. Stauffer (1949).
- No. 6. Groundwater Resources in Champaign County. By H. F. Smith (1950).
- No. 7. The Silting of Ridge Lake, Fox Ridge State Park, Charleston, Illinois. By J. B. Stall, L. C. Gottschalk, A. A. Klingebiel, E. L. Sauer and S. W. Melsted (1951). Out of print.
- No. 8. The Silting of Lake Chautauqua, Havana, Illinois. By J. B. Stall and S. W. Melsted (1951).
- No. 9. The Silting of Carbondale Reservoir, Carbondale, Illinois. By B. O. Larson, A. A. Klingebiel, E. L. Sauer, S. W. Melsted, and R. C. Hay (1951). Out of print.
- No. 10. The Silting of Lake Bracken, Galesburg, Illinois. By B. O. Larson, A. A. Klingebiel, E. L. Sauer, and S. W. Melsted (1951).
- No. 11. Irrigation in Illinois. By W. J. Roberts (1951).
- No. 12. The Silting of West Frankfort Reservoir, West Frankfort, Illinois. By J. B. Stall, A. A. Klingebiel, S. W. Melsted, and E. L. Sauer (1951).
- No. 13. Studies of Thunderstorm Rainfall with Dense Raingage Networks and Radar (1951). Out of print.
- No. 14. The Storm of July 8, 1951 in North Central Illinois (1952).
- No. 15. The Silting of Lake Calhoun, Galva, Illinois. By J. B. Stall, A. A. Klingebiel, S. A. Melsted and E. L. Sauer (1952).
- No. 16. The Silting of Lake Springfield, Springfield, Illinois. By J. B. Stall, L. C. Gottschalk, and H. M. Smith (1952).
- No. 17. Preliminary Investigation of Groundwater Resources in the American Bottom. By Jack Bruin and H. F. Smith (1953).
- No. 18. The Silting of Lake Carthage, Carthage, Illinois. By J. B. Stall, G. R. Hall, S. W. Melsted and E. L. Sauer (1953).
- No. 19. Rainfall-Radar Studies of 1951. By G. E. Stout, J. C. Neill, and G. W. Farnsworth (1953).
- No. 20. Precipitation Measurement Study. By John C. Kurtyka (1953).
- No. 21. Analysis of 1952 Radar and Raingage Data. By J. C. Neill (1953).
- No. 22. Study of an Illinois Tornado Using Radar, Synoptic Weather and Field Survey Data. By F. A. Huff, H. W. Hiser and S. G. Bigler (1954).
- No. 23. Bubbler System Instrumentation for Water Level Measurement. By G. H. Nelson (1955).
- No. 24. The Storm of July 18-19, 1952 Rockford, Illinois and Vicinity. By Bernt O. Larson, Homer W. Hiser, and Warren Daniels (1955).
- No. 25. Selected Mediods for Pumping Test Analysis. By Jack Bruin and H. E. Hudson Jr. (1955).
- No. 26. Groundwater Resources in Lee and Whiteside Counties. By Ross Hanson (1955).
- No. 27. The October 1954 Storm in Northern Illinois. By F. A. Huff, H. W. Hiser, and G. E. Stout (1955).
- No. 28. Radar Back-Scattering from Non-Spherical Scatterers. By Prem Mathur and E. A. Mueller (1955).
- No. 29. Evaluation of a Low Powered 3-cm Radar Quantitative Rainfall Measurements. By F. A. Huff, J. C. Neill and M. Spock Jr. (1956).