

enviBUILD2018, 27-28 September, Debrecen, Hungary

Cost efficiency of retrofit measures for typical masonry houses in Kosovo

Egzon BAJRAKTARI^a, Violeta NUSHI^{a*}, Manuela ALMEIDA^b

a - Faculty of Civil Engineering and Architecture, University of Prishtina “Hasan Prishtina”,
Kosovo

b - Department of Civil Engineering, University of Minho, Portugal

* - corresponding author, violeta.nushi@uni-pr.edu, UP-FNA, Bregu i Diellit pn. 10000
Prishtinë, Kosovo

Abstract: A major challenge our society faces today is the buildings energy consumption. Building stock is responsible for about 40% of energy consumption worldwide. The same applies for Kosovo where large number of houses are poorly weatherized and inefficient in terms of energy consumption. Most of the energy consumption in the household sector in Kosovo is dedicated to the needs for heating purposes. Furthermore, many of these houses use wood or coal for heating releasing a lot of gases in the air and so contribute to an increased air pollution both indoors and outdoors. The Faculty of Civil Engineering and Architecture at the University of Prishtina “Hasan Prishtina” aims to address the issue of energy efficiency for these houses. Specifically, in this study we intend to evaluate various retrofit measures applicable in the country for typical masonry houses and identify the cost-efficient solution. This paper reports for the initial results of the study and discusses related challenges.

Keywords: Energy retrofit, cost-efficiency, masonry buildings, Kosovo.

1. Introduction

The building sector accounts for large portion of global energy use and greenhouse gas emissions. In Kosovo, similar to global statistics, the household sector consumes about 38% of the overall energy consumption [1]. Most of this energy consumption in the household sector is dedicated to the needs for heating in housing spaces [2, 3]. First projects applying energy efficiency measures in new and existing buildings have begun countrywide.

On the other hand, the government is working toward completing the legislative framework which supports and encourages energy efficiency in the building sector. Both the works in practice and the drafting of the legislation are based on the foreign examples. In this regard, there is need for local standards and benchmarks to be established in the field of energy efficiency and related retrofit measures. Of course this should be based on the relevant international standards and guiding documents [4, 5, 6].

Faculty of Civil Engineering and Architecture at the University of Prishtina “Hasan Prishtina” with the project LEMENS (original full title “Levërdia Ekonomike e Masave për Eficiencë Energjetike në Sanimin e Ndërtesave Ekzistuese”, in English: “Cost efficiency of the measures for energy efficiency in the renovation of existing buildings”) aims to address the issue of determination of the cost-efficiency of the measures for energy efficiency renovation of existing buildings. To gain an understanding of the practices and problems in the field we have

monitored the implementation of the measures for energy efficiency in a number of existing buildings. For the scope of the problem we examined general statistical data for the existing building stock in Kosovo [8]. This paper focuses on the cost-efficient solution for the renovation of masonry type one-floor single-family houses. The general statistical data [8] show that 86-89% of the whole existing residential building stock has low thermal insulation walls. The majority of the buildings in this stock are single family houses (230303 units from the statistical data of the 2011 year census [8]).

2. Materials and calculation methods

The examination of the cost efficiency of energy efficiency renovation measures for existing masonry type one-floor single-family houses buildings is done as follows.

A reference house has been modelled for the case study. It is a single-family house, one floor masonry type of building. According to statistical data [8] this model can be inferred to roughly represent 31% of the units in the existing building stock in Kosovo. These houses use wood stoves for heating, and there is usually one such stove in the main living room. Water heating is provided by separate electrical boilers in the bathroom. The characteristics of the building envelope for the reference house are shown in Table 1. The walls consist of masonry blocks with mortar on both sides. The roof is a wooden construction covered with roof tiles and over a concrete slab. The floor is a solid concrete floor. Windows are wooden frame, double pane, single glazed.

Table 1. Building envelope characteristics for the reference house.

Building envelope components	S [m ²]	U [Wm ⁻² K ⁻¹]	Main material
Floor	100	0.67	Concrete
Walls	130	0.96	Masonry units
Windows	12	2.70	Glass
Door (entry)	2	1.80	Wood
Roof	148	1.85	Roof tiles

This type of house, only for heating purposes consumes about 255 kWhm⁻²a⁻¹. Walls and the roof represent the major paths in transmission losses (Figure 1).

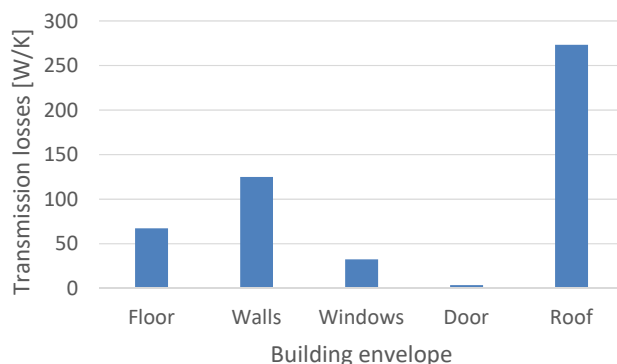


Figure 1. Transmission losses per building envelope components.

Various renovation scenarios have been established. They address only renovation measures for the building envelope (walls, windows, roof). The floor has not been considered in the list, since in the case of existing buildings the renovation of the floor will incur other renovation measures and increase the costs as well as the time. On the other hand, the roof and the enveloping walls as well as windows can be (more or less) renovated without interrupting the household and without incurring extra costs. Renovation scenarios addressing one or more building envelope components are listed in Table 2. They consist of various levels of external thermal insulation with expanded polystyrene (EPS) and various levels of roof insulation with mineral wool (MW), as well as three type of windows (double glazed, double glazed low-e and triple glazed low-e).

Table 2. List of renovation scenarios.

Scenario no	Roof	Walls	Windows
1	MW 50 mm	-	-
2	-	EPS 50 mm	-
3	-	-	PVC window Double-glazed U 1.4
4	MW 50 mm	EPS 50 mm	-
5	MW 50 mm	EPS 50 mm	PVC window Double-glazed U 1.4
6	MW 50 mm	EPS 50 mm	PVC window Double-glazed Low-e U 1.1
7	MW 50 mm	EPS 50 mm	PVC window Triple-glazed Low-e U 0.8
8	MW 80 mm	EPS 50 mm	PVC window Double-glazed U 1.4
9	MW 80 mm	EPS 50 mm	PVC window Triple-glazed Low-e U 0.8
10	MW 80 mm	EPS 80 mm	PVC window Double-glazed U 1.4
11	MW 80 mm	EPS 80 mm	PVC window Triple-glazed Low-e U 0.8
12	MW 120 mm	EPS 50 mm	PVC window Double-glazed U 1.4
13	MW 120 mm	EPS 80 mm	PVC window Double-glazed U 1.4
14	MW 120 mm	EPS 120 mm	PVC window Double-glazed U 1.4
15	MW 120 mm	EPS 80 mm	PVC window Double-glazed Low-e U 1.1
16	MW 120 mm	EPS 120 mm	PVC window Triple-glazed Low-e U 0.8
17	MW 150 mm	EPS 80 mm	PVC window Double-glazed U 1.4
18	MW 150 mm	EPS 120 mm	PVC window Double-glazed Low-e U 1.1
19	MW 150 mm	EPS 150 mm	PVC window Triple-glazed Low-e U 0.8
20	MW 250 mm	EPS 120 mm	PVC window Triple-glazed Low-e U 0.8
21	MW 250 mm	EPS 250 mm	PVC window Triple-glazed Low-e U 0.8
22	MW 370 mm	EPS 370 mm	PVC window Triple-glazed Low-e U 0.8

For the reference house and for each of the renovation scenarios the primary energy and global costs has been calculated. The primary energy is calculated following a standard procedure [6, 7] using a quasi-steady state method. For simplification only the primary energy necessary for heating purposes has been calculated. Global costs are simplified in the form of investment costs and energy costs over a certain period of time.

The weather data has been obtained from local weather stations [9, 10] as well as satellite data for global radiation [11].

3. Results

We have calculated the primary energy needs regarding heating purposes for the reference house and for each of the renovation scenarios, as well as related global costs. Figure 2 compares the results for a 30 years period, whereas Figure 3 compares the results for a 10 year period.

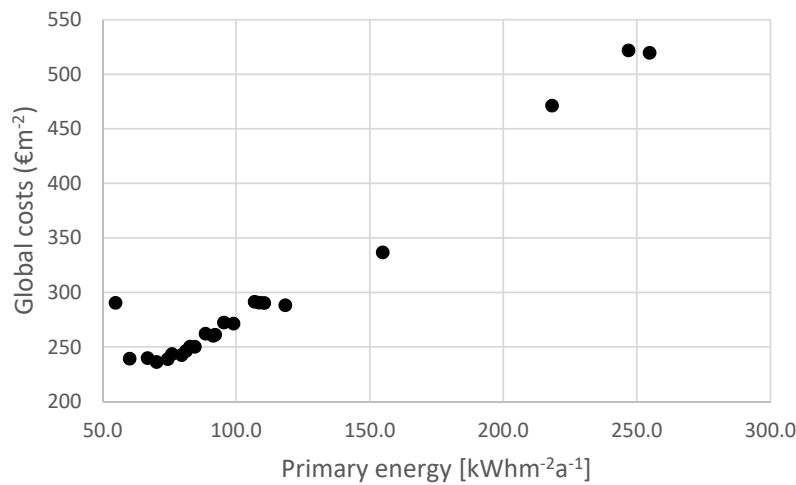


Figure 2. Comparison of primary energy and global costs for 30 years period.

In a 30 year period scenario 19 (see Table 2 for details) shows to be a cost-optimal solution. Whereas in a shorter period of time scenario 4 and 1 seem more feasible. Calculated figures for each of the data-points including a 20 years calculation period are presented in Table 3.

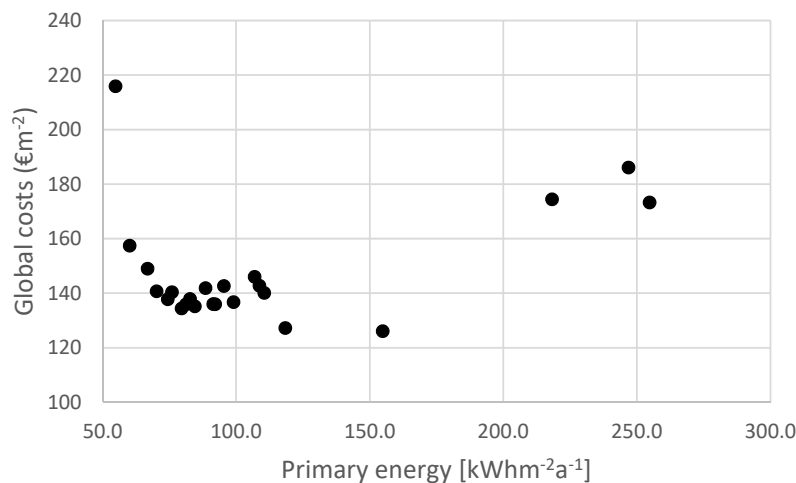


Figure 3. Comparison of primary energy and global costs for 10 years period.

Table 3. Global costs of the renovation scenarios for 10, 20 and 30 years calculation periods

Scenario	Primary energy (kWhm ⁻² a ⁻¹)	Global costs (€m ⁻²)		
		30 years period	20 years period	10 years period
Ref. House	254.8	520	346	173
1	154.9	337	231	126
2	218.3	471	323	174
3	246.9	522	354	186
4	118.4	288	208	127
5	110.5	290	215	140
6	108.7	291	217	143
7	106.9	291	219	146
8	99.0	271	204	137
9	95.4	272	208	143
10	92.2	261	199	136
11	88.5	262	202	142
12	91.4	260	198	136
13	84.6	250	193	135
14	79.6	243	189	134
15	82.7	250	194	138
16	75.9	244	192	140
17	81.2	246	191	136
18	74.4	239	188	138
19	70.2	236	188	141
20	66.8	240	194	149
21	60.2	239	198	157
22	54.8	290	253	216

4. Discussion

The results of comparing data over 10 years period seems to agree with what goes on in practice in current construction works in Kosovo. Considering low economy standing of the local population most of the builders apply very low levels of thermal insulation, meaning short term gain in savings from investments. Nevertheless, on the long run better performing scenario 19 seems the right choice.

In view of the results presented we could recommend that for the current situation in Kosovo it would be possible to require that the existing houses be refurbished using scenario 4 (envelope U value $\sim 0.4 \text{ Wm}^{-2}\text{K}^{-1}$), while planning that given a better economic standing in the future to advance the refurbishment requirements towards scenario 19 (envelope U value $\sim 0.2 \text{ Wm}^{-2}\text{K}^{-1}$). Comparable results have been found in different examples throughout Europe for the single family houses where the U value of the refurbished building envelope has been targeted from 0.16 to 0.3 as seen in [12].

We should note that the better performing renovation scenarios should include also renovation of the heating system, an issue which is not covered in this paper. Single unit wood stoves

should be replaced with correctly sized central heating systems in order to avoid overheating in certain spaces and for even distribution of the heat throughout the space.

5. Conclusion

Kosovo has a large stock of existing single family houses which are poorly weatherized. It is important that these houses are renovated towards improving their energy efficiency. This study has addressed this issue by examining various retrofit measures for such typical masonry houses. Comparing the primary energy and the global costs in simplified way this study identifies the cost-optimal solution for the renovation of existing single-family masonry buildings. Considering a 20 to 30 years period for the payback of renovation investments, this study shows it is cost-efficient to target the refurbishment of the building envelope to an average U value of $\sim 0.2 \text{ Wm}^{-2}\text{K}^{-1}$ (scenario 19, Table 3) for the case of existing single family masonry buildings.

6. Acknowledgements

This research has been financially supported, in part, by the *Ministry of Education, Science and Technology* of the Republic of Kosovo (masht.rks-gov.net). Original project title “*Levërdia Ekonomike e Masave për Eficiencë Energjetike në Sanimin e Ndërtesave Ekzistuese*”, project code LEMENS (prot.no. 1529/2 date 26.04.2017).

References

- [1] MZHE. 2013. Balanca Vjetore e Energjise e Republikes se Kosoves per vitin 2014. Ministria e Zhvillimit Ekonomik, Republika e Kosoves. Prishtine, dhjetor 2013 (mzhe-ks.net)
- [2] UNDP. 2007. Energy for Development – Human Development Report (www.ks.undp.org, last accessed 18.06.2018)
- [3] Bowen B H, Myers J A, Myderrizi A, Hasaj B, Halili B. Kosovo Household Energy Consumption – Facts and Figures. AUK-RIT Center for Energy and Natural Resources, March 2013, Prishtinë, Kosovo
- [4] The Energy Efficiency Directive 2012/27/EU (“EED”).
- [5] EC. 2010. Directive 2010/31/EU on the Energy Performance of Buildings. European Commission, L153/13, OJEU, Strasbourg, AT, 2010.
- [6] ISO. 2017. ISO 52016-1:2017. Energy performance of buildings -- Energy needs for heating and cooling, internal temperatures and sensible and latent heat loads -- Part 1: Calculation procedures (<https://www.iso.org/standard/65696.html>, last accessed 18.06.2018)
- [7] IEA. 2017. Annex 56. (<http://www.iea-annex56.org/>, last accessed 18.06.2018)
- [8] ASK. 2013. Banesat dhe ndërtesat sipas komunave. Agjencia e Statistikave e Kosoves, Prishtine, dhjetor 2013 (ask.rks-gov.net)

- [9] Instituti Hidrometeorologjik I Kosovws. Vjetari Hidrometeorologjik 2014. MMPH, AMMK, IHK, Shtator 2016 (http://www.ammk-rks.net/repository/docs/Vjetari_Hidrometeorologjik_-_2014_-_Alb_-_Web_New.pdf, last accessed 18.06.2018)
- [10] Degree Days. Custom Degree Day Data (<http://www.degreedays.net/>, last accessed 18.06.2018)
- [11] Global Solar Atlas. World Bank Group. Global Horizontal Radiation Map: Kosovo. (<http://globalsolaratlas.info/downloads/kosovo>, last accessed 18.06.2018)
- [12] IEA. 2017. Shining Examples of Cost-Effective Energy and Carbon Emissions Optimization in Building Renovation (Annex 56) (<http://www.iea-annex56.org/>)