

ENERGY EFFICIENT CONTROL FOR COMPRESSED AIR WITH STEP  
MODULATION TECHNIQUE

JANARTHANAN RAMASAMY

A project report submitted in partial fulfilment  
of the requirements for the award of degree of  
Master of Engineering (Electrical-Power)

Faculty of Electrical Engineering  
Universiti Teknologi Malaysia

JANUARY 2014

Dedication to my beloved Mother, HEE AH FONG, and my wife, Rajeswari Supramanian whom support me, physically, mentally and emotionally, throughout my Master's study.

For my siblings and friends, appreciate your encouragement and help. To all my lecturers, you are my inspiration for today and future time. Thank you everyone and only the universal supreme can bestow just reward to all of you.

## ACKNOWLEDGEMENT

First of all, I would like to expressed my gratitude to universal supreme for giving me a faith and strength to complete this project. My next highest appreciation goes to my project supervisor,. Dr. Md. Pauzi Bin Abdullah, who had continuously giving me guidance, ideas, support for this project. His support and understanding had facilitate me to complete the project and my thesis writting.

Last but not least, I would like to express my gratitude to all my families member, friends and people that involve directly or indirectly in the process to complete this project.

## **ABSTRACT**

The compressed air system is not only an energy intensive utility but also one of the least energy efficient. Over a period of time, both performance of compressors and compressed air system reduces drastically. The causes are many such as poor maintenance, wear and tear of equipment. The thesis presents the Energy efficient control for compressed air by using step modulating technique, which would optimize the energy consumption for the compressed air. The proposed technique has been tested on actual industrial consumer site. By adding the VSD “Variable Speed Drive” to the conventional control compressed air and by regulation the prime mover speeds on unloading cycle with step modulation technique it is discovered that the electrical energy consumption of the compressed air system has been optimized. This will give a prominent saving to the consumer in term of utility bill. From the analysis results, it showed that the saving of 22% can be achieved.

## ABSTRAK

Pemampat angin adalah sebuah jentera yang menggunakan tenaga elektrik yang amat tinggi pada kecekapan yang terlalu rendah. Jika ia dinilai dari segi operasi peralatan pada satu jangka masa tertentu, dari segi kecekapan peralatan dan sistem pemampat angin akan berkurang secara mendadak. Ini adalah disebabkan kerana penyelenggaraan yang tidak teratur serta kehausan pada bahagian peranti mekanikal. Thesis ini membentangkan kecekapan pegawalan tenaga untuk pemampat angin dengan menggunakan pendekatan pengurangan beperingkat, ia secara terus akan meningkatkan kecekapan pemampat serta mengurangkan penggunaan tenaga. Cara yang dicadangkan ini telah diuji disalah sebuah industri pengguna pemampat angin. Dengan pemasangan sebuah pemacu pengawal kelajuan “Variable Speed Drive” secara terus kedalam pemampat angin yang menggunakan pengawal biasa, dimana kelajuan pemacu utama dikurangkan pada waktu pemampatan tidak berbeban, dengan cara pengurangan yang dicadangkan didapati penggunaan tenaga elektrik dapat dikurangkan secara terus. Ini bukan sahaja memberikan manfaat kepada pengguna dari segi peningkatan kecekapan peralatan tetapi juga tenaga elektrik. Daripada analisis keputusan didapati pengurangan tenaga sebanyak 22% telah dicapai.

## TABLE OF CONTENTS

<b>CHAPTER</b>	<b>TITLE</b>	<b>PAGE</b>
	<b>DECLARATION</b>	i
	<b>DEDICATION</b>	ii
	<b>ACKNOWLEDGEMENT</b>	iii
	<b>ABSTRACT</b>	iv
	<b>ABSTRAK</b>	v
	<b>TABLE OF CONTENT</b>	vi
	<b>LIST OF TABLES</b>	ix
	<b>LIST OF FIGURES</b>	x
	<b>LIST OF ABBREVIATIONS</b>	xiii
	<b>LIST OF APPENDICES</b>	xiv
<b>1</b>	<b>INTRODUCTION</b>	
	1.1 Compressor Overview	2
	1.2 Compressor System Overview	4
	1.3 Type of Air Compressor	7
	1.4 Compressed Air Control Overview	10
	1.5 Estimation of Energy cost	10
	1.6 Problem Statement	12
	1.7 Objectives	15
	1.8 Project Scope	15
	1.9 Significance of Project	16
	1.10 Organization of Report	17

<b>2</b>	<b>LITERATURE REVIEW</b>	
2.0	Introduction	18
2.1	Compressor Control Method	19
2.1.1	On / Off Control	19
2.1.2	Load / Unload Control	20
2.1.3	Modulating Control	21
2.1.4	Variable Speed Drive	22
2.1.5	L-SR drive Method control	22
<b>3</b>	<b>METHODOLGY</b>	
3.0	Introduction	25
3.1	Flowchart of the project	26
3.2	Selection of Compressed Air	28
3.3	Selection of Unload period Compressed Air	28
3.4	Load Profile Study on 15 H.P. Compressed Air	29
	“AIRMAN”	
3.5	KEW6310 analysis Software 2.04	30
3.6	Load Profile analysis	31
3.7	Cost Base optimization	32
3.8	Step modulation technique Overview	38
3.9	Project Implementation	48
<b>4</b>	<b>RESULT AND DISCUSSION</b>	
4.1	Payback Period and Economic analysis	52
4.2	Logged data of “AIRMAN” Load / Unload	54

	Method control compressor	
4.3	Logged data of AIRMAN compressor with step modulation technique.	56
4.4	Summary of Result	58
<b>5</b>	<b>CONCLUSION AND FUTURE WORK</b>	
5.1	Conclusion	61
5.2	Recommendation Of Future work	62
	<b>REFERENCES</b>	63
	<b>APPENDIX</b>	66



**LIST OF TABLES**

<b>TABLE NO.</b>	<b>TITLE</b>	<b>PAGE</b>
3.1	Price list of Electrical Component	37
4.1	Energy Result consumption comparison Table	59

## LIST OF FIGURES

FIGURE NO.	TITLE	PAGE
1.0	Conversion of Atmospheric Air into Compressed Air	2
1.1	Compressed Air Energy Input and Useful Energy Output (Adapted from Northwest Energy Alliance)	3
1.2	Common Air Compressor System Components	5
1.3	Shown twin screw air compressor general layout	9
1.4	Shown Compressed Air process in twin screw compressor	9
1.5	Typical Lifetime Ownership Cost of Compressed Air Systems.	11
1.6	Load Graph Cutout view on real data	13
1.7	Load graph and Air pressure combination	14
1.8	15H.P Air compressor brand ‘AIRMAN’	16
2.1	Motor energy consumption comparisons	21
2.2	Required air system pressure 100 psig minimum	23
2.3	Graphical comparisons of L-SR and conventional Control method vs. Air demand	24
3.1	Flowchart of Energy Optimization	27
3.2	Power Quality Analyzer KEW 6310	29
3.3	KEW 6310 Analysis Software V2.04	30
3.4	Load graph profile from 15H.P. AIRMAN compressor	32
3.5	Ideal Load graph	33
3.6	Energy cost calculation by the KEW6310 software	34
3.7	Ideal load profile graph on unload period	35
3.8	Air Pressure data pattern logged with HMI unit through	40

	SIEMENS S7-300 PLC unit.	
3.9	Liner Air pressure descending gradient graph	40
3.10	Compressor controller Function Block develops in SIMATIC MANAGER Step 7 Software.	41
3.11	Unscaling Values to convert real value to Controller output resolution.	42
3.12	Pressure input value Scaling block to real number	43
3.13	sampling clock patterns	43
3.14	Flow chart of Preset setpoint Accumulation	45
3.15	Step accumulation source code	46
3.16	Function block of Step accumulation control	46
3.17	Source code of speed trimming	47
3.18	process of step modulation the compressor motor power in ideal mode	48
3.19	SIEMENS S7-300 PLC control Logic	49
3.20	VSD Hitachi SJ700	49
3.21	Pressure transducer AP-C33W	50
4.1	Shown System integration of Step modulation Technique	53
4.2	Prime Mover Load Profile graph AIRMAN Load / Unload	54
4.3	Energy calculators Data Input windows	55
4.4	Energy Reports for AIRMAN with load / Unload	55
4.5	Prime Mover load profile graph with Step modulation Technique	56
4.6	Energy calculators Data Input windows	57
4.7	Energy Reports for AIRMAN with step modulation technique	57

4.8	Comparison Load profile graph with (a) step modulation and (b) Load / unload	58
4.9	Comparison of Energy consumption in kWh before and after implementation.	60
4.10	Comparison of Electricity Bill in RM before and after implementation	60

**LIST OF ABBREVIATION**

R.O.I		Return Of Investment
D.O.E		Department Of Energy U.S
bhp		Load Horsepower
H.P.		Horse Power
Pmin	-	Minimum Power
Pmax	-	Maximum Power
VSD		Variable Speed Drive
R.P.M		Revolution Per Minutes
Sr		Synchronous Slip factor
Bar		Pressure Unit
Psig		pressure unit in per square inch gauge
Kwatt		Electric unit kilo watt

**LIST OF APPENDIX**

<b>APPENDIX</b>	<b>TITLE</b>	<b>PAGE</b>
A	Electrical Diagram	66
B	LS-R Method Manual	68

## **CHAPTER 1**


### **INTRODUCTION**

Generally the Air compressor is a mechanical energy producer, it was power by electric Motor to generate, store and distribute energy in the form of compressed air for use throughout a plant. In a compressed air system, a single set of compressors can supply power to machines all over the plant, thus eliminating the need for numerous and dispersed electric motors. This advantage must be balanced against the relative poor energy efficiency of compressed air systems, which can be as low as 20% [1], when leaks and part-load control losses are taken into account. A recent survey by the U.S. Department of Energy showed that for a typical industrial facility, approximately 10% of the electricity consumed is for generating compressed air. For some facilities, compressed air generation may account for 30% or more of the electricity consumed [2]. Compressed air is an on-site generated utility. Very often, the cost of generation is not known; however, some companies use a value of 18-30 cents per 1,000 cubic feet of air.

On a national scale, air compressors rank only behind pumps in terms of industrial motor drive electricity consumption. Thus, increasing the efficiency of compressed air systems can result in significant energy savings.

## 1.1 Compressor Overview

Compressed air is a form of stored energy that is used to operate machinery, equipment, or processes. Compressed air is used in most manufacturing and some service industries, often where it is impractical or hazardous to use electrical energy directly to supply power to tools and equipment. Powered by electricity, a typical air compressor takes approximately 7 volumes of air at atmospheric conditions, and squeezes it into 1 volume at elevated pressure (about 100 psig, [7 bars]). The resulting high pressure air is distributed to equipment or tools where it releases useful energy to the operating tool or equipment as it is expanded back to atmospheric pressure [1]. In the compression process 1 bar atmospheric conversion to 7 bars with excessive heat and through the subsequent cooling of the air back to ambient temperatures, heat and moisture, are released as illustrated in Figure 1.0.

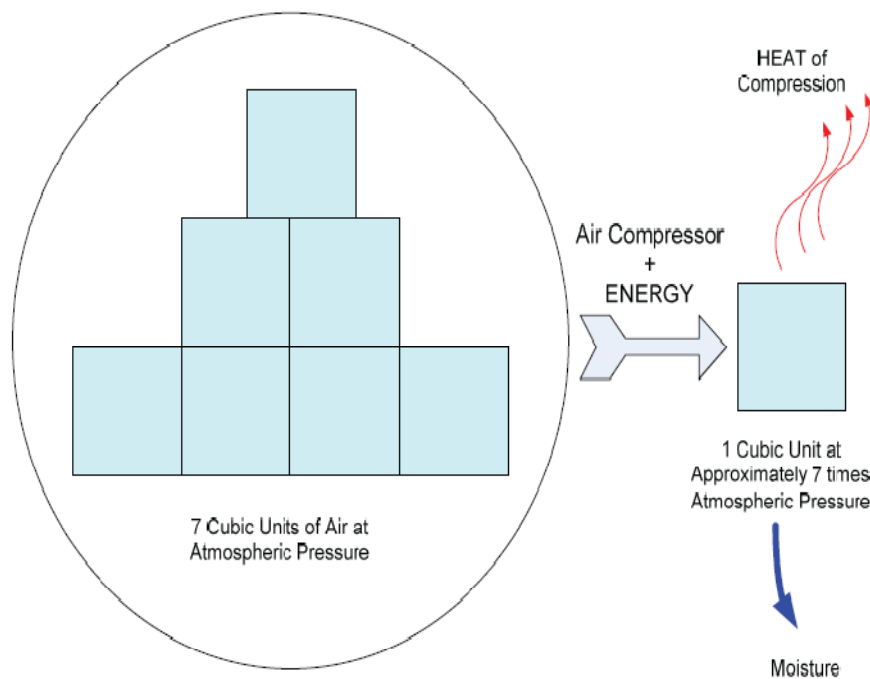


**Figure 1.0 Conversion of Atmospheric Air into Compressed Air**



Recovered heat from the air compressor can potentially be used as an energy efficiency measure for other processes, such as space and water heating. Depending on the application, excessive moisture in compressed air needs to be managed as it can cause problems with piping (corrosion) and end use equipment.

Figure 1.1 illustrates the typical losses associated with producing and distributing compressed air [1]. Assuming 100 HP energy input, approximately 91 HP ends up as losses, and only 9 HP as useful work. In other words, about 90% of the energy to produce and distribute compressed air is typically lost.

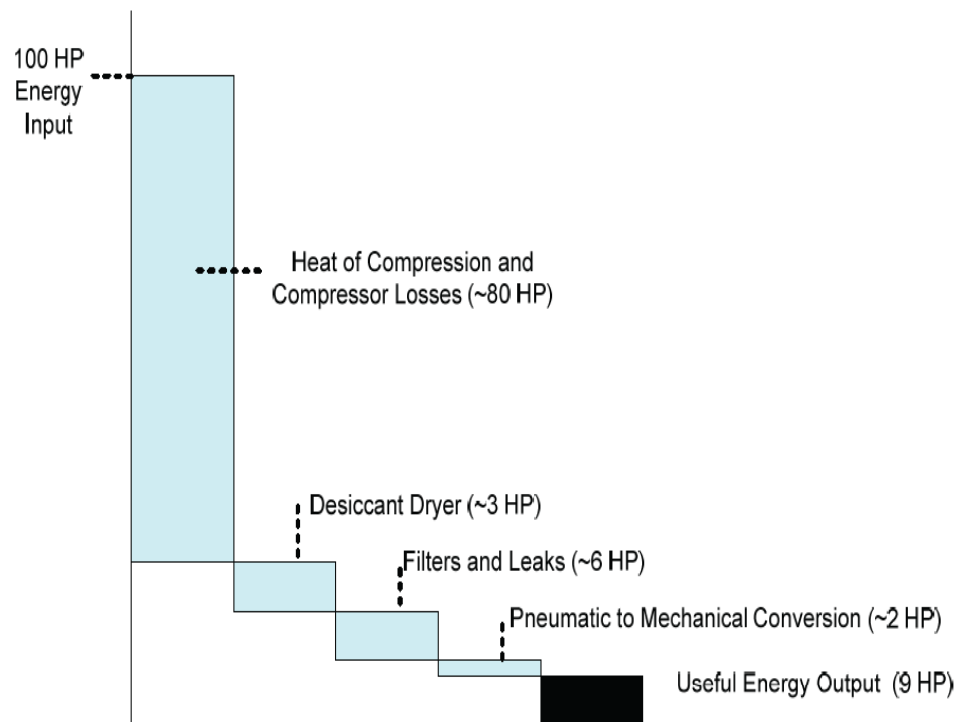

**Figure 1.1 Compressed Air Energy Input and Useful Energy Output (Adapted from Northwest Energy Alliance)**

## 1.2 Compressor System Overview

Compressed air systems consist of a number of major subsystems and components. Compressed air systems can be subdivided into the Supply and Demand side.

The Supply side includes compressors, air treatment and primary storage. A properly managed supply side will result in clean, dry, stable air being delivered at the appropriate pressure in a dependable, cost effective manner. Major compressed air supply subsystems typically include the air intake, air compressor (fixed speed and/or variable speed), after cooler, motor, controls, treatment equipment and accessories.

Controls serve to adjust the amount of compressed air being produced to maintain constant system pressure and manage the interaction between system components. Air filters and Air dryers remove moisture, oil and contaminants from the compressed air. Compressed air storage (wet and dry receivers) can also be used to improve system efficiency and stability. Accumulated water is manually or automatically discharged through drains. Optional pressure controllers are used to maintain a constant pressure at an end use device.

The Demand side includes distribution piping, secondary storage and end use equipment. A properly managed demand side minimizes pressure differentials, reduces wasted air from leakage and drainage and utilizes compressed air for appropriate applications. Distribution piping systems transport compressed air from the air compressor to the end use point where it is required. Compressed air storage receivers on the demand side can also be used to improve system pressure stability.

As a rule of thumb, for every horsepower (HP) in the nameplate capacity, the air compressor will produce approximately 4 standard cubic feet per minute (scfm).

A simplified diagram illustrating how some of the major components are connected is shown in Figure 1.2.

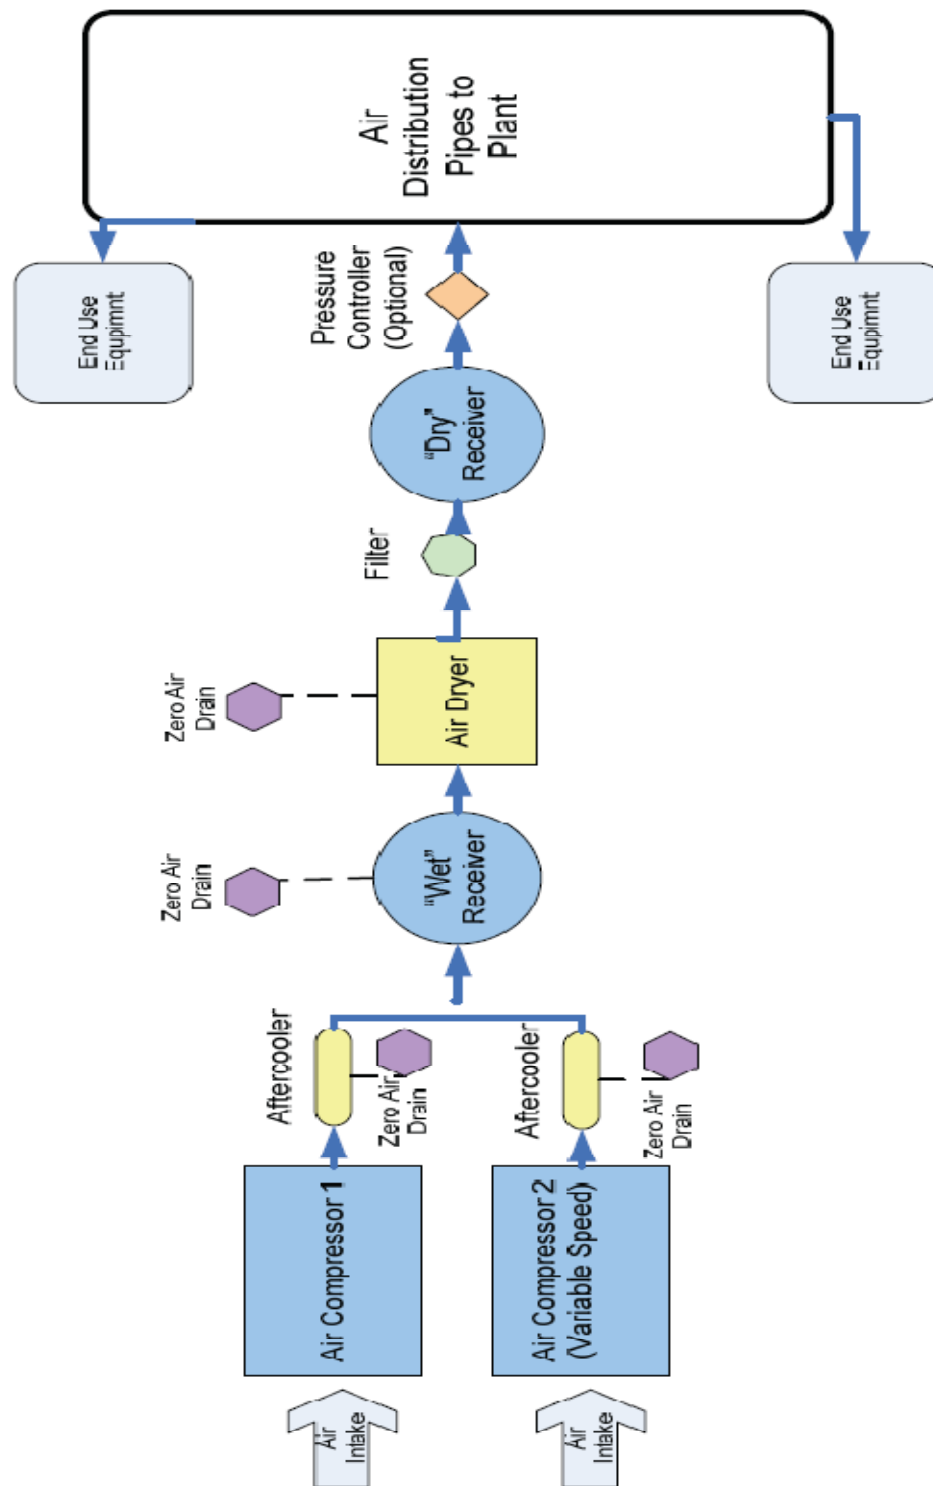


Figure 1.2 Common Air Compressor System Components

Compressed air is used for a diverse range of commercial and industrial applications. As it is widely employed throughout industry, it is sometimes considered to be the “fourth utility” at many facilities.

It has been common practice in the past to make decisions about compressed air equipment and the end uses based on a first cost notion. Ongoing energy, productivity and maintenance costs need to be considered for optimal systems. In other words, best practice calls for decisions to be based on the life cycle cost of the compressed air system and components.

Improving and maintaining peak compressed air system optimization requires addressing both the supply and demand sides of the system and understanding how the two interact.

Optimal performance can be ensured by properly specifying and sizing equipment, operating the system at the lowest possible pressure, shutting down unnecessary equipment, and managing compressor controls and air storage. In addition, the repair of chronic air leaks will further reduce costs.

For a typical compressed air end use, like an air motor or diaphragm pump, it takes about 10 units of electrical energy input to the compressor to produce about one unit of actual mechanical output to the work.

For this reason other methods of power output, such as direct drive electrical motors, should be considered first before using compressed air powered equipment. If compressed air is used for an application, the amount of air used should be the minimum quantity and pressure necessary, and should only be used for the shortest possible duration. Compressed air use should also be constantly monitored and reevaluated.

### 1.3 Type of Air compressor

There are two basic types of air compressors:

- i) Positive displacement, and
- ii) Dynamic.

- i) Positive Displacement.

In the positive displacement type, a specified quantity of air is trapped in a compression chamber and the volume which it occupies is mechanically reduced, causing a corresponding rise in pressure prior to discharge.

Rotary screw, vane and reciprocating air compressors are the three most common types of air positive displacement compressors found in small and medium sized industries.

- ii) Dynamic.

Dynamic air compressors include centrifugal and axial machines, and are used in very large manufacturing facilities. These units are beyond the scope of this document.

Here will discuss only for positive displacement compressor, the dynamic unit is not popular or common equipment use throughout industries in Malaysia.

### 1.3.1 Positive Displacement Compressor

A bicycle pump is the simplest form of a positive displacement compressor, where air is drawn into a cylinder and is compressed by a moving piston. The piston compressor has the same operating principle and uses a piston whose forward and backward movement is accomplished by a connecting rod and a rotating crankshaft. If only one side of the piston is used for compression this is called a single-acting compressor. If both the piston's top and undersides are used, the compressor is double acting.

The pressure ratio is the relationship between absolute pressure on the inlet and outlet sides. Accordingly, a machine that draws in air at atmospheric pressure 1 bar (a) and compresses it to 7 bar overpressure works at a pressure ratio of  $(7 + 1)/1 = 8$ . Sample positive displacement compressed air illustrated in Figure 1.3 Twin rotary screw compressor layout [3]. It is a most common compressor which has in service throughout Malaysia manufacturing industries in present day.

The principle for a rotating displacement compressor in twin screw form was developed during the 1930s, when a rotating compressor with high flow rate and stable flow under varying pressure conditions was required.

The twin screw element's main parts are the male and female rotors, which rotate in opposite directions while the volume between them and the housing decreases. Each screw element has a fixed, build-in pressure ratio that is dependent on its length, the pitch of the screw and the form of the discharge port. To attain maximum efficiency, the build-in pressure ratio must be adapted to the required working pressure.

The screw compressor is generally not equipped with valves and has no mechanical forces that cause unbalance. This means it can work at a high shaft speed and can combine a large flow rate with small exterior dimensions. An axial acting force, dependent on the pressure difference between the inlet and outlet, must be

overcome by the bearings. The process of air compression has illustrated in Figure 1.4 [4].

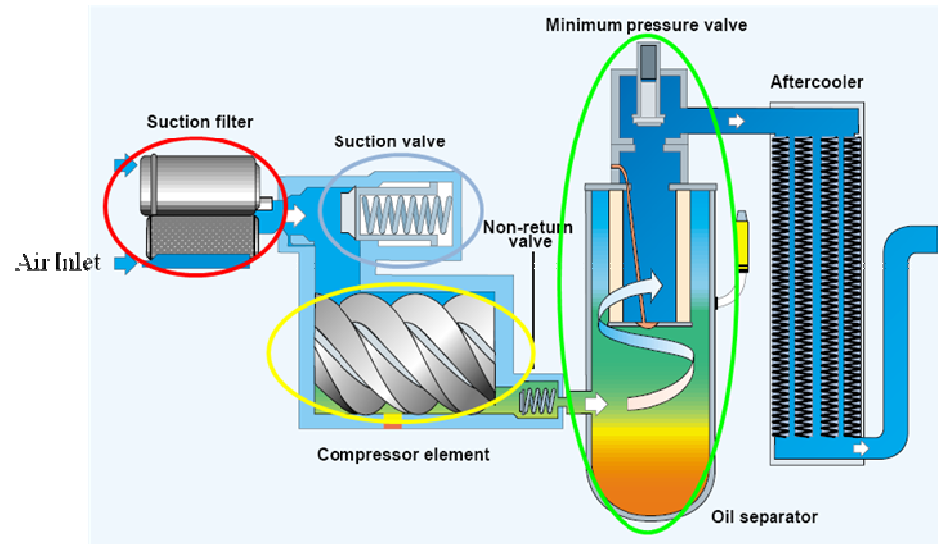


Figure 1.3 Shown twin screw air compressor general layout

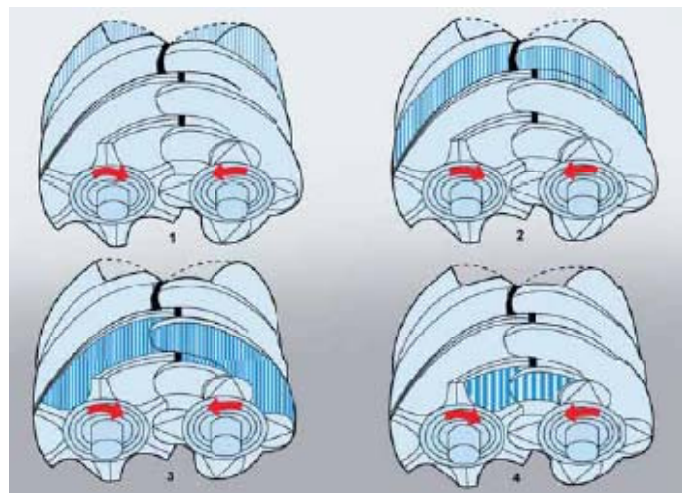


Figure 1.4 Shown Compressed Air process in twin screw compressor

## 1.4 Compressed Air control overview

As air systems seldom operate at full load all of the time, the ability to efficiently control flow at part loads is essential. Consideration should be placed to both compressor and system control selection as they are important factors affecting system performance and energy efficiency. For the positive displacement compressed air the most common method to control was load/unload, this control mode is sometimes called online/offline control.

It keeps the motor running continuously, but unloads the compressor when the discharge pressure is adequate by closing the inlet air suction valve. Unloaded rotary screw compressors typically consume 50% - 75% of their full load power demand, while producing no useful compressed air output. The detail compression about the control method will discuss in literature review.

## 1.5 Estimation of energy cost

Compressed air is one of the most expensive sources of energy in a plant. The over-all efficiency of a typical compressed air system can be as low as 10%-15%. For example, to operate a 1-horsepower (hp) air motor at 100 pounds per square inch gauge (psig), approximately 7-8 hp of electrical power is supplied to the air compressor. To calculate the cost of compressed air in your facility, use the formula shown below [2]:

$$\text{Cost (\$)} = \frac{(\text{bhp}) \times (0.746) \times (\# \text{ of operating hours}) \times (\$/\text{kWh}) \times (\% \text{ time}) \times (\% \text{ full-load bhp})}{\text{Motor Efficiency}}$$



Where:

**bhp**—Motor full-load horsepower (frequently higher than the motor nameplate horsepower—check equipment specification)


**0.746**—conversion between hp and kW

**Percent time**—percentage of time running at this operating level

**Percent full-load bhp**—bhp as percentage of full-load bhp at this operating level

**Motor efficiency**—motor efficiency at this operating level.

Assumes the compressor average loading is 65% of full load, over the first ten years of life of a typical air cooled compressor as shown in figure 1.5, with two shift operation, the operating cost (electricity and maintenance) will equal about 88% of the total lifetime cost. The cost of the original equipment and installation will account for the remaining 12% [5].

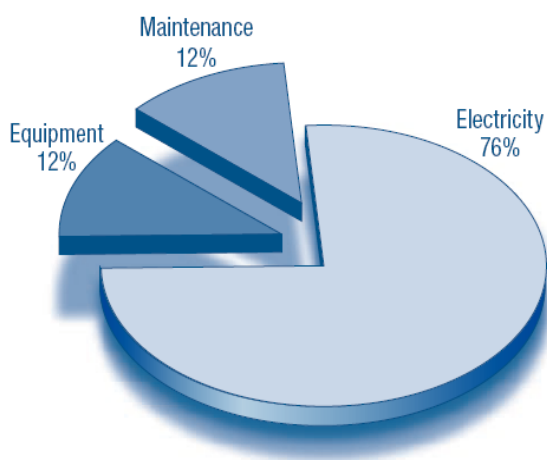

**Figure 1.5 Typical Lifetime Ownership Cost of Compressed Air Systems.**

## 1.6 Problem Statement

The discussion on problem statement will base on load graph analysis as illustrated in Figure 1.6. This load graph has been logged at one of the customer (Jayaplastic Industries (M) Sdn. Bhd.), 100 H.P (75Kwatt) Compressed air. To start to analysis load profile graph, should have a good understanding on the behavior of compressed air prime mover (Electric Motor). Naturally the asynchronous motor is non liner torque characteristic due to rotor construction [6]. It has differences compare to DC electric motor, where this motor proportionally liner to current versus torque. On the asynchronous motor the stator rotating magnetic field speed and rotor speed had differentiate by slip factor ( $S_r$ )[7]. Where the slight drop on slip ( $S_r$ ) factor of synchronous speed from rated the current will increased tremendously [6]. The motor not only became inefficient on power consumption, but as speed decreases it will proportionally affects the compressed air performance. For the compression process speed will determined the loading cycle time period, slower the speed the longer the time will consume to generated 7 bars air pressure. Usually the pressure high and low setpoint differentiated by 1 Bar. For unloading cycle time period, will base on setting of lowest point to start compression process versus demanded air volume discharge. This has illustrated at the same load graph by overlapping of pressure graph on to compare the affect lowest set point and electric motor performance and energy wastage area. The detail discussion will illustrate in further discussion.

### 1.6.1 Load graph analysis

This power data has logged from 75Kwatt power electric motor for Sullair compressed Air by using KEW6310 power quality analyzer. The logged data has converter by KEW PQA MASTER Ver2.04 software to graph form for further analysis. The motor detail has listed:

Rated Power (kW)	= 75
Rated Current (Amp)	= 147
Rated R.P.M	= 1430
Rated Voltage (Volt)	= 415

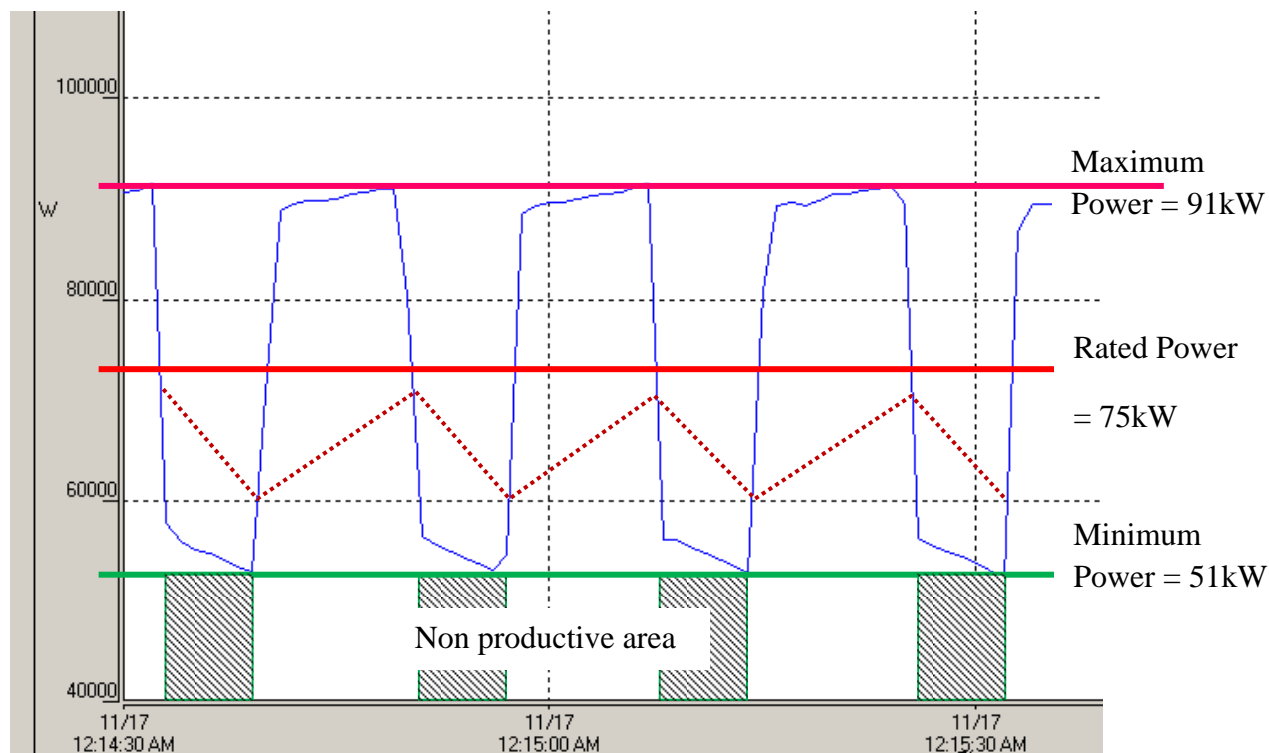


Figure 1.6 Load Graph Cut view on real data

There is few lines had been drawn onto load graph to indicate the rated power, minimum power and maximum power consume by the electric motor of sullair compressed air. Practically the energy consume by the motor should equal or less to rated power, but if the observation goes deeply with the guide of references line on loading period the power consume are more than rated nearly to pull out point, and the power consume on the unloading time nearly 70% from the rated power. The evaluation analyses for the prime mover rated power either wastage on loading period will not discussion. That is not our point of analysis, this analysis going with existed prime mover where try to find room of the potential saving.

Obviously there are existences of non productive area, with some amount power was consume. From this consumption point of power, we could pull down to optimum point by regulating the speed. The power consumption for entire system will reduce proportionally.

This is not only given energy saving, if it has compared to existing system it has also increased the compressor efficiency. To do so there is device call VSD (Variable speed Drive) need to be employ into existing system. The next step is to choose appropriate of technique to regulate the speed, with the following question rise “how to regulate the speed?”. To answered the question is a challenge where need to have a proper analysis to sure the control does not fail on the system reliable operation. This will further discussed in chapter 2.

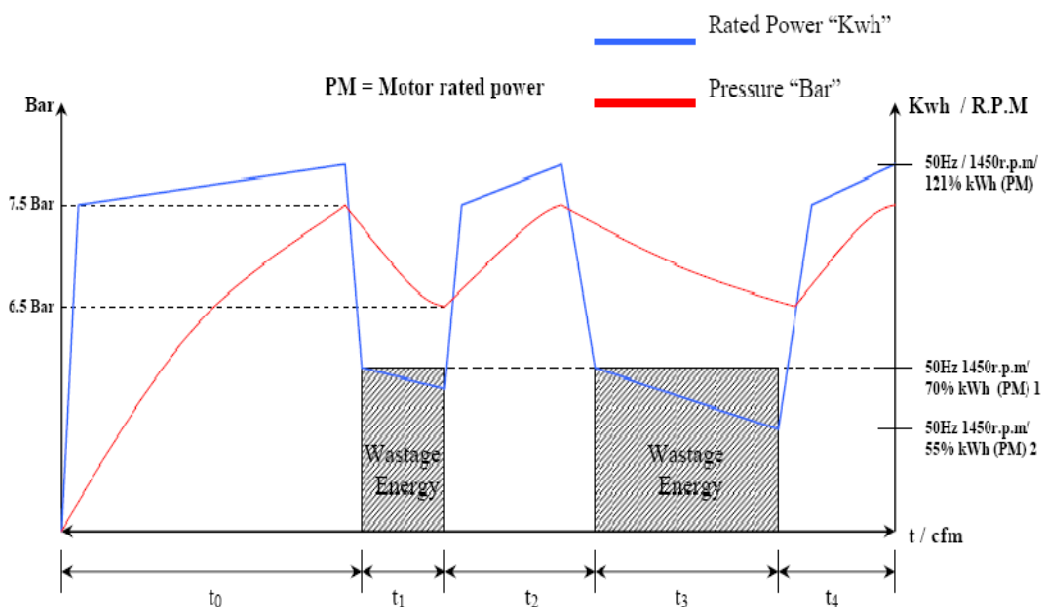


Figure 1.7 Load graph and Air pressure combination

## 1.7 Objective

The objective of this project:

- a) To Study Air compressor control system, unload cycle and Electrical load characteristics. To identify the potential energy saving in air compressor system.
- b) To propose and implemented the Low cost control strategy for Air compressor to minimize energy consumption for *existing conventional method control air compressor*.
- c) To analysis the impact of the propose energy efficient control on energy saving as well as the Return of Investment (ROI).

## 1.8 Project scope

The proposed energy solution going too implemented at one of our customer place located at Kota kemuning Shah Alam, PPR extrusion pipe manufacture (George Fisher (M) Sdn. Bhd). The 15H.P compressed air, brand Airman going to emphasis the propose method to review practical result on the energy consumption. The detail result will discuss on chapter 4. As show in the figure 1.8 was the chosen compressed air. As discussed early we are going to regulate the prime mover speed to achieve the energy saving. This project focus is not going to refurbish or redesign the existing system we just want to add in the VSD and pressure sensor to regulate the prime mover speed on unloading period with chosen appropriate control method through the initial analysis. The final control method will discuss in chapter 3.



Figure 1.8 15H.P Air compressor brand 'AIRMAN'

### **1.9 Significance of the project**

This project is not only will focus on saving but throughout the analysis process, consumers have a chance of awareness on compressed air operation efficiency and system arrangement. For most case those already have awareness they may need little idea to make the system became slightly efficient compare to present in operation. Even the saving may not significant to low demanded manufacture process, but it significant for those manufacturing process use the compressed air energy 100%.

## 1.10 Organization of the reports

In general, this report mainly consists of five main chapters; introduction, literature review, methodology and implementation of new control method to compressed air, finally other two chapters will cover on Final results and conclusion and future work of improvement.

The chapter one discussed the research project in collectively. This chapter explained the crucial aspect of the research work such as background studies, objectives, research scopes and methodology as well the thesis outline will also be discussed finally.

The chapter two completely dedicated to literature review, which will review about available control methodology and energy consumption from point of electrical aspect, on point mechanical aspect restructure of storage tank redesign this will discussed briefly the complete theory will attach in appendix, problem on the existing system of prime mover, and implementation step modulation technique with consequent problem. To have more reliable control more study required to ensure the objective of project able to meet.

The chapter three has dedicated to review on implementation technique and step modulating method. In this chapter discussion will completely on control equipment, speed regulation technique, sampling time and data analysis by the controller.

The chapter four was dedicated to analysis the result of the implementation technique, this is too sure give significant improvement on energy saving, this chapter will enclosed with conclusion.

The final chapter fully dedicated to brief to the future work and improvement to this project, to sure it has can useable for all type compressor with more reliable control.

## REFERENCES

- [1] <http://oee.nrcan.gc.ca/sites/oee.nrcan.gc.ca/files/pdf/industrial/equipment/compressed-air-ref/pdf/compressed-air-ref-eng.pdf>
- [2] <http://www.eere.energy.gov/informationcenter/>, Department of Energy's office of Energy Efficiency and Renewable Energy.
- [3] Energy Efficiency Best practice guide Compressed Air System [www.sustainability.vic.gov.au](http://www.sustainability.vic.gov.au).
- [4] [www.atlascopco.com/.../Compressed\\_Air\\_Manual\\_tcm44-1249312.pdf](http://www.atlascopco.com/.../Compressed_Air_Manual_tcm44-1249312.pdf)  
compressed air references manual.
- [5] [www.mntap.umn.edu/greenbusiness/energy/82-CompAir.pdf](http://www.mntap.umn.edu/greenbusiness/energy/82-CompAir.pdf) Technical assistance program.
- [6] Application Manual for NEMA motor SIEMENS [www.industry.usa.siemens.com](http://www.industry.usa.siemens.com).
- [7] Electric machinery Fundamental, Third Edition Stephen J.Chapman McGRAW-HILL.
- [8] General Air compressor L-SR drive system manual [www.genaircomp.com/](http://www.genaircomp.com/) .



- [9] Abels, B. and Kissock, K, Optimizing Compressed Air Storage for Energy Efficiency by University of Dayton ;11 SDP-0056 .
- [10] Customer portfolio [www.cairoengineering.com.my](http://www.cairoengineering.com.my).
- [11] Hitachi price list [www.Hitachi.us](http://www.Hitachi.us).
- [12] TNB Tariff rate manual [www.tnb.com.my/.../Tariff%20Rate%20Final%20%201%20June%202011.pdf](http://www.tnb.com.my/.../Tariff%20Rate%20Final%20%201%20June%202011.pdf) .
- [13] Kaesser Compressor operational manual.
- [14] Good practice guide for Energy Efficient compressed air system [www.thecarbontrust.co.uk/energy](http://www.thecarbontrust.co.uk/energy).
- [15] Compressed Air Case study IRISH Energy Center [www.irish-energy.ie](http://www.irish-energy.ie) .
- [16] Jianjun Xu+ and Yupeng Tang Electrical Engineering School of Beijing Jiaotong University, Beijing Jiaotong University Beijing, **The Automatic Control System of Air Compressor for Saving Energy ICCEE 2010 : 10.7763/IPCSIT.2012.V53.No.2.62.**
- [17] Selection Guide for energy saving product manual <http://energysaving.smc.au>.
- [18] Energy Efficiency Policy Opportunites for Electric Motor-Driven System [www.iea.org](http://www.iea.org).
- [19] *Energy Efficiency Guide for Industry in Asia* – [www.energyefficiencyasia.org](http://www.energyefficiencyasia.org).

[20] Code and Standard Enhancement Initiative (CASE) Compressed Air, by California Utilities Statewide Codes and Standards Team November 2011.

[21] Dealing with High volume Intermitten Demands, By Ron Marshall and Bill Scales Compressed Air best practice [www.airbestpractice.com](http://www.airbestpractice.com).

[22] Jonathan B. Maxwell, PE, Energy Resource Solutions, Inc. Compressed Air Data logger Onset Computer cooperation <http://www.onsetcomp.com>.