

**FIRE SAFETY AND PROTECTION MEASURES
IN HERITAGE BUILDINGS WITH SPECIAL
CONSIDERATION ON MUSEUM BUILDINGS IN
MALAYSIA**

by

NURUL HAMIRUDDIN BIN SALLEH

**Thesis submitted in fulfilment of the requirements
for the degree of
Doctor of Philosophy**

July 2011

*This thesis is dedicated to
my dearest parents,
Allahyarham Hj. Salleh bin Harun (1930-2007) and
Allahyarhannah Hj. Fatimah bt. Alang Klimun (1936-2010),
may Allah s.w.t. forgives their sins and shortcomings and
admits their souls into Jannah.*

I hereby declare that I have read this thesis and in my opinion this thesis is sufficient in terms of scope and quality for the award of the degree of Doctor of Philosophy (Architecture).


Signature :

Name of Supervisor : PROFESSOR DR. A GHAFAR AHMAD

Date :

DECLARATION

I hereby declare that the thesis is based on my original work except for quotations and citations which have been duly acknowledged. I also declare that it has not been previously or concurrently submitted for any other degree at Universiti Sains Malaysia or other institutions.

Signature : 

Name : NURUL HAMIRUDDIN BIN SALLEH

Date : 29 JULY 2011

ACKNOWLEDGEMENT

بِسْمِ اللَّهِ الرَّحْمَنِ الرَّحِيمِ

In the name of Allah, the Most Gracious and the Most Merciful

First and foremost, I would like to express my utmost praise and gratification to Allah (*Subha na huwa taala*), the Creator of all mankind, for the guidance, ease and blessings that He has provided me throughout the journey of obtaining my PhD.

I have a number of people to thank for their assistance, guidance, support, wisdom and friendship throughout the research. Without that assistance, the task would not have been completed and I am indebted to them.

My deepest appreciation goes to my supervisor, Professor Dr. A Ghafar Ahmad, who is now seconded as the Deputy Commissioner of Heritage to the Department of National Heritage Malaysia for his profound knowledge and intellectual expertise in the realm of architectural conservation, his belief in my ability to produce the thesis as well as his invaluable guidance and constructive criticisms throughout the whole challenging process of producing the thesis.

I would also like to express the deepest gratitude to my external examiner, Professor Dr. Mohd Hamdan Ahmad and internal examiners, Associate Professor Dr. Muna Hanim Abdul Samad and Associate Professor Dr. Ahmad Sanusi Hassan for their valuable advices and constructive comments.

Special thanks go to En. Rosli Mohd Nor, Pn. Farizah Idris, En. Sharudin Mohamad Som and En. Khalid Syed Ali from the Department of National Heritage Malaysia; Tuan Ahmad Izram Osman and Tuan Hamdan Daud of the Putrajaya Fire and Rescue Department;

Pn. Roslina Harun of the Kuala Lumpur Fire and Rescue Department; En. Wan Jamaluddin Wan Yusooof, En. Esa Haron and En. Mohd Shawali Badi from the Department of Museums Malaysia; Pn. Rahimah Mat, Pn. Norhanisah Ahmad, En. Sabki Ibrahim, Dato' Dr. Kamarul Baharin Buyong, En. Abdul Hadi Mutalib and those who contributed directly or indirectly but their names are not mentioned here.

I would like to thank the International Islamic University Malaysia for the study leave and the Ministry of Higher Education Malaysia for the scholarship given to pursue this study. A special thank also goes to my friends and colleagues for their continuous support and encouragement.

Last, but not least, I could not have gone through the painstaking journey for my PhD. without the encouragement and energy from my family, especially my beloved wife Nurlelawati Ab. Jalil, my daughter Nur Fatini, my sons Amir Muzaffar and Amir Muhsin, my parents and my siblings. I thank my family for their constant prayers and encouragement for my success, and I thank my daughter and sons, who have given me reasons to cheer during the hard times, and have inspired my optimism and determination to complete the study. Thank you all from the depth of my heart.

TABLE OF CONTENTS

	Page
Declaration	
Acknowledgement	ii - iii
Table of Contents	iv - vii
List of Tables	viii – ix
List of Figures	x
List of Plates	xi – xvii
List of Appendixes	xvii
Abstrak	xviii
Abstract	xix
CHAPTER 1: INTRODUCTION	
1.1 Introduction	1
1.2 Research Background	1 – 7
1.3 Problem Statements	
1.3.1 Heritage Buildings on Fire	7 – 11
1.3.2 Lack of Fire Safety Awareness	11 – 13
1.3.3 Many Buildings Not Compliance to the Fire Services Act 1988, Regulations and Order (Act 341)	13 – 15
1.3.4 Lack of Fire Safety Regulations and Guidelines for Heritage Buildings	15
1.4 Scope of Study	16 – 17
1.5 Objectives of Study	18
1.6 Research Framework	18
1.7 Significance and Benefits of Study	18
1.8 Structure of the Thesis	19 – 21
CHAPTER 2: FIRE SAFETY IN HERITAGE BUILDINGS	
2.1 Introduction	22
2.2 Fire Safety Objectives in Heritage Buildings	22 – 24
2.3 Fire Safety Problems in Heritage Buildings	24 – 26
2.4 Fire Safety Approach in Heritage Buildings	26 – 31
2.5 Heritage Buildings Loss to Fires	31 – 34
2.6 International Fire Safety Codes and Guidelines for Heritage Buildings	35 – 43
2.6.1 The National Fire Protection Association (NFPA)	37 – 39
2.6.2 Historic Scotland	40 – 41
2.6.3 The COST Action C17: European Fire Heritage Network	41 – 43
2.7 Legislations and Standards on Building Fire Safety in Malaysia	43 – 48

2.7.1	The Uniform Building By-laws 1984 (UBBL 1984)	44 – 45
2.7.2	The Fire Services Act 1988 (Act 341), Regulations and Order	45 – 46
2.7.3	The Occupational Safety and Health Act 1994 (Act 514)	46 – 47
2.7.4	Malaysian Standards	47 – 48
2.7.5	Other Guidelines	48
2.8	Research on Fire Safety of Heritage Buildings in Malaysia	49 – 51
2.9	Summary	51 – 52
CHAPTER 3: FIRE SAFETY MANAGEMENT IN BUILDINGS		
3.1	Introduction	54
3.2	The Principle of Fire	54 – 60
3.2.1	Science of Fire	54 – 55
3.2.2	Fire Stages	55 – 59
3.2.3	Fire Classification	59 – 60
3.3	Fire Safety Concept	60 – 61
3.4	Fire Protection in Buildings	61 – 65
3.4.1	Passive Fire Protection	63
3.4.2	Active Fire Protection	63 – 65
3.5	Human Behaviour and Fire	65 – 69
3.6	Fire Safety Management	69 – 85
3.6.1	Principles and Importance of Managing Fire Safety	70 – 74
3.6.2	Fire Safety Management Components	74 – 85
3.7	Summary	86
CHAPTER 4: HERITAGE BUILDING CONSERVATION IN MALAYSIA		
4.1	Introduction	88
4.2	Heritage Buildings in Malaysia	88 – 92
4.3	Building Conservation Approach	93 – 98
4.4	Architectural Conservation in Malaysia	99 – 103
4.5	Heritage Conservation Bodies in Malaysia	103 – 110
4.5.1	Government Agencies	104 – 107
4.5.2	Non-Governmental Organisations / Trusts	107 – 108
4.5.3	Higher Learning Institutions / Universities	109 – 110
4.6	Heritage Conservation Legislations in Malaysia	110 – 124
4.6.1	The National Heritage Act 2005 (Act 645)	111 – 117
4.6.2	The Local Government Act 1976 (Act 171)	117
4.6.3	The Town and Country Planning Act 1976 (Act 172)	118
4.6.4	The Federal Territory (Planning) Act 1982 (Act 267)	118 – 119

4.6.5	Preservation and Conservation of Culture Heritage of Melaka Enactment 1988 (Melaka Enactment No.6 of 1988)	119 – 120
4.6.6	The Sarawak Cultural Heritage Ordinance 1993	120
4.6.7	Johore Enactment No.7 of 1988	121
4.6.8	Conservation Guidelines	122
4.6.9	International Charters, Resolutions and Recommendations	123 – 124
4.7	Challenges in Architectural Conservation in Malaysia	125 – 128
4.7.1	Economic Development Pressure	125 – 126
4.7.2	Lack of Knowledge in Conservation Works	127
4.7.3	Ineffective Enforcement	127
4.7.4	Poor Public Awareness on Conservation	128
4.8	Summary	128 – 129
CHAPTER 5: RESEARCH METHODOLOGY		
5.1	Introduction	131
5.2	Methodology	131– 134
5.3	Data Collection	135 – 187
5.3.1	Literature Review	135
5.3.2	Observations	135 – 142
5.3.3	Interviews	142 – 144
5.3.4	Questionnaires	145 – 146
5.3.5	Case Studies	147 – 187
5.4	Summary	187
CHAPTER 6: ANALYSES AND FINDINGS		
6.1	Introduction	189
6.2	The Background of Respondents in Interviews and Questionnaires	189 – 191
6.2.1	The Background of Respondents in Interviews	189 - 190
6.2.2	The Background of Respondents in Questionnaires	190 - 191
6.3	Fire Safety and Protection Measures in the Studied Heritage Buildings	192 - 232
6.3.1	Fire Safety and Protection Measures in Case Study 1	192 - 205
6.3.2	Fire Safety and Protection Measures in Case Study 2	205 - 220
6.3.3	Fire Safety and Protection Measures in Case Study 3	220 - 232
6.4	Compliance with the Malaysian Legislations and Standards	232 – 249
6.4.1	The Requirements of the Uniform Building By-laws 1984 (UBBL 1984)	233 - 238
6.4.2	The Requirements of Fire Services Act 1988 (Act 341), Regulations and Order	239

6.4.3	The Requirements of Occupational Safety and Health Act 1994 (Act 514) & Regulations and Orders	239 – 240
6.4.4	The Requirements of MS 983: KELUAR Signs (Internally Illuminated)- Specifications (2004)	241 – 242
6.4.5	The Requirements of MS 1038: Part 1: Specification for Emergency Lighting of Premises - Premises Other Than Cinemas and Certain Other Specified Premises Used for Entertainment (1986)	242 – 245
6.4.6	The Requirements of MS 1539: Part 3: Specification for Portable Fire Extinguishers - Selection and Installation (2003)	246 – 248
6.4.7	The Requirements of MS 1539: Part 4: Specification for Portable Fire Extinguishers: Maintenance of Portable Fire Extinguishers - Code of Practice (2004)	249
6.5	Summary	250 - 251
CHAPTER 7: CONCLUSIONS AND RECOMMENDATIONS		
7.1	Introduction	253
7.2	Conclusions	253 – 257
	7.2.1 Majority heritage buildings in Malaysia with poor fire safety and protection measures	253 – 255
	7.2.2 Give higher priority to building security aspects	255 – 256
	7.2.3 No comprehensive fire safety regulations and guidelines for heritage buildings in Malaysia	256 – 257
7.3	Recommendation Guidelines	258 – 280
	7.3.1 Guidelines to install fire safety measures in heritage buildings	258 – 260
	7.3.2 Guidelines of fire safety measures in heritage buildings	261 – 270
	7.3.3 Guidelines on fire safety inspection in heritage buildings	271 – 276
	7.3.4 General guidance to improve fire safety management	277 – 280
7.4	Directions for Future Research	281
BIBLIOGRAPHY		282 – 302
APPENDIXES		303 – 343
LIST OF PUBLICATIONS		344

LIST OF TABLES

		Page
Table 1.1	Fire statistics for heritage buildings in Malaysia from 1992 – 2010	3
Table 1.2	Fire statistics in Malaysia from 2001 – 2008	7
Table 1.3	Statistics of causes of building fires in Malaysia for 2007 and 2008	8
Table 1.4	List of museum fires in the world (1958 - 2008)	10 – 11
Table 2.1	Fire safety objectives as stated in the NFPA 914: Code for Fire Protection of Historic Structures	27
Table 2.2	Principles in the insertion of fire detection and suppression systems in heritage buildings	29
Table 2.3	A list of high profile heritage buildings and locations that were lost in fire	33
Table 2.4	List of countries that have fire regulation goals specific to cultural heritage	36
Table 2.5	List of legislations and standards related to fire safety for buildings in Malaysia	44
Table 3.1	Fire classes in the USA, Europe, Australasia and Malaysia	60
Table 3.2	Occupant and building characteristics	67
Table 4.1	Definitions of significance and assessment criteria in international charters	96
Table 4.2	Statistic of international tourists to Malaysia from 2004 to 2008	100
Table 4.3	Important events in the cultural heritage conservation of Malaysia	102
Table 4.4	The list of international awards for Malaysian conservation projects	103
Table 4.5	List of National Heritage objects	114
Table 4.6	List of UNESCO and ICOMOS Charters, Resolutions and Recommendations	124
Table 5.1	Total number of museums in Malaysia	136
Table 5.2	The chronology of the establishment of museums in Malaysia	137
Table 5.3	List of surveyed museums	139
Table 5.4	Management of surveyed museums	140
Table 5.5	List of respondents in interview sessions	144
Table 5.6	Total respondents in questionnaires	146
Table 5.7	List of case studies	149
Table 5.8	The total number of visitors to museums under the Kelantan Museums Corporation in 2007 and 2009	176

		Page
Table 6.1	List of referred Malaysian legislations and standards	232
Table 6.2	Findings in accordance with the requirements of UBBL 1984	233 – 238
Table 6.3	Findings in accordance with the requirements of Act 341	248
Table 6.4	Findings in accordance with the requirements of Act 514	240
Table 6.5	Findings in accordance with the requirements of MS 983	241 – 242
Table 6.6	Findings in accordance with the requirements of MS 1038: Part 1	243 – 245
Table 6.7	Findings in accordance with the requirements of MS 1539: Part 3	247 – 248
Table 6.8	Findings in accordance with the requirements of MS 1539: Part 4	249
Table 6.9	Summary compliance with the requirements of Malaysian legislations and standards	251
Table 7.1	The advantages and disadvantages of fire safety management components	261 – 263
Table 7.2	The advantages and disadvantages of active fire protection systems	264 – 269
Table 7.3	The advantages and disadvantages of passive fire protection systems	270

LIST OF FIGURES

		Page
Figure 1.1	Buildings fire statistic in Malaysia for 2000 - 2008	12
Figure 1.2	Fire safety management problems in surveyed heritage buildings	15
Figure 1.3	Summary of thesis structure	21
Figure 2.1	Fire safety objectives in heritage buildings	23
Figure 2.2	Statistics of heritage buildings damaged due to fire in Scotland from 1992 – 2005	34
Figure 3.1	Fire triangle (Left). Fire tetrahedron (Right)	55
Figure 3.2	Fire growth curve	56
Figure 3.3	General fire safety objectives	61
Figure 3.4	Active fire protection systems	64
Figure 3.5	Flow model diagram of human behaviour in a fire incident	69
Figure 3.6	Fire safety strategy in a building	71
Figure 3.7	Key elements of successful health and safety management	72
Figure 3.8	Steps in fire safety planning and management	75
Figure 3.9	Fire risk assessment process	77
Figure 4.1	Heritage classifications	89
Figure 4.2	Organisation chart of the Department of National Heritage Malaysia	106
Figure 4.3	The process to designate a National Heritage site	115
Figure 4.4	The process to designate a Heritage site	116
Figure 5.1	Research framework	134

LIST OF PLATES

		Page
Plate 1.1	Traditional timber house ‘Rumah Pak Ali’ that built in 1876 was destroyed by fire in October 2003	2
Plate 1.2	The former High Court of Kuala Lumpur (1896) was twice destroyed by fire in 1992. The first fire occurred in 16 March 1992 when the building was undergoing renovation works (left) and later in December (right)	2
Plate 1.3	The Sarawak’s oldest club that known as the Sarawak Club (1876), was razed in an early morning fire on 27 July 2006	2
Plate 2.1	Retro-fitting services require careful integration in historically sensitive interiors	29
Plate 2.2	Any additions should be with as little physical damage to the fabric of heritage buildings as possible and minimum aesthetic intrusion	31
Plate 2.3	The Namdaemun Gate in Seoul, the South Korean landmark. The historic structure was built in 1398 (Left). The structure was destroyed by fire (suspected arson) on 11 February 2008 (Right)	33
Plate 3.1	A concise policy statement should be strategically displayed inside and outside the building	78
Plate 3.2	It is highly recommended that all staff obtain personal copy of fire safety guidance booklet or fire safety manual	79
Plate 3.3	Basic fire training for all staff should be conducted annually	81
Plate 3.4	Assembly area should be clearly signposted and easily identified by all occupants	82
Plate 3.5	A clear fire escape plan will assist occupants to evacuate the building	84
Plate 3.6	The Damage Limitation Team should conduct exercises on a regular basis	84
Plate 4.1	Map of Malaysia	90
Plate 4.2	Examples of architectural style in Malaysia: A traditional Malay architecture of the Kuala Kangsar Royal Museum (a), The Portuguese architecture of a Famosa in Melaka (b), The Dutch architecture of Stadhuys in Melaka (c), The Moorish architecture of the Sultan Abdul Samad Building, Kuala Lumpur (d), The Tudor architecture of the Royal Selangor Club Building, Kuala Lumpur (e), and The Neo-Classical architecture of the Penang Town Hall, George Town (f)	92
Plate 4.3	The National Heritage plaque (Left) and the Heritage plaque (Right)	113

	Page	
Plate 4.4	The National Heritage Buildings of Malaysia: the Sultan Abdul Samad building (a), Victorian Institution (b), the Merdeka Stadium (c) and the Perak Museum (d)	117
Plate 4.5	The Bok House in Jalan Ampang was built in 1929 with the building's photo in 2001 (Left). The Bok House was demolished in 2006 (Right)	126
Plate 4.6	Uncontrolled developments surrounding Kampung Baru, Kuala Lumpur results in a drastic change on the traditional setting of the early Malay settlement (Left). An adaptive re-used colonial building has been sandwiched by a multi-storey hotel in George Town (Right)	126
Plate 5.1	Location of surveyed museums	140
Plate 5.2	The front façade of the Kedah Royal Museum, Alor Setar, Kedah	150
Plate 5.3	The main gateway to the Kedah Royal Museum (Left). The main entrance of the Kedah Royal Museum (Right)	152
Plate 5.4	The site plan of the Kedah Royal Museum	153
Plate 5.5	An office of the Kedah Royal Museum located on the ground floor of the museum	153
Plate 5.6	The complete traditional Royal Dais is one of the main attractions at the Kedah Royal Museum (Left). The Bridal Chamber is located at the Front Hall (Right)	154
Plate 5.7	The Astaka Hall is the heart of the Kedah Royal Museum (Left). The Royal Regalia Gallery exhibits the royal regalia of the Kedah Sultanates (Right)	155
Plate 5.8	The ground floor plan of the Kedah Royal Museum	156
Plate 5.9	The first floor plan of the Kedah Royal Museum	157
Plate 5.10	A headgear of the late Sultan Abdul Hamid Halim Shah presented by the King of Siam on the occasions of honouring the Sultan with the 'Chao Phya Saibun' title on 24 August 1895 (Left). A set of table and chairs used by the late Sultan Abdul Hamid Halim Shah (Right)	158
Plate 5.11	Some bronze collections of the Kedah Sultanates (Left). Accessories used in Kedah royal weddings (Right)	158
Plate 5.12	Showcases in the Kedah Royal Museum	159
Plate 5.13	The two outdoor galleries in the Kedah Royal Museum	159
Plate 5.14	The façade of the Kedah Royal Museum, from west (Left) and from north (Right)	162
Plate 5.15	The front façade of the Perak Museum, Taiping, Perak	163

	Page
Plate 5.16	The site plan of the Perak Museum 165
Plate 5.17	An ornate early 20 th century throne of the Perak Sultanate is one of the main attractions in the Perak Museum 166
Plate 5.18	Skeletons of animals are the most attractive collections in the Perak Museum 166
Plate 5.19	The interior of the Natural History Gallery (Left). The interior view of the Clay and Indigenous People Gallery (Right) 167
Plate 5.20	Three aboriginal dugout canoes from the early 18 th century and an old jet fighter (Top). A 19 th century railway carriage used between 1885 and 1895 and a 20 th century bus (Below) 168
Plate 5.21	The ground floor plan of the Perak Museum 169
Plate 5.22	The first floor plan of the Perak Museum 170
Plate 5.23	Among the many items of interest in the Perak Museum. A preserved Orang Utan (Left). A howdah that is believed to be the only one still in existence in Malaysia (Right) 171
Plate 5.24	Most of the collections are displayed in a combination of timber and glass showcases labelled in English and Malay 172
Plate 5.25	The Perak Museum is influenced by the architectural styles of the Moorish, the Neo-Classical and the Victorian 172
Plate 5.26	All old showcases are made of <i>Meranti</i> and <i>Chengal</i> timbers with glass panels 173
Plate 5.27	Most of new showcases and display decorations in the Perak Museum are made of plywood 173
Plate 5.28	The front façade of the Kelantan Royal Traditions and Customs Museum, Kota Bharu, Kelantan 174
Plate 5.29	The Kelantan Royal Traditions and Customs Museum. The Main Gallery building (Left). The Weapons Gallery building (Right) 177
Plate 5.30	An exhibition on the seven-month pregnancy ceremony (Left). An exhibition on the shaving and ascending cot ceremony (Right) 178
Plate 5.31	The site plan of the Kelantan Royal Traditions and Customs Museum 179
Plate 5.32	The interior of the Weapons Gallery 179
Plate 5.33	Some of outdoor exhibits displayed underneath the Weapons Gallery. An antique Fiat car (Left). Horse carriages (Right) 180
Plate 5.34	Outdoor exhibitions within the museum. A traditional timber boat (Left). <i>Panca Persada</i> (Right) 180

		Page
Plate 5.35	The ground floor plan of the Kelantan Royal Traditions and Customs Museum	181
Plate 5.36	The first floor plan of the Kelantan Royal Traditions and Customs Museum	182
Plate 5.37	Among collections exhibited in the museum. Brass items (a) Two decorative <i>Chengal</i> beds (b) Textile collections (c) Women jewelleryes (d)	183
Plate 5.38	Some of the traditional Malay weapons exhibited at the Weapons Gallery	184
Plate 5.39	The wall material of the Main Gallery building is a combination of brick masonry walls and <i>Chengal</i> timber wall panels (Left). The Weapons Gallery building is built of <i>Chengal</i> timber (Right)	185
Plate 5.40	An imported wrought iron spiral staircase (Left).Decorative <i>Chengal</i> wall panels located in the front façade of the Main Gallery (Right)	185
Plate 5.41	The roof structures of the museum are made of <i>Chengal</i> timbers and finished by <i>Singhora</i> roof tiles	186
Plate 5.42	Showcases in the museum made of <i>Chengal</i> timber	187
Plate 6.1	Fire exits in the Kedah Royal Museum. The main entrance is the only unlocked fire exit in the museum (Left). Fire exits are locked and obstructed (Centre & Right)	193
Plate 6.2	The two-meter gateway is the main entrance to access the building compound (Left). The museum is surrounded with a two-meter masonry wall and wrought iron fences (Right)	193
Plate 6.3	All extinguishers are hung on walls between 1.2 to 1.5 meters from floor level	194
Plate 6.4	Type of exit sign used in the Kedah Royal Museum	195
Plate 6.5	The ceiling mounted emergency lights are used in the Kedah Royal Museum	196
Plate 6.6	Two types of CCTV cameras used in the Kedah Royal Museum. A dome-type of coloured camera for indoor (Left).A box-type camera with a weather-proof housing for outdoor (Right)	196
Plate 6.7	The location of fire safety measures on the ground floor of the Kedah Royal Museum	197
Plate 6.8	The location of fire safety measures on the first floor of the Kedah Royal Museum	198
Plate 6.9	The broken display units are abandoned on the ground floor (Left). The untidy main office of the Kedah Royal Museum (Right)	200

		Page
Plate 6.10	Poor electrical wiring	200
Plate 6.11	Fire doors are locked and obstructed	201
Plate 6.12	One of individual padlock device used (Left). The main gateway obstructs fire department vehicles from accessing the building compound (Right)	201
Plate 6.13	One of an individual key system used (Left). A free-standing timber showcase covered with a heavy tempered glass (Right)	202
Plate 6.14	Some exhibits are placed along the evacuation route	202
Plate 6.15	No directional signs are provided to navigate visitors towards the nearest exit	203
Plate 6.16	Examples of directional exit signs	203
Plate 6.17	Assembly points should be clearly signposted	204
Plate 6.18	Malfunctioning KELUAR sign	204
Plate 6.19	Most of the fire exit doors in the museum are locked	206
Plate 6.20	There are few island showcases located along the evacuation routes	206
Plate 6.21	The main entrance of the Perak Museum (Left). A large parking space could be useful in the event of fire (Right)	207
Plate 6.22	9-kg dry powder fire extinguishers are provided in the Perak Museum. All extinguishers are mounted on the walls between 1.2 to 1.5 meters from the floor	208
Plate 6.23	Two types of KELUAR signs installed in the Perak Museum. A sign reading KELUAR with a pictorial illustration in white against a green background (Left). A sign reading KELUAR with a pictorial illustration in green against a white background (Right)	208
Plate 6.24	Two types of emergency lights used in the Perak Museum. The ceiling mounted (Left). The wall mounted (Right)	209
Plate 6.25	The colour dome-type camera used to monitor the interior of the Perak Museum	210
Plate 6.26	Type of automatic detectors used in the Perak Museum. An ionisation-type of smoke detector (Left). A heat detector (Right)	211
Plate 6.27	A manual call point break glass with alarm system	211
Plate 6.28	New fire hose reel system in the Perak Museum. A water tank and pump house for the hose reel system (Left). The hose reel system was installed with sympathetic approaches to the existing building (Right)	212
Plate 6.29	The location of the fire hydrant in the Perak Museum	213

		Page
Plate 6.30	The location of fire safety measures on the ground floor of the Perak Museum	214
Plate 6.31	The location of fire safety measures on the first floor of the Perak Museum	215
Plate 6.32	A steep and narrow timber staircase available for escape in case of emergency	216
Plate 6.33	The main entrance door is the only unlocked fire exit door	217
Plate 6.34	Electromechanical door locking devices. Emergency door release device (Left). Exit stopper (Right)	217
Plate 6.35	Individual lock devices used	218
Plate 6.36	Showcases are located along the evacuation routes in the Natural History Gallery	218
Plate 6.37	The Natural History Gallery with ceiling height up to 6.9 meters (Left). Optical beam smoke detectors (Right)	219
Plate 6.38	Means of escape in the Main Gallery building. The main entrance is the only unlocked means of escape (a). The visitors at the upper floor have no other option but to walk down to the ground level through the narrow spiral staircases available (b). Alternative fire exits are locked from inside by padlocks (c)	221
Plate 6.39	Showcases located along the evacuation routes may cause evacuation problems in the event of fire	221
Plate 6.40	Fire and Rescue vehicles may access the museum compound without any difficulties. A large parking space is located in front of the museum (Left). Jalan Istana on the right side of the museum (Right)	222
Plate 6.41	9-kg dry powder fire extinguishers are provided in the Kelantan Royal Traditions and Customs Museum. All extinguishers are mounted between 1.2 to 1.5 meters from the floor	223
Plate 6.42	Emergency lights are mounted both on the wall and the ceiling of the museum. The wall mounted emergency light (Left). The ceiling mounted emergency light (Right)	223
Plate 6.43	The fire hydrant located outside the museum	224
Plate 6.44	Location of fire safety facilities on the ground floor of the Kelantan Royal Traditions and Customs Museum	225
Plate 6.45	Location of fire safety facilities on the first floor of the Kelantan Royal Traditions and Customs Museum	226
Plate 6.46	Location of fire hydrant	227

	Page	
Plate 6.47	Unused cabinets are placed underneath the Weapons Gallery	228
Plate 6.48	A fire exit door is locked by a pad-lock device	229
Plate 6.49	Poor electrical wiring in the Weapons Gallery building	229
Plate 6.50	No directional exit signs are provided in the building	230
Plate 6.51	One of the free standing showcases in the museum (Left). Individual padlock devices used for showcases (Right)	231
Plate 6.52	Examples of KELUAR signs	231

LIST OF APPENDIXES

Appendix A	Fire Safety Checklist Form
Appendix B	Form A: Questionnaire Form for Museum Manager
Appendix C	Form B: Questionnaire Form for Museum Staff
Appendix D	Results of Interviews
Appendix E	Results of Questionnaires

LANGKAH-LANGKAH KESELAMATAN DAN PERLINDUNGAN KEBAKARAN DI BANGUNAN WARISAN DENGAN PENGKHUSUSAN PADA BANGUNAN MUZIUM DI MALAYSIA

ABSTRAK

Di Malaysia, beberapa bangunan warisan telah musnah dan rosak teruk diakibatkan oleh kebakaran seperti Muzium Rakyat, Melaka (2001), Rumah Pak Ali (2003) dan Kelab Sarawak, Kuching (2006). Kebakaran sememangnya merupakan ancaman kepada bangunan warisan iaitu bukan sahaja kepada penghuninya malah juga kepada bangunan dan isi kandungannya. Bangunan warisan memang tidak boleh ditukar ganti tetapi ia amat terdedah kepada beberapa risiko kebakaran termasuk saiz bangunan yang besar, isi kandungan yang mudah terbakar dan struktur bangunan sedia ada yang lemah rintangan api. Namun begitu, sehingga kini masih tiada perundangan dan garis panduan keselamatan kebakaran khusus untuk bangunan warisan di Malaysia. Oleh itu, kajian ini adalah bertujuan untuk mengaudit langkah-langkah keselamatan kebakaran dan menilai pengurusan keselamatan kebakaran di bangunan warisan di Malaysia dengan pengkhususan pada bangunan muzium. Gabungan metodologi pemerhatian lapangan, temubual, borang soal-selidik dan kajian kes telah dilakukan untuk memperolehi data utama di dalam kajian ini. Sebanyak 37 bangunan warisan dari sembilan negeri di Malaysia telah berjaya dikaji. Tiga daripada bangunan tersebut telah dipilih sebagai kajian kes yang setiap satunya mewakili kriteria berlainan. Hasil kajian mendapati bangunan warisan yang dikaji masih mempunyai kelemahan keselamatan kebakaran dan boleh membahayakan nyawa pengguna serta koleksi bersejarah sekiranya berlaku kebakaran. Empat garis panduan keselamatan kebakaran untuk bangunan warisan ada dicadangkan di akhir kajian ini.

FIRE SAFETY AND PROTECTION MEASURES IN HERITAGE BUILDINGS WITH SPECIAL CONSIDERATION ON MUSEUM BUILDINGS IN MALAYSIA

ABSTRACT

In Malaysia, a number of priceless heritage buildings were badly damaged or burnt down by fire including the People Museum, Melaka (2001), Pak Ali's House, Gombak (2003) and the Sarawak Club, Kuching (2006). Indeed, fire is one of the greatest threats to heritage buildings not only to the buildings' occupants but also to the buildings' fabrics and contents. Heritage buildings are irreplaceable, in addition to being vulnerable to fire due to several factors: large scale buildings, flammable priceless contents, and weak existing structures to fire resistance. Unfortunately, until today, there are no sufficient legislations or guidelines on fire safety for heritage buildings in Malaysia. This study audits the current fire safety measures and examines the management of fire safety in Malaysian heritage buildings that focuses on museum buildings. A combination of observations, interviews, questionnaires and case studies was employed to provide primary data in this study. Thirty seven heritage buildings from nine different states in Malaysia were successfully surveyed as building samples. Later, three of them were selected as case studies; each of them represented different criteria in order to gather various information and comparison as much as possible. Findings from the study revealed that there are several fire safety weaknesses in the heritage buildings that could put people and heritage properties on fire risks. Four fire safety guidelines for heritage buildings are recommended at the end of the study.

CHAPTER 1

INTRODUCTION

1.1 Introduction

This chapter is an introductory chapter which introduces background of the study upon which the thesis was based, namely the introduction of the subject matter, research background, problem statements, objectives, research framework, significance, limitations and scope of study.

1.2 Research Background

In Malaysia, there are a number of valuable heritage buildings which have been classified into several categories, namely traditional timber Malay houses, pre-world war shop houses, colonial office buildings, and religious buildings. Some of them have been listed as Heritage Buildings or National Heritage Buildings under the National Heritage Act 2005 (Act 645). However, mostly due to inappropriate management and poor fire protection measures, several irreplaceable heritage buildings in Malaysia were destroyed or burnt down by fire, such as Pak Ali's House (*Rumah Pak Ali*) (Plate 1.1), the former High Court of Kuala Lumpur (Plate 1.2) and the Sarawak Club (Plate 1.3). In fact, in the last decade, at least one heritage building has been destroyed or damaged by fire almost every year in Malaysia (Table 1.1). The worst fire occurred in 2008, where a total of 59 heritage buildings were involved in five different fire incidents. These tragedies emphasise the vulnerability of heritage buildings and their contents to fire and its aftermath. Therefore, this study is an analysis of the current practice of fire safety management in Malaysian heritage buildings, specifically heritage buildings that are used as museums either originally or through adaptive re-use processes.



Plate 1.1: Traditional timber house 'Rumah Pak Ali' that built in 1876 was destroyed by fire in October 2003
(Source: Surainie Mohd Hanif)



Plate 1.2: The former High Court of Kuala Lumpur (1896) was twice destroyed by fire in 1992. The first fire occurred in 16 March 1992 when the building was undergoing renovation works (left) and later in December (right)
(Source: <http://www.beritaharian.com.my> , 23 March 2008)



Plate 1.3: The Sarawak's oldest club that known as the Sarawak Club (1876), was razed in an early morning fire on 27 July 2006
(Source: <http://thestar.com.my/news> , 28 July 2006)

Table 1.1: Fire statistics of heritage buildings in Malaysia from 1992 – 2010

Date	Building	Year of Built	Function	Estimated Loss (MYR)	Cause
16 March & Dec. 1992	The High Court Building, Kuala Lumpur	1896 / 1904	Court		
17 Sept. 1992	The National Museum Malaysia Kuala Lumpur	1959	Museum	100,000	Suspected origin from portable water heater or smoking
12 Sept. 1996	The Sultan Abu Bakar Royal Museum, Johor	1866	Museum	Undisclosed	Arson (Molotov cocktail)
15 March 1997	The Sultan Abu Bakar Royal Museum, Johor	1866	Museum	Undisclosed	Undisclosed
2 Dec. 2001	The People's Museum, Melaka		Museum	Undisclosed (Exhibition Hall is totally damaged. Several copies of Dutch manuscripts, old paintings and artefacts were destroyed)	Short-circuit
20 Oct. 2003	Pak Ali's House, Kampung Kerdas, Gombak	1876	Museum	> 1 million	Short-circuit
27 June 2005	23 Shop houses of pre-World War, Meru, Klang	1920 - 1930	Shop house	5 million	
27 June 2005	13 Shop houses of pre-World War, Kampung Sentosa, off Jln Klang Lama, KL	1920 - 1930	Shop house	> 500,000	
30 May 2006	The Handcraft Village, Jalan Semarak, Kuala Lumpur		Handcraft centre	300,000	
17 July 2006	Shop house, Jalan Laksamana, Bandar Hilir, Melaka	> 1806	Shop house		
27 July 2006	The Sarawak Club, Kuching	1876	Club house		
24 July 2007	The Royal Malaysian Police Voluntary Club Ipoh	1910	Club house		
30 Sept. 2007	The PULAPOL Senior Police Quarters, Jalan Semarak, KL	1940	Quarters	300,000	Short-circuit
19 Mac. 2008	6 old shop houses, Taiping, Perak	1895	Shop	> 300,000	
05 May 2008	38 units of Punan Bah longhouse, Belaga, Sarawak		Residential	> 500,000	
11 July 2008	The Memorial Datuk Onn Jaafar, Batu Pahat.		Memorial	Destroyed 70% of the building and artefacts	Undisclosed
09 Dec. 2008	7 old wooden shop houses, Tamparuli, Sabah	1950s	Shop house	(Totally destroyed)	unreported
11 Dec. 2008	7 old shop houses, Lebuah Armenian, Penang (In World Heritage Site zone)	> 50 years	Shop house	± 600,000	unreported
21 Dec. 2009	7 shop houses, Jalan Gambier, Kuching, Sarawak	> 100 years	Shop house		
6 Feb. 2010	4 shop houses, Jalan Wayang, Kuching, Sarawak	> 100 years	Shop house		

(Source: Personal survey, 2010)

It is widely regarded that fire is one of the greatest threats not only to the occupants of a building but also to its fabric and contents. However, the “Fire Safety Philosophy” of the Malaysian Uniform Building By-laws 1984 (UBBL 1984) is mainly for the life safety of the building’s occupants. In the case of a heritage building, until today, no proper legal requirements have been endorsed to protect historic contents and structures from fire. According to many international fire experts including Ingval Maxwell Obe, Stewart Kidd and John M. Watts, Jr., fire safety systems in heritage buildings must be sympathetically designed in order to minimise the impact on the historic character (authenticity) of the buildings. Nevertheless, although many lessons have been learned and approaches to fire safety in heritage buildings have grown more sophisticated, one simple fact remains: most fires occur as a result of human action or negligence. UBBL 1984 and Act 645 are further discussed in Chapter 2 and Chapter 4 of the thesis respectively.

Historically, fire has long been an enemy of historic structures, with some older structures falling victim many times. One example is the LaFenice Theatre (Venice Opera House) that first opened in 1792 on the site of a theatre that burned down in 1773. After being rebuilt, the building was again extensively damaged by fire in 1836 and 1996 (Bukowski, Nuzzolese and Bindo, 2001). In addition, history shows that fire was recognised as a threat to great civilisations as early as 2000 years ago. The Roman Empire devised a system of *corps vigilante* whose sole task was to be on the watch for the outbreak of fire. The Great Fire of London in 1666 became the catalyst for the modern day building codes. The fire broke out in a baker’s shop and destroyed half of London. The buildings in London at that time were not fire separated and so the fire spread easily. Analysis of how the fire spread led to the creation of the first building regulations.

Spadaccini (1998) stated that when fire is not controlled, it may result in injury or death of people from smoke, gases and heat, destruction of buildings, their contents and other tangible property, temporary or permanent closure of business, loss of income and

possibly bankruptcy, and destruction of irreplaceable reminders of human heritage. In the case of a heritage building, the loss of authentic fabric in a fire is irretrievable. Much could and should be done to minimise the likelihood of fire, starting with the early elimination of major risks and the management of those risks which cannot be eliminated, and alleviating the destructive consequences of fire (Marchant, Marshall and Newson, 1997). While modern buildings are designed from the outset to allow the occupants to leave quickly and easily in the event of a fire, adapting a heritage building is more difficult. Two primary factors must be considered: the protection of persons either living, working or visiting in the premises, and the protection of the building fabrics and its contents. If the building concerned is also open to the visiting public, the requirement for life safety measures is even greater (Forrest, 1996). Moreover, many heritage buildings generally exhibit combustible construction and inadequate exits, for example long, single paths of travel, narrow stairways and unprotected vertical openings that violate modern codes and fire protection practices (Bukowski, Nuzzolese and Bindo, 2001).

In this respect, Marchant, Marshall and Newson (1997) highlight that authentic fabric lost to fire is irreplaceable; no matter how good subsequent restoration may be, the original has been lost forever. It follows that the conservation and protection of heritage buildings must involve giving them the best possible protection from fire. This is not to ignore the safety of occupants, which remains of paramount importance, rather to ensure that fire protection measures look beyond the immediate requirements of life safety to encompass the protection of the building fabric and contents as well. Much can be done by good management to prevent fires from occurring in the first place. Beyond this, the installation of fire detection and protection systems may be required. There are many devices available, from simple smoke detectors to carefully engineered detection, alarm and suppression systems. However, in some instances, such technology demands a level of intervention in the fabric that is unacceptable in conservation terms. Measures taken to protect the fabric must not damage what they set out to protect. A balance needs to be established.

Therefore, when formulating proposals for heritage buildings, a more flexible approach is often called for, which will include a rigorous assessment of the need for proposed works and an exploration of alternative strategies, set against their likely impact on the fabric of the building. In most cases, such an approach will enable a sympathetic solution to be developed to meet the spirit, if not the full requirements of the regulations, whilst minimising impact on the heritage building. Building owners and managers must understand that mere legal compliance guarantees nothing more than verification that the life safety provisions of the building meet the legal minimum and that protection of fabric may be limited. Further measures are likely to be necessary to provide the best level of protection for the building itself against the effects of fire (Kidd, 2005).

Kidd (2001 and 2005) also adds in upgrading fire safety systems in heritage buildings, special considerations should be applied. Not only must the systems aim to comply with the relevant standards and provide the intended levels of protection, but additionally their impact on the building and its fabric must meet a range of tests. Furthermore, it is essential that full consideration be paid to the risks of potential damage to original fabric as well as the aesthetic impact fire systems might have on heritage buildings. Any changes to a listed building must not only address fire protection needs but must fully comply with the law in respect of listed building consent.

In terms of fire safety codes, Watts and Solomon (2002) state that, while building codes have progressed to keep up with developing techniques of modern construction, the issues of fire safety for heritage buildings are relegated to guidance documents, for example, with no legal authority. A few rehabilitation codes have evolved that recognise the inherent differences between new construction and existing buildings but they retain the inflexibility and additional problems of specification-based codes, and are inadequate in their approach to heritage buildings, the subcategory of existing buildings with the highest requirement for

property protection. None of the recent generation of codes has resolved the conflict between the prescriptive language of fire safety and the philosophical language of the Burra Charters and Venice Charters, documents used internationally. This topic is further discussed in Chapter 2.

1.3 Problem Statements

Several key issues with regard to fire safety and heritage buildings in Malaysia have been identified as follows:

1.3.1 Heritage Buildings on Fire

Fire does not respect age or historic importance of any buildings. Until today, fire has damaged and destroyed many prominent heritage properties worldwide. This issue is further discussed in Chapter 2. In Malaysia, the number of fire cases has gradually increased from 2001 to 2008, the highest was recorded in 2005 with 31,138 cases compared to 15,419 cases in 2001 (Table 1.2). According to the Fire and Rescue Department of Malaysia (FRDM), fire has caused a total loss of approximately RM5,769.60 million from 2001 to 2008 that claimed 582 lives and injured 679 people. 25,402 (15%) from the total of fire cases involved buildings. The highest building fires were recorded in 2008 with 3,556 cases compared to 3,447 cases in 2007. Electrical fault was recorded as the highest cause of fire in the both years (Table 1.3).

Table 1.2: Fire statistics in Malaysia from 2001 – 2008

	2001	2002	2003	2004	2005	2006	2007	2008	TOTAL
Fire Cases	15,419	25,726	18,290	22,779	31,138	18,913	20,225	21,524	174,014
Death	62	46	100	65	70	71	80	88	582
Injured	81	76	68	107	115	86	67	79	679
Building Fires	2489	2887	3059	3154	3457	3353	3447	3556	25,402
Estimated Loss (RM million)	584.22	603.02	502.40	614.70	794.70	760.70	865.30	1,044.56	5,769.60

(Source: Fire and Rescue Department of Malaysia, 2010)

Table 1.3: Statistics of causes of building fires in Malaysia for 2007 and 2008

Cause of Fire	Total Cases	
	2007	2008
Electrical	1248	1323
Cigarette butts	98	130
Fire spark	89	85
Fire crackers	22	22
Mosquito coil/ Candles/ Joss sticks	221	187
Gas stove/ Oil	298	349
Spontaneous action	34	33
Intentionally with good faith	102	120
Arson	128	124
Unknown	651	479
Chemical reaction	12	8
Match sticks	130	123
Others	414	573
GRAND TOTAL	3447	3556

(Source: <http://www.bomba.gov.my>, 11 February 2010)

On the 21st of April 2009, Datuk Hamzah Abu Bakar, the former Director General of FRDM, reported that fires have caused a total loss of more than RM235 million in three months (January to March 2009) with 21 deaths and 12 injured (Harian Metro, 22 April 2009). Among the states that recorded the highest amount of fire loss are Selangor (RM80 million), Penang (RM61 million) and Johor (RM21 million). Nevertheless, until recently, there has been no separate statistics for heritage building fires in Malaysia. Based on newspaper cuttings and internet searches, fires have also damaged and destroyed many heritage buildings in Malaysia with a total loss of more than RM5 million. Unfortunately, as mentioned earlier, the FRDM in line with the UBBL 1984 has stressed that the life safety of occupants is the ultimate principle of fire safety in a building (Hamzah, 2006). Property protection, which includes protection of contents such as furnishings, fittings, objects of value as well as the property itself, has not really been emphasised. This scenario is quite similar to England and Ireland, where relevant building and fire regulations have traditionally placed the greatest emphasis on two fire protection objectives, namely life safety protection and prevention of conflagrations (Pickard, 1993).

Furthermore, in order to preserve heritage buildings, most of the buildings have been adaptive re-used into different functions from its original such as museums, galleries, hotels and offices through conservation processes. However, a majority of Malaysian heritage buildings have been converted into museums, galleries and memorials. Similarly, like other heritage buildings, fire has always been a threat to museums where, from 1992 to 2008, at least 6 museums have been involved in fires that destroyed the buildings and its contents. The cases could be considered as an alarming issue and should be given higher priority because the buildings and its contents are categorised as historically valuable, priceless and irreplaceable. This is on the assumption that the problems are due to many factors such as insufficient fire safety systems, poor maintenance, and lack of fire safety guidelines. In fact, the authorities have also failed to provide sufficient guidance and good strategy in safeguarding buildings that may be considered as heritage buildings from fire damages. In a study, Siti Rohamini (2002) has found that active fire protection systems in museums are still insufficient based on the ratio of their contents. Fire in museums is not only a problem in Malaysia but also throughout the world (Table 1.4). The National Fire Protection Association (NFPA) estimates that an average of 89 museum and gallery fires each year in the United States of America (USA) (Kidd, 2005). In Canada, some 316 museum, art gallery and library fires occurred between 1982 and 1993 that caused an estimated loss of over USD17 million (Mills, 2007).

Table 1.4: List of museum fires in the world (1958 - 2008)

Date	Museum Name	Cause of Fire	Fire Prevention Equipment	Estimated Loss
15 April 1958	The Museum of Modern Art , New York, USA	Origin was workmen repainting second floor galleries who were smoking on the job.	Detectors but no sprinklers.	USD 700,000 (Loss of one life, 33 injuries, several galleries, two major paintings, including a Monet, seven paintings severely damaged)
9 Aug.1970	The Henry Ford Museum , Michigan, USA	Origin suspected to be an overheated hair curling iron in a dressing room.	Detectors but no sprinklers on part of the building.	USD 2 million (Loss of several historic displays of shops and equipment)
30 Sept.1970	The Smithsonian Institution National Museum of American History , Washington D.C. USA	Origin was electrical short in the exhibit.	Detectors but no sprinklers.	USD 1 million (Loss of two galleries and their exhibits, with some water damage)
22 Feb.1978	The San Diego Aerospace Museum and International Aerospace Hall of Fame , California, USA	Arson. Arsonists were two youths seen running away.	No detectors, no sprinklers	USD 16 million (Loss of the building and entire collection, including 40 planes and library)
8 July 1978	The Museum of Modern Art , Rio de Janeiro, Brazil	Suspected origin from smoking or defective wiring.	No detectors, no sprinklers	USD 50 million (Loss of most of the interior, the roof, and 900 works of art (90% of the collection))
31 Dec.1984	The Byer Museum of Art , Illinois, USA	Suspected electrical origin.	Detectors but no sprinklers.	USD 3 million (Loss of the upper two floors and roof, with extensive water damage)
17 Oct.1985	The Huntington Gallery , California, USA	Suspected origin was an electrical on the elevator at night, which burst explosively into the first floor.	Smoke detectors in the museum but not in the elevator or elevator shaft. No sprinklers.	USD 1.5 million (Loss of elevator and elevator shaft, one minor painting, and extensive smoke damage)
11 May 1988	The Cabildo Building, Louisiana Museum of Art , New Orleans, USA	Origin was workmen welding gutters on the exterior igniting an interior hollow space.	Detectors in the museum, but no detectors in the hollow space, no sprinklers.	USD 5 million (Loss of furniture collections in the attic, roof, structural and water damage)
17 Sept.1992	The National Museum Malaysia , Kuala Lumpur, MALAYSIA	Suspected origin from portable water heater or smoking		USD 30,000 (Loss of some AV equipments and documentary collections)
20 Nov.1992	The Windsor Castle , London, ENGLAND	Suspected origin was blow torch.	No detectors or sprinklers.	USD 90 million (Loss of a tower, several rooms, tapestries, and minor paintings)
19 April 1993	The Yuma Arizona Art Center , Arizona, USA	Suspected origin was electrical.	Smoke detectors no sprinklers.	USD 1.5 million (Loss of historic building and 39 fine art pieces with some smoke and water damage)
09 Aug.1993	The Oakland Museum , California, USA	Origin was defective exhibit motor in storage room.	Detectors but no sprinklers.	USD 1 million (Loss of gallery and some exhibits on loan)

Table 1.4: Continued

Date	Museum Name	Cause of Fire	Fire Prevention Equipment	Estimated Loss
2 June 1994	The Oshkosh Public Museum , Wisconsin, USA	Origin was workmen welding gutters on the exterior igniting an interior hollow space.	Detectors in the museum, but no detectors in the hollow space, no sprinklers.	USD 2 million (Loss of 10% of the collection and collection records)
12 Sep.1996	The Sultan Abu Bakar Royal Museum , Johor, MALAYSIA	Arson (Molotov cocktail)		Undisclosed
15 March 1997	The Sultan Abu Bakar Royal Museum , Johor, MALAYSIA	Undisclosed		Undisclosed
02 Dec.2001	The People's Museum , Melaka, MALAYSIA	Electrical short-circuit		Undisclosed (Exhibition Hall is totally damaged. Several copies of Dutch manuscripts, old paintings and artefacts were destroyed in the 9.15pm fire)
16 Sep.2003	The National Motorcycle Museum , Birmingham, UK	A cigarette		GBP 8 million
20 Oct.2003	The Pak Ali House , Gombak, MALAYSIA	Electrical short-circuit	No detectors or sprinklers.	> USD 500,000 (Building badly damaged and not reopened)
18 Nov.2003	The Holocaust Museum , Terre Haute, Indiana USA	Suspected domestic terrorism		
28 Aug.2005	The Mackinac Bridge Museum , Mackinac City, Michigan, USA			
18 March 2008	The Tweetsie Railroad Museum (1957) , Blowing Rock, North Carolina, USA	Lightning may have struck the building causing an electrical fire		(The building is completely unrecognizable, reduced to charred remnants and mangled metal)
4 April 2008	The Quebec City Armoury (1884) , Quebec, CANADA		Undergoing renovations	(Destroyed many souvenirs linked to the history of fighting for Canada during various wars)
11 July 2008	The Memorial Datuk Onn Jaafar , Batu Pahat. MALAYSIA	Undisclosed	Undergoing renovations to open for public	Undisclosed (Destroyed 70% of the building and artefacts)

(Source: www.museum-security.org)

1.3.2 Lack of Fire Safety Awareness

From Figure 1.1, it can be assumed that the increment of the total building fire incidents may be due to lack of fire safety awareness amongst the authorities, owners and public. On the 13th of September 2006, Ab. Ghani Daud, the Director of Fire and Rescue Department of Perak stated that poor fire safety awareness among building owners is one of the main causes of building fires in the Perak state. It is believed that most of the buildings'

owners have put more efforts on building security instead of building fire safety (Utusan Malaysia, 2006). This issue was also highlighted in 2002 by Tan Sri Lee Lam Thye, Chairman of the National Institute of Occupational Safety and Health (NIOSH), who stated that fire safety among owners and buildings occupants of shopping complexes, offices and educational institutions has not improved and that their awareness is at a relatively low level (The Star, 2002). For example, in 2001, the Federal Territory Fire and Rescue Department issued 467 notices, of which 329 were to shopping complexes, 265 to hotels, 100 to educational institutions and 163 to factories. Most of the notices were for failing to provide adequate emergency exits, lights and fire hose reels (The Star, 2002).

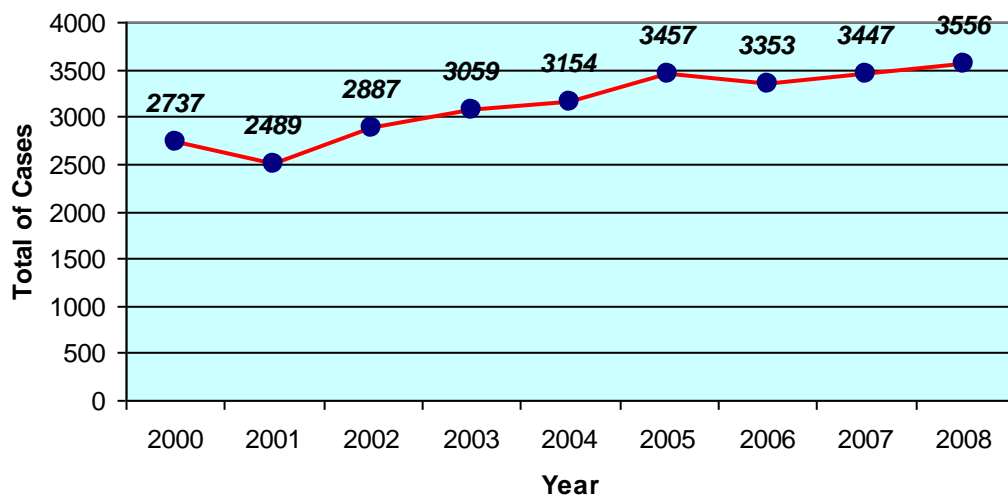


Figure 1.1: Buildings fire statistic in Malaysia for 2000 - 2008
 (Source: Fire and Rescue Department of Malaysia, 2010)

In Malaysia, fire safety awareness has always been taken for granted by the public, hence increasing the total number of deaths and injuries due to fire in the country. Mohd Armal Mahfuzan (2007) highlights that various measures have been taken by government authorities and Non-Governmental Organisations (NGOs) in enhancing the awareness of building occupants on fire safety in order to reduce fire incidents and zero-fire. However, the standard level of fire safety awareness among the public is still disappointing. This means that the campaigns have not increased public awareness towards fire safety. This view is supported by Siti Rohamini (2002) in her study discovered that fire safety awareness among

visitors as members of the public, is still low. Nevertheless, fire safety awareness among building staff is at moderate level. However, in a survey conducted by Muna Hanim (2009) amongst the staff of a hospital and two libraries in Universiti Sains Malaysia reveals that respondents from buildings are quite unsure regarding the correct sequence of actions in the event of a fire even though they are quite exposed to various knowledge on fire safety.

1.3.3 Buildings Not Compliance to the Fire Services Act 1988, Regulations and Order (Act 341)

Section 27 of the Fire Services Act 1988 (Act 341) states that every designated building or premise is required to have a fire certificate (FC) and the certificate shall be renewable annually. Any owner of the designated premises without a FC shall be guilty of an offence (Sec. 33, Act 341) and be liable to a fine not exceeding RM5,000 or to imprisonment for a term not exceeding three years or both (Sec. 58, Act 341). Nevertheless, Datuk Hamzah Abu Bakar, the former Director General of FRDM reported that, in 2009 there are 125 buildings in Kuala Lumpur still without FCs (Harian Metro, 2009). In addition, Mohd. Yusof Muhammad, the former Director of the Johor Fire and Rescue Department stated that, until April 2007, 728 buildings were legally required to have FCs in the state in which 43 of them were government buildings and 685 private buildings. However, only 3 government buildings and 663 private buildings applied for the FCs (Utusan Malaysia, 2007). In Perak, only 45 out of 236 high-risk buildings have received FCs since 2003 (Utusan Malaysia, 2006). Actually, this is a never ending issue as the former Director General of FRDM Datuk Jaafar Sidek Tambi, had also highlighted the issue back in 2002. At that time, he reported that 1,208 buildings or 26.4% of 4,564 buildings in Malaysia which required FCs did not obtain the certificate even after 14 years (Bernama, 2002b).

On the other hand, in 2008, the FDRM issued 8,309 Fire-hazard Abatement notices (Form A, Act 341) from a total of 14,980 inspected buildings in Malaysia. 1,526 were issued

to buildings located in Kuala Lumpur (Nor Hisham, 2009). While a total of 1,600 and 1,347 Fire-hazard Abatement notices were issued in 2005 and 2006 respectively in Perak (Utusan Malaysia, 2006). In 2008 until March 2009, the FRDM has filed 21 court cases towards premises and individuals that did not comply with the requirements and regulations of Act 341 in Kuala Lumpur (Bernama, 2002b).

The above statistics are also proven in surveys and observations conducted by the author from September 2007 until May 2008 on 37 heritage buildings located in the nine states of Malaysia (see Plate 5.1 in Chapter 5). In which, 59.4% (22) of the buildings are managed by state governments, 24.4% (9) managed by government agencies (e.g., the National Archives Malaysia, the Royal Malaysian Police and Universiti Sains Malaysia), 10.8% (4) by the Federal government under the Department of Museums, and 5.4% (2) under government linked company and private agency (see Table 5.4 in Chapter 5). Various fire safety management problems in the heritage buildings have been identified from the survey (Figure 1.2). Ten leading problems identified are as follows:

- i. Buildings without fire safety plan (100%).
- ii. No periodical fire training for staff (100%).
- iii. Buildings without fire certificate (97%).
- iv. Buildings without emergency escape plan (97%).
- v. Buildings not disabled friendly (97%).
- vi. Buildings without fire policy (95%).
- vii. Buildings without periodical risk assessment (89%).
- viii. Buildings without direct link to the local fire brigade (86%).
- ix. Buildings without periodical fire drill (84%).
- x. Buildings without insurance (68%).

In addition, it is also discovered in the interview surveys that the problems occurred mainly due to three factors which are lack of fire safety guidelines, poor fire safety awareness, and lack of enforcement by respective authorities.

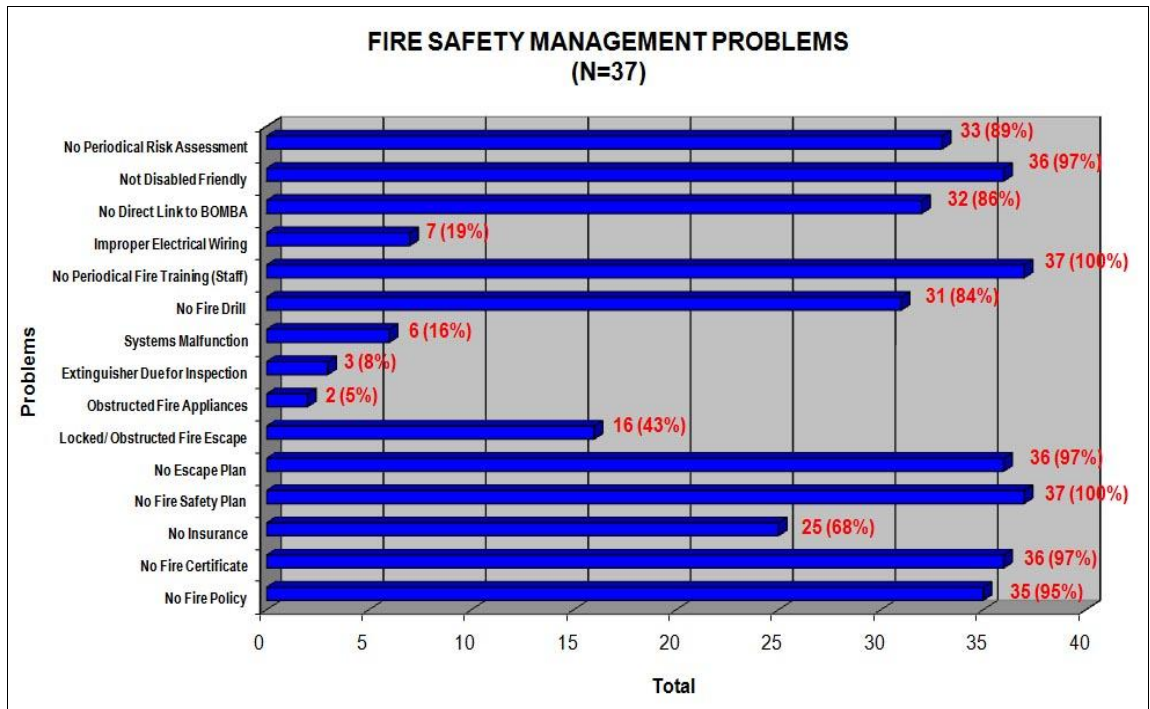


Figure 1.2: Fire safety management problems in surveyed heritage buildings
(Source: Personal survey, 2009)

1.3.4 Lack of Fire Safety Regulations and Guidelines for Heritage Buildings

Presently, fire safety requirements (both passive and active protection systems) for new and existing buildings in Malaysia are required to be designed according to the UBBL 1984 (Part VII: Fire Requirements and Part VIII: Fire Alarms, Fire Detection, Fire Extinguishment and Fire Fighting Access). The law is a prescriptive building code which is most suitable for new buildings. In other words, not all fire safety requirements in the UBBL 1984 are suitable to be applied in upgrading fire safety in heritage buildings. Heritage buildings were built before the law was introduced and most of the buildings have been renovated and adaptive re-used many times. As mentioned earlier, there are some major differences which pose a challenge to the modern designer and fire protection engineer in the application of general fire protection principles in heritage buildings. The challenge in protecting heritage structure is to maintain their historical fabric and authenticity while providing a reasonable level of safety for their occupants and contents. Until today, no proper fire safety guidelines or legal requirements have been provided to protect historic contents and structures from fire.

1.4 Scope of Study

The focus of the study is divided into two aspects. The first, focuses on fire safety, its objectives, components, codes and approaches in the context of heritage buildings. The second focuses on the interaction between fire safety and heritage buildings. Most Malaysian historic buildings are used as public museums, therefore, the scope of the study is limited to museums that have used historic buildings either originally as a museum or through an adaptive re-used process. Nevertheless, only museums that are managed by both the Federal and State governments are selected. In this study, the buildings will be called ‘heritage buildings’ throughout the thesis. This is in line with the words ‘heritage building’ defined by Steward Kidd in, *Fire Safety Management in Heritage Buildings*:

“a building of historic value or a building (not necessarily historic), such as a museum, library or gallery, housing cultural artefacts.” (Kidd, 2005: 83)

According to the International Council of Museums (ICOM) (2007b), a museum is defined as:

“a non-profit, permanent institution in the service of society and its development, open to the public, which acquires, conserves, researches, communicates and exhibits the tangible and intangible heritage of humanity and its environment for the purposes of education, study and enjoyment.” (Article 3, Section 1)

Meanwhile, Othman Yatim (1999) defines a museum as *“a building used for storing and exhibiting objects of historical, scientific or cultural interest”*. Therefore, based on the definitions given above, any museum, memorial, archive or gallery may be included in the museum category.

Furthermore, as stated in Table 1.1, statistically fire cases involving heritage buildings in Malaysia are the second highest after historic shop houses. However, it is not the intention of this study to disregard the issue of fire safety of other historic buildings in Malaysia. It is hoped that studying fire safety in heritage buildings could provide a starting

point in understanding and managing fire safety in other historic buildings. Heritage buildings are selected mainly because both building and contents in the buildings have a historical significance (i.e., the buildings are not only classified as heritage buildings but also contain priceless collections such as old artefacts, manuscripts, royal memorabilia and others). Unlike other historic buildings, heritage buildings face greater loss in cases involving fire.

In addition, heritage buildings as educational resources for the community may receive large amount of visitors because the buildings are normally open to public. For example, in 2007, approximately more than 5 million visitors visited 58 heritage buildings managed by nine different agencies in Malaysia. Thus, more visitor means that more people are exposed to danger if a fire were to occur.

It needs to be mentioned that this study is limited to the following aspects:

- i. The study attempts to fill a gap by providing a holistic approach on how to manage fire safety programmes in heritage buildings. The success of any fire safety measures in the buildings depend on the effectiveness of its management programmes,
- ii. This study audits visually fire safety measures that are provided in the selected museums. It does not examine the ability and reliability aspects of fire safety measures within the buildings, and
- iii. The study focuses only on heritage buildings that are currently being used as a museum and are solely managed by the Federal and State governments.

1.5 Objectives of Study

The objectives of this study are to:

- i. Audit the fire safety measures in Malaysian heritage buildings,
- ii. Examine the management of fire safety by the employees of Malaysian heritage buildings, and
- iii. Formulate fire safety guidelines for relevant organisations or those involved (directly or indirectly) in heritage building conservation in order to prevent and protect occupants, fabric and contents of the heritage buildings from the risk of fire.

1.6 Research Framework

This study is based on a mixed method approach using concurrent procedures. In this method, the author collects both quantitative and qualitative data at the same time during the study and then integrates the information in the interpretation of the overall results. Detailed explanations on the selected research methods are discussed in Chapter 5.

1.7 Significance and Benefits of Study

In summary, the contributions of this study towards the fire safety management of heritage buildings are as follows:

- i. To provide a theoretical understanding of the concept of fire safety management in heritage buildings. This promotes the best level of fire safety management which could protect the life safety of occupants and at least minimise fire damage to the historic fabrics and contents in Malaysian heritage buildings, and
- ii. To contribute underlying fire safety guidelines with reference to the research findings to the relevant organisations or those involved in safeguarding, managing, conserving or upgrading any heritage buildings.

1.8 Structure of the Thesis

Figure 1.3 explains the process taken in completing this study. The thesis is organised into ten chapters as follows:

Chapter 1 is an introductory chapter which introduces background of the study upon which the thesis was based, namely the introduction of the subject matter, research background, problem statements, objectives, research framework, significance, limitations and scope of study.

Chapter 2 is the literature review which is divided into three main parts. The first part reviews the literature on fire safety in heritage buildings which includes its objectives, design approaches and problems. Heritage buildings loss to fire worldwide is also highlighted in this part. The second part of the chapter focuses on the fire safety codes and guidelines for heritage buildings at international levels as well as in Malaysia. Finally, research on fire safety in heritage buildings in Malaysia is discussed.

Chapter 3 is divided into five parts. The first part reviews theories and literature on the principle of fire which include the science of fire and its stages and classifications. The second part discusses on fire safety concept in a building. The third part of the chapter focuses on the common fire protection systems in buildings, namely passive and active measures. The fourth part of this chapter discusses the perceptions and behaviour of people in the event of a fire. Finally, the principles and components of fire safety management in buildings are explained.

Chapter 4 discusses heritage building conservation in Malaysia. The introduction part of this chapter explains architectural heritage in the country followed by the architectural conservation approach in general. All legislations and agencies/organisations involved in the Malaysian conservation movements are also discussed in this chapter. This chapter ends with discussions on building conservation challenges.

Chapter 5 presents the methodologies selected in this study which are divided into three methods. The first method involves literature review, where both heritage building and fire safety literatures are reviewed in order to identify key issues and recent research that are related or significant to the research topic. The second method involves the collection of primary data through onsite observations, interviews and questionnaires. Finally, the third method, three case studies which have been selected as an approach to audit and to examine directly fire safety and protection measures in the heritage buildings.

Chapter 6 discusses the findings from the selected methodologies and is divided into three parts. The first part discusses the background of respondents in interviews and questionnaires. The second part analyses fire safety measures and fire safety weaknesses in the studied buildings. Meanwhile, the third part presents the audit results on fire safety and protection measures in the studied buildings with reference to the requirements of the UBBL 1984, the Fire Services Act 1988, the Occupational Safety and Health Act 1994 and four relevant Malaysian Standards. This chapter ends with a summary of the analysis and findings.

Chapter 7 is the concluding chapter that is divided into four sections. The first section discusses the conclusions in order to fulfil the objectives of the undertaken study. The second section discusses the recommended guidelines for the betterment

of fire safety management in heritage buildings. The third section highlights the contribution of this study and, lastly, the directions for future research.

This study also contains Appendixes which can be found at the end of thesis to support the author's main discussions in the chapters.



Figure 1.3: Summary of thesis structure

CHAPTER 2

FIRE SAFETY IN HERITAGE BUILDINGS

2.1 Introduction

This chapter is divided into three parts. The first part reviews the literature on fire safety in heritage buildings which includes its objectives, design approaches and problems. Heritage building loss to fire worldwide is also highlighted in this part. The second part of the chapter focuses on the fire safety codes and guidelines for heritage buildings at international levels as well as in Malaysia. Finally, research on the fire safety of heritage buildings in Malaysia is discussed.

2.2 Fire Safety Objectives in Heritage Buildings

Marchant (1989) highlights that there was little or no difference between heritage buildings and new buildings since fire safety objectives are the same for all buildings. Fire may happen in any buildings without knowing whether the buildings are historic or new. However, the differences between heritage and new buildings lie in the heritage values attached to the building with regard to either its fabric or/and contents. In general, the major differences between new and heritage buildings are the aesthetic, economic, and practical constraints on the use of the available methods of providing fire safety (Marchant, 1989). It is widely accepted that there are three fire safety objectives in heritage buildings (Marchant, 1989; Kidd, 1995; Marsella, 2008; Papaioannou, 1991; DEI, 2007). They are life safety, contents protection and fabric protection as presented in Figure 2.1. These objectives can be achieved by the introduction of an improved management emergency capability and by the use of selected components of fire precautions so that the potential probable loss is reduced to an acceptable level (Marchant, 1989). In this context, it is included in *the NFPA 909: Code for the Protection of Cultural Resource Properties- Museums, Libraries, and Places of Worship (2005 edition)* that the additional fire safety goal for collection preservation. In

which, a reasonable level of protection against damage or loss to collections from fire, products of combustion, and fire suppression agents and activities shall be provided. Fire safety and fire protection features shall be designed, approved, implemented, and maintained to preserve the original qualities or character of the collection or a heritage building, structure, site, or environment (NFPA, 2005). The recommendations of fire safety design in heritage buildings are further explained in this chapter.

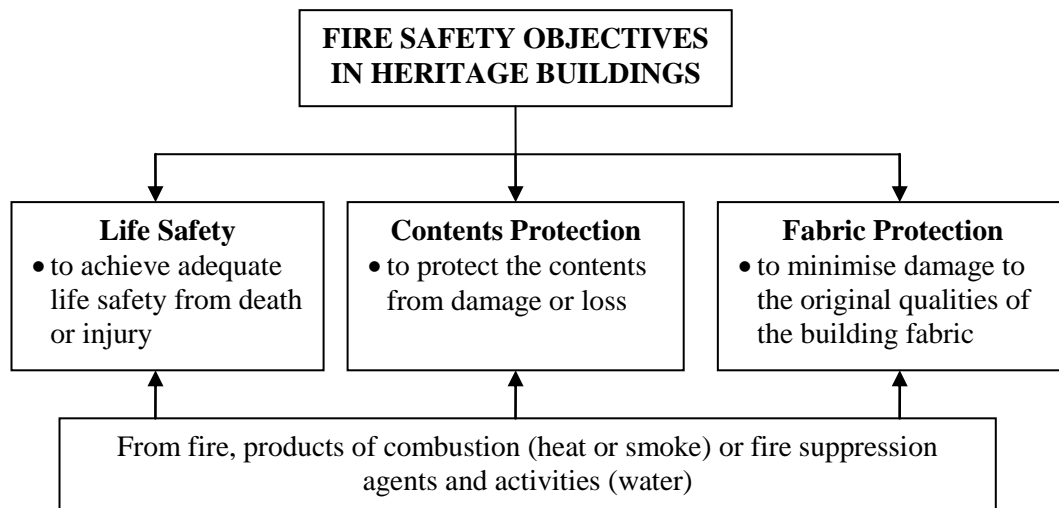


Figure 2.1: Fire safety objectives in heritage buildings

The fire safety regulations in many countries (including Malaysia) state that life safety is the ultimate principle of fire safety in a building. For example, in Part VII and Part VIII of the Malaysian Uniform Building By-Laws 1984 (UBBL 1984) recommend that life safety of the buildings' occupants must be the prime consideration. This is similar to England and Ireland in which property protection that includes protection to the buildings' fabrics and buildings' contents, has been given the least consideration (Pickard, 1993). In fact, it is also stated in the *NFPA 5000: Building and Fire Safety Code* that buildings shall be designed and constructed to provide reasonable safety for occupants and fire fighters (Watts Jr. and Kaplan, 2003). Indeed, it is no doubt that life safety is more important or priceless than property. Nevertheless, property protection should also be considered as a major concern in fire safety as well. This is because some of the buildings and/or contents in the building are irreplaceable especially for properties that have historical values.

Papaionnou (1991) suggests that an acceptable level of safety for both people and property must be determined through an adequate system of risk and safety evaluation. This means that before planning fire safety, all involving parties (e.g., owners, architects, authorities, fire experts, insurance people and others) ought to discuss and to exchange ideas on the various aspects of the problems. This view is supported in the NFPA (2003), that the earlier fire safety objectives established in the design process could identify more effective and economical fire safety methods to be applied. Nevertheless, the firm effectiveness of fire safety in a building is the joint responsibility of the building owners (management) and occupants (staff and visitors). In other words, it must be supported by a sound fire safety management in place. All parties concerned must be aware of their individual duties in ensuring that adequate standards of fire safety and property protection are both provided and maintained (Kidd, 1995). The management of fire safety is further explained in Chapter 3.

2.3 Fire Safety Problems in Heritage Buildings

During the last decades, great concern on the conservation of cultural heritage including fire protection has risen among various countries authorities, fire experts, conservationists and citizens (Papaioannaou, 2009). Many literatures including books and research reports continuously highlight that heritage buildings are more exposed to fire than new buildings (Kidd, 1998; Feilden, 2001; Lilawati, 2001). In general, there are two problems of fire safety in heritage buildings. Firstly, most of them are relatively more exposed to fire risks due to their existing structures and contents that are particularly vulnerable to fire. The hazards present at fires involving heritage buildings generally arise from the building itself, the contents of the building, the nature of the fire situation, the function of the building, and environmental consideration (Kidd, 2005). Most of them are widely exposed to several fire risks such as follows:

- i. Existing structures which are weak on fire resistance, aging or decaying building materials and combustible materials (e.g., timber).

- ii. Inadequate fire prevention and protection systems, notably passive fire protection.
- iii. Lack of fire safety awareness among building owners, managers, staff and public.
- iv. Low standard of management, housekeeping and maintenance.
- v. Being located at the busiest areas or narrow roads without good access to fire brigade.
- vi. Existing electrical wiring which has not been upgraded or replaced accordingly where few historic buildings are still using old electrical wiring.
- vii. Storage for many flammable but priceless contents, artefacts or heritage collections such as old books, manuscripts, traditional costumes and antique furniture.
- viii. Large numbers of visitors where most are open daily to public.
- ix. Dangers from renovation works.
- x. Possible dangers from natural factors such as lightning and overheating.
- xi. Dangers due to carelessness and arson.

The second problem concerns the method of upgrading fire safety in heritage buildings (Kidd, 1998). The responsibility of fire safety of heritage buildings lies mainly in the hands of the owner. Nevertheless, upgrading fire safety measures in heritage buildings may result in conflict between fire safety standard requirements and the historical significance of the buildings, particularly when the use of a building is changed (adaptive re-use). For example, difficulties will often arise when additional staircases for means of escape and the installation of fire precautions hardware, such as exit notices, emergency lighting and fire detection systems, are required (Kidd, 1995). It is noted that, in cases of conflict between the needs of fire protection and the need to minimise the intrusion into historic structures, a logical and systematic approach to the assessment of fire safety requirements is needed in order to reveal alternative methods of achieving adequate, appropriate, and cost-effective