

1 **Summary**

2 **Background:** The spread of pathogens via the airborne route is often underestimated and little is
3 known about the extent to which airborne microbial contamination levels vary throughout the day and
4 night in hospital facilities.

5 **Aims:** This study evaluates airborne contamination levels within ICU isolation rooms over 10-24 hr
6 periods, with the aim of improving the understanding of the variability of environmental aerial
7 bioburden, and the extent to which ward activities may contribute to this.

8 **Methods:** Environmental air monitoring was conducted within occupied and vacant inpatient isolation
9 rooms. A sieve impactor sampler was used to collect 500 L air samples every 15 minutes over 10-
10 hour (08:00-18:00 h) and 24-hour (08:00-08:00 h) periods. Samples were collected, room activity
11 logged, and the bacterial contamination levels were recorded as cfu/m³ of air.

12 **Findings:** A high degree of variability in levels of airborne contamination was observed across all
13 scenarios in the studied isolation rooms. Air bioburden increased as room occupancy increased, with
14 air contamination levels highest in rooms occupied for the longest time during the study (10 days)
15 with a mean value of 104.4 cfu/m³ and a range of 12–510 cfu/m³. Counts were lowest in unoccupied
16 rooms, with an average value of 20 cfu/m³ and during the night.

17 **Conclusion:** Peaks in airborne contamination showed a direct relation to an increase in activity levels.
18 This study provides first clear evidence of the extent of variability in microbial airborne levels over
19 24-hour periods in ICU isolation rooms and directly correlates microbial load to ward activity.

20

21

22 **Keywords:**

23 Airborne; contamination; bacteria; air sampling; bioburden; environment

24

25

1 **Introduction**

2 It is estimated that 10-33% of hospital-acquired infections (HAI) are transmitted via the air [1],
3 however the role of air as a vector in the spread of infection is less understood. Over a century on,
4 controversy surrounding particle size, transmission characteristics and associated infection risk have
5 led to a lack of airborne infection control strategies in healthcare premises [2].

6 Airborne transmission is a route for many serious infectious organisms such as norovirus, influenza,
7 SARS, methicillin-resistant *Staphylococcus aureus* (MRSA) and the highly contagious
8 *Mycobacterium tuberculosis*; whilst multi-drug resistant *Acinetobacter* and *Clostridium difficile* have
9 also been identified in hospital air [3]. Air quality standards exist for operating theatres (<180 cfu/m³
10 during an operation, and <10 cfu/m³ during theatre commissioning and in ultraclean theatres) [4],
11 however there are currently no accepted standards for other hospital areas, including ICU which
12 houses arguably the most vulnerable patients.

13 Microorganisms originating from the human respiratory tract can become airborne by coughing,
14 sneezing or exhaling, and remain suspended in the air for prolonged periods of time, sometimes
15 indefinitely [5-7]. These infectious respiratory droplets can evaporate to droplet nuclei which have the
16 ability to travel long distances on air currents, and be easily dispersed throughout hospital buildings.
17 As such, numerous studies have reiterated that environmental contamination should not be
18 underestimated, with regards to infection transmission directly from airborne dust, respiratory droplets
19 or droplet nuclei, or indirectly once settled onto surfaces [8, 9-11].

20 The aim of the present study was to assess, for the first time, continuous (10-24 hour) monitoring of
21 the levels of airborne microorganisms in an ICU and correlate changes in airborne contamination
22 levels to room activity, to generate an improved understanding of the airborne microbial load in a
23 hospital setting.

24

25

1 **Methods**

2 *Setting*

3 This study was conducted in isolation rooms of an ICU between May and December 2017. The Unit
4 has 3 inpatient isolation rooms and a 7-bed open bay. Isolation rooms chosen for sampling tended to
5 house serious burn trauma cases, critical postoperative care patients or potentially infectious patients.
6 Air entering the unit passes through High Efficiency Particulate Air (HEPA) filters. Both occupied
7 and unoccupied isolation rooms, with an area of approximately 25-30 m² (5 × 6 m), were sampled as
8 part of the study. Rooms were maintained at positive pressure, with a temperature of around 20°C,
9 and had no windows that could be opened. Rooms were cleaned daily: domestic staff cleaned the
10 floor, sink, surfaces, bins and ledges, and nursing staff damp-dusted all frequently touched surfaces
11 and equipment. Cleaning was monitored fortnightly by Facilities staff, adhering to NHS Scotland
12 National Cleaning Services Specifications. GRI Infection Control Policies were adhered to throughout
13 [12].

14

15 *Sample Collection Methods*

16 Monitoring of airborne contamination was conducted using a Surface Air System (SAS) Super-180
17 sieve impactor active air sampler (Cherwell Laboratories, UK). The air sampler was situated in the
18 corner of the isolation room, approximately 1-1.5m above the ground and sampled the air by actively
19 drawing a pre-set air volume through the sampler. 500-L air samples were collected every 15 minutes
20 over 10-hour (08:00–18:00h) and 24-hour (08:00–08:00h) periods onto non-selective tryptone soya
21 agar (TSA) plates (Oxoid Ltd, UK), favourable for environmental sampling. An activity log was
22 compiled to record room activity that may correlate with peaks in air contamination. After sampling,
23 TSA plates were incubated at 37°C for 48-hours and enumerated. The total number of microbial
24 colony-forming units (cfu) on each plate was corrected for the statistical probability of multiple
25 particles passing through the same hole, by referring to correction tables supplied with the equipment

1 [13]. The probable count (Pr) was then used to calculate the cfu per cubic metre of air sampled using
2 the equation:

$$3 \quad X = \frac{\text{Pr} \times 1000}{V}$$

4 where V = volume of air sampled; Pr = probable count; X = cfu per 1 m³ of air.

5

6 *Statistical analysis*

7 Data was analysed using statistical control charts (Minitab v17) to determine data points classed as
8 ‘out of control’ from the overall dataset of each case study based on rationale by previous work [14].
9 ‘Out of control’ observations (flagged in red) are data points >3 standard deviations above the mean
10 and are significantly greater than the mean of the dataset. Analysis of data between case studies was
11 also conducted using one-way ANOVA at the 95% confidence level (Minitab v17).

12

13

14 **Results**

15 *Airborne bioburden monitoring over 10-h in patient-occupied isolation rooms*

16 Ten-hour monitoring of patient-occupied isolation rooms took place on three separate sampling days
17 from 08:00–18:00h. The first case study (Fig. 1a) involved a 71-year-old male patient, with a post
18 partial pancreatectomy for cancer and multi-organ failure, occupying the room for 8 days prior to
19 commencement of air monitoring. Results (Table I) demonstrate a high degree of variability over the
20 10-h period, with a mean airborne bacterial load of 64.3±31.8 cfu/m³, and a minimum of 12 cfu/m³,
21 and a maximum of 166 cfu/m³. This maximum (Observation 16 at 11:45h) was statistically classified
22 as ‘out of control’ and coincided with collection after fresh bed sheets were shaken in preparation of a
23 bed change.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25

The results of a second case study (Fig. 1b) were generated in a room which housed a 37-year-old male patient with severe community-acquired pneumonia who had occupied the room for 7 days prior. A mean value of 44.1 ± 36.1 cfu/m³ was recorded. The patient was mobile, talking and subsequently transferred from ICU after completion of the study. Airborne contamination levels remained low and consistent for most of the study (between 10–50 cfu/m³) from (08:00–14:00h) during which room activity was minimal. The number of people entering the room was low (0-2) as the patient did not require 1:1 care for most of the period. Bioburden levels increased from 10–110 cfu/m³ in response to the presence of a visitor at 14:00 (observation 25), and remained elevated until their departure (observation 29 at 15:00h). Significantly higher ('out of control') levels were observed when the patient was assisted out of bed, followed by the removal of the bed from the room. This group of activities occurred between 15:45–16:30h (observation 32-35) and resulted in an increase to 166 cfu/m³.

A third study (Fig. 1c) was conducted in a room occupied by a 75-year-old female patient, admitted to ICU with pneumonia and multi-organ failure and occupied the room for 3 days. A mean of 48.8 ± 20.5 cfu/m³ was recorded with a range of 20–116 cfu/m³. 'Out of control' levels occurred due to a high level of room activity during patient re-intubation, involving an increase from 2 to 4 staff within the room and a higher degree of physical movement around the patient's bed (Observation 9; 10:00h).

Overall, airborne bioburden data (Fig. 1) demonstrates that there is significant variability ($P=0.008$) in airborne bacterial counts across the 10-h sampling period in all 3 independent case studies conducted in patient-occupied isolation room studies regardless of patient scenario (Table I).

1 *Airborne bioburden monitoring over 24-h patient-occupied isolation rooms*

2 The first 24-hour case study was conducted in a room occupied for 10 days by a 70-year-old female
3 with respiratory failure on a background of gastroenteritis and *Clostridium difficile* infection (Fig. 2a).
4 Over the 24-hour period, the mean air bioburden was 104.4 ± 96.2 cfu/m³ with minimum and
5 maximum recorded values of 12 and 510 cfu/m³, respectively. When the dataset was divided into
6 'day' and 'night' (08:00–20:00h and 20:00–08:00h, respectively), the mean airborne count from the
7 'day' was 151.2 cfu/m³, in comparison to a mean 'night' value of 56.6 cfu/m³ ($P < 0.001$). The 'out of
8 control' levels collected at 11:15–11:45h (observations 14-16) were a direct result of a high degree of
9 room activity in which an increased staff presence (from 1 to 5) aided the movement of the patient
10 from a bed via a mechanical hoist. Additionally, the footfall in and out of the room was substantially
11 higher during these samples leading to a peak count of 510 cfu/m³, the highest level of air bioburden
12 recorded across the entire set of case studies.

13

14 Figure 2b displays the air monitoring results in a room occupied for 6-days by a male patient with
15 Guillian-Barre demyelinating disease and widespread muscle weakness. Air contamination levels
16 varied substantially across 24 hours, with 'out of control' levels occurring during visiting hours. The
17 mean value across the 24 hours was 102.4 ± 68.8 cfu/m³ with a minimum value of 5 cfu/m³ recorded at
18 04:45h and maximum value of 355 cfu/m³ recorded at 14:45h. The mean values for 'day' and 'night'
19 were 113.6 and 91.0 cfu/m³ respectively ($P = 0.080$), (Table I).

20

21 The final case study (Fig. 2c) was conducted in an isolation room occupied for 1 day by a 56-year-old
22 immunocompromised female patient with respiratory failure and background of rheumatoid arthritis.
23 The overall mean value across the 24-hour case study was 62.1 ± 82.4 cfu/m³ with a range of 0–398
24 cfu/m³. An initial surge in airborne bacteria to the maximum value of 398 cfu/m³ occurred in response
25 to an increase in staff presence required to assist patient intubation. Significantly high levels of 214
26 cfu/m³ were also observed when a ventilator was changed (Observation 9; 10:00h). Contamination

1 levels peaked again at observation 33-36 (16:00–17:00h), during which the patient was wheeled out of
2 the room for a CT scan resulting in air counts of 300–400 cfu/m³. The mean day time value was 86.9
3 cfu/m³, followed by relatively low and consistent values during the night with an average of 36.7
4 cfu/m³ ($P=0.002$). Counts then increased from observation 94–97 (07:15-08:00h) during morning
5 handover.

6

7 As a baseline control for comparison, monitoring was also conducted in an empty isolation room (Fig.
8 2d). Airborne bacteria levels were low and consistent across the 24 hours, however average values
9 between ‘day’ and ‘night’ still varied from 26.8 cfu/m³ (08:00–20:00h) to 13.0 cfu/m³ (20:00—8:00h)
10 ($P<0.001$). An overall mean value of 20.0 ± 14.2 cfu/m³ was recorded. Significant (‘out of control’)
11 levels occurred within this dataset during cleaning of the empty room.

12

13 ***Correlation of high air bioburden levels to room activity***

14 Table II details specific room activities which were consistently linked to high levels of air
15 contamination across all studies, based on the collated activity logs. Increases in air bioburden as a
16 result of each activity were calculated as a percentage increase from the sample mean of the
17 corresponding study to allow a fair comparison. The two ‘highest risk’ activities for increasing
18 bioburden were (i) the movement/operation of large pieces of equipment and (ii) an increased number
19 of staff in the room. The movement or operation of large equipment into and around patient rooms
20 (e.g. x-ray scanners, mechanical hoists, trolleys) resulted in an increase in air bioburden of 197.6%,
21 with a range of 3.1-540.9% (n=16). An increase in staff numbers within patient rooms caused similar
22 peaks in contamination levels. When >3 staff were present in the room, air counts increased by an
23 average of 197.1% (n=15) from the sample mean. Percentage increase values ranged from 18.2-
24 518.4%. When this scope was widened to include staff numbers greater than 2, the average increase in
25 airborne bacteria was 154.7% (n=43), with a range of 1.5-540.9%. The highest recorded number of
26 staff in a patient isolation room at a given time across all case studies was 9. Other ‘high risk’

1 activities included bed changes (+145.3%), patient personal hygiene/turn (+103.9%), visiting hours
2 (+83.8%) and cleaning (+56.6%).

3

4 **Discussion**

5 Understanding the route and transmission of infectious microorganisms plays a key role in infection
6 prevention. Recently, the role of the environment as a source of infection within clinical
7 establishments has been increasingly documented [15]. However, to date, there have been few studies
8 which have characterised levels of airborne microorganisms within an ICU over extended time
9 periods. Previous clinical air studies have focused on short time periods or specific activities of
10 interest [14, 16, 17]. The present study has significantly expanded this information by successfully
11 demonstrating the levels and fluctuations of airborne bacteria within an ICU during different patient
12 and environmental scenarios over 10 and 24-hour periods.

13

14 Airborne microbial counts were shown to greatly vary across the 10-h or 24-h sampling periods
15 during all case studies (Table I), and this variation was expected given the extremely dynamic nature
16 of an ICU. Results also enabled peaks in airborne bacterial load to be correlated to specific activities,
17 and particular activities to be statistically classified as ‘out-of-control’, but it is important to bear in
18 mind that these ‘out-of-control’ peaks are relative only to the dataset as a whole in which they were
19 recorded.

20

21 Mean bioburden levels recorded in this study are lower than those from other ICU studies which have
22 reported levels between 350–450 cfu/m³ [18, 19], and higher than those from a more recent study
23 (<40 cfu/m³) [20]. The differences are likely due to confounding factors including differences in air
24 change ventilation rates, number of medical staff and patients, patient conditions, and importantly, the
25 sample number and collection times. The degree of variation evidenced in the different case studies in

1 the present work demonstrates that mean levels will be significantly different if different sampling
2 periods and/or lower sample numbers are used.

3

4 Extensive variation in air counts was observed in 10-hour patient-occupied isolation room studies, and
5 mean values reflected the length of room occupation, with one exception (Fig. 2b). In this study the
6 patient occupied the room for 7 days, but the mean airborne bacterial load was only 44.1 cfu/m³. This
7 correlated well with room activity, as in this case, the patient was conscious and required little 1:1
8 care.

9

10 Results from 24-hour monitoring also indicated that the longer the patient occupied the room, the
11 greater the mean cfu/m³, and additionally, the mean ‘day’ airborne counts were statistically different
12 to the equivalent ‘night’ levels ($P<0.001$). This observation reflected the reduced activity in the unit
13 overnight. However, it was interesting to observe that a patient turn activity, which resulted in a
14 significant peak in air counts during the day time (Fig. 3c, observation numbers 34 and 75), had
15 minimal effects when carried out during the night. This potentially indicates that the activity of the
16 unit as a whole contributes to air counts even within individual isolation rooms, highlighting how
17 easily airborne microorganisms are dispersed through the ICU in general. Studies in Burns units have
18 demonstrated the ease by which bacteria are liberated from the patient into the air [21]. One study
19 showed that 31% of dressing changes on MRSA positive burns patients liberated the organism into
20 the air [22]. A similar finding was observed in the present study, whereby an average increase in
21 cfu/m³ of 103.9% (n=16) was recorded during patient personal hygiene/turn activities involving bed
22 bathing and physical movement of the patient.

23

24 A number of patient care-related activities contributed to peaks in air contamination levels, most of
25 which are centred on an increase in people traffic. It is estimated that each individual disperses

1 approximately 10^4 particles while walking, many of which are viable and some pathogenic, meaning
2 the more people present in a room, the greater the chance of dispersing biological particles which may
3 have the potential to cause harm [23, 24]. This is relevant to the present study where an average
4 percentage increase in air bioburden of 197.1% was generated as a result of >3 staff members present
5 in the isolation room. Bed sheet changes have also been implicated in the increase in aerial dispersal
6 of bacteria. In the present study, this caused an average increase of 145.3% (n=7). Previous studies
7 have recorded similar results whereby mean counts of airborne MRSA from infected patients
8 increased from 4.7 cfu/m³ to 116 cfu/m³ during bed sheet changes and remained elevated for some
9 time after the event [25]. Similarly, air counts of up to 2614 cfu/m³ were recorded in response to bed
10 changes in a Burns Unit, with elevated levels persisting for up to 60 minutes [14].

11

12 A previous study monitored variations in airborne bioaerosols in a hospital ward in response to
13 general ward activities, however the longest period of air sampling was 8-hours, with no account of
14 overnight activity and air data [16]. Results agree with the present study in terms of bioaerosol-
15 generating activities and increased dispersal during early mornings when ward activity was high. A
16 strong correlation between increased viable counts and increased *Staphylococcus* species was also
17 observed, indicating the likelihood of an increased dispersal of *S. aureus* when peaks in air
18 contamination occurred. Most 'high risk' activities identified have been previously linked to high
19 airborne bacterial levels, with one exception. The movement of large medical equipment into/within
20 patient rooms caused the highest overall average increase in air bioburden at 197.6% (n=16). This
21 could be due to movement of large air volumes already containing viable organisms or may implicate
22 equipment as significant environmental reservoirs of microorganisms within the ICU.

23

24 Surfaces have been well implicated in the cross-infection of patients by acting as reservoirs for the
25 transmission of microorganisms, but there still remains uncertainty regarding the degree of
26 contribution of the airborne route to the overall spread of infection. However, pneumonia and

1 respiratory tract infections were the second largest group of HAIs and accounted for 22.4% of the
2 total HAIs in Scotland in 2016 [26]. All airborne microbes ultimately end up depositing onto
3 surrounding surfaces, and so can indirectly contribute to infection transmission via direct surface
4 contact. A recent study aimed to establish a correlation between air and surface microbes in the
5 critical care environment, further emphasising this phenomenon [20]. Their research found a strong
6 association between passive air sampling counts and surface counts and indeed made the important
7 point that surface bacteria will include a portion of airborne bacteria after settling. Settle plate
8 standards were also proposed in 2000, as an ‘Index of microbial air contamination (IMA)’, a passive
9 form of air sampling in which microbial contamination from the air is evaluated after it has settled
10 onto the surface of agar plates [27]. Using settle plates as part of routine environmental screening for
11 HAI risk from airborne contaminants could be a positive addition to infection control strategies,
12 however, as shown in the present study through active air sampling, biologically active particles are
13 present at all times in the air of the ICU, even in unoccupied rooms. Therefore, if using passive
14 sampling methods, care should be taken to ensure that counts are not underestimated due to the
15 potential for droplet nuclei to remain suspended for prolonged periods [6].

16

17 As a limitation, identification of the collected microorganisms was not possible. It is important to note
18 though, that although certain activities resulted in high levels of air bioburden, this does not
19 necessarily correlate to a high level of pathogenic organisms. Recently, it was shown that
20 environmental bioburden measured by total colony count did not predict the presence of clinically
21 relevant pathogenic organisms [28]. Additionally, viral collection was not possible with this
22 methodology. Future consideration should be given to identification and correlation of airborne
23 microorganisms with strains originating from the patients housed in the environment, however for the
24 present study the scope was to assess overall variability of airborne bacteria and changes in response
25 to key activities.

26

1 **Conclusion**

2 This study successfully recorded for the first time, environmental air contamination levels in an ICU
3 across 24-hour time periods. Bioaerosol counts varied significantly across sampling periods, however
4 peaks were a direct result of room activity, in particular during the presence of increased numbers of
5 medical staff and/or use of large equipment. Various other factors contributed to increased levels of
6 air contamination, predominantly length of room occupation and people traffic. Although these results
7 are specific to this ICU setting, this study provides an insight into the typical background levels of
8 airborne microorganisms in the critical care setting, and how they change in response to the everyday
9 operation of this dynamic environment. A greater understanding of the airborne transmission route
10 and the clinical airborne microflora is required to more fully understand the role of airborne pathogens
11 in the spread of HAIs, with the aim of establishing more direct and continuous infection control
12 strategies.

13

14 **Acknowledgements**

15 Authors would like to thank the staff and patients at Glasgow Royal Infirmary ICU for their support
16 and patience during this study. Authors also wish to thank The Robertson Trust for their support. Due
17 to the nature of the study, data underpinning this publication cannot be made openly available, but is
18 stored securely on the University of Strathclyde KnowledgeBase at:
19 <https://doi.org/10.15129/ee8f296b-2eeb-41f5-ae55-f527fd5ca1bf>.

20

21 **Conflict of Interest Statement**

22 None declared.

23

24

1 **Funding Sources**

2 L.R.D was supported by an Engineering and Physical Sciences Research Council (EPSRC) Doctoral
3 Training Grant (Reference: EP/M508159/1).

4

5 **References**

- 6 1. House of Commons Public Accounts Committee. Reducing healthcare-associated infections in
7 hospitals in England, Fifty-second report of session 2008-9,
8 <https://publications.parliament.uk/pa/cm200809/cmselect/cmpubacc/812/812.pdf>; 2009 [accessed
9 15 July 2017].
- 10
- 11 2. Hobday R and Dancer S. Roles of sunlight and natural ventilation for controlling infection:
12 historical and current perspectives. *J Hosp Infect* 2013; 84: 271-82.
13 <https://doi.org/10.1016/j.jhin.2013.04.011>
- 14
- 15 3. Mirhoseini SH, Nikaeen M, Shamsizadeh Z, Khanahmad H. Hospital air: A potential route for
16 transmission of infections caused by β -lactam-resistant bacteria. *Am J Infect Control* 2016; 44:
17 898-904. <https://doi.org/10.1016/j.ajic.2016.01.041>
- 18
- 19 4. Department of Health. Health technical memorandum HTM 03e01: specialised ventilation for
20 healthcare premises, Part A: design and validation. London: The Stationary Office; 2007.
- 21
- 22 5. Fitzgerald D, Haas DW. *Mycobacterium tuberculosis*. In: Mandell GL, Bennett JE, Dolin R,
23 editors. Principles and practice of infectious diseases 6th edition. Philadelphia: Churchill
24 Livingstone; 2005, p. 2852-86.
- 25

- 1 6. Beggs CB. The airborne transmission of infection in hospital buildings: fact or fiction ? Indoor
2 Built Environ 2003; 12: 9-18. <https://doi.org/10.1177/1420326X03012001002>
3
- 4 7. Morowaska L. Droplet fate in indoor environments, or can we prevent the spread of infection?
5 Indoor Air 2006; 16: 335-47. <https://doi.org/10.1111/j.1600-0668.2006.00432.x>
6
- 7 8. Dancer SJ. Importance of the environment in MRSA acquisition: the case for hospital cleaning.
8 Lancet Infect Dis 2008; 8:101-13. [https://doi.org/10.1016/S1473-3099\(07\)70241-4](https://doi.org/10.1016/S1473-3099(07)70241-4)
9
- 10 9. King MF, Noakes CJ, Sleigh PA, Camargo-Valero MA. Bioaerosol deposition in single and two-
11 bed hospital rooms: a numerical and experimental study. Build Environ 2013; 59: 436-47.
12 <https://doi.org/10.1016/j.buildenv.2012.09.011>
13
- 14 10. Otter JA, Yezli S, Salkeld JAG, French GL. Evidence that contaminated surfaces contribute to the
15 transmission of hospital pathogens and an overview of strategies to address contaminated surfaces
16 in hospital settings. Am J Infect Control; 41:S6–11. <https://doi.org/10.1016/j.ajic.2012.12.004>
17
- 18 11. Bogusz A, Stewart M, Hunter J, Yip B, Reid D, Robertson C, et al. How quickly do hospital
19 surfaces become contaminated after detergent cleaning? Healthcare Infect. 2013; 18: 3–9.
20 <https://doi.org/10.1071/HI12063>
21
- 22 12. NHS Greater Glasgow and Clyde (NHSGGC). National Infection Prevention and Control Manual.
23 Infection prevention and control homepage, [https://www.nhsggc.org.uk/your-health/infection-](https://www.nhsggc.org.uk/your-health/infection-prevention-and-control/#)
24 [prevention-and-control/#](https://www.nhsggc.org.uk/your-health/infection-prevention-and-control/#); 2012 [accessed 15th April 2019].
25
- 26 13. International pbi S.p.A. “SAS Super 100/180”, “DUO SAS Super 360”, “SAS Isolator” - Code n.
27 18198/19121, 24584, 43216/43217 Instruction Manual. Revision 5. Milan: International PBI

- 1 S.p.A; 2005, p.1-53.
- 2
- 3 14. Bache SE, Maclean M, Gettinby G, Anderson JG, MacGregor SJ, Taggart I. Airborne bacterial
4 dispersal during and after dressing and bed changes on burns patients. *Burns* 2015; 41: 39-48.
5 <https://doi.org/10.1016/j.burns.2014.05.015>
6
- 7 15. Dancer SJ. Controlling hospital-acquired infection: focus on the role of the environment and new
8 technologies for decontamination. *Clin Microbiol Rev* 2014; 27: 665-90.
9 <https://doi.org/10.1128/CMR.00020-14>
10
- 11 16. Hathway EA, Noakes CJ, Fletcher LA, Sleight PA, Clifton I, Elliot MW. The role of nursing
12 activities on the bioaerosol production in hospital wards. *Indoor Built Environ* 2013; 22: 410-21.
13 <https://doi.org/10.1177/1420326X11428088>
14
- 15 17. Andersen BM, Rasch M, Kvist J, Tollefsen T, Lukkassen R, Sandvik L et al. Floor cleaning:
16 effect on bacteria and organic materials in hospital rooms. *J Hosp Infect* 2009; 71: 57-65.
17 <https://doi.org/10.1016/j.jhin.2008.09.014>
18
- 19 18. Huang PY, Shi ZY, Chen CH, Den W, Huang HM, Tsai JJ. Airborne and surface-bound microbial
20 contamination in two intensive care units of a medical centre in central Taiwan. *Aerosol and Air*
21 *Qual Res* 2013; 13: 1060-9. <https://doi.org/10.4209/aaqr.2012.08.0217>
22
- 23 19. Bauer TM, Ofner E, Just HM, Just H, Daschner FD. An epidemiological study assessing the
24 relative importance of airborne and direct contact transmission of microorganisms in a medical
25 intensive care unit. *J Hosp Infect* 2009; 15: 301-9. [https://doi.org/10.1016/0195-6701\(90\)90087-5](https://doi.org/10.1016/0195-6701(90)90087-5)
26

- 1 20. Smith J, Adams CE, King MF, Noakes CJ, Robertson C, Dancer SJ. Is there an association
2 between airborne and surface microbes in the critical care environment? *J Hosp Infect* 2018; 100:
3 e123-9. <https://doi.org/10.1016/j.jhin.2018.04.003>
4
- 5 21. Bache SE, Maclean M, Gettinby G, Anderson JG, MacGregor SJ, Taggart I. Quantifying bacterial
6 transfer from patients to staff during burns dressing and bed changes: implications for infection
7 control. *Burns* 2013; 39: 220-8. <https://doi.org/10.1016/j.burns.2012.12.005>
8
- 9 22. Dansby W, Purdue G, Hunt J, Arnoldo B, Phillips D, Moody B, et al. Aerolization of methicillin-
10 resistant *Staphylococcus aureus* during an epidemic in a burn intensive care unit. *J Burn Care Res*
11 2008; 29: 331–7. <https://doi.org/10.1097/BCR.0b013e3181667583>
12
- 13 23. Noble WC. Dispersal of skin microorganisms. *Br J Dermatol* 1975; 93: 477–485.
14 <https://doi.org/10.1111/j.1365-2133.1975.tb06527.x>
15
- 16 24. Sadrizadeh S, Tammelin A, Ekolind P, Holmberg S. Influence of staff number and internal
17 constellation on surgical site infection in an operating room. *Particuology* 2014; 13: 42–51.
18 <https://doi.org/10.1016/j.partic.2013.10.006>
19
- 20 25. Shiomori T, Miyamoto H, Makishima K, Yoshida M, Fujiyoshi T, Udaka T, et al. Evaluation of
21 bedmaking-related airborne and surface methicillin-resistant *Staphylococcus aureus*
22 contamination. *J Hosp Infect* 2002; 50: 30–5. <https://doi.org/10.1053/jhin.2001.1136>
23
- 24 26. Health Protection Scotland. Scottish national point prevalence survey of healthcare associated
25 infection and antimicrobial prescribing 2016,
26 <https://www.hps.scot.nhs.uk/pubs/detail.aspx?id=3236/>; 2017 [accessed 23 May 2018].

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23

27. Pasquarella C, Pitzurra O, Svino A. The index of microbial air contamination. J Hosp Infect 2000; 46: 241-56. <https://doi.org/10.1053/jhin.2000.0820>

28. Widmer F, Frei R, Romanyuk A, Tschudin Sutter S, Widmer A. Overall bioburden by total colony count does not predict the presence of pathogens with high clinical relevance in hospital and community environments. J Hosp Infect 2019; 101: 240-4. <https://doi.org/10.1016/j.jhin.2018.11.014>

1 **Figure Captions**

2

3 **Fig 1.** Statistical Control Charts (Minitab v17) demonstrating levels of airborne bacteria over a 10-
4 hour period (08:00-18:00) in patient-occupied isolation rooms within an ICU. Rooms were occupied
5 by patients for differing periods prior to the commencement of air sampling: (a) 8 days, (b) 7 days,
6 and (c) 3 days. Each data point represents the probable cfu/m³ from air samples taken at 15-minute
7 intervals and incubated for 48 hours. ‘Out of control’ data points are highlighted in red. ‘High risk’
8 activities leading to increased airborne bioburden above the mean are identified as follows:
9 a=increase in staff presence >3; b=patient personal hygiene/turn; c=bed/sheet changes; d=visiting;
10 e=movement of large equipment into/around room; f=cleaning. (n=41; UCL = upper control limit; \bar{X} =
11 mean; LCL = lower control limit).

12

13 **Fig 2.** Statistical Control Charts (Minitab v17) demonstrating levels of airborne bacteria over a 24-
14 hour period (08:00-08:00) in occupied and unoccupied inpatient isolation rooms of an ICU. In patient
15 occupied rooms, rooms were occupied by patients for differing periods prior to the commencement of
16 air sampling: (a) 10 days, (b) 6 days, and (c) 1 day. Monitoring of an empty patient room was also
17 included for comparison (d). For analysis, periods of ‘Day’ and ‘Night’ were categorised as 08:00-
18 20:00 and 20:00-08:00, respectively. Each data point represents the probable cfu/m³ from air samples
19 taken at 15-minute intervals and incubated for 48 hours. ‘Out of control’ data points are highlighted in
20 red. ‘High risk’ activities leading to increased airborne bioburden above the mean are identified as
21 follows: a=increase in staff presence >3; b=patient personal hygiene/turn; c=bed/sheet changes;
22 d=visiting; e=movement of large equipment into/around room; f=cleaning. (n=97; UCL = upper
23 control limit; \bar{X} = mean; LCL = lower control limit).

24

25

1 **Table I.** Summary of data generated from the different case studies within an ICU monitoring the
 2 microbial air contamination levels across 10- and 24-hour sampling periods. Data were recorded in
 3 occupied and empty patient isolation rooms. For each study, details are also provided for the ward
 4 activities which were associated with the significant increases in airborne bioburden (the ‘out of
 5 control’ observations, as highlighted by the statistical process control charts (Figs 1-3)). Mean and
 6 standard deviation were recorded for each 10 hour case study (n=46), whilst 24 hour studies were
 7 further analysed via day (08:00 – 20:00) and night (20:00 – 08:00) portions of the sample collection
 8 period (n=97).

9

Case Study (Figure)	Length of Room Occupancy (days)	Total Mean (cfu/m ³ ±SD)	Total Range (cfu/m ³)	P Value (95% C.I)	Mean Day (08:00-20:00) (cfu/m ³ ±SD)	Mean Night (20:00 – 08:00) (cfu/m ³ ±SD)	P Value for Day v. Night (95% C.I)	Activities which contributed to increased bioburden and consequent failing of control chart statistical tests (Observation No.)
INPATIENT ISOLATION ROOM 10 HOUR STUDIES								
Fig. 1a	8	64.3 (±31.8)	12-166	0.008	-	-		Fresh bed sheets shaken (16)
Fig. 1b	7	44.2 (±36.1)	8-166		-	-		Increased staff presence from 0 to 2 (9)
Fig. 1c	3	48.8 (±20.5)	20-116		-	-		Patient helped out of bed (32-33) Bed removed from room (35)
INPATIENT ISOLATION ROOM 24 HOUR STUDIES								
Fig. 2a	10	104.4 (±96.2)	12-510	<0.001	151.2 (±111.9)	56.6 (±39.1)	<0.001	Patient turn, patient physio, operation of mechanical hoist, high staff presence (14-18) Increased people traffic from 1 (visitor) to 2 (visitor + nurse) (33)
Fig. 2b	6	102.4 (±68.8)	5-355		113.6 (±79.4)	90.9 (±54.3)	0.080	Increased people traffic from 0 to 2 (visitor + nurse) (27-29)
Fig. 2c	1	62.1 (±82.4)	0-398		86.9 (±95.8)	36.7 (±56.3)	0.002	Increased staff presence from 2-5 staff (4) Ventilator change (9) Patient in bed taken for CT scan followed by return (33,34) Patient turn (36)
Fig. 2d	0	20.0 (±14.2)	2-90		26.8 (±16.3)	13.0 (±6.6)	<0.001	Room cleaning (17) Brief open and close of door (31) Handover of sampler (49)

1 **Table II.** Overview of the ‘high risk’ ward activities which contributed to increases in airborne
 2 microbial bioburden. Activities which consistently correlated to high air counts were selected, and
 3 percentage increases in cfu/m³ were calculated from the sample mean of the corresponding case study.
 4 The overall average percentage increase is given, alongside the sample size (n).

5

Activity	Average % increase from sample mean	Range (%)
Increase in staff presence >3	197.1	18.2-518.4 (n=15)
Personal patient hygiene/turn	103.9	1.5-359.8 (n=16)
Bed/sheet changes	145.3	1.5-276.4 (n=7)
Visiting	83.8	5.4-247.3 (n=23)
Movement of large equipment into/around room	197.6	3.1-540.9 (n=16)
Cleaning	56.6	27.1-95.4 (n=5)

6

7

8

9

10

11

12

13


14

15

16


17

1 Figure 1(a)

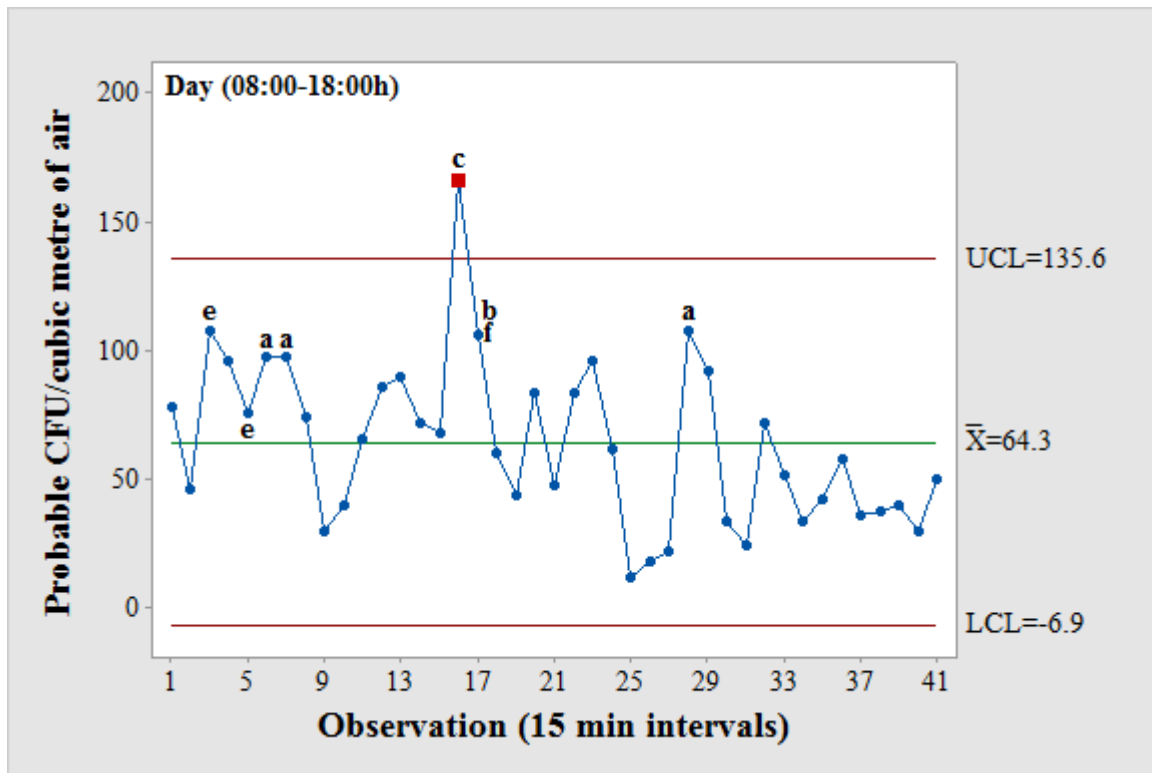


2

3 Figure 1(b)

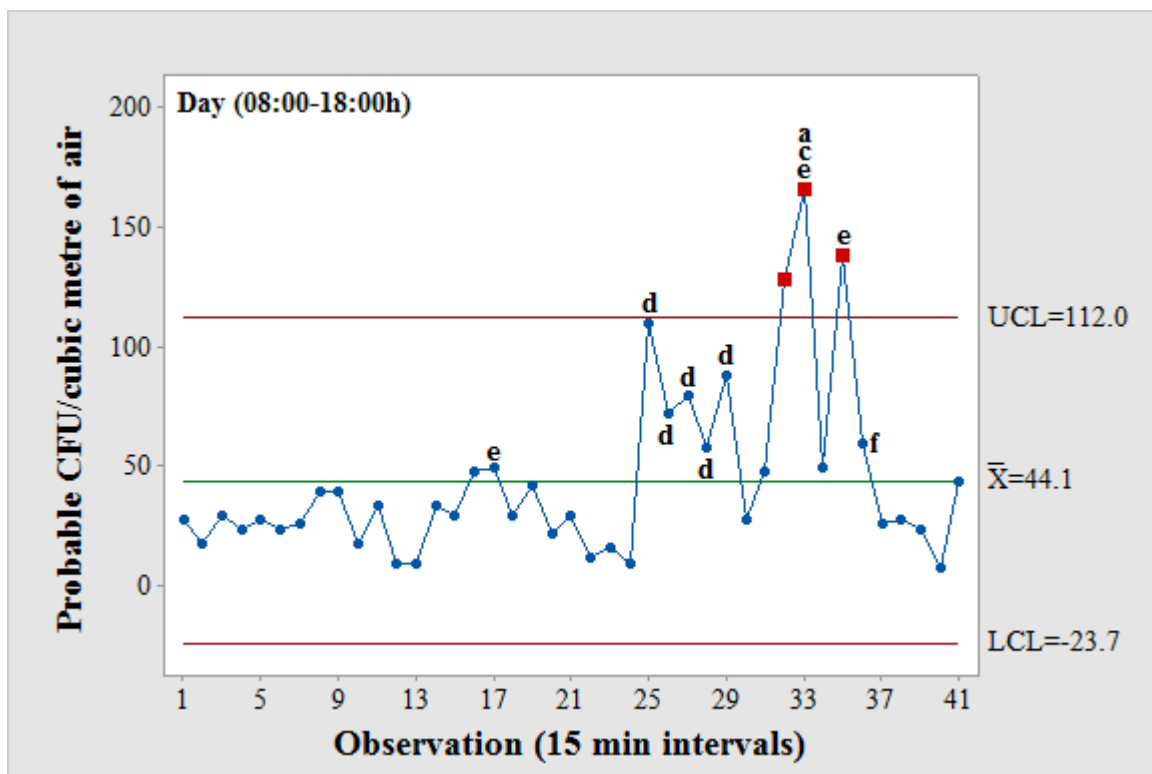


4

1 Figure 1(c)

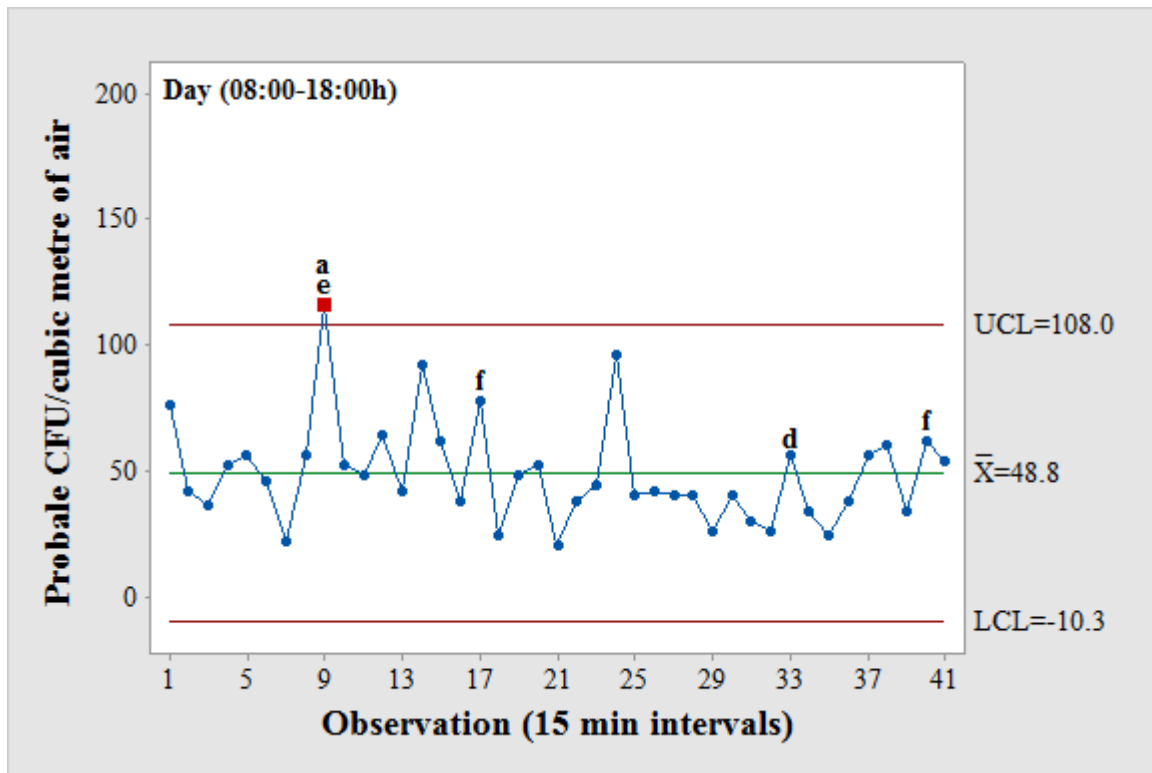


2

3 Figure 2(a)

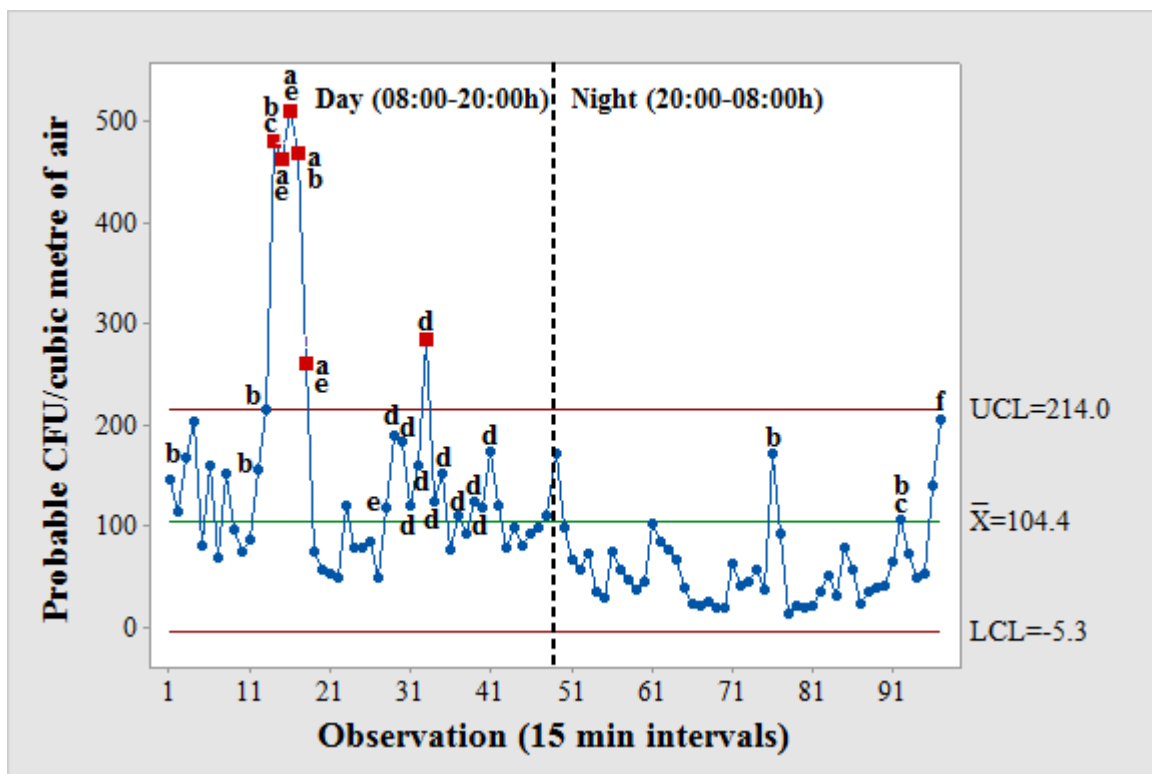


4

1 Figure 2(b)

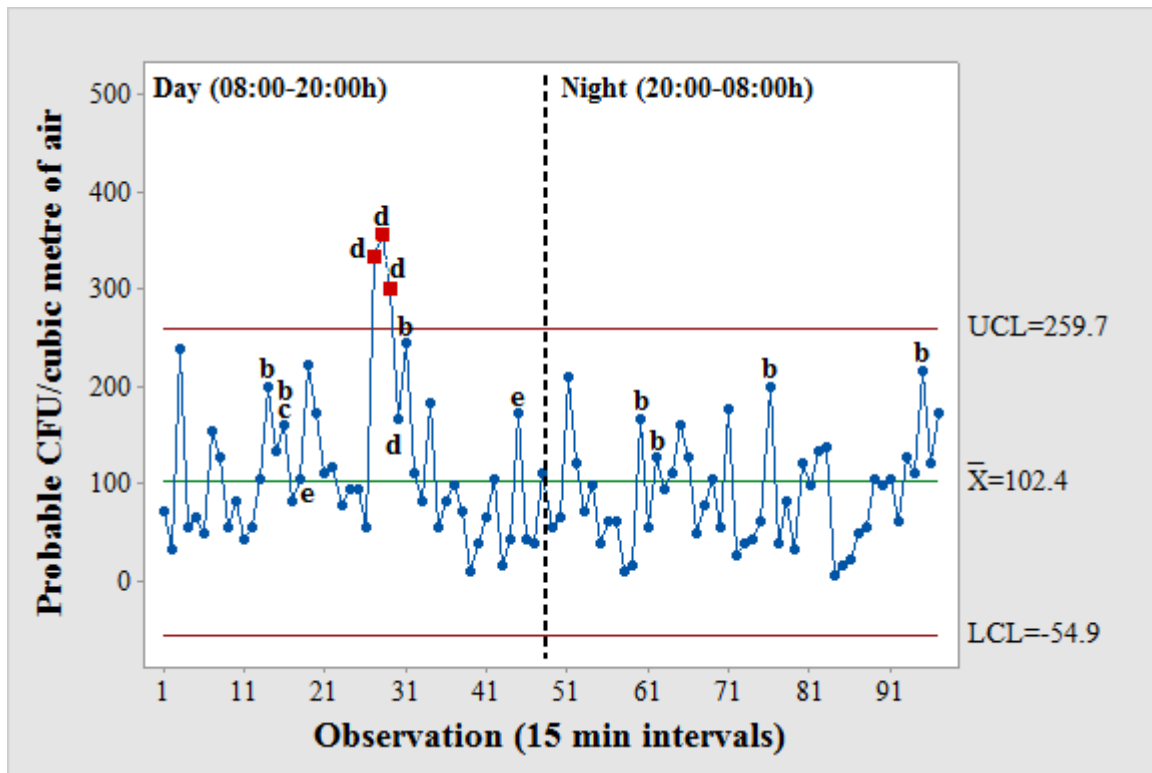


2

3 Figure 2(c)

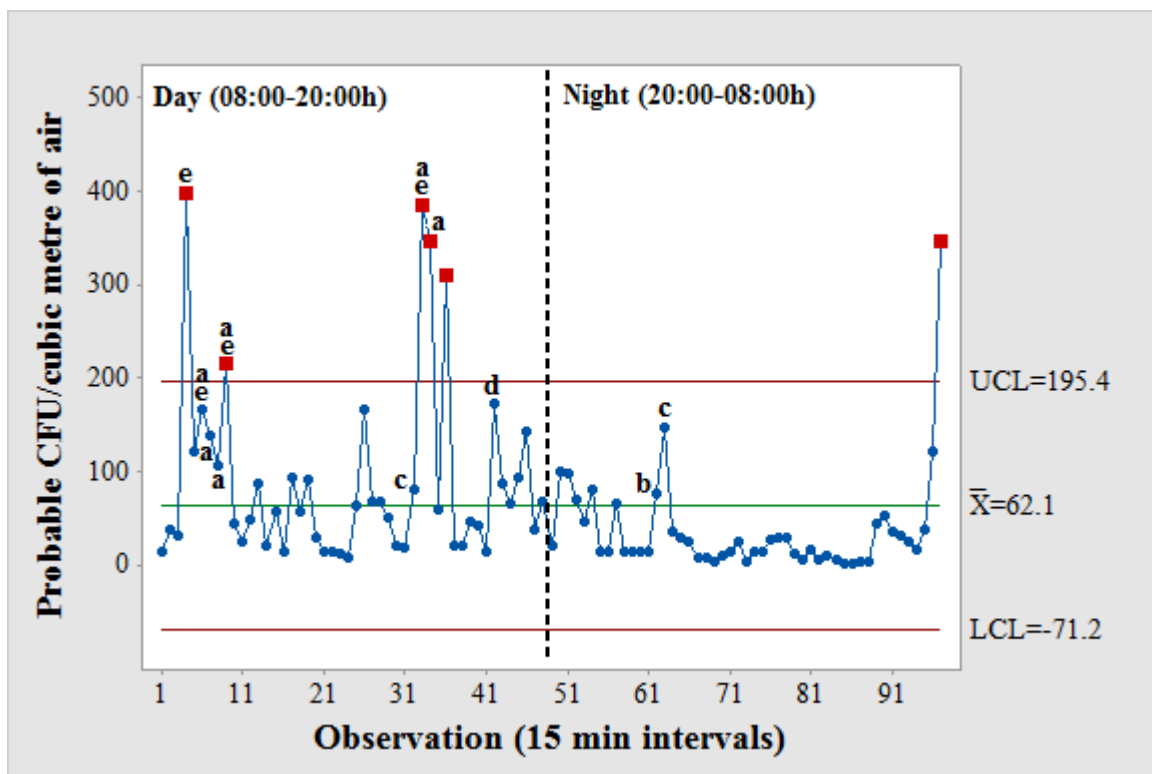

4

1 Figure 2(d)

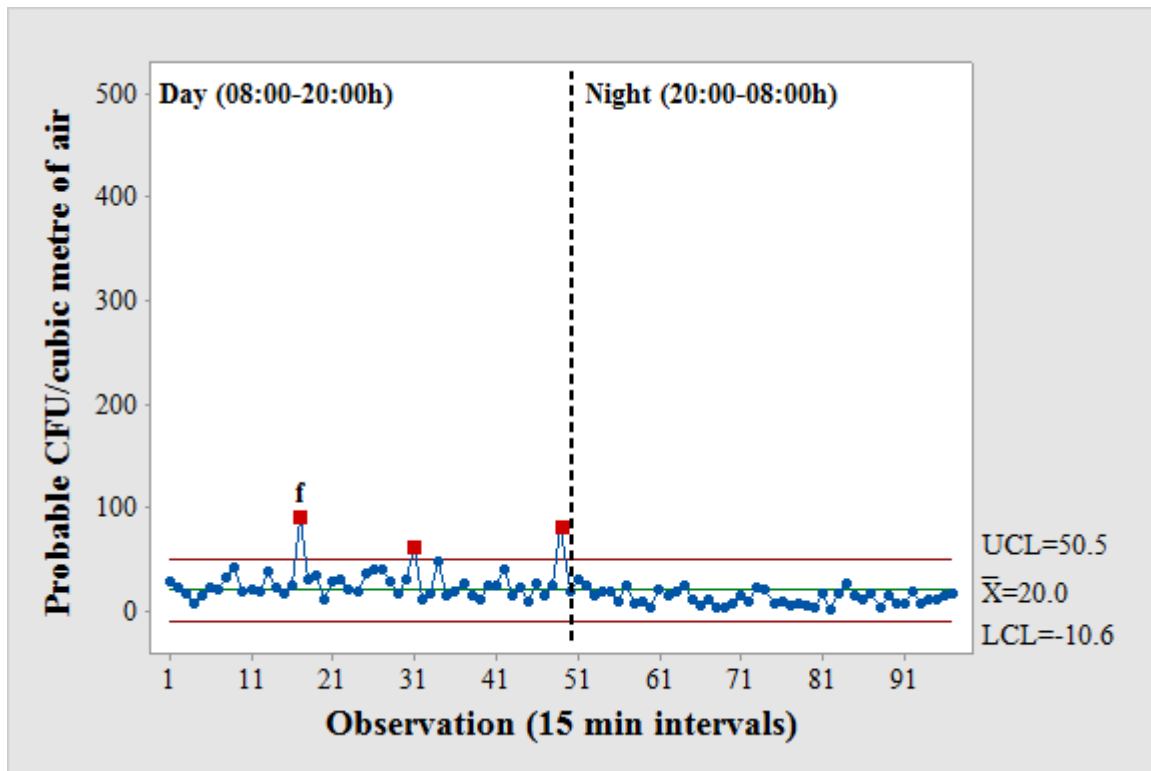

2