

BEHAVIOR OF AEROSOLS IN A STEAM-AIR ENVIRONMENT

R. E. Adams M. L. Tobias
 A. W. Longest

Oak Ridge National Laboratory
 Oak Ridge, Tennessee 37831

CONF-850406--8

TI85 011422

DISCLAIMER

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

For publication in the Proceedings of the International Symposium - Workshop on Particulate and Multi-Phase Processes and 16th Annual Meeting of the Fine Particle Society Miami Beach, Florida, April 22-26, 1985.

MASTER

By acceptance of this article, the publisher or recipient acknowledges the U.S. Government's right to retain a nonexclusive, royalty-free license in and to any copyright covering the article.

→ *Research sponsored by the Office of Nuclear Regulatory Research, U.S. Nuclear Regulatory Commission under Interagency Agreements 40-551-75 and 40-552-75 with the U.S. Department of Energy under contract DE-AC05-84OR21400 with Martin Marietta Energy Systems, Inc.

JEW

BEHAVIOR OF AEROSOLS IN A STEAM-AIR ENVIRONMENT

R. E. Adams M. L. Tobias
A. W. Longest

Oak Ridge National Laboratory
Oak Ridge, Tennessee 37831

INTRODUCTION

The behavior of aerosols assumed to be characteristic of those generated during light water reactor (LWR) accident sequences and released into containment is being studied in the Nuclear Safety Pilot Plant (NSPP) which is located at the Oak Ridge National Laboratory (ORNL). This project, which is part of the ORNL Aerosol Release and Transport (ART) Program, is sponsored by the Division of Accident Evaluation, Nuclear Regulatory Commission, and the purpose is to provide experimental qualification for LWR aerosol behavior codes under development.

The program plan for the NSPP aerosol project provides for the study of the behavior, within containment, of simulated LWR accident aerosols emanating from fuel, reactor core structural materials, and from concrete-molten core materials interactions. The aerodynamic behavior of each of these aerosols was studied individually to establish its characteristics; current experiments involve mixtures of these aerosols to establish their interaction and collective behavior within containment. Tests have been conducted with U3O8 aerosols, Fe2O3 aerosols, and concrete aerosols in an environment of either dry air [relative humidity (RH) less than 20%] or steam-air [relative humidity (RH) approximately 100%] with aerosol mass concentration being the primary experimental variable. Experiments are underway involving mixtures of these

aerosols, and, to date, the test aerosol mixture has been $\text{Fe}_2\text{O}_3 + \text{U}_3\text{O}_8$; in these tests the primary experimental variables have been aerosol mass concentration and aerosol composition (mass ratio).

EXPERIMENTAL

The NSPP facility, shown schematically in Fig. 1, includes a test containment vessel, aerosol generating equipment, analytical sampling and system parameter measuring equipment, and an in-vessel liquid spray decontamination system. The NSPP vessel is a stainless steel cylinder with dished ends having a diameter of 3 m, a total height of 5.5 m, and a volume of 38.3 m^3 . The floor area is 7.7 m^2 and the internal surface area (including top, bottom, and structural items) is 68.9 m^2 . The equipment for the measurement of aerosol parameters includes filter samplers for measuring the aerosol mass concentration, coupon samplers for aerosol fallout and plateout measurement, cascade impactors and a centrifuge sampler for determining the aerodynamic particle size distribution of the aerosol, and devices for collecting samples for electron microscopy. System parameters measured are moisture content of the vessel atmosphere, steam condensation rates on the vessel wall, temperature of vessel atmosphere, temperature gradients near the wall, and vessel pressure.

The test aerosols are produced with a generator which consists of a commercial plasma torch assembly and a special reaction chamber into which metal or concrete powder is injected together with argon and oxygen gases. The U_3O_8 test aerosol is produced through vaporization of uranium powder in the plasma flame, followed by reaction of the vapor

with oxygen and subsequent condensation as very small U_3O_8 particles. The Fe_2O_3 test aerosol is generated in the same manner. For production of concrete aerosol, powdered concrete is injected into the plasma flame where both compound decomposition and compound vaporization/condensation occur in contrast to chemical compound formation as in the case of U_3O_8 and Fe_2O_3 aerosol.

For the dry aerosol tests the vessel atmosphere was dry air (RH <20%) and the temperature and pressure were slightly above ambient. The slight elevations in temperature and pressure result from the heat produced and gases injected by the plasma torch aerosol generator.

The steam-air aerosol tests were conducted under quasi-steady-state steam conditions. The test atmosphere was prepared by injecting steam into the vessel (initially at subatmospheric pressure) to form a steam-air mixture at elevated temperature and pressure (around 380 K and at an absolute pressure of about 0.2 MPa); upon achieving this condition the rate of steam injection was reduced and the accumulated steam condensate removed from the vessel. The test aerosol was then introduced and steam injection was continued for six hours at a low rate to balance steam losses by wall condensation and assure maintenance of the quasi-steady-state conditions.

Single-Component Aerosol Tests

A number of single-component aerosol tests have been conducted under both dry air and steam-air test environments. Table I lists these tests.

Under dry conditions the three aerosols, U_3O_8 , Fe_2O_3 , and concrete, behave in a different manner with regard to rate of removal (decrease in

aerosol mass concentration) from the vessel atmosphere. Figure 2 compares the behavior of the three aerosols. (Note that the aerosol mass concentration is normalized with respect to maximum concentration and that time is measured from the time of termination of aerosol generation for the purpose of comparison.) Scanning electron microphotography (SEM) shows the aerosols to be agglomerated in the form of branched-chains (Fig. 3). Particle size measurements by cascade impactors and spiral centrifuges indicated that the aerodynamic mass median diameter (AMMD) of the U_3O_8 and Fe_2O_3 aerosols ranged between 1.5 and 3 μm while that of the concrete aerosol was about 1 μm , or less. Based upon the results from these tests under dry conditions, it has been observed that these aerosols have similar sizes and shapes but act aerodynamically in a different fashion.

The presence of steam in the test environment causes a change in both the aerodynamic behavior and the physical shape of these aerosols. The aerodynamic behavior of the aerosols is compared in Fig. 4. The most obvious effect of steam is an enhanced rate of aerosol removal from the vessel atmosphere in the case of U_3O_8 and Fe_2O_3 aerosols. For example, in Fig. 2 under dry conditions, the time required for 99% of the Fe_2O_3 aerosol to disappear from the vessel atmosphere is about 350 min; under steam-air conditions (Fig. 4) this time is about 100 min. A similar comparison can be made for U_3O_8 aerosol. The shape of these two aerosols is changed from chain-agglomerate to almost spherical by the presence of steam as illustrated in Fig. 5 for U_3O_8 . The AMMD for the U_3O_8 or Fe_2O_3 aerosols in steam ranged from about 1 to 2 μm .

Concrete aerosol does not seem to be affected by the presence of steam in the same manner as U_3O_8 or Fe_2O_3 aerosol. This lack of influence is illustrated in Fig. 6 where the rates of removal of concrete aerosol under dry and under steam-air conditions are compared. This aerosol was generated by passing powdered limestone-aggregate concrete through the plasma torch aerosol generator. The concrete aerosol is not a simple, single-component, aerosol such as U_3O_8 or Fe_2O_3 ; it is actually a complex mixture of Al_2O_3 , SiO_2 , CaO , MgO , Fe_2O_3 , and various silicates with Al, Ca, Mg, and Fe as the cations. Steam also affects the physical shape of concrete aerosols (possibly to a slightly lesser degree than for U_3O_8 or Fe_2O_3) producing some spherical agglomerates. Figure 7 contains scanning electron microphotographs of a concrete aerosol in a dry air and in a steam-air atmosphere.

Multi-Component Aerosol Tests

Recent activities in the NSPP involve the study of the behavior of multi-component (mixed) aerosols in both dry air and steam-air environments. Details of these tests are contained in Table II. The first mixed aerosol to be studied in detail is $U_3O_8 + Fe_2O_3$. This mixture simulates those aerosols emanating from molten fuel and molten-core support and structural materials. Experimental procedures are essentially the same as for the single-component aerosol tests. The principal difference is in aerosol generation; the U_3O_8 and Fe_2O_3 aerosols are produced with separate plasma torch generators and allowed to mix within the vessel.

Four mixed aerosol experiments involving various mixtures of Fe_2O_3 and U_3O_8 aerosols have been completed; three were conducted in a steam-air environment and one in a dry air ($\text{RH} < 20\%$) environment. The behavior of the mixed aerosol ($\text{Fe}_2\text{O}_3 + \text{U}_3\text{O}_8$) in a steam-air environment has been similar in the three experiments conducted, although the mass ratio of Fe_2O_3 to U_3O_8 has been different in each case. The aerosol mass fraction airborne (C/C_{max}) as a function of time after termination of aerosol generation is illustrated in Fig. 8 for these experiments. Although the rate of aerosol removal during the first 30 min is somewhat larger in Exps. 611 and 613 as compared to Exp. 612, the time required for 99% removal of aerosol mass from the volume of the vessel is about 60 min in all three experiments. SEM photographs of the mixed aerosol showed almost spherical clumps of aerosol in each case. The AMMD of the mixed aerosol in all cases was in the 1 to 1.7- μm range.

To illustrate the effect of steam on the behavior of the mixed aerosol, the results from experiment 631 are compared with those of Nos. 611-613 in Fig. 8. Under dry air conditions, the mixed aerosol tends to remain airborne longer than under steam-air conditions. Note that the time required for 99% of this aerosol to be removed from the vessel is about 400 min as compared with 60 min for the aerosol in the steam-air environment. SEM photographs show the aerosol to be in the form of chain-agglomerates (also observed in previous experiments with Fe_2O_3 or U_3O_8 aerosol in dry air) rather than in spherical clumps as in Nos. 611-613. The AMMD for the mixed aerosol is slightly larger in the dry atmosphere with a value as large as 2.7 μm being observed.

It appears, based upon data in hand, that the influence of one aerosol component on the other, in a mixed aerosol, can be significant. The behavior of a mixed $\text{Fe}_2\text{O}_3 + \text{U}_3\text{O}_8$ aerosol is compared with that of a Fe_2O_3 aerosol and a U_3O_8 aerosol in Fig. 9. The behavior (rate of aerosol mass removal) of the $\text{Fe}_2\text{O}_3 + \text{U}_3\text{O}_8$ aerosol is more similar to that of Fe_2O_3 aerosol than that of U_3O_8 aerosol. Future tests on mixed aerosols will permit a more definitive examination of the influence of one component on another in mixed aerosols.

SUMMARY

General statements may be made on the behavior of single-component and multi-component aerosols in the NSPP vessel. The removal processes for U_3O_8 , Fe_2O_3 , and $\text{U}_3\text{O}_8 + \text{Fe}_2\text{O}_3$ aerosols are enhanced in a steam-air atmosphere. Steam-air seems to have little effect on removal of concrete aerosol from the vessel atmosphere. A steam-air environment causes a change in aerosol shape from chain-agglomerate to basically spherical for U_3O_8 , Fe_2O_3 , and $\text{U}_3\text{O}_8 + \text{Fe}_2\text{O}_3$ aerosol; for concrete the change in aerosol shape is from chain-agglomerate to partially spherical. The mass ratio of the individual components of a multi-component aerosol seems to have an observable influence on the resultant behavior of these aerosols in steam.

The enhanced rate of removal of the U_3O_8 , the Fe_2O_3 , and the mixed $\text{U}_3\text{O}_8 + \text{Fe}_2\text{O}_3$ aerosols from the atmosphere of the NSPP vessel by steam-air is probably caused by the change in aerosol shape and the condensation of steam on the aerosol surfaces combining to increase the effect of gravitational settling. The apparent lack of an effect by steam-air

on the removal rate of concrete aerosol could result from a differing physical/chemical response of the surfaces of this aerosol to condensing steam.

Table I. Details of single-component aerosol tests

Test Nos.	Aerosol	No. of tests	Test environment	Aerosol conc. range ($\mu\text{g}/\text{cm}^3$)
201-7, 209	U ₃ O ₈	8	Air (dry)	0.05-9.0
208, 210	U ₃ O ₈	2	Air (moist)	7.1, 12.5
401-4, 406-7	U ₃ O ₈	6	Air-steam	5.8-28.0
511	Fe ₂ O ₃	1	Air (dry)	2.4
501-5	Fe ₂ O ₃	5	Air-steam	1.0-8.5
531	Concrete	1	Air (dry)	1.5
521-2	Concrete	2	Air-steam	1.1, 1.5

Table II. Details of multi-component aerosol tests

Test No.	Mixed aerosol	Test environment	Max. aerosol conc. ($\mu\text{g}/\text{cm}^3$)	Mass ratio ($\text{Fe}_2\text{O}_3/\text{U}_3\text{O}_8$)
611	$\text{U}_3\text{O}_8 + \text{Fe}_2\text{O}_3$	Air-steam	4.0 5.5	1.4/1
612	$\text{U}_3\text{O}_8 + \text{Fe}_2\text{O}_3$	Air-steam	1.8 0.5	0.3/1
613	$\text{U}_3\text{O}_8 + \text{Fe}_2\text{O}_3$	Air-steam	0.7 6.8	9.7/1
631	$\text{U}_3\text{O}_8 + \text{Fe}_2\text{O}_3$	Air (dry)	1.7 1.2	0.7/1

NSPP FACILITY SCHEMATIC

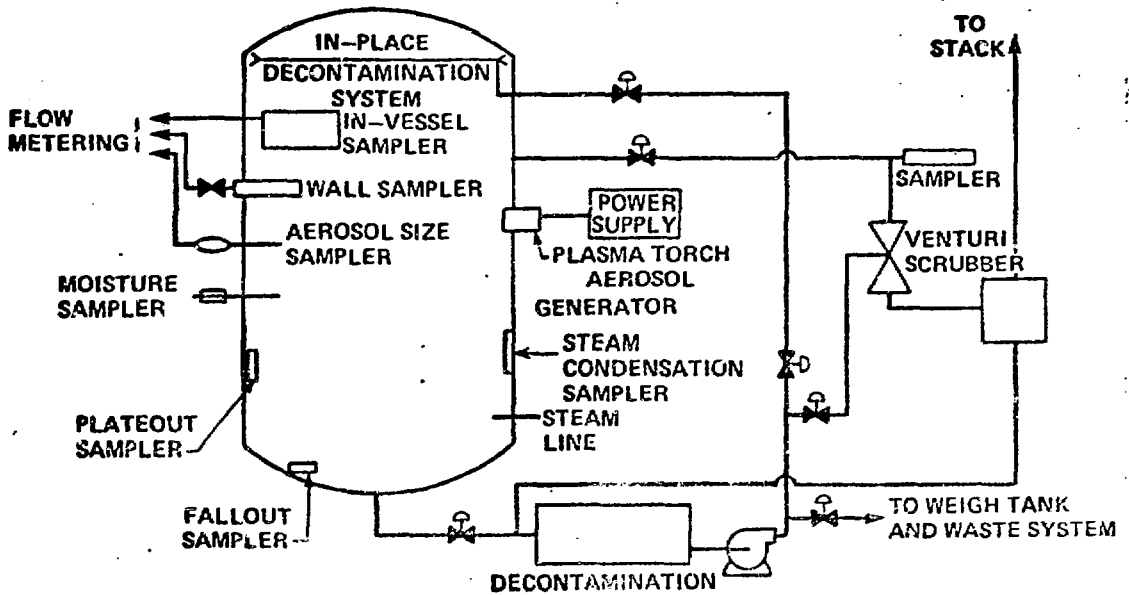


Fig. 1

BEHAVIOR OF VARIOUS AEROSOLS IN A DRY ENVIRONMENT (RH < 20%)

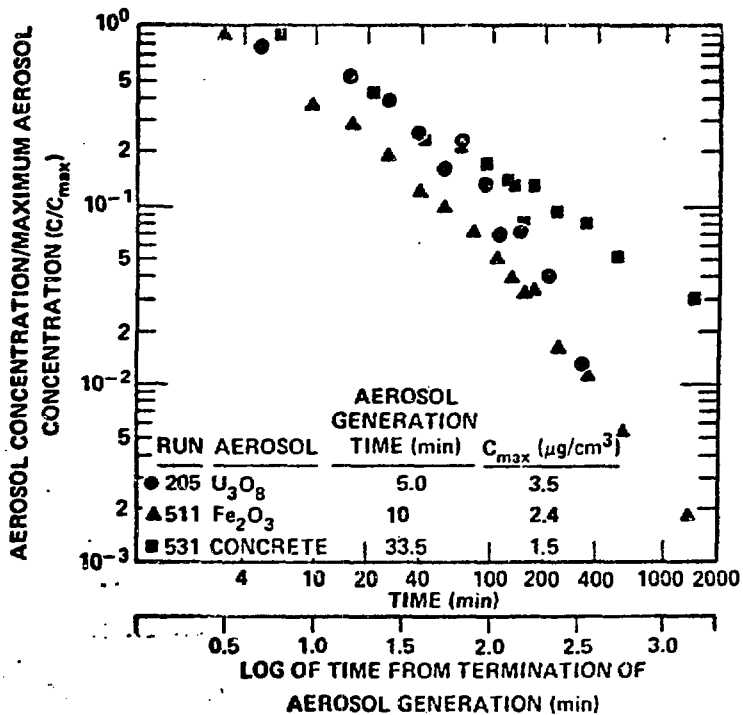


Fig. 2

**TYPICAL CHAIN AGGLOMERATE AEROSOLS IN A DRY
AIR ENVIRONMENT (RH < 20%)**



TEST 207, U_3O_8 , 2000X



TEST 511, Fe_2O_3 , 2000X



TEST 531, CONCRETE, 2700X

Fig. 3

BEHAVIOR OF VARIOUS AEROSOLS IN A STEAM-AIR ENVIRONMENT (RH ~ 100%)


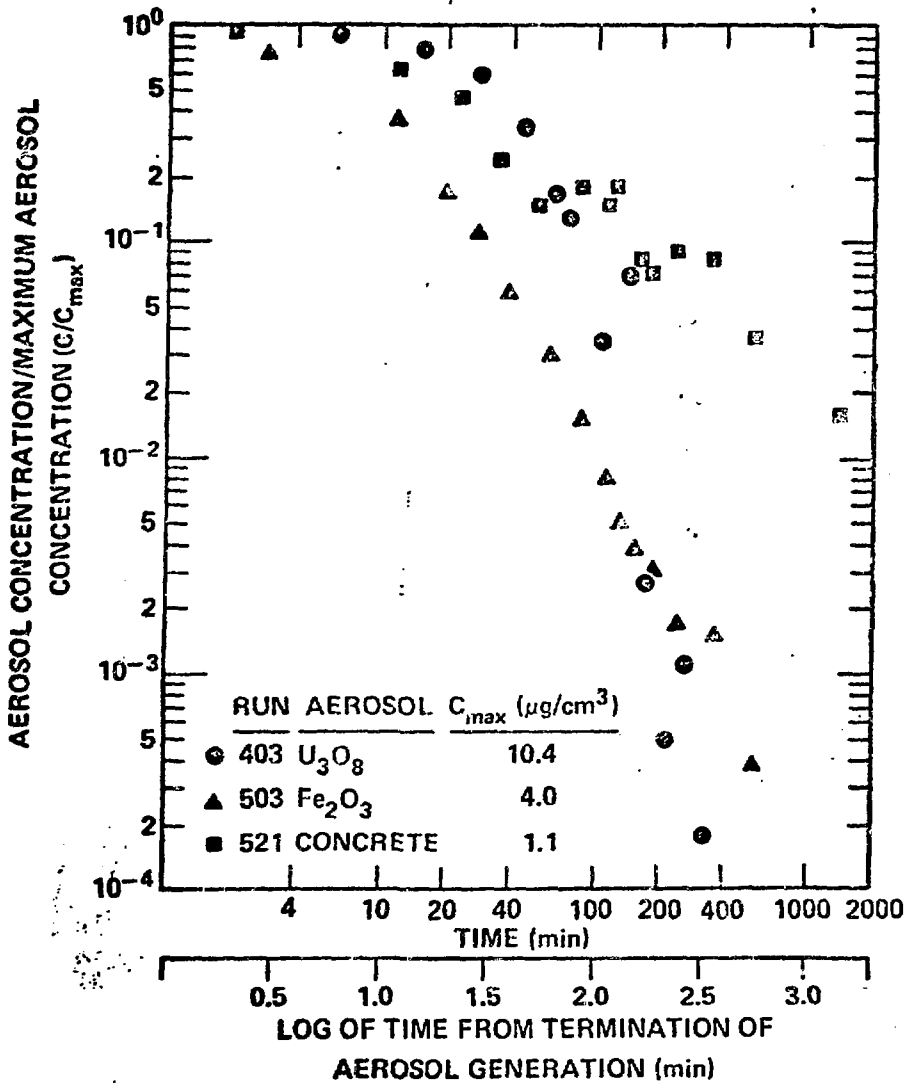


Fig. 4


**MOISTURE/STEAM INFLUENCES PHYSICAL SHAPE
OF U_3O_8 AEROSOL AGGLOMERATES**



**TEST 207 - DRY ATMOSPHERE
(RH 20%)**

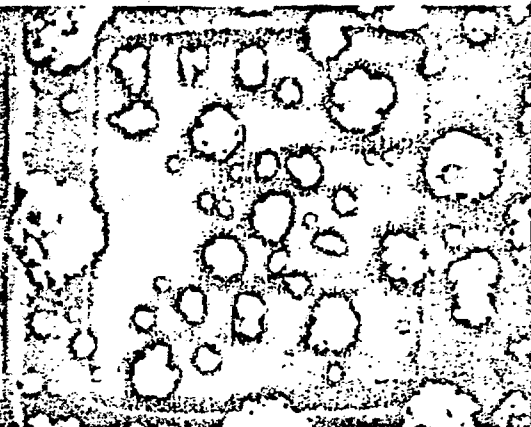

**TEST 208 - MOIST ATMOSPHERE
(RH 95%)**

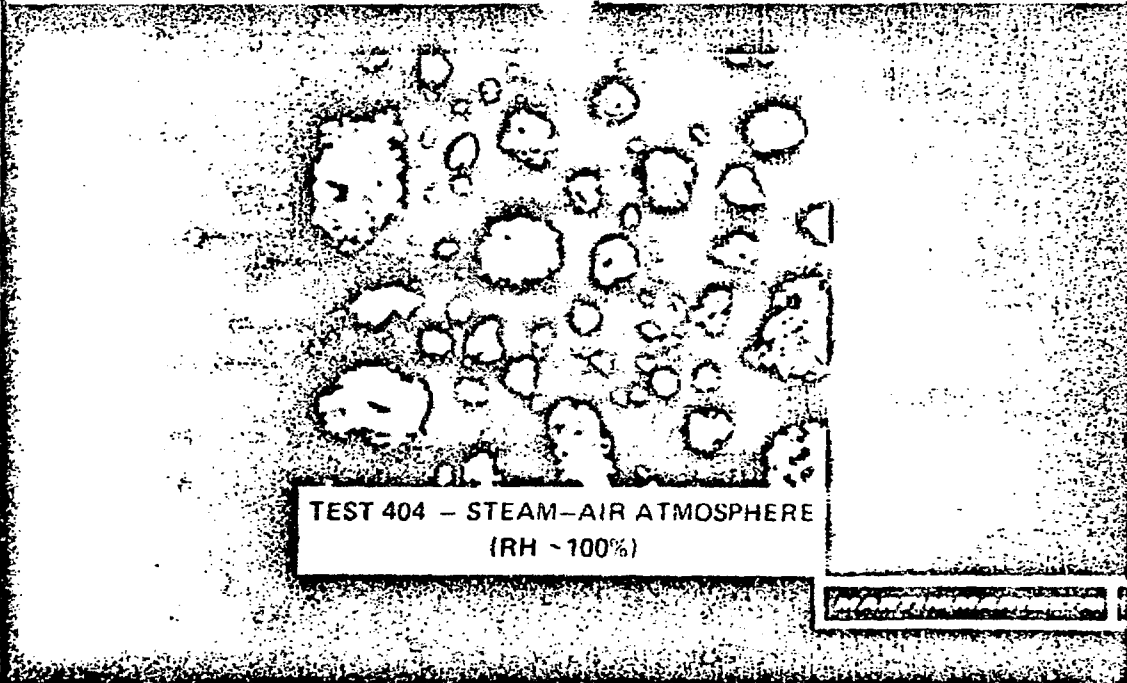

**TEST 404 - STEAM-AIR ATMOSPHERE
(RH ~100%)**

Fig. 5

INFLUENCE OF STEAM ON BEHAVIOR OF CONCRETE AEROSOLS IN NSPP VESSEL


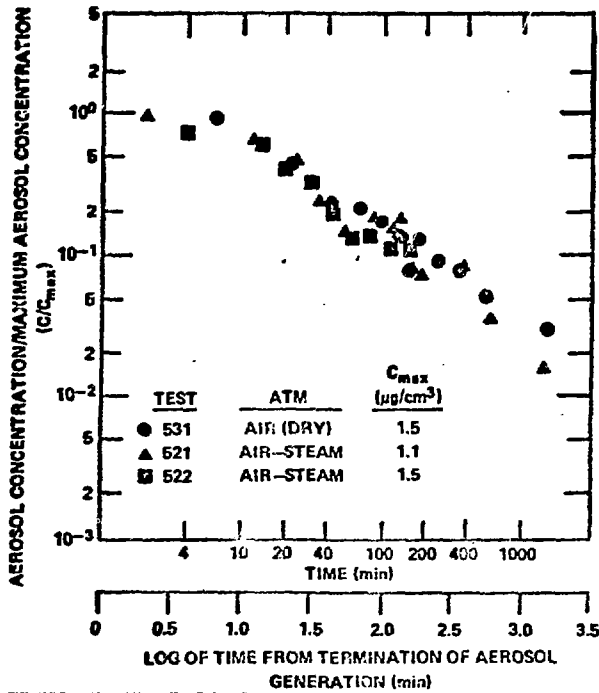


Fig. 6

STEAM INFLUENCES PHYSICAL SHAPE OF CONCRETE AEROSOL AGGLOMERATES



TEST 531 - DRY ATMOSPHERE
(RH < 20%)
6300X MAG.

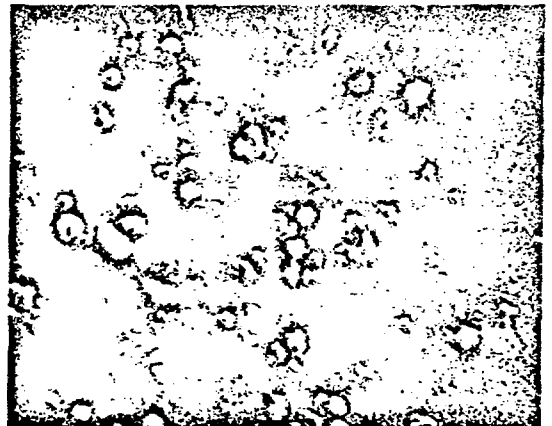

TEST 052 - STEAM-AIR ATMOSPHERE
(RH ~ 100%)
9000X MAG.

Fig. 7

COMPARISON OF BEHAVIOR OF MIXED AEROSOLS ($\text{Fe}_2\text{O}_3 + \text{U}_3\text{O}_8$) IN STEAM-AIR AND DRY AIR ENVIRONMENTS

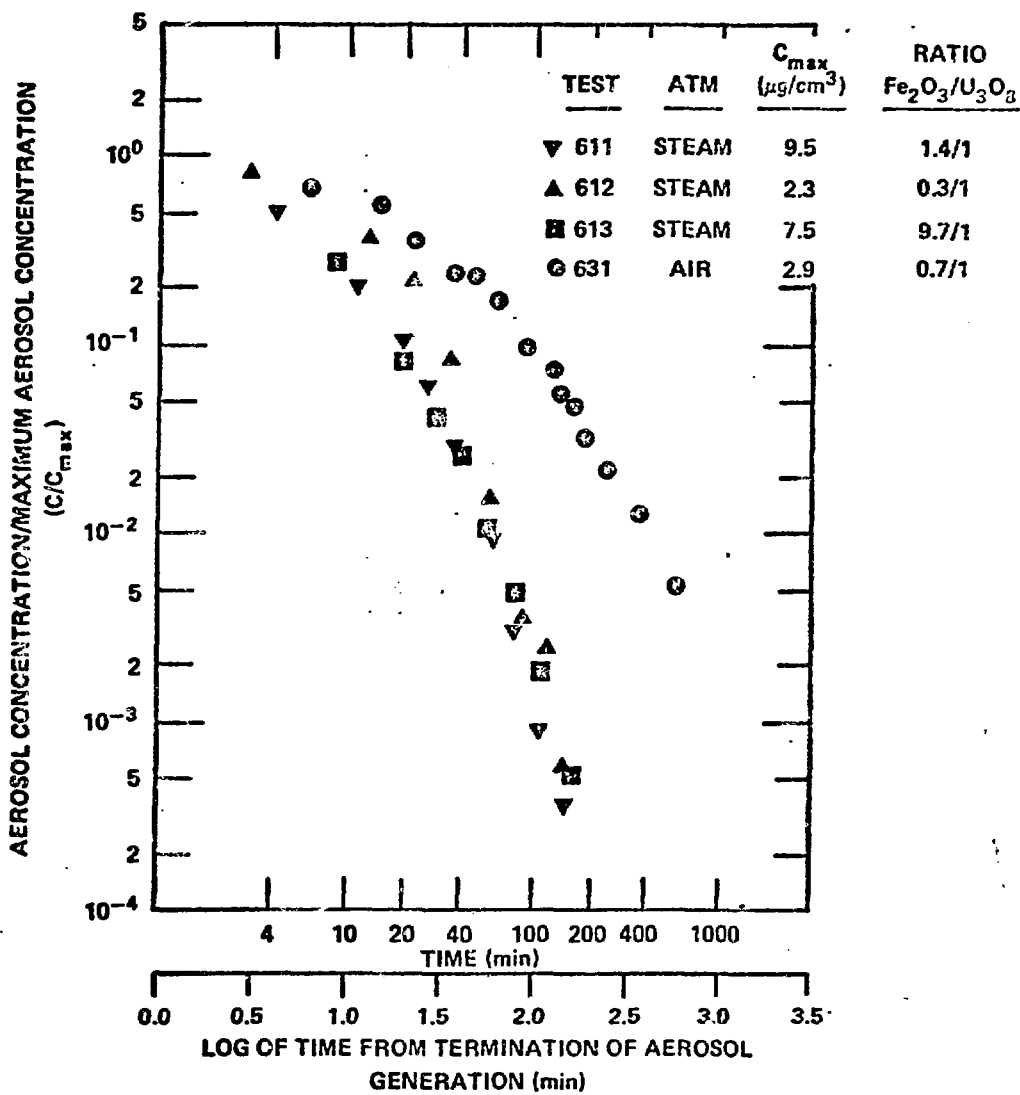


Fig. 8

COMPARISON OF THE BEHAVIOR OF A MIXED-AEROSOL WITH THAT OF INDIVIDUAL AEROSOLS IN A STEAM-AIR ENVIRONMENT

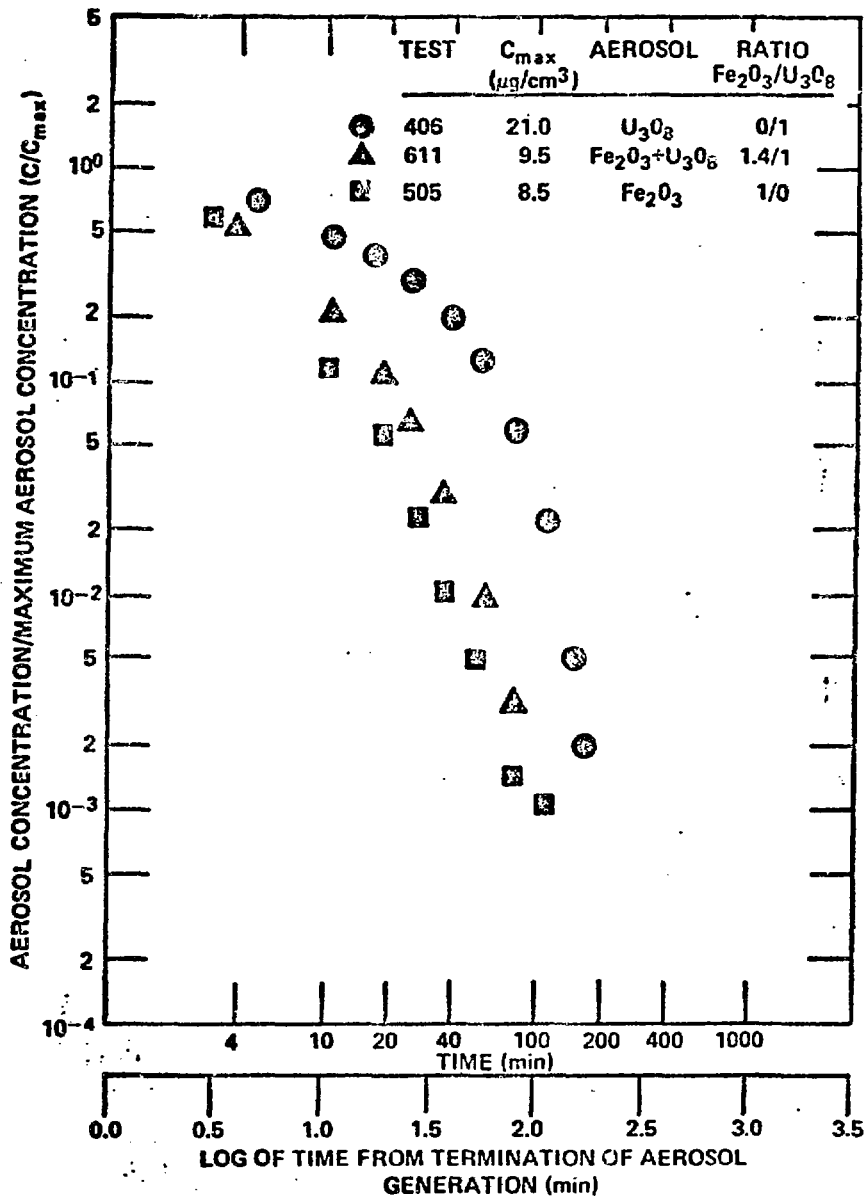


Fig. 9