

8
Conf. 901007--6

UCRL-JC-103816 Rev. 1
PREPRINT


MAR 11 1991

HYLIFE-II Inertial Confinement Fusion Reactor Design

Ralph W. Moir

This paper was being prepared for the
proceedings of the ANS Ninth Topical Meeting on the
Technology of Fusion Energy to be published
in Fusion Technology
Oak Brook, Illinois
October 7-11, 1990

December 14, 1990

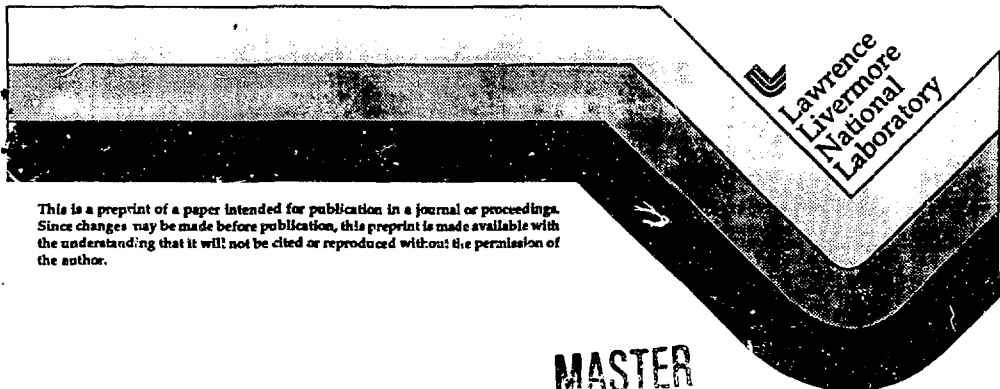

This is a preprint of a paper intended for publication in a journal or proceedings. Since changes may be made before publication, this preprint is made available with the understanding that it will not be cited or reproduced without the permission of the author.

MASTER

DISTRIBUTION OF THIS DOCUMENT IS UNLIMITED

DISCLAIMER

This document was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor the University of California nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial products, process, or service by trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or the University of California, and shall not be used for advertising or product endorsement purposes.

HYLIFE-II Inertial Confinement Fusion Reactor Design

Ralph W. Moir

University of California
Lawrence Livermore National Laboratory
P. O. Box 808
Livermore, California 94550

Abstract

The HYLIFE-II inertial fusion power plant design study uses a liquid fall, in the form of jets to protect the first structural wall from neutron damage, x rays, and blast to provide a 30-y lifetime. HYLIFE-I used liquid lithium. HYLIFE II avoids the fire hazard of lithium by using a molten salt composed of fluorine, lithium, and beryllium (Li_2BeF_6) called Flibe. Access for heavy-ion beams is provided. Calculations for assumed heavy-ion beam performance show a nominal gain of 70 at 5 MJ producing 350 MJ, about 5.2 times less yield than the 1.8 GJ from a driver energy of 4.5 MJ with gain of 400 for HYLIFE-I. The nominal 1 CWe of power can be maintained by increasing the repetition rate by a factor of about 5.2, from 1.5 to 8 Hz. A higher repetition rate requires faster re-establishment of the jets after a shot, which can be accomplished in part by decreasing the jet fall height and increasing the jet flow velocity. Multiple chambers may be required. In addition, although not considered for HYLIFE-I, there is undoubtedly liquid splash that must be forcibly cleared because gravity is too slow, especially at high repetition rates. Splash removal can be accomplished by either pulsed or oscillating jet flows. The cost of electricity is estimated to be 0.09 \$/kW-h in constant 1988 dollars, about twice that of future coal and light water reactor nuclear power. The driver beam cost is about one-half the total cost.

Introduction

The HYLIFE-I design (Blink et al., 1985) in which a molten salt composed of fluorine, lithium, and beryllium (Flibe) is substituted for liquid lithium is called HYLIFE-II (Moir et al., 1990). It will work with minor modifications of the HYLIFE-I design (e.g., beam access) if targets having a yield of 1.8 GJ (a gain of 400 with a 4.5-MJ driver) can be obtained, as assumed in HYLIFE-I. Splash clearing, however, was never satisfactorily accomplished in HYLIFE-I. High gain (400) results from advanced targets and is beyond the state-of-the-art. Conventional targets are predicted to have gains of 70 at 5 MJ with projected beam parameters giving a yield of only 350 MJ. Such low yields (350 MJ) rather than 2000 MJ) push the design to high repetition rates to obtain either the same power or higher driver energy and result in major departures from the HYLIFE-I design. Because, for any target design, the gain increases with driver energy, a larger yield can be obtained with higher driver energy, but drivers are expensive and the cost increases as the driver energy increases. The cost of electricity is expected to decrease as the repetition rate increases and eventually to rise again when pumping power

becomes large. We find this rise is above 10 Hz. We looked at three ways to obtain a higher repetition rate: use three chambers, pulse the flow, and use oscillating nozzles.

Flibe Compared to Liquid Lithium

The lithium fire hazard in HYLIFE-I will be eliminated by using the low-viscosity molten salt, Flibe (Li_2BeF_6). Flibe can operate compatibly with Hastelloy N or 316-stainless steel at a much higher temperature than lithium (923 K vs 770 K). The heat-transfer properties, while different, should remove heat and serve the purpose of a liquid protecting the permanent structure from neutron damage and blast. Because it is not a single element like lithium, dissociation may slow condensation and limit the repetition rate. There is also a potential corrosion problem from fluorine compounds formed during the evaporation process.

Plant Parameters

The plant parameters for the base case using pulsed flow (Hoffman, 1991) are shown in Table 1. The power balance diagram is Fig. 1. System studies are underway to vary the driver energy, thus changing the repetition rate. The driver cost should drop as repetition rate increases, if the gain does not drop too fast with the increasing repetition rate. We have shown the cost of electricity falls rapidly as the repetition rate increases from 1.5 Hz to about 4 Hz. There is some further cost decrease as the repetition rate increases from 4 Hz up to our

Table 1. Plant Parameters

Driver energy	5 MJ
Target gain	70
Yield	350 MJ
Blanket multiplication	1.15
Repetition rate	8.2 Hz
Fusion power	2835 MW
Thermal power	3312 MW
Recirculating power	282 MWe
Pumping power	37 MWe
Beam electrical power	203 MWe
Auxiliary power	42 MWe
Net electrical power	1863 MWe

design point of 8 Hz. The 8 Hz repetition rate was chosen somewhat arbitrarily and future analysis on condensation, chemical recombination, splash clearing, and many other

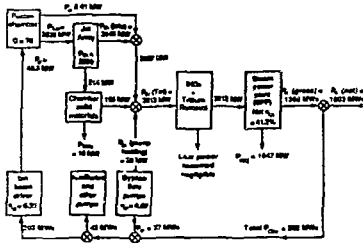


Fig. 1. Detailed power balance for the base case HY LIFE-II.

technical features might change the repetition rate. A key concern is the Filibe flow rate (Table 2). The Filibe flow rate needed to reestablish the liquid wall is much larger than that needed to remove heat. We have reduced the flow rate from the 96 m³/s of HY LIFE-I to 66 m³/s and the liquid inventory from 1600 m³ to 750 m³. However, the density of Filibe is four times that of lithium and we should try for further reductions. By decreasing the radius to the first wall from 0.5 m to 0.3 m and decreasing the flow speed, the flow rates and inventories might be further reduced, thereby lowering the costs.

Table 2. Jet Array and Primary Loop Parameters.

No. of chambers	1	
Fall distance between shots (m)	2.1	
Repetition rate (Hz)	8.1	
Injection velocity, V_0 (m/s)	16.2	
Static head required to produce V_0 (m)	13.4	
Vol. flow rates (m ³ /s):		
Jet array (bypass flow)	53.6	
Spray (max.)	9.7	
First wall	2.6	
Total Flow	65.9	
No. of pumps (rated flow per pump = 5 m ³ /s):		
Bypass flow	11	
HX flow	3	
Method used to produce V_0		
head	Static	Press.
Bypass pumping power (MW _e): (for $\eta_p = 80\%$)	.37	.37
Bypass pump head		
Gravity head above pool (m)	19.8	10.4
Friction + minor losses (m)	2.5	16.2
Total pump head (m)	22.3	27.1
Bypass pipes: inner diameter (m)	1.0	1.0
Estimated total Filibe inventory (m ³)	960	750

Target

The target is designed for heavy ions such as $^{200}\text{Hg}^{+}$ at 10 GeV. The gain depends on energy delivered to the target, beam radius (2 mm), and ion range (0.1 g/cm²). Target gain curves for a zero-degree beam half angle are shown in Fig. 2a (Bangert, 1988). We assume 30% of the energy, 5 MJ for example, is delivered on a long "foot" pulse of about 30 ns and 70% is delivered in the main pulse lasting about 8 ns. If the beam half angle is $\pm 10^\circ$ then the gain is reduced by 16% (Fig. 2b) (Moir et al., 1990). To obtain a yield of 350 Mj will require about 6 MJ input energy (as can be worked out from Fig. 2 for a range of 0.1 mg/cm² and 2 mm focal spot size). The correction for beam angles leading to the 6 MJ driver were not incorporated in the rest of this work. The design work did not consider the target factory, target injection, and tracking.

Driver Interface Issues

The driver is assumed to be a heavy-ion beam, although we also considered laser and compact-torus drivers. Because energy in a single beam is limited, 12 separate beams are assumed to provide the nominal 5 MJ total energy. These can be directed from two sides of the reactor or from only one side. The difficulty is to get a close-packed array with enough shielding. The beams are shown in Fig. 3. A heavy-ion driver at 5 MJ, based on $^{200}\text{Hg}^{+}$ at 10 GeV, costs in the range of \$1 B to

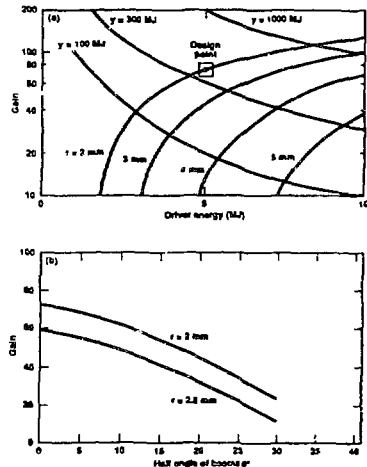


Fig. 2. Target gain vs. driver energy and beam half-angle. The beam spot size r and range R are given as parameters. The design point is 5 MJ, gain 70, range 0.1 g/cm², and spot radius 2 mm. The beam angle of about $\pm 10^\circ$ has yet to be put into the analysis.

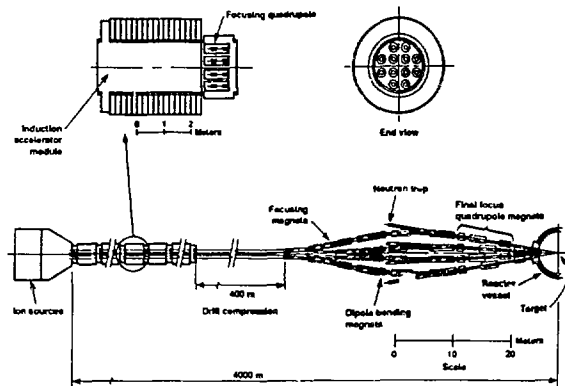


Fig. 3. As an example we show a one-sided configuration of HYLIFE-II with 12 beams using heavy-induction linear accelerators. The length is approximately 4 km for charge +3 or three times longer for Charge +1. The final beam focusing magnets (last 50 m) are in a very preliminary design stage. The half-angle encompassing all beams is $\pm 10^\circ$ for this array.

\$2 B (10^9 \$), a factor of 3 or more too high for good economics. Other drivers, such as a recirculating induction accelerator with fewer components are possible. Another possibility is the mirrortron, which has as a goal to shorten the heavy-ion beam lines by obtaining an order of magnitude higher energy gradient than is possible with induction accelerators (400 m long vs 4000 m). Compact tori that are accelerated and focused require a much different target and transport system design and are interesting because of their order-of-magnitude lower cost (about \$100 M). However, they are speculative because the experimental parameters of compact torus accelerators are orders of magnitude away from that needed. Laser drivers have been considered but are not leading candidates at this time because of high cost, low efficiency, and poor target performance as well as the need to illuminate the target from many angles. Our back-up strategy to cut the driver's contribution to the cost of electricity is to either have one driver switched to up to four reactors, each of 1-GWe size, as done in the HIBALL-II study (Badger, 1984) or to increase the power out of the reactor chamber up to 4 GWe. The cost and complication of switching is probably acceptable when the total power is as high as 4 GWe, but is not acceptable at 1 GWe.

Chamber Mechanical Design

A liquid fall is used to protect the first structural wall from neutron and blast damage. The liquid breaks up as a result of sudden neutron heating and the wall must be strong enough to contain the flying liquid (Chen and Schrock, 1991a; and Chen and Schrock, 1991b).

Steady Flow with Multiple Chambers

The HYLIFE-I chamber shown in Fig. 4 is a steady-flow chamber. The structural wall is protected by weir flow. This requires slow flow (10 m/s) and a long fall distance (about 5 m)

to protect the nozzle parts from neutron damage by the curvature of the flow over the weir. The repetition rate is low (1.5 Hz) because of the long reformation time of the jet array. Splash is only partially cleared by gravity. The large distance above the target (over 8 m) would not be cleared.

To obtain enough power in HYLIFE-II, we considered using up to three 2.7-Hz chambers (1/3 GWe each). This system would have the complication of switching beams, high pumping power, high cost for a 1-GWe power plant, and still not be cleared of splash. The three-chamber design option was so undesirable it was dropped from further consideration.

Pulsed Flow

The pulsed flow case shown in Fig. 5 uses continuous flow everywhere except for a slug of liquid 0.3 m in radius and about 1 m long, injected at 12 to 16 m/s for 6 to 8 Hz. The high repetition rate is achieved by a short fall distance of only 2 m. A pulsed pump to inject the slug needs to be designed and developed to withstand cyclic fatigue. The slug will clear splash from the beam path near the target. It is vital that the trailing edge of the liquid slug be sharply cut off and not leave too many splash droplets in the beam path. Other pulsed jets may be needed to clear splash from the rest of the beam path. One issue that requires solution is the isochoric neutron heating of the top of one slug that reduces its velocity and diminishes the volume for the next shot (thereby possibly limiting the repetition rate to 4 Hz). The downward momentum of the liquid slug is large compared to the upward impulse produced by the microexplosion. Many issues need further thought.

Oscillating Flow

Another way to achieve a high repetition rate and short fall distance with splash clearing is to oscillate the jet nozzles horizontally, as shown in Fig. 6 (Petzoldt, 1991). A

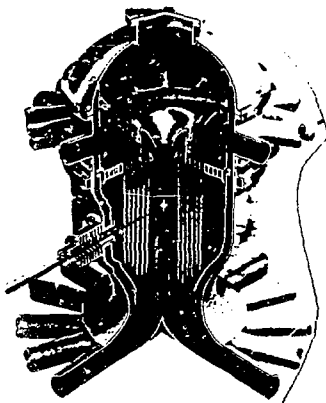


Fig. 4. HYLIFE-I used steady flow.

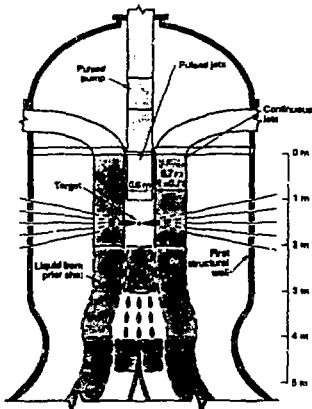


Fig. 5. HYLIFE-II, pulsed flow. The flow speed for 8 Hz is 16 m/s with a 2-m fall height, giving a flow rate of 34 m³/s.

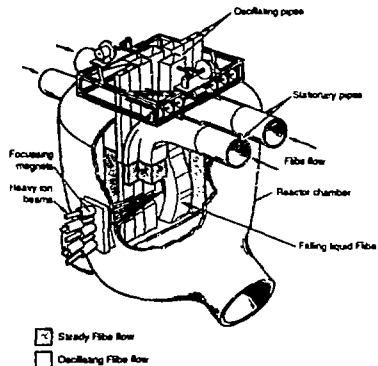


Fig. 6. HYLIFE-II, oscillating flow.

pocket is formed in the flow where a target is injected and the microexplosion occurs. The oscillating flow sweeps splash liquid from the target region. The beam path can be cleared with more oscillating flows or with pulsed flows of liquid. It will be necessary to design mechanical moving parts, including bellows, to allow nozzles to oscillate at up to 8 Hz through a motion of up to ± 0.1 m. Fatigue and vibration will be design problems. We have not yet chosen between oscillating flow and pulsed flow for our reference design.

Jet Design, Clearing, and Condensation

Steady horizontal and vertical, nonionically thick, liquid jets shown in Fig. 7 will clear the beam path and protect the beam ports from radiation damage. For gravity clearing of the beam paths, the spacing between these jets should be less than S ($S = 0.5 \text{ g}^2$), where S is the distance liquid droplets or splash can fall by gravity between shots. For 8 Hz, $S = 7.7 \text{ cm}$. If splash starts with an upward velocity, the distance S must be cut by up to a factor of two. With this system, splash is not cleared from all regions of the beam path and further work is needed.

The energy from the 350 MJ microexplosion will evaporate about 6.8 kg of liquid Fibre. The density of the vapor cloud when it has filled the chamber is about 10^{18} /cm^3 , assuming 6.8 kg at 5000 K in a 3-m-high chamber with 3-m radius. By the time of the next shot (0.125 s for 8 Hz) the density must drop from 10^{18} /cm^3 to about $3 \times 10^{15} \text{ /cm}^3$ in 0.125 s for propagation of heavy ions, a factor of 3×10^4 . This density reduction can come about by condensation of the vapor on the liquid jets and on the droplets left from the explosion (Bai and Schrock, 1991). One strategy is to inject "cool" Fibre at 873 K in a spray of droplets in the vicinity of the beam paths. According to our calculations, this injected spray can provide enough condensation area without depending on the explosion itself making enough small droplets of the liquid in the chamber. Our present model indicates the temperature in the cloud drops quickly ($< 1 \text{ ms}$) to 5000 K. Below 5000 K,

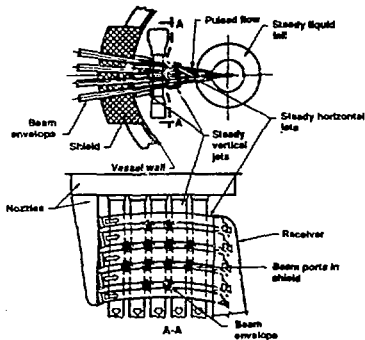


Fig. 7. Thick horizontal and vertical liquid jets protect the beam ports from radiation and help clear splash liquid for the next shot.

radiation is slow and conduction and convection bring the temperature to about 1500 K when the liquid surface and cloud temperature are equal, after about 1 ms. After this time, condensation proceeds at the rate heat can be transported from the liquid surface into the cool liquid interior. Although we predict condensation will be fast enough to allow an 8-Hz repetition rate, we recommend a definitive experiment on condensation with Filbe because of the complication of condensation of Filbe dissociation products, etc.

Neutronics

Neutronics analyses of the HYLIFE-II reactor concept (Tobin, 1991) includes calculating the tritium breeding ratio (TBR), the system energy multiplication factor (SEMF), the energy deposition in the Filbe and first structural wall (FSW), and the radiation damage rates for displacements per atom (dpa) and helium production. The TBR is 1.17, 1.02 of which is bred in the Filbe fall and 0.15 is bred in the reflector behind the FSW. Nearly 15% of the tritium is bred in ⁷Li. The SEMF is 1.15, bringing the 2835 MW of fusion power to 3260 MW_e.

Three candidate wall materials were considered for the FSW, two Hastelloys and a modified 316-stainless steel where manganese is substituted for nickel. There is a problem with corrosion of manganese so this option probably will be dropped in favor of unmodified 316-stainless steel. Results show that the 316-stainless steel is a superior choice for helium-generation-limited lifetime, dpa-limited lifetime, and shallow burial index. The areas where the Hastelloy steels are superior include decay thermal power, corrosion resistance, and high-temperature strength. However, the magnitude is insufficient to cause the steel to melt. The main safety issues for HYLIFE-II are the large shallow burial index (106) and the requirement to contain 99.9964% of the ¹⁹F inventory to prevent its release to the public. Although fluorine is very chemically

active, in the form of Filbe it is well tied up and not volatile. Therefore special nuclear certification as in the ASME (so-called N-stamp) is not needed.

Tritium Systems

Practically all of the tritium gas emitted by exploding targets will be removed by the vacuum pumping system, but almost none of the tritium bred in the Filbe will diffuse out of the Filbe droplets (Longhurst, 1991). At a fusion power of 2835 MWth with a breeding ratio of 1.17, the tritium production rate in the Filbe is 1.16×10^{24} atoms/s. The corresponding radioactivity production rate is 4.8 MCi/d, of which most will be recycled in new targets. The fraction of tritium removed from Filbe by the primary loop vacuum disengager (wherein a fine spray of Filbe droplets permits tritium to diffuse out and be pumped) is about 99%. The fraction of tritium leaking through the intermediate heat exchanger (IHx) per pass of the coolant through the IHx is 6.5%, according to detailed calculations of mass transfer during turbulent flow in the IHx. The fraction of tritium removed from the NaBF₄ intermediate coolant by the gas exchanger is greater than 99%. Because data on tritium behavior in NaBF₄ are lacking, the fraction of tritium leaking from the NaBF₄ through the steam generator tubes is conservatively assumed to be about 1%. For these conditions, the tritium leak rate is held to less than 40 Ci/d, which satisfies the safety goal for routine releases.

The tritium removal system could be very large because the intermediate coolant flow rate is very large. The blast chamber and Filbe piping should be double-walled, to prevent significant tritium leakage under normal and off-normal conditions. Beryllium metal will be used to neutralize free fluorine liberated in the Filbe by nuclear reactions. The greatest need for future work is to design the vacuum disengager and gas exchanger to quantify the size, power dissipation, and cost associated with achieving 99% efficiencies.

Materials and Molten Salt Technology

Compatibility and Corrosion

We chose a high-nickel steel for our vessel material and pipes. A 316-stainless steel will work with adequately low corrosion rates, and modified Hastelloy N (a high-nickel steel) will work even better. In the future we might consider the use of carbon-carbon composites for the vessel material because graphite is compatible with the molten salt if tritium retention is not too serious. Pyrolytic graphite has low retention but porous forms of graphite have higher retention. The use of a graphite vessel will reduce activation, increase tritium breeding, and reduce the heat leak to the shield.

Chemical Kinetics of Dissociated Filbe

We know that when Filbe is dissociated into its constituents by the microexplosion about 9 kg of Filbe is raised to 5000 K. (Recent investigations not folded into this work suggest this temperature may be as much as ten times higher.) These constituents will reform Filbe and not other species. That is, Filbe is stable under radiation and the recombination reaction is strong; however, based on preliminary study, we believe that the recombination is sufficiently fast not to be a limiting factor in the condensation of Filbe vapor on liquid droplet surfaces. An issue with condensation is that the constituents of Filbe must chemically recombine and stick on striking the droplet surfaces. Too low a sticking ratio will slow condensation. We think LF will have a sticking coefficient of at least 0.5. We are concerned that the BeF₂ may bounce off

liquid surfaces many times before sticking and joining the bulk liquid (sticking coefficient may be 0.01 to 0.05). If the small sticking coefficient is not limiting, we have shown all other processes are fast enough to permit a repetition rate as high as 8 Hz. This is an area for further study and a definitive experiment is needed.

Choice of Target Material

We chose tantalum for use in the target because it is relatively high Z ($Z = 73$) and is soluble in Flibe. We can make coatings by chemical vapor or liquid deposition. Many other high-Z materials we could have chosen, such as lead and tungsten, would precipitate on the walls of the vessel and pipes, making recovery difficult and causing other problems.

Balance of Plant

The power flow diagram is shown in Fig. 1. The components emphasizing the balance-of-plant (BOP) (Hoffman, 1991) are shown in Fig. 8. We have shown the eutectic composition of Flibe that melts at 636 K (363 °C) is practical but costly because of its high viscosity therefore the low-viscosity composition that melts at 733 K (460 °C) was chosen. Our use of molten salt relies heavily on early work at ORNL on the molten salt reactor (Rosenthal et al. 1972). The intermediate coolant NaBF₄ was chosen (Briggs, 1971) in part because of its tendency to hold up tritium in the form of T₂O and retard its passing on into the steam system and hence to the environment.

Safety and Environment

An outstanding feature of the HYLIFE-II reactor is its favorable safety characteristics (Dolan and Longhurst, 1991). Safety and environmental goals for HYLIFE-II include:

- offsite dose from severe accident less than 2 Sv (200 rem) for passive safety,
- no N-stamp requirement for most components, requires less than 0.25 Sv (25 rem) offsite dose,
- working area dose rate less than 50 nSv/h (5 mrem/h) for a low occupational risk,
- dose from routine atmospheric effluents less than 50 μ Sv/y (5 mrem/y).

To evaluate the potential to meet these goals, the consequences of a severe accident involving blast chamber

failure and breach of containment are studied, including the effects of activation products, tritium, and beryllium toxicity. HYLIFE-II has no large sources of energy available to disperse radioactive materials. The tritium inventory in the Flibe could be kept very low (about 1 g). The dominant activation product is about 300 MCi of ¹⁰F (half-life 110 m). A very small fraction ($\approx 10^{-4}$) of the Flibe activation products would be mobilized, because the microexplosion vaporizes about 9 kg from the 1500 t of Flibe. Only a fraction of the mobilized vapor would escape from a hole in the blast chamber, and only a fraction of that, from a hole in the containment building. The ¹⁰F offsite dose from a severe accident breaching both the blast chamber and the containment would be less than 0.2 mSv (20 mrem). Thus, N-stamp requirements can be avoided in the main reactor components, and the passive safety goal can be met.

If the maximum vulnerable tritium inventory in the target factory and tritium handling systems were less than 2.5 kg, then the maximum offsite dose from its release would be less than 0.25 Sv (25 rem), and the N-stamp requirement could be avoided for those systems as well. A same content maintenance should be feasible on the NaBF₄ secondary loop, but not on the Flibe primary loop (unless a very effective impurity removal system were operating and activated impurities did not plate out on pipe walls). Activation of metallic impurities in the Flibe from a NaBF₄ secondary coolant leak from corrosion products, from target materials, or from a Mo/C corrosion inhibitor (if used) could result in high dose rates. The occupational risk goal can be met if personnel do not work in the primary coolant loop area. The routine effluent goal is met provided the tritium removal systems in the primary and intermediate coolant loops are made large enough. After 30 y of operation with a 50-cm-thick Flibe jet curtain, the dose rate from the blast chamber (made of high nickel steel such as Hastelloy or stainless steel) would be too high for shallow and burial.

Economic Analysis and Systems Issues

The Safire economics and systems analysis code was used to study some trends in HYLIFE-II (Bieri, 1991). Some but not all of the algorithms in Safire were changed to model the chamber and IHX using Flibe instead of lithium, therefore the trends are only suggestive. A series of curves plotted against repetition rate show the important features (Fig. 9). As the repetition rate drops, the yield per shot goes up dramatically to maintain power. To get a higher yield, the driver energy must go up, which adds dramatically to the total plant cost, especially as repetition rate drops. The electrical power to the driver is practically independent of repetition rate above a few Hertz for our base case gain curve. The driver power is about 100 MWe. As the repetition rate increases the pumping power increases, but not enough to compensate for the falling driver cost, thus the cost of electricity is a falling function of repetition rate. The repetition rate of 1.5 Hz of HYLIFE-I has a cost 60% higher than at 8 Hz. HYLIFE-I was optimized for targets that were then thought to have much higher gain.

The cost breakdown is given in Table 3 for a case with a 5-MJ driver operating at a 7.5 Hz repetition rate. This code result is somewhat different from the 8.1 Hz of the rest of the study. The cost of electricity is about 0.27 \$/kW-h for current dollars or 0.09 \$/kW-h for noninflation constant 1988 dollars. If the driver direct cost were to drop by a factor of 4, from \$1300 M to \$325 M, the cost of electricity would drop by 40% (to 0.055 \$/kW-h), which is close to that of future coal and high-water-reactivity (LWR) nuclear power costs of 0.04 to 0.05 \$/kW-h.

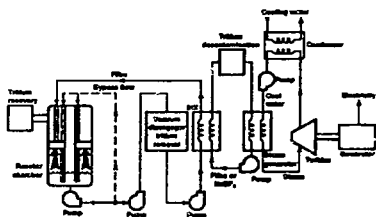


Fig. 8. The reaction chamber and power conversion system for HYLIFE-II.

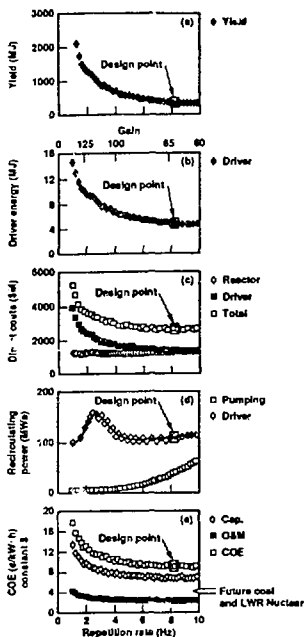


Fig. 9. (a) Yield vs repetition rate. (b) Driver energy vs repetition rate. The gain is given as well. (c) Direct capital cost vs repetition rate. (d) Recirculating power vs repetition rate. The driver power differs from that of the rest of the paper by a factor of 2 because the injection efficiency used in Fig. 1 was 20% and about 35% was used in Safire. (e) Cost of electricity vs repetition rate. Note that this cost is close for the design point of the 9.6 e/kWe-h in the paper by Hoffman, 1991.

Summary and Conclusions

In the design known as HYLIFE-II, we have substituted Fibre for lithium and modified the HYLIFE-I design to obtain repetition rates up to 8 Hz. We examined pulsed and oscillating flow concepts to obtain this high repetition rate and to remove splash liquid from the beam lines before the next shot. Condensation is predicted to reduce the Fibre vapor to low enough values to permit an 8-Hz repetition rate. The fire hazard has been eliminated and safety requirements met (but not shallow burial upon decommissioning).

Table 3. Plant Cost Breakdown

Acct.	Item	Cost (million \$)	
20	Land and land rights	5.0	
21	Structures and improvements	280.2	
22	Reactor plant equipment	551.4	
	Tracking, align systems	30.4	
	First wall systems	1.6	
	Tritium extraction systems	4.6	
	Blanket and shield	32.5	
	Heat transport system	80.4	
	149.5		
23	Turbine plant equipment	229.8	
24	Electric plant equipment	90.9	
25	Miscellaneous plant equipment	59.5	
26	Main heat rejection equipment	41.1	
27	Drive equipment	1397.3	
28	Target factory equipment	128.8	
	Total direct cost	7783.9	
91	Construction services	556.8	
92	Home office engineering and services	417.6	
93	Field office engineering and services	278.4	
94	Owner's cost	194.9	
95	Project contingency	423.2	
	Total overnight cost	4654.7	
		Current \$	Constant \$
		1996	1988
96	Escalation during construction	1502.2	0.0
97	Interest during construction	1955.1	434.8
	Total capital cost	8112.0	5089.5
	Cost of electricity (¢/kWh)		
	Capital	21.12	6.79
	Fuel	0.03	0.01
	O&M	6.97	2.24
	Total	28.11	9.04

At present, the design and performance of the system depend on many assumptions that must be verified by future analysis and experiment before we can have a high level of confidence in the predicted performance. Some of the key issues include verifying splash removal techniques, tritium removal effectiveness and permeation rates, condensation phenomena and sticking coefficients, heavy-ion accelerator technology and cost reduction, and beam propagation. To be competitive with future coal and LWR nuclear power, the cost of electricity needs to be reduced by a factor of 2.

Acknowledgements

We thank many people on the ICF program staff at the Lawrence Livermore National Laboratory for advice throughout this study. This work was performed under the auspices of the U. S. Department of Energy by Lawrence Livermore National Laboratory under Contract W-7405-Eng-48.

References

- Bai, R. Y., and Schrock, V. E. (1991), "An Approximate Method for Analyzing Transient Condensation on Spray in

- HYLIFE-II," to be published in *Proc. Ninth ANS Topical Meeting on the Tech. of Fusion Energy, Fusion Tech.*, May.
- Badger, B. et al. (1984), *HIBALL-II—An Improved Conceptual Heavy Ion Beam Driven Fusion Reactor Study*, Univ of Wisconsin Report, Kfk-3840, FPA-84-4, UWFD-625.
- Bangerter, R. C. (1988), "Targets for Heavy-Ion Fusion," *Fusion Tech.*, 13, 349.
- Bieri, R. L. (1991), "Parametric Studies for a HYLIFE-II Electric Power Plant," to be published in *Proc. Ninth ANS Topical Meeting on the Tech. of Fusion Energy, Fusion Tech.*, May.
- Blink, J. A., Hogan, W. J., Hovingh, J., Meier, W. R., and Pitts, J. H. (1985), *The High-Yield Lithium-Injection Fusion Energy (HYLIFE-II) Reactor*, Lawrence Livermore National Laboratory, Livermore, Calif., UCID-53559.
- Briggs, R. B. (Winter 1971-1972), "Tritium in Molten-Salt Reactors," *Reactor Tech.*, 14, 335.
- Chen, X. M., and Schrock, V. E. (1991a), "A Note on the Pressure Field Within an Outward Moving Free Annulus," to be published in *Proc. Ninth ANS Topical Meeting on the Tech. of Fusion Energy, Fusion Tech.*, May.
- Chen, X. M., and Schrock, V. E. (1991b), "The Pressure Relaxation of Liquid Jets After Isochoric Heating," to be published in *Proc. Ninth ANS Topical Meeting on the Tech. of Fusion Energy, Fusion Tech.*, May.
- Dolan, T. J., and Longhurst, G. R. (1991), "Safety and Environmental Aspects of HYLIFE-II," to be published in *Proc. Ninth ANS Topical Meeting on the Tech. of Fusion Energy, Fusion Tech.*, May.
- Hoffman, M. A. (1991), "The Heat Transport System and Plant Design for the HYLIFE-II Fusion Reactor," to be published in *Fusion Technology*.
- Longhurst, G. R. (1991), "Estimating Tritium Losses Through HYLIFE-II Heat Exchangers," to be published in *Proc. Ninth ANS Topical Meeting on the Tech. of Fusion Energy, Fusion Tech.*, May.
- Moir, R. W., Adamson, M. G., Bangerter, F. O., Bieri, R. L., Condit, R. H., Hartman, C. W., Langdon, A. B., Logan, B. G., Orth, C. D., Petzoldt, R. W., Pitts, J. H., Post, R. F., Sacks, R. A., Tobin, M. T., Dolan, T. J., Longhurst, G. R., Hoffman, M. A., Schrock, V. E., Bai, R. Y., Chen, X. M., Liu, J., Sze, D.-K., Meier, W. R. (1990), *HYLIFE-II Progress Report*, Lawrence Livermore National Laboratory, Livermore, Calif., UCID-21814.
- Petzoldt, R. W. (1991), "Oscillating Liquid Flow in ICF Reactors," to be published in *Proc. Ninth ANS Topical Meeting on the Tech. of Fusion Energy, Fusion Tech.*, May.
- Rosenthal, M. W., Haubenreich, P. N., and Briggs, R. B. (1972), *The Development Status of Molten-Salt Breeder Reactors*, Oak Ridge National Laboratory, Oak Ridge, Tenn., ORNL-4812.
- Tobin, M. T. (1991), "Neutronic analysis for HYLIFE-II," to be published in *Proc. Ninth ANS Topical Meeting on the Tech. of Fusion Energy, Fusion Tech.*, May.