

## Research on Multi - Resonant LCL Harmonic Suppression Strategy

Jingwen Chen, Xin Zhou and Hongshe Dang\*

School of electrical and information engineering

Shaanxi University of Science and Technology

Shaanxi 710021, China

\*Address correspondence to this author at xuefu Road,

Xi'an, China, 710021;

e-mail: 2452744621@qq.com

**Abstract**—Aiming at the resonance problem in the process of grid connection of LCL filter microgrid inverter, a multi-resonance LCL harmonic suppression strategy is proposed. On the basis of analyzing the principle and establishing the mathematical model in detail, the realization process of the multi-resonance constant power compound control strategy is studied emphatically. Through the simulation, the validity of the control strategy is verified, The results show that the scheme stabilizes the output power and reduces the total harmonic distortion of the grid-connected inverter to 0.12%, and the corresponding phase current distortion rate drops to 0.02%.The suppression effect is obvious, it is an effective harmonic suppression method.

**Keywords**-Microgrid Inverter;Harmonic;Multi Resonance Control;Constant Power Control

### I. INTRODUCTION

With the depletion of traditional energy sources, the new energy power generation system with microgrid as the carrier has been developed rapidly because of its flexible, decentralized, small, close to users and the use of clean energy. Due to the energy structure of the micro grid mainly clean energy such as wind power, photovoltaic power generation, the distributed energy will generally need electricity to the grid through power electronic converter device to realize grid connected. Therefore, a lot of power electronic devices access to power grid harmonics, caused the converter power factor lower and parallel resonant circuit or series resonance, decrease active reactive power

measurement accuracy, reduce the quality of power supply a series of problems, give the user the safe and security, economic operation of power system brings great harm. so harmonic suppression is very important.

Current research of harmonic suppression methods, mainly has: the harmonic suppression method based on active filter [1] [2] [3]; the micro-grid harmonic suppression based on virtual impedance [4]; LCL type Grid-connected inverter harmonic suppression [5] [6] [7] [8] and so on. Compared to L-filter, LCL-type filter has a third-order low-pass filter characteristics,( LCL filter with third order low pass filter properties), so for the same harmonic standard and lower switching frequency, we can use a relatively small filter inductor design, effectively reduce the system size(volume) and reduce losses, but the same will bring resonance problems. In this paper, a harmonic control strategy of micro-grid inverter based on PI control, multi-resonance control and LCL constant power control is proposed, which is used in the process of grid-connected control of micro-grid inverter to further reduce and net voltage of the total harmonic distortion rate, get better power of the grid.

### II. MATERIAL AND METHODS

#### A. Principle block diagram of multi resonance LCL harmonic suppression strategy

Figure 1 is LCL multi-resonant constant power grid control system block diagram. Where  $P_{ref}$   $Q_{ref}$  are the

actual active and reactive power reference values,  $v_{abc}$  ,  
 $i_{abc}$  are the actual values of the grid voltage and current,  $v_d$  ,  
 $v_q$  and  $i_d$  ,  $i_q$  are the voltage components of the dq axis,  
 $i_{dref}$  and  $i_{qref}$  are the capacitor current reference Value,  
 $i_{cd}$  ,  $i_{cq}$  ,  $i_{cdref}$  ,  $i_{cqref}$  are the capacitance current  
 detection value on the dq axis components and capacitance  
 current reference value.

The figure includes PQ control module, current loop  
 multi-resonance control module, and PWM modulation  
 module etc. Micro-network inverter grid output voltage  
 $v_{abc}$  and current detection values  $i_{oabc}$  ,after  $\alpha\beta$  coordinate  
 transformation to get  $v_\alpha$  ,  $v_\beta$  and  $i_\alpha$  ,  $i_\beta$  ,will be sent to the  
 PQ controller; PQ controller according the active and  
 reactive setpoint  $P_{ref}$  and  $Q_{ref}$  to calculate the current  
 reference values  $i_{\alpha ref}$  and  $i_{\beta ref}$  and then compare with the  
 current detection value of the  $\alpha\beta$  components  $i_\alpha$  and  $i_\beta$  .  
 And after the ratio multi-resonant regulator  $G_2(S)$  in the  
 current loop control module, the reference values  $i_{c\alpha ref}$  ,  
 $i_{c\beta ref}$  of the capacitive current are obtained, then compared  
 with the capacitance current detection value  $\alpha\beta$  component  
 $i_{c\alpha}$  and  $i_{c\beta}$  . And then adjusted by the proportional regulator  
 $G_1(S)$  , the control PWM circuit drives the inverter, so that  
 the inverter output active power and reactive power constant.  
 In order to meet the requirements of system stability, the  
 current loop control module in Figure 1 solves the resonance  
 problem caused by LCL, and achieves the purpose of  
 suppressing low frequency harmonics and improves the  
 system accuracy.

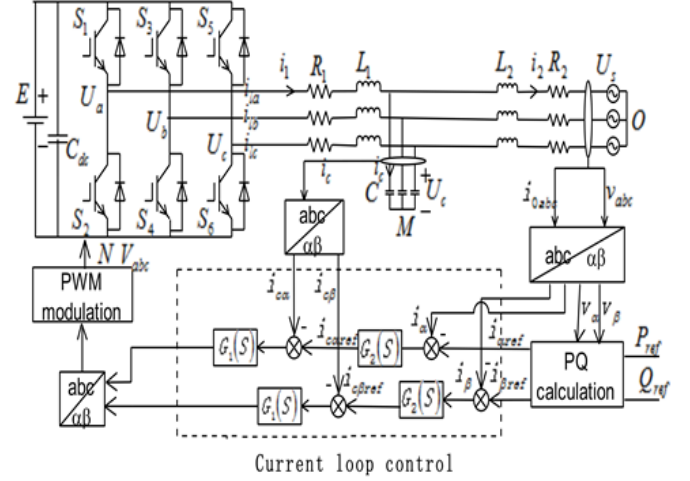


Figure 1. Principle block diagram of multi resonance LCL harmonic  
 suppression strategy

### B. Multi - resonant LCL Grid - connected Control Mathematical Model

Figure 1 constitutes a third-order LCL-type filter, where  
 $L_1$  is the inductance,  $R_1$  is its internal resistance and the  
 equivalent resistance between the upper and lower legs of  
 each phase,  $R_2$  is the internal resistance of  $L_2$  . In the case  
 of three-phase grid voltage symmetry, the mathematical  
 model is as follows:

$$\begin{aligned}
 &L_1 \frac{di_1(t)}{dt} + R_1 i_1(t) + L_2 \frac{di_2(t)}{dt} + R_2 i_2(t) \\
 &= U_{dc}(t) S_k(t) + U_{NO} - U_s(t)
 \end{aligned} \quad (1)$$

$$C \frac{du_c(t)}{dt} = i_1(t) - i_2(t) \quad (2)$$

$$i_{dc}(t) = C_{dc} \frac{du_{dc}(t)}{dt} + \sum_{k=a,b,c} i_k(t) S_k(t) \quad (3)$$

$$U_{NO}(t) = -\frac{u_{dc}(t)}{3} \sum_{k=a,b,c} S_k(t) \quad (4)$$

Where  $S_k$  is the switching function of the power switching device, when  $S_k = 0$ , the upper arm is turned on and the lower arm is turned off; When  $S_k = 1$ , the upper arm off, the lower arm conduction. Corresponding to the relationship between  $\alpha$  and  $\beta$  stationary coordinate system is as follows:

$$\begin{aligned}
 L_1 \frac{di_{1\alpha}}{dt} &= u_\alpha - u_{c\alpha} - R_1 i_{1\alpha} \\
 L_1 \frac{di_{1\beta}}{dt} &= u_\beta - u_{c\beta} - R_1 i_{1\beta} \\
 L_2 \frac{di_{2\alpha}}{dt} &= u_{c\alpha} - e_\alpha - R_2 i_{2\alpha} \\
 L_2 \frac{di_{2\beta}}{dt} &= u_{c\beta} - e_\beta - R_2 i_{2\beta} \\
 i_{c\alpha} &= i_{1\alpha} - i_{2\alpha} \\
 i_{c\beta} &= i_{1\beta} - i_{2\beta}
 \end{aligned} \tag{5}$$

$i_{1\alpha}$ 、 $i_{1\beta}$ 、 $i_{2\alpha}$ 、 $i_{2\beta}$  are the  $\alpha$  and  $\beta$  components of the input and output currents in the  $\alpha\beta$  coordinate system;  $i_{c\alpha}$ 、 $i_{c\beta}$ 、 $u_{c\alpha}$ 、 $u_{c\beta}$  are the  $\alpha$  and  $\beta$  components of the capacitive current and voltage in the  $\alpha\beta$  coordinate system;  $e_\alpha$  and  $e_\beta$  are the  $\alpha$  and  $\beta$  components of the grid voltage in the  $\alpha\beta$  coordinate system.

C. A block diagram of current loop control

LCL-type filter in the better suppression of high-frequency harmonics at the same time, because of its own structure for a third-order system, easy to produce resonance, the frequency near the narrow band and too high gain, will lead to the system and the load Parameter changes are very sensitive, affecting the stability of the system to bring a series of impact and harm to the grid. In order to reduce its sensitivity and high gain characteristics, to achieve the AC signal without static tracking, this paper on the basis

of the use of active damping introduced into the capacitor current loop regulation to suppress high frequency interference, and the external loop current using proportional resonance control, Constructs a transfer function that performs AC compensation on the reference input signal. So that in a specific bandwidth in the same frequency response characteristics, to meet the system stability requirements, so that the output at the resonant frequency at high gain, the other frequency segment attenuation. Thus reducing the resonance, improve the stability of the system and control accuracy.

The control block diagram is shows as follows:

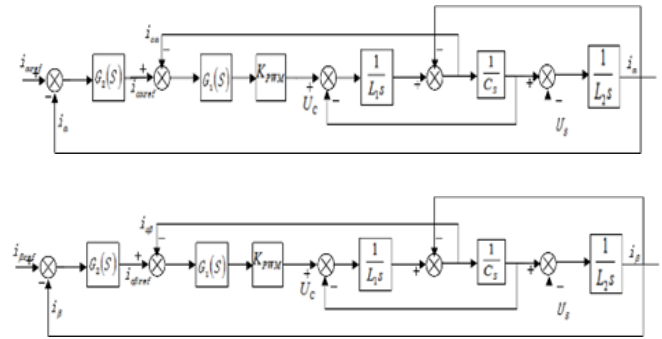


Figure 2. Block diagram of current loop control

As shown in Figure 2 where  $G_2(S)$  selected proportional resonance regulator,  $G_1(S)$  selected proportional regulator. After the current is transformed by the coordinate, the voltage and current  $v_\alpha$ 、 $v_\beta$  and  $i_\alpha$ 、 $i_\beta$  in the two stationary coordinates are obtained and sent to the PQ calculation module to obtain the reference current  $i_{\alpha ref}$ 、 $i_{\beta ref}$ , and then compared with  $i_\alpha$  and  $i_\beta$  obtained the deviation by the proportion multi-resonant regulator  $G_1(S)$  in the current loop control module, get the capacitor current reference value  $i_{c\alpha ref}$  and  $i_{c\beta ref}$ . And it is compared with the capacitance current detection value  $\alpha\beta$  component  $i_{c\alpha}$  and  $i_{c\beta}$ , after adjusting the proportional regulator  $G_2(S)$ , then control PWM circuit drives the inverter, so that the inverter output active power and reactive power constant.

D. PR control

Since the PR regulator is equivalent to the PI modulator in the stationary coordinate system under the  $\alpha\beta$  coordinate,

the PR regulator can also be used to design the PI regulator parameter. Figure 2 in the parallel current and reference current deviation, through the multi-resonant control get the capacitor current reference value  $i_{cref}$ ,  $i_{cref}$  and the actual capacitance of the current deviation, and then through the proportional control, the resulting signal through the PWM modulation to achieve active damping control. The use of a proportional feedback control of the capacitor current, stabilize the capacitor voltage, and enhance the stability of the system. The parallel current and capacitive current transfer functions are as follows:

$$G(S) = \frac{I_2(S)}{I_{ref}(s)} = \frac{KK_{PWM}K_\rho s + KK_{PWM}K_i}{L_1L_2Cs^4 + KK_{PWM}L_2Cs^3 + Ls^2 + KK_{PWM}s + KK_{PWM}K_i} \quad (6)$$

The corresponding characteristic equation is:

$$D(S) = L_1L_2Cs^4 + KK_{PWM}L_2Cs^3 + Ls^2 + KK_{PWM}s + KK_{PWM}K_i \quad (7)$$

According to the Rouse stability criterion, the system stability condition is calculated as:

$$K_\rho < 1 + L_2/L_1 \\ K_\rho(L - K_\rho L_1) - KK_{PWM}K_i L_2 C > 0 \quad (8)$$

According to the stability criterion (formula 9) to set the parameters, so that when the grid to reach a stable state.

### III. MULTIPLE PR CONTROL

A single PR regulator generates an infinite gain at a specific frequency. In order to ensure its stability and easy to achieve, using the approximate structure; its transfer function is as follows: The transfer function is as follows:

$$G_{PR} = K_P + \frac{2K_h w_c s}{s^2 + 2w_c s + w_h} \quad (9)$$

Where  $K_P$  is the scale factor,  $w_c$  is the frequency adjustment coefficient,  $K_h$  is the resonance coefficient, and  $w_h$  is the resonant frequency.

In order to achieve the 5,7,11 harmonic current compensation need to re-connect three resonant controller.

The transfer function of the current inner loop multi-resonance controller is:

$$G_{PR} = K_P + \sum_{i=5,7,11} \frac{2K_h w_c s}{s^2 + 2w_c s + w_h} \quad (10)$$

The minimum value of the resonant frequency in the LCL grid-connected inverter is:

$$f_r = \frac{1}{2\pi} \sqrt{\frac{L_1 + L_2}{L_1 L_2 C}} \quad (11)$$

Then the minimum value of K is:

$$K_{min} = \frac{2L_1}{(L_1 + L_2)E} \quad (12)$$

In order to ensure the stability of the control system, the cutoff frequency should be chosen to be less than  $f_r$  so the  $K_P$  in the multi-resonance PR control can be approximated by the cutoff frequency  $f_c$ :

$$K_P = \frac{4\pi f_c (L_1 + L_2)}{E} \quad (13)$$

According to the scope of K and the specific control requirements, through the control system open-loop baud diagram for parameter adjustment.

### IV. DISCUSSION

Based on the detailed analysis of the principle of multi-resonance constant power control, the simulation results of the mathematical model are as follows

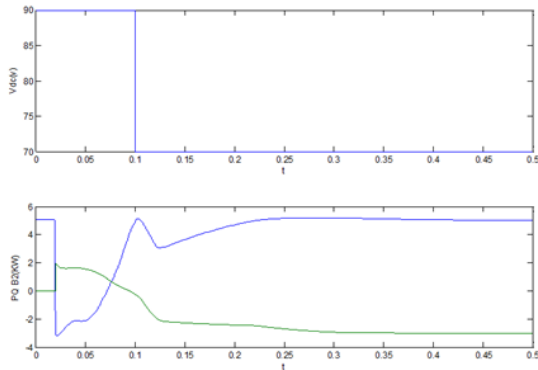


Figure 3. DC side voltage control after active, no power waveform

As shown above, the active and reactive power of the output after LCL multi-resonant constant power control is constant, which ensures the stable operation of the system.

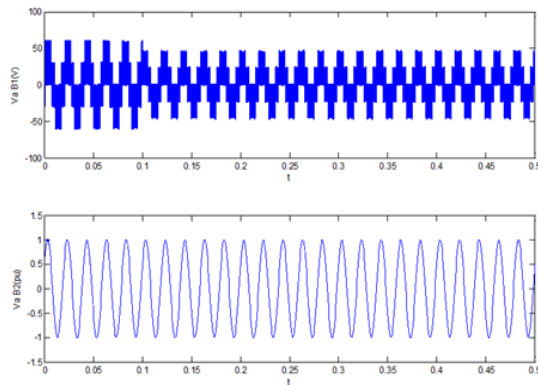


Figure 4. By LCL multi-resonant constant power control before and after the voltage waveform

From Fig. 4, we can find that the voltage and current waveforms before the LCL multi-resonant constant power control are unstable and distorted. After the control of the voltage and current waveform is improved, harmonic suppression effect is obvious.

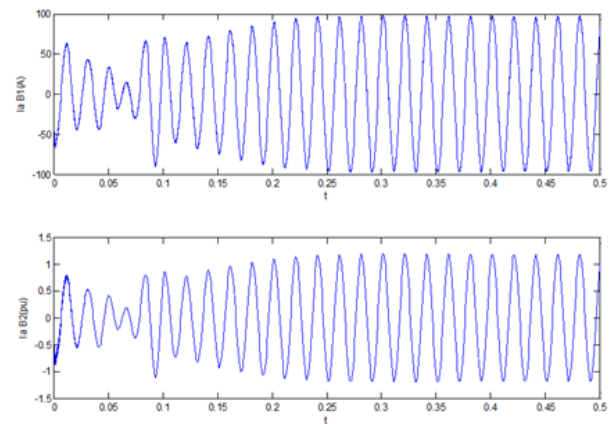


Figure 5. By LCL multi-resonant constant power control before and after the current waveform

From the above figure can be found by the LCL multi-resonant constant power control after the current waveform has improved.

In order to analyze the filtering effect by LCL multiresolution constant power control, the voltage distortion rate, the total voltage distortion rate and the current distortion rate of the respective voltage waveforms before and after the control are summarized as shown in Table 1 and 2 respectively.

TABLE I. LCL MULTI-RESONANT CONSTANT POWER GRID-CONNECTED CONTROL BEFORE AND AFTER THE VOLTAGE HARMONIC CONTENT

	Voltage distortion rate	current distortion rate
<b>Before filtering</b>	76.03%	15.23%
<b>After filtering</b>	0.12%	0.02%

TABLE II. LCL MULTI-RESONANT CONSTANT POWER CONTROL BEFORE AND AFTER THE VOLTAGE AND CURRENT DISTORTION

Number of harmonics	5	7	11
<b>Before filtering</b>	2.86%	0.93%	0.98%
<b>After filtering</b>	0.08%	0.04%	0.01%

From Table 1, it can be found that the contents of the harmonics before the filtering are reduced and have an inhibitory effect.

Table 2 can be seen by LCL multi-resonant constant power control filter before the voltage distortion rate of 76.03%, a phase current distortion rate of 15.23%, filtered voltage distortion rate reduced to 0.12%, the corresponding phase current distortion Small to 0.02 inhibitory effect is obvious.

#### V. CONCLUSION

In this paper, a harmonic suppression strategy for micro-grid inverter combined with LCL constant power control and multi-resonant PI control is proposed for the resonant problem of LCL filter microgrid inverters. It is found that the scheme stabilizes the output power LCL and reduces the total harmonic distortion rate of the grid inverter to 0.12% and the corresponding phase current distortion rate is reduced to 0.02%. The harmonic suppression effect is obvious.

#### REFERENCES

- [1] Shang taohong. Study and parameter design of shunt hybrid active power filter [J] proceedings of the computer science, 2012, 29 (11): 327-330.
  - [2] Li Yan, Luo an, Fang Lu, Wang Wen. High voltage type hybrid active power filter [J]. Journal of electric technology, 2013, 28 (6): 147-157
  - [3] Wang Jidong, Qin Meicui. Micro grid harmonic suppression method [J]. Journal of Tianjin University APF based on the (Science and Technology Edition), 2015, 48 (7): 637-642
  - [4] Li Li. Study on hierarchical control and power quality improvement of microgrid [D]. Beijing: North China Electric Power University, 2015
  - [5] Han Yongru, Xue Shilong, and Study on the control strategy of grid connected inverter based on LCL filter [J]. Shanghai: Maritime University, 2015, 1 (103-109): (in Chinese)
  - [6] Huang Yafeng, Li Long, Yan Gangui large capacity PV inverter LCL filter parameter optimization design [J]. Beijing: North China Electric Power University, 2013, 41 (21): 104-110
  - [7] Zhang Xing, Li Fei, and in the grid connected inverter LCL filter improved topology [J]. Hefei: HeFei University of Technology, 2014,6:10-17
  - [8] Xu Jinming, Xie Shaojun, L L filter grid connected inverter robust current control [J]. Nanjing: Nanjing University of Aeronautics and Astronautics, 2012,36 (19): 99-104
  - [9] Yang Kun, Xie Chuan, Chen Guozhu. Current control of static reactive power generator based on frequency adaptive resonance controller [J]. Journal of electrical engineering, 2014, 29 (8): 249-254.
  - [10] Zhang Zhicheng, Liu Zhenlai, Guan Huchang. Island micro grid harmonic control method of [J]. power electronic technology, 2015, 49 (12): 135-13
- Chen Jingwen (1978-), male (Han nationality), Inner Mongolia Chifeng people, associate professor, graduate tutor, research direction for micro-grid technology and application, E-mail: chenjw@sust.edu.cn
- Zhou Xin (1993-), female (Han), Xianyang, Shaanxi, Master, research direction for micro-grid harmonics, inter-harmonics of the study
- Dang hongshe(1962-), male (Han nationality), ShaanXiXianyang people, professor, research direction for micro-gridtechnology and application, (Corresponding author: E-mail: 2452744621@qq.com)