

Performance of SF₆ GIB under the influence of power frequency voltages

L.Rajasekhar Goud (Corresponding author)

EEE Department, G.Pulla Reddy Engineering College, Kurnool, India

E-mail: lrs_76@rediffmail.com

M.Uday Kumar, D.Subbarayudu

EEE Department, G.Pulla Reddy Engineering College, Kurnool, India

J.Amarnath

EEE Department, J.N.T.U Hyderabad, India

Abstract

A method based on particle motion is proposed to determine the particle trajectory in Gas Insulated Substation (GIS) or Gas Insulated Busduct (GIB). In order to determine the movement of a particle in a GIB, an inner electrode diameter of 40mm and outer enclosure diameter of 137mm was considered. Aluminium and copper wires of 0.25mm/10mm and 0.25mm/12mm were considered to be present on the enclosure surface. The motion of the wire (particle) was simulated using the charge acquired by the particles, the macroscopic field that the particle site, the drag coefficient, Reynold's number and coefficient of restitution. In order to determine the random behaviour of moving particles, the calculation of movement in axial and radial directions was done at every time step using rectangular random numbers. Typically for Aluminium wire for a bus duct voltage of 100 kV RMS, the movement of the particle (0.5mm / 8mm) for 2 Sec was computed to be 18.0337mm in radial and 424.4979mm in axial directions and the movement of the particle (0.25mm / 12mm) for 2 Sec was computed to be 22.4249mm in radial and 503.618mm in axial directions. Similar calculation is extended for a typical 200 kV (RMS) Gas Insulated Busduct.

Keywords: Monte-Carlo, Particle Contamination, Particle Movement, Horizontal Movement, Vertical Movement.

1. Introduction

The excellent dielectric properties of Sulphur Hexa fluoride (SF₆) have long been recognized of various high voltage applications. Compressed SF₆ gases have been used as an insulating medium as well as are quenching medium in electrical apparatus over a wide range of voltages. Due to high reliability of equipment, Gas Insulated Busduct (GIB) or Gas Insulated Substations (GIS) can be used for longer duration without any periodical inspections. Conducting contaminations could however, seriously reduce the dielectric strength of Gas Insulated system.

The present paper deals with the computer simulation of particle movement in GIB. The specific work reported deals with the charge acquired by the particle due to microscopic field at the location of the particle, the force exerted by the field on particle, the drag due to viscosity of the gas and random behavior during movement.

2. Modeling Technique

A typical horizontal bus duct comprising of inner conductor and outer enclosure, filled with SF₆ gas is considered for study. A particle (wire) is assumed to be at rest at the enclosure surface, until a voltage sufficient enough to lift the particle and move in the field is applied. After acquiring an appropriate charge in the field, the particle lifts and begins to move in the direction of the field overcoming the forces due to its

own weight and drag. The simulation considers several parameters e.g. the macroscopic field at the location of the particle, its weight, viscosity of the gas, Reynold's number, drag coefficient of restitution on its impact to enclosure. During return flight, a new charge on the particle is assigned based on the instantaneous electric field.

3. Theoretical Study

The primary goal of the simulations was to create an appropriate mathematical model of the particle motion in a GIS which will enable further simulations of the motion particles with arbitrary shapes. Several authors [1-7] have suggested solutions for the motion of sphere or a wire like metallic particle in a coaxial system with bare electrodes under AC voltage. The motion equation of a particle can be expressed

$$m \frac{d^2y}{dt^2} = F_e - mg - F_d \quad (I)$$

Where y is the direction of motion m is the mass of particle, F_e is the electric force and F_d is drag force, the direction of the drag force is always opposed to the direction of motion. For laminar flow the drag force component around the hemispherical ends of the particle is due to shock and skin friction [2-3].


4. Simulation of Particle motion

Computer simulations of the motion of metallic wire particles were carried out on GIB of 40mm inner diameter and 137mm outer diameter with 100KV RMS applied to inner conductor. A Software was developed in C language considering the above equations and was used for all simulation studies.

5. Simulation Results and Discussions

Fig.1.(a) shows the movement of aluminum particle in radial direction for an applied voltage of 100kV rms and length of the particle to be 12mm/8mm. The highest displacement in radial direction during its upward journey is simulated to be 22.4249mm/18.0337mm. As the applied voltage is increased the maximum radial movement also increases as given in table1. Fig.1.(b) shows the movement of copper particle was determined for 100 kV with similar parameters as above and was found to have a maximum movement of 4.8588mm/3.5191mm in radial direction. The movement of Cu particle for various voltages is also given in Table 1.

(a) Aluminum

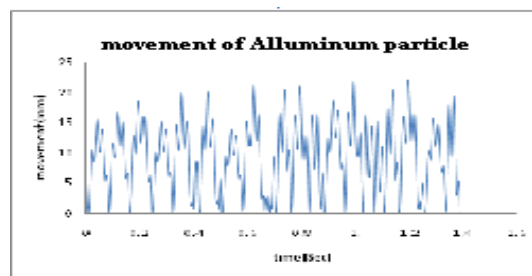

(b) Copper


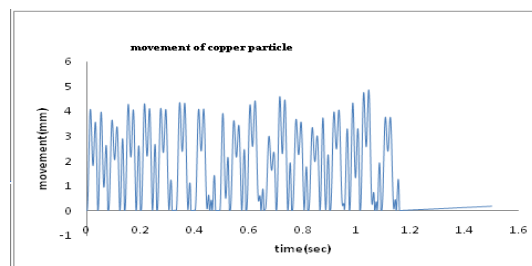


Fig.1 Movement of particle with 0.25 mm diameter and length 12 mm, voltage 100 kV

It is noticed that the movement of copper particle is far less than aluminum particle of identical size. This is expected due to higher weight of particle. The axial and radial movements of aluminum and copper particles are calculated using Monte-Carlo technique for three voltages viz 100kV, 145kV and 200 kV with solid angle of 1° . It is significant to note that for all the cases considered, there is no change in maximum radial movement, even when Monte-Carlo method is applied.

(a) Aluminum

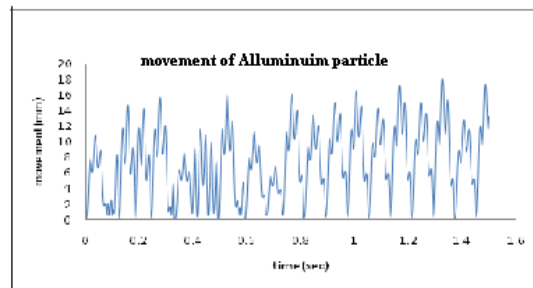

(b) Copper

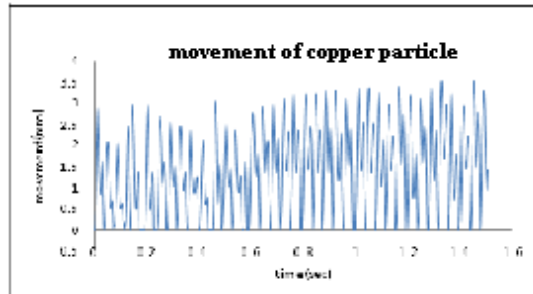


Fig.2 Movement of particle with 0.25 mm diameter and length 8 mm, voltage 100 kV

Table1: Axial and Radial Movement of Aluminum and Copper particles: simulation time: 2 Sec, length: 12mm

Voltage(kv)	type	Max radial movement(mm)	Montecarlo($\sigma=1^\circ$)	
			Axial(mm)	Radial(mm)
75	Cu	0	0	0
	Al	12.6434724	321.9089	12.6434
100	Cu	4.8588465	90.0969	4.8588
	Al	22.4252277	503.618	22.4249
145	Cu	13.5588784	169.0688	13.5588
	Al	36.0058479	925.8408	36.0057
200	Cu	17.9470618	16.5564	17.9463
	Al	57.7206982	506.7857	57.7204

Table2: Axial and Radial Movement of Aluminum and Copper particles: simulation time: 2 Sec, length: 8mm

Voltage(kv)	type	Max radial movement(mm)	Montecarlo($\sigma=1^\circ$)	
			Axial(mm)	Radial(mm)
75	cu	0	0	0
	Al	9.6583535	270.3076	9.658
100	Cu	3.5190949	91.1911	3.5191
	Al	18.0337695	424.4979	18.0337
145	Cu	10.718734	252.9008	10.7187
	Al	28.3301506	763.4532	28.3289
200	Cu	16.9603977	75.2338	16.9603
	Al	50.1567259	942.0275	50.155

6. Conclusions

A model has been formulated to simulate the movement of wire like particle in Gas Insulated Busduct (GIB). Monte- Carlo simulation is adopted to determine the axial as well as radial movements of particle in the bus duct. Distance traveled in the radial direction is found to be same with or without Monte- Carlo simulation.

Acknowledgements:

The authors are thankful to the management of G.PullaReddy Engineering College (autonomous), Kurnool,(AP) for providing facilities to do this work.

References

AH Cookson, et.al (1976), "Recent Research in the United States on the Effect of Particle Contamination Reducing the Breakdown Voltage in Compressed Gas-Insulated Systems"; *Int. Conf.*

on Large High Voltage Systems, Pairs.

H. Anis, KD Srivastava (1980), "Movement of charged Conducting Particles Under Impulse Voltages in Compressed Gases"; *IEEE Int. Conf. on Industrial Applications.*

MM Moreos, et.al (1983) "Dynamics of Metallic Contaminants in Compressed Gas Insulated Power Apparatus"; *IV ISH, Athens.*

H. Anis. KD Srivastava (1989) "Breakdown Characteristics of Dielectric Coated Electrodes in Sulphur Hexafluoride Gas with Particle Contamination"; *VI ISH, New Orleans, LA, USA.*

H. Anis, KD Srivastava (1981) "Free Conducting Particles in Compressed Gas Insulation"; *IEEE Trans. On Electrical Insulation, Vol EI-16, pp. 327-338.*

M.E. Holmberg, et.al. (1995), "Identification of Metallic Particle in GIS by Statistical Analysis and Acoustical Measurements and Computer Simulations", *9th International Symposium on High Voltage Engineering Graz, Austria.*

M.E. Holmberg, S.S.Gubanski (1997), "Discharges from Moving Particles in GIS" *IEEE PES Summer Meeting Berlin, Germany.*

L.RajasekharGoud, J.Amarnath and D.Subbarayudu, "simulation of particle motion in a Gas insulated Bus duct", Published in Engineering Today monthly Journal, Chennai (India) in October 2006, Pages21-22

L.RajasekharGoud, J.Amarnath, et.al, "Monte-carlo simulation of particle Movement in 1-phase and 3-phase Gas insulated Bus duct" -Published at international conference on "condition Monitoring and diagnosis 2006" (CMD2006) chang wond, Korea, April 2-5,2006.

L.RajasekharGoud, D.Subbarayudu, J.Amarnath, "metallic particle motion in a single phase gas insulated bus duct under the influence of power frequency voltages" published in the international journal of Electronic and Electrical Engg (ISSN-0974-2174 volume 3, Number 1,(2010) pp,33-42.

This academic article was published by The International Institute for Science, Technology and Education (IISTE). The IISTE is a pioneer in the Open Access Publishing service based in the U.S. and Europe. The aim of the institute is Accelerating Global Knowledge Sharing.

More information about the publisher can be found in the IISTE's homepage:

<http://www.iiste.org>

The IISTE is currently hosting more than 30 peer-reviewed academic journals and collaborating with academic institutions around the world. **Prospective authors of IISTE journals can find the submission instruction on the following page:**

<http://www.iiste.org/Journals/>

The IISTE editorial team promises to review and publish all the qualified submissions in a fast manner. All the journals articles are available online to the readers all over the world without financial, legal, or technical barriers other than those inseparable from gaining access to the internet itself. Printed version of the journals is also available upon request of readers and authors.

IISTE Knowledge Sharing Partners

EBSCO, Index Copernicus, Ulrich's Periodicals Directory, JournalTOCS, PKP Open Archives Harvester, Bielefeld Academic Search Engine, Elektronische Zeitschriftenbibliothek EZB, Open J-Gate, OCLC WorldCat, Universe Digital Library, NewJour, Google Scholar

