

## A Reliability Model on an APFC System with Three Stages of Working with Respect to Variation in Power Factor

Rekha<sup>1</sup> Shilpi\*<sup>2</sup> Gulshan Taneja<sup>3</sup>

Department of Mathematics, M.D.University, Rohtak, Haryana, India  
rekhaarnav@gmail.com; batrashilpi1989@gmail.com; drgtaneja@gmail.com

### Abstract

The present paper deals with the reliability and profit analysis of an automatic power factor controller (APFC) system with three stages of working with respect to variation in power factor. Power factor may vary and result into three categories: controlled, partially controlled and uncontrolled power factor. Due to poor power factor system, many industries have to face many problems like electric loads, energy loads and fuse replacement like. So, there is need to accurate/ appropriate these problems. Study of APFC system, therefore, is of great importance. In the present study, the system is initially operative with controlled factor, then it may transit to the mode where the power factor is partially controlled and vice versa. Also, from the partially controlled power factor mode, the system may transit to a mode of uncontrolled power factor and vice versa. If the system fails, there is need to detect the type of failure by inspection. The type of failure may be 'Fuse blown off' or 'Transformer burnt' or 'Programme problem' or 'output relay faulty'. After repair/replacement on failure, the system goes back to the same controlling mode as was existing at the time of failure. Various measures of system effectiveness have been obtained by making use of regenerative point technique. Graphs have been plotted to draw interesting conclusions related to the revenue per unit up time, loss per unit time during which the power factor remains uncontrolled/partially controlled.

**Keywords:-** Automatic Power Factor Control (APFC) System, Controlled/Partial Controlled/Uncontrolled Power factor, Measures of System effectiveness, Regenerative point technique.

### Introduction

In this present era, the main objective of the industries is the optimization of available resources to obtain the maximum profit. Reliability modeling can be of great use for fulfilling this objective. A large number of researchers including [1-6] have widely studied the concept the Reliability for one or more units systems considering variety of situations. Bhatia et al [4] discussed the probabilistic analysis of an automatic power factor controller (APFC). Some typical examples of such modern systems include transformers, fluorescent lighting. AC induction motors. Are/induction furnaces etc, which draw not only active power (KW) from the supply but also inductive reactive power (KV Ar). Also, apparent power (KVA) is combination of active and reactive power. Power factor is the ratio of active power to apparent power. The low power factor is highly undesirable as it causes an increase in current, resulting in additional losses of active power in all the element of power system. The power factor should be as close to unity as possible which may otherwise lead to energy losses and big penalty.

Bhatia et al. [ ] discussed the model with variation in power factor considering two stages of working i.e. one with power factor controlled and the other with power factor uncontrolled. But, the situation may be there with three stages of working i.e. power factor controlled, power factor partial controlled, and power factor uncontrolled. Normally, if the power factor of APFC is  $\geq 0.9$  then the system is said to be working with power factor controlled whereas if it lies between 0.85-0.9, then the system is said to work with power factor partial controlled and if it is  $< 0.8$  then it is the stage of power factor uncontrolled.

Keeping the above three stages of working, we, in the present paper develop a reliability model on Automatic power factor controller (APFC) panel because the problem of power factor correction/ maintenance of electrical loads is a basic problem which is common to all industrial companies using the information collected by [4]. The system is initially operative with controlled factor, then it may transit to the mode where the power factor is partially controlled and vice versa. Also, from the partially controlled power factor mode, the system may transit to a mode of uncontrolled power factor and vice versa. If the system fails, there is need to detect the type of failure by inspection. The type of failure may be 'Fuse blown off' or 'Transformer burnt' or 'Programme problem' or 'output relay faulty'. After repair/replacement on failure, the system goes back to the same controlling mode as was existing at the time of failure.

The system is analyzed by making use of regenerative point techniques. Various measures of system effectiveness are obtained such as mean time to system failure (MTSF), availability when power factor is controlled, availability when power factor is partial controlled, availability when power factor is not controlled, busy period of type I repair, busy period of type II repair, busy period of type III repair, busy period of type IV repair, expected number of visits of the repairman, expected number of fuse replacement, expected number of transformer replacement. The profit incurred to the system is also evaluated and graphical study is also done.

Graphs have been plotted to draw interesting conclusions related to the revenue per unit up time, loss per unit time during which the power factor remains uncontrolled/partially controlled.

From the data/information gathered from an industry, used from [4] and assumed (near to actual one) if not provided by any source; the estimates of rates, costs and probabilities are obtains as :

- Estimated value of failure rate ( $\lambda$ ) = 0.001 per hour
- Estimated value of rate with which power factor changes from controlled mode to partial controlled mode ( $\beta_{11}$ ) = 0.015 per hours
- Estimated value of rate with power factor changes from partial controlled mode to controlled mode ( $\beta_{12}$ ) = 0.2
- Estimated value of rate with power factor changes from partial controlled mode to uncontrolled mode ( $\gamma_{11}$ ) = 0.005
- Estimated value of rate with power factor changes from uncontrolled mode to partial controlled mode ( $\gamma_{12}$ ) = 0.3
- Probability of failure of type I ( $p_1$ ) = 0.3
- Probability of failure of type II ( $p_2$ ) = 0.2
- Probability of failure of type III ( $p_3$ ) = 0.4
- Probability of failure of type IV ( $p_4$ ) = 0.1
- Expected cost of fuse replacement ( $C_1$ ) = 50 INR
- Expected cost of transformer replacement ( $C_2$ ) = 150 INR
- Expected cost of visit of repairman ( $C_3$ ) = 1000 INR

### Nomenclature

$\lambda$	Constant rate of failure
$\beta_{11}$	Rate with which power factor changes from controlled mode to partial controlled mode
$\beta_{12}$	Rate with which power factor changes from partial controlled mode to controlled mode
$\gamma_{11}$	Rate with which power factor changes from partial controlled mode to uncontrolled mode
$\gamma_{12}$	Rate with which power factor changes from uncontrolled mode to partial controlled mode
$f_1(t), I(t)$	p.d.f. and c.d.f. of inspection time
$p_1$	probability of failure of type I (Fuse blown off)
$p_2$	probability of failure of type II (Transform burnt)
$p_3$	probability of failure of type III (Programming Problem)
$p_4$	probability of failure of type IV (output relay faulty)
$f_1(t), F_1(t)$	p.d.f. and c.d.f. of failure of type I with controlled power factor
$f_2(t), F_2(t)$	p.d.f. and c.d.f. of failure of type II controlled power factor
$f_3(t), F_3(t)$	p.d.f. and c.d.f. of failure of type III controlled power factor
$f_4(t), F_4(t)$	p.d.f. and c.d.f. of failure of type IV controlled power factor Laplace convolution
$h_{12}(t), H_{12}(t)$	p.d.f. and c.d.f. of the time which includes repair of type I failure as well as conversion of power factor from uncontrolled mode.
$h_{22}(t), H_{22}(t)$	p.d.f. and c.d.f. of the time which includes repair of type II failure as well as conversion of power factor from uncontrolled mode.
$h_{32}(t), H_{32}(t)$	p.d.f. and c.d.f. of the time which includes repair of type III failure as well as conversion of power factor from uncontrolled mode.
$h_{42}(t), H_{42}(t)$	p.d.f. and c.d.f. of the time which includes repair of type IV failure as well as conversion of power factor from uncontrolled mode to controlled mode.
$g_{12}(t), G_{12}(t)$	p.d.f. and c.d.f. of the time which includes repair of type I failure as well as conversion of power factor from partial controlled mode.
$g_{22}(t), G_{22}(t)$	p.d.f. and c.d.f. of the time which includes repair of type II failure as well as conversion of power factor from partial controlled mode
$g_{32}(t), G_{32}(t)$	p.d.f. and c.d.f. of the time which includes repair of type III failure as well as conversion of power factor from partial controlled mode
$g_{42}(t), G_{42}(t)$	p.d.f. and c.d.f. of the time which includes repair of type IV failure as well as conversion of power factor from partial controlled mode
Op	the unit is operative
C	power factor controlled
$\bar{C}$	power factor partial controlled
$\bar{\bar{C}}$	power factor not controlled
F	unit is under inspection on failure

$F_{r1}$	the main unit is under repair in case of type I (fuse blown off)
$F_{r2}$	the main unit is under repair in case of type II (transformer burnt)
$F_{r3}$	the main unit is under repair in case of type III (programming problem)
$F_{r4}$	the main unit is under repair in case of type IV (output relay faulty)
$C_0$	revenue per unit up time
$C_{21}$	cost per unit up time for which the repairman is busy for repairing the unit having failure of type I
$C_{22}$	cost per unit time for which the repairman is busy for repairing the unit having failure of type II
$C_{23}$	cost per unit up time for which the repairman is busy for repairing the unit having failure of type III
$C_{24}$	cost per unit up time for which the repairman is busy for repairing the unit failure of type IV
$C_1$	cost per fuse replacement
$C_2$	cost per transformer replacement
$C_3$	cost per visit of the repairman
$L\bar{C}$	Loss per unit time when power factor is partial controlled
$\bar{L}C$	Loss per unit time when power factor is not controlled
$\bar{A}C_0$	Steady state availability – this is the probability that the system is in up state when power factor is not controlled
$A\bar{C}_0$	Steady state availability – this is the probability that the system is in up state when power factor is partial controlled
$BF_0$	probability that the repairman is busy for the repair of type-I failure at instant t; given that the system entered regenerative state i at t=0
$BT_0$	probability that the repairman is busy for the repair of type-II failure at instant t; given that the system entered regenerative state i at t=0
$BP_0$	probability that the repairman is busy for the repair of type-III failure at instant t; given that the system entered regenerative state i at t=0
$BO_0$	probability that the repairman is busy for the repair of type-IV failure at instant t; given that the system entered regenerative state i at t=0
$V_0$	expected number of visits of the repairman in (0,t]; given that the system entered regenerative state i at t=0
$FR_0$	expected number of fuse replacements at instant t; given that the system started from the regenerative state i at t=0
$TR_0$	expected number of transformer replacements; given that the system started from the regenerative state i at t=0

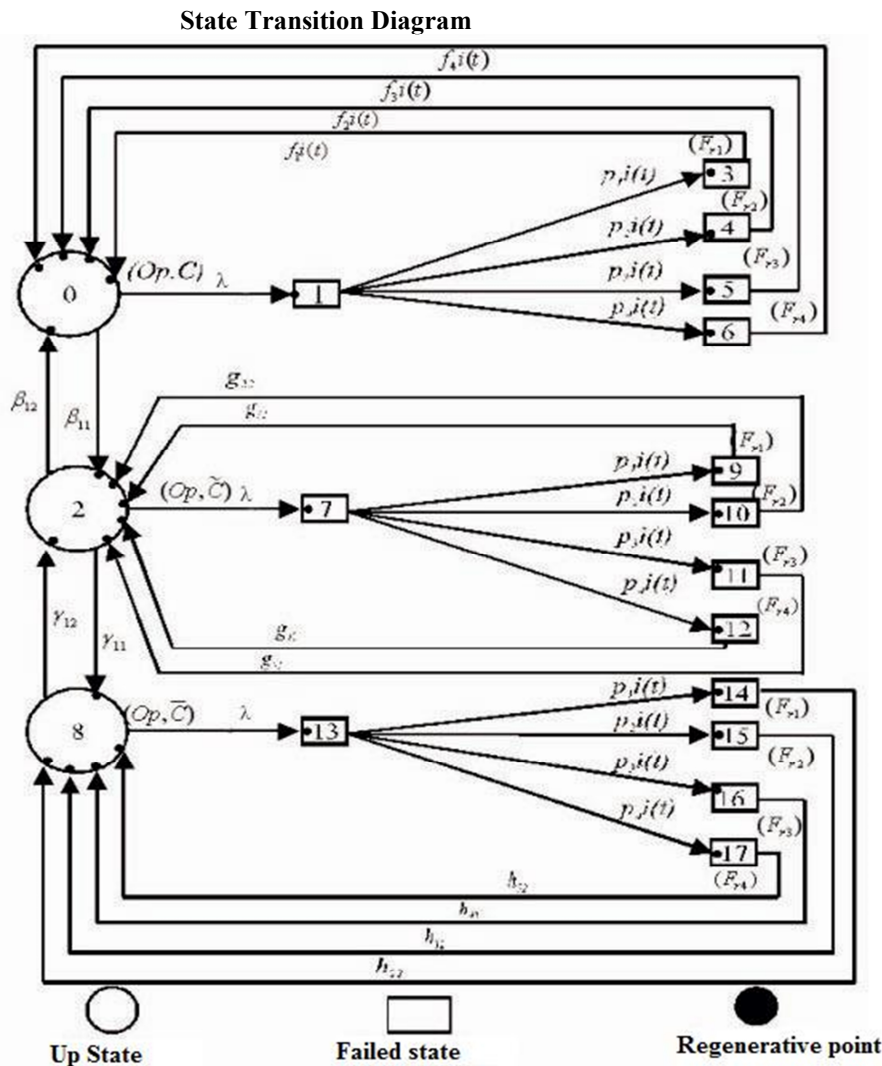


Fig. 1

**Model Description & Assumptions**

- Initially the system is operative with controlled power factor.
- Mode of Power factor may get changed from controlled to partial controlled, partially controlled to uncontrolled and vice-versa.
- Failure times are assumed to follow an exponential distribution, whereas the others follow arbitrary distributions.
- After repair, the system becomes as good as new.
- All the random variables area independent.

**Transition Probability and Mean Sojourn Time**

The transition diagram showing various states of transition of system are shown in Fig 1 the entry into the states 0,1,2,3,4,5,6,7,8,9,10,11,12,13,14,15,16&17 are regenerative state to regenerative state are given below:

$dQ_{0,1}(t) = \beta_{11} e^{-(\lambda+\beta_{11})t} dt$	$dQ_{02}(t) = \lambda e^{-(\lambda+\beta_{11})t} dt$
$dQ_{20}(t) = \beta_{12} e^{-(\lambda+\beta_{12}+\gamma_{11})t} dt$	$dQ_{27}(t) = \lambda e^{-(\lambda+\beta_{12}+\gamma_{11})t} dt$
$dQ_{28}(t) = \gamma_{11} e^{-(\lambda+\beta_{12}+\gamma_{11})t} dt$	$dQ_{82}(t) = \gamma_{12} e^{-(\lambda+\gamma_{12})t} dt$
$dQ_{8,13}(t) = \lambda e^{-(\lambda+\gamma_{12})t} dt$	$dQ_{30}(t) = f_1^{(t)} dt$
$dQ_{40}(t) = f_2^{(t)} dt$	$dQ_{50}(t) = f_3^{(t)} dt$
$dQ_{60}(t) = f_4^{(t)} dt$	$dQ_{92}(t) = g_{12}^{(t)} dt$
$dQ_{10,2}(t) = g_{22}^{(t)} dt$	$dQ_{11,2}(t) = g_{32}^{(t)} dt$
$dQ_{12,2}(t) = g_{42}^{(t)} dt$	$dQ_{14,8}(t) = h_{12}^{(t)} dt$
$dQ_{15,8}(t) = h_{22}^{(t)} dt$	$dQ_{16,8}(t) = h_{32}^{(t)} dt$
$dQ_{17,8}(t) = h_{42}^{(t)} dt$	$dQ_{13}^{(t)} = p_1 i(t) dt = dQ_{79}(t) = dQ_{13,14}(t)$

$$dQ_{14}^{(t)} = p_2 i(t) dt = dQ_{7,10}(t) = dQ_{13,15}(t) \quad dQ_{15}^{(t)} = p_3 i(t) dt = dQ_{7,11}(t) = dQ_{13,16}(t)$$

$$dQ_{16}^{(t)} = p_4 i(t) dt = dQ_{7,12}(t) = dQ_{13,17}(t)$$

The non zero element  $p_{ij}$  can be obtained by  $p_{ij} = \lim_{s \rightarrow 0} q_{ij}(s)$  such that

$$p_{01} + p_{02} = 1$$

$$p_{13} + p_{14} + p_{15} + p_{16} = 1$$

$$p_{20} + p_{27} + p_{28} = 1$$

$$p_{30} + p_{40} + p_{50} + p_{60} = 1$$

$$p_{92} + p_{10,2} + p_{11,2} + p_{12,2} = 1$$

$$p_{14,8} + p_{15,8} + p_{16,8} + p_{17,8} = 1$$

$$p_{79} + p_{7,10} + p_{7,11} + p_{7,12} = 1$$

$$p_{13,14} + p_{13,15} + p_{13,16} + p_{13,17} = 1$$

The mean sojourn times ( $\mu_i$ ) in the regenerative state  $i$  is defined as the time to stay in that state before transition to any other state.

If  $T$  denotes the stay time in the regenerative state  $i$ , then:

$$\mu_i = E(T) = P(T > y)$$

$$\mu_0 = \frac{1}{\lambda + \beta_{11}} \quad \mu_1 = \int_0^{\infty} t i(t) dt = \mu_7 = \mu_{13} \quad \mu_2 = \frac{1}{\lambda + \beta_{12} + y_{11}} \quad \mu_3 = \int_0^{\infty} t f_1(t) dt$$

$$\mu_4 = \int_0^{\infty} t f_2(t) dt \quad \mu_5 = \int_0^{\infty} t f_3(t) dt \quad \mu_6 = \int_0^{\infty} t f_4(t) dt \quad \mu_8 = \frac{1}{\lambda + y_{12}} \quad \mu_9 = \int_0^{\infty} t g_{12}(t) dt$$

$$\mu_{10} = \int_0^{\infty} t g_{22}(t) dt \quad \mu_{11} = \int_0^{\infty} t g_{32}(t) dt \quad \mu_{12} = \int_0^{\infty} t g_{42}(t) dt \quad \mu_{14} = \int_0^{\infty} t h_{12}(t) dt \quad \mu_{15} = \int_0^{\infty} t h_{22}(t) dt$$

$$\mu_{16} = \int_0^{\infty} t h_{32}(t) dt \quad \mu_{17} = \int_0^{\infty} t h_{42}(t) dt$$

The unconditional mean time taken by the system to transit to any regenerative state  $i$  when time is counted from the epoch of entrance into state is mathematical stated as :

Also

$$m_{ij} = \int_0^{\infty} t dQ_{ij}(t) = -q_{ij}(0)$$

$$m_{01} + m_{02} = \mu_0 ; m_{13} + m_{14} + m_{15} + m_{16} = \mu_1 ; m_{20} + m_{27} + m_{28} = \mu_2 ; m_{30} = \mu_3$$

$$m_{40} = \mu_4 ; m_{50} = \mu_5 ; m_{60} = \mu_6 ; m_{79} + m_{7,10} + m_{7,11} + m_{7,12} = \mu_7 ; m_{82} + m_{8,13} = \mu_8$$

$$m_{92} = \mu_9 ; m_{10,2} = \mu_{10} ; m_{11,2} = \mu_{11} ; m_{12,2} = \mu_{12} ; m_{17,2} = \mu_{17}$$

$$m_{13,14} + m_{13,15} + m_{13,16} + m_{13,17} = \mu_{13} ; m_{14,8} = \mu_{14} ; m_{15,2} = \mu_{15} ; m_{16,2} = \mu_{16}$$

### Measures of System Effectiveness

Considering the failed state as absorbing state and using the probabilistic arguments used for regenerative process, we obtained the recursive relation for mean time to system failure (MTSF), availability when power factor is controlled, availability when power factor is partial controlled, availability when power factor is not controlled, busy period for repair of type I, type II, type III, and type IV failure, expected number of visits of the repairman, expected number of fuse replacements, expected number of transformer replacements. Then employing Laplace/Laplace Stieltj's Transforms of these recursive relations, the steady state solution for the above mentioned measures of system effectiveness are obtained as under:

Mean time to system failure =  $N/D$

Availability when power factor controlled ( $AC_0$ ) =  $N_1/D_1$

Availability when power factor partial controlled ( $\overline{AC}_0$ ) =  $N_2/D_1$

Availability when power factor uncontrolled ( $\overline{\overline{AC}}_0$ ) =  $N_2/D_1$

Busy Period of type – I repair ( $BF_0$ ) =  $N_4/D_1$

Busy Period of type – II repair ( $BT_0$ ) =  $N_5/D_1$

Busy Period of type – III repair ( $BP_0$ ) =  $N_6/D_1$

Busy Period of type – IV repair ( $BO_0$ ) =  $N_4/D_1$

Expected Number of Visits of Repair man ( $V_0$ ) =  $N_8/D_1$

Expected Number of Fuse Replacement ( $FR_0$ ) =  $N_9/D_1$

Expected Number of Transformer Replacement ( $PR_0$ ) =  $N_{10}/D_1$

where

$$N = \mu_0 + p_{01}\mu_1, \quad D = 1 - p_{01} - p_{10}$$

$$N_1 = p_{02} - p_{82} - \mu_0,$$

$$D_1 = p_{20} - p_{82} - \mu_0 + p_{82} - p_{20} - \mu_1 + p_{02} - p_{82} - \mu_2 + p_{01} - p_{13} - p_{82} - p_{20} - \mu_3 + p_{01} - p_{14} - p_{82} - p_{20} - \mu_4 + p_{01} - p_{15} - p_{82} - p_{20} - \mu_5 + p_{01} - p_{15} - p_{82} - p_{20}$$

$$\begin{aligned} & \mu_6 + p_{02} p_{27} p_{82} \mu_7 + p_{02} p_{28} \mu_8 + p_{02} p_{27} p_{82} p_{79} \mu_9 + p_{02} p_{27} p_{7,10} p_{82} \mu_{10} + p_{02} p_{27} p_{7,11} p_{82} \mu_{11} + p_{02} p_{7,12} p_{82} \mu_{12} + p_{02} \\ & p_{28} p_{8,13} \mu_{13} + p_{02} p_{28} p_{8,13} p_{13,14} \mu_{14} + p_{02} p_{28} p_{8,13} p_{13,15} \mu_{15} + p_{02} p_{28} p_{8,13} p_{13,16} \mu_{16} + p_{02} p_{28} p_{8,13} p_{13,17} \mu_{17}, \\ N_2 &= p_{02} p_{82} \mu_2, N_3 = p_{02} p_{28} \mu_8, \\ N_4 &= p_{01} p_{13} p_{20} \mu_8 + p_{02} p_{27} p_{79} p_{82} \mu_9 + p_{28} p_{8,13} p_{13,14} \mu_{14}, \\ N_5 &= p_{01} p_{14} p_{20} p_{82} \mu_4 + p_{02} p_{27} p_{7,10} p_{82} \mu_{10} + p_{28} p_{8,13} p_{13,15} \mu_{15}, \\ N_6 &= p_{01} p_{15} p_{20} p_{82} \mu_5 + p_{02} p_{27} p_{7,11} p_{82} \mu_{11} + p_{28} p_{8,13} p_{13,16} \mu_{16}, \\ N_7 &= p_{01} p_{16} p_{20} p_{82} \mu_5 + p_{02} p_{27} p_{7,12} p_{82} \mu_{12} + p_{28} p_{8,13} p_{13,17} \mu_{17}, \\ N_8 &= p_{01} p_{20} p_{02} (p_{27} p_{82} + p_{28}), \\ N_9 &= p_{01} p_{13} p_{20} + p_{02} [p_{27} p_{79} p_{82} + p_{28} p_{8,13} p_{13,14}], \\ N_{10} &= p_{01} p_{24} p_{82} + p_{02} [p_{27} p_{7,10} p_{82} + p_{28} p_{8,13} p_{13,15}] \end{aligned}$$

### Profit Analysis

At steady state, the expected total profit (P) per unit time incurred to the system is given by:

$$\text{Profit (P}_3) = C_0 (AC_0 + \overline{AC}_0) - C_{21} BF_0 - C_{22} BT_0 - C_{23} BP_0 - C_{24} BO_0 - C_1 FR_0 - C_2 PR_0 - C_3 V_0 - (L \overline{E}) (A \overline{E}) - (\overline{LC}) (\overline{AC}_0)$$

Particular Case;

$$\begin{aligned} f_1(t) &= \alpha_1 e^{-\alpha_1 t}, f_2(t) = \alpha_2 e^{-\alpha_2 t}, f_3(t) = \alpha_3 e^{-\alpha_3 t}, f_4(t) = \alpha_4 e^{-\alpha_4 t}, g_{12}(t) = \beta_{22} e^{-\beta_{22} t}, g_{22}(t) = \beta_{32} e^{-\beta_{32} t}, \\ g_{32}(t) &= \beta_{42} e^{-\beta_{42} t}, g_{42}(t) = \beta_{52} e^{-\beta_{52} t}, h_{12}(t) = \gamma_{22} e^{-\gamma_{22} t}, h_{22}(t) = \gamma_{32} e^{-\gamma_{32} t}, \\ h_{32}(t) &= \gamma_{42} e^{-\gamma_{42} t}, h_{42}(t) = \gamma_{52} e^{-\gamma_{52} t}, i(t) = \int e^{-\delta t} \end{aligned}$$

Using the values of the parameters as mentioned under the heading of Introduction in this paper as

$$\begin{aligned} p_1=0.3, p_2=0.2, p_3=0.4, p_4=0.1, \alpha_1=4, \alpha_2=2, \alpha_3=6, \alpha_4=10, \beta_{11}=0.015, \beta_{12}=0.2, \beta_{22}=2.5, \beta_{32}=1.75, \\ \beta_{42}=4, \beta_{52}=6.5, \alpha_{11}=0.005, \alpha_{12}=0.3, \alpha_{22}=2.5, \alpha_{32}=0.25, \alpha_{42}=2, \alpha_{52}=3, \delta=6, \lambda=0.001, \\ L\overline{C}=500, \overline{LC}=300, C_1=50, C_2=250, C_3=1000, C_{21}=100, C_{22}=150, C_{23}=50, C_{24}=75; \end{aligned}$$

The following values of various measures of system effectiveness are obtained:

1. Mean Time To System Failure (MTSF)=1002.669Hours
2. Availability when Power Factor is controlled(AC<sub>0</sub>)=0.908497
3. Availability when Power Factor is partial controlled(A E<sub>0</sub>)=0.048723
4. Availability when Power Factor is not controlled(AC<sub>0</sub>)=0.000792
5. Busy Period of Type I repair(BF<sub>0</sub>)=0.000077445
6. Busy Period of Type II repair(BT<sub>0</sub>)=0.000101
7. Busy Period of Type III repair(BP<sub>0</sub>)=0.00006825
8. Busy Period of Type IV repair(BO<sub>0</sub>)=0.0000103
9. Expected number of Visits of repairman(v<sub>0</sub>)=0.00124
10. Expected number of Fuse Replacement(FR<sub>0</sub>)=0.0003
11. Expected number of Transformer Replacement(TR<sub>0</sub>)=0.0002
12. Profit incurred to the system(P)=941.668

### Graphical Interpretation (Conclusion)

Various graphs have been plotted but all the graphs have not been shown here to avoid wastage of space and to avoid repetition of similar interpretation. However, the users of such systems may plot any other suitable graph as per their requirement and on the basis of the data available to them and may draw important conclusion and as a result may take important decision regarding profitability of the system. some of the plotted graphs are shown as follows:

**Fig. 2** depicts the behaviour of MTSF with different values of  $\lambda$ . MTSF decreases with increases the value of  $\lambda$ .

**Fig. 3** depicts the behaviour of profit(P) with respect to loss( $\overline{LC}$ ) due to partial controlled power factor for different values of the rate ( $\beta_{12}$ ) with which power factor changes from partial controlled mode to controlled mode. It can be concluded that the profit (P) decreases with increases the value of ( $\overline{LC}$ ) and higher values for higher value of  $\beta_{12}$ . It can also be noticed that if  $\beta_{12}=0.2$  then  $P > \text{or} < 0$  according as  $\overline{LC} > \text{or} < 326.7$ . So, for the model to be beneficial,  $\overline{LC}$  should be  $< 325$  if  $\beta_{12}=0.2$ .

Similarly, for  $\beta_{12}=0.3$  and  $\beta_{12}=0.4$ , the values for  $\overline{LC}$  should be lesser than 420.31 and 504.47 respectively.

**Fig. 4** shows the behaviour of profit(P) with respect to cost ( $C_2$ ) per replacement of the transformer for different values of cost ( $C_3$ ) per visit of repairman. It is obvious from the graph that the profit decreases with the increase in the values of cost ( $C_2$ ). It can also be noticed that if  $C_3=2100$  then  $P > \text{or} < 0$  according as  $C_2 < \text{or} > 4378.89$ . So, for the model to be beneficial,  $C_2$  should be  $< 4378.89$  if  $C_3=2100$ . Similarly, for  $C_3=2140$  and  $C_3=2180$ , the values for  $C_2$  should be lesser than 4002.44 and 3507.97, respectively.

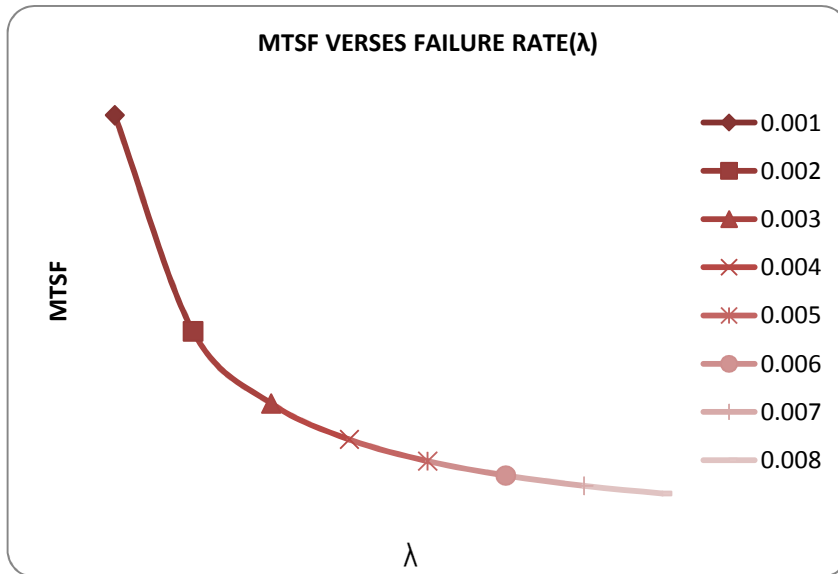


Fig. 2

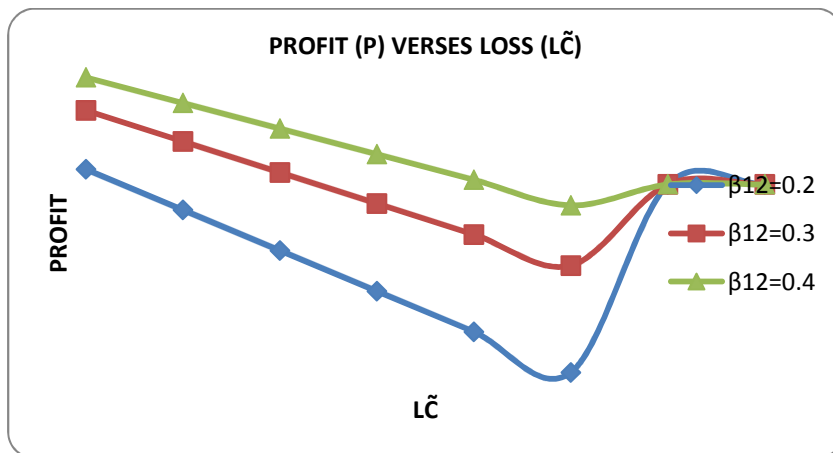


Fig. 3

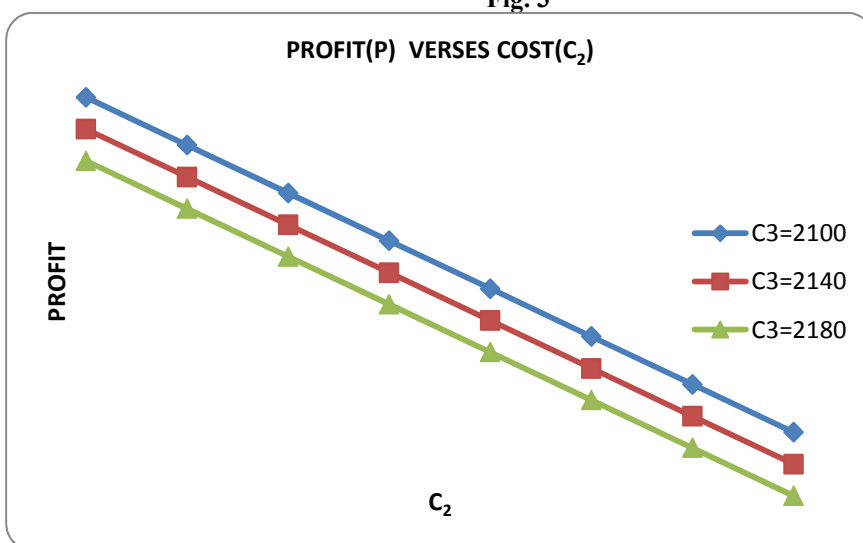


Fig. 4

## References

1. Bhatia et al (2012), "Probabilistic Analysis of an Automatic Power Factor Controller with variation in Power Factor", *International Journal of Engineering Science and Technology (IJEST)*, 4(10), 4359-4366
2. Kumar R and Kapoor S (2013), "Economic and performance evaluation of stochastic model on a base transceiver system considering various operational modes and catastrophic failures", *Journal of Mathematics and Statistics*, 9(3):198-207, 2013
3. Mathew, A. G., Rizwan, S. M., and Majumdar M. C., (2010), "Comparative Analysis between Profits of the Two Models of CC Plant", *International Conference on Modeling, Optimization and Computing, AIP Conf. Proc. 1298*, pp. 226-231.
4. Parashar, Bhupender, and Taneja, G., (2007), "Reliability and profit evaluation of a PLC hot standby system based on master slave concept and two types of repair facilities", *IEEE Transactions on Reliability*, vol.56(3), pp 534-539.
5. Rizwan S M (2007), "Reliability analysis of a 2-unit system with two repairmen", *Caledonian Journal of Engineering*, 3(2), 1-5.
6. Taneja G and Singh Dalip (2013), "Reliability Analysis of a Power Generating System Through Gas and Steam Turbines with Scheduled Inspection", *Aryabhata Journal of Mathematics & Informatics*, 5(2), 373-380.

## Short Profile of Rekha

Rekha born at Karnal (Haryana) in India on 28 Oct., 1990, Rekha is currently doing M.Phil. (Maths) under the supervision of Prof. Gulshan Taneja, Maharshi Dayanand University, Rohtak.

## Short Profile of Shilpi

Shilpi born at Rohtak (Haryana) in India on 5 Dec., 1989, Shilpi is currently doing Ph.D. (Maths) under the supervision of Prof. Gulshan Taneja, Maharshi Dayanand University, Rohtak.

## Short Profile of Dr Gulshan Taneja

Born at Rohtak (Haryana) in India on 8<sup>th</sup> May 1965, Dr Gulshan Taneja is currently working as Professor in the Department of Mathematics, Maharshi Dayanand University Rohtak. He earned his Ph.D. degree in 1992 from Maharshi Dayanand University, Rohtak, India. He had a wide range of teaching as well as research experience of about 25 years. He is Associate Editor/Editor/Reviewer of many International Journals in Mathematics/Engineering. He has supervised 8 Ph.D. theses and 8 M.Phil. dissertations in Mathematics/Statistics. Currently, 8 are being supervised by him. Dr Taneja has published over 170 Research Papers in various Journals of International repute and proceedings of the National/International conferences. He has delivered many Invited talks/Extension lectures in India as well as Abroad. He chaired sessions in number of National / International Conferences and acted as a Resource person in Refresher Courses also. He participated in around 35 National/International conferences. He is the writer of the six blocks of a Course run by IGNOU, New Delhi, INDIA and has also edited four books published by the same University. He is one of the editors of the proceedings of two National Conferences in India and is member of various academic societies/ associations. His areas of interest are "Reliability Modeling", "Queueing Theory" and "Optimization".



The IISTE is a pioneer in the Open-Access hosting service and academic event management. The aim of the firm is Accelerating Global Knowledge Sharing.

More information about the firm can be found on the homepage:

<http://www.iiste.org>

## CALL FOR JOURNAL PAPERS

There are more than 30 peer-reviewed academic journals hosted under the hosting platform.

**Prospective authors of journals can find the submission instruction on the following page:** <http://www.iiste.org/journals/> All the journals articles are available online to the readers all over the world without financial, legal, or technical barriers other than those inseparable from gaining access to the internet itself. Paper version of the journals is also available upon request of readers and authors.

## MORE RESOURCES

Book publication information: <http://www.iiste.org/book/>

Academic conference: <http://www.iiste.org/conference/upcoming-conferences-call-for-paper/>

## IISTE Knowledge Sharing Partners

EBSCO, Index Copernicus, Ulrich's Periodicals Directory, JournalTOCS, PKP Open Archives Harvester, Bielefeld Academic Search Engine, Elektronische Zeitschriftenbibliothek EZB, Open J-Gate, OCLC WorldCat, Universe Digital Library, NewJour, Google Scholar

