



**Faculty of Electrical Engineering**

**IMPACT OF PHOTOVOLTAIC SYSTEMS INTEGRATION  
ON ELECTRICITY DISTRIBUTION NETWORKS**

**Wadhah Esmaeel Ibraheem**

**Master of Electrical Engineering**

**(Industrial Power)**

**2014**

**IMPACT OF PHOTOVOLTAIC SYSTEMS INTEGRATION ON ELECTRICITY  
DISTRIBUTION NETWORKS**

**WADHAH ESMAEEL IBRAHEEM**

**A dissertation submitted  
In partial fulfillment of the requirements for the degree of Master of  
Electrical Engineering (Industrial Power)**

**Faculty of Electrical Engineering**

**UNIVERSITI TEKNIKAL MALAYSIA MELAKA**

**2014**

**Examiner Approval sheet**

**IMPACT OF PHOTOVOLTAIC SYSTEMS INTEGRATION ON  
ELECTRICITY DISTRIBUTION NETWORKS**

By

Wadhah Esmaeel Ibraheem

Dissertation accepted as conforming to the required requirements for the degree of  
Master of Engineering and approved by the examining committee

**Assoc. Prof. Dr  
Zulkiflie Bin Ibrahim**  
*Dean of Electrical Engineering Collage  
Chairman*

**Datuk Prof. Dr  
Mohd Ruddin Ab Ghani**  
*First Examiner*

**Encik  
Khairul Anwar bin Ibrahim**  
*Second Examiner*

2014

## DECLARATION

I declare that this dissertation entitle ~~Impact~~ of Photovoltaic Systems Integration on Electricity Distribution Networks” is the result of my own research except as cited in the references. The dissertation has not been accepted for any degree and is not concurrently submitted in candidature of any other degree.

Signature : .....

Name : .....

Date : .....

## APPROVAL

I hereby declare that I have read this dissertation and in my opinion this dissertation is sufficient in terms of scope and quality for the award of Master of Electrical Engineering (Industrial Power).

Signature : .....

Supervisor Name : .....

Date : .....

## **DEDICATION**

I dedicate my dissertation work to my family and many friends. A special feeling of gratitude to my loving parents, Esmael Ibraheem and Najiyah Tareq whom words of encouragement and a push for tenacity to improve myself throughout all my walks of life. Thank you for giving me a chance and I love you.

I also dedicate this dissertation to my brothers Mustafa and Suhaib who have supported me throughout my life. I always miss and I cherish the memories that we had. I love both of you.

And I do not forget to dedicate this work to my sweetheart Ban Haider who has always been with me in overcoming times in my loneliness. Her patience is the meaning of love, kindness and gentle soul, thus I love you.

## ABSTRACT

Traditionally, power systems are designed to operate in a unidirectional power flow. In the past few years, integration of solar photovoltaic (PV) systems on distribution network has grown rapidly given its potential technical and economic benefits, which include higher network utilization, enhanced reliability and loss reduction. However, the high PV generation during low demand periods may cause potential network problems. In addition, PV generation depends directly to the sun irradiance which could potentially cause problems in the cases of high PV penetration level. The intermittency of the power generated from the PV plants may introduce voltage fluctuation and power quality issues. These issues may limit the PV penetration level and hence necessary measures are needed to alleviate the potential problems. This dissertation investigates the steady state impact of the PV plant penetration on the operation of power distribution networks. This includes the impact of PV generation on the network losses. In addition, the light and heavy load cases have been considered in this work to analyze their respective impact on the network voltage. The maximum PV penetration level that can be injected into the grid is identified. Mitigation strategy has also been proposed to control the voltage fluctuation that caused by PV plants. Standard IEEE distribution test cases have been modeled by utilizing OpenDss simulator. These test cases were used to perform the case studies of distribution systems in order to evaluate the impact of grid connected PV systems. The results indicate that the integration can have a positive impact and negative impact on the connected grids. The interest lies in the voltage improvement at load buses and the reduction in the system losses. The maximum capacity and the impact of the PV on the grid connected system depend on the PV size, installation location and system topology. The results also show that the STATCOM technique can effectively reduce the voltage fluctuation in the network.

## ABSTRAK

Secara tradisinya, sistem kuasa direka untuk beroperasi dalam satu arah aliran kuasa. Beberapa tahun kebelakangan ini, sistem solar photovoltan (PV) telah berkembang pesat memberikan manfaat yang berpotensi dari segi teknikal dan ekonomi termasuk penggunaan rangkaian yang tinggi, kebolehpercayaan yang dipertingkatkan dan pengurangan kerugian. Walaubagaimanapun, penjanaan PV yang tinggi dalam tempoh permintaan yang rendah boleh menyebabkan potensi rangkaian yang bermasalah. Di samping itu, generasi PV bergantung secara langsung kepada sinaran matahari yang berpotensi boleh menyebabkan masalah dalam kes-kes tahap penembusan PV yang tinggi. Peralihan janaan kuasa yang cepat dari loji PV boleh menyebabkan voltan turun naik dan isu-isu pada kualiti kuasa. Isu ini boleh menghadkan tahap penembusan PV dan oleh itu langkah-langkah adalah diperlukan untuk mengurangkan potensi masalah yang mungkin berlaku. disertasi ini mengkaji kesan penembusan loji PV dalam keadaan tetap pada operasi rangkaian pengagihan kuasa. Ini termasuk kesan generasi PV ke atas kerugian rangkaian. Tambahan pula, benda ringan dan berat telah dipertimbangkan dalam kajian ini untuk menganalisis kesan masing-masing pada voltan rangkaian. Tahap maksimum penembusan PV yang boleh disuntik ke dalam grid tersebut telah dikenalpasti. Strategi kawalan juga telah dicadangkan untuk mengawal voltan turun naik yang disebabkan oleh loji-loji PV. Kes-kes pengujian piawaian IEEE telah dimodelkan dengan menggunakan simulasi OpenDss. Kes-kes pengujian tersebut telah digunakan untuk melaksanakan kajian kes sistem pengedaran bagi menilai kesan grid yang berkaitan sistem PV. Keputusan menunjukkan bahawa integrasi boleh memberi kesan positif dan kesan negatif ke atas grid yang berkaitan. Kepentingan terletak pada peningkatan voltan bas beban dan pengurangan kerugian sistem. Kapasiti maksimum dan kesan PV pada sistem grid yang berkaitan bergantung kepada saiz PV, lokasi pemasangan dan sistem topologi. Keputusan juga menunjukkan bahawa teknik STATCOM berkesan boleh mengurangkan turun naik voltan dalam rangkaian.



## ACKNOWLEDGMENTS

In preparing this dissertation, I was in contact with many people, researchers, academicians and practitioners. They have contributed towards my understanding and thought. In particular, I wish to express my sincere appreciation to my main supervisor, I thank to my supervisor Dr. Gan Chin Kim with all of my heart who gave me encouragement, guidance and support from the initial to the final level of my dissertation.

I am also very thankful to lecturers and professors in Universiti Teknikal Malaysia Melaka (UTeM) for their guidance, advices and motivation. Many thanks to my teachers in the first degree in Diyala University. I appreciate their continued support and interest in my course study.

I am also indebted to Universiti Teknikal Malaysia Melaka (UTeM). They deserve special thanks for their assistance in supporting students by conferences, technical talks and workshops.

My fellow postgraduate students should also be recognized for their support. My sincere appreciation also extends to all my colleagues and others who have provided assistance at various occasions. Their views and tips are useful indeed. Unfortunately, it is not possible to list all of them in this limited space. I am grateful to all my family members

## TABLE OF CONTENTS

<b>DECLARATION</b>	
<b>APPROVAL</b>	
<b>DEDICATION</b>	
<b>ABSTRACT</b>	<b>i</b>
<b>ABSTRAK</b>	<b>ii</b>
<b>ACKNOWLEDGMENTS</b>	<b>iii</b>
<b>TABLE OF CONTENTS</b>	<b>iv</b>
<b>LIST OF TABLES</b>	<b>vii</b>
<b>LIST OF FIGURES</b>	<b>viii</b>
<b>LIST OF APPENDICES</b>	<b>xii</b>
<b>LIST OF ABBREVIATION</b>	<b>xiii</b>
<b>LIST OF PUBLICATION</b>	<b>xiv</b>
<b>CHAPTER</b>	
<b>1 INTRODUCTION</b>	<b>1</b>
1.1 Research Background	1
1.2 Problem Statement	3
1.3 Research Objectives	4
1.4 Research Scope	5
1.5 Chapter's Organization	6
<b>2 LITERATURE REVIEW</b>	<b>7</b>
2.1 Distributed Generation: Photovoltaic Systems	7
2.2 Distribution system	9
2.3 Photovoltaic System (PVs)	12
2.3.1 Deployment of PV System	12
2.3.2 Characteristics of PV Module	16
2.3.3 PV System Inverter	22
2.3.4 Fluctuations of the Power Generated from PV Systems	23
2.3.5 Solar Photovoltaic Integration	25
2.3.6 Types of Grid-tied Photovoltaic Systems	26
2.4 Impact of Grid-connected Solar PV Systems	28
2.4.1 Impacts of PV Systems on Voltage Profile	32
2.4.2 Mitigation methods for voltage problems	33
2.4.3 Impacts of PV Systems on Network Losses	39
2.5 Penetration level of Grid-connected PV systems	40
2.6 Summary of the Literature Review	42

<b>3</b>	<b>OPEN DISTRIBUTION SYSTEM SIMULATOR (OpenDss) MODELING</b>	<b>44</b>
3.1	Introduction	44
3.2	Simulation Capabilities	46
3.2.1	Power Flow Solution	46
3.2.2	Fault Studies Solution	48
3.2.3	Harmonic Analysis	48
3.2.4	Dynamics Simulation	49
3.3	OpenDss Architecture of Models	49
3.4	Circuit Modeling Basics	51
3.4.1	DSS connection models (Buses and Terminals)	52
3.4.2	Power Delivery Elements	53
3.4.3	Power Conversion Elements	54
3.5	Distribution System Circuit Modeling	55
3.5.1	Initial Definition with Voltage Source Object	56
3.5.2	Transformer Modeling	57
3.5.3	Line Object Modeling	59
3.5.4	Load Object Modeling	63
3.5.5	Recording Elements (Monitors)	64
3.5.6	Solving and Showing Results Reports	66
3.6	Validation of OpenDss with IEEE Test Feeders	66
<b>4</b>	<b>MODELING AND SIMULATION</b>	<b>76</b>
4.1	Simulation Tools	77
4.2	Photovoltaic Power Generation model	77
4.2.1	V-I Characteristics Modeling	77
4.2.2	Time series PV Power Generation Model	84
4.3	PV Impact Analysis on Distribution System Networks	86
4.3.1	Distribution System Voltage Performance Analysis	87
4.3.2	Impact of PV Generation of the Feeder Losses	93
4.3.3	Study on The Penetration Level of Grids-connected PVs	95
4.4	Mitigation of Voltage Fluctuation by STATCOM Compensation	100
<b>5</b>	<b>RESULTS AND DISCUSSION</b>	<b>102</b>
5.1	Solar Photovoltaic Panel Generation	102
5.1.1	V-I Characteristics of PV system	103
5.1.2	Daily Solar PV power generation	106
5.2	Steady State Voltage Improvement in Distribution Networks	110
5.3	Voltage Improvement Based on Daily Time Series	114
5.4	Losses Impact on Grid-connected PV Systems	117
5.5	Penetration Level of PV System in Distribution Networks	121
5.5.1	PV Penetration Limit of 34-bus Test System	121
5.5.2	Impact of PV Penetration on Distribution Network under Various Load Levels	124
5.6	Mitigation of Voltage Fluctuation by STATCOM Compensation	129
<b>6</b>	<b>CONCLUSIONS AND FUTURE WORKS</b>	<b>135</b>
6.1	Conclusions	135
6.2	Significance of Results	138

6.3	Future works	139
<b>7</b>	<b>REFERENCES</b>	<b>140</b>
<b>8</b>	<b>APPENDICES</b>	<b>147</b>
8.1	APPENDIX A	147
8.2	APPENDIX B	150
8.3	APPENDIX C	168
8.4	APPENDIX D	191

## LIST OF TABLES

TABLE	TITLE	PAGE
2.1	ANSI C84.1 Voltage Range for 120V voltage level	11
2.2	Classification of grid-connected photovoltaic systems	27
2.3	IEEE 1547 standard family	29
2.4	Grid-connected response to abnormal Voltages	31
2.5	Grid-connected response to abnormal Frequencies	31
2.6	The Summary of the Conducted Studies by the other Researchers	42
3.1	Application Studies in OpenDss Program	45
3.2	Methods of Identifying Transformer Object	57
3.3	Validation of OpenDss 4-bus system results with IEEE test results	70
3.4	Voltage Validation of OpenDss 13-bus system results with IEEE test results	73
3.5	Voltage Validation of OpenDss 34-bus system results with IEEE test results	75
4.1	The electrical characteristics data of SolarWorld SW 255 PV panel	78
4.2	Ideal Factor $A$ and Band Gap Energy of Solar Cell	80
5.1	Percentage of System Voltages Improvement	128
5.2	The Summary of Voltage and Tap-changer before and after Mitigation	134

## LIST OF FIGURES

FIGURE	TITLE	PAGE
1.1	Solar PV Global Capacity, 1995–2012 (Mcginn et al., 2013)	2
2.1	IEEE 4 Node Radial Test Feeder	10
2.2	Voltage range limits used in this study (Liu & Bebic, 2008)	12
2.3	Average PV systems prices	14
2.4	Local BIPV Pricing Trend (MBIPV Project, 2013)	16
2.5	Band-gap view of solar cell junction.	17
2.6	Equivalent circuit of a single solar cell. (Ding et al., 2012)	18
2.7	I-V curve and varying irradiance at 25°C. (Ding et al., 2011)	19
2.8	I-V curve and varying temperature at constant irradiance	20
2.9	P-V curve for a typical PV panel at different irradiance levels	21
2.10	Typical PV plant power output of two days in U.S (Lave et al., 2011)	24
2.11	Distribution Grid-connected Photovoltaic Components	26
2.12	schematic diagram of Step Voltage Regulator (SVR)	34
2.13	Circuit diagram of a Thyristor Voltage Regulator (TVR)	34
2.14	Phase diagram of Voltage Rising in feeders - tied Solar Systems	35
2.15	Voltage Profile Along the feeder	36
2.16	Annual Energy Losses Based on Penetration Level (Quezada et al., 2006)	39
3.1	OpenDss Sitructure	46
3.2	OpenDss Architecture of Models	50

3.3	OpenDss Solution Loop	51
3.4	Bus and Terminal Models Definition	52
3.5	Power Delivery Element Definition	54
3.6	Compensation Current Model of PC Elements	54
3.7	Pole Configuration	61
3.8	4-Bus IEEE Test Feeder	68
3.9	13-Bus Test System	68
3.10	34-Bus Test System	74
4.1	Photovoltaic (PV) panel model	81
4.2	The design for PV module	82
4.3	Photo-current module	82
4.4	(a) Reverse saturation current - $I_{rs}$ . (b) Saturation current which varies with temperature.	83
4.5	The Output Current of PV model	83
4.6	The Site of PV Plant Installation in Loughborough city (UK)	85
4.7	Block Diagram of the PV System Model by OpenDss	86
4.8	IEEE 13-Node Distribution Network without PV System	87
4.9	13-bus Test Feeder with The Connected PV Systems	89
4.10	Flowchart representing installation of PV system in 13-bus IEEE system	90
4.11	Flowchart of Voltage Improvement and Fluctuation Methodology	92
4.12	The Flowchart of PV Generation Impact on the Distribution Losses	94
4.13	The Time Series Losses Impact Test Feeder	95
4.14	IEEE 34 Node Test Feeder	96

4.15	Methodology of Determining the Maximum Level of Penetration	97
4.16	4-bus IEEE Test Feeder with Connection PV System	98
4.17	Sending and Receiving Voltage in 4-bus Test System	99
4.18	Flow Chart of STATCOM Compensation Methodology	101
5.1	I-V Characteristics of SolarWorld SW 255 (Mono)Photovoltaic Cell	103
5.2	P-V Characteristics of SolarWorld SW 255 (Mono) Photovoltaic Cell	104
5.3	I-V Characteristics of SolarWorld SW 255 (Mono) Photovoltaic Cell	105
5.4	P-V Characteristics of SolarWorld SW 255 (Mono) Photovoltaic Cell	105
5.5	Outdoor Global Irradiance with Clouds Clearing Index	106
5.6	Daily Temperature in Loughborough City	107
5.7	PV Panel Daily Voltage	107
5.8	PV Panel Daily Current Profile	108
5.9	Zoomed Voltage of Modeled PV System	108
5.10	PV Power Generation Profile	109
5.11	Voltage Improvement Caused by Installed PV system	110
5.12	Three Phase Voltages at 13-bus Feeder with PV	112
5.13	Tap-changer Position According to Penetration level	113
5.14	Daily (5-minute) Load Profile and PV Generation	114
5.15	Daily Voltage Profile at Customer's Bus (Bus.671)	115
5.16	Voltage Profile of Main Substation	116
5.17	Voltage Profile of Bus-Bar 671	116
5.18	Percentage of Losses at Various PV Locations	118
5.19	692-675 Feeder Load and PV System Profile	119



5.20	Feeder Losses with Different PV System Capacities	119
5.21	U-shape Trajectory of The Losses Behavior in IEEE 13-bus System	120
5.22	Maximum Allowable Injected Power at Bus 814	122
5.23	Maximum Allowable Injected Power at Bus 824	122
5.24	Maximum Allowable Injected Power at Bus 836	123
5.25	Maximum Allowable Injected Power at Buses 814, 824 and 836 Together	124
5.26	IEEE 4-Bus Test System	125
5.27	Voltages in Different Percentages of Maximum Demand	127
5.28	System voltages regulation	128
5.29	Voltage Profile before STATCOM Mitigation	129
5.30	Tap-changer Movement before Mitigation	130
5.31	Voltage and Tap-Changer Profiles of IEEE 34-Bus System with Mitigation Control	132
5.32	Voltage and Tap-Changer Profiles of IEEE 34-Bus System with Mitigation Control and 1500 kW Installation	133

## LIST OF APPENDICES

APPENDIX	TITLE	PAGE
<b>A</b>	SolarWorld Catalogue SW 255 mono PV model	147
<b>B</b>	IEEE Distribution Test Feeders System	150
	<i>B1. IEEE 4 Node Test System</i>	150
	<i>B2. IEEE 13 Node Test System</i>	155
	<i>B3. IEEE 34 Node Test System</i>	162
<b>C</b>	OpenDss and MATLAB Codes	168
<b>D</b>	Publication	191

## LIST OF ABBREVIATION

<b>ANSI</b>	American National Standards Institute
<b>BIPV</b>	Building Integration PV
<b>CHP</b>	Combined Heat and Power
<b>CSV</b>	Comma-Separated Value
<b>COM</b>	Component Object Model
<b>DER</b>	Distributed Energy Resource
<b>DG</b>	Distributed Generation
<b>DLL</b>	Dynamic Link Library
<b>EPRI</b>	Electric Power Research Institute
<b>EPS</b>	Electric Power Systems
<b>PES</b>	IEEE Power and Energy Society
<b>IEEE</b>	Institute of Electrical and Electronics Engineers
<b>ISE</b>	Interconnection System Equipment
<b>IEA</b>	International Energy Agency
<b>MBIPV</b>	Malaysia Building Integrated Photovoltaic
<b>MPP</b>	Maximum Power Point
<b>MPPT</b>	Maximum Power Point Tracker
<b>NERL</b>	National Renewable Energy Laboratory
<b>NOCT</b>	Nominal Operating Cell Temperature
<b>OLTC</b>	On Load Tap Changers
<b>OpenDss</b>	Open Distribution System Simulator
<b>PV</b>	Photovoltaic
<b>PCC</b>	Point of Common Coupling
<b>RES</b>	Renewable Energy System
<b>STATCOM</b>	Static Synchronous Compensator
<b>STC</b>	Standard Test Condition
<b>SVR</b>	Step Voltage Regulators
<b>TCC Fuse</b>	Time-Current Characteristic Fuse
<b>TNB</b>	Tenaga Nasional Berhad
<b>TVR</b>	Thyristor Voltage Regulator
<b>UL</b>	Underwriters Laboratories
<b>VBA</b>	Visual Basic of Application
<b>Yprim</b>	Primitive y Matrix

## LIST OF PUBLICATION

### Journal

[1] W. E. Ibraheem, C. K. Gan, "Effect of technical impact of PV penetration on distribution network under various load levels" Applied Mechanics and Materials, ISSN 1660-9336, May 2014. (Accepted and to be appeared in May 2014 issue), *Scopus-indexed*

[2] W. E. Ibraheem, C. K. Gan, M. R. Ab. Ghani "Impact of Photovoltaic (PV) Systems on Distribution Networks" International Review on Modeling and Simulations (IREMOS), ISSN 1974-9821, March 2014. (Accepted and to be appeared in March 2014 issue), *Scopus-indexed*

# CHAPTER 1

## INTRODUCTION

### 1.1 Research Background

These days the demand for electrical energy is increasing to meet the load expansion in the electrical power system. The rise of the world weather temperature and the depletion of fossil fuel and the price of the fuel had motivated more researches and development in renewable energy system (RES). This is to reduce the CO<sub>2</sub> emission. Many countries have engaged in renewable electricity and they have set ambitious for producing power from green sources to meet the expected demand in the coming years.

Photovoltaic (PV) solar energy is one of the important sources of the renewable energy; it has grown in many countries steadily in the last few years. In Europe, the combined target yield a total expected PV power generation capacity is 84.4 GW by 2020, where the maximum projected PV target is in Germany which is around 51.8 GW from solar energy (Pearsall, 2011). In Malaysia according to the 10<sup>th</sup> Malaysian plan (2011-2015) the PV generation in the country will reach 65 MW in 2015 and it is projected to be 190 MW by 2020 (Shamsuddin, 2012). U.S. imports of PV products from South Korea are small, but the country has a stated goal to capture 10% of the global PV market by 2020 (Platzer, 2012).

PV systems generation is not different of other renewable energy resources (naturally replenished). Solar energy is comparatively clean by owning a lower effect on

the environment as well as it saves the depletion of fossil fuel and coal. The variability in the output of the PV panels is a natural behavior of these resources and it is a significant issue. The rising and setting of the sun lead to a regularly variation of the PV panel generation over the daily time period. In addition, the output can be decreased to 50%-80% when the clouds pass over PV plants (Kleissl, 2012). In this case a backup power will be required to cover the output variable to maintain the operation voltage under the limit. If the response of the backup elements is too slow to cover the problem, power quality can adversely affected.

Despite these difficulties, solar PV plants still have the fastest growing of renewable energy technology in 2012. As shown in Figure 1.1 a predestined that 29 GW of the solar capacity in 2012 have been added to the power capacity which was in 2011. The power was almost 150% has increased of the installed capacity of 2010 bringing the totally generation about 100 GW (Mcginn et al., 2013).

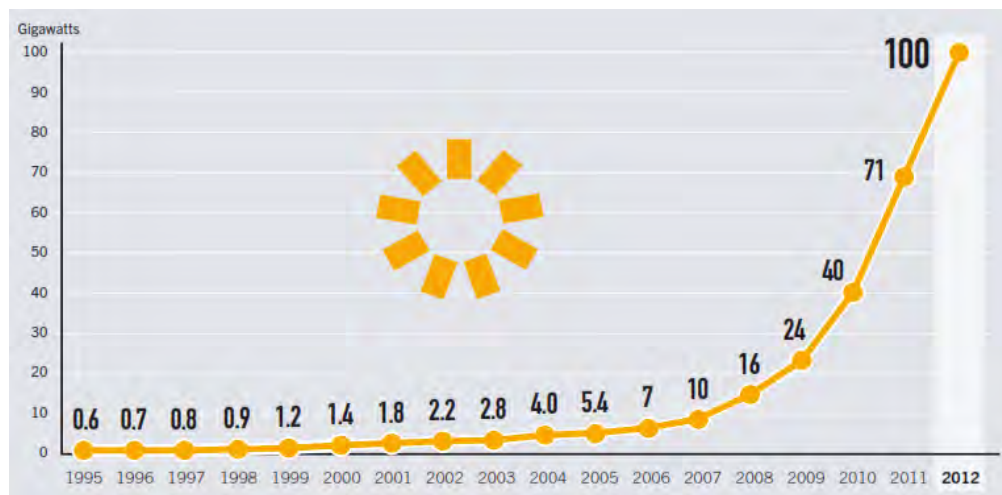


Figure 1.1 Solar PV Global Capacity, 1995–2012 (Mcginn et al., 2013)

As the rapid increasing of the PV integration, it could potentially bring problems in terms system operation where a reverse power can be introduced by higher penetration levels resulted a rise in bus voltages and feeder losses (Agalgaonkar, 2013). Numbers of researches have been done in the recent years to evaluate the impact of PV system on power grids. The notable studies were by *National Renewable Energy Laboratory (NREL)* in February 2008, and the other one in 2002 which had been conducted by the *International Energy Agency (IEA)* (E. Liu & Bebic, 2008) (Arne Faaborg, 2002). In Malaysia, Tenaga Nasional Berhad (TNB) has provides a guideline and recommendations to the interconnection of PV systems with distribution grids (Tenaga Nasional Berhad, 2013). These studies included many reports of the PV impact on the distribution grids to address the analytical and technical issues of the high penetration level of distribution generation as in reference (Tie & Gan, 2013).

## **1.2 Problem Statement**

Radial distribution systems have only one power source for a group of customers supported by one direction power flow networks, the voltage regulation which is implemented by utilizing tap changer at the substation point or by compensating the estimated voltage drop or rise according the load demand profile. The injected power by the PV plants modules at the load side buses will decrease the demand of the local load which leads to a losses reduction and voltage profile improvement. Obviously, this case is true as long as the real power flows from the substation to the customer side (when the load is less that PV power). If the PV generation is more than the load downstream of the PV location, the power flow may be reversed towards the substation. Consequently, U-

shape trajectory of distribution networks losses is expected. In addition, voltage rise can be expected along the distribution system feeder as a result of the reverse power flow.

The rise of the voltage at the end-user limits the amount of the penetration level which wanted to be installed in the distribution network. The natural behavior of the solar source makes the generation of the PV plant systems in fluctuated profile. The rapid variation of the PV power introduces a voltage fluctuation along the PV working time and hence it effects on the voltage regulation in some cases.

### **1.3 Research Objectives**

In a light of the issues described above, this research aims to analyze the impact of the PV system on distribution systems. The focus of this research is to evaluate the voltage and losses impact on the distribution feeders. The main objectives of this work are:

- To model and simulate the commercially available PV panels and results validation with the product catalogue.
- To investigate the impact of PV integration on distribution networks in terms of network losses at different PV locations and to evaluate the voltage impact under different PV penetration level and load levels.
- To implement voltage control strategies in order to alleviate voltage fluctuation issues from solar PV system.