

REMOVAL OF ARSENIC FROM AQUEOUS SOLUTION BY PHOTOCATALYTIC UV IRRADIATION

Mahsa Jahangiri-rad, PhD Student

Department of environmental health engineering, Tehran medical sciences branch,
Islamic azad university, Tehran, Iran

Abstract

The purpose of this research was to investigate the photocatalytic removal of arsenic from aqueous solution using UV/TiO₂ process in a batch system. A 120 W UV lamp with irradiation 247 nm wave length inside a quartz jacket was submerged in the reactor to provide better irradiation of water samples in the presence of TiO₂ nanoparticles. The optimum dosage of TiO₂ was obtained equal to 1 g/L, with variation TiO₂ dosage at constant pH and initial concentrations of arsenic. The effect of pH, contact time and initial concentration of arsenic was studied at the constant amount of TiO₂(1g/L). The results showed that photocatalytic removal efficiency increased with increasing reaction time and TiO₂ dosage. In addition, it was found that removal efficiency of arsenic decreased by increasing initial arsenic concentration and pH. In conclusion the results showed that UV/TiO₂ was an effective method in removal of arsenic from aqueous solutions.

Keywords: TiO₂ nanoparticles, arsenic, photocatalytic reaction, aqueous solution

Introduction

Arsenic is considered as one of the most toxic and carcinogenic elements (Basu et al., 2010). Arsenic compounds resemble in some respects those of phosphorus which occupies the same group (column) of the periodic table. Arsenic is less commonly observed in the pentavalent state, however. The most common oxidation states for arsenic are: -3 in the arsenides, such as alloy-like intermetallic compounds; and +3 in the arsenites, arsenics(III), and most organoarsenic compounds (Bellack, 1971). Arsenic occurs in natural water in organic and inorganic forms. The species of inorganic arsenic are dependent on the redox conditions and the pH. Arsenic (As (V)) dominates in oxygen-rich waters and arsenite (As (III)) in reducing environments (Edwards, 1988). When heated in air, arsenic oxidizes to arsenic trioxide; the fumes from this reaction have an odor resembling garlic. Arsenic makes up about 1.5 ppm of the Earth's crust. Soil contains 1–10 ppm of arsenic and Seawater has 1.6 ppb arsenic. Minerals with the formula MAsS and MAs₂ (M = Fe, Ni, Co) are the dominant commercial sources of arsenic, together with realgar (an arsenic sulfide mineral) and native arsenic. Arsenic also occurs in various organic forms in the environment (Blissen and Frimmel, 2003). Many countries and districts in Southeast Asia, such as Vietnam and Cambodia, Western area of Iran (Kurdistan rural areas) and North Eastern and South Western coast area of Taiwan have geological environments conducive to generation of high-arsenic groundwaters (Mandal and Suzuki, 2002). Widespread arsenic contamination of groundwater has led to a massive epidemic of arsenic poisoning. It is estimated that approximately 57 million people in the many parts of the world are drinking groundwater with arsenic concentrations elevated above the World Health Organization's standard of 10 parts per billion (ppb) (EPA, 2001). Due to such harmful effects of arsenic on human health, new USEPA regulation lowered the maximum contaminant level (MCL) for arsenic in

drinking water from 50 to 10 $\mu\text{g/L}$ (Sorg, 1997), therefore it is necessary to find novel technologies to access this new regulation. A large number of technologies have been examined to remove arsenic from contaminated water (Choong, Chuah, Robiah, Gregory, & Azni, 2007). Many factors such as arsenic concentrations in water, presence of other constituents in water and expenses associated with a treatment process are contributed in selection of technology (Sorg, 1997). Arsenic removal methods include coagulation and precipitation (Chen and Wilkie, 1997), membrane separation (Choong et al., 2007), ion exchange (Waypa et al., 1997) and adsorption (Awual et al., 2008; B?aba et al., 1999). Many of the waste streams contain As(III), which requires oxidation before it can be removed by common methods such as iron co-precipitation or ion exchange. Since the oxidation rate of dissolved As(III) by oxygen is extremely slow, oxidants such as chlorine, ozone or permanganate need to be used. Chlorine has traditionally been the oxidant of choice, but there are growing concerns regarding the generation of organochloride byproducts from the naturally occurring organic matter which may also be present (EPA, 2001). In this paper Photocatalytic oxidation (PCO) was achieved with the combination of UV light rays and TiO_2 nanoparticles. Nanoparticles have also solely known as effective adsorbents for some organic and inorganic substances. Therefore this paper evaluates the combination process of adsorption and advanced oxidation for arsenic removal. This process creates hydroxyl radicals and super-oxide ions, which are highly reactive electrons and designed to remove arsenic in water. The effects of other factors including Initial concentration of As(III), pH and light intensity were also investigated.

Materials and methods

TiO_2 nano particles were purchased from Evonik-industrial company, Germany. The purity, especial surface area (BET) and sizes of the selected nanoparticles were 99.5%, 50 ± 15 and 21nm, respectively. TEM image of selected TiO_2 nanoparticles is shown in figure 1.

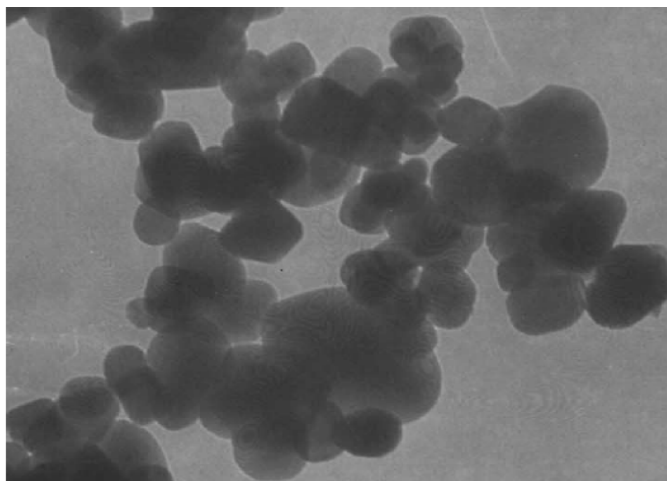


Fig 1. TEM micrograph of TiO_2

A 120 W UV lamp with irradiation 247 nm wave length inside a quartz jacket was submerged in the reactor to provide better irradiation of water samples. This reactor was operated continuously, and stirred by use of a simple magnetic stirrer. The schematic diagram

of the reactor used in the experiment is shown in Fig 2. The experiments are conducted in the inner part (glass reactor) and the outer part designed to act as a cooling bath for circulating cold water and maintaining the temperature at 20°C. A 100 mg/L arsenic stock solution was prepared from $\text{Na}_2\text{HASO}_4 \cdot 7\text{H}_2\text{O}$. The arsenic solutions, used in this study with 5,15 and 20 mg/L concentration, were obtained by diluting the stock solution to desired concentration in distilled water. The effects of other parameters including initial pH (3, 7 and 11), arsenic concentration, amount of titanium oxide nanoparticles (0.25, 0.5, 0.75, 1 and 1.5 mg/L) and reaction time were investigated. The batch adsorption experiments conducted for each concentration with different amounts of TiO_2 nano particles. The photocatalytic reaction then undertaken by switching on UV lamp. All the experiments were done by maintaining one factor constant and changing other parameters. Samples then centrifuged (4000 rpm) and the amount of arsenic was detected by Hatch arsenic kits (Product #2822800) which its validity was approved previously (Edwards et al., 1998).The solutions pH was controlled by addition of NaOH or HCl. The pH of solution was measured using pH meter (Metrohm E520).

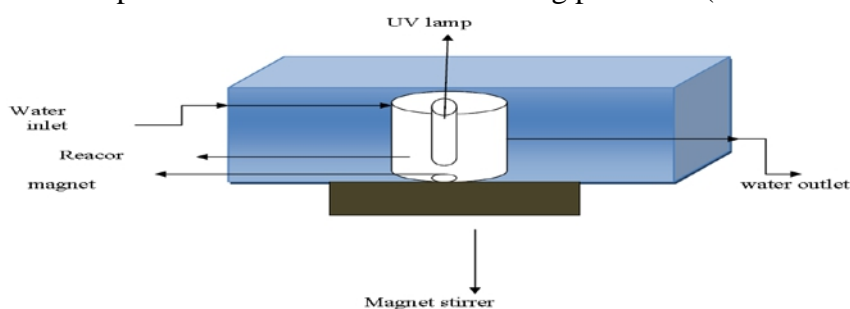


Fig 2. Schematic representation of photocatalytic reactor

Results and discussion

Effects of initial TiO_2 concentration and adsorption time

The effects of different initial TiO_2 nanoparticles on arsenic removal were investigated at arsenic initial concentration of 15 mg/L and pH 7. The results obtained were shown in Fig 3. As shown in figure 3 as the adsorbent concentrations increased, arsenic removal enhanced. The initial sharp rise within 20 min of adsorption indicates the availability of readily accessible sites for adsorption. However, after 25 min a plateau is reached, indicating virtually no more sites remain available for further arsenic adsorption. Moreover, Arsenic removal increased from 35% to 68% when TiO_2 nanoparticles concentration increased from 0.25 to 1 mg/L. No hefty removal in arsenic observed when adsorbent dosage increased to 1.5 mg/L. Therefore, This value was chosen for the conduction of photocatalytic experiments.




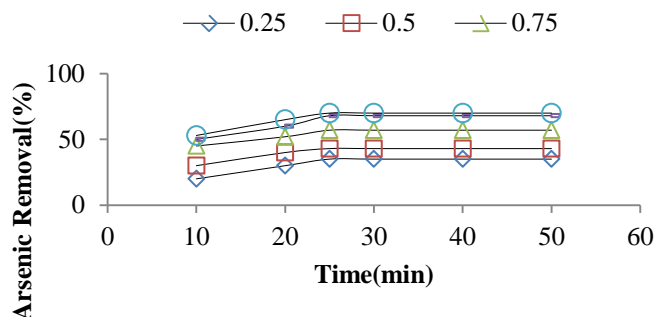


Fig 3. Effects of TiO_2 concentrations on arsenic adsorption

Effects of initial pH in photocatalytic reaction

The effects of various pH were investigated and the results are shown in Fig 4. The experiment conducted with arsenic initial concentration of 15 mg/L and 1 mg/L of TiO₂ nanoparticles. As shown in Fig 4 maximum removal of arsenic (95%) was observed in pH 11. In pH=3 removal efficiencies decreased. The following shows Arsenic Photocatalytic oxidation with TiO₂(Aceituno et al., 2002).



The zero charge point for TiO₂ particles depending on their anatase form varies from 5 to 7. If the mentioned pH is higher or lower, the TiO₂ surface charge becomes negative and positive, respectively. As a result, TiO₂ surface in basic conditions has negative charge and arsenic adsorption on the negative surface of TiO₂ is easier in basic pH. Decreasing pH gradually increases the electrostatic repulsion between TiO₂ surface and arsenic, which is positively charged at pH below 5 (Hidaka et al., 2004).

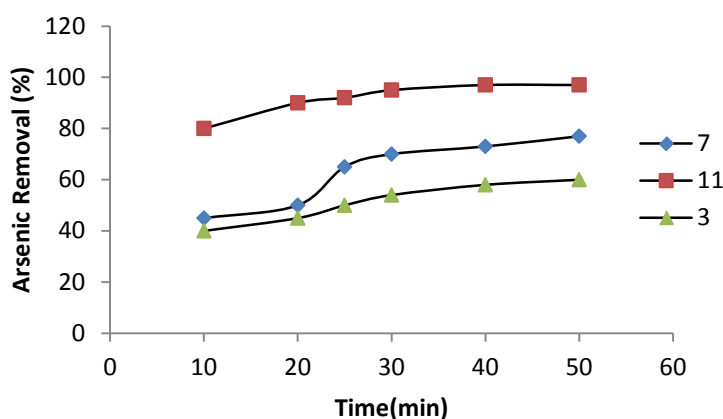


Fig 4. Effect of pH in photocatalytic reaction

Effects of initial arsenic concentration

The effects of initial arsenic concentration of its removal in pH 11 is shown in Fig5. It is shown that initial arsenic concentration strongly affected its removal. The removal observed decreased as initial arsenic concentration gradually increased from 5 to 20 mg/L. When the amount of arsenic is small the photogenerated electrons efficiently transfer to TiO₂, as the result better separation of electrons and holes would be achieved. These electrons could react with adsorbed oxygen molecular or surface Ti⁴⁺ to form reactive species O₂⁰⁻ and reactive center surface Ti³⁺, respectively. This suggested that the recombination was slowed and the generation of O₂⁰⁻ and surface Ti³⁺ was accelerated. In this situation the yield of OH⁰ would also be increased. However higher amount of arsenic lead to its deposition which would cover more TiO₂ surface and hinder the contact between TiO₂ and arsenic, which would increase diffuse distance and decrease the amount of received photons. Furthermore, As the radical densities were equal in all the solutions, a solution with low arsenic concentration with the same hydroxyl radical rate, would have higher transformation rate in comparison to solutions with higher density rates (Lopez et al., 2006).

The obtained results indicate that the UV/TiO₂ process is robust to remove arsenic by 1 mg/L TiO₂ within 25 min. It is also proved in this research that arsenic removal using this

process follows the first order kinetics. Moreover, results showed that arsenic was better in basic pH. Removal enhanced in lower concentration of arsenic as in higher concentration it deposited on UV lamps which subsequently reduced UV penetration on TiO₂ area.

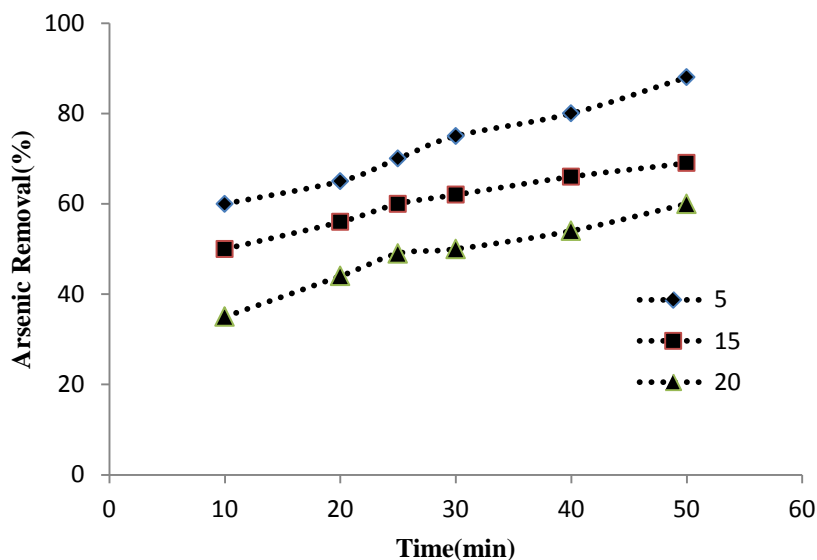


Fig 5. Effect of arsenic initial concentration in photocatalytic reaction

References:

- Aceituno M, Stalikas CD, Lunar L, Rubio S, Pérez-Bendito D. H₂O₂/TiO₂ photocatalytic oxidation of metol, Identification of intermediates and reaction pathways. *Water Res.*2002; 36: 3582-359.
- Awual M, Urata S, Jyo A, Tamada M, Katakai A. Arsenate removal from water by a weak-base anion exchange fibrous adsorbent. *Water Res.* 2008; 42(3): 689-696.
- Baba Y, Ohguma K, Kawano K. Highly selective adsorption resins, Synthesis of chitosan derivatives and their adsorption properties for nitrate anion. *Chem J.* 1999; 7: 471- 472.
- Basu A, Mahata J, Gupta S, Giri AK. Genetic toxicology of a paradoxical human carcinogen, arsenic: a review. *Mutat Res-Rev Mutat.*2010; 488(2): 171-194.
- Bellack E. Arsenic removal from potable water. *J Am Water Works Ass.* 1971; 63(7): 454-458.
- Blssen M, Frimmel FH. Arsenic: a review. Part I: Occurrence, toxicity, speciation, mobility. *Acta Hydroch Hydrob.* 2003; 31(1): 9-18.
- Chen PY, Wilkie JA. Arsenic removal from drinking water during coagulation. *J Enviro Eng.* 1997; 123: 800-805.
- Choong TSY, Chuah TG, Robiah Y, Gregory Koay FL, Azni I. Arsenic toxicity, health hazards and removal techniques from water: an overview. *Desalination.* 2007; 217(1-3):139-166.
- Edwards, M. Patel, S. McNeill, L. Chen, H. Frey, M. Eaton, AD. Antweiler, RC. Taylor, HE. (1998). Considerations in As analysis and speciation. *J Am Water Works Ass,* 90(3), 103-113.
- EPA US. National Primary Drinking Water Regulations; Arsenic and Clarifications to Compliance and New Source Contaminants Monitoring; Final Rule. *Federal Register.*2001; 6: 6976-7066.
- Hidaka H, Koike T, Kurihara T, Serpone N. Dynamics and mechanistic features in the photocatalyzed oxidation of disulfonated anionic surfactants on the surface of UV-irradiated titania nanoparticles. *New J. of Chemistry.* 2004; 28: 1100-1106.
- Lopez JL, Garcia Einshlag FS, Gonzles AL, Cappearelli E, Oliverosos TM, Braun AM.

Hydroxyl radical photodegradation of 4-Chloro-3,5-Dinitrobenzoic acid in aqueous solution. J. Photochem. Photobio. A: Chemistry. 2006; 137: 177-184.

Mandal BK, Suzuki KT. Arsenic round the world: a review. Talanta. 2002; 58(1): 201-235.

Sorg TJ. Treatment technology to meet the interim primary drinking water regulations for inorganics: part 4. J Am Water Works Ass. 1997; 71(8): 454-466.

Waypa JJ, Elimelech M, Hering JG. Arsenic removal by RO and NF membranes. J Am Water Works Ass. 1997; 89(10): 102-114.