


Article

# Performance and Economic Analysis of Concentrated Solar Power Generation for Pakistan

Mujeeb Iqbal Soomro <sup>1,\*</sup>, Abdullah Mengal <sup>2</sup>, Yasir Aftab Memon <sup>1</sup>,  
Muhammad Waris Ali Khan <sup>3</sup>, Qadir Nawaz Shafiq <sup>1</sup> and Nayyar Hussain Mirjat <sup>4</sup>

<sup>1</sup> Department of Mechanical Engineering, Mehran University of Engineering & Technology, SZAB Campus, Khairpur 66020, Pakistan

<sup>2</sup> Department of Mechanical Engineering, Balochistan University of Engineering and Technology, Khuzdar 89100, Pakistan

<sup>3</sup> Faculty of Industrial Management, University Malaysia, Pahang 26300, Malaysia

<sup>4</sup> Department of Electrical Engineering, Mehran University of Engineering & Technology, Jamshoro 76062, Pakistan

\* Correspondence: mujeebsoomro@muetkhp.edu.pk; Tel.: +92-345-3802280

Received: 24 July 2019; Accepted: 26 August 2019; Published: 1 September 2019



**Abstract:** In Pakistan, the utilization of renewable energy sources is increasing in order to reduce the electricity supply and demand gap. However, concentrated solar power (CSP) generation has not been considered in the country even though it has gained considerable attention worldwide. This study, as such, investigates the potential, performance, and economic analyses of four CSP technologies for different locations in Pakistan. Initially, an assessment of CSP sites, including solar resource, land, and water availability, was undertaken. Then, performance simulations of CSP technologies for four different locations of Pakistan, namely Quetta, Hyderabad, Multan, and Peshawar, were examined. For all cases, highest energy production was achieved in summers and lowest in winters, and CSP plants with evaporative cooling were found to be efficient compared to air cooling. The results also revealed that the Quetta and Hyderabad regions were promising for CSP development while parabolic trough (PT) and solar power tower (SPT) were the suitable CSP technologies for these regions. Specifically, the SPT plant with air cooling could be a favorable option for energy production in Quetta. Lastly, economic analyses revealed the financial feasibility of CSP plants in Pakistan since the levelized cost of energy is found to be significantly low.


**Keywords:** concentrated solar power; CSP plants; site assessment; performance analyses; economic analyses; system advisor model; Pakistan

## 1. Introduction

Nowadays, energy in the form of electricity is considered to be an essential component of modern life across the globe. However, many countries of the world are facing severe electricity crises, including Pakistan. In Pakistan, the electricity outage ranges from 8–10 h in an urban area while up to 18 h in rural areas [1]. The reason behind these outages is the gap between demand and supply. The demand for electricity in the country is increasing with the increasing population and urbanization; however, supply is 20%–25% short [2]. The major reason behind a low energy supply is the great dependency on fossil fuels, which are limited and depleting. In Pakistan, 87.3% of the primary energy supply is based on fossil fuels; gas (37.9%) and oil (34.4%) have the highest share in the total primary energy supply by the end of 2016 [3]. However, the energy produced by renewable energy sources (except large hydro) was less than 1% of the energy mix [3]. Although Pakistan is blessed with renewable energy sources such as wind, biomass, and solar, share of renewable energy sources in energy production is almost

negligible. Specifically, an abundant potential of solar energy is available in the country because of its location in the sunbelt. Solar energy can be utilized in two ways: solar photovoltaics (SPV) and concentrated solar power (CSP) [4]. SPV systems are used to convert sunlight directly into electricity whereas CSP systems (also known as solar thermal systems) are used for concentrating and heating a heat transfer fluid (HTF) for a power cycle. In Pakistan, the installation and development of the SPV system is growing [4]. Quaid-e-Azam solar park (QASP), which is the first ever power station in the country consisting of SPV with a capacity of 1000 MW, is under construction [4]. Out of 1000 MW of QASP, 300 MW has been already added to the national grid. Also, several small to large scale projects consisting of solar photovoltaics are under operation and construction [4]. However, CSP systems have not been utilized in Pakistan.

CSP is a promising technology for large scale power production. There are four families of CSP technology including (i) parabolic trough collectors (PTC), (ii) solar power tower (SPT), (iii) linear Fresnel reflects (LFR), and (iv) parabolic dish systems (PDs). There are numerous advantages of CSP, such as renewable, clean, low operating cost, etc. However, one of the issues with CSP is soiling of mirrors, where dirt is accumulated on the mirrors/reflectors. It causes a reduction in the electricity production. The soiling effect can be reduced by proper cleaning/washing of the mirrors [5–7]. The commercialization of CSP is increasing. For instance, the CSP global capacity was 400 MW in 2006, which increased to 4800 MW in 2017 [8]. The global leaders in CSP plants are Spain and the United States, having a power generation capacity of 2300 MW (48%) and 1738 MW (36%), respectively [8]. However, the rest of the world contributes 762 MW (16%), as shown in Figure 1 [8]. The advent of the commercialization era has contributed significantly, increasing the research in CSP systems. Recent research on CSP systems is concerned with site selections, technological evaluations, performance analysis, economic investigations, and developments in the CSP process and materials.

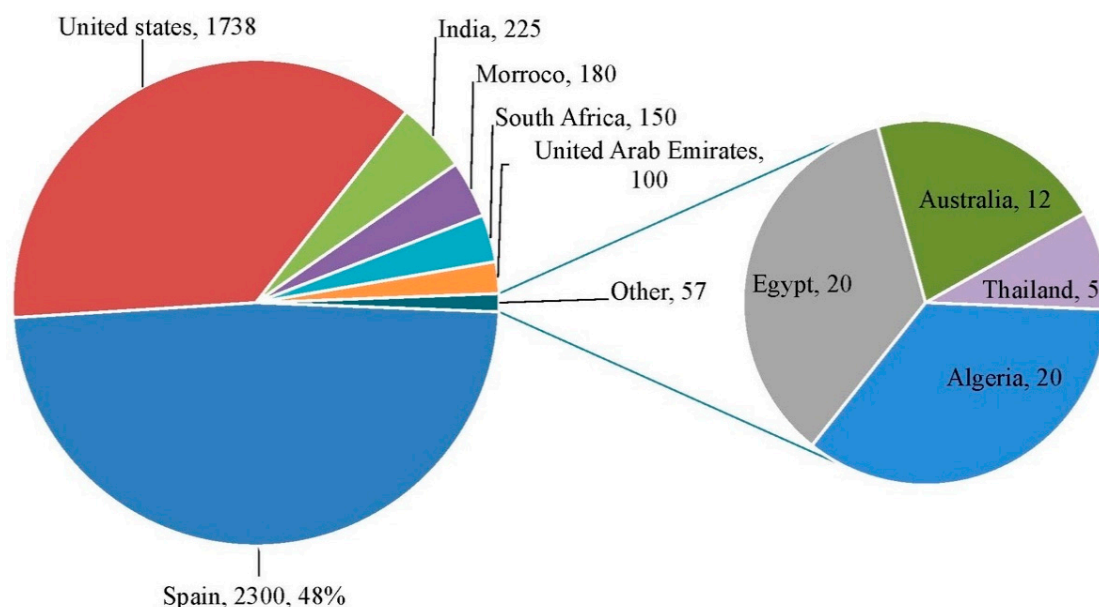

**Figure 1.** Status of concentrated solar power (CSP) plants worldwide.

Several studies have been conducted on the techno-economic evaluation of CSP plants for a different region of the world. Hinkley et al. [9] presented a cost comparison analysis of 100 MWe PT and SPT plants in different areas of Australia using the System Advisor Model (SAM) software. Purohit et al. [10] investigated CSP potential in Northwestern regions of India using SAM, and the evaluation was performed for four CSP technologies. SAM was also utilized by Guzamn et al. [11] for the simulation study of a 50 MWe PT plant in Barranquilla, Colombia. Sundaray and Kandpal [12] evaluated the techno-economic feasibility of a 100 MWe PT plant for different locations in India using SAM. Lemmer [13] performed a techno-economic assessment of PT and PD plants in Morocco. The author

presented a comparison of the two technologies in terms of economic feasibility, and SAM was used for the assessments. Wagner and Rubin [14] presented the effects of thermal energy storage (TES) on the performance and economics of a 110 MWe PT plant operating with and without different backups. The investigation was performed by the authors using SAM. Kasesem et al. [15] conducted a strengths, weaknesses, opportunities, and threats (SWOT) analysis for four CSP technologies in Saudi Arabia using SAM. SAM was also utilized by Praveen et al. [16] for the performance assessment and optimization of a 100 MWe PT plant with TES in Abu Dhabi, United Arab Emirates. Belgasim et al. [17] evaluated the potential of energy generation with a 50 MWe PT plant using SAM in Tajoura, Libya. All of the studies mentioned above have evaluated CSP potential for different countries worldwide using SAM. However, research on CSP potential and techno-economical investigations for Pakistan are rarely reported.

The current research is an attempt to investigate potential, performance, and economics of CSP generation in Pakistan. The investigations have been carried out for different locations in Pakistan, considering all CSP technologies. The performance and economic evaluations of CSP plants have been carried out utilizing SAM software. It is pertinent to mention that there are only a few other tools used for the analysis of CSP plants; however, as reported above, SAM is widely used for the analysis of CSP plants developed by national renewable energy laboratory (NREL) and that its licensing and support is quite reassuring. This paper is structured as follows. Section 2 presents an overview of CSP technologies. Section 3 provides an assessment of CSP sites in the country. Performance analysis is presented in Section 4, while Section 5 describes economic evaluation. Finally, Section 6 concludes the paper.

## 2. Overview of CSP Technologies

CSP is an extensive commercial method for electricity generation using solar energy. CSP is appropriate for the regions where the direct solar radiation and the number of sunshine hours are high. Generally, a CSP plant comprises of a solar field, TES system, and power block, as shown in Figure 2. The solar field concentrates the solar radiation onto a specific point or line to heat an HTF. The heated HTFs can be used directly or indirectly [17]. In the direct case, water is used as HTF for direct steam generations; whereas in the indirect case, different HTFs such as synthetic oil, molten salt, and Therminol VP-1 are used to heat water for a steam generation [17]. Although direct HTF is cheaper, commercial storage for steam is lacking. On the other hand, indirect HTFs are expensive, but they can be stored. Thus, indirect HTFs are widely used in CSP plants worldwide [15]. The heated HTF from the solar field flows into the TES system where additional energy is stored for continuous operation. Consequently, the HTF is used to produce steam in the steam generator, and the steam is used to drive the power unit to produce electricity. There are four main families of CSP technology which are classified by the approach how solar radiation is focused and received, as listed in Table 1 [18]. Fixed receivers remain, static independent of the focusing device, while mobile receivers move together with it. Besides, line focusing receivers concentrate the solar radiation onto a specific line while the solar radiation is focused onto a specific point in a point focusing receivers. Detailed overview of each CSP technology is presented in the following sections.

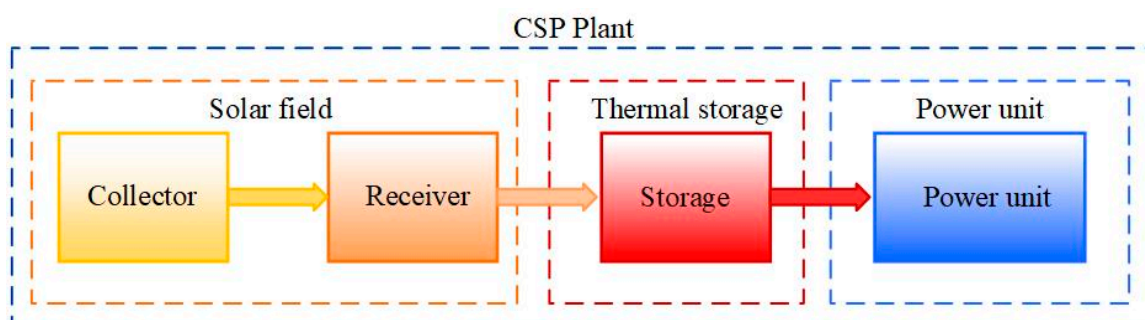



Figure 2. Principle of operation of a CSP plant.

**Table 1.** Classification of CSP technologies [18–20].

Type of Receiver	Type of Focus	
	Line Focusing	Point Focusing
Fixed	Linear Fresnel reflectors (LFR)	Solar power tower (SPT)
Mobile	Parabolic troughs (PT)	Parabolic dishes (PD)

### 2.1. Parabolic Trough Systems

Parabolic trough (PT) systems are the most mature technologies used for CSP generation [15,17,20,21]. This is the reason that the PT plants are widely commercialized compared to other configurations of CSP [15]. Figure 3 illustrates a schematic diagram of a PT system. The PT system consists of an array of parabolically curved mirrors/collectors and receivers. The collectors concentrate the solar radiation on the receivers which are filled with the HTF. The heated HTF is directed to the power unit for energy production via thermal storage. Generally, PT collectors consist of a single-axis tracking system to follow the solar radiation from east to west. The single tracking system leads to the reduction of material demand and land use factors. This is the reason that the initial cost of the PT plant is lower than dual tracking systems [15]. Generally, the power block in a CSP plant uses a Rankine cycle consisting of a boiler/steam generator to produce electricity. Therefore, CSP plants have the flexibility to integrate with conventional power plants [15]. Further characteristics of PT systems are summarized in Table 2.

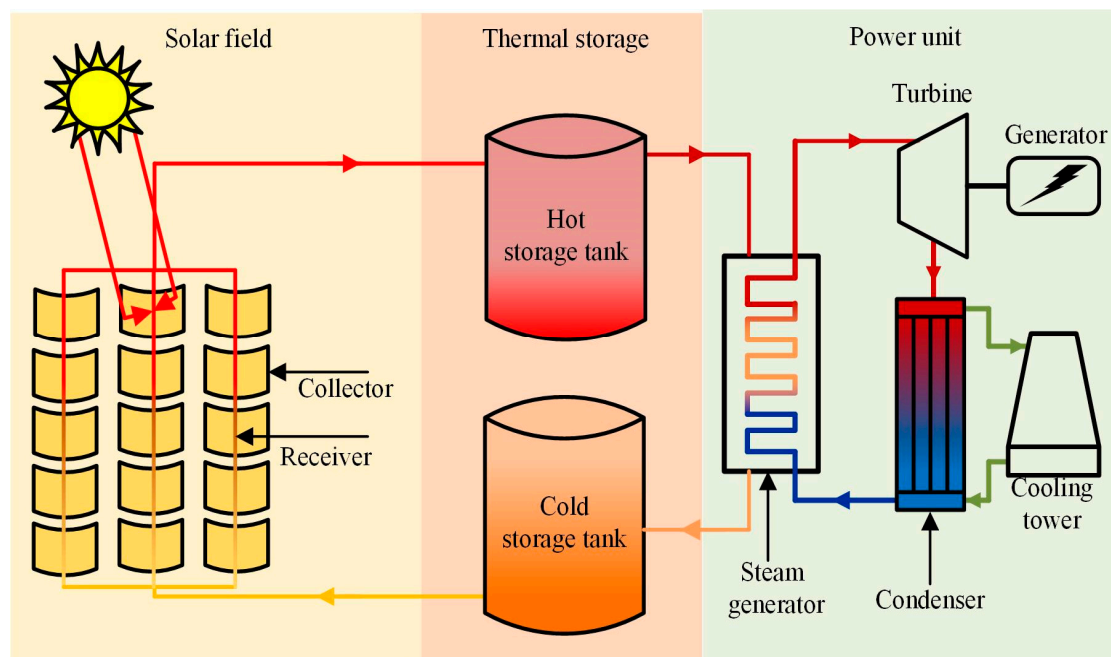**Figure 3.** A schematic diagram of a parabolic trough (PT) system.**Table 2.** Characteristics of CSP technologies [10,17,18,21–24].

Characteristic	Unit	Parabolic Trough Collectors	Solar Power Tower	Linear Fresnel Reflectors	Parabolic Dish
Plant capacity	MW	30–300	100–200	1–100	5–25
Capacity factor	%	23–56	20–78	20–25	24–25
Tracking system	-	Single-axis	Two-axis	Single-axis	Two-axis
Cycle temperature (maximum)	°C	300–400	585	150–500	800

Table 2. Cont.

Characteristic	Unit	Parabolic Trough Collectors	Solar Power Tower	Linear Fresnel Reflectors	Parabolic Dish
Concentration ratio	-	70–80	300–1000	25–100	1000–3000
Optical efficiency	%	80	73	65–75	94
Peak efficiency	%	20	19–23	10	29.4
Annual net Efficiency (solar to electric)	%	15	25–35	8–10	25–30
Cycle	-	Rankine	Rankine/Brayton	Rankine	Sterling/Rankine/Brayton
TES system	H	1–12	7–15	1–12	NA
Land occupancy	m <sup>2</sup> /MW	40,000	83,600	18,000	16,000
Cooling method	-	Closed circuit	Closed circuit	Closed circuit	Direct
Evaporative Cooling water requirements	m <sup>3</sup> /MWh	3.0	2.0–3.0	3.0	0
Dry Cooling water requirements	m <sup>3</sup> /MWh	0.3	0.25	0.2	0
Applications	-	On-grid	On-grid	On-grid	On-grid/ Off-grid
Commercialization	-	High	Medium	Medium	Low
Capital cost	\$/kW	3972	>4000	-	12,578
Capital cost	\$/m <sup>2</sup>	424	476	234	-
Outlooks for improvement	-	Limited	Very Significant	Significant	High


### 2.2. Solar Power Tower System

The solar power tower (SPT) system (also known as the central receiver system) is a type of point focusing system which consists of a number of circular two-axis tracking arrays. An array consists of numerous flat or slightly curved mirrors known as heliostats. The heliostats concentrate the solar radiation on a fixed point, which is a central receiver on top of a tower. The HTF is heated in the tower and then the HTF is directed to power block for energy production. A schematic diagram of the SPT system is presented in Figure 4. The concentration ratio of SPT ranges from 300–1000, which leads to higher working temperatures [17,18,22,23]. This is the reason that the SPT plant has higher efficiency (20%–35%) compared to other CSP configurations [17,18,22,23]. However, due to dual tracking and relatively large land requirements, the initial/capital cost of the SPT plants is high. Nevertheless, numerous SPT plants are commercially demonstrated including the world's largest CSP plant (Ivanpah) with a capacity of 392 MW in California, United States of America. It is important to mention that SPT systems continued to dominate the CSP market after PT systems [8]. Further characteristics of SPT systems are presented in Table 2.


### 2.3. Linear Fresnel Reflector System

A linear Fresnel reflector (LFR) system consists of an array of mirrors which concentrates the solar radiation on a fixed central receiver mounted on the top, as depicted in Figure 5. Generally, LFR systems are considered a modified form of PT. The LFR systems are well known for their simplicity. LFR systems have almost flat or slightly concaved mirrors. In LFR systems, the receiver is separated from reflectors unlike in PT systems, thus reducing material demand and need of high pressure rotating components. In addition, the land use factor is also lowest for LFR systems. The simplicity of the mirrors, lowest material demand, and lowest land use factor leads to the reduction of the cost of the LFR system [17]. However, the simplicity of the mirrors leads to low optical efficiency. This could be

the reason that a few large scale LFR plants are installed worldwide. Further characteristics of LFR systems are summarized in Table 2.

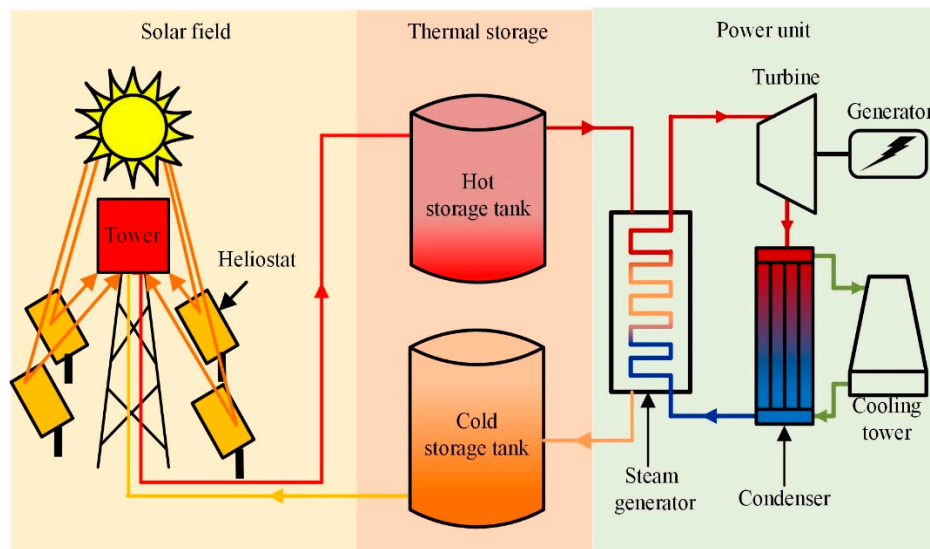


**Figure 4.** A schematic diagram of a solar power tower (SPT) system.

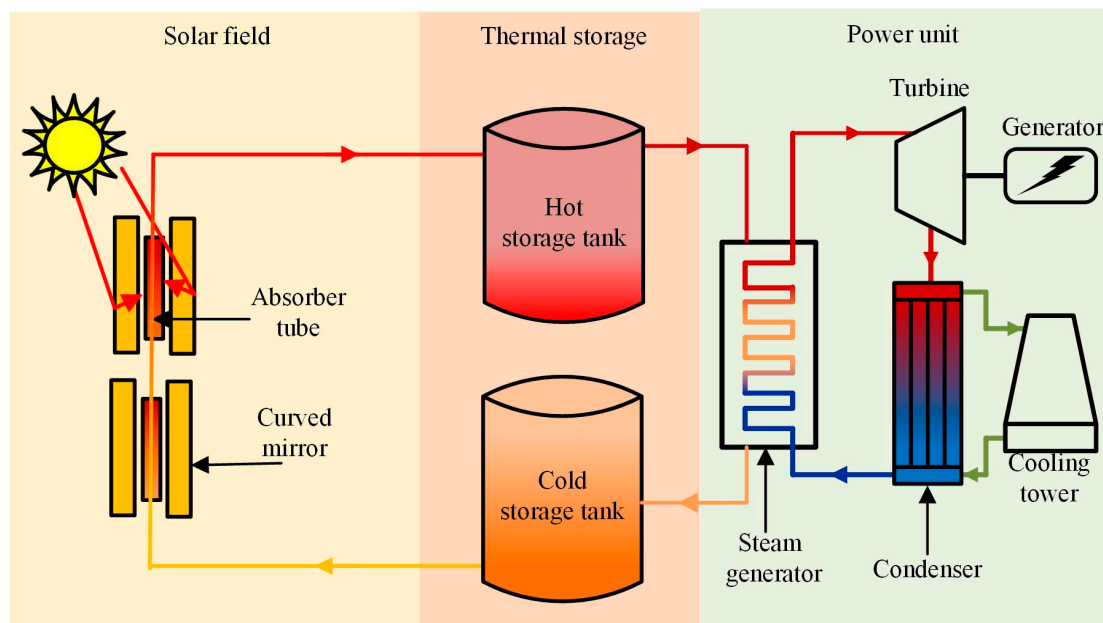

**Figure 5.** A schematic diagram of a linear Fresnel reflector (LFR) system.

#### 2.4. Parabolic Dish System

The parabolic dish (PD) system is a two-axis point focused system which concentrates the solar radiation on a focal point of the dish, as shown in Figure 6. The focal point/receiver is filled with HTF. Generally, fluid or gas is used as HTF in parabolic dish systems. HTF systems are generally heated up to 1000 °C due to highest concentration ratio of the PD systems. Then, the HTF is directed to either the Stirling engine or gas turbine which convert the thermal energy of the fluid to electrical energy. Highest concentration ratio and optical efficiency result in higher energy production and low cost. However, the limited size of the PD systems limits the installation of large plants. Moreover, most of the existing PD plants are off-grid, and their capital cost is high [15,17]. This is the reason that PD systems are rarely commercialized. A summary of the characteristics of PD systems is presented in Table 2.

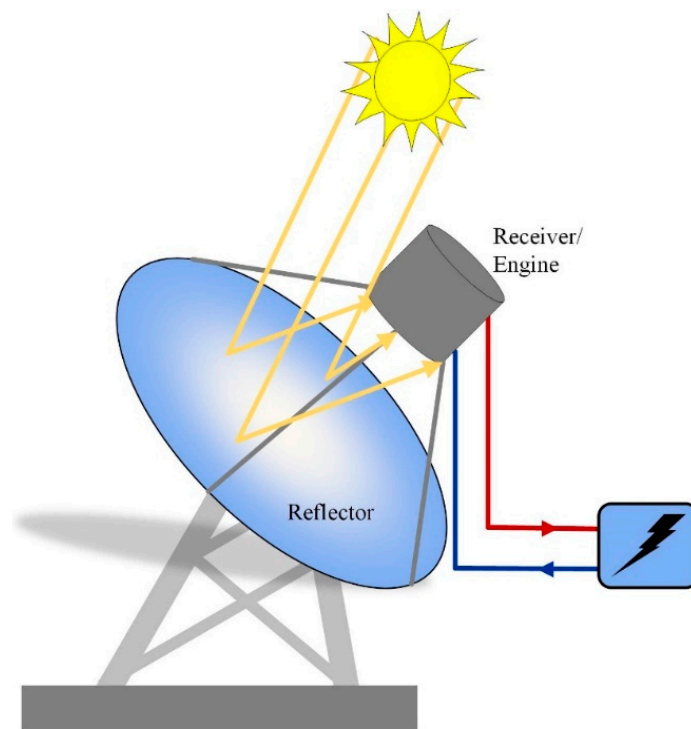

**Figure 6.** A schematic diagram of the parabolic dish (PD) system.

### 3. Assessment of CSP Sites in Pakistan

There are several technical parameters which should be considered for the site selection of a CSP plant. Specifically, solar energy potential, land, and water availability should be cautiously considered while designing a CSP plant. Therefore, this section presents an overview of solar resources, land, and water availability in Pakistan.

#### 3.1. Solar Resource Availability

Pakistan is situated between latitude  $30.3753^{\circ}$  N and longitude  $69.3451^{\circ}$  E. Pakistan is divided into four provinces and four federal administered territories, as shown in Figure 7 [22]. The provinces are named Khyber–Pakhtunkhwa (KPK), Punjab, Sindh, and Baluchistan. Providentially, Pakistan is located in the sunbelt, which means that the potential of solar energy in the country is high with long sun shining hours. The distribution map of average annual global horizontal irradiation (GHI) and direct normal irradiation (DNI) across Pakistan is presented in Figures 8 and 9, respectively [25]. In Figure 8, it can be seen that the average GHI is  $1800 \text{ kWh/m}^2$  in northern regions (KPK and northern parts of Punjab province), and  $2100 \text{ kWh/m}^2$  in southern regions (Sindh province). However, the highest average GHI is over  $2200 \text{ kWh/m}^2$  in the western region, i.e., Baluchistan province. On the other hand, the average DNI is  $1300 \text{ kWh/m}^2$  in the northern region, and it is  $1700 \text{ kWh/m}^2$  in southern regions. However, the highest average DNI is over  $2100 \text{ kWh/m}^2$  in the western region. Generally, CSP plants are considered economically feasible for the locations with DNI above  $1800 \text{ kWh/m}^2/\text{year}$  [17]. Based on this fact, the western region (Baluchistan province) and most of the parts in the southern region (Sindh and few parts of Punjab province) of Pakistan are very promising for electricity production using CSP plants. Specifically, Quetta region and Kharan Desert in Baluchistan province, Hyderabad region and the Thar Desert in Sindh province, and Bahawalpur region and the Cholistan Desert in Punjab province are favorable places for CSP plants. However, soiling of mirrors could be a major issue in desert and arid regions.

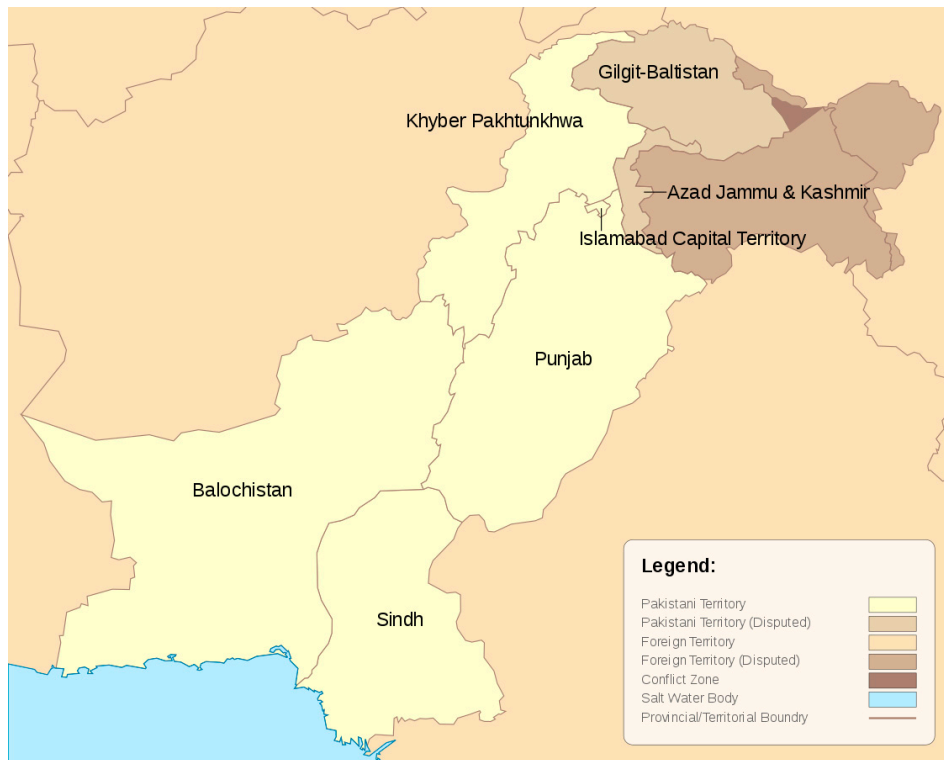


Figure 7. Pakistan map.


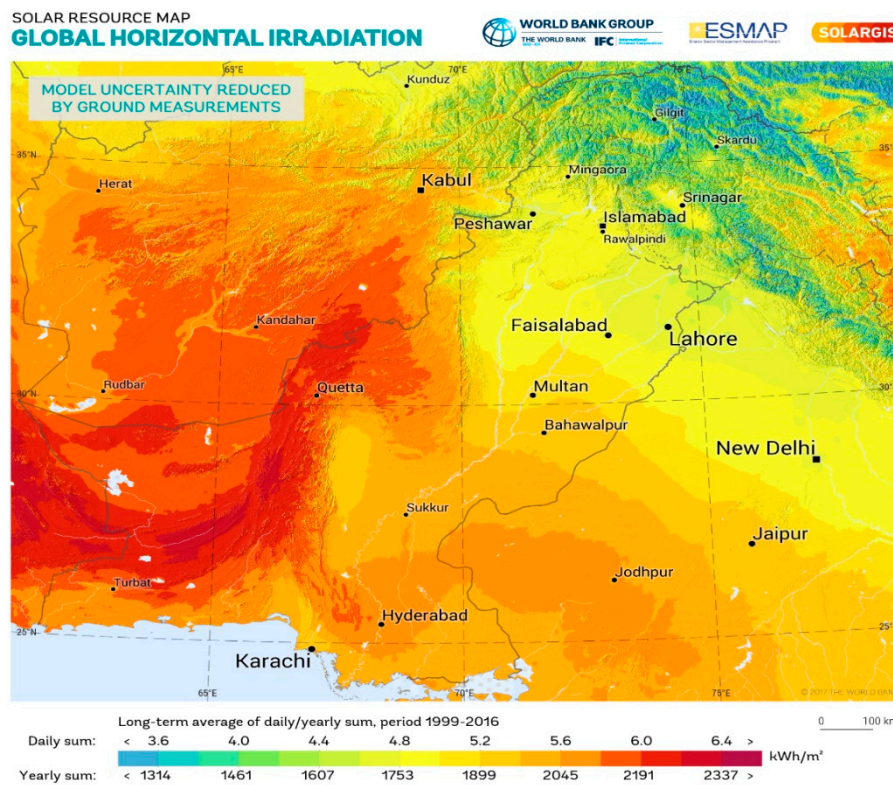


Figure 8. Annual global horizontal irradiation (GHI) in Pakistan.



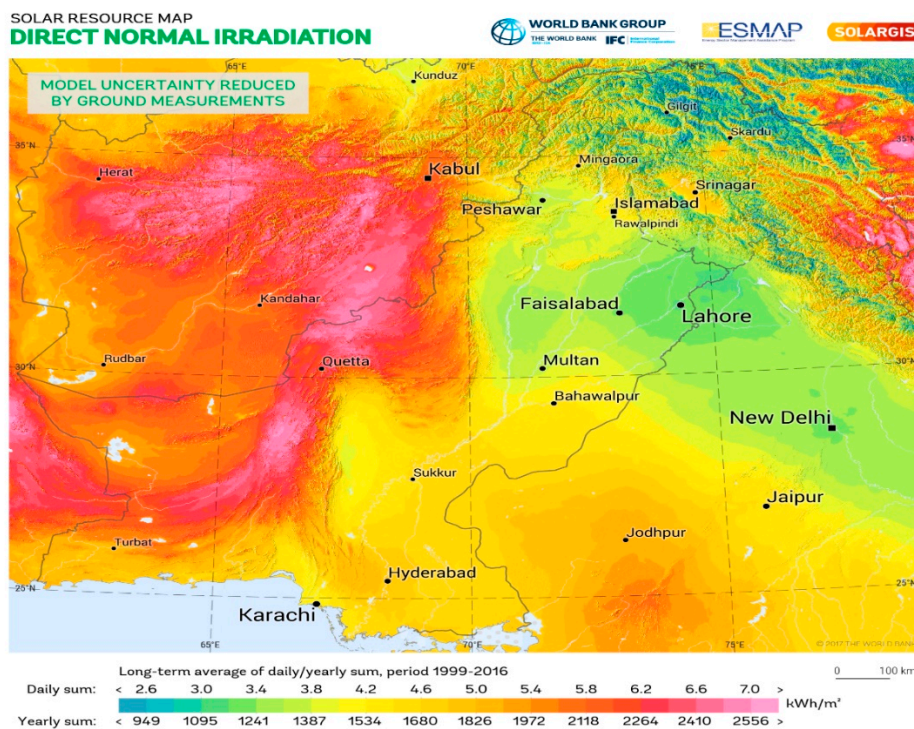

**Figure 9.** Annual direct normal irradiation (DNI) in Pakistan.

### 3.2. Land Availability

In addition to the potential of solar energy, site selection based on land availability is an important activity related to planning and designing a CSP plant. Land occupancy of CSP technologies varies from 16,000 to 83,600 m<sup>2</sup>/MW depending on configurations [10]. For instance, the land occupancy of a PT plant is 40,000 m<sup>2</sup>/MW [10]. Therefore, a large area is required for a CSP plant. It is important to note that high agricultural and residential areas should be avoided for the installation of a CSP plant [17]. Thus, remote and deserted areas represent the most suitable sites for CSP development [17]. However, essential infrastructure, such as accessibility and connectivity, should also be considered.

Geographically, Pakistan is divided into three areas: the Northern Highlands (KPK and northern parts of Punjab province); Baluchistan plateau (Baluchistan province in the west region); and Indus River plain (consists of Sindh province and major subdivisions of Punjab province) [26]. A topographical map of Pakistan is shown in Figure 10 [25]. As shown, northern highlands consist of mountains hence large flat land in that region is rare. However, the Indus River plain consists of mostly flat land. Major areas in the Indus River plain include Karachi, Hyderabad, Thar Desert, Sukkur, Bahawalpur, Cholistan Desert, and Multan. Thus, most of the Indus River plain is suitable for CSP development.

On the other hand, the Baluchistan plateau consists of upper highlands, lower highlands, plains, and deserts. The upper and lower highlands comprise of higher and lower mountains, which may not be suitable for CSP plants. However, plains and deserts such as the Kharan desert have flat areas which could be suitable for CSP development. It can be concluded that most of the areas with higher potential of solar energy such as the Indus River plain and Baluchistan plateau have flat land availability. Thus, it would not be a significant restriction for the establishment of CSP plants in Pakistan.

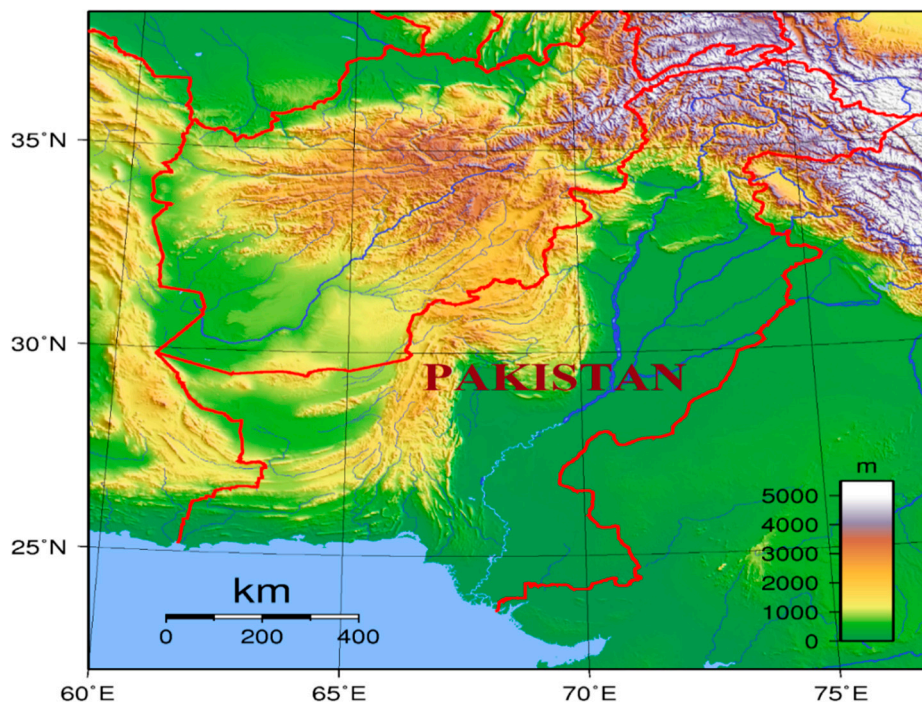


Figure 10. Topographical map of Pakistan.

### 3.3. Water Availability

Water availability is an essential parameter for the operation of either a conventional or CSP plant. Generally, water is required to fulfill three purposes in a CSP power plant: (i) steam generation for power block cycle, (ii) cooling the power cycle, and (iii) mirror washing to reduce soiling effect. Water requirements of CSP plants ranged from 3.0–3.5 m<sup>3</sup>/MWh [17]. However, almost 95% of water is used for cooling whereas the remaining is used for mirrors washing and as working fluid [17]. Water cooling (also known as wet or evaporative cooling) is an efficient cooling technology. Water cooling technology is usually employed at the region which has abundant water sources. On the other hand, dry cooling (also known as air cooling) can be employed in arid region or regions where water availability is not adequate. Although dry cooling increases the capital cost, it reduces the efficiency of the plant, and increases the levelized cost of energy (LCOE) [15,17]. Nevertheless, it can be employed to run the plants in an arid region and produce energy.

Rivers are the major source of water in Pakistan. A map of rivers and lakes in Pakistan is presented in Figure 11 [27]. It is important to mention here that most of the existing conventional power plants in Pakistan are located near rivers, specifically the Indus River. It can be seen in Figure 11 that Pakistan has uneven water distribution. The Indus River plain (Sindh and Punjab province) have a wide network of rivers which makes this region most suitable for power plants with wet cooling. On the other hand, the Baluchistan plateau does not have many networks of rivers except for a few areas. Thus, the CSP plant with dry cooling could be a better option.



Figure 11. Rivers in Pakistan.

#### 4. Simulations of CSP Plants in Pakistan

The performance analysis of CSP plants at typical climate conditions in Pakistan have been presented in this study. Based on the potential of solar energy, land, and water availability, four locations from four provinces of Pakistan were selected for the proposed study. The sites selected for the proposed work are as follows:

(i) Quetta (Province: Baluchistan; Region: Baluchistan Plateau)

This region has the abundant potential of solar energy, and flat land availability is not a concern specifically in plains and deserts. However, water availability is a major issue in the region.

(ii) Hyderabad (Province: Sindh; Region: Indus River plain)

The region has a good potential of solar energy, and availability of flat land and water is not an issue in the region since it is a part of Indus River plain.

(iii) Multan (Province: Punjab; Region: Indus River plain)

The region has a fair potential of solar energy, and availability of flat land and water is not an issue in the region.

(iv) Peshawar (Province: Khyber Pakhtunkhwa; Region: Northland highland)


Solar energy availability is not high and flat land is rare in the region. However, water scarcity is not an issue in the region. Therefore, the purpose of selecting Peshawar is to evaluate the CSP generation potential in KPK province and northland highlands region.

The performance of a CSP plant is highly affected by meteorological conditions such as solar radiation, ambient temperature, wind speed, relative humidity, soiling, sunshape, and atmospheric extinction. The average meteorological conditions of the proposed locations are listed in Table 3 [28].

**Table 3.** The average meteorological conditions of the proposed locations.

	Air Temperature	Relative Humidity	Wind Speed	Daily Solar Radiation–Horizontal	Annual Solar Radiation–Horizontal	Yearly Sun-Shine hrs.
	°C	%	m/s	KWh/m <sup>2</sup> /day	KWh/m <sup>2</sup> /year	Hrs
Quetta	18	33.7	4.5	5.46	1992.9	3341.25
Hyderabad	26.5	43.4	3.5	5.27	1923.55	3328.7
Multan	25.3	39.4	3.3	5.09	1857.85	3097.6
Peshawar	22.7	44.3	5.0	5.16	1883.4	2887

Specifically, DNI is the most important parameters affecting the performance of a CSP plant. The meteorological data of the proposed location in a typical meteorological year (.TMY) format was obtained from the national renewable energy laboratory (NREL) database [29]. The DNI of the proposed locations is presented in Figure 12 [29].

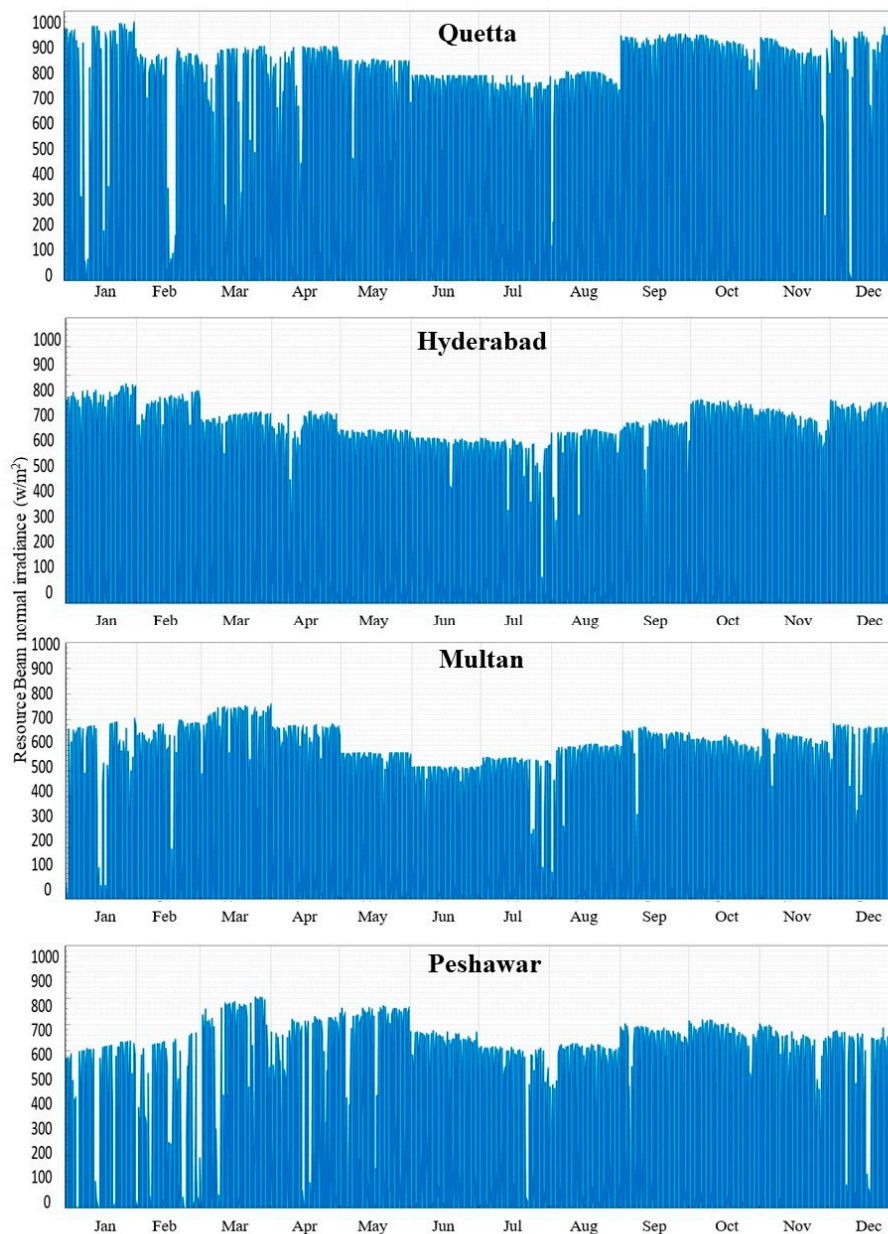**Figure 12.** DNI of the proposed locations.

#### 4.1. Simulation Results of the Proposed 50 MWe PT Plant

In this section, the system description and performance evaluation of the 50 MWe PT plant for four locations in Pakistan, which include Quetta, Hyderabad, Multan, and Peshawar are presented. The reason for considering the 50 MWe PT plant is that most of the commercial PT plants are operating under the same capacity [17]. The performance simulations of all CSP plants have been carried out using SAM software. SAM software is developed and provided by the NREL, which is operated by the Alliance for Sustainable Energy, for the United States (U.S.) Department of Energy (DOE) and may be used for any purpose whatsoever [28]. SAM can be used to simulate the techno-economic evaluations of different renewable energy sources, including CSP technologies [28]. Numerous studies have been conducted on CSP technologies using SAM [14,15,17,30,31]. The technical assumptions considered for the simulations of the 50 MWe PT plant are presented in Table 4.

Firstly, simulations were carried for the proposed PT plant with evaporative cooling. Simulation results for monthly electric power produced by the 50 MWe PT plant for all locations is depicted in Figure 13. It can be observed that maximum electricity production is obtained in summers whereas minimum in winters for all cases. It is attributed to higher solar radiation in summers, which leads to increased thermal energy and consequently increased electricity production, and vice versa for winters. Although hourly highest solar radiation is observed in winter for all cases, monthly highest DNI is not obtained in winters. The reason is inconsistency of solar radiation which is due to sunshape, atmospheric extinction, and soiling. On the other hand, the consistency of solar radiation can be seen for summer which leads to the highest monthly DNI. The higher monthly DNI leads to higher electricity production.

Specifically, it can be observed that monthly electricity production in Quetta is highest compared to other cities, followed by Hyderabad, Peshawar, and Multan. This is because of the potential of solar radiation in the region which highly affects electricity production. In addition, other annual performance parameters of the simulation are presented in Table 5. It was found that maximum annual energy production, gross-to-net-conversion, and capacity factor contributed to Quetta and Hyderabad. Therefore, the performance of the PT plant is promising in Pakistan, specifically Quetta and Hyderabad. In addition, cooling water requirements increased with increased energy production, as listed in Table 5. For instance, the highest energy production in Quetta leads to highest cooling water demand. Since the supply of cooling water could be an issue in regions such as Quetta, the simulations have been carried out with a dry/air-cooling system to investigate the effect on system performance.

**Table 4.** Design characteristics and specifications of the 50 MWe PT plant.

Description	Technical Parameter	Value
Solar field parameters	Solar multiple	2
	Row spacing	15
	Number of field subsections	2
Heat transfer fluid	Field HTF	Therminol VP-1
	Field HTF min operating temperature	12 °C
	Field HTF max operating temperature	400 °C
Solar field design point	Single loop aperture	3762.4
	Number of loops	104
	Total aperture reflective area	391,290 m <sup>2</sup>
	Total land area	1,643,000 m <sup>2</sup>
Collectors	Collector type	Solargenix SGX-1
	Reflective aperture area per solar collector assembly	470.3 m <sup>2</sup>
	Aperture Width	5 m
	Length of the collector assembly	100 m
	Number of modules per assembly	12
	Mirror reflectance	0.935
	Length of a single module	8.33 m
Receivers	Receiver type	Schott PTR70 2008

Table 4. Cont.

Description	Technical Parameter	Value
	Absorber tube inner diameter	0.066 m
	Absorber tube outer diameter	0.07 m
	Glass envelope inner diameter	0.115 m
	Glass envelope outer diameter	0.12 m
	Absorber material type	304 L
Power cycle	Design gross output	50 MW <sub>e</sub>
	Estimated gross-to-net conversion factor	0.9
	Estimated net output at design	45 MW <sub>e</sub>
	Rated cycle conversion efficiency	0.3774
	Boiler operating pressure	100 bar
	Design loop outlet temperature	391 °C
	Design loop inlet temperature	293 °C
	Condenser type	Evaporative/Air cooled
	Reference condenser water dT	10 °C
Thermal storage	Full load hours of TES	12 h
	Storage volume	21,504.1 m <sup>3</sup>
	Storage HTF fluid	Hitec Solar salt
	Tank diameter	36.99 m
	Tank loss coefficient	0.43 W/m <sup>2</sup> .K
	Storage type	Two tank
Mirror washing	Water usage per wash	0.7 L/m <sup>2</sup> , aper.
	Washes per year	63

The simulation results for monthly electricity production with air cooling for all regions are presented in Figure 14. Comparing Figures 13 and 14, it was found that electricity production reduced considerably. For instance, maximum electricity production was 17.848 GWh in September with evaporative cooling, which reduced to 15.75 GWh with air cooling in Quetta. Other performance parameters of the simulations with the air cooling system are presented in Table 6. Comparing Tables 5 and 6, it can be seen that annual energy production, gross-to-net-conversion, and capacity factor also reduced. For example, annual energy production, gross-to-net-conversion, and capacity factor were 148.59 GWh, 94.4%, 37.7%, respectively, with evaporative cooling in Quetta which reduced to 133.253 GWh, 90.2%, 33.8%, respectively, with air cooling. Nevertheless, electricity production through the PT plant with air cooling is still promising, especially in Quetta and Hyderabad.

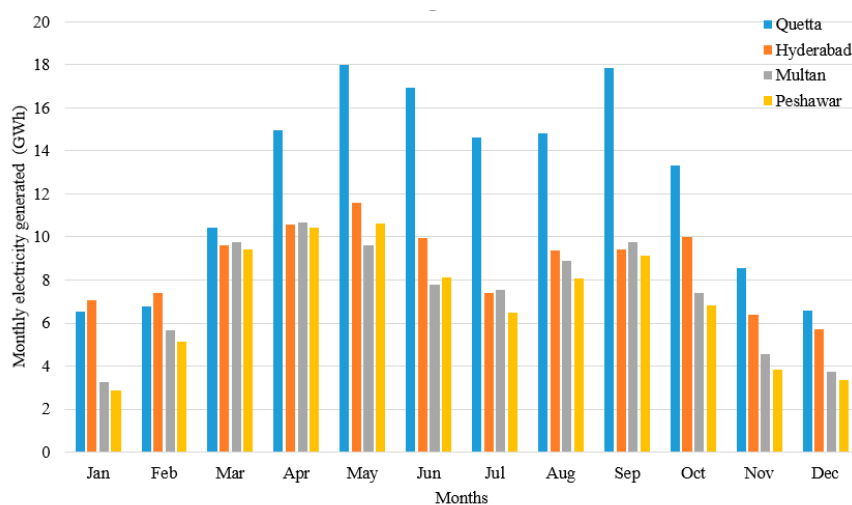
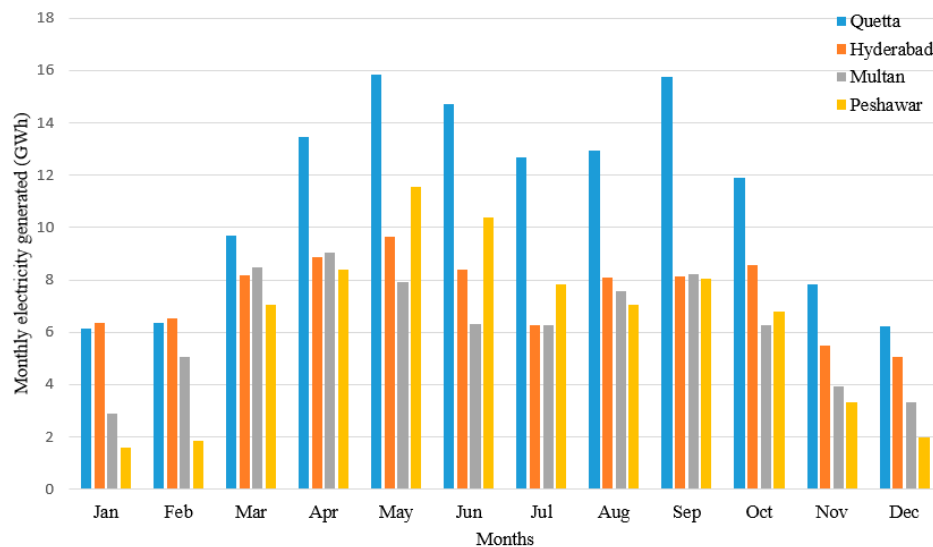


Figure 13. Electricity production by the 50 MWe PT plant with evaporative cooling for different regions.

**Table 5.** Performance parameters of the 50 MWe PT plant with evaporative cooling.

Parameters	Unit	Quetta	Hyderabad	Multan	Peshawar
Annual electricity generated	GWh	148.59	104.46	88.71	84.19
Gross-to-net conversion	%	94.4	94.6	93.3	92.1
Capacity factor	%	37.7	26.5	22.2	21.4
Cooling water requirements	m <sup>3</sup> /year	503,951	364,530	305,059	318,679


**Figure 14.** Electricity production by the 50 MWe PT plant with dry cooling for different regions.**Table 6.** Performance parameters of the 50 MWe PT plant with air cooling.

Parameters	Unit	Quetta	Hyderabad	Multan	Peshawar
Annual electricity generated	GWh	133.253	89.54	70.98	75.83
Gross-to-net conversion	%	90.2	89.1	87	86.8
Capacity factor	%	33.8	22.7	18	19.2
Cooling water requirements	m <sup>3</sup> /year	32,601	28,130	26,242	26,713

#### 4.2. Simulation Results of the Proposed 50 MWe SPT Plant

This section presents the system description and performance evaluation of the 50 MWe SPT plant in Pakistan. The technical assumptions of the 50 MWe SPT plant for simulations are summarized in Table 7, and 50 MWe SPT plant's heliostat field is presented in Figure 15. For the SPT plant, the simulations were carried for both the evaporative cooling and air cooling. Firstly, the simulation results of the 50 MWe SPT plant with evaporative cooling for four locations in Pakistan are shown in Figure 16. A similar trend can be observed for maximum electricity production in summers, whereas minimum in winters, as discussed in Section 4.1. Also, the highest monthly electricity production was achieved in Quetta. Also, Table 8 presents the annual performance parameters of the 50 MWe SPT plant with evaporative cooling. It was found that the maximum annual energy production, gross-to-net-conversion, and capacity factor contributed to Quetta followed by Hyderabad, Peshawar, and Multan. Moreover, 50 MWe SPT simulations have been carried out with air cooling, and the monthly electricity production is illustrated in Figure 17. With air cooling, highest electricity production was also obtained in Quetta followed by Hyderabad, Peshawar, and Multan. However, comparing the simulation results of the 50 MWe SPT plant with evaporative and air cooling, the electricity generation dropped significantly for all locations. The annual performance of the 50 MWe SPT plant with air cooling is reported in Table 9. Comparing Tables 8 and 9, it can be noticed that the annual energy production, gross-to-net-conversion, and capacity factor also reduced. For example, annual energy

production, gross-to-net-conversion, and capacity factor with evaporative cooling in Quetta were 233.23 GWh, 95.8%, 57.6%, respectively, which reduced to 209.80 GWh, 89.98%, 53.2%, respectively, with air cooling. Nonetheless, comparing the simulation results of the PT and SPT plant, the SPT plant shows better performance in terms of monthly electricity production and annual performance parameters. The reason behind this is the higher concentration ratio and higher efficiency. Furthermore, it is important to note that cooling water requirements of the SPT plant are lower than the PT plant for all locations.

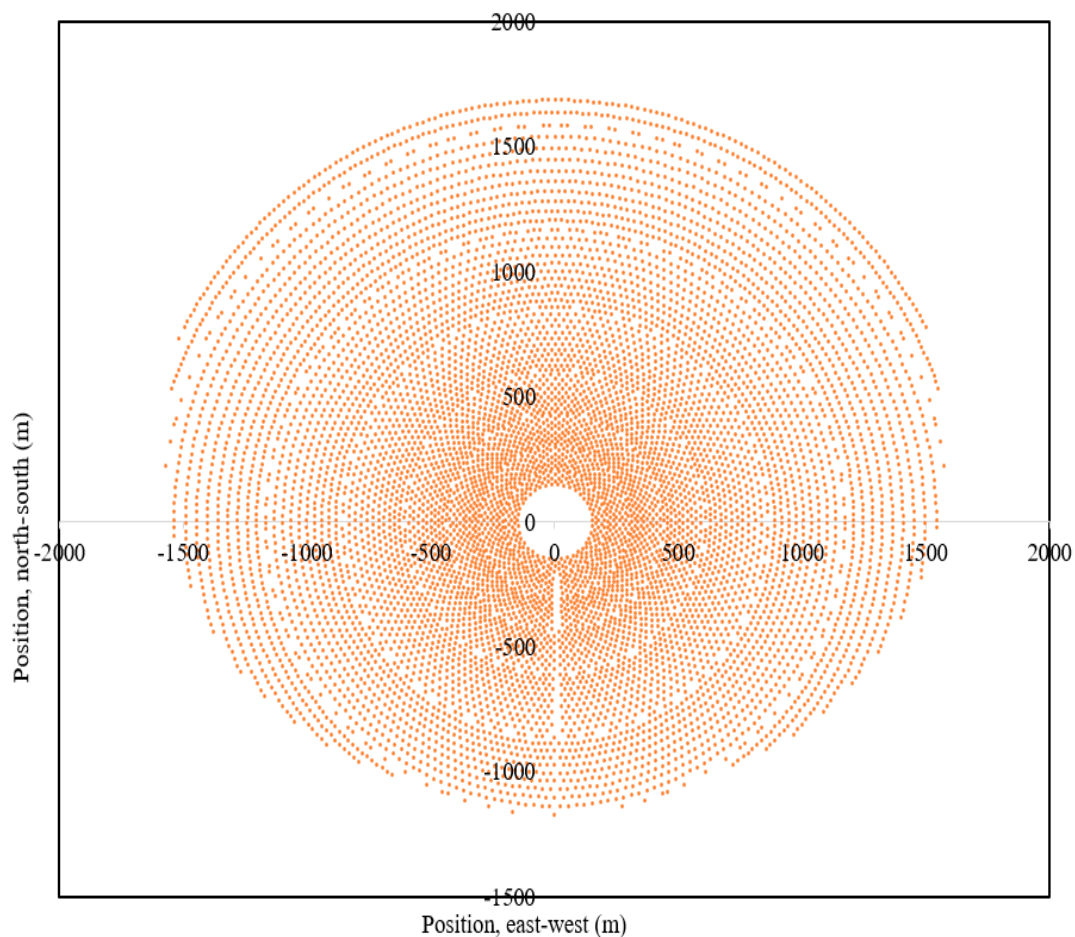

**Figure 15.** Heliostat field of the 50 MWe SPT plant.

**Table 7.** Design characteristics and specifications of the 50 MWe SPT plant.

<b>System Design</b>		
Heliostat field	Solar multiple	2.4
Tower and receiver	HTF hot temperature	574 °C
	HTF cold temperature	290 °C
Thermal storage	Full load hours of storage	12 h
Power cycle	Design turbine gross output	50 MWe
	Estimated gross-to-net conversion factor	0.9
	Estimated net output at design	45 MWe
	Cycle thermal efficiency	0.412
<b>Heliostat field</b>		
Heliostat properties	Heliostat width	12.2 m
	Heliostat height	12.2 m
	Single heliostat area	144.375 m <sup>2</sup>



Table 7. Cont.

System Design		
Land area	Base land area	7,022,833 m <sup>2</sup>
	Non-solar field land area	182,109 m <sup>2</sup>
	Total land area	7,203,404 m <sup>2</sup>
Power cycle		
Rankine cycle parameters	Boiler operating pressure	100 bar
	Condenser type	Evaporative/Air cooled
	Reference condenser water dT	10 °C
Thermal storage		
	Total tank volume	7132 m <sup>3</sup>
	Storage HTF fluid	Salt (60% NaNO <sub>3</sub> 40% KNO <sub>3</sub> )
	Tank diameter	21.3 m
Mirror washing		
	Water usage per wash	0.7 L/m <sup>2</sup> , aper.
	Washes per year	63

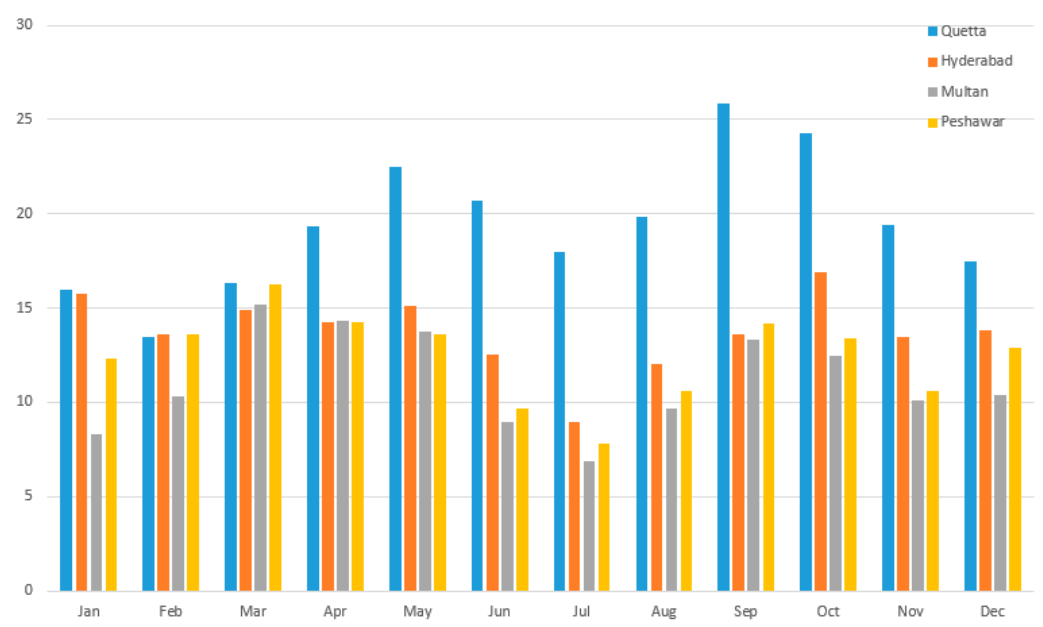



Figure 16. Electricity production by the 50 MWe SPT plant with evaporative cooling for different regions.

Table 8. Performance parameters of the 50 MWe SPT plant with evaporative cooling.

Parameters	Unit	Quetta	Hyderabad	Multan	Peshawar
Annual electricity generated	GWh	233.23	164.98	133.70	149.28
Gross-to-net conversion	%	95.8	94.8	94.2	94.37
Capacity factor	%	57.6	40.3	32.8	35.8
Cooling water requirements	m <sup>3</sup> /year	490,923	3,599,528	302,639	317,557

Table 9. Performance parameters of the 50 MWe SPT plant with air cooling.

Parameters	Unit	Quetta	Hyderabad	Multan	Peshawar
Annual electricity generated	GWh	209.80	141.96	113.52	124.09
Gross-to-net conversion	%	89.98	88.94	87.88	88.57
Capacity factor	%	53.2	36	28.8	31.5
Cooling water requirements	m <sup>3</sup> /year	38,273	34,858	31,852	32,241

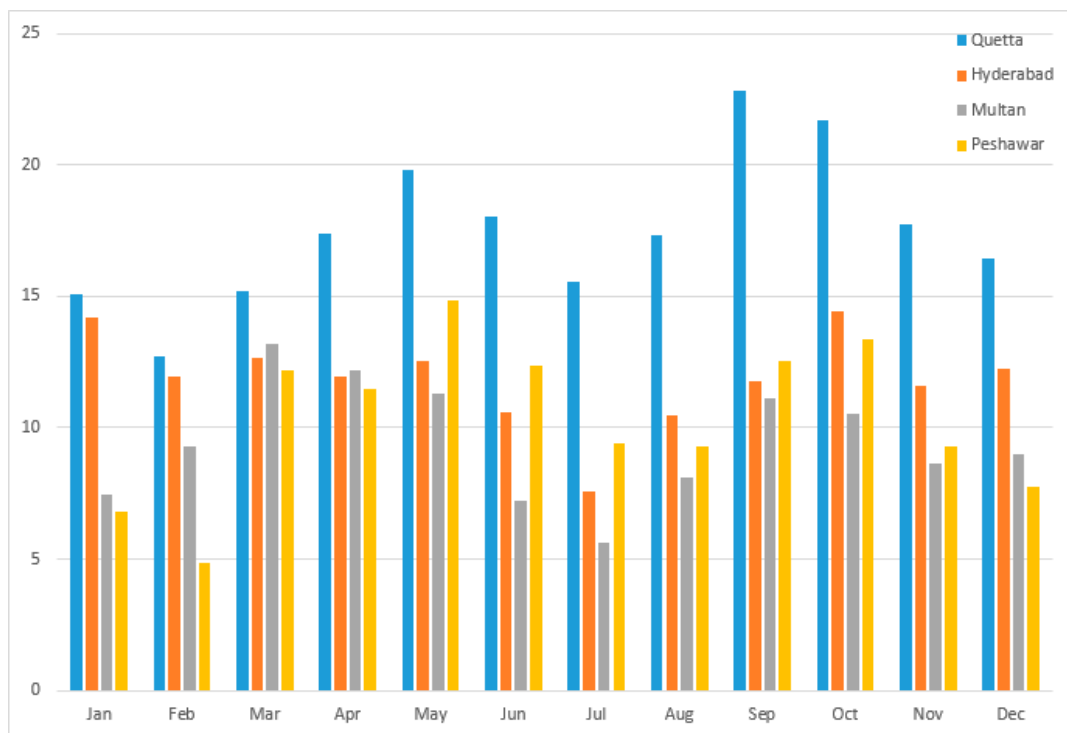

**Figure 17.** Electricity production by the 50 MWe SPT plant with dry cooling for different regions.

#### 4.3. Simulation Results of the Proposed 50 MWe LFR Plant

The technical assumptions for simulations of a 50 MWe LFR plant are listed in Table 10, and monthly electricity production from the plant with evaporative cooling is illustrated in Figure 18. It can be observed that the highest monthly energy production corresponds to summers and lowest to winters. This observation is similar to the PT plant and SPT plant. Also, to the maximum energy production to Quetta. In addition, annual performance parameters of the proposed 50 MWe LFR plant with evaporative cooling are presented in Table 11. Similar to the PT plant and SPT plant, maximum annual energy production, gross-to-net-conversion, and capacity factor contributed to Quetta followed by Hyderabad, Peshawar, and Multan. Figure 19 illustrated the monthly electricity production of the proposed 50 MWe LFR plant with air cooling. A reduction in monthly electricity production for all cities can be observed for the plant with air cooling. Similarly, a reduction in annual performance parameters for the LFR plant with air cooling can be observed in Table 12. Furthermore, comparing the simulation results of the LFR with PT and SPT plant, it can be observed that the monthly energy production and annual performance parameters of the LFR plant showed lower performance in terms of monthly electricity production and annual performance parameters. The reason behind this is its simple design, low concentration ratio, and lower efficiency. However, the cooling water requirements of the LFR plant are lowest among all CSP technologies.

**Table 10.** Design characteristics and specifications of the 50 MWe LFR plant.

Solar field		
Solar field parameters	Solar multiple	2.3
	Field aperture	850,000 m <sup>2</sup>
	Number of collector modules in a loop	16
	Number of subfield headers	2
Heat transfer fluid	Field HTF	Hitec XL
	Field HTF min: operating temperature	238 °C
	Field HTF max: operating temperature	593 °C

Table 10. Cont.

<b>Solar field</b>		
Design point	Single loop aperture	7524.8 m <sup>2</sup>
	Number of loops	71
Land area	Solar field area	854,817 m <sup>2</sup>
<b>Collector and Receiver</b>		
	Reflective aperture area of the collector	470.3 m <sup>2</sup>
	Length of the collector module	44.8 m
	Length of crossover pipping in a loop	15 m
<b>Power cycle</b>		
Plant capacity	Design gross output	50 MWe
	Estimated gross-to-net conversion factor	0.9
	Estimated net output at design	45 MWe
Power block design point	Rated cycle conversion efficiency	0.38
	Reference HTF outlet temperature at design	525 °C
	Reference HTF inlet temperature at design	293 °C
Rankine cycle parameters	Boiler operating pressure	100 bar
	Condenser type	Evaporative/air cooling
	Reference condenser water dT	10 °C
<b>Thermal storage</b>		
	Equivalent full-load thermal storage hours	12 h
	Total tank volume	9138.74 m <sup>3</sup>
	Storage HTF fluid	Hitec XL
	Tank diameter	24.12 m
	Loss coefficient from the tank	0.4 W/m <sup>2</sup> .K
<b>Mirror washing</b>		
	Water usage per wash	0.02 L/m <sup>2</sup> , aper.
	Washes per year	120

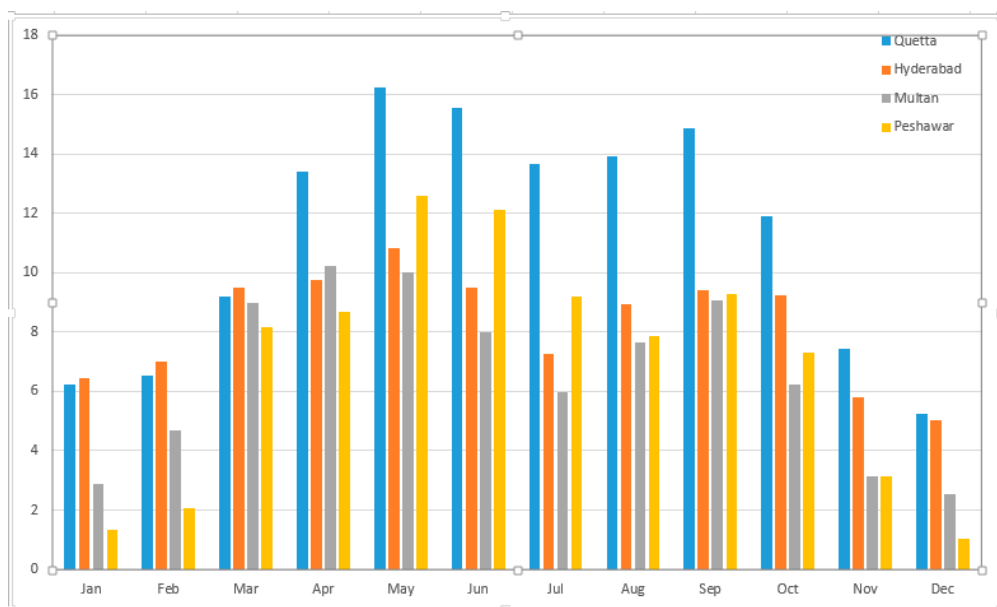
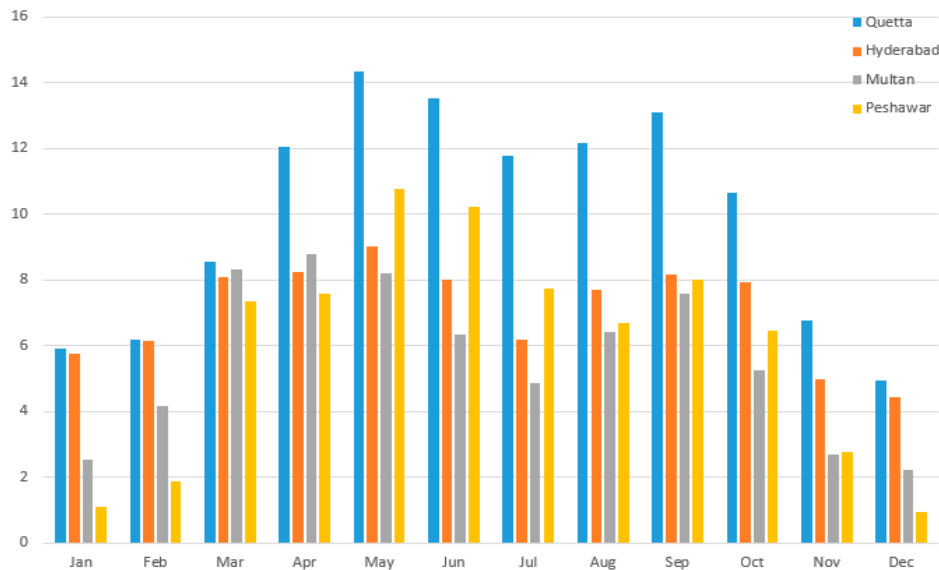


Figure 18. Electricity production by the 50 MWe LFR plant with evaporative cooling for different regions.

**Table 11.** Performance parameters of 50 MWe LFR plant with evaporative cooling.

Parameters	Unit	Quetta	Hyderabad	Multan	Peshawar
Annual electricity generated	GWh	134.26	98.70	79.37	82.65
Gross-to-net conversion	%	96.15	95.57	94.92	94.92
Capacity factor	%	34.1	25	20.1	21
Cooling water requirements	m <sup>3</sup> /year	432,329	331,636	275,783	280,224

**Figure 19.** Electricity production by the 50 MWe LFR plant with dry cooling for different regions.**Table 12.** Performance parameters of the 50 MWe LFR plant with air cooling.


Parameters	Unit	Quetta	Hyderabad	Multan	Peshawar
Annual electricity generated	GWh	119.85	84.57	67.317	71.39
Gross-to-net conversion	%	92.09	90.38	89.05	89.95
Capacity factor	%	30.4	21.5	17.1	18.1
Cooling water requirements	m <sup>3</sup> /year	12,827	10,030	8540	8656

#### 4.4. Simulation Results of the Proposed 5 MWe PD System

The performance of the 5 MWe parabolic dish system for different locations in Pakistan is presented in this section. Since large-scale parabolic dish systems are rarely commercialized, investigations have been carried out with a capacity of 5 MWe. The technical assumptions of the proposed parabolic dish system are listed in Table 13, and monthly electricity production is presented in Figure 20. As seen, the highest monthly electricity production corresponds to Quetta while lowest to Multan. Annual performance parameters (Table 14) indicated that the higher annual energy production, gross-to-net conversion, and capacity factor correspond to Quetta. Specifically, comparing the annual results of the 5 MW PD system with the other 50 MWe CSP plant, it was found that the results of the PD system are very promising. This is attributed to the higher concentration ratio and high operating temperature. However, the capital and operation and maintenance (O & M) cost of the PD systems are highest [15]. In addition, the technology is at the demonstration stage, and most of the existing PD systems are not connected to the grids [15]. Thus, for Pakistan, which already lacks in the large scale CSP plant, it would be a tough decision to invest in PD systems at present. However, PD systems are attractive for small scale projects at remote areas.

**Table 13.** Design characteristics and specifications of the PD system.

<b>Solar Field</b>		
Field layout	Number of collectors, North-South	20
	Number of collectors, East-West	10
	Number of collectors	200
	Total solar field area	45,000 m <sup>2</sup>
<b>System properties</b>		
	Total capacity	5000 kW
<b>Stirling Engine</b>		
Estimated generation	Single unit nameplate capacity	25 kW

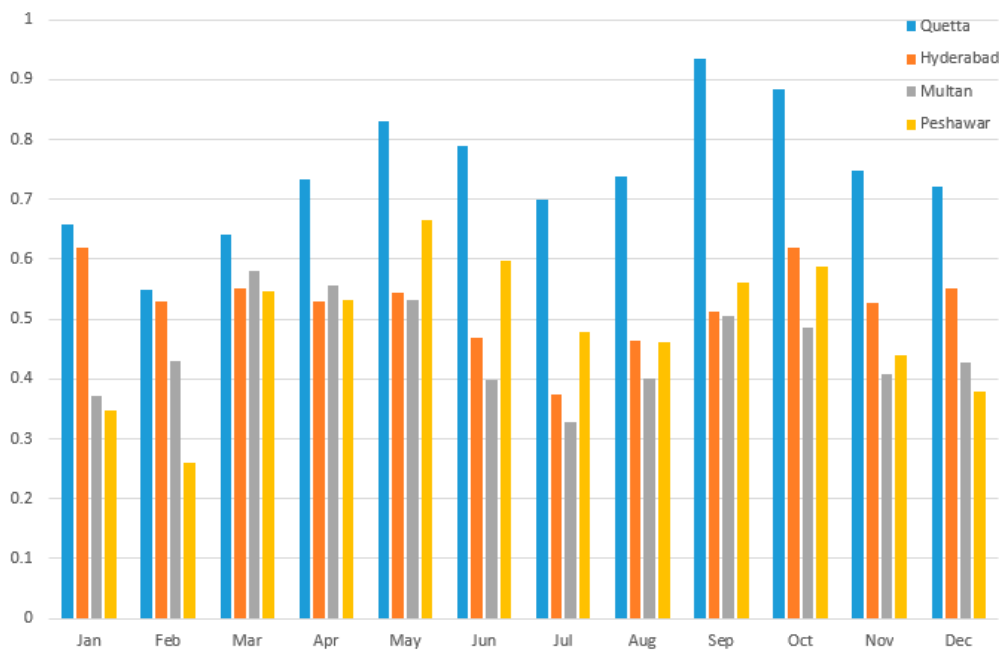**Figure 20.** Electricity production by the 5 MWe PD system for different regions.**Table 14.** Performance parameters of the 5 MWe PD system.

Parameters	Unit	Quetta	Hyderabad	Multan	Peshawar
Annual electricity generated	GWh	8.9	6.29	5.42	5.855
Gross-to-net conversion	%	43.59	41.28	41.03	42.09
Capacity factor	%	20.4	14.4	12.4	13.4

## 5. Economic Analyses

The purpose of economic analysis is to evaluate the profitability/feasibility of CSP plants. Generally, the economic feasibility of power plants is evaluated in terms of LCOE. The LCOE evaluates the electricity costs produced throughout the lifetime of the CSP plant. Specifically, real LCOE and nominal LCOE were evaluated for the CSP plants. The nominal LCOE uses the current value of the dollar, and it is used for short term analysis. Whereas real LCOE uses constant and inflation adjusted value of the dollar, and it is used for long term analysis [28,32]. Determination of nominal LCOE takes into account different factors including

- Electricity generation;
- Direct capital cost: Equipment and installation cost;
- Indirect capital cost: Approvals, engineering, and land cost;

- Operation and maintenance (O&M) cost: Equipment operation, labor cost, and maintenance cost, etc.

The economic analyses of the proposed CSP plants at different locations of Pakistan were carried out using SAM. The economic assumptions considered for the simulations of CSP plants are listed in Table 15. The LCOE of the CSP plants with evaporative cooling and air cooling are summarized in Table 16. It is important to mention here that the water costs are not considered in the evaluation of LCOE.

**Table 15.** Assumptions and data used for economic analysis of the CSP plant.

Parameters	Unit	Values
50 MWe PT Plant-Net capital cost	\$	422,455,744
50 MWe SPT Plant-Net capital cost	\$	597,225,600
50 MWe LFR Plant-Net capital cost	\$	314,223,840
5 MWe PD system-Net capital cost	\$	14,620,023
Life time	Years	30 [28]
Inflation rate	%/year	2.5 [28,32]
Real discount rate	%/year	5.5 [28,32]
Nominal discount rate	%/year	8.14 [28,32]

Firstly, comparing evaporative cooling and air cooling, it was found that LCOE of CSP plants with evaporative cooling was lower for all cases compared to air cooling. For instance, real LCOE was 3.69 ¢/kWh with evaporative cooling for the PT plant in Quetta, and it increased to 4.12 ¢/kWh with air cooling. It is due to the fact that air cooling reduces the plant's efficiency, which reduces energy production and increases the LCOE. Then, it was found that the LCOE is lowest for the PD system. It is attributed to its high concentration ratio, high temperature operation, and higher efficiency, which led to high power production and consequently reduced the energy cost. However, the PD system are not commercialized yet, as discussed in Section 4.4. Subsequently, the LCOE for the PT plant is second lowest. Even though the capital cost of the PT plant is high, but an adequate amount of energy production led to reduce the LCOE. The LCOE for LFR plant is high compared to the PD system and PT plant. In the LFR plant, the capital cost is lowest, but lower energy production due to lower efficiency led to increase the LCOE. The highest LCOE was observed for the SPT plant. Although energy production of the SPT plant was highest, the high capital cost increased the LCOE.

Nevertheless, the energy cost is competitive with the energy cost of existing conventional power plants in Pakistan [32]. Specifically, the LCOE of the PT Plant is much lower. Also, the LCOE of CSP plants for different locations in Pakistan is in good agreement with the LCOE of CSP plants available in the most recent literature [15,21,33–35]. Thus, it can be concluded that the CSP plants in Pakistan are economically feasible/viable.

Additionally, it has been observed that solar field cost contributes the biggest in the net capital cost of the CSP plant. The simulations revealed that the contribution of solar field cost in net capital cost of CSP plants was as follows: PT plant (32.4%), SPT (35.6%), LFR plant (28.6%), and PD system (47.9%). In Pakistan, the land cost in the Baluchistan plateau and Indus plain is low, which could reduce the net capital cost of CSP plants. On the other hand, since most of the CSP equipment are imported, which increases the overall cost, the net capital can be reduced by localization. Localization will enhance the local industry and create more jobs in the country. Consequently, the socio-economic condition of the country will improve. Also, the LCOE of the CSP plants can be further reduced by carbon trading under the clean development mechanism (CDM) of the Kyoto Protocol (KP).

In summary, the results of the CSP plants simulations are promising for different regions of Pakistan. Specifically, Quetta and Hyderabad regions are very attractive for CSP development, and PT and SPT could be suitable CSP technologies in the region. Specifically, SPT plants with air cooling could be a promising option for energy production in Quetta. Moreover, low LCOE revealed that

CSP plants are economically viable too. Therefore, the utilization of solar energy for CSP generation could provide opportunities for clean energy production and eradicate environmental pollution in the country.

**Table 16.** Net capital cost and levelized cost of energy (LCOE) of the CSP plants in Pakistan.

Parameters	Unit	Quetta	Hyderabad	Multan	Peshawar
50 MWe PT plant with evaporative cooling					
Nominal LCOE	Cents/kWh	4.69	6.68	8.28	7.98
Real LCOE	Cents/kWh	3.69	5.25	6.52	6.28
50 MWe PT plant with air cooling					
Nominal LCOE	Cents/kWh	5.23	7.79	9.82	9.20
Real LCOE	Cents/kWh	4.12	6.13	7.73	7.23
50 MWe SPT plant with evaporative cooling					
Nominal LCOE	Cents/kWh	14.58	20.45	26.61	24.72
Real LCOE	Cents/kWh	10.98	15.27	19.89	15.57
50 MWe SPT plant with air cooling					
Nominal LCOE	Cents/kWh	15.15	20.99	27.15	25.27
Real LCOE	Cents/kWh	11.43	15.83	20.47	19.06
50 MWe LFR plant with evaporative cooling					
Nominal LCOE	Cents/kWh	14.77	19.97	24.75	23.78
Real LCOE	Cents/kWh	11.29	15.27	18.93	18.18
50 MWe LFR plant with aircooling					
Real LCOE	Cents/kWh	16.50	23.25	29.13	27.48
Nominal LCOE	Cents/kWh	12.62	17.78	22.27	21.01
5 MWe parabolic dish system					
Real LCOE	Cents/kWh	3.34	4.75	5.51	5.10
Nominal LCOE	Cents/kWh	2.63	3.73	4.33	4.01

1 USD = 115.65 PKR [36].

## 6. Conclusions

This paper has investigated the potential of CSP, performance, and economic analyses of four CSP technologies for different locations in Pakistan. Following a brief introduction of the CSP technologies, assessment of CSP sites, including solar resource, land, and water availability in Pakistan, was investigated. It was found that CSP potential is promising in Baluchistan, Sindh, and the lower (southern) parts of Punjab province. Particularly, Quetta (Baluchistan province) has the highest CSP potential in the country with DNI 2100 kWh/m<sup>2</sup>. Also, the availability of flat land is abundant in the Indus River plain (Sindh and Punjab province). On the other hand, the plains and deserts (especially Kharan Desert) in the Baluchistan plateau are suitable for CSP plants whereas vast flatlands are rear in northern highlands which make these areas less suitable for the CSP installation.

Furthermore, water availability is uneven in Pakistan. Sindh and Punjab provinces have a wide network of rivers which makes these regions most suitable for power plants with wet cooling. On the other hand, Baluchistan plateau does not have many networks of rivers except for a few areas. Thus, the CSP plant with dry cooling could be a better option.

Based on site selection, performance simulations of four CSP technologies for four cities of Pakistan, including Quetta, Hyderabad, Multan, and Peshawar were investigated with SAM software. Design gross output for the PT, SPT, and LFR plant was considered to be 50 MWe, whereas 5 MWe for the PD system. The simulations revealed that the highest energy production was obtained in summers, whereas the lowest in winters. For all CSP technologies, maximum energy production was obtained

for Quetta followed by Hyderabad, Multan, and Peshawar. For 50 MWe plants, the performance and power production capacity was higher for the SPT plant followed by the PT plant and LFR plant. The performance of CSP plants with evaporative cooling was higher compared to air cooling.

Nevertheless, the performance of all 50 MWe plants with air cooling was found quite satisfactory, especially the SPT plant in Quetta. The performance of the 5 MWe PD system was highest among all CSP plants, but it cannot be commercialized on a large scale because the technology is still at the demonstration stage. However, PD systems could be promising for small scale projects in remote areas. Generally, Quetta, Hyderabad, Sukkur, and Multan regions are very attractive for CSP development, and PT and SPT could be suitable CSP technologies in the region. Specifically, the SPT plant with air cooling could be a promising option for energy production in Quetta.

Economic analyses of the CSP plants for different locations were undertaken using SAM software. The assessment revealed that the net capital cost was highest for the PD system, followed by the SPT plant, PT plant, and LFR plant, respectively. The solar field cost contributed major share in the net capital cost of all CSP plants. Furthermore, energy cost evaluation showed that the LCOE was lowest for PD systems followed by the PT plant and LFR plant. The highest LCOE was observed for the SPT plant. Although energy production of the SPT plant was higher, high capital cost increased the LCOE. The calculated LCOE is in good agreement with the LCOE of CSP plants available in the literature, and competitive with an energy cost of existing conventional power plants in Pakistan. Thus, it can be concluded that the CSP plants in Pakistan are economically feasibility. Therefore, the utilization of solar energy for CSP generation could provide opportunities for clean energy production and eradicate environmental pollution in the country.

**Author Contributions:** All the authors contributed to this work. M.I.S., A.M., and N.H.M. conceived and structured the study. M.I.S., M.W.A.K., Q.N.S., and Y.A.M. developed the model and analyzed the results and prepared the preliminary manuscript. M.I.S., A.M., Q.N.S. reviewed and finalized the manuscript.

**Funding:** This research received no external funding.

**Acknowledgments:** The authors highly acknowledge Mehran University of Engineering & Technology, SZAB Campus, Khairpur Mir's, and Balochistan University of Engineering & Technology, Khuzdar, Mehran University of Engineering & Technology Jamshoro for their support for completing this research work.

**Conflicts of Interest:** The authors declare no conflict of interest.

## References

1. Hussain, N. *Development of Energy Modeling and Decision Support Framework for Sustainable Electricity System of Pakistan*; Mehran University of Engineering & Technology: Jamshoro, Pakistan, 2019.
2. National Transmission & Dispatch Company (NTDC). Available online: <http://www.ntdc.com.pk/> (accessed on 8 May 2018).
3. Pakistan Energy Year Book, Hydrocarbon Development Institute of Pakistan Ministry of Energy (Petroleum Division), Government of Pakistan. 2016. Available online: <https://www.hdip.com.pk/> (accessed on 22 May 2018).
4. Tahir, Z.R.; Asim, M. Surface measured solar radiation data and solar energy resource assessment of Pakistan: A review. *Renew. Sustain. Energy Rev.* **2018**, *81*, 2839–2861. [[CrossRef](#)]
5. Vivar, M.; Herrero, R.; Antón, I.; Martínez-Moreno, F.; Moretón, R.; Sala, G.; Blakers, A.W.; Smeltink, J. Effect of soiling in CPV systems. *Sol. Energy* **2010**, *84*, 1327–1335. [[CrossRef](#)]
6. Geuder, N.; Quaschnig, V. Soiling of irradiation sensors and methods for soiling correction. *Sol. Energy* **2006**, *80*, 1402–1409. [[CrossRef](#)]
7. Wolfstetter, F.; Wilbert, S.; Dersch, J.; Dieckmann, S.; Pitz-Paal, R.; Ghennioui, A. Integration of soiling-rate measurements and cleaning strategies in yield analysis of parabolic trough plants. *J. Sol. Energy Eng.* **2018**, *140*, 041008. [[CrossRef](#)]
8. REN21. *Renewable Global Status Report-REN21 Secretariat*; REN21: Paris, France, 2017; Available online: <http://www.ren21.net/status-of-renewables/global-status-report/> (accessed on 8 May 2018).



9. Hinkley, J.; Curtin, B.; Hayward, J.; Wonhas, A.; Boyd, R.; Grima, C.; Mikhail, A. *Concentrating Solar Power—Drivers and Opportunities for Cost-Competitive Electricity*; Commonwealth Scientific and Industrial Research Organisation (CSIRO): Canberra, Australia, 2011.
10. Purohit, I.; Purohit, P.; Shekhar, S. Evaluating the potential of concentrating solar power generation in Northwestern India. *Energy Policy* **2013**, *62*, 157–175. [[CrossRef](#)]
11. Guzman, L.; Henao, A.; Vasquez, R. Simulation and Optimization of a Parabolic Trough Solar Power Plant in the City of Barranquilla by Using System Advisor Model (SAM). *Energy Procedia* **2014**, *57*, 497–506. [[CrossRef](#)]
12. Sundaray, S.; Kandpal, T.C. Preliminary feasibility evaluation of solar thermal power generation in India. *Int. J. Sustain. Energy* **2014**, *33*, 461–469. [[CrossRef](#)]
13. Lemmer, V. *Comparative Market Analysis and Economic Simulation for Morocco of the Parabolic Trough and Dish CSP Technologies*; University of Lisboa: Lisbon, Portugal, 2014.
14. Wagner, S.J.; Rubin, E.S. Economic implications of thermal energy storage for concentrated solar thermal power. *Renew. Energy* **2014**, *61*, 81–95. [[CrossRef](#)]
15. Kassem, A.; Al-Haddad, K.; Komljenovic, D. Concentrated solar thermal power in Saudi Arabia: Definition and simulation of alternative scenarios. *Renew. Sustain. Energy Rev.* **2017**, *80*, 75–91. [[CrossRef](#)]
16. Praveen, R.P.; Abdul Baseer, M.; Awan, A.; Zubair, M. Performance Analysis and Optimization of a Parabolic Trough Solar Power Plant in the Middle East Region. *Energies* **2018**, *11*, 741. [[CrossRef](#)]
17. Belgasim, B.; Aldali, Y.; Abdunnabi, M.J.R.; Hashem, G.; Hossin, K. The potential of concentrating solar power (CSP) for electricity generation in Libya. *Renew. Sustain. Energy Rev.* **2018**, *90*, 1–15. [[CrossRef](#)]
18. International Energy Agency (IEA). *Technology Roadmap: Concentrating Solar Power*; International Energy Agency (IEA): Paris, France, 2010.
19. Albarbar, A.; Arar, A. Performance Assessment and Improvement of Central Receivers Used for Solar Thermal Plants. *Energies* **2019**, *12*, 3079. [[CrossRef](#)]
20. Al-Kayiem, H.; Mohammad, S. Potential of Renewable Energy Resources with an Emphasis on Solar Power in Iraq: An Outlook. *Resources* **2019**, *8*, 42. [[CrossRef](#)]
21. Soomro, M.; Mengal, A.; Shafiq, Q.; Ur Rehman, S.; Soomro, S.; Harijan, K. Performance Improvement and Energy Cost Reduction under Different Scenarios for a Parabolic Trough Solar Power Plant in the Middle-East Region. *Processes* **2019**, *7*, 429. [[CrossRef](#)]
22. International Renewable Energy Agency (IRENA). *Renewable Energy Technologies: Cost Analysis Series. IRENA Working Paper on Power Sector—Concentrating Solar Power*; International Renewable Energy Agency (IRENA): Abu Dhabi, UAE, 2012; Volume 1.
23. Zhang, H.L.; Baeyens, J.; Degrève, J.; Cacères, G. Concentrated solar power plants: Review and design methodology. *Renew. Sustain. Energy Rev.* **2013**, *22*, 466–481. [[CrossRef](#)]
24. Răboacă, M.S.; Badea, G.; Enache, A.; Filote, C.; Răsoi, G.; Rata, M.; Felseghi, R.A. Concentrating Solar Power Technologies. *Energies* **2019**, *12*, 1048. [[CrossRef](#)]
25. Solargis. Available online: <https://solargis.com/maps-and-gis-data/download/pakistan> (accessed on 11 May 2018).
26. Administrative Units of Pakistan. Available online: [https://en.wikipedia.org/wiki/Administrative\\_units\\_of\\_Pakistan](https://en.wikipedia.org/wiki/Administrative_units_of_Pakistan) (accessed on 11 May 2018).
27. Geography of Pakistan. Available online: [https://en.wikipedia.org/wiki/Geography\\_of\\_Pakistan](https://en.wikipedia.org/wiki/Geography_of_Pakistan) (accessed on 12 May 2018).
28. Surface Meteorology and Solar Energy. Available online: <https://eosweb.larc.nasa.gov/sse/RETScreen/> (accessed on 17 May 2018).
29. National Solar Radiation Database (NSRDB). National Renewable Energy Laboratory (NREL). Available online: <https://nsrdb.nrel.gov/nsrdb-viewer> (accessed on 17 May 2018).
30. Casati, E.; Casella, F.; Colonna, P. Design of CSP plants with optimally operated thermal storage. *Sol. Energy* **2015**, *116*, 371–387. [[CrossRef](#)]
31. Llorente García, I.; Álvarez, J.L.; Blanco, D. Performance model for parabolic trough solar thermal power plants with thermal storage: Comparison to operating plant data. *Sol. Energy* **2011**, *85*, 2443–2460. [[CrossRef](#)]
32. System Advisor Model (SAM). National Renewable Energy Laboratory. Available online: <https://sam.nrel.gov/financial> (accessed on 8 May 2018).
33. Soomro, M.I.; Kim, W.-S. Performance and economic investigations of solar power tower plant integrated with direct contact membrane distillation system. *Energy Convers. Manag.* **2018**, *174*, 626–638. [[CrossRef](#)]

34. Soomro, M.I.; Kim, W.-S. Parabolic-trough plant integrated with direct-contact membrane distillation system: Concept, simulation, performance, and economic evaluation. *Sol. Energy* **2018**, *173*, 348–361. [[CrossRef](#)]
35. Soomro, M.I.; Kim, W.-S. Performance and economic evaluation of linear Fresnel reflector plant integrated direct contact membrane distillation system. *Renew. Energy* **2018**, *129*, 561–569. [[CrossRef](#)]
36. Exchange Rates. Available online: <https://www.exchange-rates.org/Rate/USD/PKR> (accessed on 22 May 2018).



© 2019 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<http://creativecommons.org/licenses/by/4.0/>).