

Journal of Civil Engineering and Architecture 14 (2020) 37-45
doi: 10.17265/1934-7359/2020.01.004



Influence of Local Weather Conditions on Ventilation of a Pitched Wooden Roof

Nora Schjøth Bunkholt¹, Lars Gullbrekken¹ and Tore Kvande²

1. SINTEF Community, Trondheim 7046, Norway

2. Department of Civil and Environmental Engineering—NTNU, Trondheim 7491, Norway

Abstract: This paper investigates the influence of temperature and wind conditions on ventilation of the air cavity beneath the roofing in a full-scale pitched wooden roof construction. The potential for condensation in the air cavity is studied. The relevant roof construction is equipped with 81 thermocouples and four air velocity measurement devices. A weather station at the site records outdoor temperature and wind conditions. Five periods between 2016 and 2018 are investigated. The findings show distinct periods of below-ambient temperature and positive condensation potential in the ventilated air cavity of the roof. A relation between low wind speed and positive condensation potential is shown. Difference in size of periods with below-ambient temperature and periods with positive condensation potential implies that the materials in the roof regulate the humidity in the air cavity. Large negative peaks in the condensation potential indicate dry-out of the construction.

Key words: Pitched roof, wood construction, air cavity, ventilation, condensation.

1. Introduction

The Norwegian climate is characterized by extreme variations and large geographical and seasonal differences. This results in considerable weather strain, which puts large demands on Norwegian building envelopes [1]. As an exposed element of the building envelope, the roof must be constructed to stand local weather loads. Pitched wooden roofs, defined as roofs with a wooden load bearing system, are a widely used roof structure in Norway [2]. Such roofs are constructed with ventilation by providing airflow through an air cavity beneath the roofing. The purpose of the ventilation is: (1) to remove excessive moisture from the roof construction to avoid damages and mould growth, and (2) to remove heat in order to prevent melting of snow on the roof and subsequent formation of ice on the eaves [3]. Performed this way, ventilated pitched wooden roofs are considered climatic robust constructions. The risk of condensation inside the air cavity is, however, dependent on local weather

conditions and the consequences are dependent on the roof design and materials used.

Temperature and air flow conditions in ventilated pitched wooden roofs have been studied both numerically (e.g., Refs. [4, 5]) and experimentally (e.g., Refs. [6-8]). However, few works have turned attention to cold climates and condensation challenges in the ventilated air cavity of the roofs. Blom [9] studied temperature and moisture conditions in attics and pitched insulated roofs. Moisture content was measured in the roof of a test house, but condensation levels in particular were not investigated. Measurements performed by Gullbrekken et al. [10] aimed at studying the influence of temperature and air velocity conditions on condensation and ventilation in the air cavity of a pitched wooden roof. Long periods of below-ambient temperature in the air cavity were measured. During three periods in spring, summer and autumn 2016, the temperature at the rear side of the roofing was found to be lower than the outdoor temperature 51%, 14% and 56% of the time, respectively. A strong correlation between wind speed and air velocity in the air cavity was observed.

Corresponding author: Nora Schjøth Bunkholt, M.Sc., research field: building physics.

However, the condensation potential in the cavity was not investigated. In addition, the study only included the south face of the roof and periods during winter were not studied.

This paper is a continuation of the study performed by Gullbrekken et al. [10]. The aim of the present study is to investigate the influence of temperature and wind conditions on ventilation of the air cavity in the same full-scale wooden roof construction. One of the main goals is to examine the risk of condensation in the ventilated air cavity.

The following research questions are addressed:

- How is the temperature in the air cavity depending on the outdoor climate?
- What is the condensation potential that follows below-ambient temperature periods in the air cavity?
- What consequences do the risks of condensation imply?

The study includes pitched wooden roofs and focuses on roofs insulated in the entire cross section. Roofs with cold attics, ventilated or unventilated, are not studied. Neither are air cavities with cross-ventilation, nor flat roofs and compact roofs.

2. Theoretical Framework

Air contains moisture in the shape of water vapor. At every temperature there is an upper limit for water vapor content in air, denoting the saturation pressure. Saturation pressure increases with increasing temperature, i.e. air may contain more water vapor at higher temperatures [11]. Saturation curves are found empirically and may vary depending on the reference. As a result, different formulas for calculating the saturation curve as a function of temperature exist [12]. The formulas have varying accuracy and are usually valid within certain temperature intervals. In this study, saturation pressure is calculated with Eqs. (1a) and (1b) [12, 13]. Partial vapor pressure is given by Eq. (2) [11].

$$p_{sat} = 611 \cdot \exp(72.5 \cdot 10^{-3} \cdot \theta - 288.1 \cdot 10^{-6} \cdot \theta^2 + 0.79 \cdot 10^{-6} \cdot \theta^3), [0^\circ\text{C} \leq \theta \leq 40^\circ\text{C}] \quad (1a)$$

$$p_{sat} = 611 \cdot \exp(82.9 \cdot 10^{-3} \cdot \theta - 288.1 \cdot 10^{-6} \cdot$$

$$\theta^2 + 4.403 \cdot \theta^3), [-30^\circ\text{C} \leq \theta \leq 0^\circ\text{C}] \quad (1b)$$

where p_{sat} is saturation pressure of water vapour (Pa), θ air temperature ($^\circ\text{C}$).

$$p_v = 461.4 \cdot v \cdot (\theta + 273.15) \quad (2)$$

where p_v is partial pressure difference of water vapour (Pa), v absolute humidity in air (kg/m^3).

Condensation potential, denoted as CP_i , can be expressed as the difference between partial vapor pressure and saturation pressure. The risk of condensation remains zero as long as the CP_i remains negative, i.e. as long as the partial vapor pressure is lower than the saturation pressure.

3. Methods

The study was carried out on a full-scale experimental laboratory building, ZEB Test Cell Laboratory, situated in Trondheim, Norway (see Fig. 1). The building has a wooden roof construction with a roof angle of 40° . The roof has eaves-to-eaves ventilated air cavities below the roofing, with 48 mm wide inlets and outlets along the eaves. The air cavities are 10.8 m long, 552 mm wide and 48 mm high. The lower surface of the cavities consists of a flexible roof underlay mounted on an oriented strand board (OSB). The upper surface is an OSB covered by a bitumen-based roofing membrane on the weather exposed side (see Fig. 2).

The air cavities of the roof are equipped with instrumentation for temperature and air velocity measurements (Fig. 2). Eighty-one (81) thermocouples are shared evenly on nine parallel cavities. In each cavity, three thermocouples are located 0.5 m above the eaves, three are found between the eaves and ridge, and three are located 0.5 m below the ridge. In each triplet, one sensor is installed on the roof underlay, one is installed in the middle of the air cavity, and one is mounted on the rear surface of the roofing. In two of the air cavities, two air velocity measurement probes are installed. The accuracy and range of the sensors are $\pm 0.10^\circ\text{C}$ and -20°C - 60°C for the thermocouples, and 0.05 m/s and 0.05-5 m/s for the air velocity probes.

Outdoor temperature and wind exposure are recorded at a weather station located 1.5 m above the ridge of the roof. The equipment has a measuring interval of one minute.

Four of the cavities on the roof were studied, described in the plan drawing in Fig. 1, showing the building from above. Two cavities on the southern side of the roof, denoted as SA and SE, and two cavities on the northern side of the roof, denoted as NA and NE, were included in the study.

The periods of measurement presented in this paper represent different seasons in 2016-2018, including spring (22.3-31.3.16), summer (3.7-14.7.16), autumn (21.9-27.9.16) and winter (21.12-31.12.17 and 24.2-7.3.18). The selection of the periods is based partly on the preference of studying different seasons, and partly on the access to longer measurement periods with complete data. The stability of the outdoor climate


during the periods also was of importance. Two different winter periods were chosen in order to compare the situation with and without snow covering the roof (December 2017 without snow and February/March 2018 with snow).

4. Results

All results are based on data with a one-minute measuring interval. Due to different duration of the periods, the number of measurements in each period varies. Temperature, condensation and wind conditions are presented for the five given periods. Temperature conditions in the air cavities, as well as wind conditions are described in Fig. 3. The temperature data used are an average of measurements given by the three triplets of sensors in each air cavity. Wind directions are divided into eight wind approach zones, A-H, described by the following angles: 0°, 45°, 90°, 135°, 180°, 225°, 270°, 315°.



(a)

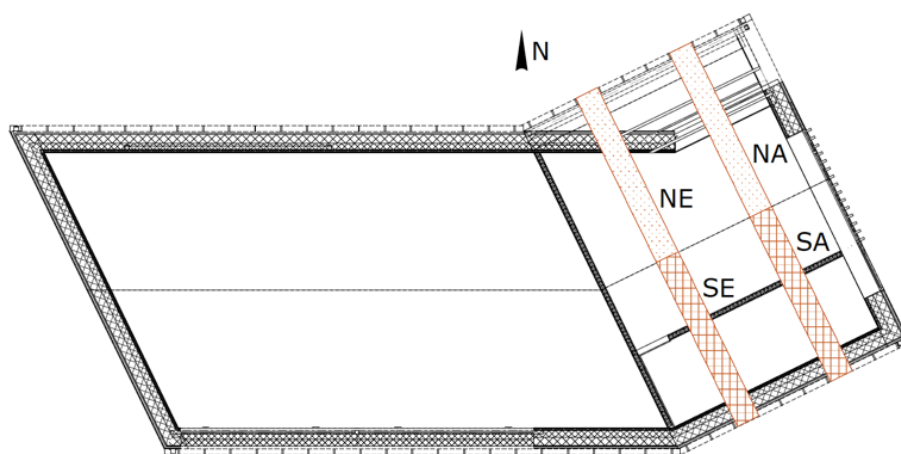

(b)

Fig. 1 (a) The ZEB Test Cell Laboratory; (b) position of the air cavities included in the study.

Source: the figure is based on a plan drawing created by Luca Finocchiaro.

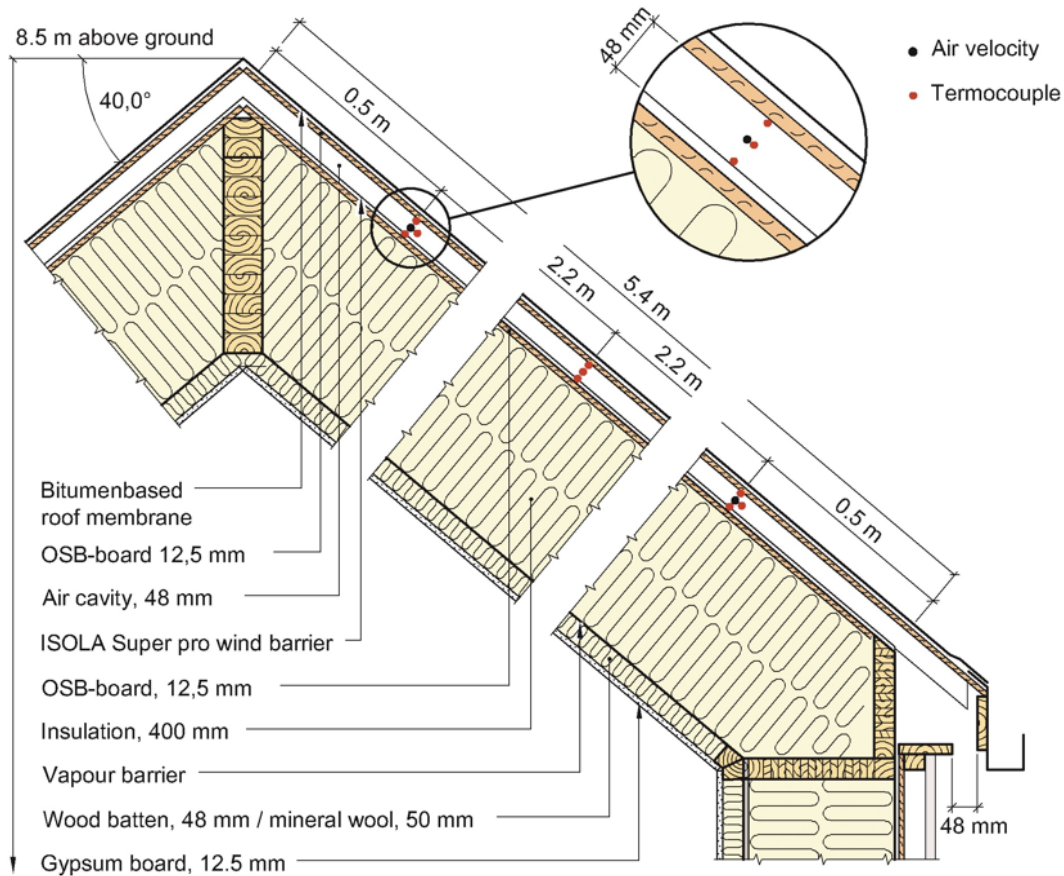


Fig. 2 ZEB Test Cell Laboratory roof structure.

180°, 225°, 270°, 315° ± 22.5°. The angle of 0° corresponds to wind approaching perpendicular to the wall on the northern side of the building (zone A). Fig. 4 shows CP_i in the air cavity and wind speed as a function of time. Fig. 5 compares the risk of condensation in the different periods. In Fig. 5 results are not given for February/March 2018, as no positive CP_i was found in this period.

5. Discussion

In this paper, the temperature and condensation conditions in the ventilated air cavity of a full-scale pitched wooden roof have been investigated. Five periods between 2016 and 2018 were included in the study. How the temperature in the air cavity depends on the outdoor temperature and wind is presented in Fig. 3. The subsequent CP_i in periods with below-ambient temperature in the air cavity is examined in Figs. 4 and 5.

5.1 Temperature Conditions

The measurements from the roof at ZEB Test Cell Laboratory demonstrated long periods of below-ambient temperature in the ventilated air cavity beneath the roofing. During the spring and autumn periods, the measurements at the rear side of the roofing showed temperatures below the ambient temperature for approximately 50% of the time. This is in line with the results found by Gullbrekken et al. [10]. In the December period, below-ambient temperature was measured close to 100% of the time. There was no snow on the roof in this period. Low outdoor temperatures and periods with clear sky may have contributed to large cooling of the roof and the subsequent low temperatures at the rear side of the roofing. During the second winter period, in February/March 2018, comparatively small intervals with below-ambient temperature were measured. Snow,

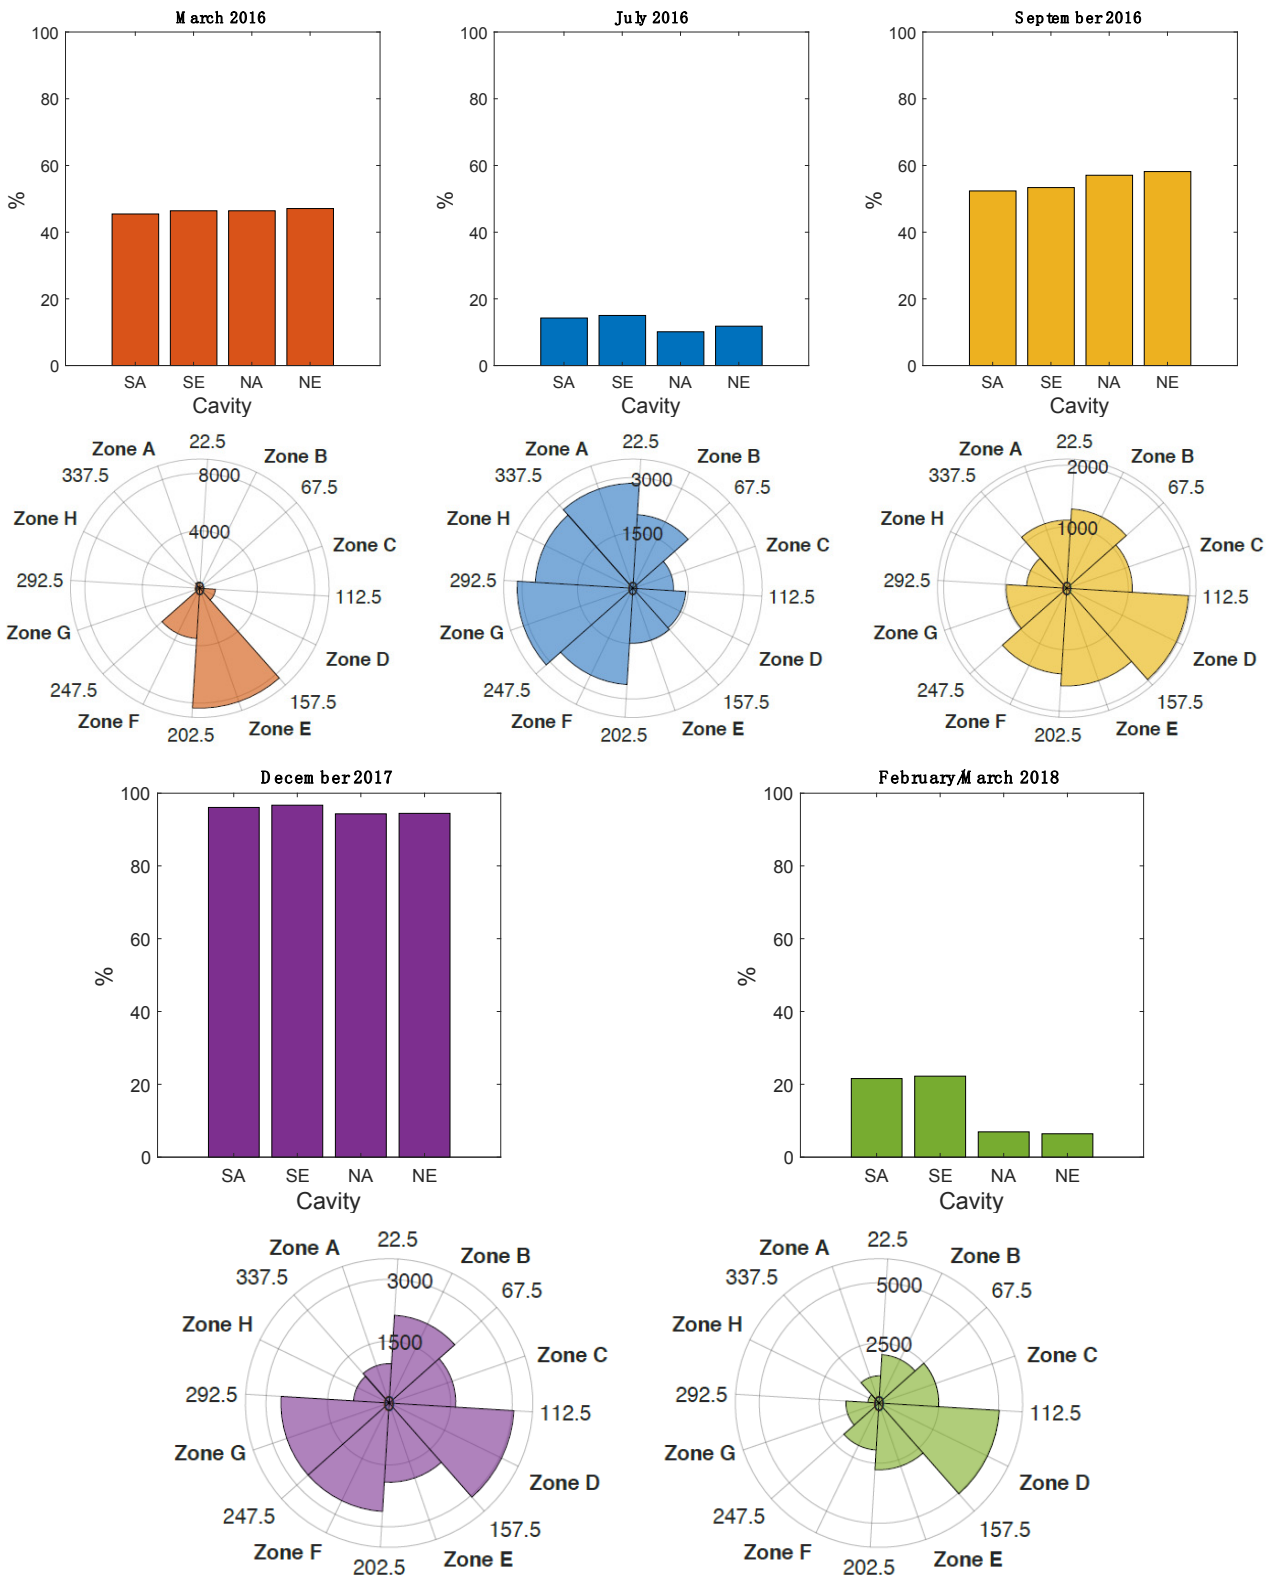


Fig. 3 The bar charts present the percentage of each period with lower temperature on the rear side of the roofing than in the outdoor air. The polar charts show the occurrence of wind from different directions towards the house. The radial axes in the polar charts represent the number of measurements within a zone. Note that the scale of the radial axes varies between the different periods.

Influence of Local Weather Conditions on Ventilation of a Pitched Wooden Roof

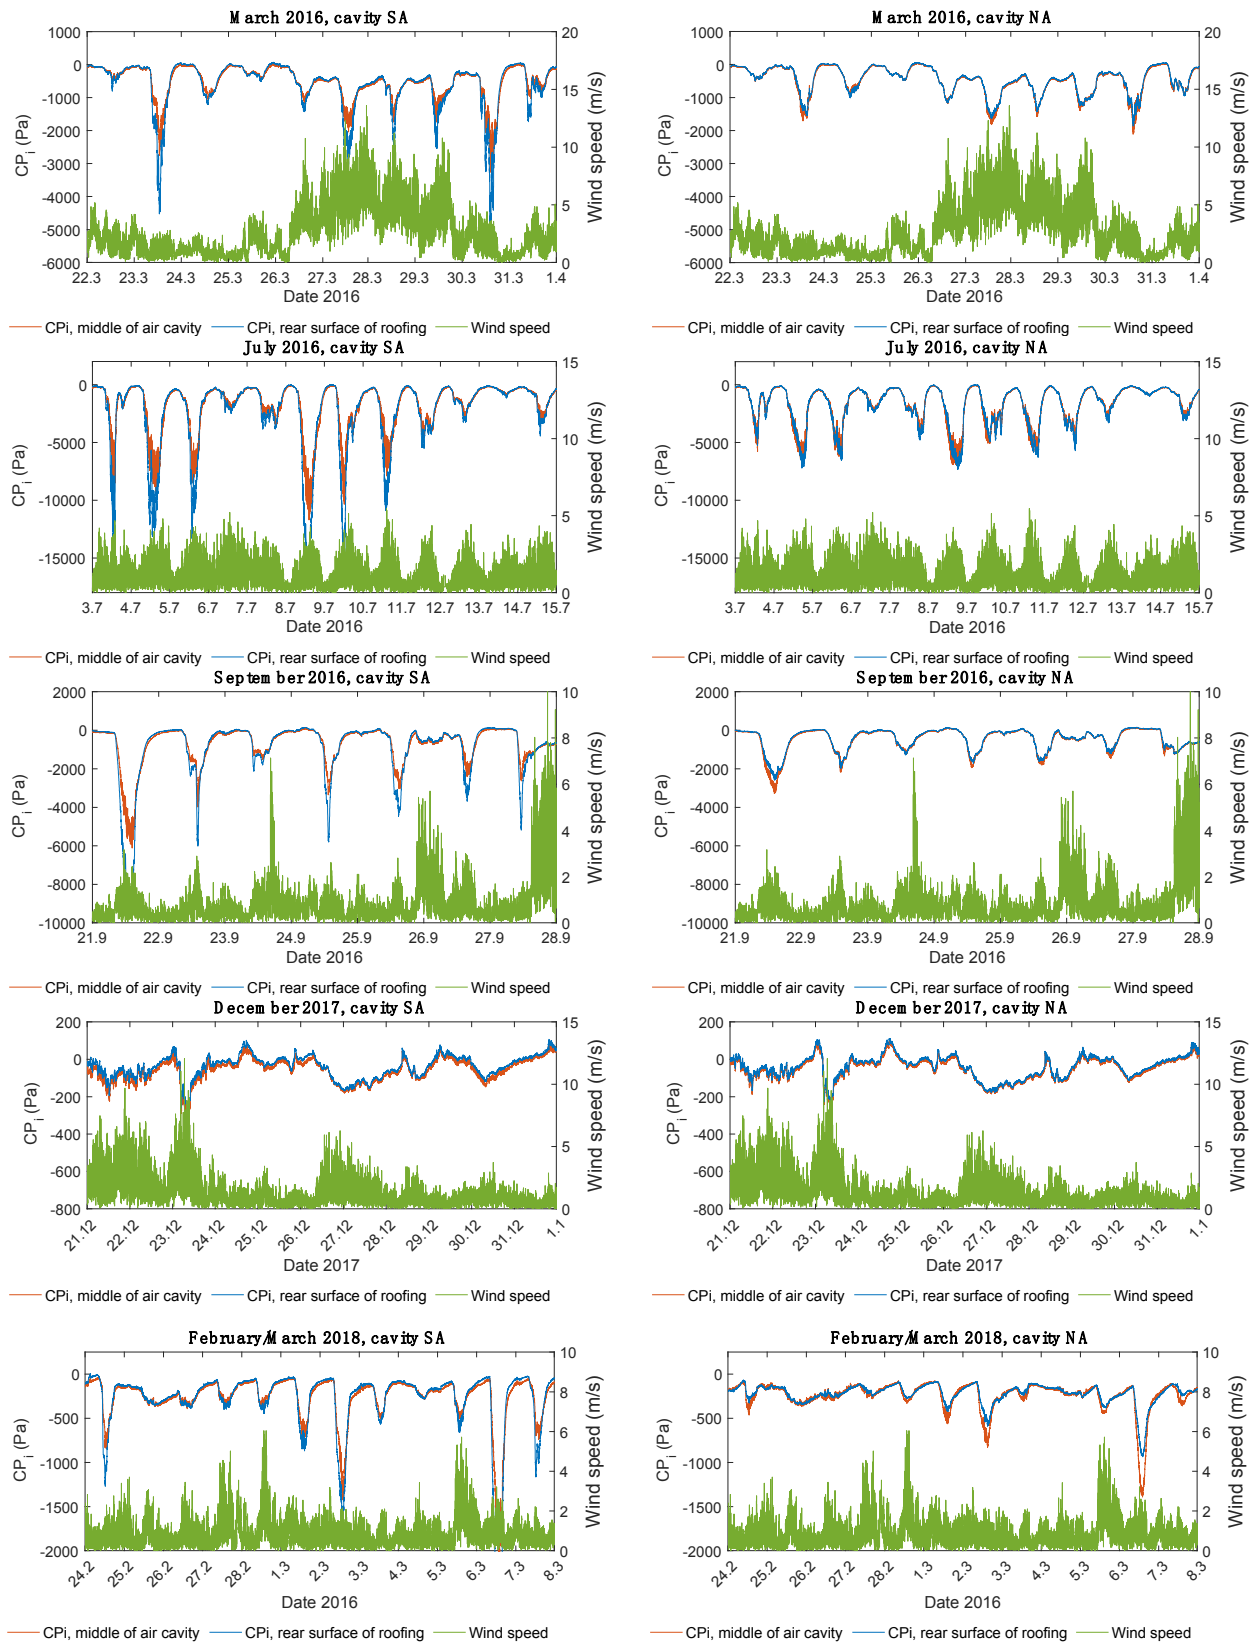


Fig. 4 Variation in CP_i and wind speed in the five periods. Results for cavities SA (left) and NA (right) are presented. Note different axes scales.

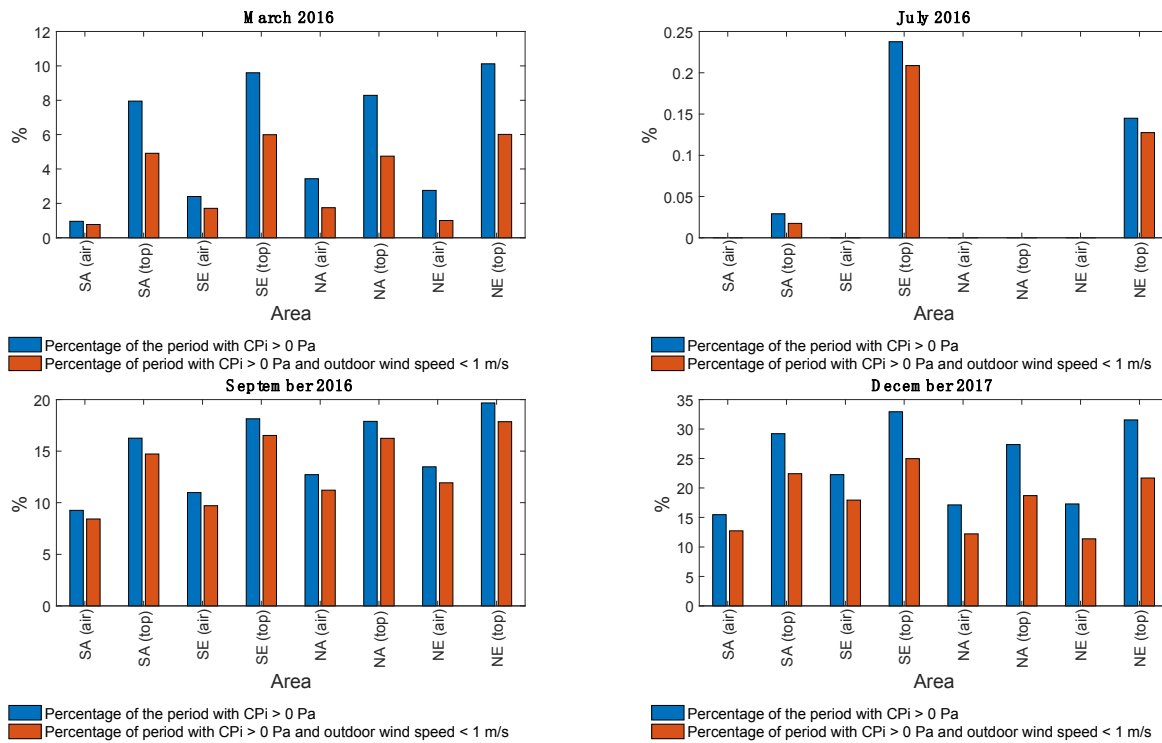


Fig. 5 Percentage of each period with positive CP_i , and percentage of each period with positive CP_i at the same time as the wind speed is < 1 m/s. Note different axes scales.

which covered the roof in this period, has an isolating effect, hence protecting the roof from the low outdoor temperatures and subsequent undercooling. Undercooling was still present for approximately 20% of the time on the southern part of the roof.

5.2 Temperature Influence on CP_i

As recorded in Fig. 4, differences in CP_i were found when comparing the southern and the northern side of the roof. Due to heating by the sun, the negative peaks in CP_i were much larger on the southern side. The large negative peaks in CP_i correspond to the points of time with high temperatures in the air cavity found by Gullbrekken et al. [10]. The periods of positive CP_i were larger on the northern side of the roof. Together with the smaller size of negative peaks, this implies that the risk of condensation is higher at the northern side. A larger CP_i was also observed for the rear side of the roofing than for the middle of the air cavity. However, the rear side of the roofing also had a larger dry-out potential because of greater heating of the roofing during the day. This decreases the risk of long-term

moisture deposit on the OSB. Both during the spring and autumn periods, the local climate gave high temperatures during the day and shifts to low temperature during the night. The high temperatures give the large negative CP_i during daytime, while the shifts to low temperatures during night contribute to the positive CP_i . The winter period in 2017 gave positive CP_i in up to 33% of the time as a result of the long periods of undercooling. The summer period in 2016 and the winter period in 2018 showed very little and no positive CP_i , respectively. This agrees with the smaller periods of below-ambient temperature on the rear side of the roofing found in these periods.

5.3 Wind Influence on CP_i

A relationship was also shown between variation in wind and CP_i . Periods with larger wind speed corresponded to periods with low CP_i , and the opposite. However, it is not unambiguous that high wind speed leads to small CP_i , as large negative CP_i to a great extent is influenced by the temperature conditions in the air cavity. Yet, Fig. 4 shows that the positive peaks

of the CP_i decreased when the wind speed increased, and the opposite. It was also found that the wind speed was very low, i.e. below 1 m/s, during most of time when the CP_i was positive. This implies that wind speed is of importance for the condensation situation in the air cavity. Gullbrekken [14] showed that most weather stations in Norway had a daily average wind speed larger than 1 m/s more than 250 days of the year. This indicates good conditions for ventilation of roofs. However, the present paper found that the studied periods had wind speeds less than 1 m/s during 27-75% of the time. Accordingly, in cases with condensation risk it is important to study the local climate conditions in order to make sure ventilation of the air cavity is satisfactory.

A strong correlation between wind speed and air velocity in the ventilated air gap was found by Gullbrekken et al. [10] for the spring, summer and autumn periods studied. This showed how high wind speed may induce good ventilation of the roof. Even though good ventilation of the air cavity is supposed to avoid condensation [3], this study found that the risk of condensation was not eliminated. However, a very close relationship between undercooling and CP_i was seen. Undercooling may cause large changes in the partial vapor pressure in the air close to the rear side of the roofing, hence increasing the CP_i . If the undercooling is very strong, i.e., the temperature differences are large, the outside air may become a humidity source and increase the moisture at the rear side of the roofing in a ventilated roof. Ideally, the ventilation should be closed in periods with below-ambient temperature in the air cavity in order to avoid moistening of the cavity.

5.4 Consequences of Condensation

The periods with below-ambient temperature in the air cavity were longer than the periods with positive CP_i . This implies that the OSB at the rear side of the roofing was absorbing moisture due to its hygroscopic

properties, hence regulating the humidity content of the air in the cavity. Accordingly, there is low risk of visible condensate on the rear side of the roofing and hence low risk of condensate dripping onto the roof underlay. Due to the large negative peaks in CP_i , especially at the south side of the roof, the surface will experience dry-out. Consequently, there is little concern that moisture absorbed will lead to damages in the OSB. With other roofing materials, the risk of condensation and following consequences may be larger. Hens et al. [15] found that the CP_i in a flat metallic roof with ventilated cavity was positive 47% of the time at the rear side of the roofing. The study also measured that timber laths and rafters in the roof absorbed moisture.

Eqs. (1a) and (1b) were used to calculate the saturation pressures in the studied air cavities. As the equations are empirical, other results than those found in this study may be obtained if using equations from other references. In addition, the CP_i can only be utilised to evaluate the risk of condensation on a given surface. To be able to evaluate the amount of condensate, the integral of all positive CP_i with time must be considered. This is not studied in this paper and could be done in further research.

6. Conclusions

The study of the roof on the ZEB Test Cell Laboratory shows distinct periods with below-ambient temperature in the ventilated air cavity. Large differences between seasons are found. Positive CP_i is measured during long periods, especially in spring, autumn and winter without snow. Large proportions of the periods with positive CP_i have wind speeds less than 1 m/s. The periods with below-ambient temperature in the air cavity are larger than the periods with positive CP_i . This implies that the materials in the roof absorb moisture and regulate the humidity in the air cavity. However, large negative peaks in CP_i indicate dry-out of the construction.

Acknowledgements

The authors gratefully acknowledge the financial support by the Research Council of Norway and several partners through the Centre of Research-based Innovation “Klima 2050” (www.klima2050.no). Support is also given by FME ZEB (www.zeb.no). Special thanks give to CAD operator Remy Eik for help with Fig. 2.

References

- [1] Lisø, K. R., and Kvande, T. 2007. *Klimatilpasning av bygninger (Climate Adaptation of Buildings)*. Oslo, Norway: SINTEF Building and Infrastructure.
- [2] Edvar den, K. I., and Ramstad, T. Ø. 2014. *Trehus Håndbok 5 (Wood Frame Houses Handbook 5)*. Norway: SINTEF Building and Infrastructure.
- [3] Bøhlerengen, T. 2007. “Isolerte skrå tretak med lufting mellom vindspærre og undertak (Insulated Pitched Wooden Roofs with Ventilation between Wind Barrier and Underroof.” In *SINTEF Building Research Design Guides 525.101*. Oslo, Norway: SINTEF Building and Infrastructure.
- [4] Tong, S., and Li, H. 2014. “An Efficient Model Development and Experimental Study for the Heat Transfer in Naturally Ventilated Inclined Roofs.” *Building and Environment* 81: 296-308.
- [5] Villi, G., Pasut, W., and De Carli, M. 2009. “CFD Modelling and Thermal Performance Analysis of a Wooden Ventilated Roof Structure.” *Building Simulation* 2 (3): 215-28.
- [6] Hofseth, V. 2004. *Studie av luftede trekonstruksjoner (Study of Ventilated Roof Constructions)*. Trondheim, Norway: Norwegian University of Science and Technology.
- [7] Lee, S., Park, S. H., Yeo, M. S., et al. 2008. “An Experimental Study on Airflow in the Cavity of a Ventilated Roof.” *Building and Environment* 44 (7): 1431-9.
- [8] Nusser, B., and Teibinger, M. 2013. “Experimental Investigations about the Air Flow in the Ventilation Layer of Low Pitched Roofs.” Presented at 2nd Central European Symposium on Building Physics, Vienna, Austria.
- [9] Blom, P. 2001. “Venting of Attics and Pitched, Insulated Roofs.” *Journal of Thermal Envelope and Building Science* 25 (1): 32-50.
- [10] Gullbrekken, L., Kvande, T., and Time, B. 2017. “Ventilated Wooden Roofs: Influence of Local Weather Conditions-Measurements.” Presented at NSB 2017—11th Nordic Symposium on Building Physics, Trondheim.
- [11] Thue, J. V. 2016. *Bygningsfysikk Grunnlag (Building Physics—Basics)*. Bergen, Norway: Fagbokforlaget.
- [12] Hens, H. 2007. *Building Physics—Heat, Air and Moisture*. Berlin, Germany: Ernst & Sohn.
- [13] Hens, H. 2007. *Building Physics—Heat, Air and Moisture*. Berlin, Germany: Ernst & Sohn.
- [14] Gullbrekken, L. 2018. “Climate Adaptation of Pitched Wooden Roofs.” Ph.D. thesis, Norwegian University of Science and Technology.
- [15] Hens, H., Janssens, A., and Zheng, R. 2002. “Zinc Roofs: An Evaluation Based on Test House Measurements.” *Building and Environment* 38 (6): 795-806.