

## **Exergetic performance and comparative assessment of bottoming power cycles operating with carbon dioxide based binary mixture as working fluid**

Muhammad Haroon<sup>1,\*</sup>, Abubakr Ayub<sup>2,€</sup>, Nadeem Ahmed Sheikh<sup>1,£</sup>, Muhammad Imran<sup>3,¥</sup>

<sup>1</sup> Department of Mechanical Engineering, International Islamic University Islamabad (IIUI),  
Islamabad, Pakistan

<sup>2</sup> Department of Mechanical and Industrial Engineering, University of Brescia, Brescia, Italy

<sup>3</sup> Mechanical Engineering & Design, School of Engineering and Applied Science, Aston  
University, Aston Triangle, Birmingham B4 7ET, UK

\* First Author: [engrmuhammadharoon31@gmail.com](mailto:engrmuhammadharoon31@gmail.com); [haroon.msme49@iiu.edu.pk](mailto:haroon.msme49@iiu.edu.pk)

€ [a.ayub@unibs.it](mailto:a.ayub@unibs.it), £ [ndahmed@gmail.com](mailto:ndahmed@gmail.com), ¥ [m.imran12@aston.ac.uk](mailto:m.imran12@aston.ac.uk)

## Abstract

*This paper evaluates the exergetic performance of gas turbine-bottoming power cycles operating with CO<sub>2</sub>-Toluene (CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub>) binary mixture as working fluid. A generic criterion for selection of CO<sub>2</sub>-based binary mixture is delineated and composition of CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture is decided based on the required minimum cycle temperature compatible with ambient conditions. For the purpose of comparison and analysis, two bottoming cycle configurations are selected, and their realistic operating conditions are determined based on ambient conditions through sensitivity analysis. The performance of bottoming cycles using CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture are compared with bottoming cycles using pure CO<sub>2</sub> as working fluid at different ambient temperatures to highlight the benefits of exploiting CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture as working fluid in arid and harsh desert climates. Comparative analysis keeping maximum cycle temperature (TIT) fixed at 673 K because of thermal stability constraint reveals that the CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> bottoming simple regenerative cycle (BSRC) configuration gives better exergetic performance compared to bottoming preheating cycle (BPHC) configuration using same working mixture at different ambient temperature conditions. As cycles operating with pure CO<sub>2</sub> can only perform better at lower ambient temperature conditions. With the increase in ambient temperatures, bottoming cycles with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture outperform and produce significant gains in exergetic and energetic performance compared to pure CO<sub>2</sub> bottoming cycles. The maximum gain in exergetic efficiency in case of BSRC and BPHC are 26.83% and 18.71% respectively at operating ambient temperature of 313 K. Also, the overall gains in energetic efficiencies in case of BSRC and BPHC are 28.92% and 10.12% respectively. However, on the basis of smaller overall heat exchanger sizes (UA), BPHC configuration is predicted as better option for bottoming cycles operating in higher ambient temperature zones performing with higher exergetic efficiency.*

## Keywords

CO<sub>2</sub>-Toluene binary mixture; Bottoming Brayton power cycles; CO<sub>2</sub>-based mixtures; Exergy analysis; Preheating cycle; Comparative analysis

## Introduction

Demand for distributed and efficient generation has led to various studies on micro-generators using waste and/or renewable energy resources. Sustainable development requires energy conversion systems which are both economically as well as environmentally sustainable. The conventional power systems, mostly using fossil fuels, although plays vital role in economic growth but so far but they pose risk to the environment in the form of global warming, depletion of ozone layer and reduction in fossil fuels. To meet the increasing energy demand while keeping checks over its harmful impacts on the environment is the main challenge for power industry in this era.

At present, several alternates for energy conversion are proposed and widely studied like Organic Rankine Cycles (ORCs) and Air Brayton cycles<sup>1-4</sup>. In recent years, supercritical carbon dioxide (sCO<sub>2</sub>) power cycles are explored in numerous applications owing to favorable thermodynamic properties of CO<sub>2</sub><sup>5</sup>. CO<sub>2</sub> offers many benefits: such as zero ozone depletion potential, nontoxic, inexpensive and abundant in nature. Importantly, the critical point of CO<sub>2</sub> is at 31°C when pressurized to 7.4MPa. The high density of CO<sub>2</sub> (or low compressibility factor) near critical point manifests in the form of lower compression work, higher cycle efficiency and compact cycle components. Owing to the less corrosive nature of CO<sub>2</sub>, it has been used in high temperature applications like solar power tower powered sCO<sub>2</sub> Brayton cycles<sup>6,7</sup> and

nuclear heat source powered sCO<sub>2</sub> Brayton cycles<sup>8-10</sup>. Numerous studies are also carried out on potential of sCO<sub>2</sub> Brayton cycles in high and low-grade waste heat recovery applications<sup>11-13</sup>.

It is observed that the performance of sCO<sub>2</sub> power cycles is sensitive to variation in environmental temperature. The cycle efficiency drops considerably when operated at higher ambient temperatures since the heat rejection is at a higher temperature compared to the critical point of CO<sub>2</sub>; therefore, the real gas benefits of using sCO<sub>2</sub> cannot be realized. Operating in arid and high temperature climatic conditions is important. For instance, the typical densely populated areas of the earth which have low precipitation and high mean annual temperatures are classified as BWh areas according to Köppen Climate Classification<sup>14</sup>. In such climatic conditions many densely populated regions and city exist such as Karachi, Riyadh, Dubai & most parts of MENA where the peak temperatures are in the range of 40°C - 50°C and constitute 12% of earth's land part.

The performance of sCO<sub>2</sub> power cycles at higher environmental temperature can be managed by shifting the critical point of CO<sub>2</sub> to higher temperature by addition of second compound in CO<sub>2</sub>; this has been done by designing CO<sub>2</sub>-based binary mixture<sup>15</sup>. The underlying idea is to design binary mixture of CO<sub>2</sub> with other organic or inorganic compound in order to shift the critical point of the mixture to higher temperatures<sup>16</sup> so that lowest operating temperature of the sCO<sub>2</sub> Brayton cycle is matched with high environmental temperatures typically of BWh areas.

Invernizzi *et al*<sup>17,18</sup> investigated various CO<sub>2</sub>-based binary mixtures as working fluids in Brayton power cycles. He found significant improvement in efficiency of the Brayton power cycles operating with binary mixtures compared to sCO<sub>2</sub> power cycles. Seungjoon *et al*<sup>19</sup> studied the performance of Brayton cycles with CO<sub>2</sub>-based binary mixtures in warm environments and found CO<sub>2</sub>/R32 and CO<sub>2</sub>/Toluene binary mixtures possessing better efficiency compared to sCO<sub>2</sub> power cycles. In solar power tower application, Manzoloni *et al*<sup>15</sup> found that Brayton power cycles operating with CO<sub>2</sub>/N<sub>2</sub>O<sub>4</sub> and CO<sub>2</sub>/TiCl<sub>4</sub> as working fluids perform better than conventional steam Rankine cycles in desert climates.

Carlos *et al*<sup>20</sup> analyzed eight CO<sub>2</sub>/refrigerants binary mixtures in recuperative and non-recuperative transcritical Rankine cycles (TRC) and suggests pure CO<sub>2</sub> TRC as favorable option owing to compactness and better environmental value compared to TRC with CO<sub>2</sub>/refrigerants. Similarly, Baomin *et al*<sup>21</sup> investigated CO<sub>2</sub> based low Global Warming Potential (GWP) zeotropic mixtures working fluids in TRC powered by low grade heat source. The authors recommended CO<sub>2</sub>/R161 for small scale systems, while CO<sub>2</sub>/R1234yf and CO<sub>2</sub>/R1234ze for large scale systems.

In essence, the research on CO<sub>2</sub>-based binary mixtures as working fluids in power cycles has been increasing in terms of working fluids selection and optimization of power cycles both for high temperature and low temperature heat sources<sup>22,23</sup>. Nonetheless, the main challenges are achievement of reasonable thermodynamic efficiencies, selection and characterization of additives for CO<sub>2</sub>-based binary mixtures compatible with wide range of heat sources. Moreover, much of the work is carried out on thermodynamic properties and thermal stability of pure and mixture working fluids.

In heat recovery application, there are many studies on use of pure and mixtures of organic compounds in ORCs<sup>24,25</sup>. Iglesias *et al*<sup>26</sup> presented a review of most relevant architectures of ORCs and compared the performance with Trilateral cycles (TCs) for low-medium grade heat recovery. They found lower first law efficiencies (between 5% to 10%) in ORCs as compared to TCs which showed efficiencies between 36% and 51%. In addition, there are other safety

and environmental issues associated with organic fluids which are high flammability of hydrocarbons, toxicity, high ozone depletion potential and high global warming potential of compounds which contain chloro-fluoro carbons. Low thermal stability of organic compounds also limits ORCs to low grade heat sources of maximum temperature not greater than 350°C-400°C. Due to such constraints, proper screening of compounds is required to use in any particular heat source application. Astolfi *et al*<sup>27</sup> compared the thermodynamic performance of ORCs and CO<sub>2</sub> power cycles in order to decide the optimum operating range. They found ORCs a suitable choice for maximum heat source temperature less than 350°C and CO<sub>2</sub> cycles for higher maximum temperatures.

The exploitation of carbon dioxide based binary mixture as working fluid in heat recovery bottoming cycles is a possible option owing to stable characteristics of carbon dioxide and higher efficiency of carbon dioxide cycles as discussed earlier. Notably, the binary mixture of carbon dioxide with suitable organic compound in proper composition can potentially provide advantage in designing a mixture with desired properties<sup>17</sup>.

In the present study, the application of CO<sub>2</sub>-based binary mixture in bottoming cycles is assessed for two different configurations. Detailed literature suggests that the application of using CO<sub>2</sub>-based binary mixtures as heat-recovery units is not previously explored extensively especially when operated in hot/arid climates. Bottoming cycles have two challenges namely, maximizing efficiency and secondly conversion to useful work. For the purpose of analysis in this work, the heat source of bottoming cycles is exhaust heat of GE-LM2500 medium scale gas turbine. Primarily, appropriate organic compound for the binary mixture is selected on the basis of thermodynamic properties, heat source compatibility, health and safety characteristics. Secondly, the thermodynamic properties of the binary mixture are calculated, and accuracy of the thermodynamic method is ensured. Then, parametric evaluation using energy and exergy analysis is conducted to choose practical conditions for cycle performance. Eventually, the comparative analysis is carried out among pure CO<sub>2</sub> and CO<sub>2</sub>-based binary mixture in bottoming cycles at different ambient/environmental temperatures. Based on comparison of energetic efficiency, exergetic efficiency, overall size of the heat exchangers (UA) and heat recovery, optimum configuration of bottoming cycle is recommended.

## **Selection and Properties of CO<sub>2</sub>-Toluene binary mixture**

### **Selection of organic additive**

The selection of appropriate organic fluid as an additive for CO<sub>2</sub> based binary mixture is challenging. In reality, there are several measures which should be visited during selection<sup>28</sup>. The additive should be:

- Environmentally benign i.e. the GWP and ODP values lie within the safe limits proposed by the standards.
- Thermally stable at high temperatures.
- Auto ignition temperature should be far greater than higher cycle temperature i.e. 673 K (400°C).
- Critical point temperature should be higher than the CO<sub>2</sub> since, the objective here is to elevate the heat sink temperature to facilitate cycle cooling process in warm environments.
- Reasonable critical point pressure.
- Non-flammable, non-toxic and good material compatibility
- Accurate thermodynamic property data should be available.

In particular, it becomes difficult to find an additive which fulfills all the aspects mentioned above for a particular application as it requires both experimental and numerical studies. Therefore, here the selection of the additive is done on the basis of one important aspect compromising the other characteristic of little relevance. The candidate working fluids for additive selection are straight chain alkanes, siloxanes and aromatic hydrocarbons<sup>18</sup>. The straight chain alkanes have low thermal stability and most of them are flammable<sup>18</sup>. Various studies show that the aromatic hydrocarbons like benzene and toluene are comparatively more stable<sup>29,30</sup>. The critical point temperatures of aromatic hydrocarbons are also greater as compared to CO<sub>2</sub> which is beneficial to design a binary mixture with higher critical temperatures. Benzene cannot be a good choice owing to its hazardous effects on human health.

In recent years, Toluene has been investigated as a working fluid in ORCs for biomass, gas turbine and IC engine waste heat recovery applications<sup>31–35</sup>. It is moderately toxic, yet the harmful effects on human life can potentially be minimized using effective filtration techniques like activated carbon adsorption methods<sup>36</sup>. It is highly flammable (flash point temperature = 3°C). However, the flammability can be curbed by keeping the content (mole fraction) of Toluene lower in the binary mixture. Thanks to its higher thermal stability; it is found to be thermochemically stable till 400°C in static tests performed in a stainless steel circuit<sup>30</sup>. At low temperatures, Toluene shows excellent material compatibility with stainless steel and Aluminum<sup>37</sup>, however, more studies are needed to determine the material compatibility at higher temperatures.

In view of the thermal stability, higher critical point temperature and reasonable critical pressure, Toluene can be selected as a favorable additive for CO<sub>2</sub> based binary mixture as working fluid in bottoming power cycles. **Table I** summarized the thermodynamic, safety and health characteristics of Toluene and CO<sub>2</sub>.

*Table I: Thermodynamic, safety and health characteristics of Toluene and CO<sub>2</sub>.*

| Fluid           | Molar Mass (kg/kmol) | P <sub>cr</sub> (bars) | T <sub>cr</sub> (°C) | Thermal Stability limit (°C) | ODP | GWP      | Autoignition Temperature (°C) | Flammability |
|-----------------|----------------------|------------------------|----------------------|------------------------------|-----|----------|-------------------------------|--------------|
| Toluene         | 92.14                | 41.08                  | 318.6                | 400                          | 0   | low      | 480                           | Yes          |
| CO <sub>2</sub> | 44.01                | 73.8                   | 31.06                | 800                          | 0   | Very low | <i>Not flammable</i>          |              |

### Properties of the binary mixture

After the selection of a reasonably appropriate additive for the binary mixture, the next key objective is to study the thermodynamic properties including the calculation of dew and bubble lines, critical points and vapor-liquid equilibrium (VLE) of the CO<sub>2</sub>-Toluene binary mixture at various compositions. This requires choosing an adequate equation of state (EoS) which can calculate thermodynamic and transport properties accurately. Cubic EoS like Peng-Robinson (PR) and Soave-Redlich-Kwong (SRK) EoS have been used widely to study the real gas properties of both pure substances and mixtures<sup>38,39</sup>. These EoS though are not proven to be very precise but they are capable of describing the thermodynamic behavior of many types of fluids and mixtures. In fact, for processes at higher pressure and temperatures, it is recommended to use cubic EoS<sup>40</sup>.

Since its first publication in 1976, PR EoS has been used extensively to study the VLE and thermodynamic properties of pure fluids and their mixtures owing to its better predictive capability compared to other two constant EoS like SRK and van der Waals EoS. Various modifications are developed in recent past to enhance the accuracy as well as to improve the predictive capability of PR EoS <sup>39</sup>.

Therefore, this study selected PR EoS and employed its original version in conjunction with van der Waals mixing rules to determine the properties of CO<sub>2</sub>-Toluene binary mixture. The original PR EoS can be expressed as,

$$P = \frac{RT}{v-b} - \frac{\alpha a}{v(v+b) + b(v-b)} \quad \text{Eq. 1}$$

$$\alpha = \left[1 + k(1 - \sqrt{T_r})\right]^2 \quad \text{Eq. 2}$$

$$k = 0.37464 + 1.54226\omega - 0.26992\omega^2 \quad \text{Eq. 3}$$

$$a = 0.45724 \frac{R^2 T_c^2}{P_c} \quad \text{Eq. 4}$$

$$b = 0.0778 \frac{RT_c}{P_c} \quad \text{Eq. 5}$$

Then, van der Waals mixing rules for binary mixture can be expressed as,

$$a_m = \sum_j \sum_j z_i z_j a_{i,j} \quad \text{Eq. 6}$$

$$b_m = \sum_j \sum_j z_i z_j b_{i,j} \quad \text{Eq. 7}$$

$$a_{i,j} = \sqrt{a_i a_j} (1 - k_{ij}) \quad \text{Eq. 8}$$

$$b_{i,j} = \frac{b_i + b_j}{2} \quad \text{Eq. 9}$$

Where, ‘ $\omega$ ’ is acentric factor of pure fluid. The value of binary interaction parameter ‘ $k_{ij}$ ’ can be computed using experimental VLE data. Fortunately, the experimental VLE and critical points data for CO<sub>2</sub>-Toluene binary mixture is available in literature. In addition, the value if  $k_{ij}$  calculated using the experimental data is also available in ASPEN plus databank i.e.  $k_{ij} = 0.1056$ .

So, the pure fluid properties given in **Table I** and value of  $k_{ij}$  are used in PR EoS to compute the VLE, P-T envelop and T-s diagrams of CO<sub>2</sub>-Toluene binary mixture. All the calculations using PR EoS are carried out in ASPEN plus. The calculated isothermal VLE is compared with experimental data to ensure the accuracy of PR EoS as shown in **Figure 1**. As evident, the computed VLE is in close agreement with experimental VLE data.

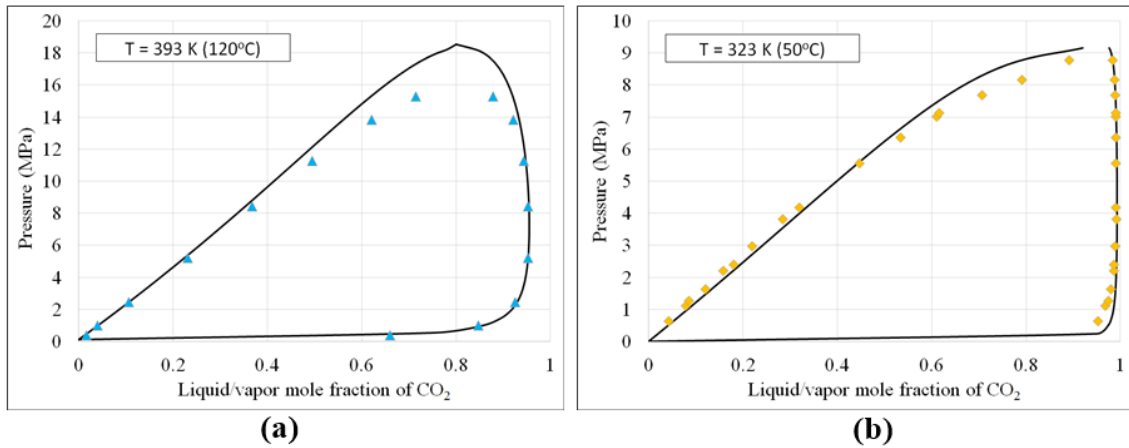


Figure 1: VLE of CO<sub>2</sub>-Toluene binary mixture at (a)  $T=393\text{ K}$  and (b)  $T=323\text{ K}$  computed using PR EoS in Aspen Plus. The experimental data taken from <sup>41,42</sup>.

Critical points are also recorded from P-T envelop at different composition and compared with available experimental data. **Figure 2** shows the critical locus computed using ASPEN plus and compared with REFPROP and available experimental data <sup>41,43</sup>. The difference of critical loci is due to the different methods followed by ASPEN plus and REFPROP; ASPEN plus uses PR EoS while REFPROP uses Kunz and Wagner model. Nevertheless, the model is reasonably accurate and matches well with experimental data.

#### Composition of the binary mixture

The bubble and dew lines for CO<sub>2</sub> and Toluene and their binary mixture at two compositions are also plotted in T-s plane to identify the cycle conditions. **Figure 3** shows T-s plot along with isobars at different pressures for pure CO<sub>2</sub>, pure Toluene and 0.95 CO<sub>2</sub>/0.05 Toluene and 0.9 CO<sub>2</sub>/0.1 Toluene composition binary mixtures. The increase in critical temperature by adoption of CO<sub>2</sub>-based binary mixture is evident.

For adequate heat rejection of bottoming power cycle at warm ambient conditions, the design minimum cycle temperature (or condensation temperature) is chosen to be  $T_{\min} = 50^{\circ}\text{C}$ . For 0.95 CO<sub>2</sub>/0.05 Toluene composition, the design  $T_{\min}$  lies inside the critical region where the PR EoS fails to compute properties as evident from **Figure 3**. Whereas, for 0.9 CO<sub>2</sub>/0.1 Toluene composition, the design  $T_{\min}$  occur on the bubble line at bubble pressure of 9.14 MPa which is a suitable condensation condition. The cycle  $T_{\min}$  on the bubble line is beneficial in terms of smaller compression/pump work and the resulting power cycle is to be a condensing cycle as proposed earlier by Angelino <sup>44</sup>. Thus, 0.9 CO<sub>2</sub>/0.1 Toluene composition is decided as working fluid to study the thermodynamic performance of bottoming power cycles and comparison with pure CO<sub>2</sub> bottoming power cycles.

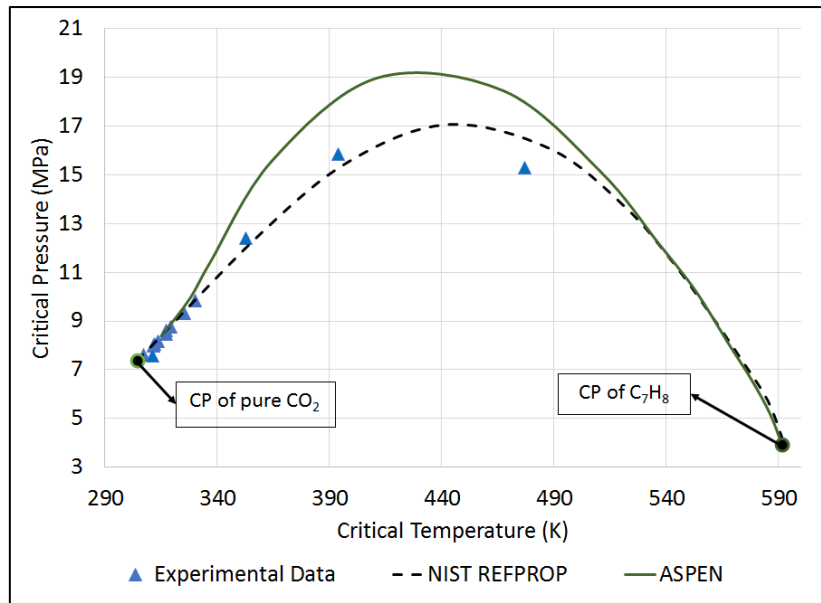


Figure 2: Critical loci of  $\text{CO}_2$ -Toluene binary mixture in  $P$ - $T$  plane. The experimental data is taken from <sup>41,43</sup>.

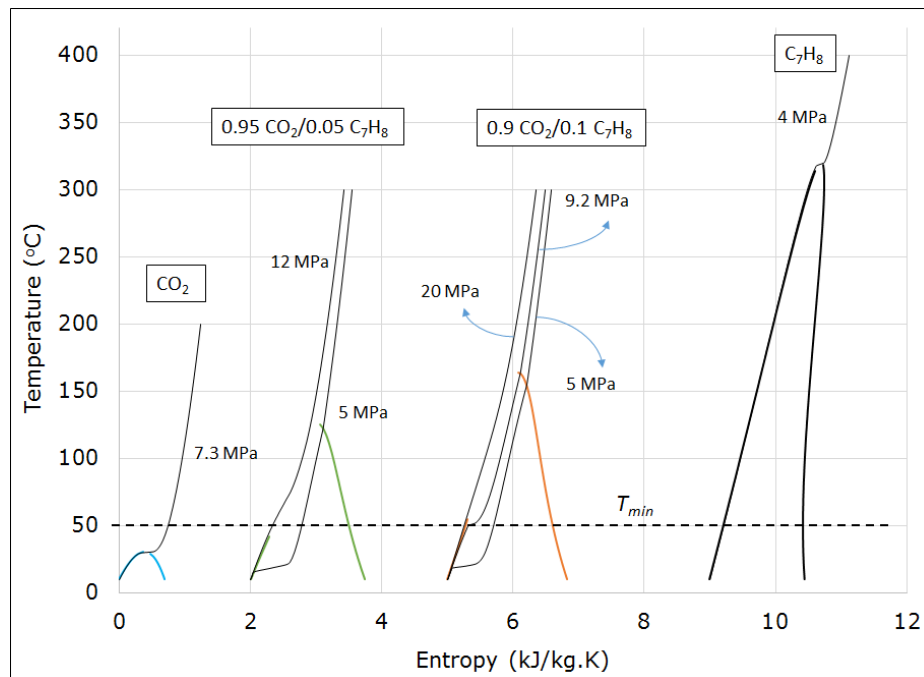


Figure 3:  $T$ - $s$  diagram of  $\text{CO}_2$ , Toluene and their binary mixtures at two compositions. This figure is adapted from <sup>17</sup>.

## Thermodynamic Method

General electric (GE) LM2500 gas turbine<sup>45</sup> is selected as the reference topping gas turbine for bottoming power cycles. The specifications of the topping cycle and exhaust gas composition are illustrated in **Table II**. Because of the thermal stability limit (i.e. 400 °C) imposed by Toluene, a medium scale gas turbine system is chosen here.



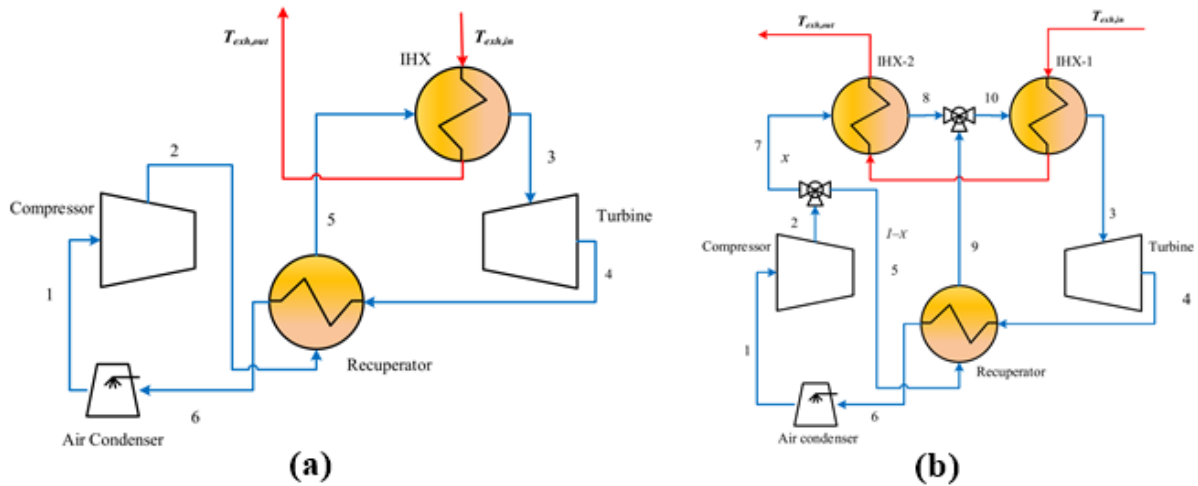


Figure 4: Bottoming cycle configurations, (a) Bottoming simple regenerative cycle (BSRC), (b) Bottoming preheating cycle (BPHC)

The analysis on topping cycle is not included since this study focuses on the performance of bottoming cycles operating with  $\text{CO}_2$ -Toluene (from now onwards refer to as  $\text{CO}_2$ - $\text{C}_7\text{H}_8$ ) binary mixture. Two plant configurations are analyzed for topping cycle exhaust heat recovery, these are: Bottoming Simple Regenerative Cycle (BSRC) and Bottoming Partial Heating Cycle (BPHC) also refer to as preheating cycle in literature. Both configurations are shown in Figure 4. BSRC is the simpler configuration with one recuperator and one integrated heat exchanger (IHX) for heat recovery; this configuration is often employed in literature for WHR applications to compare the performance with other complex cycle configurations. BPHC is a slightly complex configuration with mass split after compression in order to recover more heat from exhaust gases and to achieve better thermal match in the recuperator. This cycle proved to be high performance cycle in WHR supercritical  $\text{CO}_2$  power cycles<sup>11,46,47</sup> that's why this configuration is selected here in the case of  $\text{CO}_2$ - $\text{C}_7\text{H}_8$  binary mixture condensation power cycles.

Table II: GE LM2500 topping gas turbine specification and exhaust gas composition.

| Parameter                                         | Value         | Exhaust gas composition |                |
|---------------------------------------------------|---------------|-------------------------|----------------|
|                                                   |               | Component               | Mole Fractions |
| Power Output                                      | 24.8 MW       | $\text{CO}_2$           | 0.03           |
| Efficiency                                        | 35.1 %        | Nitrogen                | 0.76           |
| Pressure Ratio (P.R)                              | 19            | Oxygen                  | 0.14           |
| Mass Flow Rate of exhaust gases (MFR)             | 71 Kg/Sec     | Water                   | 0.07           |
| Exhaust gases Temperature ( $T_{\text{exh,in}}$ ) | 798 K (525°C) |                         |                |

The cycle model and specifications are developed in ASPEN plus calculation environment. IHX and recuperator are modeled using minimum temperature difference approach known as MITA approach. This approach divides a heat exchanger into internal zones and computes temperatures and temperature differences in each zone employing energy balance and converges the final solution according to given value of MITA. This approach seems more reliable as compared to conventional methods which assume the effectiveness value for a heat exchanger and computes the outlet temperatures considering the entire heat exchanger as a black box. Moreover, MITA approach also provides the conditions at which pinch occurs inside a heat exchanger so that to avoid those conditions during cycle calculations.

## Air Condenser Modeling

To model air condenser in the bottoming cycles, a designed value of temperature difference at the outlet of condenser is considered i.e. 10°C and the cycle minimum temperature ( $T_{\min}$ ) or compressor inlet temperature are calculated using,

$$T_{\min} = T_{amb} + 10^{\circ}\text{C} \quad \text{Eq. 10}$$

This approach is beneficial to avoid pinch in air condensers during changes in ambient temperatures ( $T_{amb}$ )<sup>3</sup>.

## Performance Indicators

The energy balance calculations are carried out using ASPEN plus followed by computation of first law efficiency using following equation:

$$\eta_I = \frac{\dot{W}_{net}}{\dot{Q}_{in}} \quad \text{Eq. 11}$$

For second law or exergetic analysis, the exergy of each stream is calculated, and exergy destroyed in each component of the power cycle is determined using exergy balance<sup>48-50</sup>. The exergy balance for each component of the cycle are given in **Table III**.

Table III: Exergy balance equations for components of the bottoming power cycles.

| Component   | Exergy balance                                                    | Eq. No |
|-------------|-------------------------------------------------------------------|--------|
| Compressor  | $E_{d,C} = W_C + E_x - E_{x,2}$                                   | Eq. 12 |
| Turbine     | $E_{d,T} = -W_T + E_{x,3} - E_{x,4}$                              | Eq. 13 |
| Recuperator | $E_{d,rec} = E_{x,5} - E_{x,9} + E_{x,4} - E_{x,6}$               | Eq. 14 |
| Condenser   | $E_{d,cond} = E_{x,6} - E_{x,1} + E_{x,Air\ in} - E_{x,Air\ out}$ | Eq. 15 |
| IHX-1       | $E_{d,IHX1} = E_{x,exhin} - E_{x,exhout,i} + E_{x,10} - E_{x,3}$  | Eq. 16 |
| IHX-2       | $E_{d,IHX2} = E_{x,exhin,i} - E_{x,exhout} + E_{x,7} - E_{x,8}$   | Eq. 17 |

Total exergy destroyed, exergy input, exergetic efficiency and exergy destruction ratio are computed using Eqs 9, 10, 11 and 12 respectively, as follows:

$$\dot{E}_d = \dot{E}_{d,C} + \dot{E}_{d,T} + \dot{E}_{d,rec} + \dot{E}_{d,cond} + \dot{E}_{d,IHX1} + \dot{E}_{d,IHX2} \quad \text{Eq. 18}$$

$$\dot{E}_{input} = \dot{E}_{x,exhin} - \dot{E}_{x,exhout} + \dot{E}_{x,Air\ in} - \dot{E}_{x,Air\ out} \quad \text{Eq. 19}$$

$$\eta_{II} = 1 - \frac{\dot{E}_d}{\dot{E}_{input}} \quad \text{Eq. 20}$$

$$\dot{E}_{d,ratio} = \frac{\dot{E}_d}{\dot{E}_{input}} \quad \text{Eq. 21}$$

## Validation

The accuracy of the thermodynamic method of this study is ensured by validation with the analysis done in previous studies. The validation is performed for SRC configuration since the PHC configuration is not studied yet in case of CO<sub>2</sub>-based binary mixture as working fluid.

The validation is carried out at following conditions taken from the literature reference: *Composition*: 0.95 CO<sub>2</sub>/0.05 CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub>,  $T_{min} = 326$  K,  $P_{min} = 12$  MPa,  $T_{max} = 623$  K,  $P_{max} = 30$  MPa and turbomachinery efficiencies = 85%. The results are extracted from the plot available in Figure 15 of the reference. **Table IV** shows the comparison of temperatures and  $\eta_I$  with the reference. The matching of results shows the accuracy of the method followed in this study.

Table IV: Validation of results for SRC configuration operating with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture

| Parameter      | Literature <sup>17</sup> | Present Work | Percentage Difference % |
|----------------|--------------------------|--------------|-------------------------|
| T <sub>2</sub> | 361                      | 358          | -0.83                   |
| T <sub>6</sub> | 498                      | 486.6        | -2.29                   |
| T <sub>4</sub> | 538                      | 540.5        | 0.46                    |
| T <sub>5</sub> | 373                      | 378          | 1.34                    |
| $\eta_I$       | 22.40%                   | 23%          | 2.68                    |

## Results and Discussion

### Exergetic Performance

In this section, the performance of bottoming cycles operating with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture are delineated. The thermodynamic performance indicators considered for the analysis are energetic efficiency, power output, exergetic efficiency and overall UA value of heat exchangers. In addition, the mass flow rates of working fluids and mass split in BPHC configuration are also studied.

Table V: Operating conditions for exergetic analysis of the bottoming power cycles.

| Parameter                                      | Value                                          |
|------------------------------------------------|------------------------------------------------|
| Cycle minimum temperature T <sub>min</sub> (K) | 323 K                                          |
| Cycle minimum pressure P <sub>min</sub> (MPa)  | P <sub>sat</sub> @ T <sub>min</sub> = 9.14 MPa |
| Cycle maximum temperature, TIT (K)             | 673 K                                          |
| Turbomachinery isentropic efficiency (%)       | 80%                                            |
| Pinch point in heat recovery units(s)          | 10 K                                           |

The internal heat exchanger (recuperator) is a very sensitive component of any recuperative cycle because of its location in the cycle; the amount of heat recuperation in the recuperator decides the heat load of components which are located ahead of the recuperator. In power cycles considered in this study, the components which are connected at outlet streams of the recuperator are cooler/condenser and heat recovery unit (IHX-I). Therefore, the influence of minimum internal temperature difference in the recuperator (MITA<sub>R</sub>) on cycle performance parameters is investigated.

The input operating conditions for cycle calculations are given in **Table V**. The simultaneous effect of MITA<sub>R</sub> and cycle maximum pressure (P<sub>max</sub>) on energetic and exergetic performance

of the cycles are studied. **Figure 5** illustrates the exergetic efficiency and exergy destruction rate ratio of both BSRC and BPHC operating with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture. In both cycle configurations, the exergetic performance increases with increase in cycle maximum pressure. The effect of MITA<sub>R</sub> shows that the maximum performance occurs at small value of MITA<sub>R</sub> for both cycle configurations. It is evident that the performance of BPHC is lower than the BSRC mainly due to larger exergy destruction ratio of the cycle components. This result here in case of the binary mixture is a converse of the performance in case pure CO<sub>2</sub> bottoming power cycles in which BPHC performed better than BSRC as found by various studies in literature<sup>46,47</sup>. **Figure 5** also demonstrate that the influence of MITA<sub>R</sub> on the exergetic performance in BSRC is comparatively more as compared to BPHC in which the exergetic performance is not very sensitive to change in MITA<sub>R</sub> since the three performance lines are closer to each other.

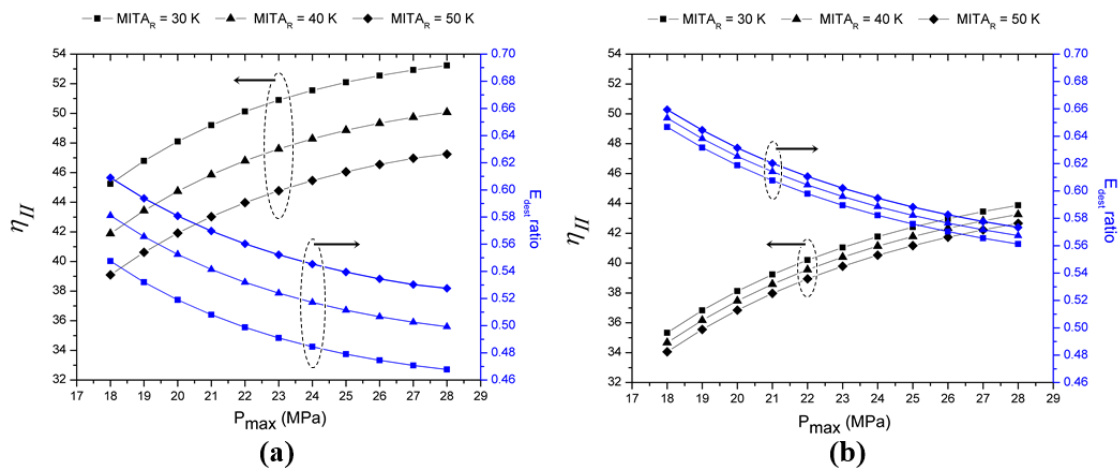


Figure 5: Exergetic efficiency and exergy destruction ratio of (a) BSRC and (b) BPHC with respect to cycle maximum pressure and minimum temperature difference inside the recuperator (MITA<sub>R</sub>).

**Figure 6** displays the overall UA of heat exchangers and mass flow rate of working fluid mixture for both cycle configurations. The overall UA of heat exchangers provides the indication of overall size footprint of the power cycle. The increase in P<sub>max</sub> results in decrease in overall UA for both cycle configurations. However, the BPHC shows lower overall UA values as compared to BSRC even though the number of components in the BPHC is large. A very large value of overall UA for BSRC at MITA<sub>R</sub> = 30 K is also evident which is the indication of very low minimum temperature in any of the heat exchanger in the cycle (i.e. occurrence of pinch), which is physically impossible. Therefore, low values of P<sub>max</sub> are evidenced to be not suitable for operation of the bottoming cycles. Furthermore, mass flow rate of binary mixture working fluid is also lower at larger values of P<sub>max</sub> which seems to be a good point in terms of cycle size and maintenance cost. The net power produced by both cycle configurations are shown in **Figure 7**. The BPHC produced more power compared to BSRC and the difference is more prominent at larger values of MITA<sub>R</sub>.

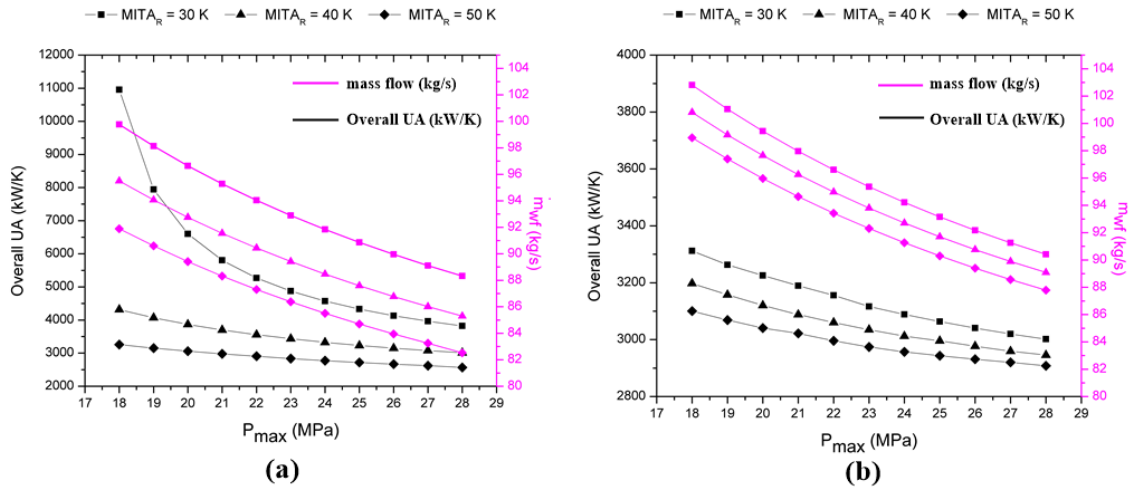


Figure 6: Overall UA of heat exchangers (black color) and working fluid mass flowrate (violet color) of (a) BSRC and (b) BPHC with variation in cycle maximum pressure and minimum internal temperature difference inside the recuperator ( $MITA_R$ ).

As a result of sensitivity analysis, practical performance conditions for both cycle configurations are decided keeping in view that the smaller values of  $MITA_R$  leads to larger overall UA (i.e. larger size of power cycle), on the other hand, very high values of  $P_{max}$  can cause difficulty in component design. Thus,  $MITA_R = 40$  K and  $P_{max} = 25$  MPa are decided as a reasonable performance condition. The T-Q curve of recuperator of both cycles at the decided condition are shown in **Figure 8**. As shown, the minimum internal temperature difference i.e. pinch point in case of BSRC occur at hot stream outlet and cold stream inlet while in case of BPHC the pinch point occurs at hot stream inlet and cold stream outlet. This difference arises due to the difference of specific heats and mass flow rates in the recuperator of the two cycle configurations.

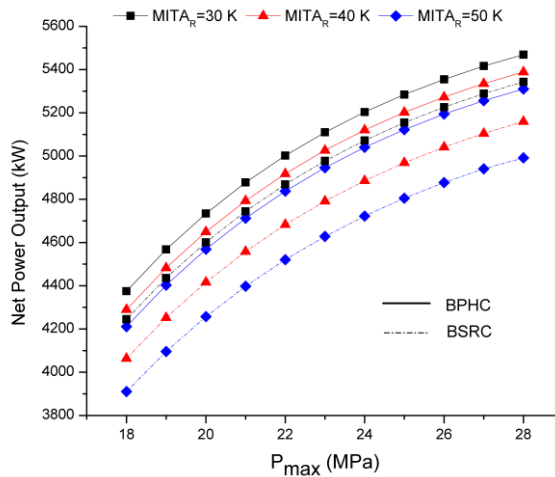


Figure 7: Net power produced by BSRC (dotted lines) and BPHC (solid lines) with variation in cycle maximum pressure and minimum internal temperature difference inside the recuperator ( $MITA_R$ ).

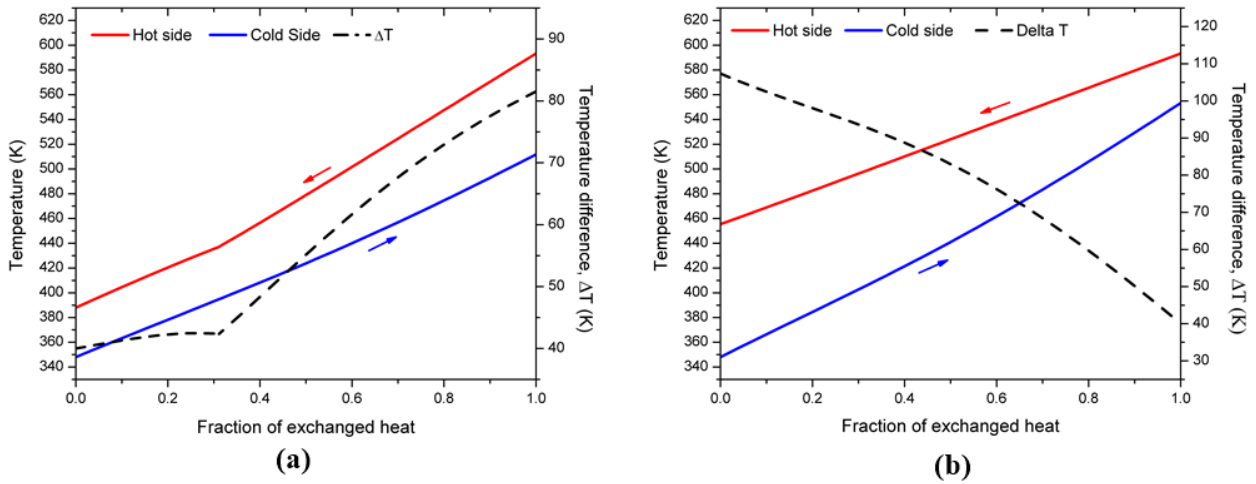


Figure 8: Temperature-heat exchange ( $T-Q$ ) curves of recuperator in (a) BSRC and (b) BPHC. Hot stream corresponds to stream coming from turbine side while cold stream corresponds to stream coming from compressor side. Dotted lines show temperature difference between the two streams.

The distribution of input exergy into net power output and exergy destruction rates for the components of two cycle configurations at decided conditions are shown in **Figure 9**. In BSRC, comparatively larger portion of exergy input is converted to net power output that is why it has larger exergetic efficiency as discussed above. Also, maximum exergy is destroyed in the recuperator owing to large temperature differences. The second component with large exergy destruction rate is IHX and then condenser at third level. In case of BPHC, the condenser showed largest exergy destruction rate because it also deals with large temperature differences. Due to the mass split in BPHC, the recuperator doesn't cool the hot side from turbine to significantly lower temperature as in the case of BSRC. As a result, the heat load of condenser increases which also enhances the exergy destruction rate in it. Hence, recuperator and condenser are the critical components both in BSRC and BPHC in terms of component design. The results of both bottoming power cycles at decided practical conditions are summarized in **Table VI**.

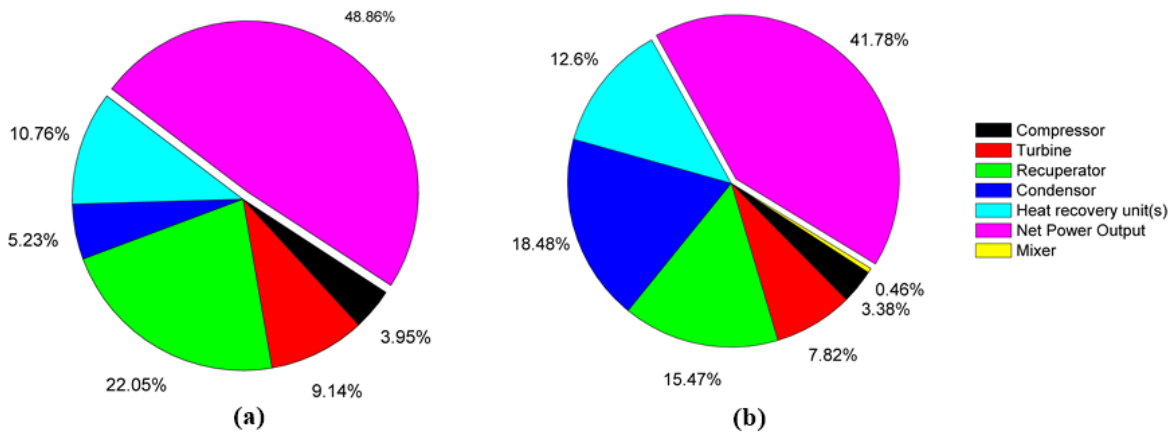


Figure 9: Distribution of input exergy from topping gas turbine exhaust into net power output and exergy destruction rates in components of (a) BSRC and (b) BPHC at decided conditions.

Table VI: Summary of results at  $P_{max} = 25 \text{ MPa}$ ,  $MITA_R = 40 \text{ K}$ .

| Performance Parameter    | CO <sub>2</sub> -C <sub>7</sub> H <sub>8</sub> BSRC | CO <sub>2</sub> -C <sub>7</sub> H <sub>8</sub> BPHC |
|--------------------------|-----------------------------------------------------|-----------------------------------------------------|
| $\eta_I$ (%)             | 22.58                                               | 15.10                                               |
| $\eta_{II}$ (%)          | 48.86                                               | 41.78                                               |
| $\dot{W}_{net}$ (kW)     | 4968.86                                             | 5201.93                                             |
| $\dot{Q}_{recv}$ (kW)    | 22001.35                                            | 34440.83                                            |
| UA (kW/K)                | 3232.28                                             | 2995.71                                             |
| $m\dot{c}_{CO_2}$ (kg/s) | 87.59                                               | 91.70                                               |
| $x$                      | <i>No split</i>                                     | 0.50                                                |

## Thermodynamic Comparison

**Table VI** have demonstrated important results on the performance of two configurations of bottoming cycles operating with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture as working fluid. However, it is interesting to compare the performance with the bottoming cycles operating with pure CO<sub>2</sub> to observe the influence of  $P_{max}$  and  $T_{amb}$  on the performance and to determine the optimal operating range for different working fluids. Comparative assessment is also essential to ascertain the benefits and drawbacks of use of CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture in bottoming power cycles.

### Comparison at varying $P_{max}$

**Figure 10**(a) shows the influence of  $P_{max}$  on the exergetic efficiency of all cases of bottoming power cycles investigated in this study at  $MITA_R = 40 \text{ K}$ . As noted earlier, the exergetic efficiency of all cycles is increasing with increase in  $P_{max}$ . The BSRC configuration in case of pure CO<sub>2</sub> and CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> working fluids demonstrate higher exergetic performance as compared to BPHC configuration. Figure 10(b) illustrates net power produced with variation in  $P_{max}$ . The overall trend demonstrates that the power cycle configurations operating with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> working fluid produced more power compared to configurations with pure CO<sub>2</sub> working fluid. The behavior of overall UA for all investigated cycles is shown in Figure 10(c). The overall UA of cycles operating CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> working fluid are higher compared to cycles with pure CO<sub>2</sub>.

Inclusively, the higher exergetic performance and power output in power cycles operating with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> working fluid comes with higher overall UA i.e. larger power plant size footprint.

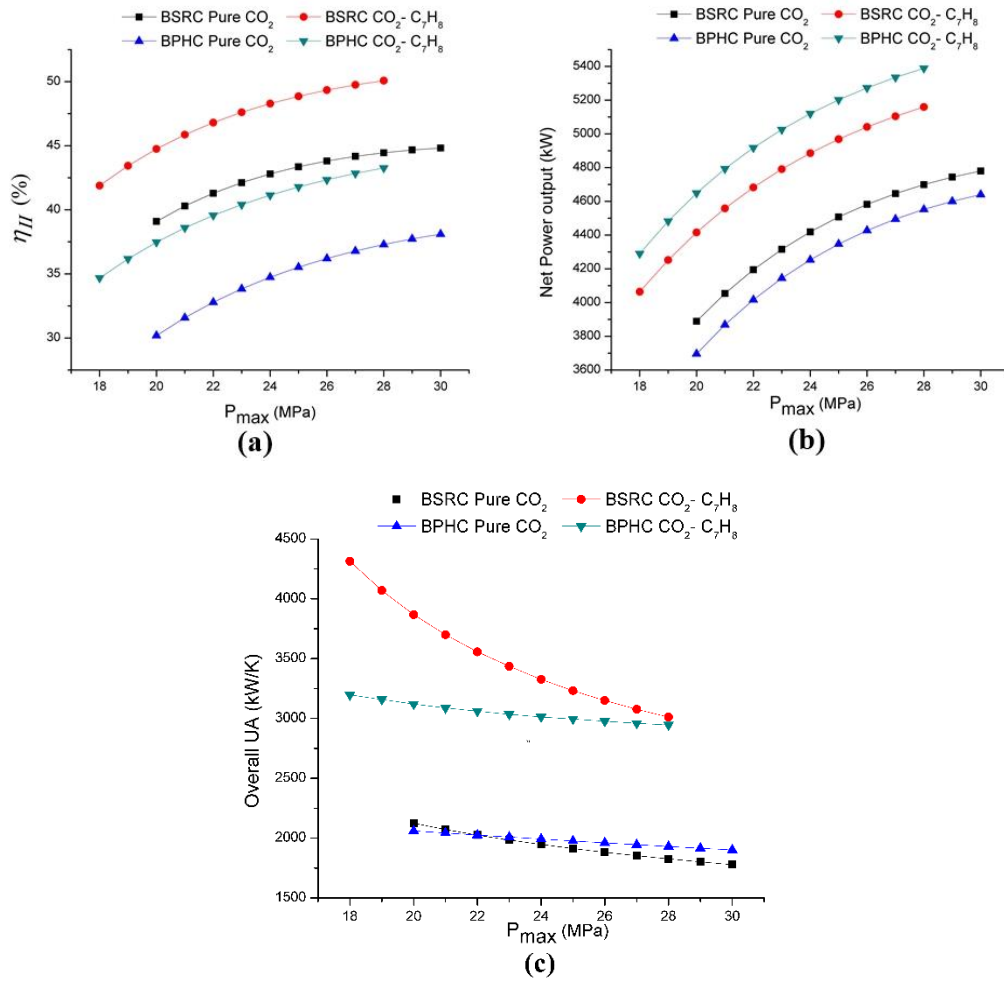


Figure 10: Comparison of exergetic efficiency (a), power output (b) and overall UA (c) of two bottoming cycles configurations operating with pure CO<sub>2</sub> and CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture at varying P<sub>max</sub>.

### Comparison at varying T<sub>amb</sub>

The influence of variation in ambient temperature on the performance of BSRC and BPHC in case of CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> and pure CO<sub>2</sub> working fluids is also investigated. The purpose is to study the cycle performance when cycle is operating in off design conditions; the variation in T<sub>amb</sub> changes the cycle condensing temperature T<sub>min</sub>, which significantly influences the cycle performance. In case of binary mixture of CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub>, the critical temperature is shifted to higher critical temperature (as shown in Figure 3 in properties section) to match with hot ambient conditions. So, here a comparative analysis is performed to highlight the benefit of CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture for power cycle subject to varying condensation temperatures.



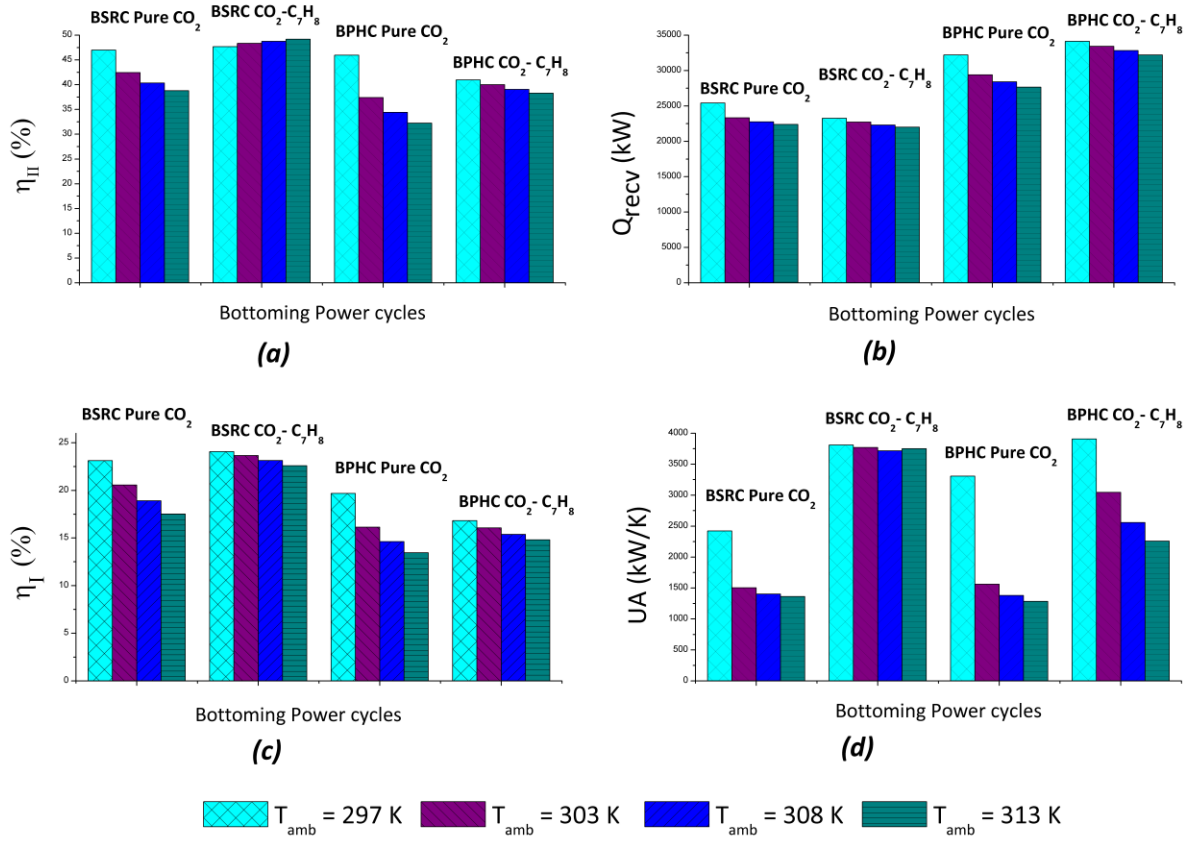


Figure 11: Thermodynamic comparison of bottoming power cycles operating with  $\text{CO}_2\text{-C}_7\text{H}_8$  and pure  $\text{CO}_2$  as working fluids at four ambient temperature conditions.

(a) Exergetic efficiency (b) Heat recovery (c) Energetic efficiency and (d) overall UA of heat exchangers.

Table VII: Conditions for comparative analysis among  $\text{CO}_2\text{-C}_7\text{H}_8$  and pure  $\text{CO}_2$  bottoming power cycles

| Parameter                                | Value                                     |                           |
|------------------------------------------|-------------------------------------------|---------------------------|
|                                          | $\text{CO}_2\text{-C}_7\text{H}_8$ cycles | Pure $\text{CO}_2$ cycles |
| Cycle minimum temperature $T_{min}$ (K)  | Depends on Ambient Temperature            |                           |
| Cycle minimum pressure $P_{min}$ (MPa)   | $P_{sat} @ T_{min}$                       | $1.1 P_{cr}^{17}$         |
| Cycle maximum temperature, TIT (K)       | 673 K                                     |                           |
| Pressure ratio                           | 2.7                                       |                           |
| Turbomachinery isentropic efficiency (%) | 80%                                       |                           |
| Pinch point in heat recovery units(s)    | 10 K in IHX-I<br>40 K in IHX-II           |                           |
| Pinch point in recuperator               | 40 K                                      |                           |

The general conditions for comparison are given in [Table VII](#). In case of  $\text{CO}_2\text{-C}_7\text{H}_8$  bottoming cycles, the cycle minimum pressure at certain value of  $T_{min}$  is the saturation pressure i.e.  $P_{sat} @ T_{min}$ , since the condition lie on bubble line of the binary mixture. However, cycle minimum pressure  $P_{min}$  in case of pure  $\text{CO}_2$  bottoming power cycles is considered to be slightly larger than critical point pressure of pure  $\text{CO}_2$  owing to two vital reasons:

- The selection of  $P_{min}$  larger than critical pressure enhances the thermodynamic efficiencies of pure  $\text{CO}_2$  cycles at higher cycle minimum temperatures ( $T_{min}$ )<sup>17</sup>.

- To avoid the risk of two-phase flow at the compressor inlet which is detrimental for the performance of compressor<sup>51,52</sup>.

**Figure 11** illustrates the energetic efficiency, exergetic efficiency, heat recovery and overall UA of BSRC and BPHC configurations in case of both CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> and pure CO<sub>2</sub> as working fluids.

Following points can be extracted from this comparative analysis:

- Considering the energetic and exergetic performance of pure CO<sub>2</sub> bottoming cycles, the cycles shows greater efficiencies at T<sub>amb</sub> = 297 K, but the performance is decreasing at higher values of T<sub>amb</sub>. Also, the performance of BSRC is better than BPHC at higher T<sub>amb</sub> conditions.
- Considering the energetic and exergetic performance of CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> bottoming cycles, the BSRC performs better than BPHC at all T<sub>amb</sub> conditions.

*Table VIII: Percentage gain in energetic and exergetic performance in CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> bottoming cycles with reference to pure CO<sub>2</sub> bottoming cycles.*

| T <sub>amb</sub> | CO <sub>2</sub> -C <sub>7</sub> H <sub>8</sub> BSRC |                | CO <sub>2</sub> -C <sub>7</sub> H <sub>8</sub> BPHC |                |
|------------------|-----------------------------------------------------|----------------|-----------------------------------------------------|----------------|
|                  | η <sub>II</sub>                                     | η <sub>I</sub> | η <sub>II</sub>                                     | η <sub>I</sub> |
| <b>297</b>       | 1.47                                                | 4.06           | -10.91                                              | -14.47         |
| <b>303</b>       | 13.88                                               | 15.10          | 6.96                                                | -0.47          |
| <b>308</b>       | 20.84                                               | 22.38          | 13.50                                               | 5.22           |
| <b>313</b>       | 26.83                                               | 28.92          | 18.71                                               | 10.12          |

- The bottoming cycles with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> shows better energetic and exergetic performance at higher T<sub>amb</sub> conditions as compared to their pure CO<sub>2</sub> counterpart configurations. The percentage gain in performance of CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> bottoming cycles with reference to pure CO<sub>2</sub> bottoming cycles is recorded in **Table VIII**. As evident, the gain in case of CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> BSRC is more as compared to CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> BPHC particularly at higher ambient temperatures.
- In terms of heat recovery, the BPHC reveals higher values in case of both CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> and pure CO<sub>2</sub> cycles.
- The BSRC depicts highest overall UA among all the cases while bottoming cycles with pure CO<sub>2</sub> shows smaller UA values. However, BPHC with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> shows reasonable UA values at higher T<sub>amb</sub> conditions.

Based on comparative analysis, it is evident that the bottoming cycles operating CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> working fluid performs better than bottoming cycles with pure CO<sub>2</sub> at higher T<sub>amb</sub> conditions. Besides, the BSRC with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> shows highest thermodynamic performance but at the cost of larger UA compared to other configurations. BPHC with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> can be selected as better choice for hot/arid climatic conditions because it shows not only better performance at higher T<sub>amb</sub> conditions but also with smaller UA i.e. smaller plant size footprint. In addition, CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> BPHC is more beneficial in terms of lowering the emissions owing to larger heat recovery from exhaust gases.

## Conclusion

This paper analyzed the energetic and exergetic performance of Gas-Turbine bottoming cycles operating with CO<sub>2</sub>-Toluene binary mixture as working fluid. Two bottoming cycles configurations are selected from the best practice in literature; BSRC and BPHC configurations. The practical operating conditions for both cycles are decided based on sensitivity analysis. Moreover, a thorough comparative analysis at identical operating conditions is carried out to draw the main benefits of using CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture in place of pure CO<sub>2</sub> as working fluid in bottoming cycles.

Following points can be concluded from this study:

- Sensitivity analysis of cycle maximum pressure ( $P_{max}$ ) and minimum temperature difference inside the recuperator ( $MITA_R$ ) suggests  $P_{max} = 25$  MPa and  $MITA_R = 40$  K as practical performance conditions keeping in view the exergetic performance and size footprint of the power cycle.
- The main cause of exergy destruction in both power cycle configurations with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture are heat exchangers (IHX(s), recuperator and condenser).
- Comparative analysis among bottoming cycles configurations reveals that bottoming cycles operating with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> binary mixture yield better energetic and exergetic performance as compared to bottoming cycles with pure CO<sub>2</sub>.
- The gain in energetic and exergetic performance of CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> bottoming cycles with reference to pure CO<sub>2</sub> bottoming cycles is assessed; the performance gain increases with increase in ambient temperature. At maximum condition of  $T_{amb} = 313$  K, the gain in energetic and exergetic efficiency in case of BSRC are 28.92% and 26.83 % respectively. Whereas, the gain in case of BPHC are 10.12% and 18.71% respectively.
- Inclusively, the higher exergetic performance and power output in power cycles operating with CO<sub>2</sub>-C<sub>7</sub>H<sub>8</sub> working fluid comes with comparatively higher overall UA i.e. larger power plant size footprint.
- Taking into consideration both thermodynamic performance and overall UA, BPHC configuration is suggested as reasonable choice for higher ambient temperature conditions.

## Nomenclature

| Symbols and Abbreviations |                                                        |
|---------------------------|--------------------------------------------------------|
| BSRC                      | Bottoming simple regenerative cycle                    |
| BPHC                      | Bottoming preheating cycle                             |
| CP                        | Critical point                                         |
| EoS                       | Equation of state                                      |
| GWP                       | Global warming potential                               |
| IHX                       | Integrated heat exchanger                              |
| MITA                      | Minimum internal temperature approach                  |
| ODP                       | Ozone depletion potential                              |
| PR                        | Peng Robinson                                          |
| $\dot{Q}_{in}$            | Heat input in integrated heat exchanger                |
| R                         | Gas constant                                           |
| $T_r$                     | Reduced temperature                                    |
| UA                        | Heat transfer coefficient times area of heat exchanger |
| VLE                       | Vapor liquid equilibrium                               |
| $x$                       | Mass split                                             |

| Greek letters |                            |
|---------------|----------------------------|
| $\eta$        | Efficiency                 |
| $\omega$      | Acentric factor of a fluid |
| Subscripts    |                            |
| <i>amb</i>    | Ambient                    |
| <i>cr</i>     | Critical point             |
| <i>exh</i>    | Exhaust gases              |
| <i>max</i>    | Maximum                    |
| <i>m</i>      | Mixture                    |
| <i>recv</i>   | Recovery                   |
| <i>R</i>      | Recuperator                |
| <i>I</i>      | Energy efficiency          |
| <i>II</i>     | Exergy efficiency          |

## Declaration of Interest

None.

## References

1. Ahmadi MH, Alhuyi Nazari M, Sadeghzadeh M, et al. Thermodynamic and economic analysis of performance evaluation of all the thermal power plants: A review. *Energy Sci Eng.* 2019;7(1):30-65. doi:10.1002/ese3.223
2. Invernizzi CM, Ayub A, Di Marcoberardino G, Iora P. Pure and Hydrocarbon Binary Mixtures as Possible Alternatives Working Fluids to the Usual Organic Rankine Cycles Biomass Conversion Systems. *Energies.* 2019;12(21):4140. doi:10.3390/en12214140
3. Mohammadi K, McGowan JG. Thermo-economic analysis of multi-stage recuperative Brayton cycles: Part II – Waste energy recovery using CO<sub>2</sub> and organic Rankine power cycles. *Energy Convers Manag.* 2019;185:920-934. doi:10.1016/j.enconman.2019.01.091
4. Saghafifar M, Gadalla M. A critical assessment of thermo-economic analyses of different air bottoming cycles for waste heat recovery. *Int J Energy Res.* 2019;43(4):1315-1341. doi:10.1002/er.4243
5. Ahn Y, Bae SJ, Kim M, et al. Review of supercritical CO<sub>2</sub> power cycle technology and current status of research and development. *Nucl Eng Technol.* 2015;47(6):647-661. doi:10.1016/j.net.2015.06.009
6. Al-Sulaiman FA, Atif M. Performance comparison of different supercritical carbon dioxide Brayton cycles integrated with a solar power tower. *Energy.* 2015;82(February):61-71. doi:10.1016/j.energy.2014.12.070
7. Wang K, He YL, Zhu HH. Integration between supercritical CO<sub>2</sub> Brayton cycles and molten salt solar power towers: A review and a comprehensive comparison of different cycle layouts. *Appl Energy.* 2017;195(October):819-836. doi:10.1016/j.apenergy.2017.03.099
8. Dostal V, Driscoll MJ, Hejzlar P. A Supercritical Carbon Dioxide Cycle for Next Generation Nuclear Reactors. *Tech Rep MIT-ANP-TR-100.* 2004:1-317. doi:MIT-ANP-

9. Kulhánek M, Dostál V. Thermodynamic Analysis and Comparison of Supercritical Carbon Dioxide Cycles. *Proc SCCO2 Power Cycle Symp.* 2011:1-7. [http://www.sco2powercyclesymposium.org/resource\\_center/system\\_concepts/thermodynamic-analysis-and-comparison-of-supercritical-carbon-dioxide-cycles](http://www.sco2powercyclesymposium.org/resource_center/system_concepts/thermodynamic-analysis-and-comparison-of-supercritical-carbon-dioxide-cycles).
10. Yoon HJ, Ahn Y, Lee JI, Addad Y. Potential advantages of coupling supercritical CO<sub>2</sub> Brayton cycle to water cooled small and medium size reactor. *Nucl Eng Des.* 2012;245:223-232. doi:10.1016/j.nucengdes.2012.01.014
11. Ayub A, Sheikh NA, Tariq R, Khan MM, Invernizzi CM. Exergetic optimization and comparison of combined gas turbine supercritical CO<sub>2</sub> power cycles. *J Renew Sustain Energy.* 2018;10(4):044703. doi:10.1063/1.5038333
12. Invernizzi C, Iora P, Silva P. Bottoming micro-Rankine cycles for micro-gas turbines. *Appl Therm Eng.* 2007;27(1):100-110. doi:10.1016/j.applthermaleng.2006.05.003
13. Manente G, Fortuna FM. Supercritical CO<sub>2</sub> power cycles for waste heat recovery: A systematic comparison between traditional and novel layouts with dual expansion. *Energy Convers Manag.* 2019;197(April):111777. doi:10.1016/j.enconman.2019.111777
14. Kottek M, Grieser J, Beck C, Rudolf B, Rubel F. World Maps of Köppen-Geiger climate classification updated. *Meteorol Zeitschrift.* 2006. doi:10.1127/0941-2948/2006/0130
15. Manzolini G, Binotti M, Bonalumi D, Invernizzi C, Iora P. CO<sub>2</sub> mixtures as innovative working fluid in power cycles applied to solar plants. Techno-economic assessment. *Sol Energy.* 2019;181(January):530-544. doi:S0038092X19300210
16. Lasala S, Bonalumi D, Macchi E, Privat R, Jaubert JN. The design of CO<sub>2</sub>-based working fluids for high-temperature heat source power cycles. *Energy Procedia.* 2017;129:947-954. doi:10.1016/j.egypro.2017.09.125
17. Invernizzi CM. Prospects of mixtures as working fluids in real-gas Brayton cycles. *Energies.* 2017;10(10). doi:10.3390/en10101649
18. Invernizzi CM, Van Der Stelt T. Supercritical and real gas Brayton cycles operating with mixtures of carbon dioxide and hydrocarbons. *Proc Inst Mech Eng Part A J Power Energy.* 2012;226(5):682-693. doi:10.1177/0957650912444689
19. Baik S, Lee JI. Preliminary study of supercritical CO<sub>2</sub> mixed with gases for power cycle in warm environments. *ASME 2018 Turbo Expo.* 2018:1-8.
20. Sánchez CJN, da Silva AK. Technical and environmental analysis of transcritical Rankine cycles operating with numerous CO<sub>2</sub> mixtures. *Energy.* 2018;142:180-190. doi:10.1016/j.energy.2017.09.120
21. Dai B, Li M, Ma Y. Thermodynamic analysis of carbon dioxide blends with low GWP (global warming potential) working fluids-based transcritical Rankine cycles for low-grade heat energy recovery. *Energy.* 2014;64:942-952. doi:10.1016/j.energy.2013.11.019
22. Xia J, Wang J, Zhang G, Lou J, Zhao P, Dai Y. Thermo-economic analysis and comparative study of transcritical power cycles using CO<sub>2</sub>-based mixtures as working fluids. *Appl Therm Eng.* 2018;144(December 2017):31-44.

- doi:10.1016/j.applthermaleng.2018.08.012
23. Wu C, Wang S sen, Jiang X, Li J. Thermodynamic analysis and performance optimization of transcritical power cycles using CO<sub>2</sub>-based binary zeotropic mixtures as working fluids for geothermal power plants. *Appl Therm Eng.* 2017;115:292-304. doi:10.1016/j.applthermaleng.2016.12.077
  24. Imran M, Haglind F, Lemort V, Meroni A. Optimization of organic rankine cycle power systems for waste heat recovery on heavy-duty vehicles considering the performance, cost, mass and volume of the system. *Energy.* 2019;180:229-241. doi:10.1016/j.energy.2019.05.091
  25. Scaccabarozzi R, Tavano M, Invernizzi CM, Martelli E. Comparison of working fluids and cycle optimization for heat recovery ORCs from large internal combustion engines. *Energy.* 2018;158:396-416. doi:10.1016/j.energy.2018.06.017
  26. Iglesias Garcia S, Ferreira Garcia R, Carbia Carril J, Iglesias Garcia D. A review of thermodynamic cycles used in low temperature recovery systems over the last two years. *Renew Sustain Energy Rev.* 2018;81(May 2016):760-767. doi:10.1016/j.rser.2017.08.049
  27. Astolfi M, Alfani D, Lasala S, Macchi E. Comparison between ORC and CO<sub>2</sub> power systems for the exploitation of low-medium temperature heat sources. *Energy.* 2018;161:1250-1261. doi:10.1016/j.energy.2018.07.099
  28. Bonalumi D, Lasala S, Macchi E. CO<sub>2</sub>-TiCl<sub>4</sub> working fluid for high-temperature heat source power cycles and solar application. *Renew Energy.* 2018:1-13. doi:10.1016/j.renene.2018.10.018
  29. Andersen WC, Bruno TJ. Rapid screening of fluids for chemical stability in organic rankine cycle applications. *Ind Eng Chem Res.* 2005;44(15):5560-5566. doi:10.1021/ie050351s
  30. Invernizzi CM, Iora P, Manzolini G, Lasala S. Thermal stability of n-pentane, cyclopentane and toluene as working fluids in organic Rankine engines. *Appl Therm Eng.* 2017;121:172-179. doi:10.1016/j.applthermaleng.2017.04.038
  31. Yagli H, Koc A, Karakus C, Koc Y. Comparison of toluene and cyclohexane as a working fluid of an organic Rankine cycle used for reheat furnace waste heat recovery. *Int J Exergy.* 2016;19(3):420-438. doi:10.1504/IJEX.2016.075677
  32. Song J, Gu C wei. Parametric analysis of a dual loop Organic Rankine Cycle (ORC) system for engine waste heat recovery. *Energy Convers Manag.* 2015;105:995-1005. doi:10.1016/j.enconman.2015.08.074
  33. Fergani Z, Touil D, Morosuk T. Multi-criteria exergy based optimization of an Organic Rankine Cycle for waste heat recovery in the cement industry. *Energy Convers Manag.* 2016;112:81-90. doi:10.1016/j.enconman.2015.12.083
  34. Yağlı H, Koç Y, Koç A, Görgülü A, Tandiroğlu A. Parametric optimization and exergetic analysis comparison of subcritical and supercritical organic Rankine cycle (ORC) for biogas fuelled combined heat and power (CHP) engine exhaust gas waste heat. *Energy.* 2016;111:923-932. doi:10.1016/j.energy.2016.05.119
  35. Uusitalo A, Honkatukia J, Turunen-Saaresti T, Grönman A. Thermodynamic evaluation on the effect of working fluid type and fluids critical properties on design and

- performance of Organic Rankine Cycles. *J Clean Prod.* 2018;188:253-263. doi:10.1016/j.jclepro.2018.03.228
36. Görgülü A, Yağlı H, Koç Y, Koç A, Baltacıoğlu E. Activated carbon adsorption behaviour of toluene at various temperatures and relative humidity. *Environ Prot Eng.* 2019;45(1):111-126. doi:10.5277/epel90109
  37. Graco. Chemical Compatibility Guide. [https://www.graco.com/content/dam/graco/ipd/literature/misc/chemical-compatibility-guide/Graco\\_ChemCompGuideEN-B.pdf](https://www.graco.com/content/dam/graco/ipd/literature/misc/chemical-compatibility-guide/Graco_ChemCompGuideEN-B.pdf). Published 2013. Accessed August 21, 2019.
  38. Sandler SI. *Chemical, Biochemical and Engineering Thermodynamics*. Fourth Edi. John Wiley & Sons; 2006.
  39. Lopez-Echeverry JS, Reif-Acherman S, Araujo-Lopez E. Peng-Robinson equation of state: 40 years through cubics. *Fluid Phase Equilib.* 2017;447:39-71. doi:10.1016/j.fluid.2017.05.007
  40. Eric C. Carlson. Dont Gamble With Physical Properties For Simulations. *Chem Eng Prog.* 1996;(October):35-46. doi:10.1039/c4dt01534g
  41. Ng H, Robinson DB. Equilibrium Phase Properties of the Toluene-Carbon Dioxide System. *J Chem Eng Data.* 1978;23(4):325-327. doi:0021-9568/78/1723-03
  42. Fink SD, Hershey HC. Modeling the vapor-liquid equilibria of 1,1,1-trichloroethane + carbon dioxide and toluene + carbon dioxide at 308, 323, and 353 K. *Ind Eng Chem Res.* 1990;29(2):295-306. doi:10.1021/ie00098a022
  43. Reaves JT, Griffith AT, Roberts CB. Critical Properties of Dilute Carbon Dioxide + Entrainer and Ethane + Entrainer Mixtures. *J Chem Eng Data.* 2002;43(4):683-686. doi:10.1021/je9702753
  44. Angelino G. Carbon Dioxide Condensation Cycles for Power Production. *ASME J Eng Power.* 1968;90(3):287-296. doi:10.1115/1.3609190
  45. GTW - Gas Turbine world, 2018 GTW Handbook. 2018:1-126. [gasturbineworld.com](http://gasturbineworld.com).
  46. Marchionni M, Bianchi G, Tassou SA. Techno-economic assessment of Joule-Brayton cycle architectures for heat to power conversion from high-grade heat sources using CO<sub>2</sub> in the supercritical state. *Energy.* 2018;148:1140-1152. doi:10.1016/j.energy.2018.02.005
  47. Kim MS, Ahn Y, Kim B, Lee JI. Study on the supercritical CO<sub>2</sub> power cycles for landfill gas firing gas turbine bottoming cycle. *Energy.* 2016;111(September):893-909. doi:10.1016/j.energy.2016.06.014
  48. Moran MJ, Shapiro HN, Boettner DD, Bailey M. *Fundamentals of Engineering Thermodynamics*. John Wiley & Sons; 2010. <http://books.google.com/books?id=oyt8iW6B4aUC&pgis=1>.
  49. Koc Y, Kose O, Yagli H. Exergy analysis of a natural gas fuelled gas turbine based cogeneration cycle. *Int J Exergy.* 2019;30(2):103. doi:10.1504/ijex.2019.102162
  50. Yağlı H, Karakuş C, Koç Y, Çevik M, Uğurlu İ, Koç A. Designing and exergetic analysis of a solar power tower system for Iskenderun region. *Int J Exergy.* 2019;28(1):96-112. doi:10.1504/IJEX.2019.097273

51. Monje B. Design of supercritical carbon dioxide centrifugal compressors. 2014;(January). doi:10.1016/j.vetpar.2012.02.017
52. Monje B, Savill M, Pilidis P, Group PS. A Design Strategy for Supercritical CO2 Compressors. *Proc ASME Turbo Expo 2014 Turbine Tech Conf Expo GT2014 June 16 – 20, 2014, Düsseldorf, Ger.* 2014:1-11. doi:10.1115/GT2014-25151