

Characterization of the thermal performance of an outdoor telecommunication cabinet

P. Silva, L. Pires, C. Patrício & P.D. Gaspar
*Department of Electromechanical Engineering,
University of Beira Interior, Portugal*

Abstract

The growing use of telecommunication technologies has led the industry to develop infrastructure to support this progress. The outer telecommunications cabinets are part of the Base Transceiver Station allowing to accommodate and protect from outer adverse conditions a set of electronic equipment needed to operate the mobile communication network. This kind of cabinets should have a proper thermal performance to ensure indoor air temperature below 55°C to avoid exceeding the maximum operating temperature of the electronic equipment. This work describes the analysis of the thermal performance of an outdoor telecommunication cabinet using the computational tool DesignBuilder. The simulation results are compared to the experimental data collected in real cabinet under normal operating conditions. The simulation results show that the air temperature predicted by the model is closer to the temperature measured experimentally inside the cabinet particularly when the weather data files of the computational model have a similar behavior to the actual weather data. Numerical studies show that the use of mechanical ventilation is effective in the extraction of heat generated inside the cabinet. However, there is a limit beyond which increasing the air flow rate does not result in a significant decrease of the cabinet air temperature. The studies also show the importance of the radiant properties and the geographical location of the cabinet. High values of the outer surface cabinet emissivity impair the thermal performance of the cabinet during the day and for some locations, an operational mechanical ventilation system may not be enough to maintain the indoor air temperature below 55°C. Overall, the use of DesignBuilder proved to be very effective for characterizing the thermal performance of telecommunications outdoor cabinets.

Keywords: numerical modeling, telecommunication outdoor cabinet, thermal characterization, DesignBuilder

1 Introduction

The increasing technological development and globalization had a significant and direct impact on our way of living. Communication technologies particularly improved the communication between people and between companies, their mobility and carrying out everyday tasks that otherwise would require more time and resources to be achieved. A typical wireless telecommunications network makes connections between different terminals, allowing the exchange of information between them. The basic infrastructure of a telecommunications network is the Base Transceiver Station (BTS), which could present energy consumption greater than other public buildings [1]. In that way, if the telecommunications industry wants to save economic resources and become more sustainable, it is imperative to reduce the energy consumption of BTS [2]. Cooling demand of a BTS can represent up to 25% of its energy consumption, therefore, implementing less energy consumption cooling techniques has a good energy saving potential [2,3]. An important component of the BTS is the outdoor telecommunication cabinet (OTC) which contain several electronic equipment that require a correct thermal management. Some of that equipment may become inoperable if temperatures higher than 70 °C occur inside the cabinet [4,5]. So, a proper management of the air temperature inside the OTC brings, not only, energy advantages but it is also essential for a good performance, reliability and durability of electronic equipment [6]. More than half of the failures in electronic systems occurs due to poor temperature control [7]. The results of experimental tests on electronic components indicate that decreasing 1 °C on its surface temperature reduces the probability of failure in 4%. Additionally, the increase between 10 and 20 °C in the surface temperature increases component failure probability in 100% [8]. The temperature increase may additionally accelerate chemical reactions, increase corrosion and induce redox reactions in some metals. It can also increase the accumulated fatigue of welded components, or cause frequency changes of the internal clocks of the processors, which can lead to undesirable time gaps [9,10,11].

When natural convection cooling is insufficient to maintain the ideal conditions for equipment operation, it is necessary to apply other cooling techniques. In that case, forced ventilation emerges as one of the most widespread techniques for equipment cooling, due to the low cost of implementation and simplicity [12,13]. However, the use of forced ventilation with outside air presents some drawbacks, due to dust and moisture transport to the interior of the OTC. Moreover, because the filters are not designed to maintain their function during the lifetime of the OTC, it is necessary to perform maintenance procedure that leads to an increase of its maintenance costs [3]. When cooling by forced ventilation is not enough to remove the heat inside the OTC, other cooling techniques may be used, such as vapor compression refrigeration. However, the power consumption associated with this type of solution may correspond to about 30 to 50% of the total energy consumed in the BTS [14].

In addition to these conventional solutions there is also the possibility to choose other cooling techniques, active and passive, including the thermoelectric cooling,

geothermal cooling or the use of phase change materials (PCM), among others [12, 15, 16 17].

In the present paper, a numerical model of an OTC was prepared using the computational tool DesignBuilder. The results of the computer model were compared to experimental data collected in a real cabinet in normal operating conditions. Subsequently, the computer model was used to characterize the thermal behavior of the cabinet submitted to different operation conditions, internal or external.

2 Materials and methods

DesignBuilder, version 3.4.041 – with Energy Plus 8.1, was the computational model used in this simulation study. The DesignBuilder emerged in 2005 as the first, and currently the most complete, graphical user interface with the EnergyPlus. This computational tool has the ability to simulate the thermal behavior of a building in a variable time base, as well to calculate the energy consumption, in order to test solutions and strategies to improve energy efficiency. For this, it is necessary to introduce in the program a variety of parameters, such as the location, the geometry, the parameters related to activity, the lighting, the constructive elements, the glazed surfaces, the HVAC systems, among others [18]. Additionally this tool can take solar radiation effects into account, which may represent an important additional heat load with consequences on the value of the indoor air temperature and, consequently, can lead to a decrease in reliability of the electronic equipment by increasing the probability of failure [19].

2.1 Outdoor cabinet description

The experimental data was collected from an OTC located near the city of Covilhã, in the inland/center region of Portugal. The OTC location is subject to sunlight for most of the day. The cabinet consists of a pedestal, an intermediate space that houses the telecommunications equipment and switchboards and, finally, an upper space where the fans are installed. In fig. 1 it is possible to easily distinguish the different constituent parts of the cabinet, through the exploded view. The pedestal is 150 mm high and has lateral openings to facilitate the passage of cables. The side panels are removable, improving access to the interior. The outer dimensions of the OTC are 638x644x1480 mm³ (LengthxWidthxHeight). However, the useful inner dimensions for the placement of equipment are only 483x550x1111 mm³. The construction material is an alloy with 55.0% aluminum, 43.4% zinc and 1.6% silicon. The alloy is used in sheets with 1 mm thick. All panels have double walls with an air enclosure with 20 mm thick, in order to reduce the thermal load by solar radiation absorption. The ventilation of the air enclosure in each panel is achieved through two grilles placed in the exterior sheet for air flow, one at the bottom of the cabinet, for air inlet, and the other located in the upper part of the cabinet, for air outlet. It is also through the bottom grilles that enters the air that flows into the cabinet.



Figure 1: Exploded view of the outdoor telecommunications cabinet.

The OTC is painted with light color to reduce heat gain from solar radiation.

2.2 Cabinet characteristics

The telecommunication equipment that is installed inside an OTC depends on the telecommunications company that operates the BTS and on the services it intends to provide. The temperature control system, lighting, door-opening sensor and electrical switchboards are already installed with the cabinet. Since the communications equipment installed in each cabinet depend on the company that operates the network, its spatial arrangement may vary from case to case. For the studied case, the devices installed in the OTC are identified in Table 1. This information results from technical information provided by the equipment manufacturer. Some of this equipment has negligible thermal power dissipation.

Table 1: Equipment installed inside the cabinet under study.

Equipment	Function	Thermal power dissipated (maximum value)
AC Switch board	AC energy supply	Negligible
DC Switch board	DC energy supply	Negligible
BBU3900 Huawei	Baseband control unit	295 W
Alcatel-Lucent 7705	<i>Router</i>	60 W
EMILO-SNT - PT Inovação	Modular system type <i>Multi-Service Provisioning Platform (MSPP)</i>	120 W

Overall, the equipment that was considered inside the OTC has a heat output potential of 475 W. However, this scenario only occurs when all the equipment is dissipating the maximum thermal power for which they were designed. The value

is lower in typical operating situation. The studied OTC is located in a low population density region. In fact, it was installed to provide mobile network coverage to a highway, thus it is expected a thermal power dissipation values considerably below 475 W.

2.3 Cabinet Thermal control

The OTC temperature control system should have the capability to allow monitoring the temperature and increase the heat extraction rate if necessary. According to the OTC supplier company, with a maximum thermal power dissipated by the electronic equipment lower than 250 W, the natural convection cooling mode is enough to ensure an inside air temperature below 50°C.

However, the cabinet under study is equipped with a forced cooling system that is triggered whenever natural convection alone is not able to ensure the indoor air temperature. The cooling system consists of two axial fans that are activated by a thermostatic sensor, a type on/off system. Both fans work together and are always operated as the indoor air temperature is higher than 35°C. The main operating characteristics of fans are shown in table 2.

Table 2: Cabinet fans characteristics.

Nominal voltage	48 V
Electric power input	5.1 W
Operation temperature range	-20°C to 75°C
Nominal air flow	170 m ³ /h

There are several constraints on the fluid flow inside the OTC, such as equipment and wiring, orifices diameter of the inlet and outlet grilles, the obstructive effect caused by the air filters and an existing perforated plate to protect the fans. In addition, inadequate maintenance of the OTC and subsequent accumulation of dust in the filter along the operating time also contributes to a reduction of the air flow. As result of the pressure drop associated with the air flow through the OTC, the actual air flow should be substantially lower than the value shown in table 2.

2.4 Computational model

For simulation purposes, the three-dimensional numerical model with real OTC dimensions was built using the DesignBuilder, as displayed in Fig. 2.

The computational model consists of 6 Blocks corresponding to a zone having an internal volume 0.46 m³ and an HVAC system to simulate the real ventilation system provided by the fans in the OTC. The backside panels and the front door have double wall thickness of 20 mm as in the actual OTC.

As the program does not have the alloy used in the construction of the OTC their thermal characteristics were manually added: thermal conductivity 160 W/mK, specific heat 880 J/kgK and density of 2800 kg/m³.

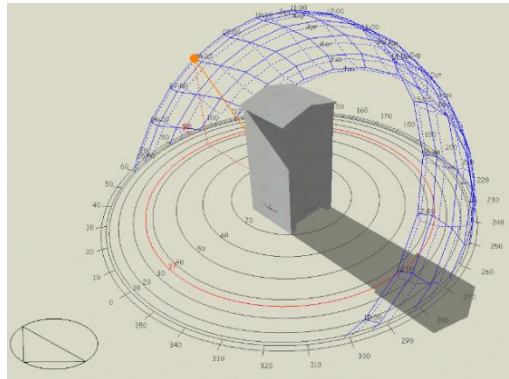


Figure 2: Outdoor cabinet modeled with DesignBuilder.

To simulate thermal loads within each zone, DesignBuilder has several options according to their source. The Lighting submenu was used to overcome the 60 W/m^2 limitation of the thermal load value imposed by the program in the submenu Activity. The submenu Lighting allows the introduction of the thermal dissipation rate inside the cabinet per unit of area without restrictions. The area used in the calculation of the thermal load inside the cabinet is 1.43 m^2 corresponding to the sum of the floor area in each one of the blocks involved in numerical simulation. Additional details of the computational model can be found in [20].

3 Analysis and discussion of results

In this section the results obtained from the computer model are analyzed and discussed. The simulation values and the experimental values are compared in the first subsection to validate the computational model. After that, parametric studies with the computational model are developed to assess the influence of various factors such as the volumetric air flow, thermal power dissipation, radiant properties of the cabinet envelope and the OTC geographical location.

3.1. Comparison with experimental data

A numerical model must be validated so that the model simulations produce reliable results. The computational model was validated by comparison of the numerical results with experimental data obtained from an OTC in normal operation. As said before, the cabinet chosen to collect experimental data is located in the municipality of Covilhã, close to the A23 highway. The cabinet experimental values were collected between 15 and 19 April 2015 and it was considered an average thermal power of 100 W dissipated by the electronic equipment due to the low use of the OTC in the period. The values of the cabinet indoor temperature obtained experimentally are crossed with numerical values for the same period. However, the climatic data files used in this kind of simulation software influence significantly the quality of results [21, 22, 23]. Thus, the

climatic data file used in Design Builder was compared with values measured at a weather station near to the OTC in the same period. The weather station provides a set of climatic data including air temperature, wind speed and solar radiation. The comparison between the weather station data and the DesignBuilder climatic data is shown on fig. 3 and fig. 4 to the values of the outdoor temperature and the solar radiation in the period.

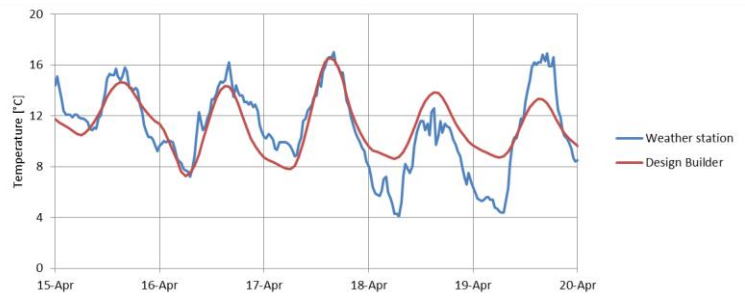


Figure 3: Outside temperature (weather station vs. DB climatic data file).

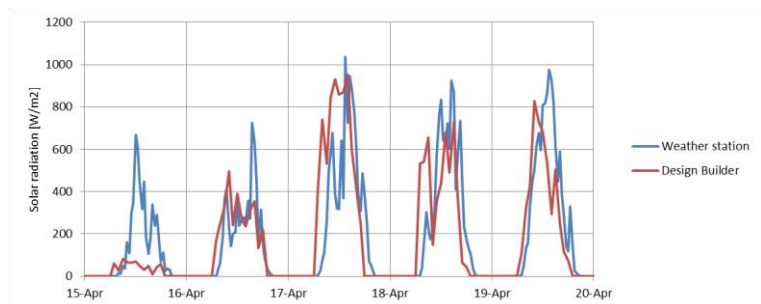


Figure 4: Solar radiation (weather station vs. DB climatic data file).

From the analysis of fig. 3 and fig. 4 it appears that the 16 and 17 April show the best agreement of solar radiation values and air temperature for the period. The temperature values inside the OTC for the same period are shown in fig. 5.

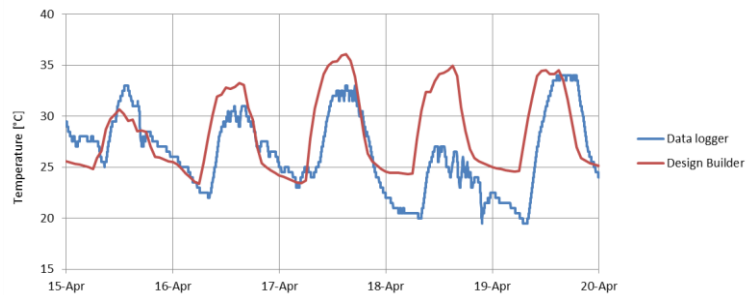


Figure 5: Temperature values inside the cabinet, numerical and experimental.

The experimental data were obtained by measuring the indoor air temperature immediately before the fan, close to the sensor that controls the activation of the fans. Air temperature was measured with an accuracy of $\pm 0.5^{\circ}\text{C}$. According to fig. 5, when the actual weather data and the weather data from the computational model have a similar behavior, also the air temperature inside the OTC predicted by the model is closer to the temperature measured experimentally. This figure also allows concluding that the OTC fans are never actuated during the period, since the indoor air temperature never exceeds 35°C .

3.2. Parametric studies

The computational studies presented in this subsection are directed to the most demanding situation from the thermal point of view, corresponding to the summer period in northern hemisphere. The period between 10 and 15 August was selected since the highest values of the air temperature inside the cabinet are expected.

3.2.1 Air flow rate

When the OTC thermal dissipation rate is not high enough to keep the inside air temperature with acceptable values, it is necessary to resort to forced ventilation. The characteristics of the flow provided by the fans influence the amount of heat that is withdrawn from the OTC to the outside per unit of time. The effect of the volumetric air flow that passes through the OTC on the inner air temperature is shown in fig. 6. The maximum measured air temperature difference in the period is around 3°C to 5°C to the minimum and maximum air flow rates studied, $25\text{ m}^3/\text{h}$ and $100\text{ m}^3/\text{h}$, respectively. It is necessary to quadruple the air flow rate for an air temperature decreasing of around 4°C . The decrease of the air temperature inside the OTC is more pronounced when the air flow rate ranges from $25\text{ m}^3/\text{h}$ to $50\text{ m}^3/\text{h}$. From this value, the decrease of air temperature is smaller. An air flow rate increase from $75\text{ m}^3/\text{h}$ to $100\text{ m}^3/\text{h}$ results in an air temperature decrease of 2%.

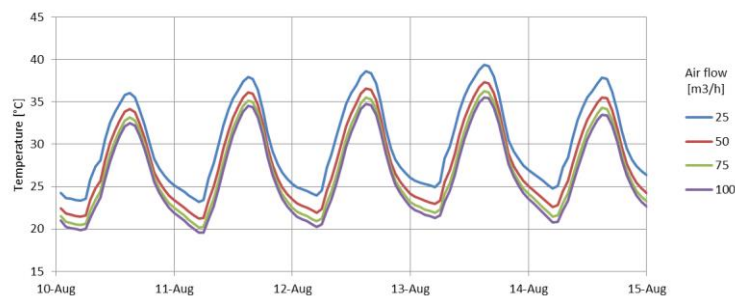


Figure 6: Inside air temperature vs. cabinet air flow rate.

We conclude that further increase of the air flow, that contributes to the increase of the OTC energy consumption, do not provides better control of the maximum air temperature reached inside the cabinet. Thus, the optimization of the thermal performance of an OTC cooled exclusively by forced air circulation requires appropriate volumetric air flow rates.

3.2.2 Thermal power dissipated

The thermal power dissipated by the electronic equipment inside the OTC is one of the most relevant factors to the variation of the inner air temperature. As shown in fig. 7 the results for the air temperature inside the OTC to the average thermal power dissipated ranges between 100 W and 400 W. The simulation results were obtained considering that there is no renewal of the air inside the OTC. There is an almost direct proportionality between the increases of air temperature and thermal power dissipated by the electronic equipment, as shown in fig. 7. However, an air temperature inside the OTC below 55°C without forced ventilation only is assured for a dissipated thermal power lower than 100 W. Therefore, an operational mechanical ventilation system is required for higher dissipation rates. The evolution of the air temperature inside the OTC due to the thermal power dissipated for an air flow of 100 m³/h is shown in fig. 8. The air temperature inside the cabinet increases with the thermal power dissipated.

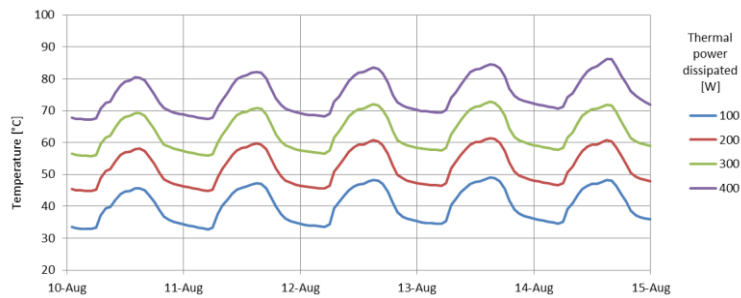


Figure 7: Inside air temperature vs. thermal power dissipated (no ventilation).

However, the inside air temperature slightly exceeds the threshold value of 55°C for safe operation of the cabinet only for the situation with thermal power of 1000 W and only for the 13th of August. When the dissipated thermal power was set at 800 W, the maximum air temperature attained inside the cabinet for the period studied was 50°C. It is found that for thermal power dissipated values between 100 W and 700 W, the maximum air temperature inside the OTC increased by about 4°C every 200 W of increase in the value of the dissipated thermal power.

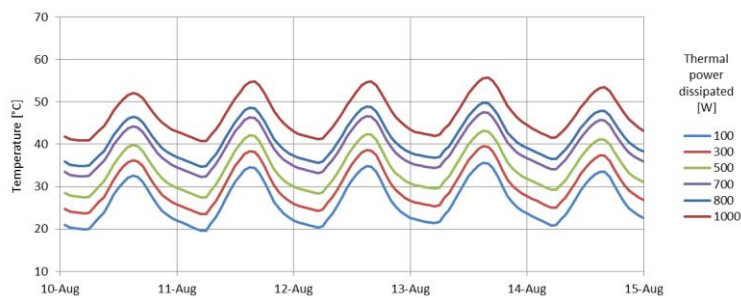


Figure 8: Inside air temperature vs. thermal power dissipated (with ventilation).

3.2.3 Radiative properties

As the OTC are in general exposed to the action of solar radiation, radiative properties of the OTC envelope affect the air temperature inside the cabinet. In practice, these radiant properties can be modified by changing the OTC building materials or outer coating. Fig. 9 shows the evolution of air temperature inside the OTC by changing the emissivity values of the outer surface of the cabinet.

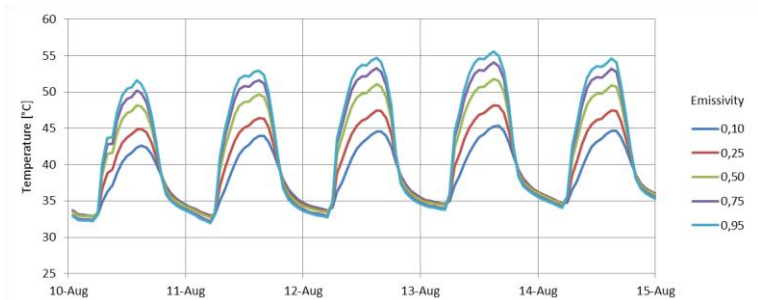


Figure 9: Temperature values inside the cabinet for several emissivity values.

The results show that the OTC radiant properties affect the air temperature during diurnal periods when the cabinet is exposed to solar radiation, with higher air temperature values to higher surface emissivity values. With an emissivity value of 0.95, the air temperature inside the cabinet exceeds 55°C during the period, whereas with 0.1 emissivity value, the air temperature inside the OTC always remains below 45°C. It can be concluded that high emissivity values of the outer surface impair the thermal performance of the cabinet during the day, which can jeopardize an effective air temperature control. During the night period, the variation in emissivity values has little influence on air temperature variation.

3.2.4 Other geographic locations

Since different geographical locations could correspond to significant climatic changes, it is important to realize in what way these changes could affect the thermal response of OTC. To study this effect some cities located in the northern hemisphere were selected (see fig. 10) in order to keep the period of study between 10 and 14 August, as in the southern hemisphere it corresponds to winter.

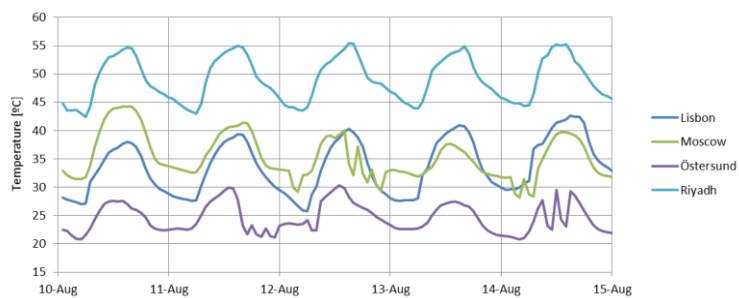


Figure 10: Inside air temperature for other OTC geographic locations.

The climatic data for the new locations were obtained from the NASA Langley Research Center Atmospheric Science Data Center Surface meteorological and Solar Energy (SSE) web portal supported by the NASA LaRC POWER Project [24].

According to fig. 10, the city of Ostersund (Sweden), in Northern Europe, has the lowest air temperature values inside the OTC, thus enabling greater thermal power dissipated compared to the other cases studied. For hot climates, such in Riyadh (Saudi Arabia), even for a thermal power dissipated of 100 W, the air temperature inside the cabinet is above 50°C in most part of the daytime and sometimes exceeding 55°C. For these situations, an operational mechanical ventilation system may not be enough to ensure the safe operation of the electronic equipment inside the OTC. Lisbon (Portugal) and Moscow (Russia) showed similar results with maximum air temperature values below 45°C, and therefore the natural ventilation is adequate for low thermal power dissipated by the electronic equipment.

4 Conclusion

In this study, the computer simulation of the thermal performance of an OTC was performed using DesignBuilder. Overall, the use of DesignBuilder proved to be very effective for characterizing the thermal performance of OTC. The simulation results show that when the actual weather data and weather data from the computational model data files have a similar behavior, also the air temperature predicted by the model is closer to the temperature measured experimentally inside the cabinet. Mechanical ventilation is a simple and inexpensive method usually used for heat extraction in the OTC. The studies carried out show that the maximum temperature difference of the air inside the cabinet for air flow rates ranging from 25 m³/h and 100 m³/h, is between 3°C and 5°C. However, for higher airflow rates, the air temperature reduction is lower and therefore the increase of the air flow rate while contributing to the increase of energy consumption of the OTC not always provides a maximum control of inside air temperature. Research undertaken also shows a direct relationship between the increase of the thermal power dissipated by the electronic equipment inside the cabinet and the maximum temperature of indoor air. It was found that the temperature of the air inside the cabinet only remains below 55°C to dissipated thermal power lower than 100 W. For higher values, it is necessary to resort to the mechanical ventilation of the OTC. In particular, the results show that for thermal power dissipated between 100 W and 700 W, the maximum air temperature inside the OTC increased by about 4°C every 200 W. The simulation results also show that high values of the cabinet outer surface emissivity impair the thermal performance of the OTC during the day and may jeopardize the temperature control. The geographical location also influences the thermal performance of the OTC. The results show that for some locations an operational mechanical ventilation system may not be enough to ensure the safe operation of the electronic equipment inside the OTC.

References

- [1] Zhang, Y., Chen, Y., Wu, J., & Meng, Q., Study of ventilation cooling technology for telecommunication base stations: Control strategy and application strategy. *Energy Build.* **50**, pp. 212–218, 2012.
- [2] Lubritto, C., Petraglia, A., Vetromile, C., Curcuruto, S., Logorelli, M., Marsico, G., & D'Onofrio, A., Energy and environmental aspects of mobile communication systems. *Energy* **36(2)**, pp. 1109–1114, 2011.
- [3] Edler, T., & Lundberg, S. (2004). Energy efficiency enhancements in radio access networks. *Ericsson Review*, 1, pp. 42-51, 2004.
- [4] McGlen, R., Jachuck, R. & Lin, S., Integrated thermal management techniques for high power electronic devices. *App. Therm. Eng.* **24**, pp. 1143-1156, 2004.
- [5] Choi, J., Jeon, J. & Kim, Y., Cooling performance of a hybrid refrigeration system designed for telecommunication equipment rooms. *App. Therm. Eng.* **27**, pp. 2026-2032, 2007.
- [6] Ahmadi, M., Gholami, A., Bahrami, M., & Lau, K., Passive cooling of outside plant power systems, a green solution to reduce energy consumption, *INTELEC 2014*, IEEE 36th Int., pp. 1-9, 2014.
- [7] Yeh, L., Review of heat transfer technologies in electronic equipment. *J. Electron. Packag.* **117**, pp. 333-339, 1996.
- [8] Alawadhi, E. M., & Amon, C. H., PCM thermal control unit for portable electronic devices: experimental and numerical studies. *IEEE Trans. Compon. Packag. Manuf. Technol.* **26**, pp. 116-125, 2003.
- [9] Joshi, Y., Azar, K., Blackburn, D., Lasance, C. J., Mahajan, R., & Rantala, J., How well can we assess thermally driven reliability issues in electronic systems today? *Microelectr. J.* **34 (12)**, pp. 1195-1201, 2003.
- [10] Gurrum, S. P., Suman, S. K., Joshi, Y. K., & Fedorov, A. G., Thermal Issues in Next-Generation Integrated Circuits. *IEEE Trans. Device Mater. Rel.* **4**, pp. 709-714, 2004.
- [11] Banerjee, K., Pedram, M., & Pedram, M., Analysis and optimization of thermal issues in high-performance VLSI, *Proc. of the 2001 Int. Symp. on Physical design*, ACM: New York, pp. 230-237, 2001.
- [12] Wankhede, M., Khaire, V., & Goswami, A., Evaluation of Cooling Solutions for Outdoor Electronics, *THERMINIC2007*, EDA Publishing: Belgium, pp. 162-167, 2007.
- [13] Chen, Y., Zhang, Y., & Meng, Q., Study of ventilation cooling technology for telecommunication base stations in Guangzhou. *Energy Build.* **41**, pp. 738–744, 2009.
- [14] Tu, R., Liu, X., Li, Z., & Jiang, Y., Energy performance analysis on telecommunication base station. *Energy Build.* **43**, pp. 315-325, 2011.
- [15] Etemoglu, A., A brief survey and economical analysis of air cooling for electronic equipments. *Int. Communications in Heat and Mass Transfer* **34**, pp. 103-113, 2007.
- [16] Yuping, H., Shengqin, J., Yunhui, Z., Xiaoming, K., Qiao, C., Cucchiatti, F., & Griffa, G., Energy saving active cooling systems for outdoor cabinet, *INTELEC 2008*, IEEE 30th Int., pp. 1-6, 2008.
- [17] Masson, S. L., Chehade, A. A., & Louahia-Gualous, H., Passive cooling of telecommunication outdoor cabinets for mobile base station, *INTELEC 2013*, IEEE 35th Int., pp. 1-5, 2013.
- [18] Crawley D.B., Hand, J.W., Kummert, M., & Griffith, B.T., Contrasting the capabilities of building energy performance simulation programs. *Build. Environ.* **43**, pp. 661-673, 2008.
- [19] Muralidharan, B., Mariam, F. A., Karajgikar, S., Agonafer, D., & Hendrix, M., Energy minimization based fan configuration for double walled telecommunication cabinet with solar load, *SEMI-THERM 2010*, 26th Annual IEEE, pp. 270-277, 2010.
- [20] Patrício, C., *Thermal characterization of the performance of a telecommunication outdoor cabinet*, Master Science Thesis (in Portuguese), Beira Interior University: Covilhã, 2015.
- [21] Chan A., Developing future hourly weather files for studying the impact of climate change on building energy performance in Hong Kong. *Energy Build.* **43**, pp. 2860-2868, 2011.
- [22] Bhandari M., Shrestha S., & New, J., Evaluation of weather datasets for building energy simulation. *Energy Build.* **49**, pp. 109-118, 2012.
- [23] Gonçalves, J., Nunes, J., Silva, P.D., Gaspar, P.D., & Pires, L., Energy analysis and heat loads calculation approach: application to agrifood industrial premises, *Proc. of the 24th IIR International Congress of Refrigeration (ICR2015)*, IIR, Yokohama, Japan, 2015.
- [24] National Aeronautics and Space Administration (NASA). ASDC - SSE, <https://eosweb.larc.nasa.gov/cgi-bin/sse/sse.cgi?skip@larc.nasa.gov+s01#s01>