

CARD International Journal of Engineering and Emerging Scientific Discovery
ISSN: 2536-7250 (Print); 2536-7269 (Online)
Volume 1, Number 1, June 2016
<http://www.casirmediapublishing.com>

Reliability and Improvement of Electric Power Generation and Distribution (Ikorodu, Lagos State, Nigeria as a Case Study)

Oshin, Ola Austin

Department of Electrical and Computer Engineering,
Elizade University, Ilara-mokin, ondo

Email: austin.oshin@elizadeuniversity.edu.ng

ABSTRACT

The present unreliable and erratic power supply is a pointer to the fact that there is a great need for fault evaluation and reliability studies of electric power system in the Nigeria. The recent blackout in the country has grounded many activities and has destroyed many industrial processes. Also, the power industries face a lot of problems. Some of the highest priority issues being generation of sufficient power, urgent clearance of faults, adequate protection and increase reliability of the system, that is, bringing a steady uninterrupted power supply to the consumers. The Nigerian power problem resulted to incessant planned, forced and unplanned outages. In addition, it has resulted to erratic and unreliable supply of electricity in the country. It has reduced productivity and has increased unemployment rate in the country to over 40million (this figure is over 70% of Nigerian youths. It has led many of the youths in the country to crime. It has led many of the deaths of many innocent people in the country. Hence, an analytical method is developed to assess the dynamic- reliability of the distribution system, as well as optimizes the occurrence of faults along each of the individual consumer point in a feeder in order to improve the performance of the system. This research publication therefore evaluates the occurrence of faults which is about 856 occurrences during a period of 8 years and outages which range between 1118 to 3785 hours per annum along the distribution lines, also the failure rates of each of the feeders were analyzed in order to improve on the supply of electricity in the distribution network. The reliability of the system which ranges between 8.57×10^{-12} to 9.548×10^{-5} were analyzed; and fault clearing techniques were carried out. Efforts were made to adequately assess the failure rates of the feeders which range between 0.003 and 0.001 and reliability of the distribution system. Efforts were also made to improve the performance of the system. As a result, it was possible to establish improvement techniques which ensure adequate and constant supply of electricity to all the consumers for industrial growth and employment: a basic solution to increasing crime rate in the country.

Keywords: Fault Evaluation, Power Distribution Network, Reliability, Failure Rates, Outages

INTRODUCTION

An electric power system consists of three major components: Generation, Transmission and Distribution. A Generating station generally employs the action of a prime mover coupled to an alternator and at least an external exciter for the production of electric power. The prime mover may be a steam turbine, a wind mill or a water turbine which converts energy from other sources into mechanical energy. The external exciter produces the magnetic field. In many cases, the field will be electro-magnetic, and field coils carrying the field current will be wound on a magnetic structure. The iron forming structure will be laminated. This is to reduce field iron losses. Then the field coils are concentrated and wound around protruding poles called salient poles, or distributed in slots cut into a cylindrical magnetic structure commonly used for AC generators. With this arrangement, a DC current is applied to the field winding (rotor winding) which produces a magnetic field (a rotor magnetic field). The rotor of the generator is then turned by a prime mover producing a rotating magnetic field within the machine. The rotating magnetic fields induces a three phase set of voltages within the stator winding from which output voltage ranging between 11kV and 25kV can be obtained. This is in accordance to Faraday's laws of electromagnetic induction. The electrical energy produced by the generating station is then transmitted over long distance and distributed with the help of transmission lines and distributors to various consumers. In view of the insufficient electric power generation capacity and coupled with power losses and constant outages many industries and consumers faced with unreliable power supply in the country. Hence the focus of this research work is based on Fault Evaluation and Improvement of Electricity in Power Distribution Network: Ikorodu in Lagos State, Nigeria as a case study.

Problem Statement

The incessant electric power supply problems facing the existence of industries in Nigeria is a pointer to the fact that there is great need for fault evaluation and reliability assessment of electric power system in the country and provides solutions. As it has been earlier said, this problem has grounded many activities and has destroyed many industrial processes. In view of this, a traditional analytical method is developed to access the occurrence of faults and outages along each of the individual consumer point in a feeder, as well as optimizes the reliability of the generation, transmission and distribution system.

In view of this, it will be possible to improve on the performance of the system. It will also assist in the generation and transmission of sufficient power, clearing of faults, ensuring adequate protection and reliability of the distribution system that is, bringing a steady uninterrupted power supply to consumers within the distribution area and the entire country.

Existing Generation Capabilities in Nigeria

The generation capabilities in Nigeria are shown in Table 1.1

Table 1.1: Generation Capabilities in Nigeria

S/N	Names of Generating Stations	Raw Materials	MW
1	Egbin Thermal Power Plant	Gas, coal	1080
2	Kainji Hydro Power Plant	Hydro(water)	480
3	Jebba Hydro Power Plant	Hydro (water)	360
4	Shiroro Hydro Power Plant	Hydro (water)	450
5	Sapele Thermal Power Plant	Gas Turbine	170
6	Afam Thermal Power Plant	Gas Turbine	72
7	Delta Thermal Power Plant	Gas	329
8	Geregu Gas Power Plant	Gas	414
9	Omotosho Gas Power Plant	Gas	300
10	Papalanto Gas Power Plant	Gas	300
11	Alaoji Gas Power Plant	Gas	346 MW
	Total		4301MW

Source: Power Holding Company of Nigeria Plc, Ikorodu, Lagos State
Existing National Independent Power Project (IPP) in Nigeria

The National Independent Power Projects are shown in Table 1.2

S/N	Name/Location	Capacity
1	AES	288MW
2	Okpai	480 MW
3	Afam	300MW
4	Omokun	75MW
5	Afam VI	300MW
6	Ibom Power	188MW
7	Omokun	75 MW
8	ALSCON	360MW
	Total	2066 MW

Source: Power Holding Company of Nigeria Plc, Ikorodu, Lagos State

Though the total installed generating capacity is 5,746MW, the country is only able to generate 3,500 MW because most facilities have been poorly managed and the reliability of the generating, transmission and distribution system being very low due to high failure rates of equipment, large energy losses and poor protection system. In addition, Electricity in Nigeria is facing a lot of problems ranging from financial misappropriation, to inadequacy of facilities and non-commitment of PHCN staff. Therefore, the condition has remained pathetic with failures, power failure and non-reliability of the system on daily basis, the effects has grounded many activities and destroyed many industrial processes, and has open ways for mass unemployment, crimes, slow economic and poor national development.

Since the management of continuous, reliable and constant power supply in Nigeria is a difficult task, there is a need for the reliability assessment of the power system network. This evaluation will reveal the prevalence and frequency of faults and outages on the distribution system. It will also reveal their effects on the supply of electric power to

various consumers. Also, it will be possible to analyze the causes of faults along the transmission and distribution lines. Then adequate system techniques for improving the performance of the system will be achievable.

Specific Objectives of the Study

The specific objectives of the research work are to:

- (a) study the causes, nature and effects of faults on the distribution network;
- (b) evaluate the occurrence of faults and outages on feeders and distribution networks, and
- (c) determine the reliability of the network.
- (d) improve electricity supply in Nigeria.

Expected Contribution to Knowledge

The study is expected to:

- (a) provide the reliability indices for Ikorodu distribution network; and
- (b) establish procedure to improve electricity supply to consumers within the distribution system
- (c) establish procedure to improve electricity supply in Nigeria

RESEARCH METHODOLOGY

Power System grounding is very important, particularly since a large majority of faults involve ground or re caused by thunderstorm/lighting strikes. In order to carry out fault evaluation of Electric Power Distribution Network, a detail study of Ikorodu 132/33kV substation Network of the Power Holding Company of Nigeria under which there are about 47,739 customers was carried out. The results for Lagos Feeder were presented in this research publication. Types and frequency of faults occurrence were recorded. These data were collated, evaluated and analyzed both mathematically, graphically and with the use of computer excel software.

The data collected from the Power Holding Company of Nigeria include: Geographical map of the Distribution Area Network, fault records, causes and duration of outages, feeder-by-feeder load loss and system downtime, frequency of faults, inventory of distribution transformers on each feeder, feeder length, transformer capacity and conductor capacity, load demand of customers, number of customers and their categories. From the collated data obtained for 8 years (2004-2011), the network reliability, failure rate (λ), Mean Time Between Failures (MTBF), Mean Down Time (MDT) and Availability (A) were calculated using equations (3.1) to (3.5). Then the failure rate of the system on yearly basis was evaluated which was used to determine the reliability of the system on yearly basis. Also, feeder-by-feeder load loss and was evaluated for each year using equations (3.6) to (3.9). The month that fault occurred, the date of fault, the time the feeder tripped, the time it was restored, duration of fault (downtime), load loss in megawatts, phase on which fault occurred and nature of faults were recorded and evaluated.

From the data, the failure rates (λ) of the feeders were evaluated using equation (3.1)

$$\text{Failure rate} = \frac{\text{fault frequency on each feeder}}{\text{Period of operation of the feeder (hour)}} \dots\dots\dots (3.1)$$

The results of the failure rates were used to determine the reliability $R(t)$ of the feeders according to equation (2):

$$R(t) = e^{-\lambda t} \dots\dots\dots (3.2)$$

Where λ is failure rate (failure/hour) and t is time (hour).

Mean Time Between Failures (MTBF) of all the feeders were evaluated using equation (3):

$$\text{MTBF} \dots\dots\dots (3.3)$$

Mean Down Time were also estimated on feeder by feeder basis using equation (3.4):

$$\text{Mean Down Time (MDT)} = \frac{\text{Total down time of each feeder}}{\text{Fault frequency}} \dots\dots\dots (3.4)$$

Finally, availability (A) of electricity within the distribution network on yearly and feeder by feeder basis were evaluated using equation (5):

$$\text{Availability} = \frac{\text{operating time of the feeder in a year}}{\text{total number of hours in a year}} \dots\dots\dots(3.5)$$

In fact, Reliability Indices recovered in section (2.25) to (2.29) and the relevant equations (2.31) to (2.51) were used for all calculations which are repeated here for clarity as follows:

Reliability customer-oriented indices were obtained using the following equations.

System Average Interruption Frequency Index (SAIFI)

$$\text{SAIFI} = \frac{\text{Total number of sustained customers interruption in a year}}{\text{Total number of customer served}} \dots\dots\dots (3.6)$$

System Average Interruption Duration Index (SAIDI)

$$\text{SAIDI} = \frac{\text{Total duration of sustained interruption in a year}}{\text{Total number of customer served}} \dots\dots\dots$$

(3.7)

Customer Average Interruption Frequency Index (CAIFI)

$$\text{CAIFI} = \frac{\text{Total number of annual customer interruptions}}{\text{Total number of customers affected}} \dots\dots\dots$$

(3.8)

Customer Average Interruption Duration Index (CAIDI)

$$\text{CAIDI} = \frac{\text{Total Duration of sustained interruption in a year}}{\text{Total number of customer interruptions}} \dots\dots\dots(3.9)$$

Average Service Availability Index (ASAI)

$$ASAI = \frac{\text{Customer hours of available service}}{\text{customer hours demanded}} \dots\dots\dots (3.10)$$

Average Service Availability Index (ASUI)

$$ASUI = \frac{\text{Customer hours of unavailable/ service in a year}}{\text{customer hours demanded in a year}} \dots\dots\dots (3.11)$$

The power losses on the available feeders are calculated on the basis of the monthly maximum loading on the feeders, the resistance, size of each feeder conductor, route length of each feeder and maximum current drawn from each feeder conductor using equations (3.12 to 3.15).

Current drawn from feeder

$$I_1 = \frac{P}{\sqrt{3}V \times p.f} \dots\dots\dots (3.12)$$

and $R = \frac{\ell l}{A} \dots\dots\dots (3.13)$

where P is power in k Watts
 V is voltage in volts
 l is resistivity in Ωm
 R is resistance in ohms; and
 A is cross sectional area in m²

$$\text{Power loss} = I_L^2 R \dots\dots\dots (3.14)$$

$$\text{Power loss} = \text{Power received} - \text{Power consumed} \dots\dots\dots (3.15)$$

RESULTS AND DISCUSSIONS

Failure Rate and Reliability Index on Lagos Road Feeder

Failure rate of the feeder for the 8 Years

$$= \frac{\text{Fault frequency}}{\text{Period of operation}} \dots\dots\dots(4.2)$$

$$= \frac{92}{53690} = 0.00171354 \text{ failure /hour}$$

Reliability on Lagos Road Feeder

The reliability system for the period of 8 years (2004-2011) was obtained.

$$R(t) = e^{-\lambda t} \dots\dots\dots(4.1)$$

$$R(t) = 2.718^{-(0.00171354 \times 8760)}$$

$$R(t) = 30.3143 \times 10^{-8}$$

Mean Time between Failure (MTBF) for the Eight Yearson Lagos Road Feeder

$$= \frac{1}{\lambda}$$

$$= \frac{1}{0.00171354}$$

$$= 583.587 \text{hours (average value within the eight years)} \dots (4.3)$$

Mean Down Time (MDT) = Mean Time To Repair (MTTR)on Lagos Road Feeder

$$= \frac{\text{Total down time}}{\text{Fault frequency}} \dots\dots\dots (4.4)$$

$$= \frac{16,390}{92}$$

$$= 178.152 \text{ hours (average result within the eight years)}$$

Availability of Electricity on Lagos Road Feeder in Percentage

$$\begin{aligned}
 \text{Availability} &= \frac{\text{Operating Time}}{\text{Total hours of time in a year}} \dots\dots\dots (4.5) \\
 &= \frac{53,690}{70080} \\
 &= 0.76612 \text{ or } 76.612\%
 \end{aligned}$$

Cumulative Load Losses of the Feeders in MW (2004 – 2011)

Feeders	Lagos road feeder	Ayangburen feeder	Ijebu Ode feeder	Eyita feeder	Igbogbo feeder	Ladega feeder	Agric feeder	Isawo feeder	Oriokuta feeder
Load Loss (MW)	203	237	204.5	204.32	180.98	200.9	198.3	189.1	175.01

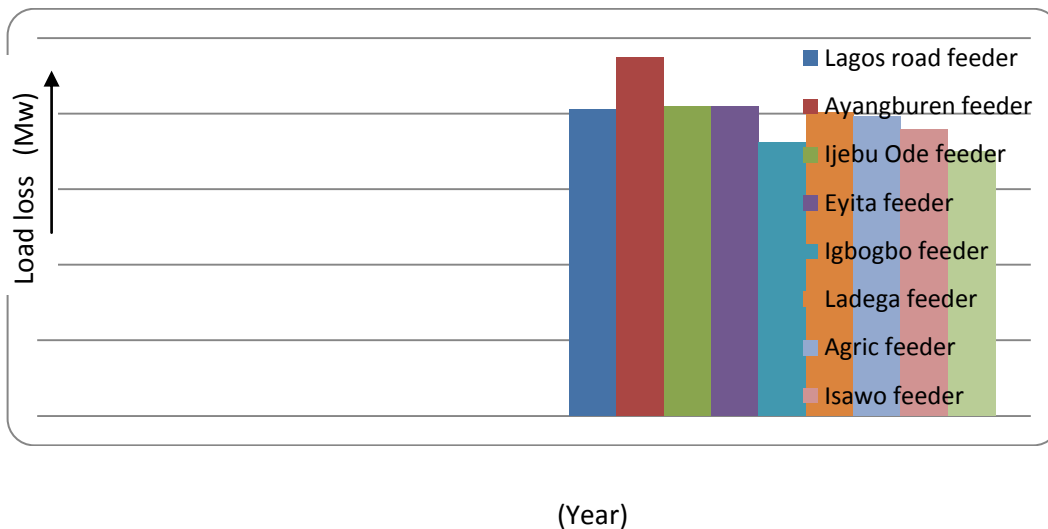


Figure 4.1 Feeder Load losses on the feeders (2004-2011)

The total load loss for the nine feeders in 2004-2011 is 1792.73MW

Table 4.2: Downtime Results for the Feeders in Hours (Year 2004-2011)

Feeders Cumulative	Lagos road feeder	Ayangburen feeder	Ijebu Ode feeder	Eyita feeder	Igbogbo feeder	Ladega feeder	Agric feeder	Isawo feeder	Oriokuta feeder
--------------------	-------------------	-------------------	------------------	--------------	----------------	---------------	--------------	--------------	-----------------

Downtime (hours)	16390	21277	18816	17842	20183	19431	17651	18628	18452

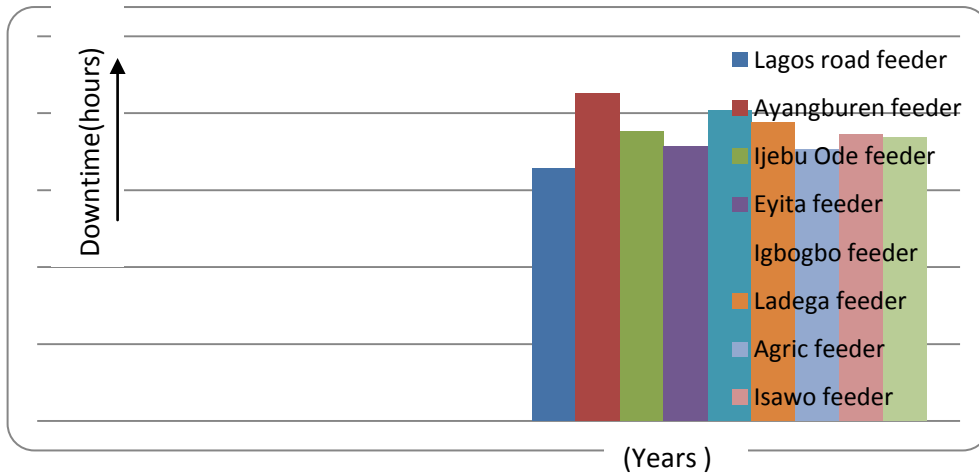


Figure 4.2: Downtime Results for the Feeders (Year 2004-2011)

Total Downtime along all the nine feeders between the 8 years (2004-2011) is equal to 168,670 Hours, out of the total time of 560,640 hours, leaving a total operating time of 391,670 hours

Table 4.3: Frequency of Faults on 11 kV Feeders (Frequency of Faults on all the Three Phases) (2004-2011)

Feeders	Lagos road feeder	Ayangburen feeder	Ijebu Ode feeder	Eyita feeder	Igbogbo feeder	Ladega feeder	Agric feeder	Isawo feeder	Oriokuta feeder
Frequency	92	106	94	100	95	97	93	90	93

Frequency of Faults ↑

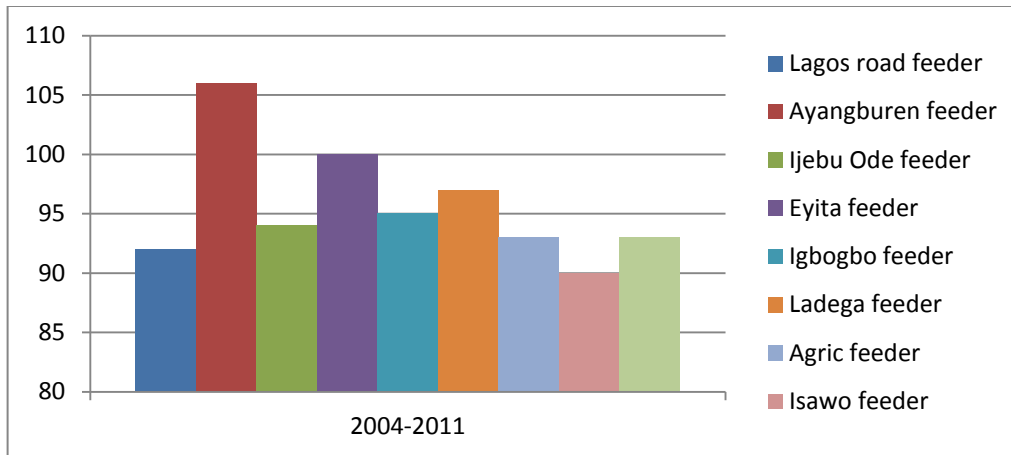


Figure 4.3: Frequency of Faults on 11 kV Feeders (Frequency of Faults on the Three Phases) (2004-2011)

Table 4.4: Failure Rate of 11 kV Feeders (2004-2011)

Feeders	Lagos road feeder	Ayangburen feeder	Ijebu Ode feeder	Eyita feeder	Igbogbo feeder	Ladega feeder	Agric feeder	Isawo feeder	Oriokuta feeder
Failure rate (hr)	0.00171	0.00217	0.00183	0.00191	0.00190	0.00192	0.00177	0.00175	0.00180

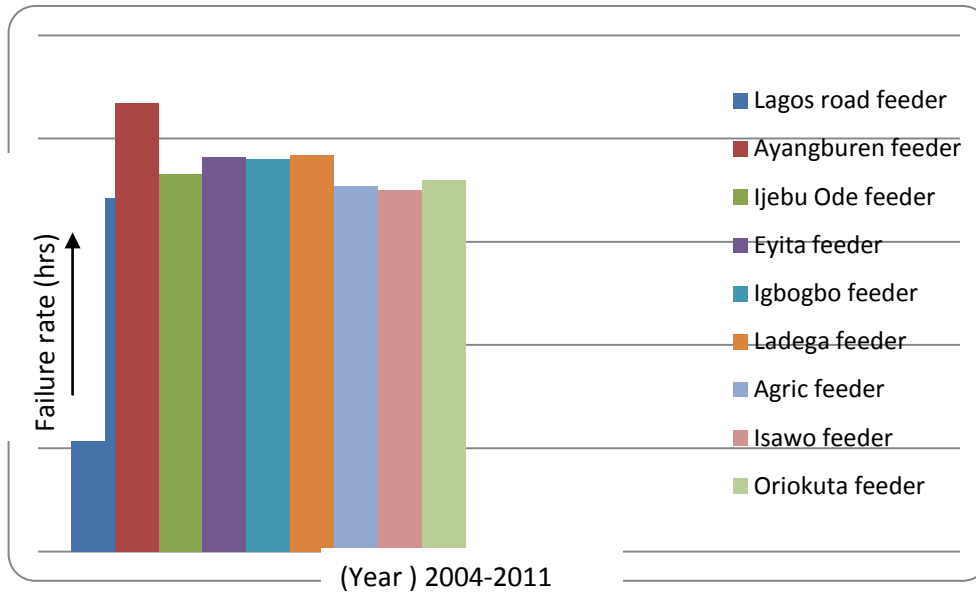


Figure 4.4: Failure Rate of 11 kV Lines Feeders (2004-2011)

Table 4.5: Reliability of 11 kV Feeders (2004-2011)

Feeders	Lagos road feeder	Ayangburen feeder	Ijebu Ode feeder	Eyita feeder	Igbogbo feeder	Ladega feeder	Agric feeder	Isawo feeder	Oriokuta feeder
Reliability ($\times 10^{-8}$)	30.314	0.547	10.587	5.223	5.721	5.185	17.878	22.181	14.048

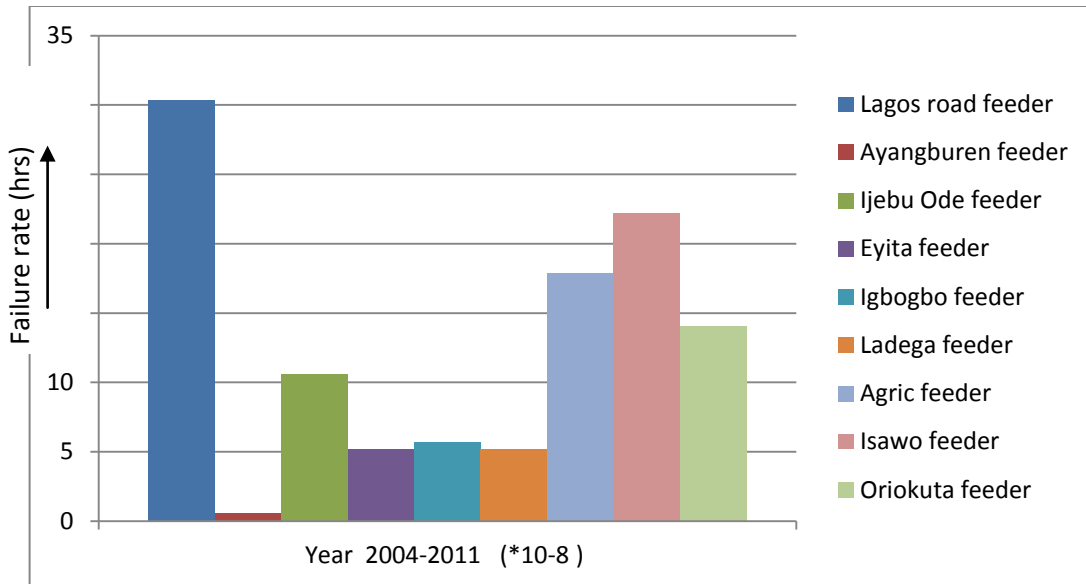


Figure 4.5: Reliability of the 11 kV Feeders (Year 2004-2011)

Resistance of Lagos Road Feeder

i. The length of each of the sections was obtained as shown in equation 3.21

$$L = S * 50 \dots\dots\dots (4.6)$$

Where S = number of spans
 50 = Average length span

ii. Resistance at 40°C (R_{40°C}) was obtained

DC Resistance (R_t)_{DC} per km of any line at temperature t (40.5) can be obtained using

Equation (3.22)

$$(R_t)_{DC} = (R_{ref})_{DC} * \frac{t + 288}{t_{ref} + 288} \dots\dots\dots (4.7)$$

Where $(R_{ref})_{DC}$ = DC Resistance of the line per km at a reference temperature t_{ref} ($20^{\circ}C$)

$(R_t)_{DC}$ = DC Resistance of the line at $40.5^{\circ}C$

$$t = 40^{\circ}C$$

$$t_{ref} = 20^{\circ}C$$

The DC Resistance of the line per km at a reference temperature $t_{ref} = 20^{\circ}C$ as stated by the manufacturer is $0.27018 \Omega / km$.

The AC Resistance $R_{t(AC)} / km$ of the line can then be obtained from

$$(4.8) \quad R_{t(AC)} / km = (R_t)_{DC} * 1.05$$

Where $R_{t(AC)} / km$ = AC Resistance of the line /km at $40^{\circ}C$

$(R_t)_{DC}$ = DC Resistance of the line at $40^{\circ}C$

1.05 is the factor used to multiply the DC resistance in order to

Obtain the AC resistance. It represents the addition resistance

Due to skin effects (Mehta and Mehta, 2008)

The resistance of the line at $40^{\circ}C$ were then obtained as follows:

$$(R_{40^{\circ}C})_{DC} / km = (R_{20})_{DC} * \frac{t + 288}{t_{ref} + 288}$$

$$t_{ref} + 288$$

$$(R_{40})_{DC}/km = 0.27018 * \frac{40 + 288}{20 + 288}$$

$$(R_{40})_{DC}/km = 0.27018 * \frac{328.5}{308}$$

$$(R_{40})_{DC}/km = 0.288163$$

$$(R_{40})_{AC}/km = 0.288163 * 1.05$$

$$(R_{40})_{AC}/km = 0.288163 * 1.05$$

$$= 0.3025709$$

Hence, the resistance of the line per kilometer = 0.3025709 ohm. These values were obtained by calculation using Microsoft excel algorithm. The values of the line resistance, inductance and impedance obtained are presented

Inductance of Lagos Road Feeder

The inductance of conductors per phase per meter can be obtained from equation (4.9)

$$= L_o = 10^{-7} * \left\{ 0.5 + 2 \log_e \frac{D_{eq}}{r} \right\}$$

.....(4.9)

$$\text{Where } D_{eq} = \sqrt[3]{D_{ab} * D_{bc} * D_{ca}} \quad \dots\dots\dots$$

(4.10)

And r = Radius of the 100mm² Aluminium conductor

The inductance of the 11KV line along Lagos Road feeder was obtained as illustrated below:

- i. Radius of the 100mm² Aluminum conductor = r
- r = 0.00559m

2. The distances between the pairs of conductors are :

$$D_{ab} = 0.658$$

$$D_{bc} = 0.658 \quad \text{and} \quad D_{ca} = 1.316$$

The equivalent distance of the conductor D_{eq} is given by

$$D_{eq} = \sqrt[3]{D_{ab} * D_{bc} * D_{ca}}$$

$$D_{eq} = \sqrt[3]{0.658 * 0.658 * 1.316}$$

$$D_{eq} = \sqrt[3]{0.5697806}$$

$$D_{eq} = 0.82902803 \text{ meter}$$

Inductance/phase/meter of the lines were obtained as follows:

$$L_o = 10^{-7} * \left\{ 0.5 + \frac{2 \log_e \frac{D_{eq}}{r}}{r} \right\}$$

$$L_o = 10^{-7} * \left\{ 0.5 + \frac{2 \log_e \frac{0.82908}{0.00559}}{0.00559} \right\}$$

$$L_o = 10^{-7} * \{ 0.5 + 2 \log_e 148.31485 \}$$

$$L_o / \text{phase/meter} = 0.0010312 \text{ Henry}$$

These values were obtained by calculation. Microsoft excel algorithm was used to analyze the results and the values of the line inductive reactance obtained were presented in tables 4.1 – 4.3

$$\text{Reactance of Lagos Road Feeder/phase/kilometer} = 2\pi f L_o \quad (4.II)$$

$$= 0.32400525 \text{ ohm}$$

$$\text{Resistance of Lagos Road Feeder/ phase/kilometer} = 0.302570893 \text{ ohm}$$

Impedance of the Lagos Road Feeder

The impedance Z , of Lagos Road feeder/kilometer = $0.302570893 + j0.32400525$

Therefore impedance Z per kilometer = 0.443 ohm

Table 4.6: Shows the Impedance of Lagos Road 11KV Feeder and their Measured Current Values on Section by Section Basis

S/N	Sections Location	Length (m)	Resistance (Ω)	Reactance (Ω)	Impedance (Ω)
1	Wema Bank	5.6	1.694	1.814	2.439
2	Jiboro	5.8	1.755	1.879	2.527
3	Afri Bank	6.0	1.815	1.944	2.614
4	Unity Bank	6.2	1.876	2.009	2.701
5	ITC	6.4	1.936	2.074	2.788
6	Oceanic Bank	6.4	1.936	2.592	2.788
7	Ragolis	8.0	2.421	2.657	3.485
8	Intercontinental	8.2	2.481	3.305	3.572
9	Oduguwa	10.2	3.086	3.337	4.444
10	First Bank	10.3	3.116	4.374	4.487
11	Fin Land	13.5	4.085	4.374	5.881
12	AmokeSoderu	13.5	4.085	4.374	5.881

S/N	Sections Location	Length (m)	Resistance (Ω)	Reactance (Ω)	Impedance (Ω)
1	Oke Oriya	10.2	3.086	3.305	4.522
2	Aniyikaye	10.6	3.207	3.434	4.699
3	Bolaji	11.4	3.450	3.694	5.053
4	Econet	11.8	3.570	3.823	5.231
5	Fatai	12.4	3.752	4.018	5.497
6	Ebun	13.5	4.085	4.374	5.985
7	Diamond Bank	7.3	2.209	2.365	3.236
8	Awosere	8.2	2.481	2.657	3.635
9	Lowa	10.2	3.086	3.305	4.522
10	Mabadeje	11.3	3.419	3.661	6.009
11	Arisendo	13.5	4.085	4.374	5.985

S/N	Sections Location	Length (m)	Resistance (Ω)	Reactance (Ω)	Impedance (Ω)
1	Lagos St Water Works	10.3	3.116	3.337	4.566
2	Etisalat	10	3.027	3.240	4.433
3	Koya	12	3.631	3.888	5.319
4	UBA	9.4	2.844	3.046	4.167
5	GTB	9.6	2.905	3.110	4.256
6	Fun City	9.8	2.965	3.175	4.344
7	Zenith Bank	9.9	2.995	3.208	4.389
8	Sterling Bank	10.0	3.026	3.240	4.433
9	Tanterlizer	10.2	3.086	3.305	4.522
10	Jobi	10.4	3.147	3.370	4.610
11	Ajenifuja	12.1	3.661	3.920	5.364
12	Towolari	11.4	3.449	3.694	5.054

Load Flow Analysis and Line Parameters along Lagos Road Feeder

The normal operating voltage of Lagos ROAD feeder is 11KV. Its length is 13.52 Km. It originates from the 33/11kV Distribution Substation Located at Sabo in Ikorodu. However, the resistance and inductance along the line form series impedance which usually reduces the voltage at the receiving end. As a result, the output of any of the 11/0.415kV distribution transformers along the feeder is always less than 220 V on a single phase and less than 415V on a three phase system. Voltages along the line were recorded using multi meter at interval of 1km. The results obtained were shown in table 4.6

Analysis and Calculations of Fault Currents on Lagos Road Feeder

Fault currents were estimated and calculated based on the data collected in Ikorodu PHCN Distribution office along 11KV Lagos Road and other feeders. From these data, calculations and analysis were made; the fault currents along the distribution line were also calculated.

From the results obtained the ratings of the protective devices such as: current transformers, relays, circuit breakers and fuses that would be required for the protection of the distribution line and equipment were obtained. Thus the protective devices selected will be able to withstand the large values of fault current which will occur in the event of faults. With this development, the protection of lines, equipment, lives and properties can be safeguarded by proper setting and of choice relays. Fault currents along the outgoing 11kV Lagos Road feeder were calculated and the results obtained presented:

At the point of fault, I/Z_{pu} equivalent = $I/0.1903823$

$$\begin{aligned} (1) \quad \frac{I}{Z_p} &= 5.253 \\ &= \frac{I}{0.1903823} \\ &= 5.253pu \end{aligned}$$

$$(2) \quad \text{Since } VA_{\text{fault}} = I/Z_{f,pu} \times (MVA)_{\text{base}},$$

$$\text{Then } VA_{\text{fault}} = 5.253 \times 15$$

$$= 78.795 \text{ MVA}$$

$$\begin{aligned} (3) \quad I_f &= \frac{I/Z_{f,pu} \times (MVA)_{\text{base}}}{KV \times \sqrt{3}} \\ &= \frac{5.253 \times 15}{11 \times \sqrt{3}} \\ &= 4.135786 \text{ KA} \end{aligned}$$

Having obtained the fault currents (I_f) and the fault voltages (V_f) from the control room of the Utility Company, one can now develop a

programme that will evaluate and determine the values of the impedance (Z) in ohms at the point of fault and the per unit impedance (Z_{pu}) up till the point of fault. Given the per km impedance of the distribution lines, the distance (that is the length of line) where repair operations should be carried out can be obtained. This will be useful in fault location, ease the location of the point of faults, speed repair operations and improve the performance of the system.

CONCLUSION AND RECOMMENDATION

The supply of electric power in Ikorodu Distribution network is not reliable. It is characterized by a large number of faults. Duration of outages or interruption of power supply is also very high in the area. Load demand kept on increasing on yearly basis. The present demand for electricity in the country is 9437MW and by the year 2015, this value according to the Energy Commission of Nigeria will be increasing to 15,730MW. Yet the country could only generate 3,500MW of electricity out of a total of 6,367 MW power station installed capacity. Because of these irregular problems, many industrial processes have been unfavourably affected. The problem has affected economic growths of local and international industries. Thus production cost and market price of goods and services kept on increasing because the affected industries seek alternative source of power supply through high cost of generators and fuel.

Again, it was observed that many of the power and distribution transformers are too old. Thus, making continuous maintenance at high cost, a regular practice in the distribution area. Fault frequency is also very high. It was observed that this high fault frequency affected the failure rates and conversely, reduces the reliability of power system in the distribution area. For example in Lagos Road feeder where the number of consumers is about 4,709, the failure rate for the eight years is 0.0017135 failure/hour/customer. This is too high because in a normal

circumstance, anywhere in the world, failure rate should be as low as 0.00001459 failure/hour/customer or even lower.

The actual electrical power requirement of customers along Lagos Road feeder is 15.328MW while power supply along the feeder is 6.711MW. This has shown that the quantity of power supply is inadequate in the area. Load demand kept on increasing in the distribution network area. As at December, 2011, load demand of the customers in Ikorodu was 120MW. Beside this increase in load, the network is characterized by the high number of faults and outages which is over 100 occurrences per annum. All these have made power failure and outage problems regular events in this distribution area. For instance, the net failure rate between years 2004-2011 along Lagos Road feeder is 0.001411 failure/hour/customer. It is even worst along Ayangburen 11kV feeder, over there, the failure rate was at the highest level of 0.002172 failure/hour/customer. And along Ijebu Ode feeder, the failure rate was 0.001834 failure/hour/customer. All these are still on the high side. They are therefore reasons for the incessant supply of electric power in this distribution area. Also, Mean Time Between Failure stands at an average of 583.59 hours along Lagos Road feeder. Mean down time along the feeder is 178.1522 hours. The results show that most of the electrical equipment along this feeder are prone to failure as a result of overload, losses, damages and decrease in efficiency of components. Thus, the supply of electricity along all the feeders is not reliable and needs improvement according to the following recommendations.

This research work revealed that the actual electrical power requirement of customers along Lagos Road feeder is 15.328MW. The actual electrical power requirement of customers in Ikorodu Distribution Network is 137.952MW. The actual electrical power requirement of customers in Lagos State is 2,759.04MW. The actual electrical power requirement of Nigeria is 106,774.848MW. If Nigeria must overcome the present incessant power outages, poor power supply which has

grounded many activities, destroyed many industrial processes, reduced productivity, increase unemployment and crime among the youths, this is the actual electrical power required by the country.

ACKNOWLEDGEMENT

I am mostly grateful unto the Almighty God who gave me the grace and opportunity to complete this research work and publication.

My gratitude goes to my Dr. G.A. Adegboyega who whole heartedly gave me all the supports I needed during this research work. His useful suggestions, corrections, great support, intensive review, encouragement and his input to this work has made it possible. May the Almighty God be with you.

I sincerely extend my gratitude to my brother, Mr. Rotimi, whose empathy is worthy of good note. My profound gratitude goes to my children Dorcas and Joseph. I thank you for your advice and words of encouragement. May The Almighty GOD Bless you all.

REFERENCES

- Adegboyega, G.A., Adu, M.R. and Melodi A.O. (2010), Power Losses in Distribution System and Solutions; Akure as a Case Study, FUTAJET, vol. 6, No.2, page 75-80
- Burke James J. (1994), Power Distribution Engineering Fundamental and Applications, Marce Dekker Inc. New York, page 125-127
- Desphande, M.V. (1984), Electrical Power System Design, Tata Mc Graw-Hill Publishing Company Limited, New Delhi, page 56-78
- Gupta B.R. (2010), Power System Analysis and Design, S. Chand Company Limited New Delhi Pages 593 – 611

- Kothari D.P. and Nagrath, I.J (2008) Power System Engineering ,
Second Edition, Mc Graw – Hill , New Delhi, Page 1 – 12, 146 –
159, 456 – 557
- Monterrosa Carlos (2011), Fault Analysis in Electrical Works and
Distribution Lines, Green and Co Ltd, London, Page 77
- Edward J. Tyler, 2005, National Electric Estimator, Craftman Book
Company Page 90
- Fortesque, C.L. (1918), Method of Symmetrical Coordinate Applied to
the Solution of Polyphase Networks
- Francis, T.G. (2001), Electrical Installation Work, Longmans, Green
and Co Ltd, London, Page 1-3
- Gupta J.B. (2006), A Course in Power System, S.K. Kataria & Sons,
New Delhi, part 1, Page 130
- Pabla, A.S. (2004) Electric Power Distribution , 5th Edition , Mc Graw –
Hill Publishing Company , New Delhi , Pages 96, 117, 218 and
230.