

Utah State University

DigitalCommons@USU

Reports

Utah Water Research Laboratory

January 1974

Steady Flow Analysis of Pipe Networks: An Instructional Manual

Roland W. Jeppson

Follow this and additional works at: https://digitalcommons.usu.edu/water_rep



Part of the [Civil and Environmental Engineering Commons](#), and the [Water Resource Management Commons](#)

Recommended Citation

Jeppson, Roland W., "Steady Flow Analysis of Pipe Networks: An Instructional Manual" (1974). *Reports*. Paper 300.

https://digitalcommons.usu.edu/water_rep/300

This Report is brought to you for free and open access by the Utah Water Research Laboratory at DigitalCommons@USU. It has been accepted for inclusion in Reports by an authorized administrator of DigitalCommons@USU. For more information, please contact digitalcommons@usu.edu.



**STEADY FLOW ANALYSIS OF PIPE NETWORKS—
An Instructional Manual**

by
Roland W. Jeppson

**Developed with support from the Quality of Rural Life Program
funded by the Kellogg Foundation and Utah State University**

**Copyright © 1974 by Roland W. Jeppson
This manual, or parts thereof, may not be reproduced in any form
without permission of the author.**

**Department of Civil and Environmental Engineering
and Utah Water Research Laboratory
Utah State University
Logan, Utah 84322**

September 1974

\$6.50

TABLE OF CONTENTS

Chapter	Page
I	FUNDAMENTALS OF FLUID MECHANICS 1
	Introduction 1
	Fluid Properties 1
	Density 1
	Specific weight 1
	Viscosity 1
	Example Problems Dealing with Fluid Properties 2
	Conservation Laws 3
	Introduction 3
	Continuity 3
	Example Problems Applying Continuity 4
	Conservation of Energy (Bernoulli Equation) 6
	Example Problems Dealing with Conservation Laws 9
	Momentum Principle in Fluid Mechanics 12
II	FRictionAL HEAD LOSSES 13
	Introduction 13
	Darcy-Weisbach Equation 13
	Friction Factor for Laminar Flow 13
	Friction Factors for Turbulent Flows 15
	Example Problems Using the Darcy-Weisbach Equation 16
	Computer Use with Darcy-Weisbach Equation (the Newton-Raphson Method) 19
	Empirical Equations 20
	Example Problems Using the Darcy-Weisbach Equation 21
	Exponential Formula 22
	Example Problems in Defining Exponential Formula from the Darcy-Weisbach Equation 22
III	MINOR LOSSES 25
	Introduction 25
	Bends, Valves, and Other Fittings 25
	Entrances, Exits, Contractions, and Enlargements 27
IV	INCOMPRESSIBLE FLOW IN PIPE NETWORKS 29
	Introduction 29
	Reducing Complexity of Pipe Networks 29
	Series pipes 29

TABLE OF CONTENTS (Continued)

Chapter	Page
Parallel pipes	30
Branching system	30
Minor losses	30
Example Problem in Finding Equivalent Pipes	31
Systems of Equations Describing Steady Flow in Pipe Networks	32
Flow rates as unknowns	32
Example Problems in Writing Flow Rate Equations	34
Heads at Junctions as Unknowns	35
Corrective flow rates around loops of network considered unknowns	36
V LINEAR THEORY METHOD	39
Introduction	39
Transforming Nonlinear Energy Equations Into Linear Equations	39
Example Problems Using Linear Theory for Solution	43
Including Pumps and Reservoirs into Linear Theory Method	44
Example Problems which Include Pumps and Reservoirs	47
VI NEWTON-RAPHSON METHOD	61
Introduction	61
Head-equation	62
Example Problems Based on the H-Equations	64
Corrective Flow Rate Equations	65
Example Problems in Solving ΔQ -Equations	68
VII HARDY CROSS METHOD	73
Introduction	73
Mathematical Development	73
APPENDIX A: UNITS AND CONVERSION FACTORS UNIT DEFINITIONS (SI)	77
APPENDIX B: AREAS FROM PIPE DIAMETERS	79
APPENDIX C: DESCRIPTION OF INPUT DATA REQUIRED BY A COMPUTER PROGRAM WHICH SOLVES THE Q-EQUATIONS BY THE LINEAR THEORY METHOD	81
APPENDIX D: DESCRIPTION OF INPUT REQUIRED BY A COMPUTER PROGRAM WHICH SOLVES THE ΔQ-EQUATIONS BY THE NEWTON-RAPHSON METHOD	85
APPENDIX E: DESCRIPTION OF INPUT DATA REQUIRED BY PROGRAM WHICH USES THE HARDY CROSS METHOD OF SOLUTION	87

CHAPTER I

FUNDAMENTALS OF FLUID MECHANICS

Introduction

This chapter provides the necessary background information concerning the properties of fluids and the laws which govern their motion. Readers with some understanding of fluid mechanics might begin their reading with Chapter II. Those readers with better training in fluid mechanics, equivalent to that acquired by civil, mechanical, agricultural, or aeronautical engineers, might begin their reading with Chapter IV.

The first section in this chapter will introduce those properties of fluids which are needed to understand later material in this manual. Along with these properties you will become acquainted with symbols which are used to denote fluid properties, as well as units and dimensions which are associated with these symbols. Later these symbols will appear in equations, and consequently as you read this chapter you should make the association between the symbol and what it represents. After covering basic fluid properties, with particular emphasis on liquids (or more precisely referred to as incompressible fluids; gases are compressible fluids), the fundamental conservation principles of mass and energy are discussed in the later portion of this first chapter with special reference to liquid (i.e., incompressible) flow in pipes and other closed conduits.

Fluid Properties

Density

The mass per unit volume is referred to as the density of the fluid and is denoted by the Greek letter ρ (rho). The dimensions of density are mass per length cubed or M/L^3 . The English system of units (abbreviated ES) uses the slug for the unit of mass, and feet for the unit of length. The dimensions commonly used in connection with the ES system of units are force, F , length, L , and time, T . In the Systeme internationale, SI, the common dimensions are mass, M , length, L , and time, T . Thus in using FLT, dimensions for the slug can be obtained by relating mass to force through the gravitational acceleration, g , i.e. $F(\text{force}) = M(\text{mass}) \times g(\text{acceleration of gravity})$. Thus since the units of acceleration are ft/sec^2 , the units of density are,

$$\frac{\text{Slug}}{\text{ft}^3} \text{ or } \frac{\text{lb-sec}^2}{\text{ft}^4}$$

in the English system.

In the international system (Système International d'Unités) of units (abbreviated SI) which is an outgrowth of the metric system, mass is measured in the unit of the gram, gr (or kilogram, kg , which equals 1000 grams); force is measured in Newtons, N , and length in meters, m . A Newton is the force required to accelerate 1 kg at a rate of $1 \text{ m}/\text{sec}^2$, and equals 10^5 dynes which is the force needed to accelerate 1 gr at $1 \text{ cm}/\text{sec}^2$.

The units of density in the SI system are:

$$\frac{\text{kg}}{\text{m}^3} \text{ or } \frac{\text{N-sec}^2}{\text{m}^4}$$

The conversion of density from the ES system to the SI system or vice versa can be determined by substituting the equivalent of each dimension as given in Appendix A. Upon doing this

$$1 \text{ Slug}/\text{ft}^3 = 515.363 \text{ kg}/\text{m}^3$$

The density of water equals $1.94 \text{ slug}/\text{ft}^3$ or $1000 \text{ kg}/\text{m}^3$ ($1 \text{ gr}/\text{cm}^3$).

Specific weight

The specific weight (sometimes referred to as the unit weight) is the weight of fluid per unit volume, and is denoted by the Greek letter γ (gamma). The specific weight thus has dimensions of force per unit volume. Its units in the ES and SI systems respectively are:

$$\frac{\text{lb}}{\text{ft}^3} \text{ and } \frac{\text{N}}{\text{m}^3} \text{ or } \frac{\text{kg}}{\text{m}^2\text{-sec}^2}$$

The specific weight is related to the fluid density by the acceleration of gravity or

$$\gamma = g\rho \quad \dots \dots \dots (1-1)$$

Since $g = 32.2 \text{ ft}/\text{sec}^2$ ($9.81 \text{ m}/\text{sec}^2$), the specific weight of water is

$$\gamma = 32.2 (1.94) = 62.4 \text{ lb}/\text{ft}^3 \quad (\text{ES})$$

or

$$\gamma = 9.81 (1000) = 9810 \text{ N}/\text{m}^3 \quad (\text{SI})$$

Viscosity

Another important fluid property is its viscosity (also referred to as dynamic or absolute viscosity). Viscosity is the fluid resistance to flow, which reveals

itself as a shearing stress within a flowing fluid and between a flowing fluid and its container. The viscosity is given the symbol μ (Greek symbol mu) and is defined as the ratio of the shearing stress τ (Greek letter tau) to the rate of change in velocity, v , or mathematically dv/dy . This definition results in the following important equation for fluid shear.

$$\tau = \mu \frac{dv}{dy} \dots \dots \dots (1-2)$$

in which dv/dy is the derivative of the velocity with respect to the distance y . The derivative dv/dy is called the velocity gradient. Equation 1-2 is valid for viscous or laminar flow but not for turbulent flow when much of the apparent shear stress is due to exchange of momentum between adjacent layers of flow. Later, means for determining whether the flow is laminar or turbulent are given.

From Eq. 1-2 it can be determined that the dimensions of viscosity are force multiplied by time divided by length squared or FT/L^2 . Its units in the ES and SI systems are respectively,

$$\frac{\text{lb-sec}}{\text{ft}^2} \text{ or } \frac{\text{Slug}}{\text{ft-sec}} \text{ and } \frac{\text{N-sec}}{\text{m}^2} \text{ or } \frac{\text{kg}}{\text{m-sec}}$$

Occasionally the viscosity is given in poises (1 poise = 1 dyne sec/cm²). One poise equal 0.1 N-sec/m².

Because of its frequent occurrence, the absolute viscosity divided by the fluid density is separately defined and called the *kinematic viscosity*, ν (Greek letter nu). The kinematic viscosity thus is

$$\nu = \mu/\rho \dots \dots \dots (1-3)$$

The dimensions of kinematic viscosity are length squared per time. Common units for ν in the ES and SI system respectively are:

$$\frac{\text{ft}^2}{\text{sec}} \text{ and } \frac{\text{m}^2}{\text{sec}}$$

Another often used unit for kinematic viscosity in the metric system is the stoke (or centistoke = .01 stoke). The stoke equals 1 cm²/sec.

The viscosity of many common fluids such as water depends upon temperature but not the shear stress τ or dv/dy . Such fluids are called Newtonian fluids to distinguish them from non-Newtonian fluids whose viscosity does depend upon dv/dy . Table 1-1 gives values of the absolute and kinematic viscosities of water over a range of temperatures.

Table 1-1. Viscosities of water.

Temperature		Viscosity, μ		Kinematic Viscosity, ν	
$^{\circ}\text{F}$	$^{\circ}\text{C}$	lb-sec/ft ² x 10 ⁵	N-sec/m ² x 10 ³	ft ² /sec x 10 ⁵	m ² /sec x 10 ⁶
32	0	3.746	1.793	1.931	1.794
40	4.4	3.229	1.546	1.664	1.546
50	10	2.735	1.309	1.410	1.310
60	15.6	2.359	1.129	1.217	1.131
68	20	2.093	1.002	1.084	1.007
70	21.1	2.050	0.982	1.059	0.984
80	26.7	1.799	0.861	0.930	0.864
90	32.2	1.595	0.764	0.826	0.767
100	37.8	1.424	0.682	0.739	0.687

Example Problems Dealing with Fluid Properties

1. A container with a volume of 8.5 ft³ (.241 m³) is filled with a liquid. The container and liquid weigh 650 lbs (2890 m) and the container weighs 55 lbs (244.6 N). Determine the density and specific weight of the liquid.

Solution: ES SI

Wt. of liquid = 650-55 = 595 lb;= 2890 - 244.6=2645.4N

$$\gamma = \frac{\text{Wt}}{\text{Vol}} = \frac{595}{8.5} = 70 \frac{\text{lb}}{\text{ft}^3}; \gamma = \frac{2645.4}{.241} = 11,000 \frac{\text{N}}{\text{m}^3}$$

$$\rho = \frac{\gamma}{g} = \frac{70}{32.2} = 2.17 \frac{\text{Slug}}{\text{ft}^3}; \rho = \frac{11,070}{9.81} = 1120 \frac{\text{kg}}{\text{m}^3}$$

2. Oil with $\mu = 2. \times 10^{-4}$ lb-sec/ft² flowing in a 4-inch (10.16 cm) diameter pipe has a parabolic velocity profile given by: $v = 0.45[1 - (r/R)^2]$ fps ($v = .1372[1 - (r/R)^2]$ mps), in which r is the radial distance from the pipe centerline and R is the radius of the pipe. What is the shear stress in the oil at $r = 0''$, $1''$ (2.54 cm) and $2''$ (5.08 cm)?

Solution:

ES

$$\tau = -\mu \frac{dv}{dr} = \mu [0.9 r/R^2];$$

at $r=0, \tau = 2. \times 10^{-4}(.9) \left(\frac{0}{.02778} \right) = 0$ psf;

$$r=1'', \tau = 2. \times 10^{-4} (.9) \left(\frac{.0833}{.02778} \right) = .000540 \text{ psf;}$$

$$r=2'', \tau = 2. \times 10^{-4} (.9) \left(\frac{.1667}{.02778} \right) = .00108 \text{ psf;}$$

SI

$$\tau = \mu [2.744 \tau/R^2]$$

$$\tau = .009576 (.2744) (0/.002581) = 0 \text{ Nsm}$$

$$\tau = .009576 (.2744) (.0254/.002581) = .02585 \text{ Nsm}$$

$$\tau = .009576 (.2744) (.0508/.002581) = .0517 \text{ Nsm}$$

3. With what force would the flowing oil in problem 2 tend to pull 1000 ft (304.8 m) length of the 4" (10.16 cm) pipe? Relate this force to the pressure drop in the pipe.

Solution:

$$\text{Force } F_{\tau} = A_s \tau = (2\pi R \times \text{length}) \tau$$

ES

$$F_{\tau} = 2\pi(.1667)(1000)(.00108) = 1.13 \text{ lbs;}$$

SI

$$F_{\tau} = 2\pi(.0508)(304.8)(.0517) = 5.03 \text{ N}$$

A control volume of the 1000 ft of fluid shows that the difference in pressure forces at the ends must equal the shear force, i.e.



$$F_{\tau} = (P_1 - P_2) A = \Delta P A, \Delta P = F_{\tau}/A$$

ES

$$\Delta P = 1.13/(\pi \cdot .02778) = 12.95 \text{ psf;}$$

SI

$$\Delta P = 5.03/(\pi \cdot .002581) = 620 \text{ Nsm}$$

Conservation Laws

Introduction

Many analytical computations in engineering and the physical sciences are based on a relatively few fundamental principles and concepts. Most important among these are Newton's laws of motion, and conservation of mass, energy, and momentum. With limited exceptions mass is not created or destroyed, energy is only converted from one form to another, and momentum is only changed by force acting through time. In fluid mechanics the quantification of the conservation of mass is referred to as the continuity equation in its various forms. An expression of the conservation of energy frequently used in hydraulics is the Bernoulli equation. The momentum principle is extremely useful in determining external forces acting on moving fluids. The equations obtained from these three conservation principles are the most fundamental equations used for solving fluid mechanics problems. These principles and equations will be discussed in this section with special reference to solving problems dealing with fluid flow in pipes.

Continuity

In more general forms, mathematical equations which embody the principle that mass is conserved are

differential or integral equations. This is the case because in general the quantities which describe the flow, such as point velocities, are functions of position in space and time. For flows whose variables vary with a single space coordinate, and do not vary in time, an algebraic equation can be used for describing the fact that mass is conserved. Flows that do not change in time are called *steady* flow, and if only one space coordinate is used the flow is *one-dimensional*. This manual deals only with steady, one-dimensional flows.

In solid mechanics the conservation of mass principle is applied by simply noting that the mass of any body remains constant. When dealing with fluid flows it is generally more convenient to deal with the amount of fluid mass passing a given section of the flow rather than to keep track of the positions of all individual particles of fluid. Thus the continuity equation will deal with mass flux passing a section of the flow instead of mass alone. Mass flux is simply the flow of mass or mass per time, and has the units of slugs/sec in the ES system and kg/sec in the SI system. Denoting mass flux by G it can be related to ρ , the area through which flow occurs and the fluid velocity by,

$$G = \rho AV = \rho Q \dots \dots \dots (1-4)$$

in which A is the cross-sectional area of the section and V is the average velocity of the flow through the section.

The area A is normal to the direction of the velocity. The symbol Q in the later part of Eq. 1-4 is the volumetric flow rate with dimensions of L³/T and is given by,

$$Q = AV \dots \dots \dots (1-5)$$

For steady flow in a conduit the mass flux through two sections denoted by subscripts 1 and 2 of pipe some distance apart must be equal if the flow is steady. Therefore

$$\begin{aligned} G_1 &= G_2 \\ \text{or} \\ \rho_1 A_1 V_1 &= \rho_2 A_2 V_2 \dots \dots \dots (1-6) \end{aligned}$$

Equation 1-6 is one form of the continuity equation. For fluids that are incompressible, i.e. whose densities are constant regardless of the pressure, the continuity equation reduces to

$$\begin{aligned} Q_1 &= Q_2 \\ \text{or} \\ A_1 V_1 &= A_2 V_2 \dots \dots \dots (1-7) \end{aligned}$$

Occasionally the weight flow rate W is wanted. It equals gG or

$$W = gG = g\rho AV = \gamma AV \dots \dots \dots (1-8)$$

In dealing with junctions of two or more pipes the continuity principle states that the mass flow into the

junction must equal the mass flow out of the junction. Mathematically this principle is,

$$\Sigma G_i = \Sigma \rho_i Q_i = 0 \dots \dots \dots (1-9)$$

in which the subscript i takes on the values for the pipes which join at the junction and the summation, Σ , indicates the sum of these G's with proper regard for sign. Again for incompressible flows Eq. 1-9 reduces to,

$$\Sigma Q_i = 0 \dots \dots \dots (1-10)$$

Equation 1-9 or 1-10 will play an important role later in analyzing networks of pipes. Junctions in such networks are commonly referred to as nodes.

If the velocity is not constant throughout the flow section, calculus can be used to determine the mass, weight, or volumetric flow rates past a section. For example, if the volumetric flow rate in a pipe is to be determined, and the velocity in the pipe is a known function of the radial distance r from the center of the pipe, then

$$Q = \int_A v(r) dA = \int_0^R v(r) (2\pi r dr)$$

in which R is the radius of the inside of the pipe. The average velocity V can be determined from this Q by

$$V = Q/A$$

Example Problems Applying Continuity

1. A 6-inch (.1524 m) pipe is connected to an 8-inch (.2032 m) pipe. If the average velocity V = 35 fps (10.67 mps) in the 6-inch pipe what is the average velocity in the 8-inch pipe? Determine the mass flow rate, the weight flow rate, and the volumetric flow rate.

$$W = gG = 32.2 (13.33) = 429.2 \text{ lb/sec}$$

$$Q = \frac{G}{\rho} = \frac{13.33}{1.94} = 6.87 \text{ ft}^3/\text{sec}$$

Solution:

SI

$$A_8 V_8 = A_6 V_6, \quad V_8 = \frac{A_6}{A_8} V_6 = \left(\frac{D_6}{D_8}\right)^2 V_6$$

$$V_8 = \left(\frac{.1524}{.2032}\right)^2 10.67 = 6.00 \text{ mps}$$

ES

$$G = 1000 (10.67) \left[\frac{\pi}{4} (.1524)^2 \right] = 194.6 \text{ kg/sec}$$

$$V_8 = \left(\frac{6}{8}\right)^2 35 = 19.69 \text{ fps}$$

$$W = 9.81 (194.6) = 1909 \text{ N/sec}$$


$$G = 1.94 (35) \left[\frac{\pi}{4} \left(\frac{6}{12}\right)^2 \right] = 13.33 \text{ slug/sec}$$

$$Q = \frac{194.6}{1000} = .1946 \text{ m}^3/\text{sec}$$

fluid will be discussed. For now it will simply be denoted by E_L .

A pump may exist in a pipeline which supplies energy to each unit mass of fluid passing through it, or a turbine may extract energy therefrom. These mechanical energies will be denoted by E_m , with the subscript standing for all forms of external mechanical energy. A pump produces a positive amount of E_m in the fluid and a turbine produces a negative E_m .

With these additional symbols for energy losses and all other forms of mechanical energy, the conservation of energy between two sections within a flow denoted by 1 and 2 respectively, such as depicted in the sketch below, is given by,

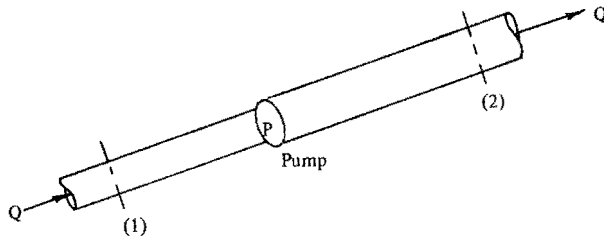

$$E_1 + E_m = E_2 + E_L \quad \dots \dots (1-12a)$$

Upon substituting from Eq. 1-11

$$gz_1 + p_1/\rho + V_1^2/2 + E_m = gz_2 + p_2/\rho + V_2^2/2 + E_L \quad \dots \dots (1-12b)$$

This equation is very important in computations dealing with incompressible fluid flow.

Energy per unit weight. Each of the terms in Eqs. 1-12 have dimensions of FL/M (lb-ft/slug in the ES system and N-m/kg in the SI system). Using the relationship between mass M and force F , $F = ML/T^2$, the dimensions


of each term in Eqs. 1-12 are also L^2/T^2 (ft^2/sec^2 in the ES system and m^2/sec^2 in the SI system). For many practical applications it is more convenient to express each term in the energy equation in dimensions of length L . This conversion of dimensions can be accomplished by dividing each term in Eq. 1-12b by g which has dimensions of L/T^2 , giving

$$z_1 + \frac{p_1}{\gamma} + \frac{V_1^2}{2g} + h_m = z_2 + \frac{p_2}{\gamma} + \frac{V_2^2}{2g} + h_L \quad \dots \dots (1-13)$$

in which $h_m = E_m/g$ and $h_L = E_L/g$

In hydraulic engineering practice Eq. 1-13 is used more widely than Eq. 1-12b, and is known as the Bernoulli equation, even though Eq. 1-12b might also be called the Bernoulli equation. These equations are very important in fluid flow, and therefore the meaning of each term should be fully understood. In Eqs. 1-12 each term represents energy per unit mass. Since Eq. 1-13 was obtained by dividing Eq. 1-12b by g and g multiplied by mass gives weight, each term in Eq. 1-13 represents energy per unit weight or $FL/F = L$.

Since the dimensions of each term in Eq. 1-13 is length, L (more correctly energy per pound), each such term is designated as a *head*, z is the *elevation head*, p/γ is the *pressure head*, and $V^2/2g$ is the *velocity head*. The sum of $z + p/\gamma$ is denoted as the *piezometric* or *hydraulic head* and the sum $z + p/\gamma + V^2/2g$ is the *total* or *stagnation head*. Lines referred to as the hydraulic grade line (abbreviated HGL) and energy line (abbreviated EL) representing the piezometric and total heads, respectively, along a flow path are often drawn on sketches of the flow system. These lines not only convey considerable information about the flow but also aid considerably in understanding and analyzing a problem. The sketch of the system of pipes containing a turbine and a pump, shown below, illustrate the HGL and EL lines. In the reservoirs

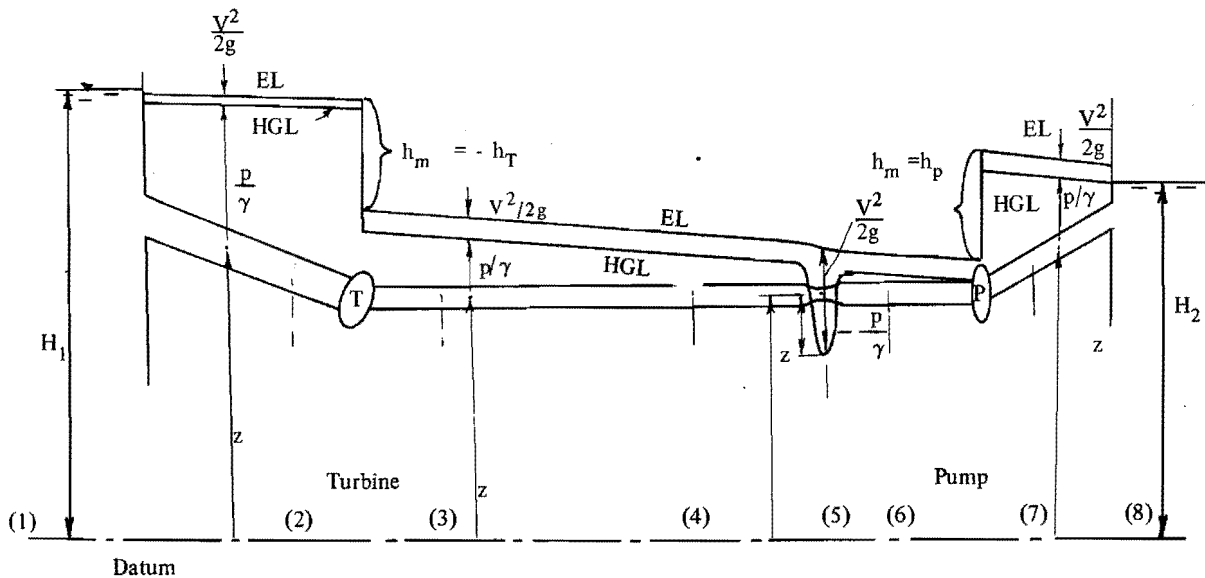

the velocity is zero, and on the water surface the pressure is zero (i.e. atmospheric), consequently the energy line is at the water surfaces in the reservoirs. The fact that the energy line at the upstream pipe entrance is slightly below the water surface in the reservoir is due to the entrance head loss, and the fact that the energy line enters the downstream reservoir above the surface means the velocity head above the water surface becomes the exit head loss. The amount that the EL drops between any two points in a pipe equals the head loss (or frictional loss) in that section of pipe. The amount of energy per pound of flowing fluid extracted by the turbine is represented by $h_m = -h_T$, and that added by the pump is $h_m = h_p$. The HGL is always the velocity head, $V^2/2g$, below the energy line. At the restricted section of pipe between the turbine and pump the velocity must increase to satisfy the continuity equation. With the resulting large increase in velocity head $V^2/2g$ at this section the pressure head, p/γ , must decrease, and for the situation depicted becomes negative, i.e. the HGL falls below the elevation of the pipe. At the entrance to the pump the pressure, which has become zero, is boosted through the pump to a relatively large value. The elevation head z is always taken as the distance between an arbitrarily selected datum and the fluid being considered, i.e., in this case the centerline of the pipe.

To illustrate the use of the Bernoulli equation, Eq. 1-13, it is written below between several of the sections identified by the numbers 1 through 8 on the above sketch. You should practice writing it between other sections.

Between sections 1 and 2

$$H_1 = (h_L)_{\text{entrance}} + z_2 + p_2/\gamma + \frac{V_2^2}{2g} + h_{L12}$$

Between sections 1 and 3

$$H_1 = (h_L)_{\text{entrance}} + z_3 + p_3/\gamma + \frac{V_3^2}{2g} + h_{L12} + h_T$$

Between sections 3 and 5

$$z_3 + p_3/\gamma + \frac{V_3^2}{2g} = z_5 - \frac{|p_5|}{\gamma} + \frac{V_5^2}{2g} + h_{L35}$$

Between sections 6 and 8

$$z_6 + p_6/\gamma + \frac{V_6^2}{2g} - h_{L68} + h_p = H_2$$

In a reservoir or other body in which the velocity of the liquid is zero the Bernoulli equation reduces to

$$z_1 + p_1/\gamma = z_2 + p_2/\gamma \quad \dots \quad (1-14)$$

in which points 1 and 2 are any arbitrary points within the fluid. Solving Eq. 1-14 for

$$p_2 - p_1 = -\gamma(z_2 - z_1) \quad \dots \quad (1-15)$$

$$\text{or } \Delta p = -\gamma \Delta z$$

Equation 1-15 is the equation of fluid statics. If z_1 is taken at the surface where the pressure is zero (i.e. atmospheric), and a vertical distance h is defined as positive downward from the water surface, Eq. 1-15 becomes the familiar equation of fluid statics,

$$p = \gamma h \quad \dots \quad (1-16)$$

which relates pressure to the depth below a liquid surface.

Equation 1-14 denotes that in a static liquid the sum of the elevation and pressure heads is constant. This constant is most easily determined at the liquid surface where the pressure is generally known, and often equal to atmospheric pressure which is taken as the zero pressure reference.

Conversion of energy per unit weight to power. Available information for pumps and turbines refers to power and efficiency and not the energy per unit weight of fluid passing through the device. Therefore equations are needed relating E_m to power P or horsepower HP . These equations are:

$$P = \frac{\gamma Q h_p}{\eta} = \frac{W h_p}{\eta} \quad \dots \quad (1-17a)$$

and

$$HP = \frac{\gamma Q h_p}{550\eta} = \frac{W h_p}{550\eta} \quad \text{ES} \quad \dots \quad (1-18a)$$

$$\left(HP = \frac{\gamma Q h_p}{746\eta} = \frac{W h_p}{746\eta} \quad \text{SI} \right) \quad W h_p$$

for pumps, and

$$P = (\gamma Q h_T)\eta = (W h_T)\eta \quad \dots \quad (1-17b)$$

$$HP = \frac{(\gamma Q h_T)\eta}{550} = \frac{(W h_T)\eta}{550} \quad \text{ES} \quad \dots \quad (1-18b)$$

$$\left(HP = \frac{(\gamma Q h_T)\eta}{746} = \frac{(W h_T)\eta}{746} \quad \text{SI} \right)$$

for turbines, in which η is the efficiency of the device and other terms are as previously defined.

Equations 1-17 and 1-18 can be derived by considering the dimensions of the quantities involved. Power is the rate of doing work or work per second. The energy exchange between the fluid and the device comprises the work and therefore energy lost or gained per second by

the fluid should be equated to power after being modified by the efficiency of the device in carrying out this conversion. Since h_m (h_p for a pump or h_T for a turbine) is energy per unit weight, we can obtain power by multiplying h_m by the weight flow rate $W = \gamma Q$. The factors 550 and 746 in Eqs. 1-17 and 1-18, are the conversion of power to horsepower in the ES and SI systems respectively, since 1 hp = 550 ft-lb/sec (1 hp = 746 N-m/sec).

Example Problems Dealing with Conservation Laws

- The mass flow rate G of water through a pipe is 5.5 slugs/sec (80.267 kg/sec). How much fluid energy flows through a section of this pipe in 10 minutes if at this section the pressure of the water is 25 psi (172.4 kNsm) and its velocity equals 10 fps (3.048 mps)?

Solution:

$$\begin{aligned} \text{energy} &= 5.5 \left(\frac{10^2}{2} + \frac{25(144)}{1.94} \right) 600; \\ &= 6,290,000 \text{ ft-lb} \end{aligned}$$

$$\begin{aligned} \text{energy} &= 80.267 \left(\frac{3.048^2}{2} + \frac{172.4 \times 10^3}{1000} \right) 600 \\ &= 8,527,000 \text{ N-m (joules)} \end{aligned}$$

- The flow rate of a river is 1000 cfs (28.3 cms). A reservoir creates a depth of water 100 ft (30.48 m) above the intake to a power plant. Assume the hydraulic turbines are 80 percent efficient. How much potential power in horsepower and kilowatts can be generated at this site? (See Appendix A for conversion to watts.)

$$HP = \eta \gamma QH / 550$$


$$\begin{aligned} \text{ES} \\ HP &= .8 (62.4) (1000) 100 / 550; \\ &= 9,070 \text{ hp} \end{aligned}$$

$$KW = 9,070 (.746) = 6,770 \text{ kw}$$

$$\begin{aligned} \text{SI} \\ HP &= .8 (9800) (28.3) (30.48) / 746 \\ &= 9070 \text{ hp} \end{aligned}$$

$$KW = 9070 (.746) = 6,770 \text{ kw}$$

- Water for a fire hose is being pumped from a lake 5 ft (1.524 m) below the ground level and the fireman is holding the nozzle 3.5 ft (1.067 m) above the ground. If the pump increases the pressure by 30 psi (206.8 kNsm), and the head loss in the fire hose is 4 ft (1.219 m), what velocity will the water have upon discharging from the nozzle? If the fireman held the nozzle vertically upward how high would the water rise (ignoring air drag)? If the nozzle is 1 inch (2.54 cm) in diameter what is the discharge and power required to drive the pump if it is 85 percent efficient?

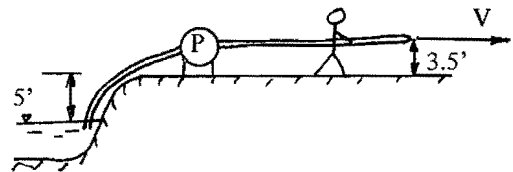

Solution:

Writing the Bernoulli equation, Eq. 1-13, between the lake and the nozzle, with the datum through the reservoir surface,

$$z_1 + \frac{p_1}{\gamma} + \frac{V_1^2}{2g} + h_p = z_2 + \frac{p_2}{\gamma} + \frac{V_2^2}{2g} + h_L$$

$$\text{in which } h_p = \Delta P / \gamma = 30 \times 144 / 62.4$$

$$\begin{aligned} \text{ES} \\ \frac{30(144)}{62.4} &= 8.5 + \frac{V_2^2}{64.4} + 4 \end{aligned}$$

$$V_2 = 60.4 \text{ fps}$$

$$\begin{aligned} \text{SI} \\ \frac{206.8 \times 10^3}{9810} &= 2.591 + \frac{V_2^2}{19.62} + 1.219 \end{aligned}$$

$$V_2 = 18.4 \text{ mps}$$

$$\text{Height of rise above nozzle} = \frac{V_2^2}{2g}$$

$$\frac{(60.4)^2}{64.4} = 56.6 \text{ ft}$$

$$\frac{(18.4)^2}{19.62} = 17.26 \text{ m}$$

Discharge $Q = VA$

$$Q = 60.4 \left[\frac{\pi}{144} (.5)^2 \right] = .329 \text{ cfs}$$

$$Q = 18.4 [\pi (.0127)^2] = .00932 \text{ cms}$$

$$HP = \frac{\gamma Q h_p}{550 \eta} = \frac{\gamma Q \Delta P / r}{550 \eta}$$

$$HP = \frac{(.329) 30 \times 144}{550 (.85)} = 3.04 \text{ hp}$$

$$HP = \frac{(.00932)(206.800)}{746 (.85)} = 3.04 \text{ hp}$$

Solution:

Writing Eq. 1-13 between the reservoir and the outlet,

$$H_1 = z_2 + \frac{p_2}{\gamma} + \frac{V_2^2}{2g} + h_{L1-2} \quad \text{but } V_2 = Q/A_2$$

$$V_2 = \frac{1}{\frac{\pi}{144} (1)^2} = 45.84 \text{ fps}$$

$$40 = \frac{(45.84)^2}{64.4} + h_L$$

$$h_L = 7.38 \text{ ft}$$

$$V_2 = \frac{.0283}{\pi (.0254)^2} = 13.96 \text{ mps}$$


$$12.19 = \frac{(13.96)^2}{19.62} + h_L$$

$$h_L = 2.26 \text{ m}$$

4. Water discharges at a rate of 1 cfs (.0283 cms) from the pipe shown which leads from a reservoir with a water surface 40 ft (12.19 m) above the outlet. What is the head loss in the pipe and what is the pressure at the 1.8 inch (4.572 cm) section?

Writing Eq. 1-13 between the reservoir and the section of 1.5 inch pipe:

$$H_1 = z_3 + \frac{p_3}{\gamma} + \frac{V_3^2}{2g} + h_{L1-3}$$

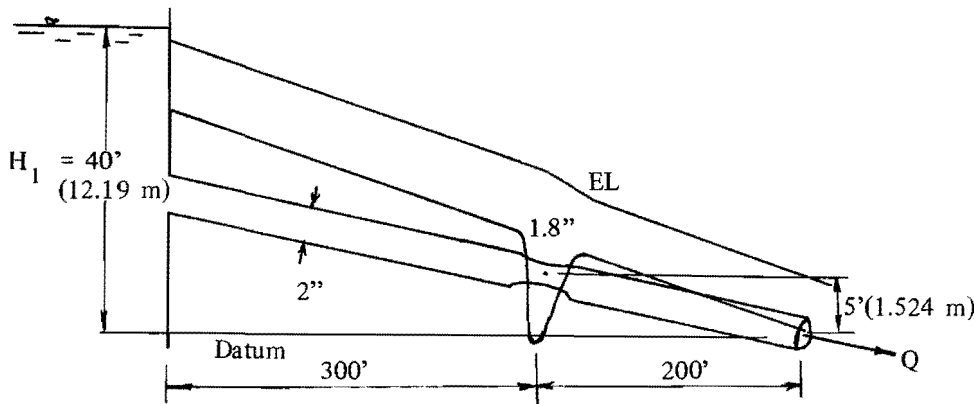

The head loss h_{L1-3} equal approximately 3/5 of that determined above


$$40 = 5 + \frac{ES}{624} + \frac{(56.59)^2}{64.4}$$

$$p_3 = -1195 \text{ psf}$$

$$12.19 = 1.524 + \frac{SI}{9810} + \frac{(17.23)^2}{19.62} + 1.356$$

$$p_3 = -57.1 \text{ kNsm}$$

5. A network of pipes has the external flows shown on the diagram. The table adjacent to the network gives the flows and head losses in the individual pipes.

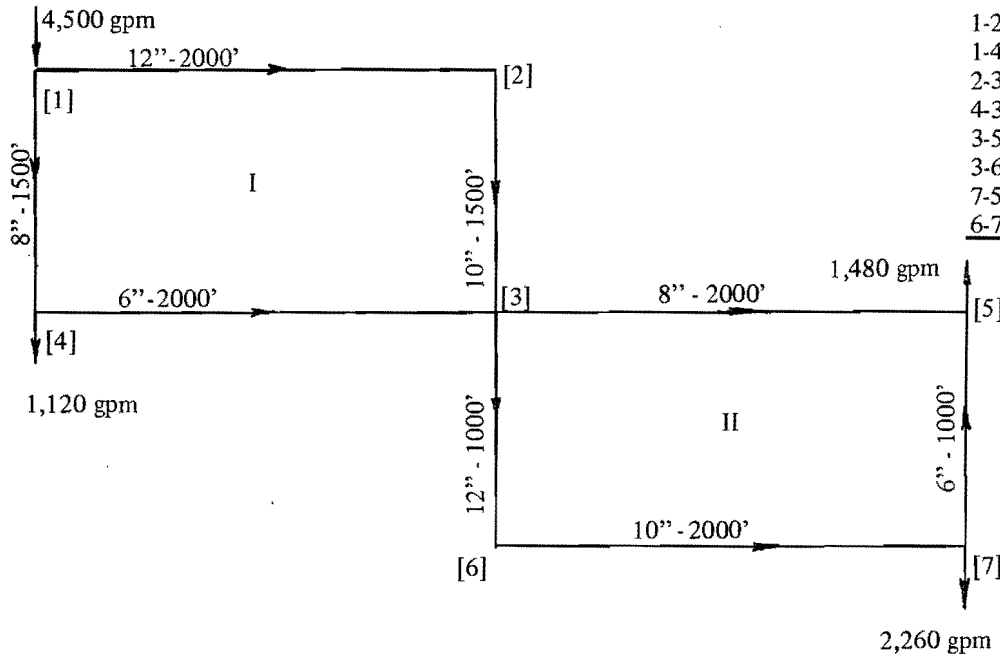

Pipe	Q(gpm)	Head Loss (ft)
1-2	2,840	63.1
1-4	1,660	96.1
2-3	2,840	115.0
4-3	540	82.0
3-5	1,300	106.5
3-6	2,080	15.7
7-5	180	5.3
6-7	2,080	85.5

Junction No.	Total Head (ft)
1	311.7
2	248.6
3	133.6
4	215.6
5	27.1
6	117.9
7	32.4

Pipe	Velocity fps	V ² /2g (ft)	Upstream		Downstream	
			Pressure Head (ft)	Pressure psi	Pressure Head (ft)	Pressure psi
1-2	8.05	1.007	310.69	134.3	247.59	107.3
1-4	10.6	1.742	309.96	134.3	213.86	92.67
2-3	11.60	2.09	246.51	106.82	131.51	56.99
4-3	6.13	.583	215.02	93.17	133.02	57.64
3-5	8.29	1.068	132.53	57.43	26.03	11.28
3-6	5.89	.540	133.06	57.66	117.36	50.86
7-5	2.04	.065	32.34	14.01	27.04	11.72
6-7	8.49	1.120	116.78	50.6	31.28	13.55

Determine the pressure at both ends of each pipe and the total head at each junction of the network if the pressure at junction [1] in the 8-inch pipe is 134.3 psi. All pipes are at the same elevation.

Solution:

The total head at junction 1 equals the pressure head in the 8-inch pipe plus the velocity head in the 8-inch pipe or $H_1 = 134.3 + (144)/62.4 + (1660/449)^2/64.4 = 311.7$ ft. Starting at this junction the head loss in individual pipes is subtracted from the total head at the upstream junction and thereafter the pressure at each junction is determined by subtracting the velocity head from the total head as shown in the tables below.

In solving problem 5 you will have noted that the velocity heads are small in comparison to the head losses and pressure heads. Consequently it is common practice when dealing with long pipes to ignore the velocity head and assume that the EL and HGL coincide.

Momentum Principle in Fluid Mechanics

The third conservation principle, that of momentum, provides an additional powerful tool to solve many fluid flow problems, particularly those dealing with external forces acting on the fluid system, such as at elbows, junctions, and reducers or enlargers. A widely used equation resulting from the momentum principle is

$$\vec{F} = \rho Q (\vec{V}_2 - \vec{V}_1) \dots \dots \dots (1-19)$$

in which \vec{F} is the resultant force (a vector with magnitude

and direction) which acts on the fluid in a control volume being analyzed, \vec{V}_2 and \vec{V}_1 are the average velocities (also vectors) leaving and entering the control volume respectively.

The problems which are handled in this manual will not be solved by use of the momentum equation, Eq. 1-19, and consequently no additional explanation of its use is given here. Any text book dealing with fluid mechanics will provide additional treatment of this subject for the interested reader. The momentum equation will only be used in developing a small amount of theory given later.

CHAPTER II

FRICTIONAL HEAD LOSSES

Introduction

There are several equations which are often used to evaluate the friction head loss (i.e., conversion of energy per unit weight into a non-recoverable form of energy). The most fundamentally sound method for computing such head losses is by means of the Darcy-Weisbach equation. Discussion of the Darcy-Weisbach equation and related topics for computing frictional head losses will occupy the majority of this chapter. Use of the Hazen-Williams and Mannings equations will be described toward the end of the chapter.

Darcy-Weisbach Equation

The Darcy-Weisbach equation is,

$$h_f = \frac{\Delta p}{\gamma} = f \frac{L}{D} \frac{V^2}{2g} \dots \dots \dots (2-1)$$

in which f is a dimensionless friction factor whose determination is described in the following pages, D is the pipe diameter, L is the length of pipe, V is the average velocity of flow, and g is the acceleration of gravity. For noncircular pressure conduits, D in Eq. 2-1 is replaced by 4 times the hydraulic radius, i.e. $4R$. The hydraulic radius is defined as the cross-sectional area divided by the wetted perimeter or $R = A/P$.

The Darcy-Weisbach equation, Eq. 2-1, can be derived by dimensional analysis as is often done in books on the subject. This exercise will not be repeated herein since it serves only to demonstrate that Eq. 2-1 is rational. Rather a thumbnail sketch of extensive, systematic tests carried out by Nikuradse in about 1933 will be discussed to illustrate the functional dependency of the friction factor on two parameters, the Reynolds number Re and the relative roughness of the pipe wall e/D .

Nikuradse measured head loss, or pressure drops, caused by bonding uniform sand particles of various sizes, e , on the interior walls of different pipes. When his test results are plotted on log-log graph paper with the Reynolds number,

$$Re = \frac{VD}{\nu} \dots \dots \dots (2-2)$$

plotted as the abscissa, and the friction factor f as the ordinate then data from different values of e/D defined the separate lines shown on Fig. 2-1.

The following conclusions can be drawn from Fig. 2-1: (1) When the Reynolds number Re is less than 2100, all data regardless of the magnitude of e/D fall on a single line defined by the equation $f = 64/Re$. Flow with $Re < 2100$ is called *laminar flow* and Eq. 2-3 (below) is valid. (2) Data for different e/D values merge into the same line for smaller values of Reynolds number, but for $Re > 2100$. Flow conditions along this line have been classified as *turbulent smooth*, or *hydraulically smooth*. For these flows the majority of the flow is turbulent but the wall roughnesses are small enough to be embedded within the laminar sublayer. (3) For large Reynolds numbers and/or large values of e/D , the friction factor f becomes independent of Re , being only a function of e/D . For these flows the curves for different values of e/D on Fig. 2-1 are horizontal lines, and the flow is referred to as "*wholly rough*" or simply "*rough*." The previous three observations have lead to classifying flow as shown on Fig. 2-1 as *laminar*, *turbulent smooth*, *turbulent transitional*, or *turbulent rough*. The prefix "turbulent" is often omitted in referring to one of the three later types of pipe flow.

Friction Factor for Laminar Flow

For laminar flows for which the well understood law of fluid shear, Eq. 1-2, applies, it is possible to provide a simple straight forward theoretical derivation of the Darcy-Weisbach equation, or more specifically derive the relationship

$$f = 64/Re \dots \dots \dots (2-3)$$

For this derivation, note first that for a pipe, y in Eq. 1-2 can be replaced by $R-r$, so $dy = -dr$ so

$$\tau = -\mu \frac{dv}{dr} \dots \dots \dots (2-4)$$

This equation contains τ and v as unknown dependent variables as well as the independent variable r . Consequently, before it can be solved another equation is needed to provide a functional relationship between τ and v , or τ and r . This second equation comes from the


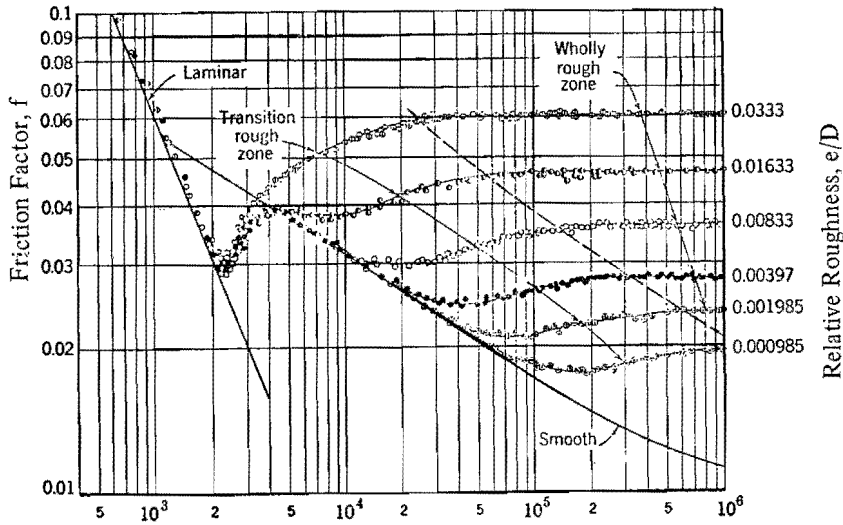


Fig. 2-1. Relationship of the friction factor to Reynolds number and the relative roughness of artificially roughened pipes.

momentum principle applied to a cylindrical element of fluid with length L and varying radius r within the pipe flow as shown in the sketch below. If this core of fluid is

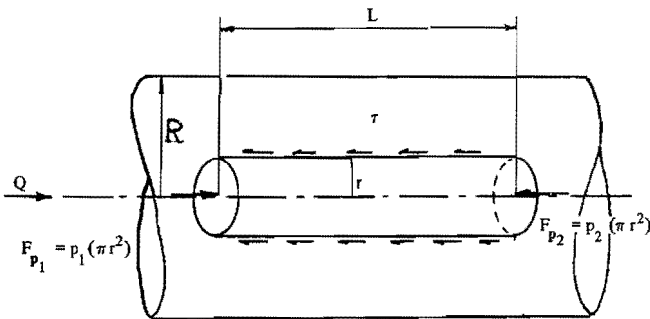

visualized as being isolated from the surrounding fluid it will have pressure forces $p_1 A$ and $p_2 A$ acting on its two ends and the force due to the shear stress τ between it and adjacent fluid acting on its cylindrical surface. Summing these forces for the left side of the momentum, Eq. 1-19 gives

$$(p_1 - p_2) \pi r^2 - \tau(2\pi rL) = \rho Q(V_1 - V_2) = 0$$

Since all forces and velocities are in the same direction for this application of the momentum, Eq. 1-19, only the magnitude of the vectors forces and velocities needs to be considered. Calling the pressure drop $p_1 - p_2$, Δp and solving for τ yields


$$\tau = \frac{\Delta p}{2L} r \quad \dots \quad (2-5)$$

No assumption about whether the flow is laminar or turbulent was made in deriving Eq. 2-5; it is valid for all pipe flows. Since $\Delta p/2L$ does not change with r , Eq. 2-5 indicates that the shear stress τ varies linearly with r being zero at the pipe centerline where $r = 0$, and is a maximum at the pipe wall $r = R$. Upon substituting for τ from Eq. 2-5 into Eq. 2-4 and separating variables, the following first order ordinary differential equation is obtained

$$dv = -\frac{\Delta p}{2L\mu} r dr \quad \dots \quad (2-6)$$

which can readily be solved by integrating both sides. Upon integrating and evaluating the constant of integration from the boundary condition that $v = 0$ when $r = R$ gives,

$$v = \frac{\Delta p}{4L\mu} (R^2 - r^2) \quad \dots \quad (2-7)$$

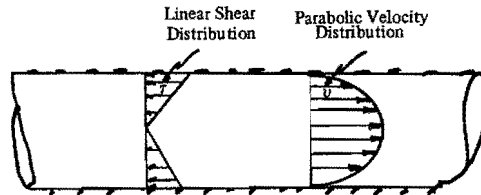

Since Eq. 2-7 is the equation of a paraboloid, for laminar flow the velocity profile is parabolic.

The volumetric flow rate Q can be determined as follows

$$Q = \int_0^R v (2\pi dr) = \frac{\pi \Delta p}{8L\mu} R^4 \dots (2-8)$$

and the average velocity

$$V = \frac{Q}{A} = \frac{\Delta p}{8L\mu} R^2 \dots (2-9)$$

Since the head loss equals the pressure drop divided by γ , h_f can be determined by solving Eq. 2-9 for Δp and dividing by γ , or

$$h_f = \frac{\Delta p}{\gamma} = \frac{8L\mu}{\gamma R^2} V \dots (2-10)$$

Equation 2-10 indicates that for laminar flow the frictional head loss h_f is proportional to the average velocity of flow since $8L\mu/(\gamma R^2)$ is constant for a given fluid in a given pipe.

Equating Eq. 2-10 to h_f in the Darcy-Weisbach equation, Eq. 2-1, and solving for f gives

$$f = \frac{64\mu/\rho}{VD} = 64/Re \dots (2-11)$$

which is identical to Eq. 2-3 obtained from Nikuradse's graph, Fig. 1-1, for laminar flow when $Re < 2100$. Thus

theoretical analyses have verified the experimentally determined equation for the friction factor f for $Re < 2100$.

Friction Factors for Turbulent Flows

Equations relating f to Re and e/D for turbulent flow (i.e. flow with $Re > 2100$) cannot be obtained from similar elementary analyses, but are as summarized in Table 2-1, and discussed below.

The pipes used by Nikuradse were artificially roughened with uniform roughnesses and, therefore, cannot be applied directly to commercial pipes containing turbulent flows. Tests by others, notably Colebrook, demonstrated that flows in commercial pipes also become independent of Reynolds number, Re , at large Re and large wall roughnesses. Consequently, it is possible to compute the equivalent relative roughness e/D for commercial pipes from the experimental equation Nikuradse determined as valid for his wholly rough pipes. This equation for wholly rough pipes is (the last equation in Table 2-1):

$$\frac{1}{\sqrt{f}} = 1.14 - 2 \log_{10} (e/D) \dots (2-13)$$

From these values of e/D , the equivalent sand grain size e for commercial pipes have been determined and are summarized in Table 2-2.

For "hydraulically smooth" pipes an analysis similar to that for laminar flow is possible but beyond the scope of this manual. This equation is (3rd equation in Table 2-1),

$$\frac{1}{\sqrt{f}} = 2 \log_{10} (Re \sqrt{f}) - 0.8 \dots (2-14)$$

Table 2-1. Summary of friction factor equations for Darcy-Weisbach equation $h_f = f \frac{L}{D} \frac{V^2}{2g}$.

Type of Flow	Equation Giving f	Range of Application
Laminar	$f = 64/Re$ (Eq. 2-1)	$Re < 2100$
Hydraulically Smooth or Turbulent Smooth	$f = .316/Re^{.25}$ (Eq. 2-15) $\frac{1}{\sqrt{f}} = 2 \log_{10} (Re \sqrt{f}) - 0.8$ (Eq. 2-14)	$4000 < Re < 10^5$ $Re > 4000$
Transition Between Hydraulically Smooth and Wholly Rough	$\frac{1}{\sqrt{f}} = 2 \log_{10} \left(\frac{e/D}{3.7} + \frac{2.52}{Re \sqrt{f}} \right) = 1.14 - 2 \log_{10} \left(\frac{e}{D} + \frac{9.35}{Re \sqrt{f}} \right)$ (Eq. 2-16)	$Re > 4000$
Hydraulically Rough or Turbulent Rough	$\frac{1}{\sqrt{f}} = 1.14 - 2 \log_{10} (e/D) = 1.14 + 2 \log_{10} (D/e)$ (Eq. 2-13)	$Re > 4000$

Table 2-2. Values of equivalent roughness e for commercial pipes (new).

Material	e	
	Inches	cm
Riveted Steel	.04 to .4	.09 to .9
Concrete	.01 to .1	.02 to .2
Wood Stove	.007 to .04	.02 to .09
Cast Iron	.0102	.026
Galvanized Iron	.006	.015
Asphalted Cast Iron	.0048	.012
Commercial Steel or Wrought Iron	.0018	.046
PVC	.000084	.00021
Drawn Tubing	.00006	.00015

The friction factor f appears on both sides of the equal sign in Eq. 2-14, and consequently it cannot be solved explicitly for f with Re known, but must be solved by trial and error or some iterative scheme. An equation proposed by Blasius, which can be solved explicitly for f which apply to smooth pipes but only for flows with Re less than 10^5 , is

$$f = \frac{0.316}{Re^{.25}} \dots \dots \dots (2-15)$$

Example Problems Using the Darcy-Weisbach Equation

1. A flow rate of 150 gpm (.00947 cms) of oil with $\mu = 1.5 \times 10^{-3}$ lb-sec/ft² (.0718 N-sec/m²) and $\rho = 1.7$ slug/ft³ (876 kg/m³) occurs in a 4-inch (.1016 m) pipe line. Determine the Reynolds number and classify the flow as laminar or turbulent.

Solution:

$$Re = \frac{VD}{\nu}, \text{ but } V = Q/A \text{ and } \nu = \mu/\rho$$

$$Re = \frac{ES}{1.5 \times 10^{-3}/1.7} = \frac{(150/449)/(\pi/36)}{1.5 \times 10^{-3}/1.7} (1/3)$$

$$Re = 1,410$$

$$Re = \frac{SI}{.0718/876} = \frac{.00947/(\pi \times .00258) (.1016)}{.0718/876}$$

$$Re = 1,410$$

Note Re is dimensionless and the result is independent of the unit system.

The flow is laminar since $Re < 2100$.

Equation 2-14 applies to smooth pipe over the entire range of $Re > 4000$, whereas Eq. 2-15 is an approximation to Eq. 2-14 limited to the range $4000 < Re < 10^5$.

For the transition zone between smooth and wholly rough flow Colebrook and White give the following equation,

$$\frac{1}{\sqrt{f}} = 1.14 - 2 \log_{10} \left(\frac{e}{D} + \frac{9.35}{Re\sqrt{f}} \right) \dots (2-16)$$

Equation 2-16 gives nearly the same values for f as Eq. 2-14 for small values of e/D and values of f nearly equal to those of Eq. 2-13 for very large values of Re . Consequently, Eq. 2-16 may be used to compute f for all turbulent flows.

Particularly for hand computations it is convenient to summarize Eqs. 2-11 through 2-16 (the equations in Table 2-1) in a graph similar to Fig. 2-1. This graph given as Fig. 2-2 has become known as the Moody diagram. Its use can eliminate the trial and error solution of Eqs. 2-14 and 2-16.

2. What is the pressure drop and head loss per 1000 ft (304.8 m) for the flow in problem 1? What is the fluid shear stress on the wall of the pipe?

Solution:

The head loss or pressure drop can be computed from Eq. 2-1 with $f = 64/Re$ or Eq. 2-10. Using Eq. 2-10, $\Delta P = (8L \mu/R^2)V$,

$$\Delta p = \frac{ES}{(2/12)^2} = \frac{8(1000)(1.5 \times 10^{-3})}{(2/12)^2} (3.828)$$

$$\Delta p = 1654 \text{ psf} = 11.5 \text{ psi}$$

$$h_L = \frac{\Delta p}{\gamma} = \frac{1654}{1.7(32.2)} = 30.2 \text{ ft}$$

$$\Delta p = \frac{SI}{(.0508)^2} = \frac{8(304.8)(.0718)}{(.0508)^2} (1.168)$$

$$\Delta p = 79,265 \text{ Nsm}$$

$$h_L = \frac{79,265}{876(9.81)} = 9.22 \text{ m}$$

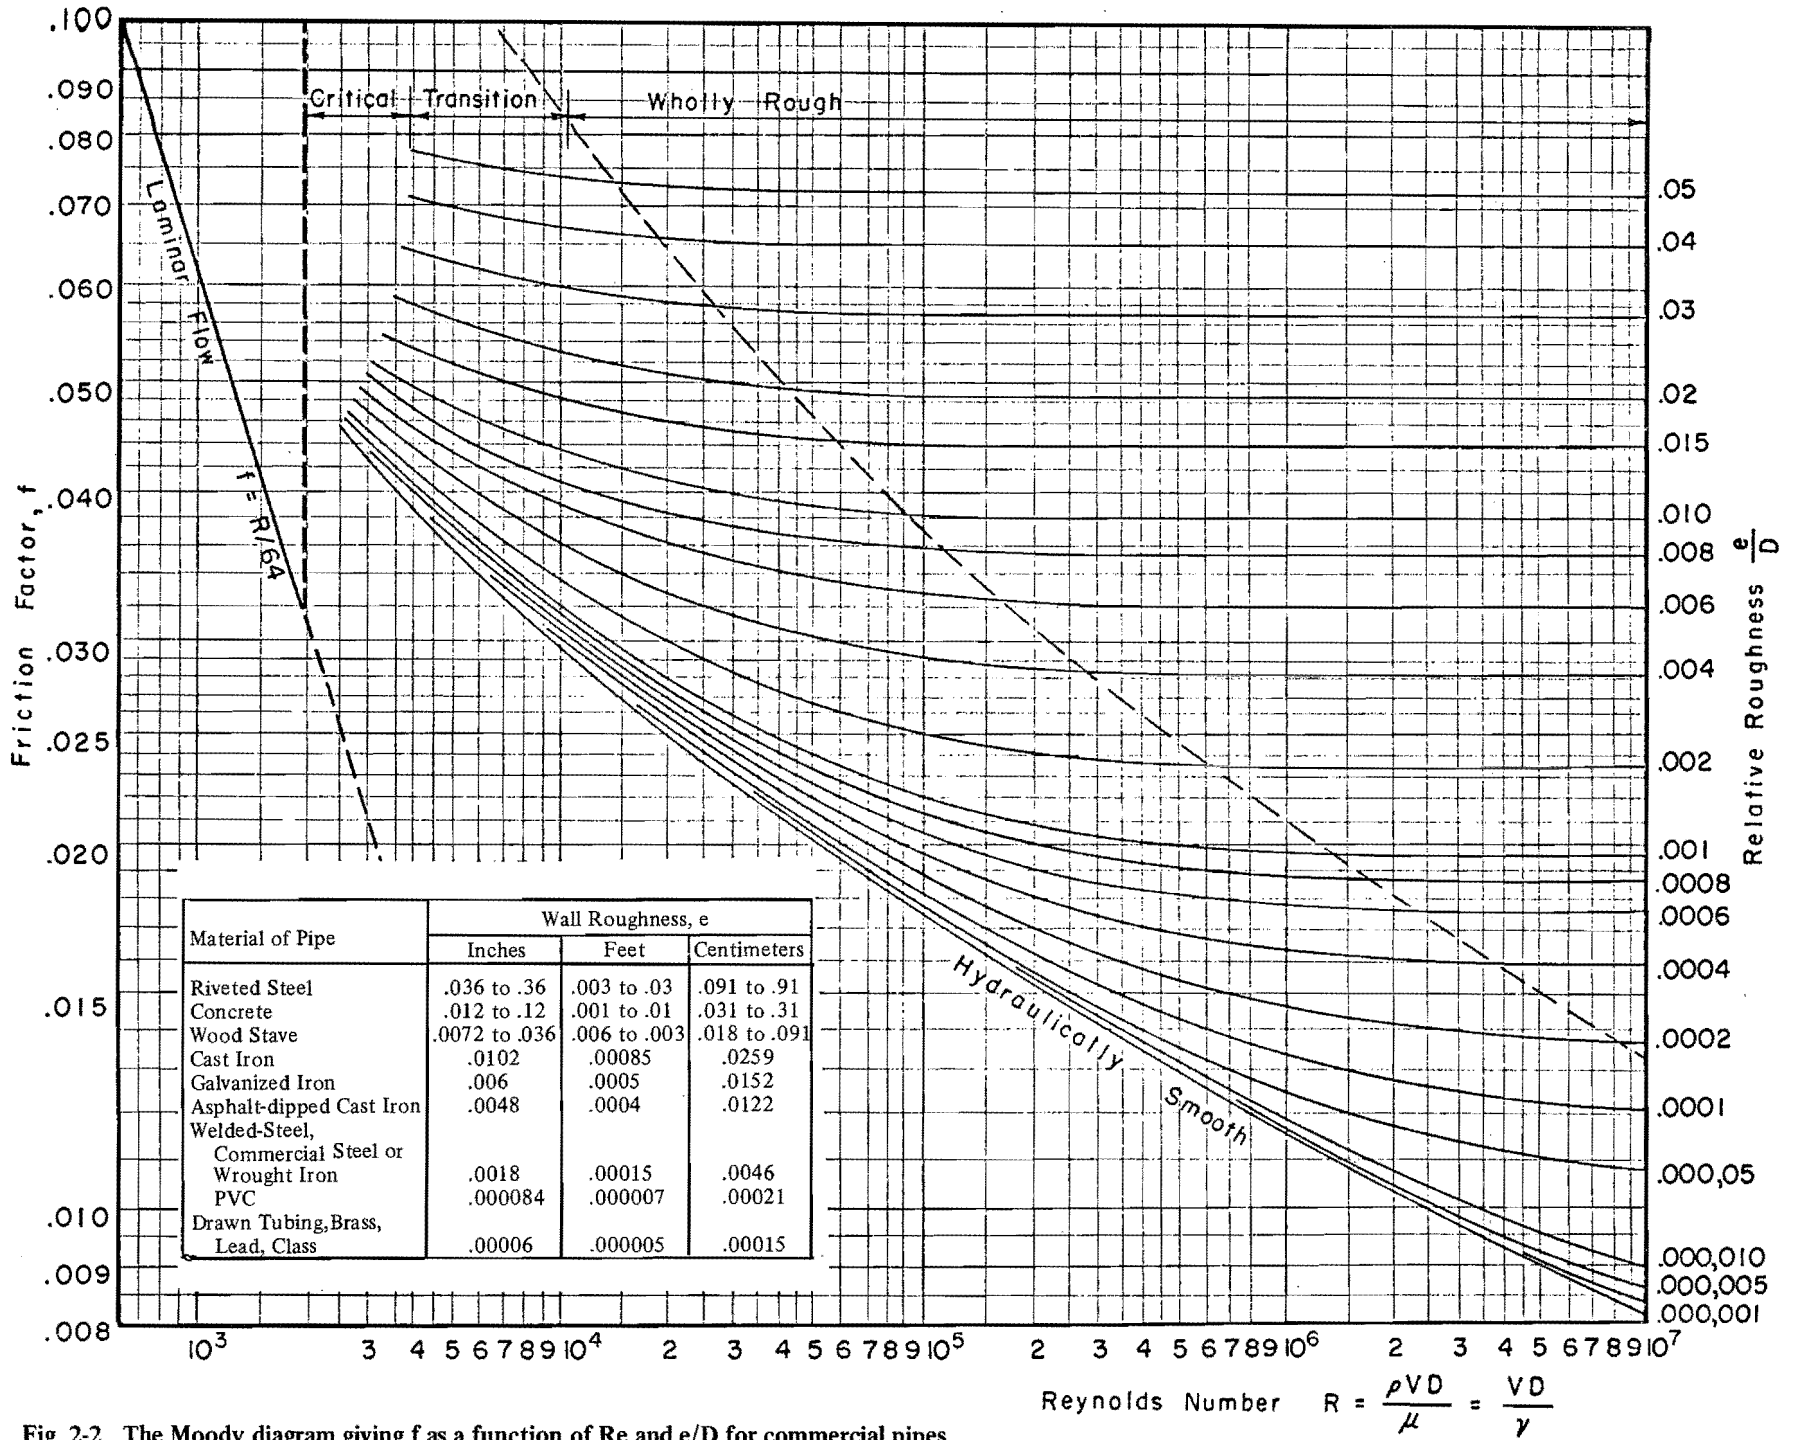


Fig. 2-2. The Moody diagram giving f as a function of Re and e/D for commercial pipes.

$$\tau_o = \frac{\Delta p}{2L} R$$

$$\tau_o = \frac{1654}{2000} \left(\frac{2}{12} \right) = .138 \text{ psf}$$

$$\tau_o = \frac{79,265}{609.6} (.0508) = 6.61 \text{ Nsm}$$

3. A 6-inch (15.25 cm) cast iron pipe 1500 ft (457.2 m) long is to carry a flow rate of water ($\nu = 1.217 \times 10^{-5} \text{ ft}^2/\text{sec}$) $Q = 1.0 \text{ cfs}$ (.0283 cms). Determine the friction factor by equation and check with the Moody diagram and the head loss in this pipe.

Solution:

$$e/D = .0102/6 = .0017 \quad e/D = .259/15.25 = .0017$$

An estimate for f can be obtained from the equation for rough flow

$$\frac{1}{\sqrt{f}} = 1.14 - 2 \log_{10} (e/D)$$

$$f = .0224$$

This value can be iteratively corrected by the equation for the transition zone $1/\sqrt{f} = 1.14 - 2 \log_{10} (e/D + 9.35/Re\sqrt{f})$.

$$1/\sqrt{f} = 1.14 - 2 \log_{10} (e/D + 9.35/Re\sqrt{f})$$

$$Re = \frac{(1.0/.196)(.5)}{1.217 \times 10^{-5}} = 2.09 \times 10^5$$

$$Re = \frac{(.0283/.01824)(.1525)}{1.131 \times 10^{-6}} = 2.09 \times 10^5$$

Iteration 1

$$\frac{1}{\sqrt{f}} = 1.14 - 2 \log_{10} \left(.0017 + \frac{9.35}{2.09 \times 10^5 \sqrt{.0224}} \right)$$

$$f = .0234$$


$$\frac{1}{\sqrt{f}} = 1.14 - 2 \log_{10} \left(.0017 + \frac{9.35}{2.09 \times 10^5 \sqrt{.0234}} \right)$$

$$f = .0234$$

Since the last iteration does not change f , $f = .0234$, which can be verified to two digits on the Moody diagram.

$$h_f = f \frac{L}{D} \frac{V^2}{2g} = .0234 \frac{1500}{.5} \frac{(1/.196)^2}{64.4} = 28.3 \text{ ft or } 8.63 \text{ m}$$

4. A 4-inch (10.16 cm) PVC pipe 6000 ft (1828.8 m) long is used to convey water at 68°F (20°C) between two reservoirs whose surface elevations differ by 150 ft (45.72 m). What is the flow rate Q .

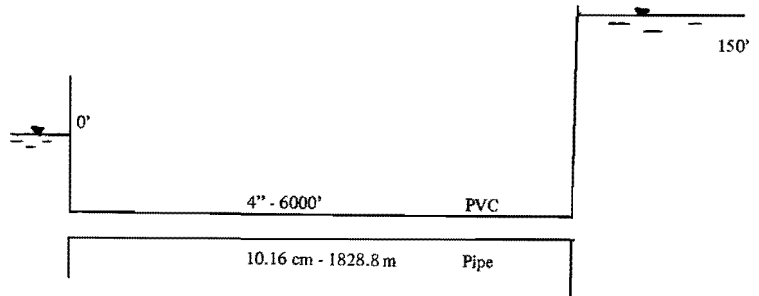

Solution:

The frictional head loss equals 150' (45.72 m); therefore, write the Darcy-Weisbach equation with Q/A substituted for V

$$150 = f \frac{(6000) Q^2}{(1/3) 64.4 (.0873)^2}$$

$$fQ^2 = .00409$$

$$45.72 = f \frac{(1828.8) Q^2}{(.1016)(19.62)(.008107)^2}$$

$$fQ^2 = 3.275 \times 10^{-6}$$

$$\text{also } Re = \frac{QD}{\nu A}$$

$$Re = \frac{.333 Q}{1.217 \times 10^{-5} (.0873)} = 3.14 \times 10^5 Q$$

$$Re = \frac{.1016}{1.131 \times 10^{-6} (.008107)} = 1.108 \times 10^7 Q$$

Solving by trial, Q is assumed, then Re is computed to enter the Moody diagram along the smooth pipe curve to obtain an f value, to examine if the equation is satisfied.

SI

ES

Try Q = .5, Re = 1.57 x 10⁵, f = .0165
 fQ² = .0165 (.5)² = .00413
 Q = .497, Re = 1.55 x 10⁵, f = .0165
 fQ² = .0165 (.495)² = .00408 O.K.
 Q = .497 cfs

Q = .014, Re = 1.57 x 10⁵, f = .0165
 fQ² = .0165 (.014)² = 3.23 x 10⁻⁶
 Use Q = .0141 cms

Computer Use with Darcy-Weisbach Equation (the Newton-Raphson Method)

Because the equations for determining f for smooth and transitional flow are implicit, requiring that problems solved by the Darcy-Weisbach equation be solved by trial, methods easily adapted to computer computations are described in this section. One very effective method for obtaining f in computer applications is to obtain an estimate of f from Eq. 2-13 initially assuming rough flow, and then iteratively correcting this value of f by Eq. 2-16 as was done by hand in the previous problem (3). A computer algorithm implementing this approach is straight forward and therefore will not be discussed further. Rather a more general method, the Newton-Raphson method (often referred to as the "Newton method") will be discussed. This discussion will serve also as an introduction to Chapter VI of the manual dealing with methods for solving systems of equations describing pipe flow. At the present the Newton method will be used to solve a single implicit equation. Later it will be used to solve a system of nonlinear equations.


The Newton-Raphson method is an iterative scheme which starts with an estimate to the solution and repeatedly computes better estimates. It has "quadratic convergence." Other methods have linear convergence. Generally if quadratic convergence occurs, fewer iterations are needed to obtain the solution with a given precision than if linear convergence occurs. In addition to rapid convergence the Newton method is easily implemented in a computer algorithm. In using the Newton method the equation containing the unknown (which we will call x when describing the method in general), is expressed as a function which equals zero when the correct solution is substituted into the equation or F(x) = 0. For instance the friction factor Eq. 2-16 in the transition region would be written as,

$$F(f) = \frac{1}{\sqrt{f}} - 1.14 + 2 \log_{10} \left(\frac{e}{D} + \frac{9.35}{Re \sqrt{f}} \right) = 0 \quad \dots \dots \dots (2-16)$$

as one form of F(x) = 0. The Newton method computes progressively better estimates of the unknown x by the formula,

$$x^{(m+1)} = x^{(m)} - F(x^{(m)})/dF^{(m)}/dx \quad \dots (2-17)$$

in which the superscripts in parentheses are not exponents but denote number of iterations. To understand how Eq. 2-17 iteratively supplies better estimates for x consider a plotting of F(x) near a solution as illustrated below. When

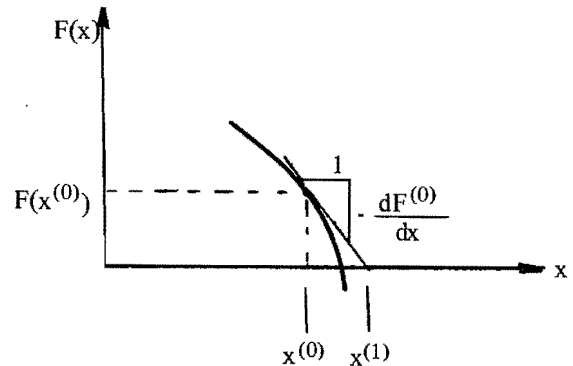

the initial guess x⁽⁰⁾ is used in Eq. 2-17, F(x) ≠ 0 since x⁽⁰⁾ is not the correct solution. The derivative dF(x⁽⁰⁾)/dx produces the slope of the curve shown on the sketch. If a line with this slope is projected to the x-axis a closer approximation x⁽¹⁾ to the solution is obtained. From similar triangles

$$\frac{x^{(1)} - x^{(0)}}{F(x^{(0)})} = - \frac{1}{\frac{dF(0)}{dx}}$$

or solving for x⁽¹⁾

$$x^{(1)} = x^{(0)} - \frac{F(x^{(0)})}{\frac{dF(0)}{dx}}$$

This is Eq. 2-17 with $m = 0$. If the procedure is repeated producing $x(1)$, $x(2)$, $x(3)$... $x(m+1)$ the function $F(x^{m+1})$ will approach zero, at which time the solution to the unknown x has been obtained.

The derivative dF/dx needed to solve Eq. 2-16 is

$$\frac{dF}{df} = -\frac{1}{2f\sqrt{f}} - \frac{9.35 \log_{10} \epsilon}{f \left(\frac{e}{D} + \frac{9.35}{Re\sqrt{f}} \right) Re\sqrt{f}} \quad \dots \dots \dots (2-18)$$

In solving for f , Eq. 2-16 may be used whether the turbulent flow is smooth, transitional, or rough. However, since the Newton method does require an initial guess, and this can explicitly be supplied by the equation for turbulent rough flow, it is desirable to be able to distinguish rough flow from transitional flow without looking at a Moody diagram. A close approximation to the curve on the Moody diagram which separates these flows is

$$\frac{V\sqrt{f/8}}{\nu} e = 100 \quad \dots \dots \dots (2-19)$$

A computer program for solving for f for the Darcy-Weisbach equation should include the following features in the order listed: (1) Reading in the specifications such as D , e (or e/D) V (or Q or Re), ν , and L . (2) If Re is not a given specification then compute Re and test whether $Re < 2100$. If so $f = 64/Re$. Otherwise (3) compute an initial value for f from the rough equation, Eq. 2-13, (4) compute $(eV\sqrt{f/8})/\nu$ and if this quantity is greater than 100, then the f from step 3 is correct, otherwise (5) solve Eq. 2-16 by the Newton method. Listed below is a FORTRAN computer program which accomplishes this.

While the procedure described above for obtaining f by a computer is not difficult to implement, Wood¹ has provided an explicit approximation to the turbulent equation for f which simplifies the programming slightly at the expense of less precision. This approximation is,

$$f = a + b/Re^c \quad \dots \dots \dots (2-20)$$

in which

$$\begin{aligned} a &= 0.094 (e/D)^{0.225} + 0.53 (e/D) \\ b &= 88 (e/D)^{0.44} \\ c &= 1.62 (e/D)^{0.134} \end{aligned}$$

FORTTRAN program for solving for the frictional head loss using the Darcy-Weisbach equation.

```

10 READ(5,100,END = 99) D,Q,FL,VIS,E,G
C D-pipe diameter, Q-flow rate, FL-length of pipe
C VIS-kinematic viscosity of fluid x 105,
C E-absolute roughness of pipe, G-acceleration of gravity
100 FORMAT (8F10.5)
A = .78539816*D*D
V = Q/A
RE = V*D/VIS
IF (RE .GT. 2100) GO TO 3
F = 64./RE
GO TO 1
3 EVIS = E/VIS
ELOG = 9.35*ALOG10(2.71828183)
ED = E/D
F = 1./(1.14-2.*ALOG10(ED))**2
PAR = V*SQRT(F/8.)*EVIS
IF (PAR .GT. 100.) GO TO 1
NCT = 0
2 FS = SQRT(F)
FZ = .5/(F*FS)
ARG = ED + 9.35/(RE*FS)
FF = 1./FS - 1.14 + 2.*ALOG10(ARG)
DF = FZ + ELOG*FZ/(ARG*RE)
DIF = FF/DF
F = F + DIF
NCT = NCT + 1
IF (ABS(DIF) .GT. .00001 .AND. NCT .LT. 15) GO TO 2
1 HL = F*FL*V*V*/(2.*G*D)
WRITE (6,101) Q,D,FL,F,HL
101 FORMAT ('Q=',F10.4,'D=',F10.4,'L=',F10.2,'F=',F10.5,
$'HEADLOSS='F10.4)
GO TO 10
99 STOP
END

```

Empirical Equations

While the Darcy-Weisbach equation is the most fundamentally sound method for determining head losses or pressure drops in closed conduit flow, empirical equations are often used. Perhaps the most widely used such equation is the *Hazen-Williams* equation, which is,

$$\begin{aligned} \text{ES} \quad Q &= 1.318 C_{HW} A R^{.63} S^{.54} \\ \text{SI} \quad Q &= 0.849 C_{HW} A R^{.63} S^{.54} \end{aligned} \quad \dots \dots \dots (2-21)$$

in which C_{HW} is the Hazen-Williams roughness coefficient, S is the slope of the energy line and equals h_f/L , R is the hydraulic radius defined as the cross-sectional area divided by the wetted parameter, P , and for pipes equals $D/4$. Table 2-3 gives values for C_{HW} for some common materials used for pressure conduits.

If the head loss is desired with Q known the Hazen-Williams equation for a pipe can be written as

¹Wood, D. J., "An Explicit Friction Factor Relationship," Civil Engineering, ASCE, 36(12):60-61. December 1966.

$$\text{ES} \quad h_f = \frac{4.73 L}{C_{HW}^{1.852} D^{4.87}} Q^{1.852} \quad \text{with D and L in feet}$$

or

$$\text{SI} \quad h_f = \frac{8.52 \times 10^5 L}{C_{HW}^{1.852} D^{4.87}} Q^{1.852} \quad \text{with D in inches and L in feet}$$

..... (2-22)

$$\text{SI} \quad h_f = \frac{10.7 L}{C_{HW}^{1.852} D^{4.87}}$$

Table 2-3. Values of the Hazen-Williams coefficient, C_{HW} Manning's n for common pipe materials.

Type of Pipe	C_{HW}	n
PVC Pipe	150	.008
Very Smooth Pipe	140	.011
New Cast Iron or Welded Steel	130	.014
Wood, Concrete	120	.016
Clay, New Riveted Steel	110	.017
Old Cast Iron, Brick	100	.020
Badly Corroded Cast Iron or Steel	80	.035

Another empirical equation is the Manning equation, which was developed for flow in open channels. The Manning equation is,

$$\text{ES} \quad Q = \frac{1.49}{n} A R^{2/3} S^{1/2} \quad \dots \dots (2-23)$$

$$\text{SI} \quad Q = \frac{1}{n} A R^{2/3} S^{1/2}$$

or for pipes with h_f on the left of the equal sign

$$\text{ES} \quad h_f = \frac{4.637 n^2 L}{D^{5.333}} Q^2 \quad \text{with D and L in feet}$$

or

$$\text{SI} \quad h_f = \frac{2.64 \times 10^6 n^2 L}{D^{5.333}} Q^2$$

with D in inches and L in feet (2-24)

$$\text{SI} \quad h_f = \frac{10.29 n^2 L}{D^{5.333}} Q^2$$

Example Problem Using Empirical Equations

- Solve problem 3 of the previous problems for the head loss using the Hazen-Williams and Manning equations. (6" (15.25 cm) cast iron pipe, L = 1500' (457.2 m), Q = 1 cfs (.0283 cms))

Hazen-Williams $C_{HW} = 130$

$$\text{ES} \quad h_f = \frac{8.52 \times 10^5 (1500)}{130^{1.852} 6^{4.87}} (1)^{1.852}$$

$$h_f = 25.3 \text{ ft}$$

$$\text{SI} \quad h_f = \frac{10.7 (457.2)}{130^{1.852} (.1525)^{4.87}} (.0283)^{1.852}$$

$$h_f = 7.71 \text{ m}$$

Manning equation n = .014

$$\text{ES} \quad h_f = \frac{2.64 \times 10^6 (.014)^2 (1500)}{6^{5.333}} (1)^2$$

$$h_f = 55.0 \text{ ft}$$

$$\text{SI} \quad h_f = \frac{10.29 (.014)^2 (457.2)}{.1525^{5.333}} (.0283)^2$$

$$h_f = 16.8 \text{ m} \quad \quad \quad 16.8 \text{ m}$$

The difference in head loss computed by the Hazen-Williams and the Manning's equation is large. When using the Manning's equation for full flowing pipes values of n somewhat smaller than those found in tables probably apply, since tabular values are based on measurements in open channels in which surface waves contribute to some head loss.

Exponential Formula

In analyzing the flow distribution in large pipe networks it is advantageous to express the head loss in each pipe of the network by an exponential formula of the form

$$h_f = K Q^n \quad \dots \dots \dots (2-25)$$

Values for K and n can be obtained directly from the previous equations given for the Hazen-Williams or Manning equations. To find K and n in Eq. 2-25 for the Darcy-Weisbach equation it should be noted that f can be approximated over a limited range by an equation of the form

$$f = \frac{a}{Q^b} \quad \dots \dots \dots (2-26)$$

Substituting Eq. 2-26 into the Darcy-Weisbach equation, Eq. 2-1, and grouping terms gives

$$n = 2 - b \quad \dots \dots \dots (2-27)$$

and

$$K = \frac{aL}{2gDA^2} \quad \dots \dots \dots (2-28)$$

Consequently determinations of n and K in the exponential formula, Eq. 2-25, requires finding values of a and b in Eq. 2-26 which cause that equation to approximate f for the range of flow rates to be encountered. If this range is too large n and K may be considered variables.

To illustrate how a and b might be determined, consider an 8-inch (.2032 m) diameter welded steel pipe 500 ft (152.4 m) long carrying water at 60°F (15.4°C). The range of flow rates the pipe is to carry is 1.0 to 2.0 cfs (.03 to .06 cms), resulting in a velocity range of 3 to 6 fps (.9 to 1.8 mps), and values of Re from 1.6×10^5 to 3.2×10^5 . With $e/D = .0002$, the friction factors from the Moody diagram for these two flow rates are $f = .018$ and $.0165$ respectively. Substitution of these two values for Q and f into Eq. 2-26 gives

$$.018 = \frac{a}{1^b}$$

and

$$.0165 = \frac{a}{2^b}$$

While a in this case can be obtained directly from the first of these two equations and b then from the second, in general they can be solved most readily by taking the logarithms of both sides or

$$\begin{aligned} -2 + .255 &= \log a - 0(b) \\ -2 + .217 &= \log a - .301 b \\ \hline .038 &= .301 b, \quad b = .126, \quad a = .018 \end{aligned}$$

and therefore

$$n = 2 - b = 1.874$$

and

$$K = \frac{aL}{2gDA^2} = \frac{.018 (500)}{64.4 (667)(349)^2} = 1.72$$

Example Problems in Defining Exponential Formula from the Darcy-Weisbach Equation

1. Cast iron pipes with $e = .0102$ inch (2.59×10^{-4} m) of the following lengths and sizes exist in a network. The range of velocities expected in these pipes is also given. Determine n and K for each of these pipes from the Darcy-Weisbach equation.

Pipe No.	Diameter		Length		V ₁		V ₂	
	Inch	m	ft	m	fps	mps	fps	mps
1	12	.3048	700	213	.425	.130	.851	.259
2	10	.254	1000	304.8	.922	.280	1.84	.561
3	6	.1524	600	182.9	5.10	1.55	10.21	3.11
4	8	.2032	800	243.8	6.70	2.04	13.40	4.08

Solution:

Following the procedure given above K and n are:

Pipe No.	1	2	3	4
n	1.854	1.899	1.971	1.978
K (ES)	0.402	1.365	11.295	3.353
K (SI)	91.3	361	3850	1183

2. Repeat problem 1 using the Hazen-Williams equation with $C_{HW} = 130$.

Solution:

Pipe No.	1	2	3	4
n	1.852	1.852	1.852	1.852
K (ES)	1.84	1.90	1.97	1.98
K(SI)	97.3	315	2274	747

CHAPTER III

MINOR LOSSES

Introduction

A number of appurtenances to pipelines such as inlets, bends, elbows, contractions, expansions, valves, meters, and pipe fittings commonly occur. These devices alter the flow pattern in the pipe creating additional turbulence which results in head loss in excess of the normal frictional losses in the pipe. These additional head losses are termed *minor losses*. If the pipelines are relatively long these losses are truly minor and can be neglected. In short pipelines they may represent the major losses in the system, or if the device causes a large loss, such as a partly closed valve, its presence has dominant influence on the flow rate. In practice the engineer must use professional judgment in deciding if and how many "minor losses" should be included in his analysis of fluid distribution systems. This chapter provides an introduction to determine magnitudes of minor losses.

Bends, Values, and Other Fittings

The head loss (or conversion of flow energy into heat) due to a gradual bend in a pipeline is primarily caused by a secondary double spiral flow which is superimposed on the main flow. In moving around the bend the larger centrifugal force acting on the faster moving center core fluid forces it toward the outside of the bend as the slower moving fluid near the walls of the pipe moves toward the inside of the bend, as illustrated in the sketch below. This causes a double spiral or secondary motion which persists downstream as far as 50 to 100 pipe diameters until viscous forces eventually dissipate it. Thus the added head loss caused by the bend does not occur at the bend but over some length of pipe downstream therefrom.

Principles governing the flow of fluid as well as much experimental evidence indicates that the head loss due to added turbulence or secondary flows will be approximately proportional to the velocity squared or the flow rate squared. It is therefore common to express the majority of minor losses by an equation of the form,

$$h_L = K_L \frac{V^2}{2g} \dots \dots \dots (3-1a)$$

or


$$h_L = C_L Q^2 \dots \dots \dots (3-1b)$$

in which

$$C_L = K_L / (2gA^2)$$

Figure 3-1 gives the loss coefficient for gradual 90 degree bends as a function of the ratio of the radius of the bend divided by the pipe diameter and the relative roughness of the pipe wall. Figure 3-2 gives this coefficient related to the angle of bend.

For valves, sharp bends, and other fittings the minor head loss may be caused, to a much greater degree, by separation of the flow lines from the boundary at abrupt changes of wall geometry in the device rather than by secondary flows. Equation 3-1 also approximates such additional head losses provided an appropriate coefficient K_L is selected. Table 3-1 provides some nominal values of K_L for various common appurtenances to pipelines.

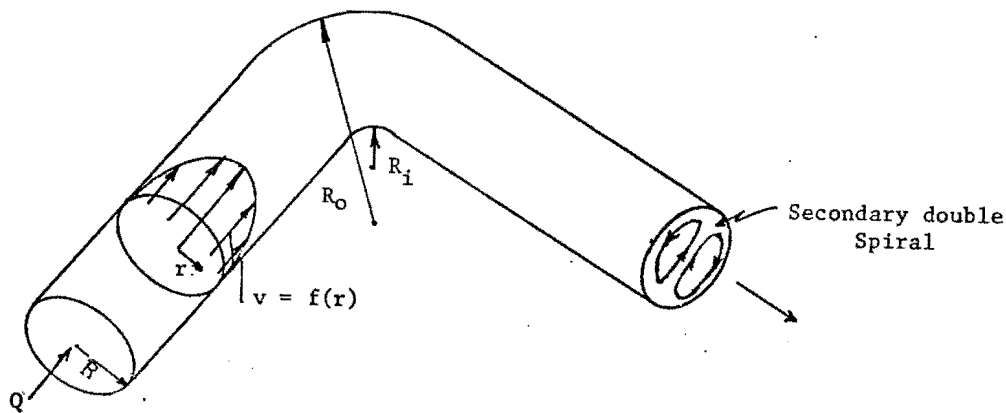

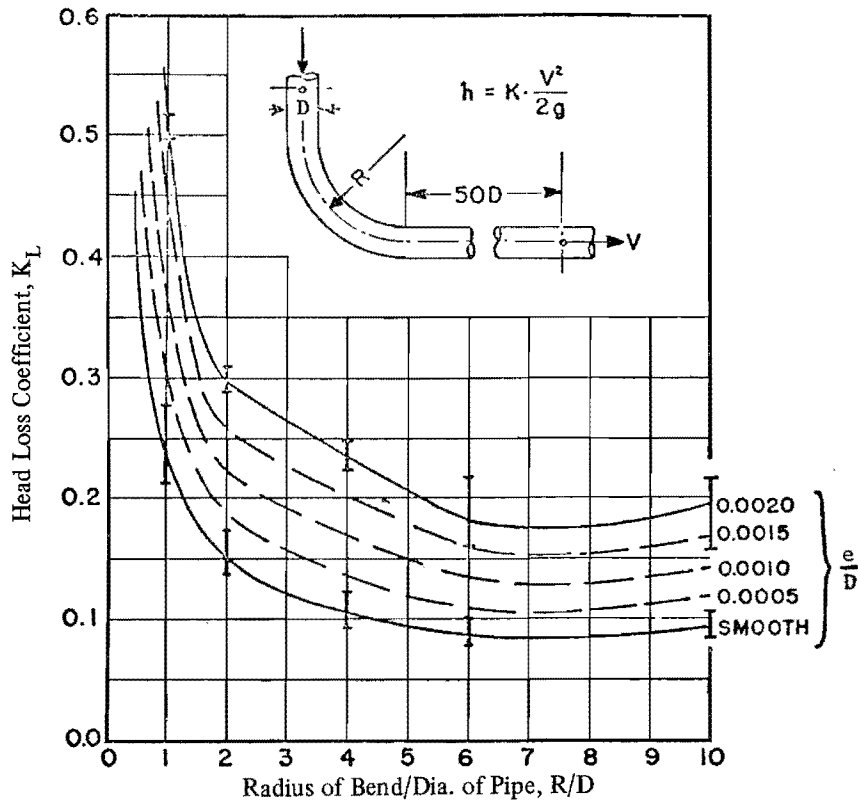


Fig. 3-1. Head loss coefficients for 90° bends of constant diameter.

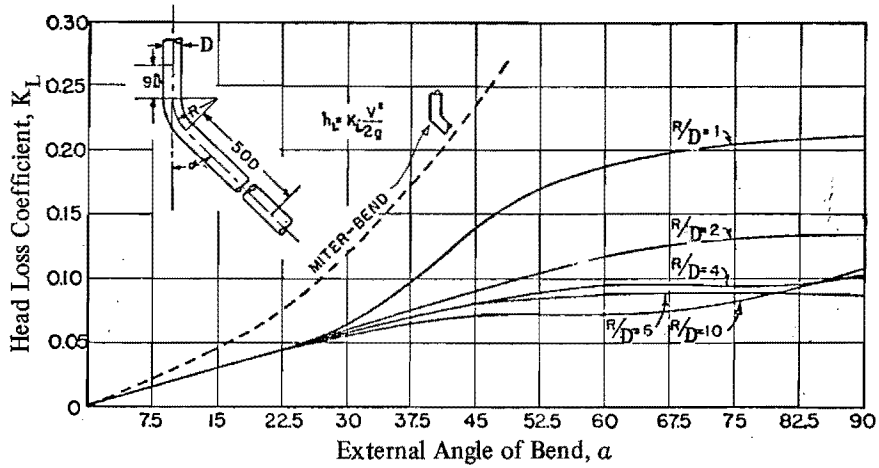



Fig. 3-2. Head loss coefficients related to degree of bend at $Re = 2.3 \times 10^5$.

Table 3-1. Loss coefficients for valves and other pipe fittings.


Device	K_L
Globe Valve (fully open)	10
Angle Valve (fully open)	5
Gate Valve (fully open)	0.19
Gate Valve (3/4 open)	1.0
Gate Valve (1/2 open)	5.6
Ball Check Valve (fully open)	70
Foot Valve (fully open)	15
Swing Check Valve (fully open)	2.3
Close Return Bend	2.2
Tee, Through Side Outlet	1.8
Standard Short Radius Elbow	0.9
Medium Sweep Elbow	0.8
Long Sweep Elbow	0.6
45° Elbow	0.4

To illustrate how the magnitude of minor losses effects flow rates consider a 4-inch (.1016 m) diameter cast iron pipeline which is 500 ft long but contains a fully open globe valve. The flow rate which can be anticipated through this pipe is sought when the total head loss is known. Let us assume the available head loss and the minor loss due to the globe valve equals 30 feet, or


$$f \frac{L}{D} \frac{V^2}{2g} + K_L \frac{V^2}{2g} = \left(f \frac{L}{D} + K_L \right) \frac{V^2}{2g} = 30$$

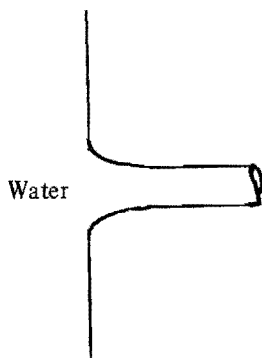

Rounded Entrance
 $K_L = 0.05$



Square Entrance
 $K_L = 0.5$

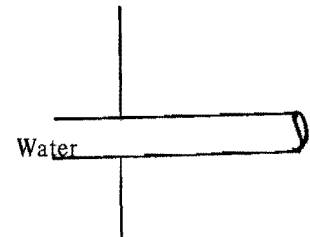

Re-entrant Entrance
 $K_L = 1.0$

or

$$(f(1500) + 10) \frac{Q^2}{5.62} = 30$$

Since f depends on the flow rate, a trial solution is needed. It might be begun by assuming $f = .02$, then $Q = 2.05$ cfs and $Re = 6.4 \times 10^5$. Now from the Moody diagram it can be determined that $f = .024$. Consequently,

$$(36 + 10) Q^2 = 168.6$$

or $Q = 1.91$ cfs. In this case the valve causes approximately 22 percent of the total head loss.

Entrances, Exits, Contractions, and Enlargements

When water which is stationary in a reservoir is accelerated radially inward in entering a pipe, separation will occur unless the inlet is sufficiently rounded. Consequently, the amount of head loss at a pipe entrance will depend upon the geometry of the entrance. The loss due to the entrance, however, can be evaluated by Eq. 3-1 with an appropriate coefficient K_L for the particular entrance. For a well rounded entrance the loss coefficient is $K_L = .05$; it is $K_L = 0.5$ for a square entrance; and if the pipe protrudes into the reservoir it is $K_L = 1.0$. These conditions are illustrated below

A contraction behaves very similar to an entrance with the exception that the fluid need not accelerate radially inward as much. Since the loss is primarily due to separation in the pipe, head loss coefficients for pipe contractions are only slightly less than those due to entrances. Consequently for a *gradual* contraction $K_L = 0.04$, and for an *abrupt* contraction $K_L = 0.5$.

For enlargements a more appropriate equation for determining the minor head loss is,

$$h_L = K_L \frac{(V_1 - V_2)^2}{2g} \dots \dots \dots (3-2)$$

in which V_1 is the average velocity in the smaller upstream pipe and V_2 is the average velocity in the larger downstream pipe. The form of this equation can be obtained from the momentum principle. This principle indicates that for a sudden enlargement $K_L = 1.0$. If the enlargement is gradual, Fig. 3-3 gives appropriate values for K_L as a function of the interior angle of the enlargement walls. Note as $\theta = 180$ (the sudden enlargement) K_L is approximately unity.

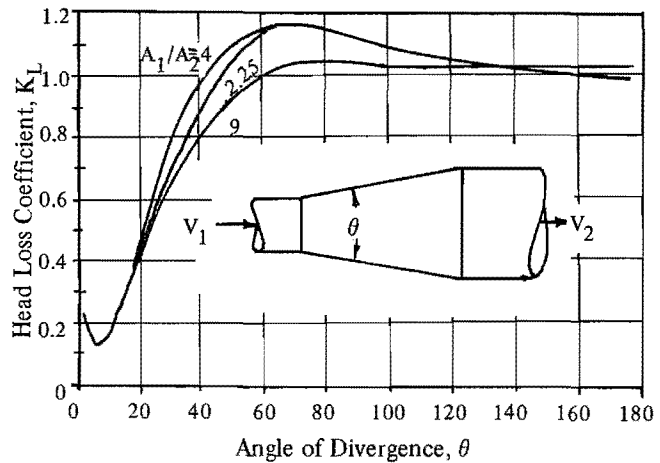


Fig. 3-3. Head loss coefficients for pipe enlargements.

When water discharges into a reservoir from a pipe, the entire kinetic energy per pound of fluid is dissipated within the reservoir. Consequently K_L for an exit equals 1.0. Exit head losses are therefore given by,

$$h_L = \frac{V^2}{2g} \dots \dots \dots (3-3)$$

CHAPTER IV

INCOMPRESSIBLE FLOW IN PIPE NETWORKS

Introduction

Analyses and design of pipe networks create a relatively complex problem, particularly if the network consists of a large number of pipes as frequently occurs in the water distribution systems of large metropolitan areas, or natural gas pipe networks. Professional judgment is involved in deciding which pipes should be included in a single analysis. Obviously it is not practical to include all pipe which delivers to all customers of a large city, even though they are connected to the total delivery system. Often only those main trunk lines which carry the fluid between separate sections of the area are included, and if necessary analyses of the networks within these sections may be included. This manual deals only with steady-state solutions. In a water distribution system, the steady-state analysis is a small but vital component of assessing the adequacy of a network. Such an analysis is needed each time changing patterns of consumption or delivery are significant or add-on features, such as supplying new subdivisions, addition of booster pumps, or storage tanks change the system. In addition to steady analyses, studies dealing with unsteady flows or transient problems, operation and control, acquisition of supply, optimization of network performance against cost, and social implications should be given consideration but are beyond the scope of this manual.

The steady-state problem is considered solved when the flow rate in each pipe is determined under some specified patterns of supply and consumption. The supply may be from reservoirs, storage tanks and/or pumps or specified as inflow or outflow at some point in the network. From the known flow rates the pressures or head losses through the system can be computed. Alternatively, the solution may be initially for the heads at each junction or node of the network and these can be used to compute the flow rates in each pipe of the network.

The oldest method for systematically solving the problem of steady flow in pipe networks is the Hardy Cross method. Not only is this method suited for hand solutions, but it has been programmed widely for computer solutions, but particularly as computers allowed much larger networks to be analyzed it became apparent that convergence of the Hardy Cross method might be very slow or even fail to provide a solution in some cases. In the past few years the Newton-Raphson method has been utilized to solve large networks, and with improve-


ments in algorithms based on the Newton-Raphson method, computer storage requirements are not greatly larger than those needed by the Hardy Cross method. An additional method called the "linear theory method" has also been proposed, and does not require an initialization as do the other two methods. The solution of a system of algebraic equations gives the flow rates in each pipe or the head or pressures throughout the system described in this chapter. In the subsequent three chapters the implementation of the linear theory method, the Newton-Raphson method and the Hardy Cross method is discussed, in the reverse order of their historical development.

Reducing Complexity of Pipe Networks

In general, pipe networks may include series pipes, parallel pipes, and branching pipes (i.e. pipes that form the topology of a tree). In addition, elbows, valves, meters, and other devices which cause local disturbances and minor losses may exist in pipes. All of the above should be combined with or converted to an "equivalent pipe" in defining the network to be analyzed. The concept of equivalence is useful in simplifying networks. Methods for defining an equivalent pipe for each of the above mentioned occurrences follows.

Series pipes

The method for reducing two or more pipes of different size in series will be explained by reference to the diagram below. The same flow must pass through each

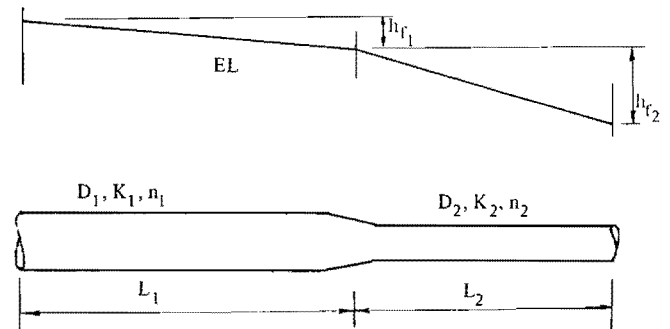

pipe in series. An equivalent pipe is a pipe which will carry this flow rate and produce the same head loss as two or more pipes, or

$$h_{r_e} = \Sigma h_{r_i} \dots \dots \dots (4-1)$$

Expressing the individual head losses by the exponential formula gives,

$$K_e Q^{n_e} = K_1 Q^{n_1} + K_2 Q^{n_2} + \dots = \sum K_i Q^{n_i} \quad \dots (4-2)$$

For network analysis K_e and n_e are needed to define the equivalent pipe's hydraulic properties. If the Hazen-Williams equation is used, all exponents $n = 1.852$, and consequently


$$K_e = K_1 + K_2 + \dots = \sum K_i \quad \dots (4-3)$$

or the coefficient K_e for the equivalent pipe equals the sum of the K 's of the individual pipes in series. If the Darcy-Weisbach equation is used, the exponents n in Eq. 4-2 will not necessarily be equal, but generally these exponents are near enough equal that the n_e for the equivalent pipe can be taken as the average of these exponents and Eq. 4-3 used to compute K_e .

Parallel pipes

An equivalent pipe can also be used to replace two or more pipes in parallel. The head loss in each pipe between junctions where parallel pipes part and join again must be equal, or

$$h_f = h_{f_1} = h_{f_2} = h_{f_3} = \dots \quad (4-4)$$

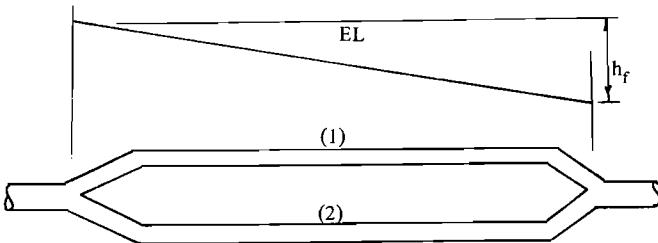

The total flow rate will equal the sum of the individual flow rates or

$$Q = Q_1 + Q_2 + \dots = \sum Q_i \quad \dots (4-5)$$

Solving the exponential formula $h_f = KQ^n$ for Q and substituting into Eq. 4-5 gives

$$\left(\frac{h_f}{K_e}\right)^{\frac{1}{n_e}} = \left(\frac{h_f}{K_1}\right)^{\frac{1}{n_1}} + \left(\frac{h_f}{K_2}\right)^{\frac{1}{n_2}} + \dots = \sum \left(\frac{h_f}{K_i}\right)^{\frac{1}{n_i}} \quad \dots (4-6)$$


If the exponents are equal as will be the case in using the Hazen-Williams equation, the head loss h_f may be eliminated from Eq. 4-6 giving

$$\left(\frac{1}{K_e}\right)^{\frac{1}{n}} = \left(\frac{1}{K_1}\right)^{\frac{1}{n}} + \left(\frac{1}{K_2}\right)^{\frac{1}{n}} + \dots = \sum \left(\frac{1}{K_i}\right)^{\frac{1}{n}} \quad \dots (4-7)$$

When the Darcy-Weisbach equation is used for the analysis, it is common practice to assume n is equal for all pipes and use Eq. 4-7 to compute the K_e for the equivalent pipe.

Branching system

In a branching system a number of pipes are connected to the main to form the topology of a tree. Assuming that the flow is from the main into the smaller laterals it is possible to calculate the flow rate in any pipe as the sum of the downstream consumptions or demands. If the laterals supply water to the main, as in a manifold, the same might be done. In either case by proceeding from the outermost branches toward the main or "root of the tree" the flow rate can be calculated, and from the flow rate in each pipe the head loss can be determined using the Darcy-Weisbach or Hazen-Williams equation. In analyzing a pipe network containing a branching system, only the main is included with the total flow rate specified by summing from the smaller pipes. Upon completing the analysis the pressure head in the main will be known. By subtracting individual head losses from this known head, the heads (or pressures) at any point throughout the branching system can be determined.

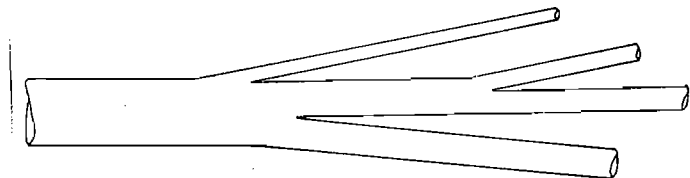

Minor losses

When a valve, meter, elbow, or other device exists in a pipe causing a minor loss which is not insignificant in comparison to the frictional loss in that pipe, an equivalent pipe should be formed for use in the network analyses. This equivalent pipe should have the same head loss for any flow rate as the sum of the pipe frictional loss and the minor head loss. The equivalent pipe is formed by adding a length ΔL to the actual pipe length such that the frictional head loss in the added length of pipe equals the minor losses. Computation of ΔL will be slightly different depending upon whether the Darcy-Weisbach or Hazen-Williams equations are to be used.

Most minor losses are computed from the formula Eq. 3-1 $h_L = K_L (V^2/2g)$ or a loss coefficient multiplied by the velocity head as described in Chapter III. The Darcy-Weisbach equation $h_f = [f(L/D)](V^2/2g)$ may also be thought of as the product of a coefficient times the velocity head. Consequently, if the Darcy-Weisbach equation is to be used in the network analyses, the length ΔL can be found by equating these two coefficients with ΔL replacing L in the Darcy-Weisbach coefficient. After solving for ΔL , the length to be added to the actual pipe length is,

$$\Delta L = \frac{K_L D}{f} \dots \dots \dots (4-8)$$

Since f is generally a function of the flow rate, ΔL also depends upon the flow rate. In practice it is generally adequate to compute ΔL , by using the f values for wholly rough flow, or if knowledge of the approximate flow rate is available the friction factor f corresponding to it may be used in Eq. 4-8. If several devices causing minor losses exist in a single pipe, then the sum of the individual ΔL 's is added to the length of the actual pipe.

The coefficient K in the exponential formula for the equivalent pipe is obtained by substituting $L + \Sigma\Delta L$ for the length of the pipe in Eq. 2-28 or

$$K_e = \frac{a(L + \Sigma\Delta L)}{2g DA^2} \dots \dots \dots (4-9)$$

when using the Darcy-Weisbach equation for computing frictional losses. When using the Hazen-Williams formula for this purpose the added pipe length ΔL , due to the device causing the minor loss, can be computed from

$$\begin{aligned} \text{ES} \quad \Delta L &= 0.00532 K_L Q^{.148} C_{HW}^{1.852} D^{.8703} \\ \text{SI} \quad \Delta L &= 0.00773 K_L Q^{.148} C_{HW}^{1.85} D^{.8703} \end{aligned} \dots \dots \dots (4-10)$$

and the K in the exponential formula is

$$\begin{aligned} \text{ES} \quad K_e &= 4.73 \frac{L + \Delta L}{C_{HW}^{1.852} D^{4.87}} \quad (\text{D and L in feet}) \\ \text{SI} \quad K_e &= \frac{10.7(L + \Delta L)}{C_{HW}^{1.852} D} \end{aligned} \dots \dots \dots (4-11)$$

Example Problem in Finding Equivalent Pipes

1. A 12-inch (30.48 cm) cast iron pipe which is 100 ft (30.48 m) long is attached in series to a 10-inch (25.4 cm) cast iron pipe which is 300 ft (91.44 m) long to carry a flow rate of 5.0 cfs (.142 m³/s) of water at 68°F (20°C). Find the length of 10-inch (25.4 cm) pipe which is equivalent to the series system.

Solution:

ES

$$\begin{aligned} V_{12} &= 5/.785 = 6.37 \text{ fps} \\ V_{10} &= 5/.545 = 9.17 \text{ fps} \\ Re_{12} &= 6.37 (1)/1.084 \times 10^{-5} = 5.90 \times 10^5 \\ Re_{10} &= 9.17 (.833)/1.084 \times 10^{-5} = 7.05 \times 10^5 \\ (e/D)_{12} &= .0102/12 = .00085 \\ (e/D)_{10} &= .0102/10 = .00102 \end{aligned}$$

from the Moody diagram

$$f_{12} = .0195, f_{10} = .0192$$

$$h_f = h_{f12} + h_{f10}$$

$$h_f = .0195 \frac{100}{1} \frac{(6.37)^2}{64.4} + .0192 \frac{300}{.833} \frac{(9.17)^2}{64.4}$$

$$\begin{aligned} h_f &= 1.23 + 9.02 = 10.25 \text{ ft.} \\ L &= h_f D(2g)/fV^2 = 340.7 \text{ ft.} \end{aligned}$$

SI

$$\begin{aligned} V_{12} &= .142/.0729 = 1.95 \text{ mps} \\ V_{10} &= .142/.0507 = 2.80 \text{ mps} \\ Re_{12} &= 1.95 (.3048)/1.007 \times 10^{-6} = 5.90 \times 10^5 \\ Re_{10} &= 2.80 (.254)/1.007 \times 10^{-6} = 7.05 \times 10^5 \\ (e/D)_{12} &= .0259/30.48 = .00085 \\ (e/D)_{10} &= .0259/25.4 = .00102 \end{aligned}$$

from the Moody diagram

$$h_f = .0195 \frac{30.48}{.3048} \frac{(1.95)^2}{19.62} + .0192 \frac{91.44}{.254} \frac{(2.80)^2}{19.62}$$

$$h_f = .378 + 2.762 = 3.14 \text{ m}$$

$$L = 3.14 (.254) (19.62)/(.0192 \times 2.80^2) = 103.9 \text{ m}$$

2. Using the Hazen-Williams formula find the coefficient K_e in the exponential formula and the diameter of an equivalent pipe to replace two 500 ft parallel pipes of 8-inch and 6-inch diameters. $C_{HW} =$

120 for both pipes, and make the equivalent pipe 500 ft long.

Solution:

$$K_8 = \frac{4.73 L}{C_{HW}^{1.852} D^{4.87}} = \frac{4.73 (500)}{7090 (.667)^{4.87}} = 2.403$$

$$K_6 = \frac{4.73 (500)}{7090 (.5)^{4.87}} = 9.754$$

From Eq. 4-7

$$\left(\frac{1}{K_e}\right)^{.54} = \left(\frac{1}{2.403}\right)^{.54} + \left(\frac{1}{9.754}\right)^{.54} = .915$$

$$K_e = 1.178 \text{ ft}$$

$$D_e = \left[\frac{4.73 L}{C_{HW}^{1.852} K_e} \right]^{1/4.87} = \left[\frac{4.73 (500)}{7090 (1.178)} \right]^{.2053}$$

$$= .772 \text{ ft}$$

$$= 9.26 \text{ inches}$$

3. An 800 ft long 8-inch cast iron pipe contains an open globe valve. Determine the length of the equivalent pipe if the flow rate is approximately 700 gpm.

Solution:

Using the procedure for determining f described in Chapter II, $f = .0218$. From Eq. 4-8

$$\Delta L = \frac{K_L D}{f} = \frac{10(8/12)}{.0218} = 306 \text{ ft}$$

$$L_e = L + \Delta L = 1106 \text{ ft}$$

Systems of Equations Describing Steady Flow in Pipe Networks

$$Q_6 - Q_1 - Q_2 - Q_5 = -5$$


$$18 - 15 - 5 - 3 = -5$$

Flow rates as unknowns

The analysis of flow in networks of pipes is based on the continuity and energy laws as described in Chapter I. To satisfy continuity, the mass, weight, or volumetric flow rate into a junction must equal the mass, weight, or volumetric flow rate out of a junction. If the volumetric flow rate is used this principle, as discussed in Chapter I, can be expressed mathematically as,

$$(\sum Q_i)_{out} - (\sum Q_i)_{in} = C \dots \dots (4-12)$$

in which C is the external flow at the junction (commonly called consumption or demand). C is positive if flow is into the junction and negative if it is out from the junction. For example if four pipes meet at a junction as shown in the sketch, Eq. 4-12 at this junction is

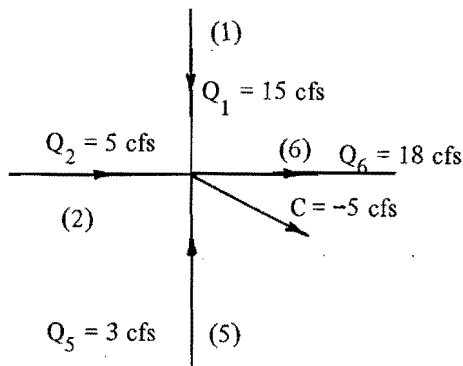

If a pipe network contains J junctions (also called nodes) then $J-1$ independent continuity equations in the form of Eq. 4-12 can be written. The last, or the J^{th} continuity equation, is not independent; that is, it can be obtained from some combination of the first $J-1$ equations. Note in passing that each of these continuity equations is linear, i.e., Q appears only to the first power.

In addition to the continuity equations which must be satisfied, the energy principle provides equations which must be satisfied. These additional equations are obtained by noting that if one adds the head losses around a closed loop, taking into account whether the head loss is positive or negative, that upon arriving at the beginning point the net head losses equals zero. Mathematically, the energy principle gives L equations of the form

$$\begin{aligned} \text{I} \\ \sum_{\ell} h_{f\ell} &= 0 \\ \text{II} \\ \sum_{\ell} h_{f\ell} &= 0 \\ &\dots \dots \dots (4-13) \\ &\dots \\ &\dots \\ \text{L} \\ \sum_{\ell} h_{f\ell} &= 0 \end{aligned}$$

in which L represents the number of non-overlapping loops or circuits in the network, and the summation on small l is over the pipes in the loops I, II, ..., L. By use of the exponential formula $h_f = KQ^n$, Eqs. 4-13 can be written in terms of the flow rate, or


$$\begin{aligned} \text{I} \\ \sum_l K_l Q_l^n &= 0 \\ \text{II} \\ \sum_l K_l Q_l^n &= 0 \\ \cdot \\ \cdot \\ \text{L} \\ \sum_l K_l Q_l^n &= 0 \end{aligned} \quad \dots \dots \dots (4-14)$$

A pipe network consisting of J junctions and L non-overlapping loops and N pipes will satisfy the equation

$$N = (J - 1) + L \quad \dots \dots \dots (4-15)$$

Since the flow rate in each pipe can be considered unknown, there will be N unknowns. The number of independent equations which can be obtained for a network as described above are (J-1) + L. Consequently the number of independent equations is equal in number to the unknown flow rates in the N pipes. The (J-1) continuity equations are linear and the L energy (or head losses) equations are nonlinear. Since large networks may consist of hundreds of pipes, systematic methods which utilize computers are needed for solving this system of simultaneous equations. Such methods are described in subsequent chapters.

As an example in defining the system of N equations which must be satisfied in solving for the N unknown volumetric flow rates in the N pipes of a network, consider the simple two loop network given below. In this example there are five pipes and therefore five unknown flow rates. There are four junctions and

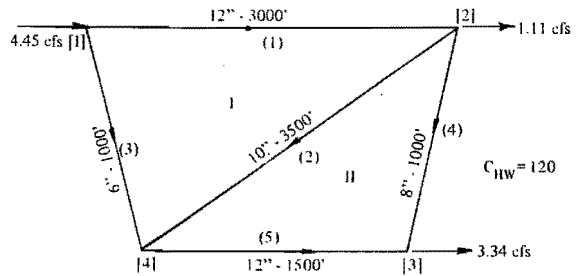

therefore three independent continuity equations and two energy equations for the head losses around the two basic loops can be written. On the sketch of this network the pipe numbers are enclosed by parentheses, the junction or node numbers are within [] brackets and the loops are denoted by Roman Numerals I and II. Arrow heads denote assumed directions of flows in the pipes. Flow rates, etc., will be denoted by a subscript corresponding to the pipe number in which that flow rate occurs. This same notation will be followed throughout the remainder of the manual. Also considerations of space prevent duplicating solutions in ES and SI units.

The J-1 = 3 continuity equations at the three consecutive junctions 1, 2, and 3 are

$$\begin{aligned} Q_1 + Q_3 &= 4.45 \\ -Q_1 + Q_2 + Q_4 &= -1.11 \\ -Q_4 - Q_5 &= -3.34 \end{aligned}$$

The continuity equation at junction 4 is $-Q_3 - Q_2 + Q_5 = 0$. However, this equation is not independent of the above three equations since it can be obtained as minus the sum of these three equations. The Hazen-Williams equation will be used to define the head losses in each pipe. In expressing these head losses the exponential equation will be used. From Eq. 2-22 the K coefficients for the exponential formula are: $[K = 4.73L / (C_{HW}^{1.852} D^{4.87})]$:

$$K_1 = 2.018, K_2 = 5.722, K_3 = 19.674, K_4 = 4.847, K_5 = 1.009$$

The energy loss equations around the two loops are:

$$\begin{aligned} 2.018 Q_1^{1.852} + 5.722 Q_2^{1.852} - 19.674 Q_3^{1.852} &= 0 \\ 4.847 Q_4^{1.852} - 1.009 Q_5^{1.852} - 5.722 Q_2^{1.852} &= 0 \end{aligned}$$

These two energy equations are obtained by starting at junctions 1 and 2, respectively, and moving around the respective loops I and II in a clockwise direction. If the assumed direction of flow is opposite to this clockwise movement a minus precedes the head loss for that pipe. Simultaneous equations such as those above will be called Q-equations.

A solution to the five unknown flow rates from the five simultaneous equations above, by the procedure described subsequently in Chapter V is: $Q_1 = 3.350$ cfs, $Q_2 = .897$ cfs, $Q_3 = 1.104$ cfs, $Q_4 = 1.340$ cfs, $Q_5 = 2.001$ cfs. This solution can be verified by substituting into each of the above equations. It is relatively easy to determine flows in individual pipes which also satisfy the J-1 continuity equations. However, the correct flow rates which simultaneously satisfy the L energy equations are


virtually impossible to obtain by trial and error if the system is large.

After solving the system of equations for the flow rate in each pipe, the head losses in each pipe can be determined. From a known head or pressure at one junction it is then a routine computation to determine the heads and pressures at each junction throughout the network, or at any point along a pipe, by subtracting the head loss from the head at the upstream junction, plus accounting for differences in elevations if this be the case.

In some problems the external flows may not be known as was assumed in the above example. Rather, the supply of water may be from reservoirs and/or pumps. The amount of flow from these individual sources will not only depend upon the demands, but also will depend upon the head losses throughout the system. Methods for incorporating pumps and reservoirs into a network analysis in which the flow rates in the individual pipes of the network are initially considered the unknowns will be dealt with in Chapter V in conjunction with the linear theory method of solution.

Example Problem in Writing Flow Rate Equations

- Write the system of equations whose solution provides the flow rates in the six pipes of the network shown below. The energy equations are to be based on the Darcy-Weisbach equation.

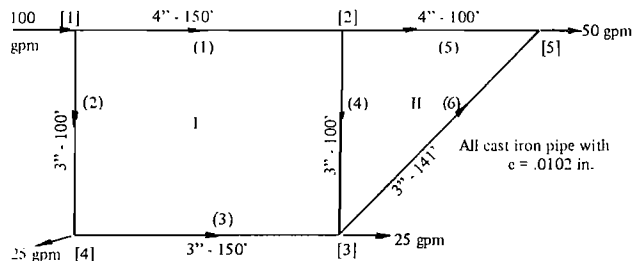

Solution

Before the energy equations can be defined it is necessary that K and n for each pipe be determined for the range of flow rates expected in that pipe by the procedures described in Chapter II. This might be accomplished by a computer program which determines f for the specified flow rate plus an incremental flow rate and f for the specified flow rate minus an incremental flow rate, and from these f 's and Q 's compute a and b in Eq. 2-26 and thereafter K and n for the exponential formula. In solving a pipe network problem a computer algorithm for doing this might be called upon whenever the flow rates being used in the solution are outside the range for which K and n are applicable. A listing of a FORTRAN program for accomplishing these computations follows along with the input data required for this problem. Values for K and n for each pipe is given below the listing.

```

100 FORMAT(8F10.5)
    ELOG=9.35*ALOG10(2.71828183)
20 READ(5,100,END=99) Q,D,FL,E,DQP,VIS
    DEQ=Q*DQP
    ED=E/D
    D=D/12.
    A=.78539392*D**2
    Q1=Q-DEQ
    Q2=Q+DEQ
    V1=Q1/A
    V2=Q2/A

```

```

RE1=V1*D/VIS
RE2=V2*D/VIS
ARL=FL/(64.4*D*A**2)
F=1./(1.14-2.*ALOG10(ED))**2
RE=RE1
MM=0
57 MCT=0
52 FS=SQRT(F)
    FZ=.5/(F*FS)
    ARG=ED+9.35/(RE*FS)
    FF=1./FS-1.14+2.*ALOG10(ARG)
    DF=FZ+ELOG*FZ/(ARG*RE)
    DIF=FF/DF
    F=F+DIF
    MCT=MCT+1
    IF(ABS(DIF).GT..00001.AND.MCT.LT.15) GO TO 52
    IF(MM.EQ.1) GO TO 55
    MM=1
    RE=RE2
    F1=F
    GO TO 57
55 F2=F
    BE=(ALOG(F1)-ALOG(F2))/(ALOG(Q2)-ALOG(Q1))
    AE=F1*(Q-DEQ)**BE
    EP=2.-BE
    CK=AE*ARL
    WRITE(6,101) Q,D,BE,AE,EP,CK
101 FORMAT(1H ,5F12.5,E16.6)
    GO TO 20
99 STOP
END

```

Input data for above problem.

Q	P	L	e	ΔQ ratio	ν
.12	4.	150.	.0102	.1	.00001217
.10	3.	100.	.0102	.1	.00001217
.05	3.	150.	.0102	.1	.00001217
.05	3.	100.	.0102	.1	.00001217
.1	4.	100.	.0102	.1	.00001217
.05	3.	141.	.0102	.1	.00001217

Pipe No.	1	2	3	4	5	6
Q(cfs)	.12	.10	.05	.05	.10	.05
K	21.0	63.9	85.2	56.8	13.6	80.1
n	1.90	1.92	1.88	1.88	1.89	1.88

The equations which will provide a solution are:

$$\begin{aligned} Q_1 + Q_2 &= .223 \\ - Q_1 + Q_4 + Q_5 &= 0 \\ - Q_3 - Q_4 + Q_6 &= -.056 \\ - Q_2 + Q_3 &= -.056 \end{aligned}$$

$$\begin{aligned} 21.0 Q_1^{1.90} + 56.8 Q_4^{1.88} - 85.2 Q_5^{1.88} + 63.9 Q_2^{1.92} &= 0 \\ 13.6 Q_5^{1.89} - 80.1 Q_6^{1.88} - 56.8 Q_4^{1.88} &= 0 \end{aligned}$$

Heads at Junctions as Unknowns

If the head (either the total head or the piezometric head, since the velocity head is generally ignored in determining heads or pressure in pipe networks) at each junction is initially considered unknown instead of the flow rate in each pipe, the number of simultaneous equations which must be solved can be reduced in number. The reduction in number of equations, however, is at the expense of not having some linear equations in the system.

To obtain the system of equations which contain the heads at the junctions of the network as unknowns, the J-1 independent continuity equations are written as before. Thereafter the relationship between the flow rate and head loss is substituted into the continuity equations. In writing these equations it is convenient to use a double subscript for the flow rates. These subscripts correspond to the junctions at the ends of the pipe. The first subscript is the junction number from which the flow comes and the second is the junction number to which the flow is going. Thus Q_{12} represents the flow in the pipe connecting junctions 1 and 2 assuming the flow is from junction 1 to junction 2. If the flow is actually in this direction Q_{12} is positive and Q_{21} equals minus Q_{12} . Solving for Q from the exponential formula (using the double subscript notation) gives

$$Q_{ij} = (h_{L_{ij}}/K_{ij})^{1/n_{ij}} = \left(\frac{H_i - H_j}{K_{ij}} \right)^{1/n_{ij}} \quad (4-16)$$


If Eq. 4-16 is substituted into the junction continuity equations (Eq. 4-12), the following equation results:

$$\left[\sum \left(\frac{H_i - H_j}{K_{ij}} \right)^{\frac{1}{n_{ij}}} \right]_{\text{out}} - \left[\sum \left(\frac{H_i - H_j}{K_{ij}} \right)^{\frac{1}{n_{ij}}} \right]_{\text{in}} = C \quad (4-17)$$

Upon writing an equation of the form of Eq. 4-17 at J-1 junctions, a system of J-1 nonlinear equations is produced.

As an illustration of this system of equations with the heads at the junctions as the unknowns, consider the

simple one loop network below which consists of three junctions and three pipes. In this network two independent continuity equations are available, and consequently the head at one of the junctions must be known. In this case at [1]. The two continuity equations are:

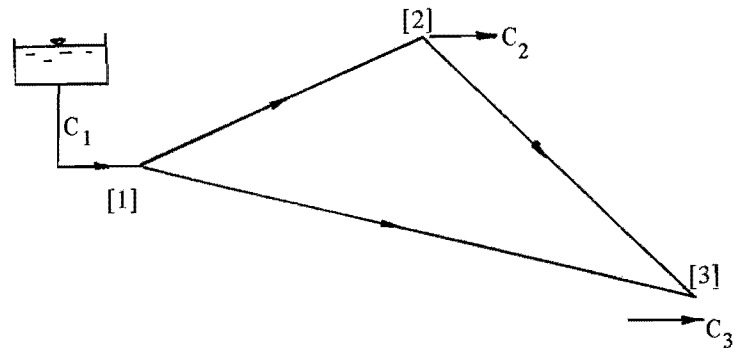

$$\begin{aligned} Q_{12} + Q_{13} &= C_1 = C_2 + C_3 \\ Q_{21} + Q_{23} &= -C_2 \quad (\text{or, } -Q_{12} + Q_{23} = -C_2) \end{aligned}$$

Note that even though in the second equation the flow in pipe 1-2 is toward the junction, the flow rate Q_{21} is not preceded by a minus sign since the notation 2-1 takes care of this. Alternatively the equations could have been written at junctions 2 and 3 instead of 1 and 2. Substituting Eq. 4-16 into these continuity equations gives the following two equations to solve for the heads, H_2 and H_3 (H_1 is known and the subscripts of the H's denote the junction numbers):

$$\begin{aligned} \left(\frac{H_1 - H_2}{K_{12}} \right)^{1/n_{12}} + \left(\frac{H_1 - H_3}{K_{13}} \right)^{1/n_{13}} &= C_2 + C_3 \\ - \left(\frac{H_1 - H_2}{K_{12}} \right)^{1/n_{12}} + \left(\frac{H_2 - H_3}{K_{23}} \right)^{1/n_{23}} &= -C_2 \end{aligned}$$

Since a negative number cannot be raised to a power a minus sign must precede any term in which the subscript notation is opposite to the direction of flow, i.e. the second form of equation as given in parentheses is used. Systems of these equations will be referred to as H-equations.

Upon solving this nonlinear system of equations, the pressure at any junction j can be computed by subtracting the junction elevation from the head H_j and then multiplying this difference by γ the specific weight of the fluid. To determine the flow rates in the pipes of the network, the now known heads are substituted into Eq. 4-16.

Corrective flow rates around loops of network considered unknowns

Since the number of junctions minus 1 (i.e. $J-1$) will be less in number than the number of pipes in a network by the number of loops L in the network, the last set of H -equations will generally be less in number than the system of Q -equations. This reduction in number of equations is not necessarily an advantage since all of the equations are nonlinear, whereas in the system of Q -equations only the L energy equations were nonlinear. A system which generally consists of even fewer equations can be written for solving a pipe network, however. These equations consider a corrective flow rate in each loop as the unknowns. This latter system will be referred to as the ΔQ -equations. Since there are L basic loops in a network the ΔQ -equations consist of L equations, all of which are nonlinear.

It is not difficult to establish an initial flow in each pipe which satisfies the $J-1$ junction continuity equation (which must also satisfy the J^{th} junction continuity equation). These initial flow estimates generally will not simultaneously satisfy the L head loss equations. Therefore they must be corrected before they equal the true flow rates in the pipes. A flow rate adjustment can be added (accounting for sign) to the initially assumed flow in each pipe forming a loop of the network without violating continuity at the junctions. This fact suggests establishing L energy (or head loss) equations around the L loops of the network in which the initial flow plus the corrective loop flow rate ΔQ is used as the true flow rate in the head loss equations. Upon satisfying these head loss equations by finding the appropriate corrective loop flow rates, the $J-1$ continuity equations would also remain


satisfied as they initially were. The corrective loop flow rates ΔQ_i may be taken positive in the clockwise or counterclockwise direction around the basic loops, but the sign convention must be consistent around any particular loop, and preferably in the same direction in all loops of the network. Clockwise directions will be considered positive in this manual.

In order to develop the mathematics of this possible system of ΔQ -equations, the initially assumed flows, which satisfy the junction continuity equations, will contain an o subscript as well as an i to denote the pipe number. Thus Q_{oi} , $i = 1, 2 \dots N$ represents the initially assumed flow rates in the N pipes. The corrective loop flow rates will be denoted by ΔQ_ℓ . Thus ΔQ_ℓ , $\ell = 1, 2 \dots L$ are corrective flow rates around the L loops of the system which must be added to Q_o for a given pipe to get the actual flow rate in that pipe. Using this notation the L energy equations around the basic loops can be written as,

$$\begin{aligned} \text{I} \quad \sum_i K_i (Q_{oi} + \Delta Q_1)^{n_i} &= 0 \quad (\text{head loss around loop I}) \\ \text{II} \quad \sum_i K_i (Q_{oi} + \Delta Q_2)^{n_i} &= 0 \quad (\text{head loss around loop II}) \\ &\vdots \\ \text{L} \quad \sum_i K_i (Q_{oi} + \Delta Q_L)^{n_i} &= 0 \quad (\text{head loss around loop L}) \end{aligned} \quad (4-18)$$

in which each summation includes only those pipes in the loop designated by the Roman numeral I, II, ... L.

The system of equations, Eq. 4-18, will be set up for the two-loop network shown below. Values for K and n in the exponential formula for the expected flow rates are given by each pipe in the network. The two corrective loop flow rates ΔQ_1 and ΔQ_2 are taken as positive in the clockwise direction. The first step is to provide initial estimates of the flow rate in each pipe which satisfy the junction continuity equations. The estimates are: $Q_{o1} =$

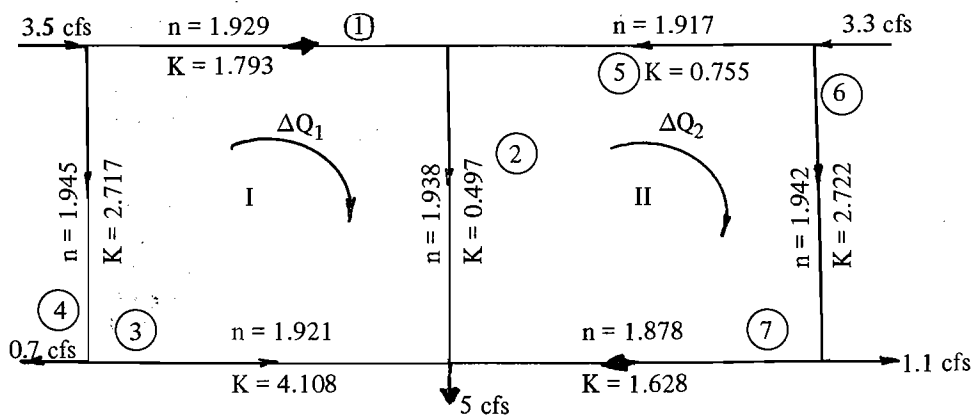

1.75 cfs, $Q_{02} = 3.55$ cfs, $Q_{03} = 1.05$ cfs, $Q_{04} = 1.75$ cfs, $Q_{05} = 1.8$ cfs, $Q_{06} = 1.5$ cfs, $Q_{07} = 0.4$ cfs in the directions shown by the arrows on the sketch. The head loss equations around the two loops are:

$$F_1 = 1.793 (1.75 + \Delta Q_1)^{1.929} + 0.497 (3.55 + \Delta Q_1 - \Delta Q_2)^{1.948} - 4.108 (1.05 - \Delta Q_1)^{1.921} - 2.717 (1.75 - \Delta Q_1)^{1.945} = 0$$

$$F_2 = -0.755 (1.8 - \Delta Q_2)^{1.917} + 2.722 (1.5 + \Delta Q_2)^{1.942} + 1.628 (0.4 + \Delta Q_2)^{1.878} - 0.497 (3.55 - \Delta Q_2 + \Delta Q_1)^{1.938} = 0$$

Upon obtaining the solution to these two equations for the two unknowns ΔQ_1 and ΔQ_2 , the flow rates in

each pipe can easily be determined by adding these corrective loop flow rates to the initially assumed flow rates. From these flow rates the head losses in each pipe are determined.

The nonlinearities in this system of equations, as well as the previous two systems discussed, make solution difficult. In the next three chapters methods for obtaining solutions are discussed. The Newton method and the Hardy Cross method (which is the Newton method applied to one equation at a time) are well adapted for the corrective loop flow rate equations, and also the junction head equations. These methods are described respectively in Chapters VI and VII. The Q-equations or the equations which consider the flow in each pipe unknown, can be solved best by the linear theory method as discussed in the next chapter, Chapter V. This flow rate system of equations can be solved by the Newton method also.

CHAPTER V

LINEAR THEORY METHOD

Introduction

In Chapter IV three alternative systems of equations were described which might be used in solving for the flow or pressure distribution in pipe networks. In this chapter the linear theory method¹ will be described and used in solving the system of equations which considers the flow rates unknown (i.e. the Q-equations). This system of equations is easy to use if the network is flow rate oriented, i.e. all external flows to the system are known. The linear theory method will be described first for solving the system of Q-equations. Thereafter it will be extended to networks containing pumps and reservoirs. For such networks, not all external flows are known, and must be obtained as part of the solution.

The linear theory method has several distinct advantages over the Newton-Raphson or the Hardy Cross methods described in the next two chapters. First, it does not require an initialization, and secondly according to Wood and Charles it always converges in a relatively few iterations. Its use in solving the head oriented equations or the corrective loop oriented equations is not recommended.

Transforming Nonlinear Energy Equations Into Linear Equations

Linear theory transforms the L nonlinear loop equations into linear equations by approximating the head in each pipe by,

$$h_{f_i} = [K_i Q_i(0)^{n-1}] Q_i = K_i' Q_i \dots (5-1)$$

That is a coefficient K_i' is defined for each pipe as the product of K_i multiplied by $Q_i(0)^{n-1}$, an estimate of the flow rate in that pipe. Combining these artificially linear loop equations with the J-1 junction continuity equations provide a system of N linear equations which can be solved by linear algebra. The solution will not necessarily be correct because the $Q_i(0)$'s will probably not have been estimated equal to the Q_i 's produced by the solution. By repeating the process, after improving the estimates to $Q_i(1)$, eventually the $Q_i(m)$'s will equal the

Q_i 's. After this iteration the correct solution has been obtained.

In applying the linear theory method it is not necessary to supply an initial guess, as perhaps implied. Instead for the first iteration each K_i' is set equal to K_i , which is equivalent to setting all flow rates $Q_i(0)$ equal to unity. Wood, in developing the linear theory method, observed that successive iterative solutions tend to oscillate about the final solution. He, therefore, suggests that after two iterative solutions have been obtained, and thereafter, that each flow rate used in the computations be the average flow rate for that pipe from the past two solutions or

$$Q_i(n) = \frac{Q_i(n-1) + Q_i(n-2)}{2} \dots \dots (5-2)$$

An example will be followed through in detail to clarify the process in solving a pipe network by the linear theory method. This example is the two-loop network shown below which consists of seven pipes. Pipes 1 and 2 contain globe valves and pipe 2 contains an orifice meter.

The first step is to obtain K and n for the exponential formula for a range of flow rates believed to be realistic. (In implementing the method in a computer program the first values used for K and n may be obtained from the Hazen-Williams equation.) Estimates of n and K are given in the table below the sketch of the pipe network (following page).

The second step is to form equivalent pipes for those pipes containing the globe valves and the orifice meter by use of Eq. 4-8,


$$\Delta L = \frac{K_L D}{f} = \frac{10(.667)}{.0218} = 306 \text{ ft for globe valve in pipe (1)}$$

$$\Delta L = \frac{10(.833)}{.02085} = 400 \text{ ft for globe valve in pipe (5)}$$

$$\Delta L = \frac{1.2(1)}{.0238} = 51 \text{ ft for the orifice meter in pipe (2)}$$

These lengths are added to the pipe lengths to form equivalent pipes. The K's in the table below the network are for the equivalent pipes.

¹Wood, Don J., and Carl O. A. Charles. "Hydraulic Network Analysis Using Linear Theory," Jour. of the Hydraulics Div., ASCE, 98(HY7):1157-1170. July 1972.

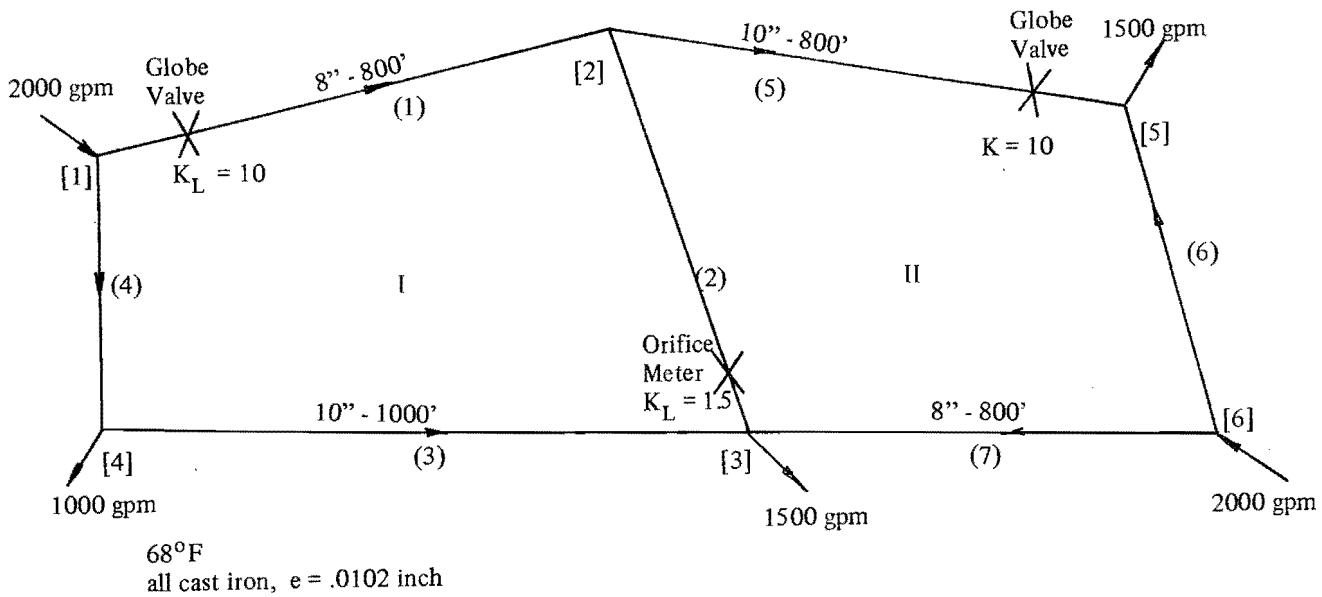

Pipe No.	1	2	3	4	5	6	7
V_1 (fps)	3.35	0.425	0.922	2.76	2.76	5.10	6.70
V_2 (fps)	6.70	0.851	1.84	5.53	5.51	10.21	13.40
$Re_1 \times 10^{-5}$	1.83	3.50	6.29	2.27	1.89	2.10	3.67
$Re_2 \times 10^{-5}$	3.67	6.99	1.26	4.54	3.77	4.19	7.34
f_1	0.0221	0.0250	0.0234	0.0203	0.0212	0.0234	0.0215
f_2	0.0215	0.0226	0.0218	0.0196	0.0205	0.0229	0.0212
b	0.0408	0.146	0.101	0.0472	0.0475	0.0287	0.0215
a	0.0223	0.0213	0.0218	0.0210	0.0216	0.0234	0.0219
n	1.96	1.85	1.90	1.95	1.95	1.97	1.98
K	4.71	.402	1.37	.264	1.14	11.30	3.35

The network has six junctions and therefore five independent continuity equations can be written. These are:

$$\begin{aligned} Q_1 + Q_4 &= 4.45 \\ -Q_1 - Q_2 + Q_5 &= 0 \\ Q_2 - Q_3 - Q_7 &= -3.34 \\ Q_3 - Q_4 &= -2.23 \\ -Q_5 - Q_6 &= -3.34 \end{aligned}$$

A minus sign precedes those Q 's with subscripts of pipes whose assumed directions of flow are into the junction, according to the convention adopted in Eq. 4-12. Under this convention external flows into the junction are positive and external flows, or demands which extract flow from the junction are negative. Alternatively, Q 's for pipes whose flows are assumed into the junction may be taken positive and those out from the junction taken negative provided external demands are positive and incoming supplies are negative on the right of the equal sign. The two head loss equations are linearized by forming a coefficient for each Q_i which equals K

multiplied by $Q_i(0)^{n-1}$. For the first iteration each $Q_i(0) = 1$ and therefore the linearized energy equations for the first iteration are:

$$\begin{aligned} 4.71 Q_1 - 0.402 Q_2 - 1.37 Q_3 - 0.264 Q_4 &= 0 \\ 1.14 Q_5 - 11.30 Q_6 + 3.35 Q_7 + 0.402 Q_2 &= 0 \end{aligned}$$

Using methods such as Gaussian elimination, Gauss-Jordan elimination, or orthogonal polynomials, the above linear system of equations is solved giving in cfs $Q_1 = 0.752$, $Q_2 = 1.37$, $Q_3 = 1.48$, $Q_4 = 3.70$, $Q_5 = 2.12$, $Q_6 = 1.22$. Based on these flow rates $n_1 = 1.93$, $K_1 = 4.71$, $n_2 = 1.92$, $K_2 = .406$, $n_3 = 1.94$, $K_3 = 1.36$, $n_4 = 1.96$, $K_4 = 0.262$, $n_5 = 1.95$, $K_5 = 1.62$, $n_6 = 1.97$, $K_6 = 11.29$, $n_7 = 1.98$, $K_7 = 3.35$. Using these values the coefficients in the two energy equations are modified. The value of K and n in the exponential formula may be modified and the modified values of K_i multiplied by $Q_i(1)^{n_i-1} = Q_i^{n_i-1}$ to obtain new coefficients in the last two energy equations. These modified energy equations for the second iteration are:

$$3.62 Q_1 - 0.541 Q_2 - 1.96 Q_3 - 0.92 Q_4 = 0$$

$$3.31 Q_5 - 13.70 Q_6 + 10.55 Q_7 + 0.406 Q_2 = 0$$

After solving this system, $Q_1 = 1.02$, $Q_2 = 0.653$, $Q_3 = 1.20$, $Q_4 = 3.43$, $Q_5 = 1.68$, $Q_6 = 1.66$, $Q_7 = 2.79$ cfs. Using the average of these flow rates and those from the previous solution to define the coefficients in the energy equations produces the final solution since these values do not change in the third digit beyond the decimal point during the next iteration. The solution therefore is: $Q_1 = 1.032$, $Q_2 = 0.656$, $Q_3 = 1.195$, $Q_4 = 3.422$, $Q_5 = 1.688$, $Q_6 = 1.653$, $Q_7 = 2.802$.

For a simple network such as that above it is practical to carry out the solution by hand. Obviously, for larger networks involving 100 or more pipes, computer algorithms must be written to carry out the numerous calculations. Below a FORTRAN computer program is listed for accomplishing this task. With this program the problem described above took 0.20 second of execution time on a UNIVAC 1108 computer. Description of the data input required by an expanded version of this program which allows for pumps and reservoirs is given in Appendix C. A program of just over one-half the size of the one listed can be written if the Hazen-Williams equation is used instead of the Darcy-Weisbach equation, since the n's and K's in the exponential formula do not depend upon the flow rate.

To use this program four different types of information are required. First the number of pipes, the number of junctions, and number of loops in the network plus other specifications such as denoting type of data (i.e. ES or SI), number of allowable iterations, viscosity of fluid, etc. (Card No. 1). Second, data giving the diameters, lengths, and wall roughness for each of the pipes (next three read statements). Third, information for establishing junction continuity equation. This information is provided by a card for each junction which contains the pipe numbers meeting at the junction. If the assumed direction of flow is into the junction this pipe number is preceded by a minus. Also if external flow occurs at the junction another card contains this data. Fourth, information is required for the energy equations. For each loop in the network a card lists the pipe numbers in that loop. A minus precedes the pipe number if the assumed direction of flow is counterclockwise around the loop.

```

      INTEGER JN(40,5),NN(40),JB(20),IFLOW(40),LP(8,20),
      $JC(50)
      REAL D(50),L(50),A(50,51),QJ(20),E(50),KP(50),V(2 ),
      $Q(50),EXPP(50),AR(50),ARL(50)
      30 READ(5,110,END=99) NP,NJ, NL,MAX,NUNIT,ERR,VIS,
      $DELQ1
      110 FORMAT(5I5,3F10.5)
      C NP--NO. OF PIPES, NJ--NO. OF JUNCTIONS, NL--NO. OF
      C LOOPS, MAX--NO. OF ITERATIONS ALLOWED, IF NUNIT=0
      C D AND E IN INCHES AND L IN FEET,IF NUNIT=1--D AND
      C E IN FEET AND L IN FEET, IF NUNIT=2 D AND E IN
      C METERS AND L IN METERS, IF NUNIT=3 D AND E IN CM

```

```

      C AND L IN METERS.
      100 FORMAT(16I5)
      NPP=NP+1
      NJ1=NJ-1
      READ(5,101) (D(I),I=1,NP)
      READ(5,101) (L(I),I=1,NP)
      READ(5,101) (E(I),I=1,NP)
      101 FORMAT(8F10.5)
      DO 48 I=1,NP
      48 E(I)=E(I)/D(I)
      IF (NUNIT-1) 40,41,42
      40 WRITE(6,102) (D(I),I=1,NP)
      102 FORMAT('OPIPE DIAMETERS (INCHES)'/,(1H ,16F8.1))
      DO 43 I=1, NP
      43 D(I)=D(I)/12.
      GO TO 44
      41 WRITE(6,112) (D(I),I=1,NP)
      112 FORMAT('OPIPE DIAMETERS (FEET)'/,(1H ,16F8.3))
      44 WRITE (6,103) (L(I),I=1,NP)
      103 FORMAT('OLENGTHS OF PIPE (FEET)'/,(1H ,16F8.0))
      G2=64.4
      GO TO 50
      42 IF (NUNIT.EQ. 2) GO TO 45
      DO 46 I=1,NP
      46 D(I)=.01*D(I)
      45 WRITE(6,113) (D(I),I=1,NP)
      113 FORMAT('O PIPE DIAMETERS (METERS)'/,(1H ,16F8.4))
      WRITE(6,114) (L(I),I=1,NP)
      114 FORMAT('O L LENGTH OF PIPES (METERS)'/,(1H ,16F8.1))
      G2=19.62
      WRITE(6,115) (E(I),I=1,NP)
      115 FORMAT('O RELATIVE ROUGHNESS OF PIPES'/,
      5(1H ,16F8.6))
      C INFLOW--IF 0 NO INFLOW, IF 1 THEN NEXT CARD GIVES
      C MAGNITUDE IN GPM, IF 2 NEXT CARD GIVES MAGNITUDE
      C IN CFS, IF 3 NEXT CARD GIVES MAGNITUDE IN CMS.
      C NNJ--NO. OF PIPES AT JUNCTIONS--POSITIVE FOR INFLOW
      C NEGATIVE FOR OUTFLOW, JN--THE NUMBERS OF PIPES
      C AT JUNCTION, IF FLOW ENTERS MINUS- IF FLOW LEAVES
      C THE PIPE NUMBER IS POSITIVE.
      DO 70 I=1,NP
      AR(I)=.78539392*D(I)**2
      70 ARL(I)=L(I)/(G2*D(I)*AR(I)**2)
      II=1
      DO 1 I=1,NJ
      READ(5,100) IFLOW(I),NNJ,(JN(I,J),J=1,NNJ)
      NN(I)=NNJ
      IF(IFLOW(I) - 1) 1,2,3
      2 READ(5,101) QJ(II)
      QJ(II)=QJ(II)/449.
      JB(II)=I
      GO TO 4
      3 READ(5,101) QJ(II)
      BJ(II)=I
      4 II=II+1
      1 CONTINUE
      C NUMBER OF PIPES IN EACH LOOP (SIGN INCLUDED)
      DO 35 I=1,NL
      READ(5,100) NNJ,(LP(I,J),J=1,NNJ)
      35 LP(8,I)=NNJ
      DO 5 I=1,NP
      IF (NUNIT .GT. 1) GO TO 66
      KP(I)=.0009517*L(I)/D(I)**4.87
      GO TO 5
      66 KP(I)=.00212*L(I)/D(I)**4.87
      5 CONTINUE
      ELOG=9.35*ALOG10(2.71828183)
      SUM=100.
      NCT=0
      20 II=1
      DO 6 I=1,NJ1
      DO 7 J=1,NP

```

```

7 A(I,J)=0.
  NNJ=NN(I)
  DO 8 J=1,NNJ
    IJ=JN(I,J)
    IF(IJ .GT. 0) GO TO 9
    IJ=ABS(IJ)
    A(I,IJ)=-1.
    GO TO 8
9 A(I,I)=1.
8 CONTINUE
  IF(IFLOW(I) .EQ. 0) GO TO 10
  A(I,NPP)=QJ(I)
  II=II+1
  GO TO 6
10 A(I,NPP)=0.
6 CONTINUE
  DO 11 I=NJ,NP
    DO 22 J=1,NP
22 A(I,J)=0.
    II=I-NJ1
    NNJ=LP(8,II)
    DO 12 J=1,NNJ
      IJ=LP(I,II)
      IJ=ABS(IJ)
      IF(IJ .LT. 0) GO TO 13
      A(I,IJ)=KP(IJ)
      GO TO 12
13 A(I,IJ)=-KP(IJ)
12 CONTINUE
11 A(I,NPP)=0.
  V(I)=4.
C SYSTEM SUBROUTINE FROM UNIVAC MATH-PACK TO
C SOLVE LINEAR SYSTEM OF EQ.
  CALL GJR(A,51,50,NP,NPP,$98,JC,V)
  IF (NCT .GT. 0) SUM=0.
  DO 51 I=1,NP
    BB=A(I,NPP)
    IF(NCT) 60,60,61
60 QM=BB
  GO TO 62
61 QM=.5*(Q(I)+BB)
  SUM=SUM+ABS(Q(I)-BB)
62 Q(I)=QM
  DELQ=QM*DELQ1
  QM=ABS(QM)
  V1=(QM-DELQ)/AR(I)
  IF(V1 .LT. .001) V1=.002
  V2=(QM+DELQ)/AR(I)
  VE=QM/AR(I)
  RE1=V1*D(I)/VIS
  RE2=V2*D(I)/VIS
  IF(RE2 .GT. 2.1E3) GO TO 53
  F1=64./RE1
  F2=64./RE2
  EXPP(I)=1.
  KP(I)=64.4*VIS*ARL(I)/D(I)
  GO TO 51
53 MM=0
  F=1./(1.14-2.*ALOG10(E(I)))**2
  PAR=VE*SQRT(.125*F)*D(I)*E(I)/VIS
  IF(PAR .GT. 65.) GO TO 54
  RE=RE1
57 MCT=0
52 FS=SQRT(F)
  FZ=.5/(F*FS)
  ARG=E(I)+9.35/(RE*FS)
  FF=1./FS-1.14+2.*ALOG10(ARG)
  DF=FZ+ELOG*FZ/(ARG*RE)
  DH=F/DF
  F=F+DH
  MCT=MCT+1
  IF(ABS(DIF) .GT. .00001 .AND. MCT .LT. 15) GO TO 52

```

```

IF(MM .EQ. 1) GO TO 55
MM=1
RE=RE2
F1=F
GO TO 57
55 F2=F
  BE=(ALOG(F1)-ALOG(F2))/(ALOG(QM+DELQ)-ALOG(QM-DELQ))
  AE=F1*(QM-DELQ)**BE
  EP=1.-BE
  EXPP(I)=EP+1.
  KP(I)=A1*ARL(I)*QM**1P
  GO TO 51
54 KP(I)=F*ARL(I)*QM**2
  EXPP(I)=2.
51 CONTINUE
  NCT=NCT+1
C THE NEXT FIVE CARDS CAN BE REMOVED
  WRITE(6,157) NCT,SUM,(Q(I),I=1,NP)
157 FORMAT('NCT=',J3,' SUM=',E10.3/, '(1H ,13F10.3)')
  WRITE(6,344) (EXPP(I),I=1,NP)
344 FORMAT('H ,13F10.3)')
  WRITE(6,344) (KP(I),I=1,NP)
  IF(SUM .GT. ERR .AND. NCT .LT. MAX) GO TO 20
  IF(NCT .EQ. MAX) WRITE(6,108) NCT,SUM
108 FORMAT('DID NOT CONVERGE IN',J5,' ITERATIONS -
  $SUM OF DIFFERENCES=',E10.4)
  IF(NUNIT .LT. 2) GO TO 63
  WRITE(6,127) (Q(I),I=1,NP)
127 FORMAT('O FLOWRATES IN PIPES IN CMS',/,(1H ,
  $13F10.4))
  DO 64 I=1,NP
64 KP(I)=KP(I)*ABS(Q(I))
  WRITE(6,139) (KP(I),I=1,NP)
  GO TO 30
63 WRITE(6,107) (Q(I),I=1,NP)
107 FORMAT('O FLOW RATES IN PIPES IN CFS',/,(1H ,
  $13F10.3))
  DO 21 I=1,NP
  KP(I)=KP(I)*ABS(Q(I))
21 Q(I)=449.*Q(I)
  WRITE(6,138) (KP(I),I=1,NP)
138 FORMAT(' HEAD LOSSES IN PIPES',/,(1H ,13F10.3))
  WRITE(6,105) (Q(I),I=1,NP)
105 FORMAT(' FLOW RATES (GPM)',/,(1H ,13F10.1))
  GO TO 30
98 WRITE(6,106) JC(1),V
106 FORMAT(' OVERFLOW OCCURRED -- CHECK
  $SPECIFICATIONS FOR REDUCDANT EQ. RESULTING
  $IN SINGULAR MATRIX',J5,2F8.2)
  GO TO 30
99 STOP
END

```

INPUT DATA FOR PREVIOUS 2 LOOP NETWORK PROBLEM


7	6	2	10	0	.001	.00001217	.1		
8.	12.		10.	12.	10.	6.	8.		
1106.	751.	1000.	500.	1200.	600.	800.			
.0102	.0102	.0102	.0102	.0102	.0102	.0102	.0102		
1	2	1	4						
2000.	0	3	-1	-2	5				
	1	3	2	-3	-7				
-1500.	1	2	3	-4					
	1	2	-5	-6					
-1500.	1	2	6	7					
2000.	4	1	-2	-3	-4				
	4	5	-6	7	2				

Pipe Nos. at junctions for defining continuity equation:

Pipes in loops for defining energy equation


Example Problems Using Linear Theory for Solution

For each of the pipe networks shown below find the flow rate and head loss in each pipe by using the linear theory method to solve the system of equations which considers the flow rates as the unknowns.

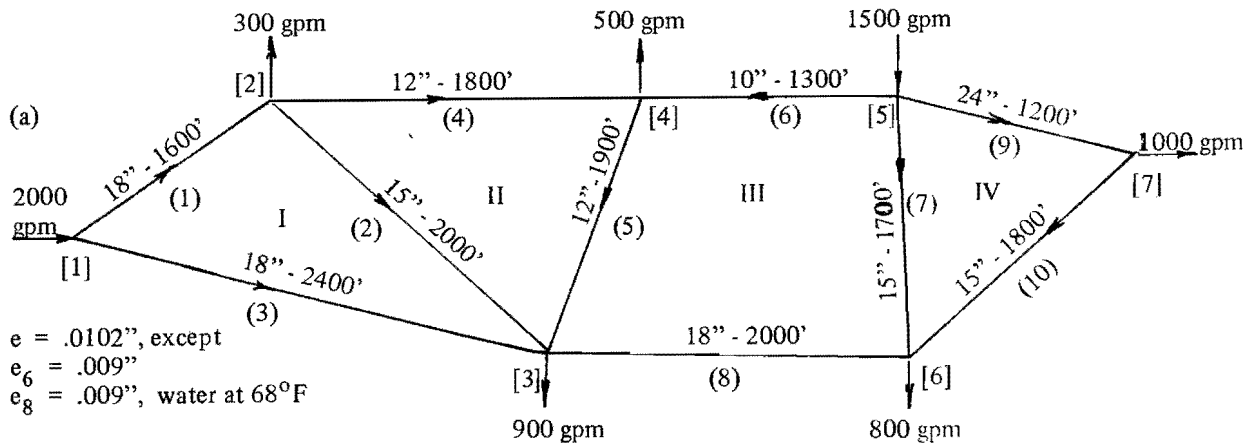

Answer

Pipe No.	1	2	3	4	5	6	7	8	9	10
Flow rate, Q, cfs	2.19	0.91	2.26	0.61	-0.27	0.23	0.65	-0.90	2.47	0.24
Flow rate, Q (gpm)	984	409	1016	275	-122	102	291	-402	1107	107
Head loss (ft)	0.500	0.297	0.797	0.389	0.092	0.110	0.134	0.116	0.111	0.023

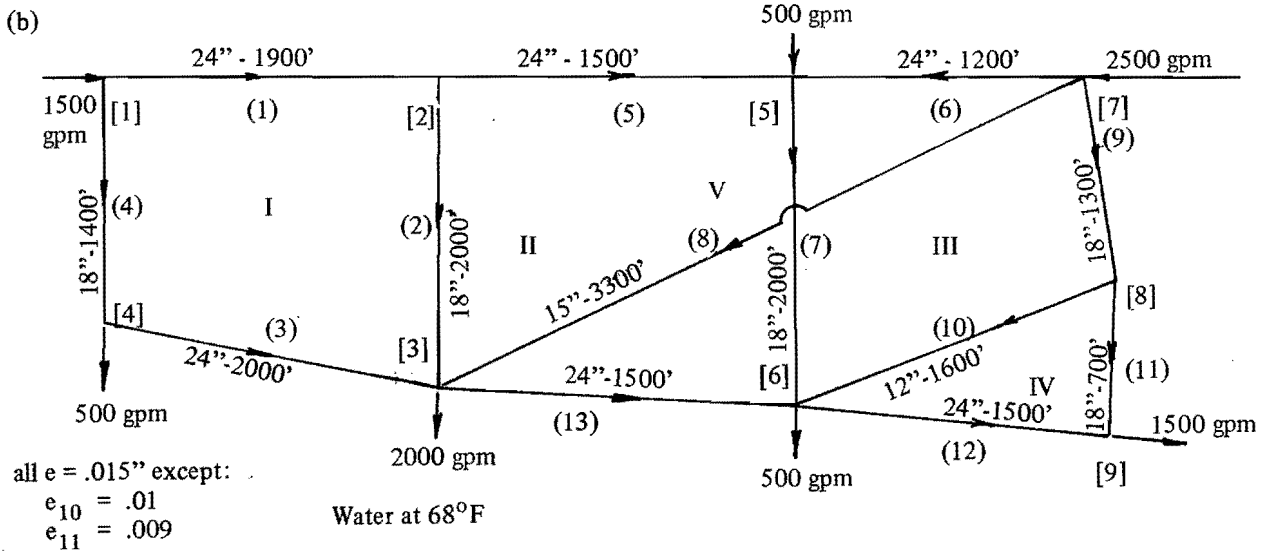

Answer

Pipe No.	1	2	3	4	5	6	7	8	9	10	11	12	13
Q (cfs)	0.95	2.03	1.28	2.39	-1.08	2.05	2.09	1.06	2.46	0.39	2.06	1.28	-0.09
Q (gpm)	427	912	573	1073	-485	922	937	476	1102	176	927	574	-40
h_f (ft)	.031	.572	.056	.546	.031	.082	.602	.685	.535	.150	.192	.042	.000

Including Pumps and Reservoirs into Linear Theory Method


All applications of the linear theory method described previously were for networks in which the external flows were assumed known. In practice this may not be the case. Rather the amount of flow being supplied from different reservoirs or pumps will depend upon the heads and flows throughout the network. Consequently the utility of the linear theory method can be enhanced by extending it to handle supply sources from reservoirs or pumps, and allow booster pumps to exist within pipelines. The methods used for this purpose are adapted from Tavallaee.¹

Each pump (not a booster pump) and each reservoir from which flow enters or leaves the system introduces an additional unknown that must be solved for in solving the network. Since pumps and reservoirs must be connected to the network by a pipe through which they supply the flow, it is natural to let the flow rates in these connective pipes be the additional unknowns. However, elevations of reservoirs, and elevations of reservoirs from which pumps obtain the water plus pump characteristics (i.e. h_p versus Q_p) are known for pumps. Therefore, equations are needed which relate these knowns to the connective pipe flow rates. Also for the networks described previously one of the junction continuity equations was redundant, being dependent upon the remaining $J-1$ junction continuity equations. With pumps and reservoirs supplying the water this is generally no longer the case. (If a junction is assumed at the reservoir or pump a redundant junction continuity equation still occurs. However, reservoirs or

pumps will not be considered junctions.) Consequently, if one reservoir and one pump supply the flow to the network, as illustrated in the sketch below, such that flows in two connective pipes become additional unknowns, one additional equation is necessary beyond the J available continuity equations and the L available energy equations. A convenient means for obtaining this additional equation is by defining a so called "pseudo loop," which connects the two reservoirs (in this instant the reservoir supplying flow and the reservoir from which the pump obtains flow) by a "no flow" pipe as illustrated below. Note that two pumps and/or reservoirs must be present or the network reduces to one for which all external flows (i.e. supplies and consumptions) are known. Consequently such pseudo loops can always be defined, because at least two reservoirs and/or pumps must exist in a network if all external flow rates are not known. The additional needed equation (or equations if more than two pumps and/or reservoirs are present), comes from the energy equation around this pseudo loop. Around pseudo loops the sum of head loss is not equal to zero but must account for the difference in reservoir elevations and head produced by the pump or pumps. Around the pseudo loop in the diagram below the energy equation is,

$$H_2 - K_5 Q_5^{n_5} - K_4 Q_4^{n_4} + K_3 Q_3^{n_3} + K_2 Q_2^{n_2} + K_1 Q_1^{n_1} + h_p = H_1$$

in which h_p is the head produced by the pump and other symbols are as previously defined. Writing this equation so

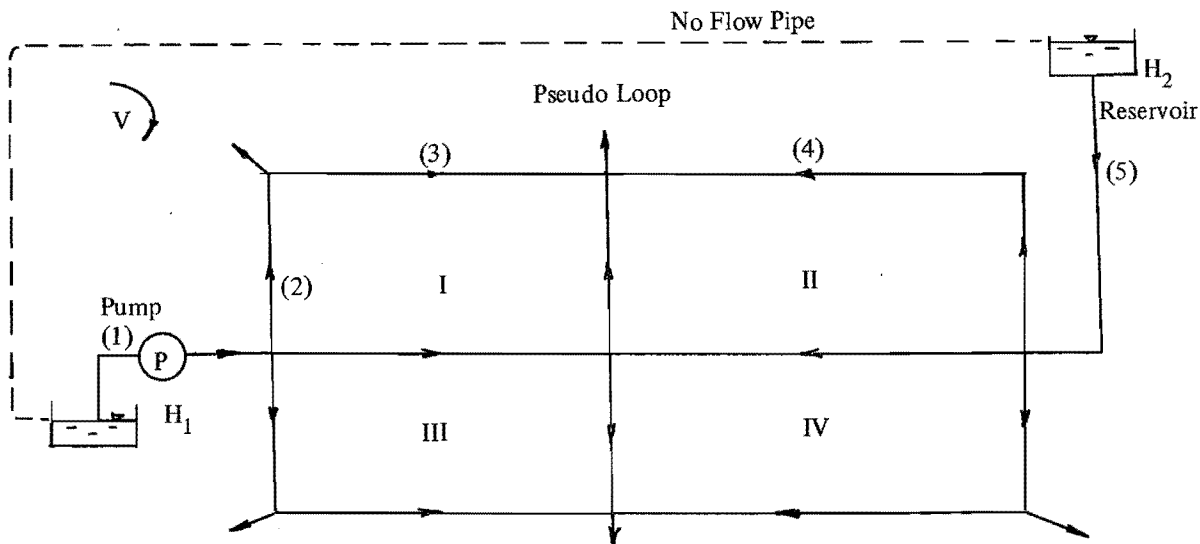

¹Tavallaee, A. "Inclusion of Pumps, Pressure Reducing Valves and Reservoirs in Pipe Networks Solved by Linear Theory Method," M.S. Thesis, Dept. of Civil & Environmental Engineering, College of Engineering, Utah State University. 1974.

that head losses in the direction of flow are positive, to be consistent with previous equations, gives,

$$-K_1 Q_1^{n_1} - K_2 Q_2^{n_2} - K_3 Q_3^{n_3} + K_4 Q_4^{n_4} + K_5 Q_5^{n_5}$$

$$- h_p = H_2 - H_1$$

or in general

$$\sum K_i Q_i^{n_i} - \sum h_p = \Delta H \dots (5-3)$$

represents the energy equation around a pseudo loop containing two reservoirs and/or pumps.

A number of alternative methods might be used to quantify the head h_p produced by the pump. The method used herein will approximate h_p over its working range by a quadratic equation of the form

$$h_p = A Q^2 + B Q + H_o \dots (5-4)$$

in which A, B, and H_o are constants for a given pump and might be determined by fitting Eq. 5-4 to three points taken from a pump characteristic curve.

When Eq. 5-4 is substituted into Eq. 5-3 a nonlinear equation results which contains only flow rates in pipes of the network (including connective pipes) as the unknowns. In this form the linear theory method does not give rapid convergence as it does when pumps and/or reservoirs are not present. The system of equations will therefore be modified to allow the linear theory method to converge rapidly. To help appreciate the motivation for this modification, reasons why the presence of pumps can greatly increase the number of required iterations in the linear theory method will be investigated.

Typical centrifugal pump characteristic curves are shown below. If the exponential formula is fit through the two points shown, the following equation results.

$$h_p = 15.84 Q^{-.503}$$

Note the negative exponent $-.503$ is vastly different from the exponents in the exponential formula for pipes which are typically slightly less than two. The head produced by this pump decreases nearly proportional to the reciprocal of the square root of the flow rate whereas the head loss in a typical pipe increases approximately proportional to the square of the flow rate. Clearly these relationships are quite dissimilar. A consequence is that when typical pump characteristic curves are used to define h_p in Eq. 5-3 and this equation becomes one of the simultaneous equations solved by the linear theory method, convergence may become very slow if at all.


To improve this situation a transformation of variables is needed so that the unknown which replaces h_p in Eq. 5-3 has an exponent value close to the rest of the n's. Such a transformation is

$$G = Q + \frac{B}{2A} \dots (5-5)$$

in which G is the new variable and A and B are the constants in Eq. 5-4. To demonstrate the appropriateness of Eq. 5-5, solve it for Q and substitute into Eq. 5-4. After some simplification

$$h_p = A G^2 + h_o \dots (5-6)$$

in which

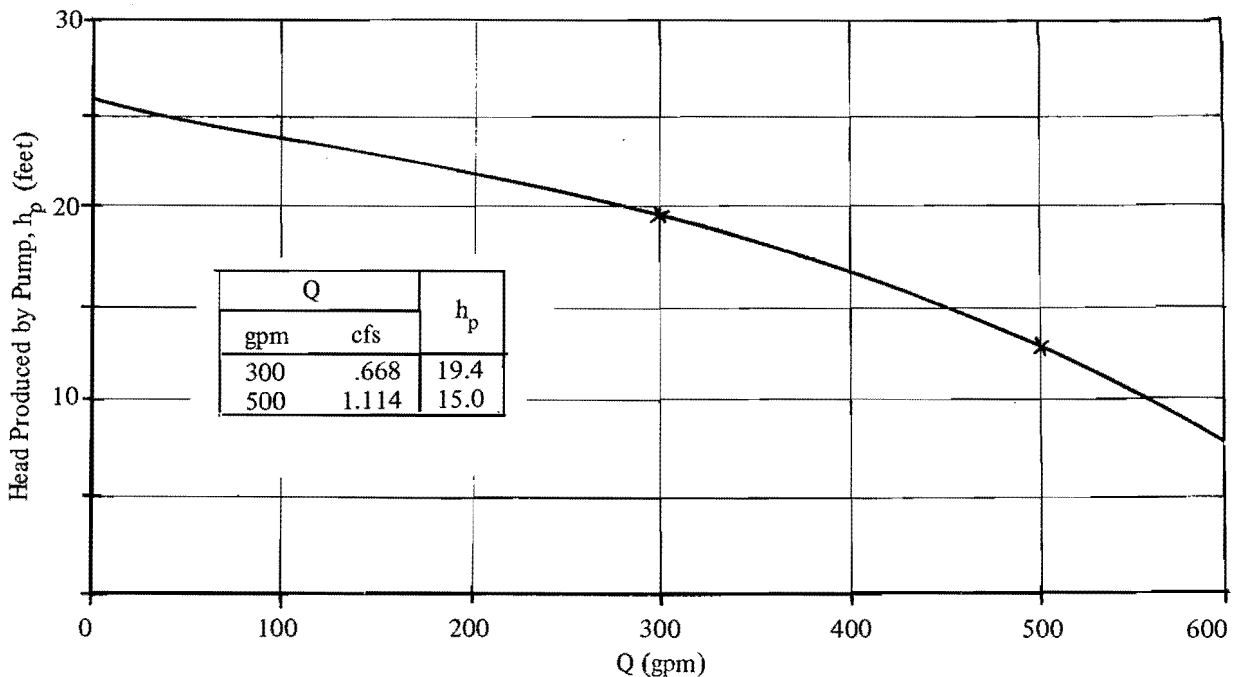

$$h_o = H_o - \frac{B}{4A} \dots \dots \dots (5-7)$$

Obviously the exponent of G (i.e. 2) is close to the value of a typical n in the exponential formula. Substituting Eq. 5-6 for h_p in Eq. 5-3 and moving the h_o 's to the other side of the equal sign gives

$$\sum K_i Q_i^{n_i} - \sum AG^2 = \Delta H + \sum h_o \dots (5-8)$$

Each term in Eq. 5-8 is similar to typical terms in the energy equation written around real loops. The only problem now is that for each pump an additional unknown G has been introduced. However, the transformation equation, Eq. 5-5, is a linear equation which relates G to the flow rate in the line containing the pump. By adding these additional equations to the system as many equations are produced as unknowns exist and a solution can be obtained. This new system of equations does converge rapidly to the solution by the linear theory method.


In summary then if pumps or reservoirs exist in a pipe network, a solution by the linear theory method is accomplished as follows:

1. J linear junction continuity equations are written.
2. L nonlinear energy equations are written around real natural loops of the system.

3. Additional pseudo loops are defined which connect supply reservoirs or reservoirs from which pumps obtain their supply by no flow pipes. Energy equations are written around these pseudo loops. These energy equations contain new unknown G_i for each pump in the network. The number of these pseudo loops must equal the difference between the number of unknown flow rates, i.e. N and (J + L).
4. As many additional linear equations of the form $G - Q = B/2A$ (Eq. 5-5) are written as pumps exist.
5. The nonlinear energy equations are linearized by defining coefficients K' of the Q's which are obtained by $K' = KQ(m)^{n-1}$ and coefficients K'_G for the G unknowns are obtained by $K'_G = AG$.
6. The resulting system is solved iteratively, adjusting the coefficients as described earlier to reflect the average of the flow from the past two solutions until convergence occurs.

Should any of the details involved in these steps be vague, following them through for a simple example will be helpful. Consider the seven-pipe, one loop network supplied by three identical pumps shown below. Each pump supply head according to the equation

$$h_p = -10.328 Q_p^2 + 2.823 Q_p + 22.289$$

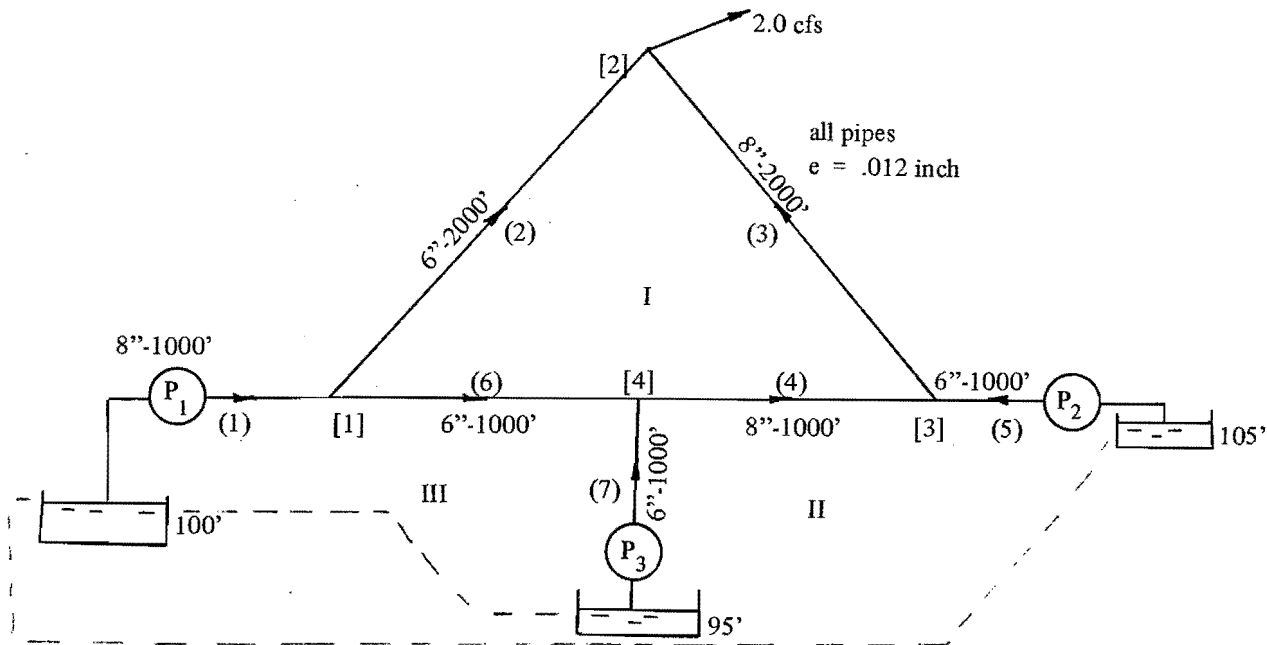

Since there are seven pipes in this network there will be seven unknown flow rates, plus three additional unknowns, i.e. the G's of Eq. 5-5 for the three pumps which supply flow. Consequently a total of 10 simultaneous equations are needed. Four of these equations are the junction continuity equations; three are from Eq. 5-5 relating the three G's to Q_1 , Q_5 , and Q_7 ; and consequently three energy equations are needed, one from the real loop and two from pseudo loops connecting pump reservoirs with no flow pipes. With the K's in the exponential formula approximately computed by the Hazen-Williams equation, these equations are:

$$\text{Pseudo Loop} \begin{cases} 6.86 Q_1^{1.85} + 6.86 Q_4^{1.85} - 27.8 Q_5^{1.85} \\ + 27.8 Q_6^{1.85} + 10.33 G_1 - 10.33 G_2 = -5 \\ 6.86 Q_1^{1.85} + 27.8 Q_6^{1.85} - 27.8 Q_7^{1.85} \\ + 10.33 G_1 - 10.33 G_3 = 5 \end{cases}$$

$$\text{Transformation Eq. 5-5} \begin{cases} -Q_1 + G_1 = -0.137 \\ -Q_5 + G_2 = -0.137 \\ -Q_7 + G_3 = -0.137 \end{cases}$$

$$\text{Continuity Equations} \begin{cases} -Q_1 + Q_2 + Q_6 = 0 \\ -Q_2 - Q_3 = -2.0 \\ Q_3 - Q_4 - Q_5 = 0 \\ Q_4 - Q_6 - Q_7 = 0 \end{cases}$$

$$\text{Real Loop} \begin{cases} 55.7 Q_2^{1.85} - 13.7 Q_3^{1.85} - 6.86 Q_4^{1.85} \\ -27.8 Q_6^{1.85} = 0 \end{cases}$$

In applying the linear theory method, the three nonlinear energy equations are linearized as described previously, and the resulting linear system solved. After three such iterative solutions of the linearized system the following solution results:

Pipe No.	1	2	3	4	5	6	7
Flow rate (cfs)	0.841	0.666	1.334	0.573	0.761	0.175	0.398
Head loss	3.15	17.63	15.46	1.50	11.42	0.674	3.24


Junction No.	1	2	3	4
Head (ft)	114.2	96.6	112.0	113.5
Pressure (psi)	49.5	41.9	48.5	49.2

Pump	Head (ft)
1	17.36
2	18.46
3	21.78

Example Problems which Include Pumps and Reservoirs

- Water supply comes from one pump and two reservoirs as shown in the sketch. How many pseudo loops need to be established? Write the system of equations whose solution provides the flow rate in

each pipe using symbols K and n in the energy equations. The pump characteristic curve is given by: $h_p = -10.33 Q_p^2 + 2.823 Q_p + 22.29$.

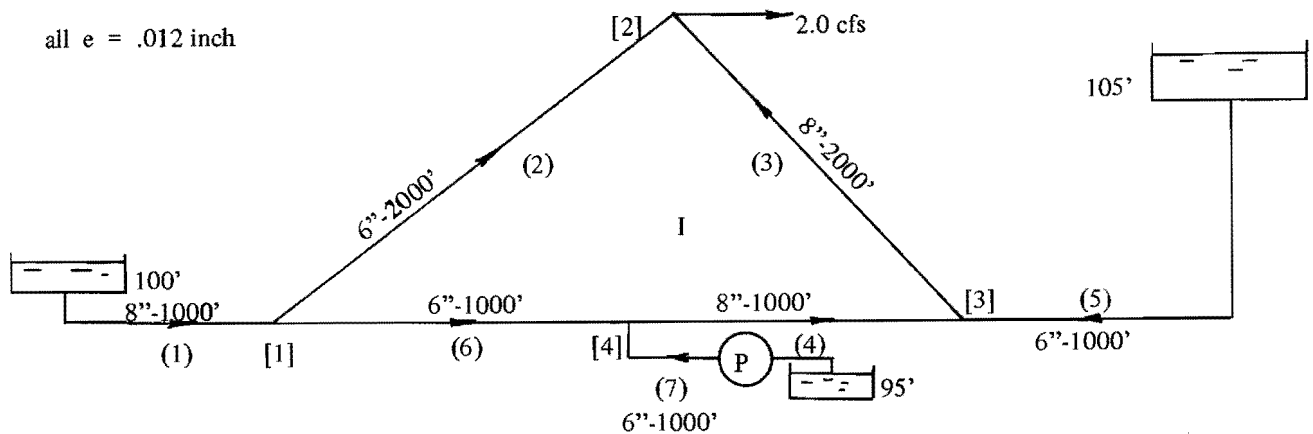

Solution:

Two pseudo loops are required. A possibility is one pseudo loop connecting the reservoirs supplying pipes 1 and 5 through pipes 1, 6, 4, and 5; and the other connects the pump reservoir and the reservoir supplying pipe 1 through pipes 1, 6, and 7.

$$\text{Continuity Equations} \begin{cases} -Q_1 + Q_2 + Q_6 = 0 \\ -Q_2 - Q_3 = -2.0 \\ Q_3 - Q_4 - Q_5 = 0 \\ Q_4 - Q_6 - Q_7 = 0 \end{cases}$$

$$\text{Real Loop} \quad \{ K_2 Q_2^{n_2} - K_3 Q_3^{n_3} - K_4 Q_4^{n_4} - K_6 Q_6^{n_6} = 0$$

$$\text{Pseudo Loop} \begin{cases} K_1 Q_1^{n_1} + K_6 Q_6^{n_6} + K_4 Q_4^{n_4} - K_5 Q_5^{n_5} = 5 \\ K_1 Q_1^{n_1} + K_6 Q_6^{n_6} - K_7 Q_7^{n_7} + 10.33 G_1 = -5 + 22.36 \end{cases}$$

$$\text{Transformation Equation} \quad \{ -Q_7 + G_1 = -0.137$$

2. Solve the network of problem 1 giving the flow rates in each pipe, the head loss in each pipe, and

the head and pressures at each junction, if the elevation of all junctions is at 80 ft.

Solution:

Pipe No.	1	2	3	4	5	6	7
Flow rate (cfs)	0.533	0.662	1.338	0.699	0.639	-0.129	0.828
Head loss (ft)	1.306	17.384	15.563	2.201	8.127	0.380	13.474

Junction No.	1	2	3	4
Elev. HGL	98.7	81.3	96.9	99.1
Pressure (psi)	8.10	0.56	7.32	8.28

3. Solve problem 1 if the pump is removed from pipeline 7 and the system is supplied by the three reservoirs.

not introduce an additional unknown G. The four continuity equations and the first two energy equations are identical to those given in the solution to problem 1. The final energy equation is,

$$K_1 Q_1^{n_1} + K_6 Q_6^{n_6} - K_7 Q_7^{n_7} = -5$$

Solution:

To solve this system there will only be seven unknowns instead of the eight as in problems 1 and 2, since the pump does

The solution by the linear theory method produces the following after three iterative solutions.

Pipe No.	1	2	3	4	5	6	7
Q (cfs)	0.979	0.680	1.320	0.527	0.793	0.300	0.227
h_f (ft)	4.23	18.32	15.16	1.28	12.39	1.88	1.11

4. Solve the single real loop pipe network supplied by the three pumps described just before these example problems by the Hazen-Williams equation assuming all pipes have a coefficient $C_{HW} = 120$.

Solution:

The equations are the same as previously given with the exception that the n's = 1.852, and the K's are constant and given by: $K_1 = 4.85$, $K_2 = 39.3$, $K_3 = 9.69$, $K_4 = 4.85$, $K_5 = 19.7$, $K_6 = 19.7$, $K_7 = 19.7$. The solution is

Pipe No.	1	2	3	4	5	6	7
Q (cfs)	0.784	0.681	1.313	0.564	0.751	0.257	0.368
h_f (ft)	3.09	19.3	16.1	1.68	11.6	1.59	3.09

5. Solve problem 3 using the Hazen-Williams formula with all $C_{HW} = 120$.

Solution:

Pipe No.	1	2	3	4	5	6	7
Q (cfs)	0.965	0.684	1.316	0.522	0.795	0.281	0.241
h_f (ft)	4.53	19.45	16.13	1.45	12.86	1.87	1.41

6. Obtain a solution to the 28 pipe network below by the linear theory method through use of the program whose input is described in Appendix C.

Pipe No.	C_{HW}	Pipe No.	C_{HW}
1	130	15	120
2	130	16	120
3	120	17	130
4	120	18	120
5	120	19	120
6	120	20	130
7	120	21	120
8	120	22	120
9	100	23	120
10	100	24	120
11	100	25	130
12	130	26	110
13	130	27	110
14	120	28	120

Pump Characteristics

$$\begin{aligned} \text{Pump No. 1 } h_p &= -0.417 Q_p^2 + 5.14 Q_p + 440.3 \\ \text{Pump No. 2 } h_p &= -0.378 Q_p^2 - 5.09 Q_p + 298.2 \\ \text{Pump No. 3 } h_p &= -2.51 Q_p^2 + 16.7 Q_p + 155.3 \end{aligned}$$

Solution:

One pseudo loop must be defined which connects the reservoirs from which pumps 1 and 2 obtain their supplies, giving 16 junction continuity equations and 12 energy equations. In addition three linear transformation equations are added for the three pumps in the network. The program described in Appendix C describes two forms of allowable input. Data for this problem for each form are given on pages 51 and 52, respectively.


Pipe No.	1	2	3	4	5	6	7	8	9	10	11
Q (cfs)	2.94	-1.76	-0.54	1.74	0.88	-2.55	-3.35	2.17	3.07	-0.44	-0.58
h_f (ft)	6.41	11.85	0.62	9.10	10.76	30.2	45.5	51.1	43.9	7.92	9.90

Pipe No.	12	13	14	15	16	17	18	19	20	21	22
Q (cfs)	0.64	0.73	1.32	1.18	0.80	-2.29	-0.17	0.09	3.27	2.45	-0.04
h_f (ft)	8.20	9.38	59.0	29.6	23.4	7.86	1.37	0.28	37.6	30.7	0.01

Pipe No.	23	24	25	26	27	28
Q (cfs)	1.15	-0.41	6.84	6.01	3.35	-2.39
h_f (ft)	6.90	6.91	30.6	0.91	0.31	8.43

Junction No.	1	2	3	4	5	6	7	8	9	10	11
Elev. HGL (ft)	1365	1359	1347	1348	1357	1346	1316	1270	1321	1329	1339

Junction No.	12	13	14	15	16
Elev. HGL (ft)	1347	1392	1354	1361	1354

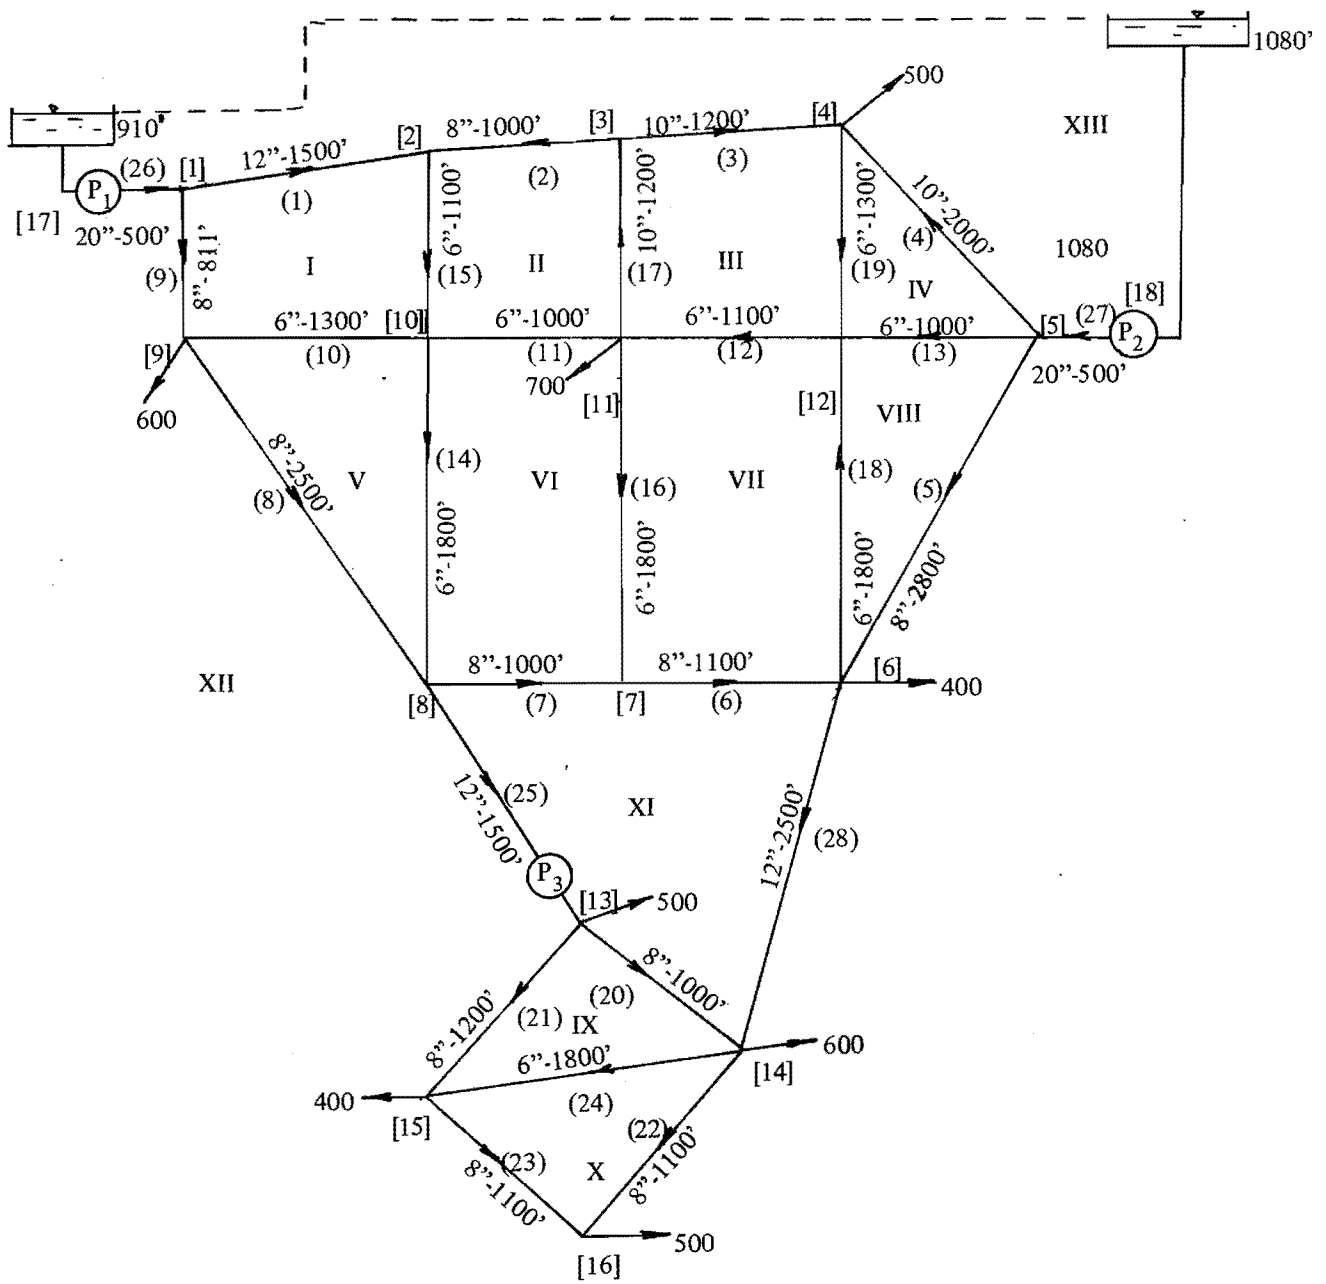

Alternate 1

28	16	11	1	8	2	0	1	1	1	2	1		
3	1	0	.1	62.4									
26	27	25											
5.568	455.97			7.0156		455.81		7.795	455.		910.		
2.004	280.5			2.3385		284.25		3.341	277.		1080.		
4.009	182.			4.454		180.		4.9	177.				
990.	1022.		1038.			1057.		1080.	1047.		1025.		1011.
987.	1015.		1030.			1051.		1100.	1085.		1075.		1110.
12.	8.		10.			10.		8.	8.		8.		8.
8.	6.		6.			6.		6.	6.		6.		6.
10.	6.		6.			8.		8.	8.		8.		6.
12.	20.		20.			12.							
1500.	1000.		1200.			2000.		2800.	1100.		1000.		2500.
811.	1300.		1000.			1100.		1000.	1800.		1100.		1800.
1200.	1800.		1300.			1000.		1200.	1100.		1100.		1800.
1500.	500.		500.			2500.							
130.	130.		120.			120.		120.	120.		120.		120.
100.	100.		100.			130.		130.	120.		120.		120.
130.	120.		120.			130.		120.	120.		120.		120.
130.	110.		110.			120.							
0	3	-26	1	9									
0	3	-1	-2	15									
0	3	2	3	-17									
1	3	-3	-4	19									
500.													
0	4	-27	4	13		5							
1	4	-6	18	-5		28							
400.													
0	3	-16	6	-7									
0	4	-8	-14	7		25							
1	3	-9	10	8									
600.													
0	4	-10	-15	11		14							
1	4	-11	17	16		-12							
700.													
0	4	-19	-18	-13		12							
1	3	20	21	-25									
500.													
1	4	-20	24	22		-28							
600.													
1	3	-21	23	-24									
400.													
1	2	-22	-23										
500.													
4	1	15	-10	-9									
4	-2	-17	-11	-15									
4	3	12	12	17									
3	-4	13	-19										
3	10	13	-8										
4	11	16	-7	-14									
4	-12	-18	-6	-16									
3	-13	5	18										
3	20	24	-21										
3	-24	22	-23										
5	7	6	28	-20		-25							
6	27	4	-3	2		-1		-26					

Alternate 2

28	11	1	8	2	0	1	1	1	2	1		
3	1	0	.1	62.4								
28	27	25										
5,568	455.97		7.0156	455.81		7.795	455.		910.			
2,004	286.5		2,3385	284.25		3.341	277.		1080.			
4,009	182.		4,454	180.		4.9	177.					
1												
1	12.	1500.		130.	1	.	2	.	1	-12		
2	8.	1000.		130.	3	.	2	.	-2	12		
3	10.	1200.		120.	3	.	4	500.	3	-12		
4	10.	2000.		120.	5	.	4	0	-4	12		
5	8.	2800.		120.	5	.	6	-400.	8			
6	8.	1100.		120.	7	.	6	0	-7	11		
7	8.	1000.		120.	8	.	7	0	-6	11		
8	8.	2500.		120.	9	.	8	0	-5			
9	8.	811.		100.	1	.	9	600.	-1			
10	6.	1300.		100.	9	.	10	0	-1	5		
11	6.	1000.		100.	10	.	11	700.	-2	6		
12	6.	1100.		130.	12	.	11	0	3	-7		
13	6.	1000.		130.	5	.	12	0	4	-8		
14	6.	1800.		120.	10	.	8	0	5	-6		
15	6.	1100.		120.	2	.	10	0	1	-2		
16	6.	1800.		120.	11	.	7	0	6	-7		
17	10.	1200.		130.	11	.	3	0	-2	3		
18	6.	1800.		120.	6	.	12	0	-7	8		
19	6.	1300.		120.	4	.	12	0	3	-4		
20	8.	1000.		130.	13	.	14	600.	9	-11		
21	8.	1200.		120.	13	.	15	400.	-9			
22	8.	1100.		120.	14	.	16	500.	10			
23	8.	1100.		120.	15	.	16	0	-10			
24	6.	1800.		120.	14	.	15	0	9	-10		
25	12.	1500.		130.	8	.	13	500.	-11			
26	20.	500.		110.	.	.	1	0	-12			
27	20.	500.		110.	.	.	5	0	12			
28	12.	2500.		120.	6	.	14	0	11			
990.	1022.		1038.	1057.	1080.		1047.	1025.	1011.			
987.	1015.		1030.	1051.	1100.		1085.	1075.	1110.			

7. What are the flow rates and head losses, as well as the elevation of the HGL in the network of problem 6 if pipeline 28 is taken out of operation. If the elevation at junctions are as given below in one of the tables of solutions what is the pressure at each junction. The solution should be obtained by the computer program described in Appendix C.

With pipeline 28 removed a single line connects two separate networks, each of which might be solved as separate problems. Obviously, if the analysis were being done by hand two separate analyses would be used and subsequently tied together. With the computer, however, it is more convenient to consider only one network containing 27 pipes, 16 junctions, and 10 real loops. The additional energy equation comes from defining a pseudo loop between the reservoirs from which pumps 1 and 2 obtain their supply. Pump 3 is a booster pump and therefore no pseudo loop needs to include it, but it adds an additional unknown G_3 giving a total of 30 unknowns and 30 simultaneous equations to solve by the linear theory method. The answers are:

Solution:

Pipe No.	1	2	3	4	5	6	7	8	9	10	11
Q (cfs)	2.92	-1.90	-0.19	1.60	1.43	-1.18	-1.90	1.60	2.62	-0.31	-0.25
h_f (ft)	6.35	13.76	0.09	7.83	26.3	7.28	15.89	28.79	32.88	4.06	2.09

Pipe No.	12	13	14	15	16	17	18	19	20	21	22
Q (cfs)	0.43	0.78	0.96	1.02	0.72	-2.09	-0.65	0.30	1.83	1.52	0.54
h_f (ft)	3.95	10.60	32.85	22.47	19.04	6.63	15.71	2.77	12.73	12.57	1.72


Pipe No.	23	24	25	26	27
Q (cfs)	0.57	-0.06	4.45	5.55	3.81
h_f (ft)	1.89	0.16	13.84	0.78	0.39

Junction No.	1	2	3	4	5	6	7	8	9	10	11
Elev. (ft)	990	1022	1038	1057	1080	1047	1025	1011	987	1015	1030
HGL (ft)	1365	1359	1345	1345	1353	1327	1319	1303	1332	1336	1338
Pressure (psi)	163	146	133	125	118	121	128	127	150	139	134

Junction No.	12	13	14	15	16
Elev. (ft)	1051	1100	1085	1075	1110
HGL (ft)	1342	1470	1457	1458	1455
Pressure (psi)	126	160	161	166	150

8. Solve the 51 pipe networks shown below using the computer program in Appendix C. All pipes have a wall roughness $e = .012$ inch. Three points along the

pump characteristics are $Q_{p1} = 0$, $h_{p1} = 196'$; $Q_{p2} = 20.43$ cfs, $h_{p2} = 151.37'$; $Q_{p3} = 25.0$ cfs, $h_{p3} = 44.0'$.

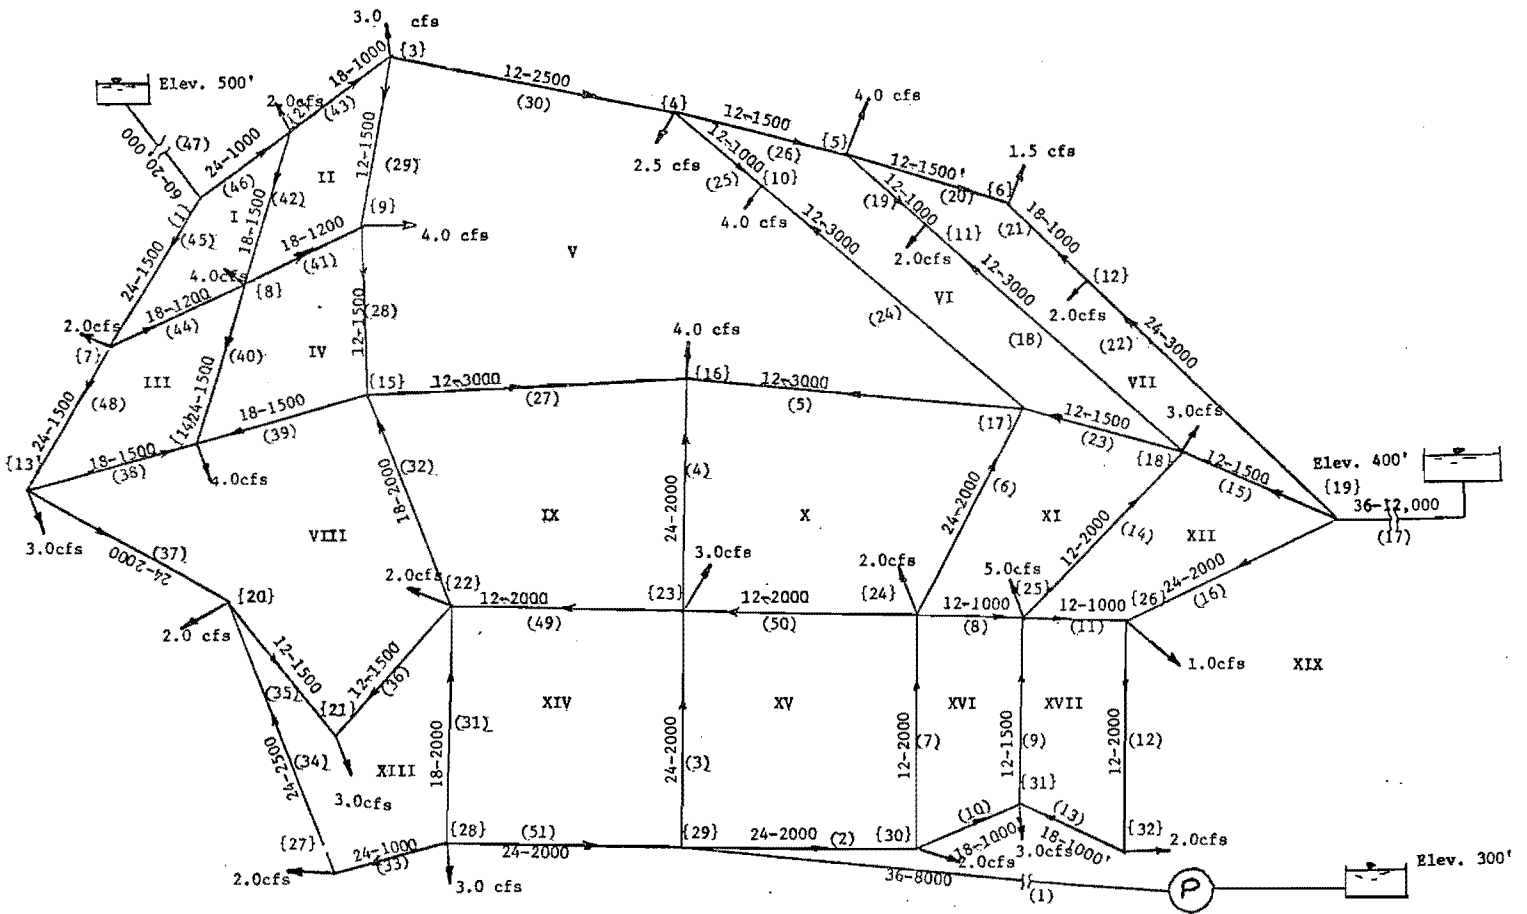

Solution:

Pipe No.	1	2	3	4	5	6	7	8	9	10	11	12	13
Q (cfs)	20.4	20.5	10.5	4.92	-4.16	2.76	4.29	4.69	4.83	14.18	2.76	-4.35	-6.35
h_f (ft)	5.58	11.31	3.03	0.70	26.58	0.23	18.77	11.19	17.81	12.15	3.96	19.28	2.50

Pipe No.	14	15	16	17	18	19	20	21	22	23	24	25	26
Q (cfs)	1.76	-1.47	-6.11	-3.02	1.60	0.40	-1.06	2.50	4.56	-4.31	2.62	1.39	3.34
h_f (ft)	3.28	1.74	1.06	0.22	4.11	0.10	0.93	0.43	0.91	14.23	10.67	1.04	8.61

Pipe No.	27	28	29	30	31	32	33	34	35	36	37	38	39
Q (cfs)	3.24	3.19	2.63	7.23	-2.73	-8.32	-10.82	-12.82	3.02	0.98	17.83	-0.73	-8.37
h_f (ft)	16.27	7.89	5.39	65.76	0.97	8.50	1.61	5.63	7.07	0.80	8.62	0.06	6.45

Pipe No.	40	41	42	43	44	45	46	47	48	49	50	51
Q (cfs)	12.10	4.57	12.33	12.85	8.34	30.45	27.18	57.63	20.11	-2.61	-5.16	10.55
h_f (ft)	3.02	1.58	13.82	10.01	5.12	18.60	9.90	7.77	8.19	7.08	27.05	3.07

This solution took seven iterations to meet the error requirement that the sum of flow rate changes be less than .01 and required 11.7 seconds of execution time on a UNIVAC 1108 computer.

9. Solve the 65 pipe network below for the flow rates in all pipes, the head losses in all pipes, the elevation of the HGL at all junctions, and the pressure at all junctions. All pipes have $e = 0.0102$ inch. Three values of flow rate and head loss for the five pumps in the network are:

Pump No.	Point 1		Point 2		Point 3	
	Q_p	h_p	Q_p	h_p	Q_p	h_p
1	8.	200.	11.	180	16.	80.
2	5.	180.	7.5	150.	10.	50.
3	4.	200.	6.	180.	10.	80.
4	4.	250.	6.	210.	8.	150.
5	2.	50.	4.	40.	6.	20.

The elevations of the junctions are:

Junction No.	Elev. ft	Junction No.	Elev. ft	Junction No.	Elev. ft	Junction No.	Elev. ft	Junction No.	Elev. ft
1	150	7	180	13	180	19	170	25	140
2	150	8	190	14	160	20	180	26	130
3	160	9	200	15	150	21	170	27	130
4	150	10	180	16	150	22	160	28	130
5	165	11	190	17	140	23	150	29	125
6	160	12	190	18	150	24	150		

Solution:

Pipe No.	1	2	3	4	5	6	7	8	9	10	11	12
Q (cfs)	11.61	3.18	2.18	1.50	2.22	-1.19	0.30	-0.68	0.49	-1.43	2.63	2.06
h_f (ft)	82.15	14.20	9.23	23.43	26.31	2.87	0.18	3.60	0.73	3.42	7.68	11.10


Pipe No.	13	14	15	16	17	18	19	20	21	22	23	24
Q (cfs)	10.00	0.93	1.49	1.89	1.54	1.47	2.75	2.71	-0.26	-1.45	-1.77	-1.71
h_f (ft)	25.67	1.89	5.33	11.07	3.78	3.44	7.22	7.04	0.18	4.21	4.03	5.74

Pipe No.	25	26	27	28	29	30	31	32	33	34	35	36
Q (cfs)	0.58	2.09	-2.10	0.07	1.18	2.73	1.14	-0.92	4.72	3.51	0.71	-1.95
h_f (ft)	1.71	19.84	18.13	0.02	3.26	21.37	20.22	1.88	28.18	28.34	8.01	22.30

Pipe No.	37	38	39	40	41	42	43	44	45	46	47	48
Q (cfs)	-2.72	0.88	-0.43	-3.72	1.05	-1.00	-0.86	-0.50	-0.40	1.45	1.43	0.35
h_f (ft)	14.28	0.85	0.13	21.31	2.40	4.25	1.63	1.72	0.90	4.75	4.87	0.79

Pipe No.	49	50	51	52	53	54	55	56	57	58	59	60
Q (cfs)	2.55	1.45	4.25	9.03	1.24	-3.02	3.27	-1.21	-0.22	-1.22	0.92	-0.80
h_f (ft)	17.59	4.21	13.38	26.61	3.32	24.63	18.65	1.55	0.08	3.78	1.17	1.15

Pipe No.	61	62	63	64	65
Q (cfs)	1.80	6.25	-5.14	2.80	7.00
h_f (ft)	4.23	12.87	19.47	16.80	23.88

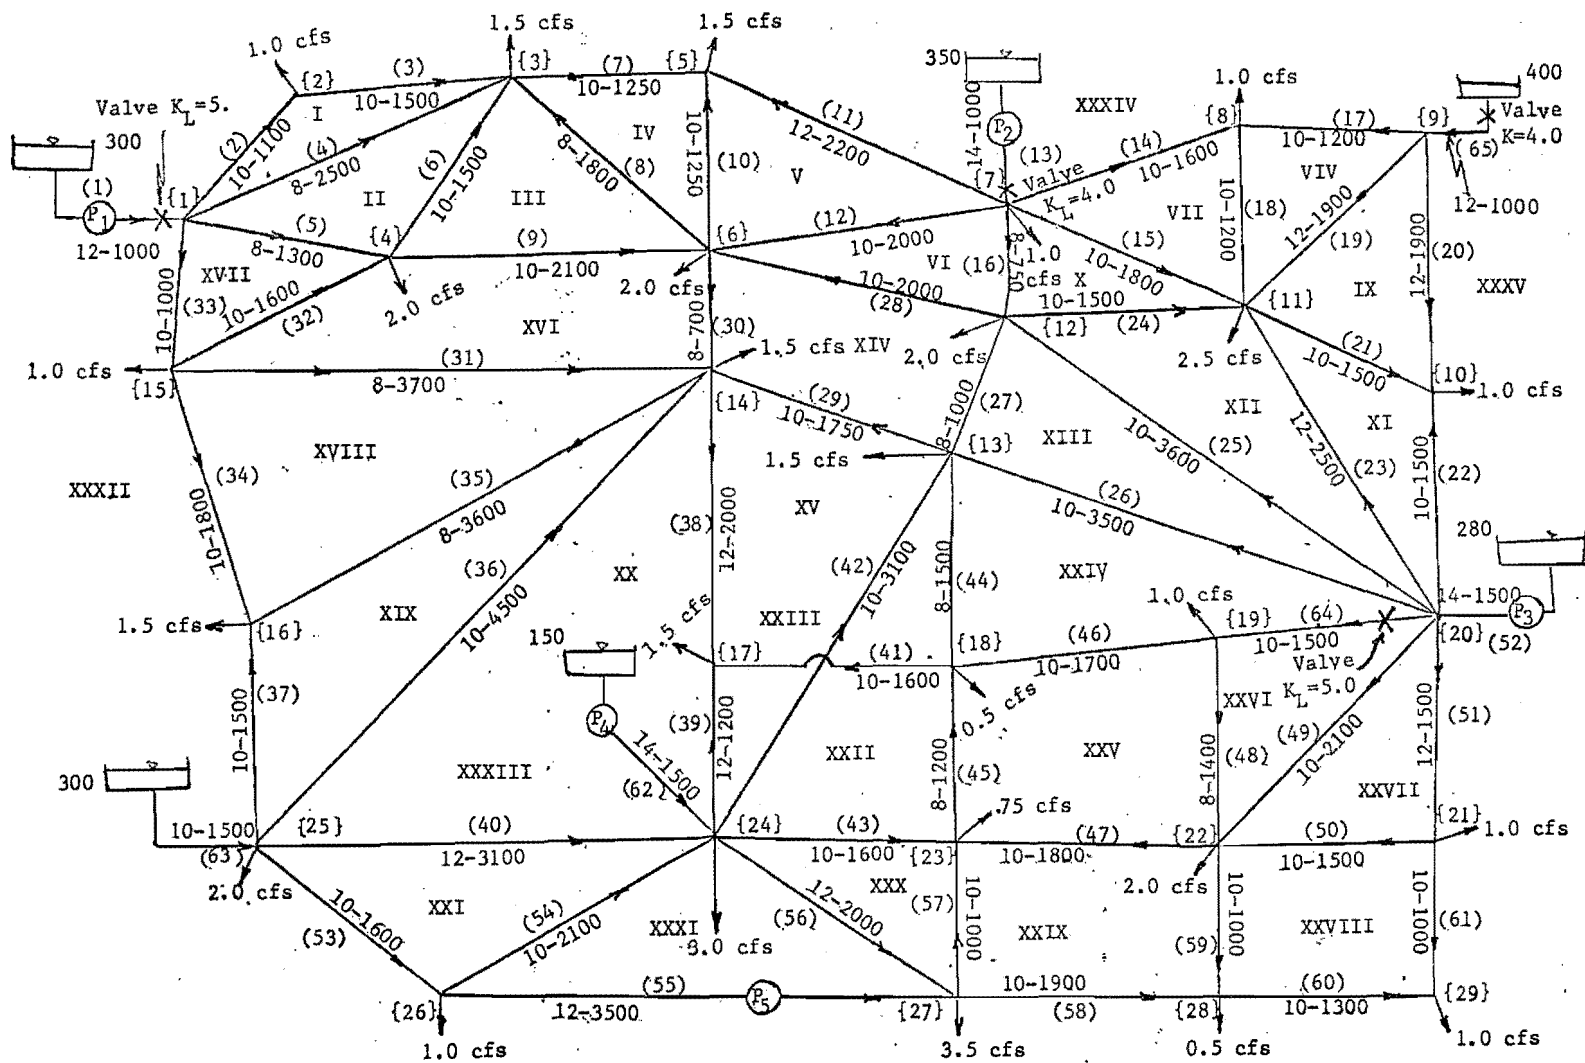

Junction No.	1	2	3	4	5	6	7	8	9	10	11
HGL (ft)	390.2	376.0	366.7	363.9	366.6	363.1	374.2	372.3	376.1	369.1	368.9
Pressure (psi)	104.1	97.9	89.6	92.7	87.3	88.0	84.2	79.0	76.3	81.9	77.5

Junction No.	12	13	14	15	16	17	18	19	20	21	22
HGL (ft)	363.2	345.0	341.8	362.0	333.8	340.9	343.3	348.1	364.9	351.5	347.3
Pressure (psi)	75.0	71.5	78.8	91.9	79.6	87.1	83.8	77.2	80.1	78.65	81.2

Junction No.	23	24	25	26	27	28	29
HGL (ft)	342.4	340.8	319.5	316.1	342.3	346.1	347.3
Pressure (psi)	83.4	82.7	77.8	80.7	92.0	93.6	96.3

Using the program described in Appendix C, the solution was obtained in six iterations with a sum of changes in flow rate equal to .019. The solution requires 23.3 seconds of execution time on a UNIVAC 1108.


10. Determine the flow rates and head losses in each of the 63 pipes of the network shown below. The diameter of each pipe is given in centimeters and the length of each pipe is given in meters. Thus pipe number 1 is 16 cm in diameter and has a length of 1500 m. All 63 pipes of the network have a wall roughness of 0.026 cm. The network is supplied by 2 reservoirs without pumps and 4 pumps obtaining their water from the reservoir as shown in the sketch. A booster pump exists in pipe 43 also. The water surface elevations are as given on the sketch in meters and the pump characteristic curves are defined by the data for three points as given below.

Pump No.	Point 1		Point 2		Point 3	
	Q (cms)	h_p (m)	Q (cms)	h_p (m)	Q (cms)	h_p (m)
1	.03	84.	.045	70.	.06	52.
2	.06	45.	.105	39.	.15	31.
3	.06	45.	.105	39.	.15	31.
4	.06	45.	.105	39.	.15	31.
5	.03	9.0	.045	7.5	.06	5.5

The elevation of the junctions are as given below. What is the elevation of the HGL at each junction, the head in meters, and the pressure in Newtons per square meter at each junction?

Junction No.	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
Elev. (m)	300	250	255	260	280	200	340	270	330	360	260	420	270	240	260	260	260

Junction No.	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33
Elev. (m)	280	270	300	250	260	200	160	160	70	70	40	20	260	200	-50	-60

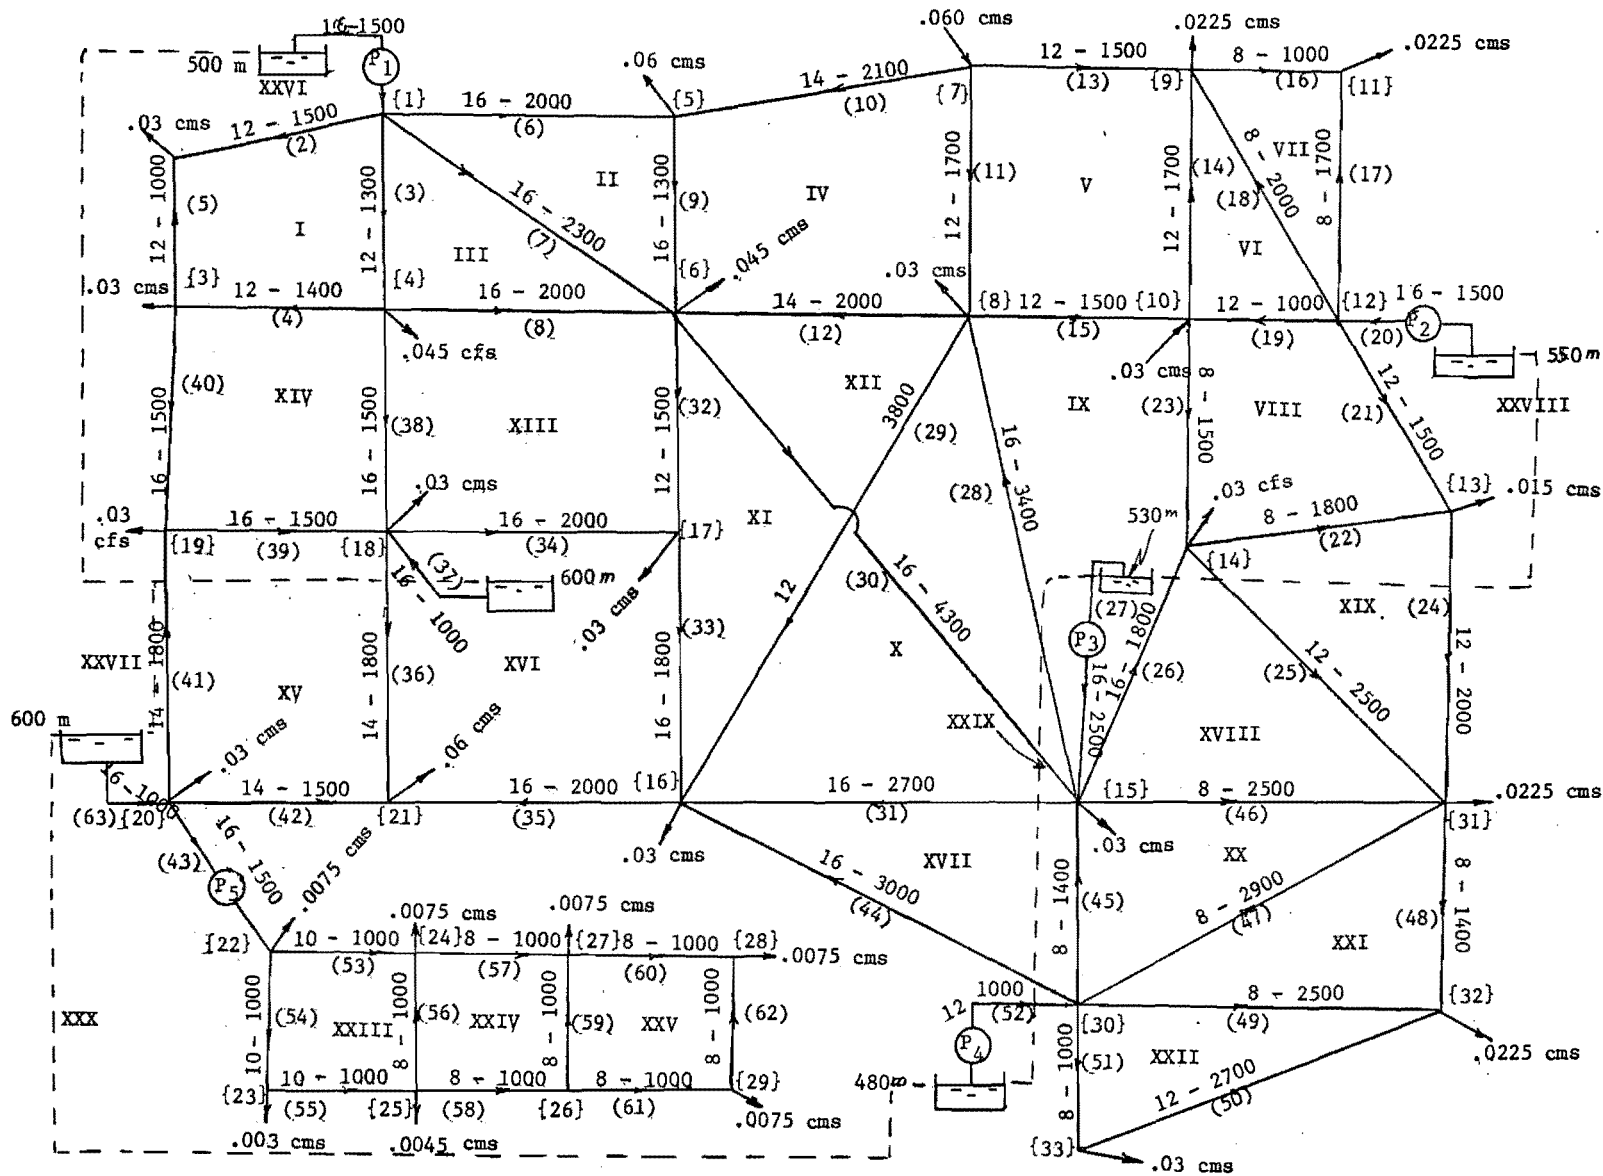

Answer

Pipe No.	Flow Rate (cms)	Head Loss (m)
1	.0869	201.1
2	.0208	53.6
3	.0132	19.1
4	.0153	27.4
5	.0092	7.16
6	.0274	27.5
7	.0254	27.3
8	.0148	8.3
9	-.0027	0.22
10	.0299	68.4
11	.0212	63.1
12	.0081	5.11
13	.0089	10.1
14	.0164	38.1
15	.0273	91.0
16	.0107	78.9
17	.0118	165.5
18	.0078	86.5
19	.0243	48.4
20	.0791	166.9
21	.0351	150.0
22	-.0035	16.3
23	.0106	117.7
24	.0166	45.8
25	.0119	29.7
26	.0277	25.3
27	.0805	287.6
28	-.0043	1.37
29	.0061	12.52
30	-.0065	3.74
31	.0148	11.16
32	.0071	6.62
33	.0046	0.80
34	.0274	27.6
35	.0094	3.5
36	.0219	31.8
37	.1306	297.8
38	-.0214	12.7
39	-.0299	24.4
40	-.0238	15.7
41	.0239	37.8
42	.0287	45.2
43	.0450	54.6
44	.0139	11.1
45	-.0002	0.11
46	.0056	55.0
47	.0051	54.9
48	.0167	267.5
49	.0137	322.4
50	-.0078	14.3
51	.0222	336.7
52	.0547	240.7
53	.0210	94.2
54	.0165	58.1

Pipe No.	Flow Rate (cms)	Head Loss (m)
55	.0135	39.1
56	-.0020	2.97
57	.0116	93.0
58	.0109	82.9
59	.0031	7.07
60	.0072	36.2
61	.0078	43.2
62	.0003	0.12
63	.1276	284.5

Junction	HGL (m)	Head (m)	Pressure (N/cm ²)
1	308.6	8.6	8.43
2	255.0	5.0	4.92
3	262.2	7.2	7.03
4	289.6	29.6	29.0
5	281.1	1.12	1.09
6	281.3	1.34	1.31
7	349.5	9.5	9.31
8	286.4	16.4	16.1
9	339.4	3.4	9.19
10	377.5	17.5	17.1
11	260.4	0.45	0.44
12	425.9	5.93	5.81
13	275.9	5.88	5.76
14	259.6	15.6	15.3
15	284.9	24.9	24.4
16	273.8	13.8	13.5
17	274.6	14.6	14.3
18	302.2	22.2	21.7
19	277.7	7.7	7.56
20	315.5	15.5	15.2
21	270.3	20.3	19.9
22	268.4	8.4	8.25
23	210.4	10.4	10.2
24	174.2	14.2	14.0
25	171.3	11.3	11.0
26	88.3	18.3	17.9
27	81.3	11.3	11.0
28	45.1	5.1	5.0
29	45.2	25.2	24.7
30	284.8	24.8	24.4
31	230.1	30.1	29.5
32	-37.5	12.5	12.2
33	-51.8	8.2	8.0

CHAPTER VI

NEWTON-RAPHSON METHOD

Introduction

In Chapter II the Newton-Raphson method (Eq. 2-17), one of the most widely used methods for solving implicit or nonlinear equations, was described. Most books dealing with numerical methods or numerical analysis provide additional treatment of the Newton-Raphson method. It is widely used because it converges rapidly to the solution. In review of the discussion of the Newton-Raphson method in Chapter II, a solution to the equation $F(x) = 0$ is obtained by the iterative formula $x^{(m+1)} = x^{(m)} - F(x^{(m)})/F'(x^{(m)})$. Mathematically the convergence of the Newton-Raphson method can be examined by using Taylor's formula to evaluate $F(x) = 0$ from the function at some iterative value $x^{(m)}$; or

$$0 = F(x) = F(x^{(m)}) + (x - x^{(m)}) F'(x^{(m)}) + (x - x^{(m)})^2 F''(\xi)/2$$

In which $\xi^{(m)}$ lies between $x^{(m)}$ and x . Solving for x gives

$$x = x^{(m)} - \frac{F(x^{(m)})}{F'(x^{(m)})} - (x - x^{(m)})^2 \frac{F''(\xi)}{2F'(x^{(m)})}$$

or

$$x = x^{(m+1)} - (x - x^{(m)})^2 \frac{F''(\xi)}{2F'(x^{(m)})}$$

Thus the error of the $(m+1)^{\text{th}}$ iterate is proportional to the square of the error in the m^{th} iterate. Convergence of this type is called quadratic convergence and in simple terms it means that each subsequent error reduction is proportional to the square of the previous error. Thus if the initial guess is 20 percent (i.e. .2) in error, successive iterations will produce errors of 4 percent, 1.6 percent, .026 percent, etc.

The Newton-Raphson method may be used to solve any of the three sets of equations describing flow in pipe networks which are discussed in Chapter IV, i.e. the equations considering (1) the flow rate in each pipe unknown, (2) the head at each junction unknown, or (3) the corrective flow rate around each loop unknown. The Newton-Raphson method does not converge as rapidly as the linear theory method does when solving the equations with the flow rate in each pipe as the unknowns. It also requires an initial guess to the solution, which is not needed by the linear theory method, and consequently

the use of the Newton-Raphson method is not recommended in solving the Q-equations. Since the other two systems of equations are fewer in number than the Q-equations, the Newton-Raphson method is competitive, and for large systems of equations requires less computer storage not only because of the fact that few simultaneous equations need to be solved, but also because less storage is needed for a given number of equations.

Before describing how the Newton-Raphson method can be used to solve either of the latter two systems of equations, it is necessary to extend this method from a single equation to a system of simultaneous equations. Notationally this extension is very simple. The iterative Newton-Raphson formula for a system of equations is,

$$\vec{x}^{(m+1)} = \vec{x}^{(m)} - D^{-1} \vec{F}(x^m) \quad \dots \quad (6-1)$$

The unknown vectors \vec{x} and \vec{F} replaces the single variable x and function F and the inverse of the Jacobian, D^{-1} , replaces $1/dF/dx$ in the Newton-Raphson formula for solving a single equation. If solving the equation with the heads as the unknowns (i.e. the H-equations) the vector \vec{x} becomes the vector \vec{H} and if solving the equations containing the corrective loop flow rates (i.e. the ΔQ -equations) \vec{x} becomes $\vec{\Delta Q}$. The individual elements for \vec{H} and $\vec{\Delta Q}$ are

$$\vec{H} = \begin{bmatrix} H_1 \\ H_2 \\ \vdots \\ H \end{bmatrix} \quad \begin{array}{l} \text{with the known} \\ \text{H omitted from} \\ \text{the vector} \end{array} \quad \text{or} \quad \vec{\Delta Q} = \begin{bmatrix} \Delta Q_1 \\ \Delta Q_2 \\ \vdots \\ \Delta Q_L \end{bmatrix}$$

The Jacobian matrix D consists of derivative elements, individual rows of which are derivatives of that particular functional equation with respect to the variables making up the column headings. For the head equation the Jacobian is,

$$D = \begin{bmatrix} \frac{\partial F_1}{\partial H_1} & \frac{\partial F_1}{\partial H_2} & \dots & \frac{\partial F_1}{\partial H_J} \\ \frac{\partial F_2}{\partial H_1} & \frac{\partial F_2}{\partial H_2} & \dots & \frac{\partial F_2}{\partial H_J} \\ \vdots & \vdots & \ddots & \vdots \\ \frac{\partial F_J}{\partial H_1} & \frac{\partial F_J}{\partial H_2} & \dots & \frac{\partial F_J}{\partial H_J} \end{bmatrix}$$

in which the row and column corresponding to the known head are omitted.


The last term $D^{-1}\vec{F}$ in Eq. 6-1 contains the inverse of D, since division by a matrix is undefined. However in application of the Newton-Raphson method the inverse is never obtained and premultiplied by \vec{F} as Eq. 6-1 implies. Rather the solution vector \vec{z} of the linear system $D\vec{z} = \vec{F}$ is subtracted from the previous iterative vector of unknowns. Selecting the H-equations in the following notation, the Newton-Raphson iterative formula in practice becomes

$$\vec{H}^{(m+1)} = \vec{H}^{(m)} - \vec{z}^{(m)} \dots \dots \dots (6-2)$$

The equivalence of Eqs 6-2 and 6-1 is evident since $\vec{z} = D^{-1}\vec{F}$. Since fewer computations are needed to solve the linear system $D\vec{z} = \vec{F}$ than to find the inverse D^{-1} obviously Eq. 6-2 is the form of the Newton-Raphson method used in practice. The Newton-Raphson method, therefore, obtains the solution to a system of nonlinear equations by iteratively solving a system of linear equations. In this sense it is similar to the linear theory method and can call on the same algorithm for solving a linear system of equations as does the linear theory method. It turns out, however, that the Jacobian is a symmetric matrix, and consequently an algorithm for solving a linear system of equations with a symmetric matrix might preferably be used for greater computational efficiency. The Newton-Raphson method does require a reasonably accurate initialization or it may not converge.

Head-equation

The Newton-Raphson method will be illustrated in detail by using it to solve the H-equations for the simple one loop network shown below. To simplify the problem the Hazen-Williams equation will be used so that K and n in the exponential formula are constant.

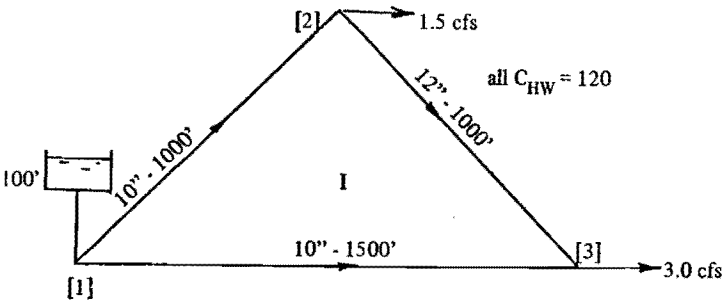

The values of K for the three pipes are: $K_{12} = 1.622$, $K_{23} = 0.667$, $K_{13} = 2.432$. The head at junction 1 is known and equal to 100 ft. The heads H_2 and H_3 at junctions 2 and 3 are unknown and to be determined. To determine these two unknowns the H-equations will be written at junctions 2 and 3 (see Eq. 4-17 for the nature of these equations), giving

$$F_2 = - \left(\frac{H_1 - H_2}{K_{12}} \right)^{1/n_{12}} + \left(\frac{H_2 - H_3}{K_{23}} \right)^{1/n_{23}} + 1.5 = 0$$

$$F_3 = - \left(\frac{H_2 - H_3}{K_{23}} \right)^{1/n_{23}} - \left(\frac{H_1 - H_3}{K_{13}} \right)^{1/n_{13}} + 3.0 = 0$$

The equation at junction 1 is not written since $H_1 = 100$ ft is known, but might have been used in place of one of the above equations. Upon substituting known values for H_1 and the K's and n's those equations become:

$$F_2 = - \left(\frac{100 - H_2}{1.622} \right)^{.54} + \left(\frac{H_2 - H_3}{.667} \right)^{.54} + 1.5 = 0$$

$$F_3 = - \left(\frac{H_2 - H_3}{.667} \right)^{.54} - \left(\frac{100 - H_3}{2.432} \right)^{.54} + 3.0 = 0$$

The Jacobian D =
$$\begin{vmatrix} \frac{\partial F_2}{\partial H_2} & \frac{\partial F_2}{\partial H_3} \\ \frac{\partial F_3}{\partial H_2} & \frac{\partial F_3}{\partial H_3} \end{vmatrix}$$

has the following elements

$$\frac{\partial F_2}{\partial H_2} = \frac{.54}{K_{12}} \left(\frac{H_1 - H_2}{K_{12}} \right)^{\frac{1}{n_{12}} - 1} + \frac{.54}{K_{23}} \left(\frac{H_2 - H_3}{K_{23}} \right)^{\frac{1}{n_{23}} - 1}$$

$$= .333 \left(\frac{100 - H_2}{1.622} \right)^{-.46} + .809 \left(\frac{H_2 - H_3}{.667} \right)^{-.46}$$

$$\frac{\partial F_2}{\partial H_3} = - \frac{.54}{K_{23}} \left(\frac{H_2 - H_3}{K_{23}} \right)^{\frac{1}{n_{23}} - 1} = .809 \left(\frac{H_2 - H_3}{.667} \right)^{-.46}$$

$$\frac{\partial F_3}{\partial H_2} = - \frac{.54}{K_{23}} \left(\frac{H_2 - H_3}{K_{23}} \right)^{\frac{1}{n_{23}} - 1} = .809 \left(\frac{H_2 - H_3}{.667} \right)^{-.46}$$

$$\frac{\partial F_3}{\partial H_3} = \frac{.54}{K_{23}} \left(\frac{H_2 - H_3}{K_{23}} \right)^{\frac{1}{n_{23}} - 1} + \frac{.54}{K_{13}} \left(\frac{H_1 - H_3}{K_{13}} \right)^{\frac{1}{n_{13}} - 1}$$

$$= .809 \left(\frac{H_2 - H_3}{.667} \right)^{-.46} + .222 \left(\frac{100 - H_3}{2.432} \right)^{-.46}$$

If the initialization $\vec{H} = \begin{vmatrix} H_2 \\ H_3 \end{vmatrix} = \begin{vmatrix} 95 \\ 85 \end{vmatrix}$ is used by the

Newton-Raphson equation, Eq. 6-2, the solution to

$$\begin{vmatrix} .431 & -.233 \\ -.233 & .329 \end{vmatrix} \begin{vmatrix} z_2 \\ z_3 \end{vmatrix} = \begin{vmatrix} 3.98 \\ -3.98 \end{vmatrix}$$

is $z_2 = 4.34$ and $z_3 = -9.04$. When these are subtracted from the initial guesses $H_2 = 90.66$, $H_3 = 94.04$. After completing six iterations the solution is: $H_2 = 91.45$ ft and $H_3 = 90.84$ ft. Using these heads the flow rates are computed as: $Q_{12} = 2.454$ cfs, $Q_{23} = 0.954$ cfs, and $Q_{13} = 2.046$ cfs.

A simple version of a FORTRAN computer program for solving the H-equations by the Newton-Raphson method is listed below.

```

      INTEGER N1(50),N2(50),NN(45),JB(45,7),JC(45)
      REAL H(45),D(50),Q(50),CHW(50),QJ(45),K(45),F(45,46),
      $V(2)
C NP--NO. PIPES, NJ--NO. OF JUNCTIONS, KNOWN--
C JUNCTION NO. OF KNOWN HEAD, MAX--MAX. NO. OF
C JUNCTIONS ALLOWED, ERR--ERROR PARAMETER
98 READ(5,100,END=99) NP,NJ,KNOWN,MAX,ERR
100 FORMAT(4I5,4F10.5)
      DO 2 I=1,NP
C N1(I) JUNCTION NO. FROM WHICH FLOW IN PIPE COMES
C N2(I) JUNCTION NO. TO WHICH FLOW IN PIPE GOES
C D(I)--DIAMETER OF PIPE IN INCHES
C CHW(I)--HAZEN-WILLIAMS COEFFICIENT FOR PIPE
C L--LENGTH OF PIPE IN FEET
      READ(5,101) N1(I),N2(I),D(I),CHW(I),L(I)
      D(I)=D(I)/12.
      K(I)=4.727328*L(I)/(CHW(I)**1.85185185*D(I)**4.87037)
101 FORMAT(2I5,5F10.5)
      NIM=NJ-1
      DO 4 J=1,NJ
C I--JUNCTION NO.
C QJ(I)--EXTERNAL FLOW AT JUNCTION, MINUS IF OUT
C FROM NETWORK
C H(I)--ESTIMATE OF HEAD AT JUNCTION USED TO
C INITIALIZE N-R SOLUTION
      4 READ(5,102) I,QJ(I),H(I)
102 FORMAT(I5,5F10.5)
      DO 5 J=1,NJ
      NNP=0
      DO 6 I=1,NP
      IF(N1(I).NE.J) GO TO 7
      NNP=NNP+1
      JB(J,NNP)=I
      GO TO 6
      7 IF(N2(I).NE.J) GO TO 6
      NNP=NNP+1
      JB(J,NNP)=-I
      6 CONTINUE
      5 NN(J)=NNP
      NCT=0
20 SUM=0.
      JE=0
      DO 10 J=1,NJ
      IF(J.EQ.KNOWN) GO TO 10
      JE=JE+1
      JJE=J-JE
      DO 15 JJ=1,NJ
15 F(JE,JJ)=0.
      NNP=NN(J)
      DO 11 KK=1,NNP
      II=JB(J,KK)
      I=ABS(II)

```

```


      I1=N1(I)
      I2=N2(I)
      ARG=(H(I1)-H(I2))/K(I)
      FAC=II/I
      FAC5=.54*FAC
      ARGE=ARG**54
13 F(JE,NJ)=F(JE,NJ)+ARGE*FAC
      IF(I1.EQ.KNOWN) GO TO 14
      IF(I1.GT.KNOWN) I1=I1-1
      F(JE,I1)=F(JE,I1)+FAC5*ARGE/(K(I)*ARG)
14 IF(I2.EQ.KNOWN) GO TO 11
      IF(I2.GT.KNOWN) I2=I2-1
      F(JE,I2)=F(JE,I2)-FAC5*ARGE/(K(I)*ARG)
11 CONTINUE
      F(JE,NJ)=F(JE,NJ)-QJ(J)
10 CONTINUE
      V(1)=4.
      CALL GJR(F,46,45,N,JM,NJ,$97,JC,V)
      JE=0
      DO 24 J=1,NJ
      IF(J.EQ.KNOWN) GO TO 24
      JE=JE+1
      DIF=F(JE,NJ)
      SUM=SUM+ABS(DIF)
      H(J)=H(J)-DIF
24 CONTINUE
      DO 25 I=1,NP
      I1=N1(I)
      I2=N2(I)
      IF(H(I1).GT.H(I2)) GO TO 25
      WRITE(6,225) I,I1,I2
225 FORMAT(' FLOW HAS REVERSED IN PIPE',3I5)
      N1(I)=I2
      N2(I)=I1
      II=I1
28 NNP=NN(II)
      DO 26 KK=1,NNP
      IF(IABS(JB(II,KK)).NE.I) GO TO 26
      JB(II,KK)=-JB(II,KK)
      GO TO 27
26 CONTINUE
27 IF(II.EQ.I2) GO TO 25
      II=I2
      GO TO 28
25 CONTINUE
      NCT=NCT+1
      WRITE(6,108) NCT,SUM
108 FORMAT(' NCT=',I5,' SUM=',E12.5)
      IF(NCT.LT.MAX.AND.SUM.GT.ERR) GO TO 20
      WRITE(6,103)(H(J),J=1,NJ)
103 FORMAT(' HEADS AT JUNCTIONS',/,(1H ,13F10.3))
      WRITE(6,104)
104 FORMAT(' FROM TO DIAMETER LENGTH
      $CHW FLOWRATE HEAD LOSS HEADS AT
      $JUNCTIONS')
      DO 17 I=1,NP
      I1=N1(I)
      I2=N2(I)
      DH=H(I1)-H(I2)
      Q(I)=(DH/K(I))**54
19 WRITE(6,105) I1,I2,D(I),L(I),CHW(I),Q(I),DH,H(I1),H(I2)
105 FORMAT(2I5,2F10.1,F10.0,4F10.3)
17 CONTINUE
      GO TO 98
97 WRITE(6,306) JC(1),V
306 FORMAT(' OVERFLOW OCCURRED--CHECK SPEC.
      $FOR REDUNDANT EQ. RESULTING IN SINGULAR
      $MATRIX',I5,2F10.2)
99 STOP
      END

```

Example Problems Based on the H-Equations

1. Solve the network given below for the heads at each junction. From these computed heads compute the

flow rates in each pipe. The head at junction 3 is to be maintained at 100 ft.

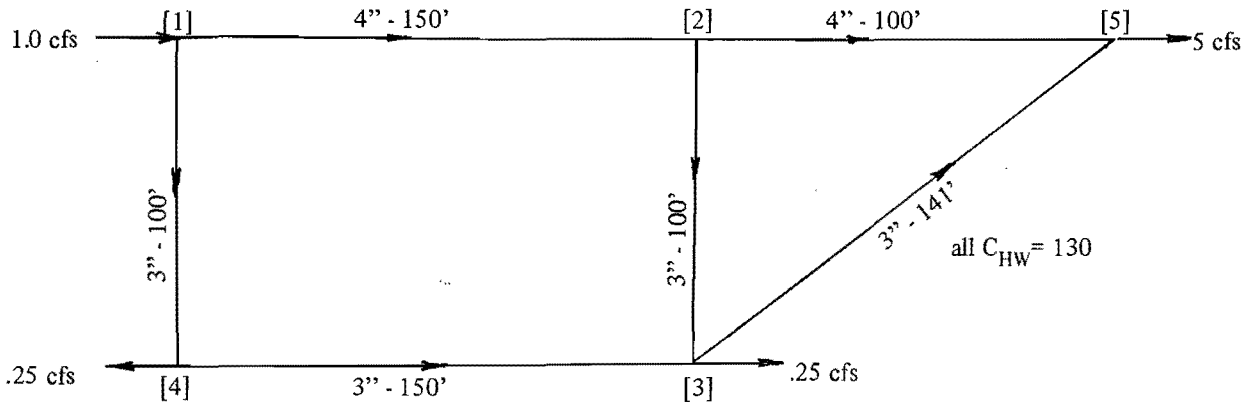

Solution:

The system of equations for this network is:

$$F_1 = \left(\frac{H_1 - H_2}{18.19} \right)^{.54} + \left(\frac{H_1 - H_4}{49.22} \right)^{.54} - 1.0 = 0$$

$$F_2 = - \left(\frac{H_1 - H_2}{18.19} \right)^{.54} + \left(\frac{H_2 - H_5}{49.22} \right)^{.54} + \left(\frac{H_2 - H_3}{12.12} \right)^{.54} = 0$$

$$F_4 = - \left(\frac{H_1 - H_4}{49.22} \right)^{.54} + \left(\frac{H_4 - 100}{73.833} \right) + .25 = 0$$


$$F_5 = - \left(\frac{H_2 - H_5}{12.12} \right)^{.54} - \left(\frac{100 - H_5}{69.40} \right)^{.54} + .5 = 0$$

If as initialization, $H_1 = 115'$, $H_2 = 103'$, $H_4 = 103'$, and $H_5 = 99'$, then

$$D\vec{z} = \vec{F} \text{ becomes } \begin{bmatrix} .057 & -.036 & -.021 & 0.0 \\ -.036 & -.150 & 0.0 & -.074 \\ -.021 & 0.0 & .053 & 0.0 \\ 0.0 & -.074 & 0.0 & -.129 \end{bmatrix} \begin{bmatrix} z_1 \\ z_2 \\ z_4 \\ z_5 \end{bmatrix} = \begin{bmatrix} .266 \\ -.029 \\ -.039 \\ -.151 \end{bmatrix}$$

A solution of which gives: $z_1 = 5.78$, $z_2 = .86$, $z_4 = 1.55$, and $z_5 = -.67$ producing $H_1 = 109.22$, $H_2 = 102.14$, $H_4 = 101.45$, $H_5 = 99.67$. After two additional iterations: $H_1 = 109.74'$, $H_2 = 102.19'$, $H_3 = 100'$, $H_4 = 101.63'$, $H_5 = 99.58'$, and $Q_{12} = 0.622$ cfs, $Q_{14} = 0.378$ cfs, $Q_{43} = 0.128$ cfs, $Q_{25} = 0.436$ cfs, $Q_{23} = 0.186$ cfs, $Q_{35} = 0.064$ cfs.

2. Obtain the elevation of the HGL at each junction and the flow in each pipe in the network below

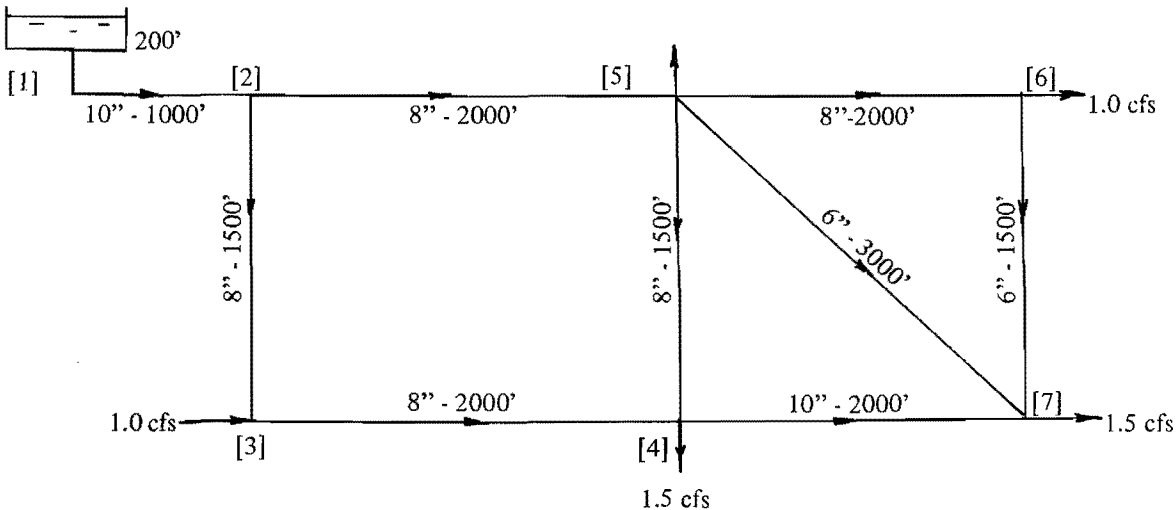

Solution:

The system of equations is:

$$F_2 = - \left(\frac{200 - H_2}{1.622} \right)^{.54} + \left(\frac{H_2 - H_5}{9.615} \right)^{.54} + \left(\frac{H_2 - H_3}{7.211} \right)^{.54} = 0$$

$$F_3 = - \left(\frac{H_2 - H_3}{7.211} \right)^{.54} + \left(\frac{H_3 - H_4}{9.615} \right)^{.54} - 1.0 = 0$$

$$F_4 = - \left(\frac{H_3 - H_4}{9.615} \right)^{.54} - \left(\frac{H_5 - H_4}{7.211} \right)^{.54} + \left(\frac{H_4 - H_7}{3.243} \right)^{.54} + .5 = 0$$

$$F_5 = - \left(\frac{H_2 - H_5}{9.615} \right)^{.54} + \left(\frac{H_5 - H_6}{9.615} \right)^{.54} + \left(\frac{H_5 - H_4}{7.211} \right)^{.54} + \left(\frac{H_5 - H_7}{58.55} \right)^{.54} + .5 = 0$$

$$F_6 = - \left(\frac{H_5 - H_6}{9.615} \right)^{.54} + \left(\frac{H_6 - H_7}{29.27} \right)^{.54} + 1.0 = 0$$

$$F_7 = - \left(\frac{H_6 - H_7}{3.243} \right)^{.54} - \left(\frac{H_5 - H_7}{58.55} \right)^{.54} - \left(\frac{H_4 - H_7}{3.243} \right)^{.54} + 1.5 = 0$$

Solving these equations by the Newton-Raphson method gives: $H_2 = 183.5'$, $H_3 = 174.1'$, $H_4 = 134.2'$, $H_5 = 137.0'$, $H_6 = 128.9'$, $H_7 = 129.2'$, and the flows are: $Q_{12} = 3.5$, $Q_{25} = 2.344$, $Q_{23} = 1.156$, $Q_{34} = 2.156$, $Q_{54} = 0.599$, $Q_{57} = .335$, $Q_{56} = .910$, $Q_{47} = 1.255$, $Q_{76} = .090$ all in cfs.

Corrective Flow Rate Equations


In applying the Newton-Raphson method to solve the system of equations which considers the corrective flow rates in each loop as the unknowns, the same procedure is followed except the unknown vector in Eq. 6-1 is ΔQ and the Jacobian is,

$$D = \begin{vmatrix} \frac{\partial F_1}{\partial \Delta Q_1} & \frac{\partial F_1}{\partial \Delta Q_2} & \cdot & \cdot & \cdot & \frac{\partial F_L}{\partial \Delta Q_L} \\ \frac{\partial F_2}{\partial \Delta Q_1} & \frac{\partial F_2}{\partial \Delta Q_2} & \cdot & \cdot & \cdot & \frac{\partial F_L}{\partial \Delta Q_L} \\ \cdot & \cdot & \cdot & \cdot & \cdot & \cdot \\ \cdot & \cdot & \cdot & \cdot & \cdot & \cdot \\ \frac{\partial F_L}{\partial \Delta Q_1} & \frac{\partial F_L}{\partial \Delta Q_2} & \cdot & \cdot & \cdot & \frac{\partial F_L}{\partial \Delta Q_L} \end{vmatrix}$$

With \vec{z} defined as the solution to $D^{(m)}\vec{z}^{(m)} = \vec{F}^{(m)}$ as previous where F now becomes the equations evaluated from the m^{th} iterative values of $\Delta \vec{Q}^{(m)}$, the Newton-Raphson method becomes

$$\Delta Q^{(m+1)} = \Delta Q^{(m)} - \vec{z} \dots \dots \dots (6-3)$$

The Newton-Raphson method will be illustrated in solving the ΔQ -equations by giving the details involved in solving the two loop network shown below. The table to the right of the sketch contains values of a possible initial flow rate in each pipe of the network which satisfy the junction continuity equations and which will be used to define the corrective loop flow rate equations. To simplify the illustration the Hazen-Williams formula will be used.

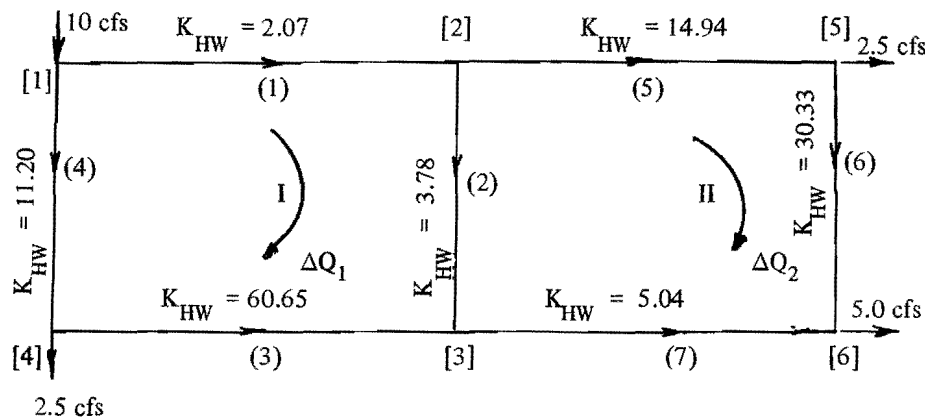

Pipe No.	Q_0 (cfs)
1	5.0
2	2.0
3	2.5
4	5.0
5	3.0
6	0.5
7	4.5

Since there are two loops, there are two corrective flow rates, ΔQ_1 and ΔQ_2 which are unknown. Writing the energy equation around these two loops (with head losses in the clockwise direction as positive), gives the following two simultaneous equations to solve for these two unknowns.

$$F_1 = 2.07 (5 + \Delta Q_1)^{1.85} + 3.78 (2 + \Delta Q_1 - \Delta Q_2)^{1.85} - 60.65 (2.5 - \Delta Q_1)^{1.85} - 11.20 (5 - \Delta Q_1)^{1.85} = 0$$

$$F_2 = 14.94 (3 + \Delta Q_2)^{1.85} + 30.33 (.5 + \Delta Q_2)^{1.85} - 5.04 (4.5 - \Delta Q_2)^{1.85} - 3.78 (-2 - \Delta Q_2 + \Delta Q_1)^{1.85} = 0$$

The four elements of the Jacobian are:

$$\frac{\partial F_1}{\partial \Delta Q_1} = 3.83 (5 + \Delta Q_1)^{.85} + 6.99 (2 + \Delta Q_1 - \Delta Q_2)^{.85} + 112.20 (-2.5 + \Delta Q_1)^{.85} + 20.72 (-5 + \Delta Q_1)^{.85}$$

$$\frac{\partial F_1}{\partial \Delta Q_2} = -6.99 (2 + \Delta Q_1 - \Delta Q_2)^{.85}$$

$$\frac{\partial F_2}{\partial \Delta Q_1} = -6.99 (2 + \Delta Q_2 - \Delta Q_1)^{.85}$$

$$\frac{\partial F_2}{\partial \Delta Q_2} = 27.64 (3 + \Delta Q_2)^{.85} + 56.11 (.5 + \Delta Q_2)^{.85} + 9.32 (4.5 - \Delta Q_2)^{.85} + 6.99 (2 - \Delta Q_2 + \Delta Q_1)^{.85}$$

Note that the Jacobian is a symmetric matrix as was the Jacobian from the H-equations.

Starting the Newton iteration with $\Delta Q_1 = \Delta Q_2 = 0$, then

$$\begin{bmatrix} 353.5 & -12.6 \\ -12.6 & 147.5 \end{bmatrix} \begin{bmatrix} z_1 \\ z_2 \end{bmatrix} = \begin{bmatrix} -497. \\ 27.4 \end{bmatrix}$$

results upon evaluating the functions F_1 and F_2 and the elements in the Jacobian. Solution of this system produces $z_1 = -\Delta Q_1^{(1)} = -1.399$, $z_2 = -\Delta Q_2^{(1)} = .0654$. For the second Newton-Raphson iteration,

$$\begin{bmatrix} 222.5 & -20.2 \\ -20.2 & 151.1 \end{bmatrix} \begin{bmatrix} z_1 \\ z_2 \end{bmatrix} = \begin{bmatrix} 90.3 \\ -5.46 \end{bmatrix}$$

which gives $z_1 = -.414$, $z_2 = -.0914$, and $\Delta Q_1^{(2)} = 1.813$ and $\Delta Q_2^{(2)} = 0.026$. After two additional iterations changes in corrective flow rates are insignificant and the solution is accepted as $\Delta Q_1 = 1.866$ and $\Delta Q_2 = 0.0331$. The flow rates in each pipe can now be computed by adding these corrective flow rates to the initially assumed values which satisfy the junction continuity equations. From these flow rates, the frictional head losses can be computed. These results are:

Pipe No.	1	2	3	4	5	6	7
Q (cfs)	6.87	3.83	0.634	3.134	3.03	0.533	4.47
h_f (ft)	73.5	45.5	26.1	92.9	116.6	9.46	80.6

A listing is given below of a simplified FORTRAN computer program for carrying out the computations described above for solving the ΔQ -equations. Below this listing is a listing of the input data required to solve example problem 1 below by this program.

FORTRAN program for solving the corrective loop flow rate equation by the Newton-Raphson method for analyzing pipe networks.

```

REAL D(50),L(50),K(50),CHW(50),QI(50),DQ(50),DR(50),
$ 51),V(2),A(3),B(3),HO(3),DELEV(3)
INTEGER LP(42,7),NN(42),LO(3),LLP(3),LOP(50,4),
$ NLOP(50)
C NP--NO. OF PIPES, NL--NO. OF LOOPS, MAX--MAX. NO.
C OF ITERATIONS ALLOWED, NPUMP--NO. OF PUMPS,
C NSL--NO. OF PSEUDO LOOPS.
98 READ(5,100,END=99) NP,NL,MAX,NPUMP,NSL
NLP=NL+1
100 FORMAT(10I5)
C II--PIPE NO., D(II)--DIAMETER OF PIPE IN INCHES, L(II)--
C LENGTH OF PIPE IN FT, CHW(II)--HAZEN WILLIAMS COEF.,
C QI(II)--INITIAL FLOW SATISFYING CONTINUITY EQS.
DO 1 I=1,NP
READ(5,101) II,D(II),L(II),CHW(II),QI(II)
D(II)=D(II)/12.
1 K(II)=4.77*L(II)/(D(II)**4.87*CHW(II)**1.852)
101 FORMAT(15,7F10.5)
DO 2 I=1,NL
DQ(I)=0.
C NNP IS THE NUMBER OF PIPES AROUND THE LOOP
C LP(I,J) ARE THE PIPE NO. AROUND THE LOOP. IF
C COUNTERCLOCKWISE THIS NO. IS -
READ(5,100) NNP,(LP(I,J),J=1,NNP)
2 NN(I)=NNP
C LLP(I)--LINE NO. CONTAINING PUMP (MINUS IF
C COUNTERCLOCKWISE, A, B, HO-PUMP CHAR
IF(NPUMP.EQ.0) GO TO 30
DO 31 I=1,NPUMP
31 READ(5,101) LLP(I),A(I),B(I),HO(I)
C LO(I)--NO. OF PSEUDO LOOP, DELEV(I)--ELEV. DIFF. ON
C RIGHT OF = IN ENERGY EQ.
DO 32 I=1,NSL
32 READ(5,101) LO(I),DELEV(I)
30 DO 50 I=1,NP
NLO=0
DO 51 L1=1,NL
NNP=NN(L1)
DO 51 KK=1,NNP
IF (IABS(LP(L1,KK)) .NE. I) GO TO 51
NLO=NLO+1
LOP(I,NLO)=L1*LP(L1,KK)/I
51 CONTINUE
50 NLOP(I)=NLO
NCT=0
10 SUM=0.
DO 3 I=1,NL
DO 12 J=1,NLP
12 DR(I J)=0.
NNP=NN(I)
DO 3 J=1,NNP
IJ=LP(I,J)
IJJ=IABS(IJ)
Q=QI(IJJ)

```

```

NLO=NLOP(IIJ)
DO 52 KK=1,NLO
L1=L0P(IIJ,KK)
LL=IABS(L1)
52 Q=Q+FLOAT(L1/LL)*DQ(LL)
QE=ABS(Q)**.852
FAC=IJ/IJ
DR(I,NLP)=DR(I,NLP)+FAC*K(IIJ)*Q*QE
DO 53 KK=1,NLO
L1=L0P(IIJ,KK)
LL=IABS(L1)
53 DR(I,LL)=DR(I,LL)+FAC*FLOAT(L1/LL)*1.852*K(IIJ)*QE
3 CONTINUE
IF(NSL.EQ.0) GO TO 40
DO 33 I=1,NSL
II=LO(I)
DR(II,NLP)=DR(II,NLP)-DELEV(I)
NNP=NN(I)
DO 33 IK=1,NNPUMP
IL=IABS(LLP(IK))
DO 33 KK=1,NNP
IF(IL.NE.IABS(LP(II,KK))) GO TO 33
Q=ABS(FLOAT(LLP(IK)/IL)*QI(IL)+DQ(II))
HP=(A(IK)*Q+B(IK))*Q+HO(IK)
IF(LLP(II).LT.0) GO TO 35
DR(II,NLP)=DR(II,NLP)-HP
DR(II,IL)=DR(II,IL)+2.*A(IK)*Q+B(IK)
GO TO 33
35 DR(II,NLP)=DR(II,NLP)+HP
DR(II,IL)=DR(II,IL)-2.*A(IK)*Q-B(IK)
33 CONTINUE
40 V(1)=4.
CALL GJR(DR,51,50,NL,NLP,$98,D,V)
DO 7 I=1,NL
SUM=SUM+ABS(DR(I,NLP))
7 DQ(I)=DQ(I)-DR(I,NLP)
NCT=NCT+1
WRITE(6,202) NCT,SUM,(DQ(I),I=1,NL)
202 FORMAT(' NCT=',I2,(12F10.3))
IF(SUM.GT..001.AND.NCT.LT.MAX) GO TO 10
IF(NCT.EQ.MAX) WRITE(6,102) NCT,SUM
102 FORMAT(' DID NOT CONVERGE --NCT=',I5,' SUM=',
$E12.5)
DO 8 I=1,NL
NNP=NN(I)
DO 8 J=1,NNP
IJ=LP(I,J)
IJJ=IABS(IJ)
8 QI(IJJ)=QI(IJJ)+FLOAT(IJ/IJJ)*DQ(I)
WRITE(6,105) (QI(I),I=1,NP)
105 FORMAT(' FLOWRATES IN PIPES',/(1H ,13F10.3))
DO 9 I=1,NP
9 D(I)=K(I)*ABS(QI(I))**.852
WRITE(6,106) (D(I),I=1,NP)
106 FORMAT(' HEAD LOSSES IN PIPES',/(1H ,13F10.3))
GO TO 98
99 STOP
END

```

The input data cards needed in order to use the previously listed program follow:

16	7	15	1	1					
1	12.	1000.	130.	2.5					
2	8.	1000.	130.	1.0					
3	10.	1200.	130.	.75					
4	10.	900.	130.	2.0					
5	10.	1000.	130.	.5					
6	10.	2500.	130.	1.0					
7	8.	1000.	130.	.25					
8	10.	1400.	130.	.75					
9	12.	2000.	130.	.5					
10	8.	1200.	130.	2.					
11	8.	1300.	130.	1.					
12	10.	1600.	130.	.5					
13	10.	1000.	130.	1.					
14	10.	1300.	130.	1.					
15	12.	900.	130.	2.25					
16	12.	500.	130.	2.5					
4	2	3	-4	-5					
4	-7	8	-15	-3					
4	2	-7	8	-6					
3	11	12	-9						
3	9	-10	-8						
3	10	13	-14						
4	16	7	-2	-1					
-1	-2.505	16.707	155.286						
7	150.								

Pipe diameters, lengths, and coef. C_{HW} and initial flow rate Q_0

Pipe Nos. in Loops

Pump characteristics Pseudo Loop No. & Δ Elev.

Pump characteristics Δ Elev.

Input data needed for example problem 1 which follows:

8	3	10							
1	12.	2000.	95.	5.					
2	10.	1500.	95.	2.					
3	6.	2000.	95.	2.5					
4	8.	1500.	95.	5.					
5	8.	2000.	95.	3.					
6	6.	1000.	95.	.5					
7	10.	2000.	95.	4.5					
8	10.	3000.	95.	2.					
3	1	2	-8						
4	5	6	-7	-2					
3	8	-3	-4						

Pipe Information

Pipes in Loop


The input data needed for a more extensive computer program using this method which was developed by Fowler are described in Appendix D. This latter computer program permits pumps, reservoirs, etc., to exist in the network, does not require information about pipe numbers in each loop, generates its own initialization, and for large networks is efficient in computer time and storage since it orders loops in such a manner so that all nonzero

elements of the Jacobian are concentrated in a band near the diagonal elements. See Epp and Fowler¹ for a description of the method used.

¹Epp, R., and A. G. Fowler. "Efficient Code for Steady-State Flows in Networks," Jour. of the Hydraulics Div., ASCE, Vol. 96, No. HY1, Proc. Paper 7002, January 1970, pp. 43-56.

Example Problems in Solving ΔQ -Equations

1. Solve the 3-loop network below using the Hazen-Williams formula and the Newton-Raphson method to solve the ΔQ -equations.

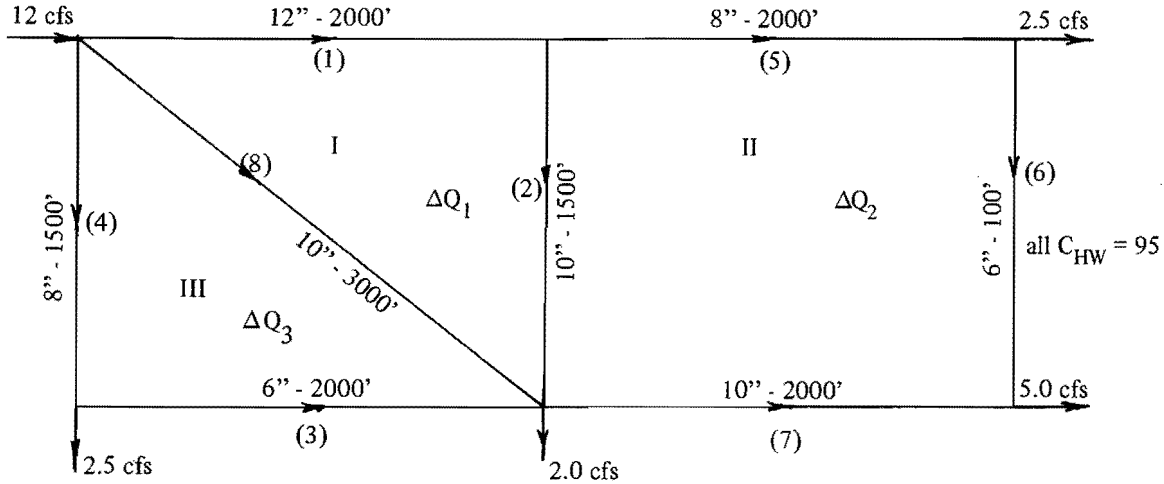

Solution:

Evaluating K_{HW} for each pipe as well as supplying an initial flow rate in each pipe gives,

Pipe No.	1	2	3	4	5	6	7	8
K_{HW}	2.074	3.78	60.65	11.21	14.94	30.32	5.04	7.56
Q_o (cfs)	5.0	2.0	2.5	5.0	3.0	0.5	4.5	2.0

The ΔQ -equations for this network are:

$$F_1 = 2.074 (5 + \Delta Q_1)^{1.85} + 3.78 (2 + \Delta Q_1 - \Delta Q_2)^{1.85} - 7.56 (2 - \Delta Q_1 + \Delta Q_3)^{1.85} = 0$$


$$F_2 = 14.94 (3 + \Delta Q_2)^{1.85} + 30.32 (.5 + \Delta Q_2)^{1.85} - 5.04 (4.5 - \Delta Q_2)^{1.85} - 3.78 (2 - \Delta Q_2 + \Delta Q_1)^{1.85} = 0$$

$$F_3 = 7.56 (2.0 + \Delta Q_3 - \Delta Q_1)^{1.85} - 60.65 (2.5 - \Delta Q_3)^{1.85} - 11.21 (5 - \Delta Q_3)^{1.85} = 0$$

The solution to this system produces: $\Delta Q_1 = 0.712$, $\Delta Q_2 = -0.115$, $\Delta Q_3 = 2.24$, all in cfs. Therefore the flow rates and head losses in each pipe are:

Pipe No.	1	2	3	4	5	6	7	8
Q (cfs)	5.712	2.827	0.257	2.757	2.885	0.385	4.615	3.531
h_f (ft)	52.29	25.90	4.90	73.30	106.32	5.18	85.59	78.19

2. Solve for the flow rate in each pipe and the head at each junction of the network shown below. The pump characteristic curve is given by $h_p = -2.505 Q_p^2 + 16.707 Q_p + 155.29$ (h_p is in feet and Q_p in cfs)

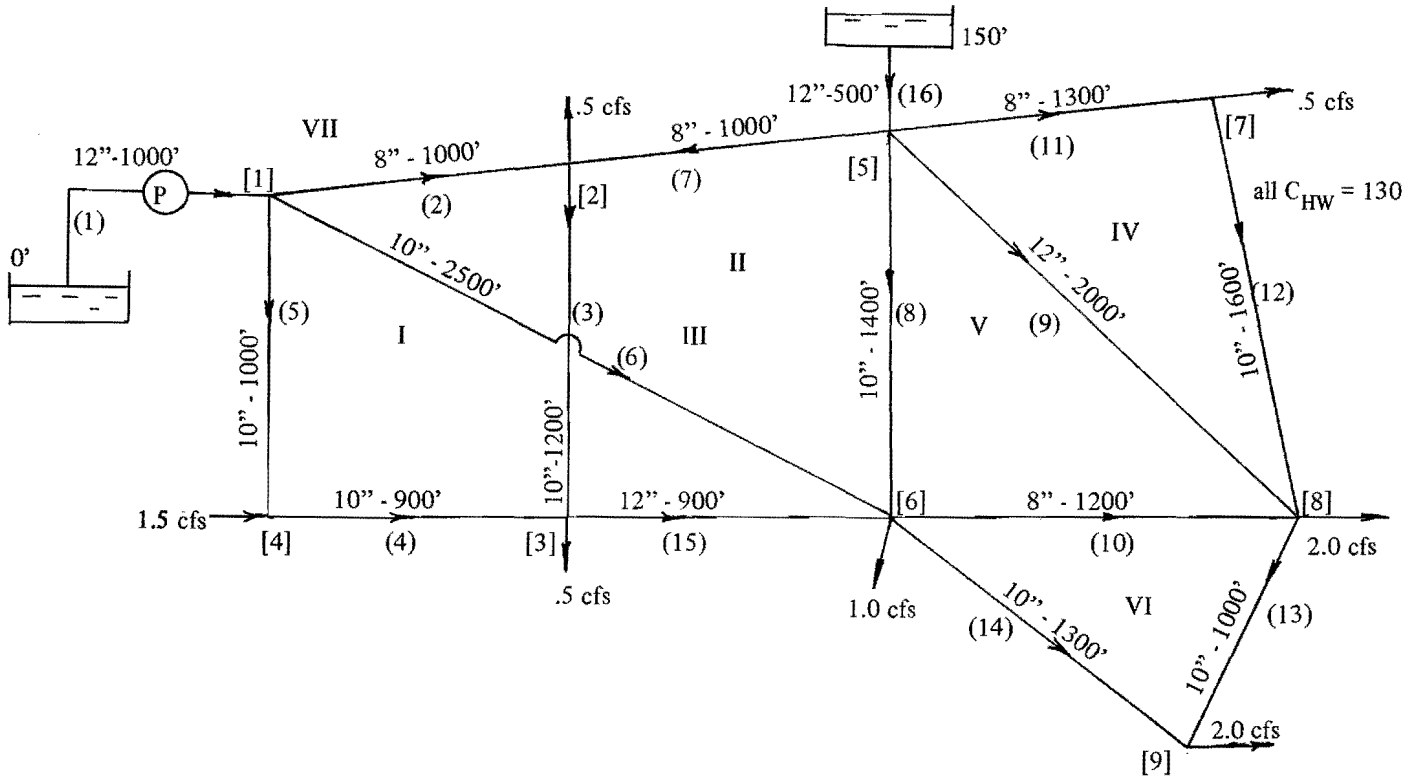

Solution:

Because of the pump and reservoir one pseudo loop connecting the reservoir by a no-flow pipe is needed. To solve for the seven corrective flow rates, seven energy equations are written as follows around the seven loops:

$$F_1 = K_2 (Q_{02} + \Delta Q_1 + \Delta Q_3)^{1.85} + K_3 (Q_{03} + \Delta Q_1 - \Delta Q_4)^{1.85} - K_4 (Q_{04} - \Delta Q_1)^{1.85} + K_5 (Q_{05} - \Delta Q_1)^{1.85} = 0$$

$$F_2 = -K_7 (Q_{07} - \Delta Q_2 - \Delta Q_3)^{1.85} + K_8 (Q_{08} + \Delta Q_2 - \Delta Q_5)^{1.85} - K_{15} (Q_{015} - \Delta Q_2)^{1.85} - K_3 (Q_{03} - \Delta Q_2 + \Delta Q_1)^{1.85} = 0$$

$$F_3 = K_2 (Q_{02} + \Delta Q_3 + \Delta Q_1)^{1.85} - K_7 (Q_{07} - \Delta Q_3 - \Delta Q_2)^{1.85} + K_8 (Q_{08} + \Delta Q_3 + \Delta Q_2)^{1.85}$$

$$-K_6 (Q_{06} - \Delta Q_3)^{1.85} = 0$$

$$F_4 = K_{11} (Q_{011} + \Delta Q_4)^{1.85} + K_{12} (Q_{012} + \Delta Q_4)^{1.85} - K_9 (Q_{09} - \Delta Q_4 + \Delta Q_5)^{1.85} = 0$$

$$F_5 = K_9 (Q_{09} + \Delta Q_5 - \Delta Q_4)^{1.85} - K_{10} (Q_{010} - \Delta Q_5 + \Delta Q_6)^{1.85} - K_8 (Q_{08} - \Delta Q_5 + \Delta Q_2)^{1.85} = 0$$

$$F_6 = K_{10} (Q_{010} + \Delta Q_6 - \Delta Q_5)^{1.85} + K_{13} (Q_{013} + \Delta Q_6)^{1.85} - K_{14} (Q_{014} - \Delta Q_6)^{1.85} = 0$$

$$F_7 = K_{16} (Q_{016} + \Delta Q_7)^{1.85} + K_7 (Q_{07} + \Delta Q_7 - \Delta Q_2 - \Delta Q_3)^{1.85} - K_2 (Q_{02} - \Delta Q_7 + \Delta Q_2 + \Delta Q_3)^{1.85} - K_1 (Q_{01} - \Delta Q_7)^{1.85} + h_p - 150 = 0$$

In the last of these equations h_p is defined by the pump characteristic curve equation with $Q_{01} - \Delta Q_7$ replacing Q_p . After supplying an initial flow for each pipe, and solving by the Newton-Raphson method the following solution results:

Pipe No.	1	2	3	4	5	6	7	8	9	10	11	12
Q (cfs)	4.975	1.653	0.114	2.777	1.277	2.045	-1.039	-0.960	1.415	0.889	0.609	0.109
h_f (ft)	11.32	10.60	0.03	8.41	2.22	13.25	4.48	1.83	2.21	4.04	2.17	0.04

Pipe No.	13	14	15	16
Q (cfs)	0.413	1.587	2.391	0.025
h_f (ft)	0.27	4.31	2.62	0.00

Junction No.	1	2	3	4	5	6	7	8	9
Head (ft)	165.1	154.5	154.5	162.9	150.0	151.8	147.8	147.8	147.5

3. Solve the network shown below. The wall roughness for all pipes is $e = .012$ inch.


Solution:

Pipe No.	1	2	3	4	5	6	7	8	9	10	11	12
Q (cfs)	19.80	10.37	4.89	4.00	2.66	4.13	4.44	4.60	13.67	2.40	4.07	6.07
h_f (ft)	10.59	2.97	0.69	24.57	0.22	17.43	10.04	16.17	11.30	3.01	16.90	2.29

Pipe No.	13	14	15	16	17	18	19	20	21	22	23	24
Q (cfs)	1.64	1.11	5.47	1.60	0.40	1.33	2.83	4.83	4.07	2.59	1.41	3.07
h_f (ft)	2.86	1.01	0.86	4.10	0.10	1.45	0.52	1.02	12.69	10.46	1.07	7.29

Pipe No.	25	26	27	28	29	30	31	32	33	34	35	36
Q (cfs)	3.11	3.07	2.57	6.98	2.48	8.02	10.26	12.26	2.94	1.06	17.21	0.63
h_f (ft)	15.00	7.28	5.16	61.39	0.81	7.89	1.46	5.16	6.73	0.92	8.03	0.05

Pipe No.	37	38	39	40	41	42	43	44	45	46	47	48
Q (cfs)	8.06	11.69	4.50	12.03	12.55	8.16	29.73	26.58	19.58	2.48	4.96	9.74
h_f (ft)	5.99	2.82	1.53	13.17	9.54	4.90	17.75	9.48	7.77	6.41	25.04	2.63

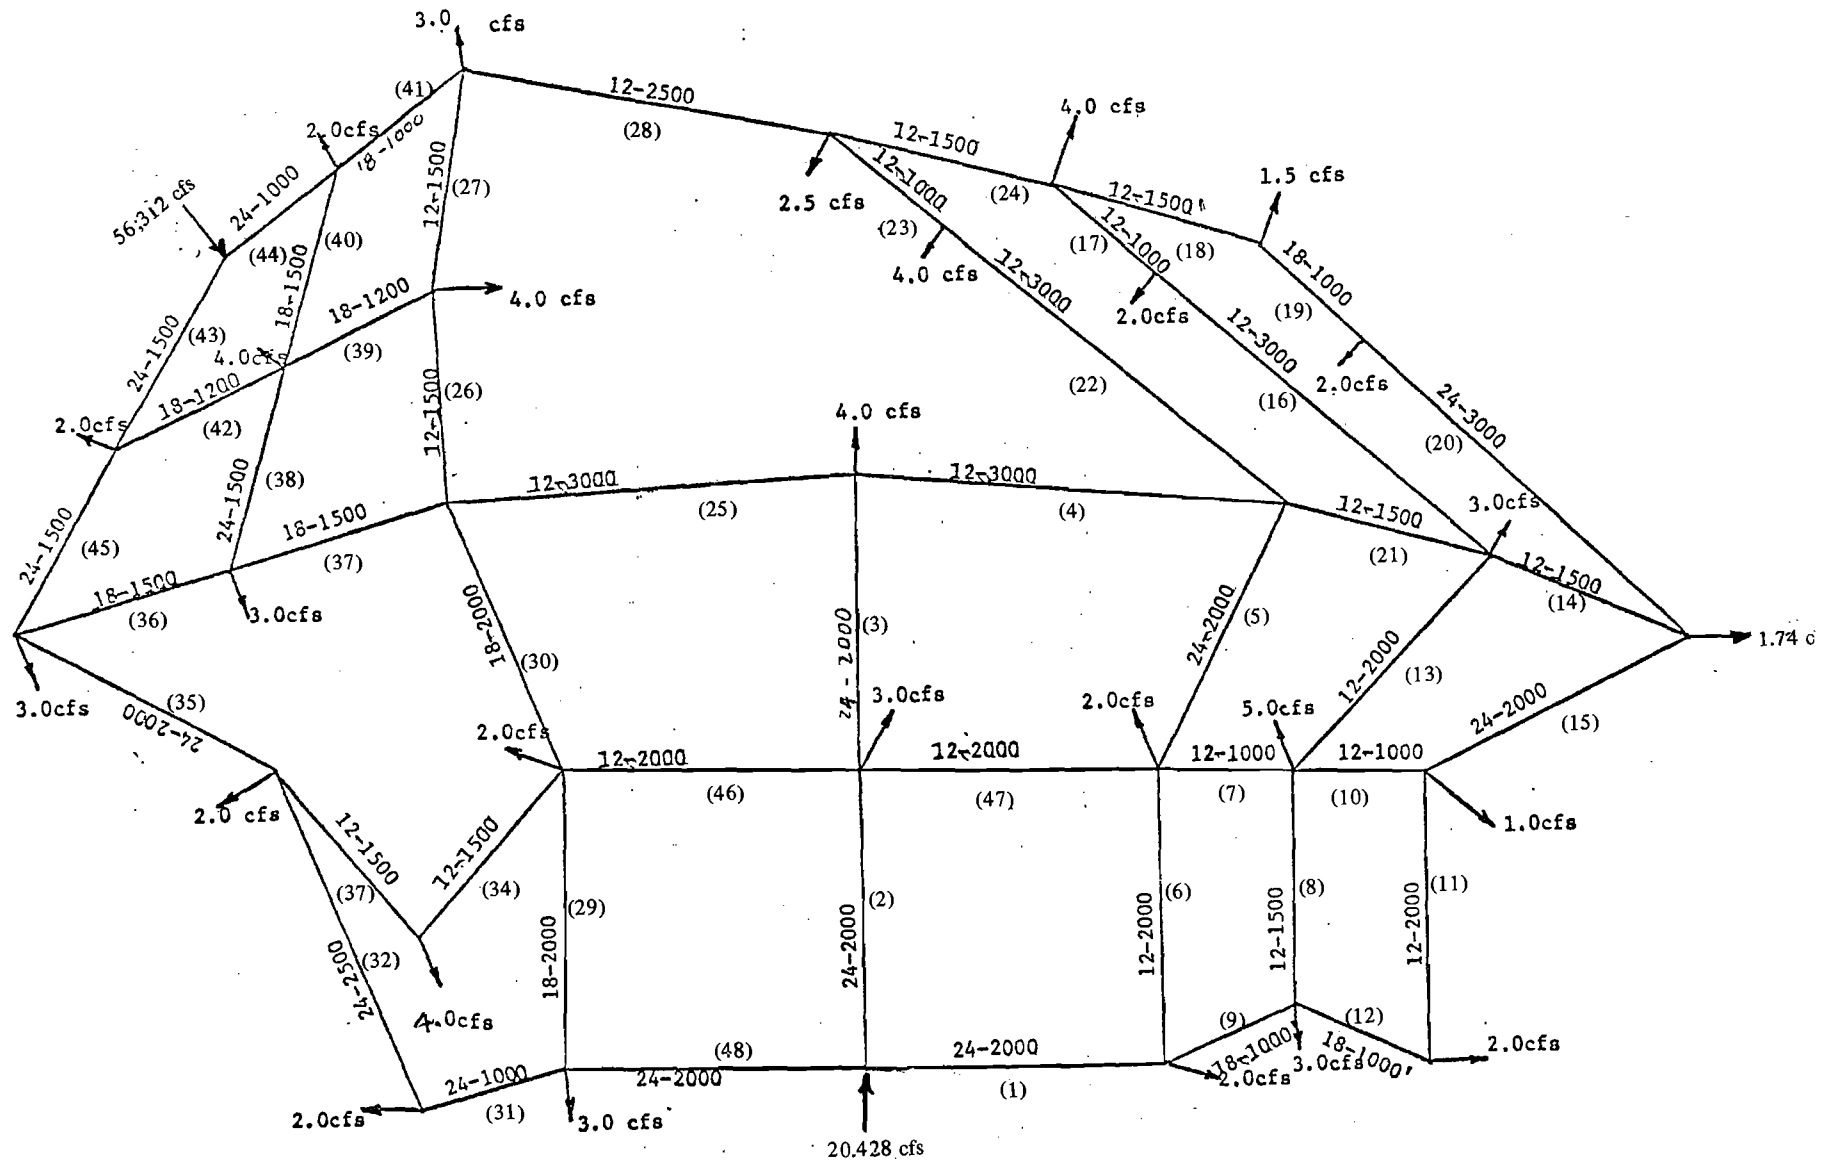

4. Solve the 48-pipe network of example problem 3 using the Hazen-Williams formula assuming the coefficient $C_{HW} = 120$ for all pipes.

Solution:

Pipe No.	1	2	3	4	5	6	7	8	9	10	11	12
Q (cfs)	19.65	10.25	4.79	3.93	2.60	4.06	4.42	4.58	13.59	2.39	4.01	6.01
h_f (ft)	11.44	3.42	0.84	25.51	0.27	18.06	10.53	16.87	11.72	3.37	17.64	2.59
Pipe No.	13	14	15	16	17	18	19	20	21	22	23	24
Q (cfs)	1.61	1.09	5.40	1.57	0.43	1.25	2.75	4.75	4.06	2.48	1.52	3.18
h_f (ft)	3.23	1.78	1.05	4.67	0.14	1.52	0.61	1.23	13.49	10.88	1.46	8.60
Pipe No.	25	26	27	28	29	30	31	32	33	34	35	36
Q (cfs)	3.14	3.04	2.47	7.20	2.41	7.94	10.07	12.07	2.97	1.03	17.04	0.41
h_f (ft)	16.83	7.93	5.39	65.07	0.95	8.66	1.66	5.79	7.57	1.07	8.78	0.03
Pipe No.	37	38	39	40	41	42	43	44	45	46	47	48
Q (cfs)	8.04	11.44	4.57	11.93	12.67	8.09	29.72	26.60	19.63	2.50	4.96	9.47
h_f (ft)	6.65	3.15	1.87	13.81	10.29	5.38	18.45	10.02	8.56	7.33	26.07	2.96

5. Solve problem 4 with the demand at the junction of pipes 3, 4, and 25 increased from 4.0 cfs to 14 cfs; the demand at the junction of pipes 14, 15, and 20 decreased from 1.74 cfs to 0 cfs; the flow into the junction of pipes 43 and 44 increased from 56.312 cfs to 63.312 cfs; and the flow into the junction of pipes 1, 2, and 48 increased from 20.428 cfs to 25.168 cfs.

Solution:

Pipe No.	1	2	3	4	5	6	7	8	9	10	11	12
Q (cfs)	21.80	16.79	12.83	3.34	2.53	4.11	4.28	3.98	15.70	1.93	2.98	8.72
h_f (ft)	13.86	8.54	5.19	18.78	0.26	18.40	9.94	13.03	15.31	2.27	10.15	5.15
Pipe No.	13	14	15	16	17	18	19	20	21	22	23	24
Q (cfs)	1.33	0.72	3.91	1.41	0.59	1.13	2.63	4.63	3.80	2.07	1.93	3.46
h_f (ft)	2.29	0.56	0.57	3.81	0.25	1.26	0.56	1.18	11.97	7.75	2.28	10.06
Pipe No.	25	26	27	28	29	30	31	32	33	34	35	36
Q (cfs)	4.50	3.89	3.00	7.89	3.17	9.47	12.99	14.99	3.46	0.54	20.45	0.76
h_f (ft)	32.77	12.48	7.70	77.20	1.59	12.00	2.66	8.66	10.05	0.32	12.31	0.08
Pipe No.	37	38	39	40	41	42	43	44	45	46	47	48
Q (cfs)	10.08	13.84	4.89	13.68	13.89	9.05	33.75	29.57	22.69	3.75	4.71	13.16
h_f (ft)	10.12	4.48	2.12	17.79	12.21	6.63	23.35	12.18	11.19	15.57	23.72	5.44

CHAPTER VII

HARDY CROSS METHOD

Introduction

The oldest and most widely used method for analyzing pipe networks is the Hardy Cross method, a description of which can be found in most hydraulics or fluid mechanics text books. In the precomputer days, hand solutions of pipe networks used the Hardy Cross method, and even today many computer programs are based on the Hardy Cross method. This method can be applied to solve the system of head equations, or the system of corrective loop flow equations, and for that matter no doubt also to solve the Q-equations. With the advent of the computer, as larger and more complex networks were analyzed, the Hardy Cross method was found to frequently converge too slowly if at all. A number of special measures have been employed to improve its convergence characteristics. These will not be discussed here. If a computer with sufficient storage is available, the methods described earlier are more suited. When using a small computer, or for hand computations of relatively small networks such as those given in the example problems in this manual, the Hardy Cross method might still be used. In describing the Hardy Cross method in this manual it will be used only to solve the ΔQ -equations. Its use in solving the H-equations or the Q-equations should be obvious from this discussion. The ΔQ -system is more frequently solved by the Hardy Cross method, probably primarily because it generally results in fewer equations. Most text books treat only its use in solving the ΔQ -equations even though this is generally not pointed out.

Mathematical Development

The Hardy Cross method is an adaptation of the Newton-Raphson method which solves one equation at a time before proceeding to the next equation during each iteration instead of solving all equations simultaneously. In doing this all other ΔQ 's except the ΔQ_ℓ of the loop ℓ for which the equation is written are assumed temporarily known. Based on this assumption, the Newton-Raphson method can be used to solve the single equation $F_\ell = 0$ for ΔQ_ℓ , or

$$\Delta Q_\ell^{(m+1)} = \Delta Q_\ell^{(m)} - \frac{F_\ell^{(m)}}{\frac{dF_\ell^{(m)}}{d(\Delta Q_\ell)}} \dots \dots \dots (7-1)$$

It is common in the Hardy Cross method to apply only one iterative correction to each equation before proceeding to the next equation (i.e. the next loop), even though several variations in detail exist. After applying one iterative correction to all equations the process is repeated until convergence is achieved. Furthermore, it is common to adjust the initially assumed flow rates in all pipes in the loop of that equation immediately upon computing each ΔQ . Consequently each equation $F_\ell = 0$ is evaluated with all ΔQ 's equal to zero, and furthermore the previous $\Delta Q_\ell^{(m)} = 0$. Consequently Eq. 7-1 reduces to,

$$\Delta Q = - \frac{F_\ell}{dF_\ell/d\Delta Q_\ell} \dots \dots \dots (7-2)$$

The superscripts denoting iteration numbers in Eq. 7-1 are deleted in Eq. 7-2 because only one ΔQ appears. The equation $F_\ell = 0$ for this ℓ loop is the head loss equation around the loop or

$$F_\ell = \sum K_i Q_i^{n_i} \dots \dots \dots (7-3)$$

The derivative of F_ℓ is,

$$\frac{dF_\ell}{d\Delta Q_\ell} = \sum |n_i K_i Q_i^{n_i-1}| \dots \dots \dots (7-4)$$

Substituting Eqs. 7-3 and 7-4 into Eq. 7-2 gives the following equation by which the Hardy Cross method computes a corrective flow rate ΔQ_ℓ for each loop of the network.

$$\Delta Q = - \frac{\sum K_i Q_i^{n_i}}{\sum |n_i K_i Q_i^{n_i-1}|} \dots \dots \dots (7-5)$$

If the Hazen-Williams equation is used to define K and n in the exponential formula, then Eq. 7-5 simplifies to


$$\Delta Q = - \frac{\sum (K_{HW})_i Q_i^{1.852}}{1.852 \sum |(K_{HW})_i Q_i^{0.852}|} = - \frac{\sum (h_f)_i}{\sum |(h_f/Q)_i|} \dots \dots \dots (7-6)$$

The Hardy Cross method may be summarized by the following steps:

1. Make an initial guess of the flow rate in each pipe such that all junction continuity equations are satisfied.
2. Compute the sum of head losses around a loop of the network keeping track of signs. If the direction of movement (clockwise or counterclockwise) around the loop is opposite to the direction of flow in the pipe this h_f is negative. This step computes $\Sigma(h_f)_i$, or the numerator of Eq. 7-5 or Eq. 7-6.
3. Compute the denominator of Eq. 7-5 or Eq. 7-6 by accumulating the absolute values of $n_i K_i Q_i^{n_i-1}$ [or $(nh_f/Q)_i$] around the same loop.
4. Compute ΔQ by dividing the result from step 2 by the result from step 3, i.e. apply Eq. 7-5 (or Eq. 7-6).

5. Repeat steps 2 through 4 for each loop in the network.
6. Repeat steps 2 through 5 iteratively until all the ΔQ 's computed during an iteration are small enough to be insignificant.

These steps are conveniently carried out in tabular form when doing a pipe network analysis by slide rule or desk calculator as illustrated below in solving for flow rates in the pipes of the two loop network given below. The solution will be based on the Darcy-Weisbach equation. The procedure will be simplified slightly if the Hazen-Williams equation is used. First initial flow rates in each pipe are selected which satisfy the junction continuity equations. Based on these flow rates the next computations determine K and n in the exponential formula for each pipe as described near the end of Chapter II. The following table gives these values.

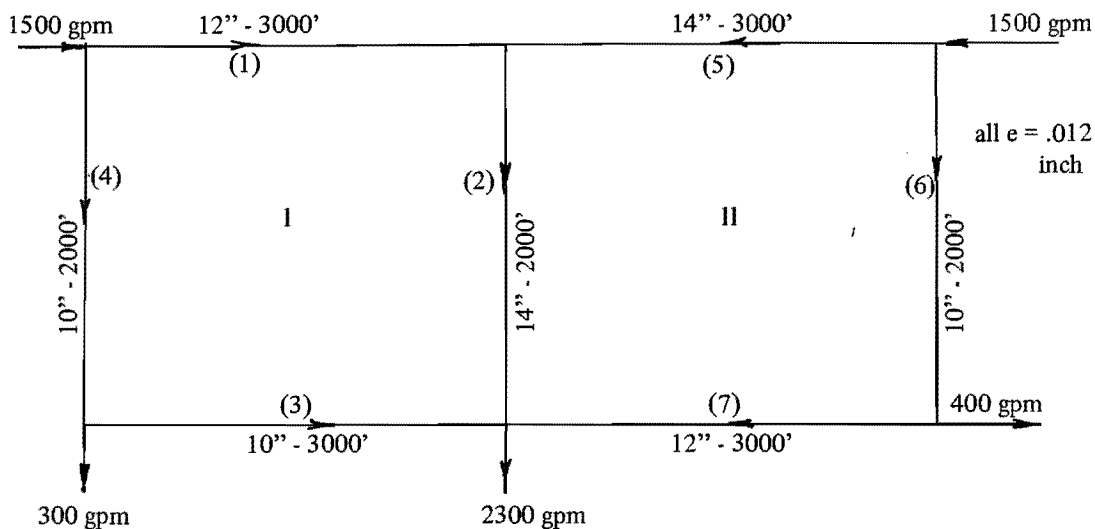

Pipe No.	1	2	3	4	5	6	7
Q (cfs)	1.67	3.45	1.00	1.67	1.78	1.56	0.67
n	1.93	1.95	1.92	1.95	1.92	1.95	1.88
K	1.66	0.49	4.21	2.79	0.76	2.79	1.66

From the values of K and n, the numerator and denominator in Eq. 7-5 (or Eq. 7-6) are computed as illustrated in the tables below.

Loop I			
Pipe	Q	KQ^n	nKQ^n/Q
1	1.67	4.83	5.57
2	3.45	5.55	3.13
3	-1.0	-4.13	7.91
4	-1.67	-7.37	8.59
		-1.12	25.20

Loop II			
Pipe	Q	KQ^n	nKQ^n/Q
5	-1.78	-2.29	2.46
6	1.56	6.45	8.04
7	0.67	0.76	2.15
2	-3.45	-5.55	3.13
		-0.63	15.78

$$\Delta Q_1 = \frac{-1.12}{25.2} = .045 \text{ cfs}$$

$$\Delta Q_2 = \frac{-0.63}{15.78} = .040$$

Adding these ΔQ 's to the flow rates gives: $Q_1 = 1.715$, $Q_2 = 3.455$, $Q_3 = 0.955$, $Q_4 = 1.625$, $Q_5 = 1.74$, $Q_6 = 1.60$, $Q_7 = 0.71$. After repeating the process several more iterations, the solution: $Q_1 = 1.767$, $Q_2 = 3.547$, $Q_3 = 0.984$, $Q_4 = 1.573$, $Q_5 = 1.862$, $Q_6 = 1.478$, $Q_7 = 0.588$, all in cfs, is obtained.

A listing of a simple FORTRAN program which uses the Darcy-Weisbach equation to determine head losses and obtains the solution by the Hardy Cross method is given below.

FORTRAN program which uses Hardy-Cross method

```

      REAL D(50),L(50),K(50),E(50),QI(50)
      INTEGER LP(42,7),NN(42)
C NP--NO. OF PIPES, NL--NO. OF LOOPS, MAX--MAX. NO.
C OF ITERATIONS ALLOWED.
C VIS--VISC. OF FLUID, ERR--ERROR PARAMETER, G2--
C 2 X ACCEL OF GRAVITY
      98 READ(5,100),END=99) NP,NL,MAX,VIS,ERR,G2
      100 FORMAT(3I5,3F10.5)
C II--PIPE NO., D(II)--DIAMETER OF PIPE IN INCHES, L(II)--
C LENGTH OF PIPE IN FT, E(II)--WALL ROUGHNESS OF
C PIPE, QI(II)--INITIAL FLOW SATISFYING CONTINUITY
C EQS.
      DO 1 I=1,NP
      READ(5,101) II,D(II),L(II),E(II),QI(II)
      E(II)=E(II)/D(II)
      1 D(II)=D(II)/12.
      101 FORMAT(I5,7F10.5)
      IF(G2 .LT. 1.E-5) G2=64.4
      ELOG=9.35*ALOG10(2.71828183)
      DO 51 I=1,NP
      QM=ABS(QI(I))
      DEQ=.1*QM
      AR=.78539392*D(I)**2
      ARL=L(I)/(G2*D(I)*AR**2)
      V1=(QM-DEQ)/AR
      V2=(QM+DEQ)/AR
      RE1=V1*D(I)/VIS
      RE2=V2*D(I)/VIS
      IF(RE2 .GT. 2.1E3) GO TO 53
      F1=64./RE1
      F2=64./RE2
      E(I)=1.
      K(I)=64.4*VIS*ARL/D(I)
      GO TO 51
      53 MM=0
      F=1./(1.14-2.*ALOG10(E(I)))**2
      PAR=V1*SQRT(.125*F)*D(I)*E(I)/VIS
      IF(PAR .GT. 65.) GO TO 54
      RE=RE1
      57 MCT=0
      52 FS=SQRT(F)
      FZ=.5/(F*FS)
      ARG=E(I)+9.35/(RE*FS)
      FP=1./FS-1.14+2.*ALOG10(ARG)
      DF=FZ+ELOG*FZ/(ARG*RE)
      DIF=FP/DF
      F=F+DIF
      MCT=MCT+1
      IF(ABS(DIF) .GT. .00001 .AND. MCT .LT. 15) GO TO 52
      IF(MM .EQ. 1) GO TO 55
      MM=1
      RE=RE2
      F1=F
      GO TO 57

```

```

      55 F2=F
      BE=(ALOG(F1)-ALOG(F2))/(ALOG(QM+DEQ)-ALOG(QM-
      $DEQ))
      AE=F1*(QM-DEQ)**BE
      E(I)=2.-BE
      K(I)=AE*ARL
      GO TO 51
      54 K(I)=F*ARL
      E(I)=2.
      51 CONTINUE
      WRITE(6,110) (K(I),I=1,NP)
      110 FORMAT(' COEF. K IN EXPONENTIAL FORMULA',/,
      $(1H ,16F8.4))
      WRITE(6,111) (E(I),I=1,NP)
      111 FORMAT(' OEXPO N IN EXPONENTIAL FORMULA',
      $/(1H ,16F8.4))
      DO 2 I=1,NL
C NNP IS THE NUMBER OF PIPES AROUND THE LOOP
C LP(I,J) ARE THE PIPE NO. AROUND THE LOOP. IF
C COUNTERCLOCKWISE THIS NO. IS --
      READ(5,120) NNP,(LP(I,J),J=1,NNP)
      120 FORMAT(16I5)
      2 NN(I)=NNP
      NCT=0
      10 SUM=0.
      DO 3 I=1,NL
      NNP=NN(I)
      SUM1=0.
      SUM2=0.
      DO 4 J=1,NNP
      IJ=LP(I,J)
      IJ=IABS(IJ)
      HL=FLOAT(IJ/IJ)*K(IJ)*QI(IJ)**E(IJ)
      SUM1=SUM1+HL
      4 SUM2=SUM2+E(IJ)*ABS(HL)/QI(IJ)
      DQ=SUM1/SUM2
      SUM=SUM+ABS(DQ)
      DO 3 J=1,NNP
      IJ=LP(I,J)
      IJ=IABS(IJ)
      3 QI(IJ)=QI(IJ)-FLOAT(IJ/IJ)*DQ
      NCT=NCT+1
      IF(NCT .LT. MAX .AND. SUM .GT. ERR) GO TO 10
      WRITE(6,105) (QI(I),I=1,NP)
      105 FORMAT(' FLOWRATES IN PIPES',/(1H ,13F10.3))
      DO 9 I=1,NP
      9 D(I)=K(I)*ABS(QI(I))*E(I)
      WRITE(6,106) (D(I),I=1,NP)
      106 FORMAT(' HEAD LOSSES IN PIPES',/(1H ,13F10.3))
      GO TO 98
      99 STOP
      END

```

The input data to a more extensive computer program using the Hardy Cross method is described in Appendix E. This program consists of approximately 10 times as many FORTRAN statements as the listing above, but it simplifies the amount of input data, by requiring no information about pipe numbers in loops, nor does it require an initialization since this is generated within the program itself.

APPENDIX A

UNITS AND CONVERSION FACTORS UNIT DEFINITIONS (SI)

1. *Meter*—m.

The meter is defined as 1,650,763.73 wave lengths in a vacuum of the orange-red line of the spectrum of krypton -86.

2. *Time second*—sec

The second is defined as the duration of 9,192,631,770 cycles of radiation associated with a specified transition of the cesium atom.

3. *Mass kilogram*—kg

The standard for the unit of mass, the kilogram, is a cylinder of platinum-iridium alloy kept by the International Bureau of Weights and Measures at Paris.

4. *Temperature Kelvin*—°K

The Kelvin scale of temperature has its origin or zero point at absolute zero and has a fixed point at the triple point of pure water defined at 273.16°K. The triple point on the Celsius scale is defined at 0.01°C which is approximately 32.02°F on the Fahrenheit scale. Conversion between these temperature scales can be accomplished by the following equations

or

$$^{\circ}\text{F} + 40 = 1.8 (^{\circ}\text{C} + 40)$$

$$^{\circ}\text{F} = 1.8 \times ^{\circ}\text{C} + 32$$

$$^{\circ}\text{C} = (^{\circ}\text{F} - 32)/1.8$$

$$^{\circ}\text{K} = ^{\circ}\text{C} + 273.15$$

$$^{\circ}\text{R} = ^{\circ}\text{F} + 459.59$$

5. *Force Newton*—N

A force of 1 N when applied for 1 sec will give a 1 kg mass a speed of 1 m/sec. Gravity gives a mass a downward acceleration of about 9.8 m/sec² or 32.2 ft/sec².

6. *Energy Joule*

$$1 \text{ Joule} = 1 \text{ N}\cdot\text{m} = 10^7 \text{ ergs} = 0.239 \text{ cal}$$

$$1 \text{ Btu} = 778 \text{ ft}\cdot\text{lb}$$

7. *Power*

$$1 \text{ watt} = 1 \text{ N}\cdot\text{m}/\text{sec} \quad 1 \text{ HP} = 550 \text{ ft}\cdot\text{lb}/\text{sec} = 746$$

$$\text{watts} = 746 \text{ N}\cdot\text{m}/\text{sec}$$

BASIC CONVERSION UNITS

	ES to SI	SI to ES
Length	1 in. = 2.54 cm 1 ft. = 0.3048 m	1 cm = .393701 in. 1 m = 3.28084 ft.
Mass	1 slug = 14.5939 kg	1 kg = 0.0685218 slugs
Force	1 lb = 4.44823 N 1 poundal = .138255 N	1 N = 0.224809 lb (1 N = 10 ⁵ dynes)
SECONDARY CONVERSION UNITS		
Area	1 in. ² = 6.4516 cm ² 1 ft. ² = .092903 m ² 1 ac. = 0.4047 Hec (1 ac. = 43,560 ft. ²)	1 cm ² = .155 in. ² 1 m ² = 10.76391 ft. ² 1 Hec = 2.471 ac. (1 Hec = 10,000 m ²)
Volume	1 in. ³ = 16.3871 cm ³ 1 ft. ³ = .028317 m ³ 1 gal. = 3.785 liters 1 fluid oz. = 29.57 cm ³ (1 ft. ³ = 7.481 gals)	1 cm ³ = .061024 in. ³ 1 m ³ = 35.31467 ft. ³ 1 liter = 0.0353 ft. ³ 1 liter = 1.057 quarts (1 liter = 1000 cm ³)
Density, ρ	1 slug/ft. ³ = 515.363 kg/m ³	1 hg/m ³ = .0019404 slug/ft. ³
Specific wt., γ	1 lb/ft. ³ = 157.07 N/m ³	1 N/m ³ = 0.00637 lb/ft. ³
Pressure	1 psf = 47.877 N/m ² 1 psi = 6894.24 N/m ² (1 psi = 144 psf) (1 atm = 14.699 psi) (1 bar = 14.5 psi)	1 N/m ² = 0.0209 psf 1 N/m ² = 0.000145 psi (1 bar = 10 ⁵ N/m ²)
Dynamic Viscosity	1 lb-sec/ft. ² = 47.88 kg/m sec	1 N sec/m ² = .0209 lb-sec/ft. ² (1 poise = 1 dyne sec/cm ² = 0.1 N sec/m ²)
Kinematic Viscosity	1 ft./sec ² = 0.0929 m ² /sec 1 ft./sec ² = 929.02 stokes	1 m ² /sec = 10.764 ft./sec 1 stoke = 0.00108 ft. ² /sec (1 stoke = 1 cm ² /sec)
Energy, Work, Heat, Torque	1 ft-lb = 1.3558 Nm 1 ft-lb = 0.324 cal 1 Btu = 252 cal	1 Nm = 0.7376 ft-lb 1 cal = 0.00397 Btu

APPENDIX B

AREAS FROM PIPE DIAMETERS

Diameter			Area			Diameter			Area		
in	ft	cm	in ²	ft ²	cm ²	in	ft	cm	in ²	ft ²	cm ²
¼	0.0208	0.635	0.0491	0.000341	0.317	5	0.417	0.7	0.63	0.1363	126.7
½	0.0417	1.27	0.1963	0.001364	1.267	6	0.500	15.24	28.27	0.1963	182.4
1	0.0833	2.54	0.785	0.00545	5.067	7	0.583	17.78	38.48	0.2673	248.3
1½	0.125	3.81	1.767	0.01227	11.40	8	0.667	20.32	50.27	0.3491	324.3
2	0.167	5.08	3.142	0.0218	20.27	9	0.750	22.86	63.62	0.4418	410.4
2½	0.208	6.35	4.909	0.0341	31.67	10	0.833	25.4	78.54	0.5454	506.7
3	0.250	7.62	7.069	0.0491	45.60	12	1.0	30.48	113.1	0.7854	729.7
3½	0.292	8.89	9.621	0.0668	62.07	18	1.5	45.72	254.5	1.767	1642.
4	0.333	10.16	12.57	0.0873	81.07	24	2.0	60.96	452.4	3.142	2919.
4½	0.375	11.43	15.90	0.1104	102.6	36	3.0	91.44	1018.	7.069	6567.

Diameter			Area			Diameter			Area		
cm	in	ft	cm ²	in ²	ft ²	cm	in	ft	cm ²	in ²	ft ²
1	0.3937	0.0328	0.7854	0.1217	0.000845	12	4.724	0.3937	113.1	17.53	0.1217
2	0.7874	0.0656	3.142	0.4869	0.003882	14	5.512	0.4593	153.9	23.86	0.1657
3	1.181	0.0984	7.069	1.096	0.007609	16	6.299	0.5249	201.1	31.16	0.2164
4	1.575	0.1312	12.57	1.948	0.01353	18	7.087	0.5906	254.5	39.44	0.2739
5	1.969	0.1640	19.63	3.043	0.02113	20	7.874	0.6562	314.2	48.69	0.3382
6	2.362	0.1969	28.27	4.383	0.03043	25	9.843	0.8202	490.9	76.09	0.5284
7	2.756	0.2297	38.48	5.965	0.04142	30	11.811	0.9843	706.9	109.6	0.7609
8	3.150	0.2625	50.27	7.791	0.05411	35	13.780	1.148	962.1	149.1	1.036
9	3.544	0.2953	63.62	9.861	0.06848	40	15.748	1.312	1257.	194.8	1.353
10	3.937	0.3281	78.54	12.17	0.08454	45	17.717	1.476	1590.	246.5	1.712

APPENDIX C

DESCRIPTION OF INPUT DATA REQUIRED BY A COMPUTER PROGRAM WHICH SOLVES THE Q-EQUATIONS BY THE LINEAR THEORY METHOD

Listings of the computer programs which require the input data described herein are not given since these programs will likely be updated and improved with time. Two different versions of the program are available from the writer, and during the workshops conducted at USU will be stored on the computer system(s) for use. The first version is based on the Darcy-Weisbach equation and the friction factor equations which define its relationship to e/D and Re in the various regions of possible flow. The second version uses the Hazen-Williams equation to determine frictional head losses in pipes. The input data required by these two versions is nearly the same except that the wall roughness e is replaced by the Hazen-Williams coefficient C_{HW} and since the first version allows the use of either ES or SI units an additional input parameter is needed to communicate what units are being used. The input data to the first version (i.e. the program based on the Darcy-Weisbach equation) will be explained in detail. Thereafter the changes in data for the Hazen-Williams version will be explained. Each of these programs is written to allow for two different alternatives for the input data. Each of these alternates is described under the headings alternative No. 1 and alternative No. 2. Preceding the data required by each card (or cards) is the card field designator written as given in FORTRAN FORMAT statements using I for integer variables (values without a decimal point), F or E for real variables (values with a decimal point). For readers not acquainted with

FORTRAN the meaning of these field designations is explained below.

The number immediately following I, F, or E represents the field width or the number of columns in the card. The number before the I, F, or E is the number of times this field is repeated. The I denotes an integer variable without a decimal point. All such numbers must be "right justified" or punched so the last digit is in the last column of that field. For real or floating point variables F or E are used. Only F fields are used herein for input data. These data should be punched with a decimal point. The integer after the decimal point in the F-field indicates the number of digits to the right of the decimal. If a decimal point is punched into the card for F-fields this punched point supersedes the specification and consequently by placing decimal points in all real variable input data, the values need only lie within the designated columns.

As an example assume two integer and three real variables are to be given values through input data cards according to the format (2I5, 3F10.5). These five values are 3, 16, 105.2, 62.4, 101.85. The following values should be punched: 3 in column 5; 1 and 6 in columns 9 and 10; 105.2 somewhere within columns 11 through 20; 62.4 somewhere within columns 21 through 30; and 101.85 somewhere within columns 31 through 40.

1. Alternate form 1 for input data to program using Darcy-Weisbach equation.

Card No. 1 (12I5)

Column

- | | |
|-------|--|
| 1-5 | The number of pipes in the network. (Only real pipes.) |
| 6-10 | The number of junctions or nodes in the network. If this field is left blank, or given a zero value, the alternate form 2 is used for the input data, and the number of junctions is determined from the pipe data. Reservoirs, nor reservoir and pump combinations are not given junction numbers at the ends of the pipes they supply. |
| 11-15 | The number of real loops in the network. |
| 16-20 | The number of pseudo loops to be used in defining additional energy equations in addition to the energy equations for each real loop. |
| 21-25 | The maximum number of iterations which will be allowed in obtaining a solution. 10-15 is a reasonable maximum number. In the event that an error in input data causes nonconvergence, the maximum number of iterations prevents excessive, and useless computer time from being used. |
| 26-30 | An indicator of the accuracy required before iterative solutions are terminated when the sum of changes in flow rate between consecutive iterations does not change in this digit to the right of the decimal point the solution process is terminated. Thus if 2 is punched in column |

- 30 the solution will be given when the sum of flow rate changes overall pipes is less than 0.01 cfs (or 0.01 cms).
- 31-35 The number of devices in the network which cause significant minor losses.
- 36-40 If greater than zero, then values of the head at each junction of the network will be computed and printed.
- 41-45 If greater than 0 the pressures at each junction of the network will be computed and printed.
- 46-50 If greater than zero the input data must contain elevations at each junction of the network. This input datum is contained on a subsequent card as described later. If these columns of the card are left blank (or given a 0 value) all junctions are assumed at zero elevation with respect to heads given for reservoirs, or elevations from which pumps obtain their water.
- 51-55 Determines the amount of intermediate output that will be printed. If -1 no information about individual iterations is printed. If 0 the iteration number and the sum of changes in flow rate is printed. If 1, the flow rates in each pipe after each iteration are also printed.
- 56-60 If greater than 0, the pipe numbers at junctions along with the external flow at the junction are printed. Also the pipe numbers in each loop of the network are printed. Printing this information allows for checking whether correct data were supplied as input for the solution.

Card No. 2 (4I5, 3F10.5)

- 1-5 Specifies the type of units associated with the subsequent input data. If 0 both the pipe diameters D and wall roughness e are in inches but the pipe lengths L in feet. If 1 the units of D , e , and L are feet. If 2 the units of D , e , and L are meters. If 3 the units of D and e are centimeters and L meters.
- 6-10 The number of pumps which exist in the network.
- 11-15 The number of these pumps which are only booster i.e. pumps which do not supply flow to the system but increase the pressure in the pipeline in which they exist.
- 16-20 The number of reservoirs, *exclusive* of those from which pumps obtain water, which supply water to (or receive water from) the pipe network.
- 21-30 The kinematic viscosity of the fluid in units of ft^2/sec^2 if ES units are used or m^2/sec^2 if SI units are used. (According to specification in columns 1-5.)
- 31-40 The fraction of the flow rate in each pipe which will be subtracted from and added to the flow rate to establish the range over which K and n of the exponential formula apply. A nominal value is .1. If left blank 0.1 is assumed.
- 41-50 The specific weight γ of the fluid, 62.4 lb/ft^3 (9800 N/m^3) if water is the fluid. If left blank (or assigned zero) 62.4 is assumed.

The following card numbers will vary depending upon the previous input data as described.

Next card (16I5)—(If no reservoir is specified on card 2 neither this card nor the next card exist.)

This data card contains the pipe numbers which connect each reservoir to the remainder of the system.

Next card (8F10.5)—(If no reservoir is specified on card 2 neither this card nor the previous card exist.)

This card contains the elevation in feet (or meters) of the water surfaces in the reservoirs, in the same sequence as established on the previous card.

Next card (16I5)—(If no pumps were specified on card 2 then this card and the following cards containing the characteristic data do not exist.)

This card contains the pipe numbers containing the pumps. Pipe numbers containing booster pumps must follow pipe numbers containing pumps which supply fluid to the network.

Next card (7F10.5)—(If no pumps were specified on card 2 then neither these cards nor the previous card exist.)

For each pump specified on card 2, a separate data card is required which contains values of three points along the characteristic curve of the pump giving the flow rate in cfs (or mps) and the corresponding head in feet (or meters) and the elevation of the water surface in feet (or meters) from which the pump obtains its supply. The data on each card is Q_{p1} , h_{p1} , Q_{p2} , h_{p2} , Q_{p3} , h_{p3} , and elevation. The sequence of these pump characteristic curve cards is the same as that established on the previous card. No elevation data are needed (or used) for booster pumps.

Next card (15,F10.5)—(If no reservoirs and no pumps were specified so that the previous four groups of cards do not exist then this card exists. Otherwise it does not exist.)

This card establishes the elevation of the HGL at a designated junction. Right justified in column 5 is the designated junction (node) number and in columns 6 through 15 the elevation of the HGL at this junction is given.

Next cards* (8F10.5)

In the same sequence as the pipes are numbered this card (or these cards if more than 8 pipes exist in the network) contains the pipe diameter in the units indicated on card 2.

Next cards* (8F10.5)

In the same sequence as the pipes are numbered these cards (or this card if fewer than eight pipes exist in the network) contain the length of each pipe in the units indicated on card 2.

Next cards* (8F10.5)

In the same sequence as the pipes are numbered, these cards (or this card if fewer than eight pipes exist in the network) contain the wall roughness e of each pipe in the units indicated on card 2.

Next cards* (16I5 followed by a card F10.5 if external flow exists at the junction)

This sequence of cards contains information giving pipe numbers and external flows at each junction of the network. A separate card is required (or two separate cards are required if an external flow exists) for each junction.

Column

- 1-5 Contains a 0 if no external flow exists at this junction; contains a 1 if the existing external flow is specified on the following card in gal/min (gpm); contains a 2 if the existing external flow is specified on the following card in ft^3/sec (or m^3/sec if SI units are used throughout).
- 6-10 Contains the number of pipes which meet at this junction.
- 11- Contain in subsequent fields of five column widths the pipe number which meet at this junction. As many of these pipe numbers as designed in columns 6-10 will be read. If the assumed direction of flow in the pipe is *away from* the junction then the pipe number is positive. If the assumed direction of flow in the pipe is *into* the junction the pipe number is preceded by a minus sign.

Following this card for each junction another card exists if columns 1-5 contain 1 or 2 which gives the external flow at the junction. If this flow is into the junction its value is preceded by a minus sign. If columns 1-5 of this junction card contain a 0 this card giving the external flow does not exist.

Next cards* (16I5)

This sequence of cards contains information giving the pipe numbers which exist in each loop of the network. A separate card is needed for each real as well as pseudo loop. These cards contain the following data:

Columns

- 1-5 Contains the number of pipes which exist in this loop.
- 6- Contains in subsequent fields of five column widths the pipe numbers in this loop. If the assumed direction of flow is opposite to a clockwise (i.e., a counterclockwise) direction around this loop then the pipe number is preceded by a minus sign.

Next card (8F10.5)—(This card does not exist if card 2 specified that all junctions were at elevation 0.)

In the sequence established by the preceding junction cards, the elevations of each junction are supplied in feet (or meters if SI units are used throughout).

Next card (16I5)—(Neither this card nor the next card exist if no devices causing significant minor losses are present as specified on card 1.)

In consecutive five column fields this card contains the pipe number in which devices, such as valves and meters, which cause minor losses exist.

Next card (8F10.5)—(Neither this card nor the previous card exist if no devices which cause significant minor losses exist.)

In consecutive 10 column fields this card contains the minor loss coefficient for the devices in the sequence established on the previous card.

*Cards denoted by an * are replaced by alternate cards as described subsequently under "alternate form 2," if this second form for input is selected.

2. **Alternate form 2 for input data to program using Darcy-Weisbach equation.**

The input data required under this alternate form is the same as given above under form 1 except that those cards distinguished by an * are replaced by the input data cards described below. That is cards giving the pipe diameters, lengths and wall roughnesses as well as the cards giving the pipes meeting at junction and the cards giving the pipe numbers around each loop are replaced by the following cards. To use this form 2 for input data, the columns 6-10 on card 1 which specify the number of junctions in the network should be left blank (or assigned zero).

First replacement card (I5) contains an integer which if equal to 1 designates external flows are specified in units of gpm; if equal to 2 designates external flows are specified in units of cfs (or cms if SI units are used).

Subsequent replacements are for each pipe in the network and contain the following input data (I5, 3F10.5, 2(I5, F10.5), 3I5):

Columns

- 1-5 The number of the pipe for which this card applies. (These numbers do not need to exist in sequence.)
- 6-15 The diameter of the pipe in units as specified on card no. 2.
- 16-25 The length of the pipe in units as specified on card no. 2.
- 26-35 The wall roughness of the pipe in units as specified on card no. 2.
- 36-40 The junction number at the end of the pipe from which the flow is assumed to come. Since pipes, which supply the network from reservoirs or from pumps taking water from reservoirs, do not contain a junction number at their supply end this field should be left blank (or assigned a zero value) if at a reservoir or reservoir-pump combination. Since the junction number at the other end of the pipe (columns 51-55) is the only number for such supply pipes all such flows must be assumed from the reservoir into the network. If the flow is into the reservoir this flow will appear as a minus in the solution.
- 41-50 The external flow rate in the units designed on the first replacement card. If this flow rate is into the network its magnitude is preceded by a minus sign.
- 51-55 The junction number at the end of the pipe toward which the assumed flow is going.
- 56-65 The external flow rate in the units designated on the first replacement card. If this flow rate is into the network its magnitude is preceded by a minus sign.
- 66-70 The number of the loop to one side of the pipe for which this card applies. If the assumed direction of flow in this pipe is opposite to the positive clockwise direction around the loop, this loop number is preceded by a minus sign.
- 71-75 The number of the loop on the other side of the pipe for which this card applies. If no loop exists on the other side leave this field blank (or zero). If the assumed direction of flow in this pipe is opposite to the positive clockwise direction around the loop, this loop number is preceded by a minus sign.
- 76-80 Same as in 71-75 if a third loop exists.

In preparing the preceding data deck it will be noted that external flows will be duplicated if the described format is followed since most junction numbers will appear twice. External flows do not need to be duplicated, however. If the external flow at a junction has already been specified

all subsequent fields which might contain the same external flow value might be left blank (but may be duplicated if desired). All external flows must appear on at least one card, however.

3. **Alternate form 1 for input data to program using the Hazen-Williams formula.**

All input data are identical to that described under 1. Alternate form 1 for input data to program using the Darcy-Weisbach equation with two exceptions. The first is that card number 2 does not contain the designator of the type of units to be given. Rather this designator has been deleted and the columns into which the subsequent data

are punched are reduced by five from that designated above.

The second exception is that the card or cards containing the wall roughness e , contain instead values for the Hazen-Williams coefficient C_{HW} .

4. **Alternate form 2 for input data to program using the Hazen-Williams formula.**

All input data are as described under 2. Alternate form 2 for input data to program using the Darcy-Weisbach equation with the first exception noted under the previous section, and that the wall roughness in

columns 26-35 of the individual cards for each pipe contain the Hazen-Williams coefficient C_{HW} instead of the wall roughness e .

APPENDIX D

DESCRIPTION OF INPUT DATA REQUIRED BY A COMPUTER PROGRAM WHICH SOLVES THE ΔQ -EQUATIONS BY THE NEWTON-RAPHSON METHOD¹

This program is based on the Hazen-Williams formula or the Manning formula for determining frictional head losses in pipes. If the Hazen-Williams formula is used the flow rates are in gpm; if the Manning formula is used the flow rates are in millions of Imperial gallons per day. The method used in the program requires less core storage than the program(s) whose input was described in Appendix C. The program itself consists of approximately four times as many FORTRAN statements as the program(s) of Appendix C, and therefore considerably more compilation time is required. Much of this additional code simplifies the amount of input data required to define a pipe network. The program includes an algorithm to find the "natural" set of loops in the network. The program also contains the logic required to calculate reasonable initial flows in each pipe as required by the Newton-Raphson method of solution. Consequently the input data are kept to a minimum.

The program requires that at least one reservoir be specified as part of the system. If only one reservoir exists it is considered the reference junction for computation of the HGL and EL. If two or more reservoirs exist the program searches out a pseudo loop (i.e. a series of pipes joining the two reservoirs). Depending upon the location of these reservoirs the band width of the Jacobian may be substantially increased with an accompanying increase in computations needed. The first reservoir listed is considered the reference reservoir and pipe sequences from all other reservoirs are sought in the computer program

which are connected to this reservoir. The band width of the Jacobian can be maintained smaller by specifying as the first reservoir one that is as close as possible to all reservoirs (i.e. as few a number of pipes between the reservoirs as possible).

The computer program whose input is described in Appendix C does not assume that reservoirs, or reservoir-pump combinations are associated with a junction number. In that program only the pipe number is identified that receives water from such sources. In this program, however, reservoirs and reservoir-pumps are identified by a node or junction number at the end of the supply line. Consequently it is necessary to assign a junction number to reservoirs and reservoir-pump combinations. The flow from the reservoir or reservoir-pump at this junction is handled as an inflow to this junction.

Pump characteristics for pumps supplying flow to the network are specified by supplying the A's to the following equation:

$$h_p = h_o (1 + A_1 Q_p + A_2 Q_p |Q_p| + A_3 Q_p |Q_p|^2) \dots \dots \dots (D-1)$$

and the elevation of the water supply for the pump is specified by A₄.

The input data required by the program to define a problem are as follows:

Card No. 1 (20A4)

Contains any alpha-numeric data used to distinguish the pipe network.

Card No. 2 (2I5,2F10.5)

Columns

- 1-5 If 0 the Hazen-Williams formula is used to compute the frictional head losses. If 1 the Manning equation is used.
- 6-10 If 0 a considerable amount of intermediate information will be printed. If 1 only the final solution is printed.
- 11-20 Contains the error parameter by which the iterative solution process is terminated. When the absolute largest change in flow rate becomes less than this value the solution is assumed sufficiently accurate.
- 21-30 Contains a multiplicative factor that multiplies the specified external flows to allow for solutions to problems in which the demands (or consumptions) may increase (or decrease) by a factor of that used in a previous solution. Thus only one value need be changed instead of the entire data deck.

¹This program was obtained from Fowler; see Epp, R., and A. G. Fowler, 1970, "Efficient Code for Steady-State Flows in Networks," Jour. of the Hydraulics Div., ASCE, 96(HY1):43-56, January.

Card No. 3 (3I5)

Columns

- 1-5 The number of pipes in the network.
- 6-10 The number of junctions in the network.
- 11-15 Maximum number of iterations allowed.

Next cards (3I5, 5X, 3F10.5)

For each pipe in the network a card is required with the following data:

Columns

- 1-5 The pipe number.
- 6-10 The junction number at the end of the pipe from which the flow is assumed to come.
- 11-15 The junction number at the end of the pipe to which the assumed flow is going.
- 21-30 The length of the pipe in thousands of feet.
- 31-40 The diameter of the pipe in inches.
- 41-50 The roughness coefficient consistent with the equation specified on card no. 2.

Next cards (I5, F5.2, 2F10.5)

For each junction in the network a card is required with the following information:

Columns

- 1-5 The junction number.
- 6-10 The fraction of the inflow at this junction.
- 11-20 The demand (or consumption) at this junction. This magnitude is preceded by a minus sign if into the junction. It is not possible to specify non-zero values in columns 6-10 and 11-20 simultaneously since a junction cannot have inflow and consumption at the same time. The computer sums up the total consumptions and proportions the inflow according to the fractions indicated. If reservoir supply inflow, these inflows will be adjusted to satisfy problem conditions.
- 21-30 The elevation of the junction in feet.

Next card (2I5)

Columns

- 1-5 The number of reservoirs.
- 6-10 The number of booster pumps.

Next cards (2I5, 5E10.5)

For each junction supplied by a pump-reservoir combination a card is required with the following data:

Columns

- 1-5 The junction number.
- 6-10 The number of pumps acting in parallel.
- 11-20 The cut-off head of the pump, i.e. the value of h_0 in Eq. D-1.
- 21- The values of $A_1, A_2, A_3,$ and A_4 in Eq. D-1 in consecutive 10 column fields.

Note: The program assumes flow into the node specified at the reservoir and pump and therefore Q in Eq. D-1 is negative since flows into junctions are assumed negative. Therefore if flow is into the network the coefficient in Eq. D-1 must be determined for negative Q .

Next cards (2I5, 5E10.5)

For each booster pump a card containing the following data is required:

Columns

- 1-5 The pipe number containing the booster pump.
- 6-10 The number of pumps in parallel.
- 11- In consecutive columns, the values of $h_B, B_1, B_2, B_3,$ and B_4 defining the pump characteristic by the equation:

$$h_p = h_B (1 - B_1 Q - B_2 Q |Q| - B_3 Q |Q|^2 - B_4 Q |Q|^3)$$

APPENDIX E

DESCRIPTION OF INPUT DATA REQUIRED BY PROGRAM WHICH USES THE HARDY-CROSS METHOD OF SOLUTION¹

The frictional head loss computations are based on the Hazen-Williams equation. Data input required by the program is free form. No data specifying pipes in loops are required.

Data Card Format

Each data card is identified by a key word in columns 1 to 4 which describes the card type. The other information on the card must appear in the order indicated but has no column restrictions. Each data item must be separated by one or more blanks. There is no restriction on the order of the cards except that an entire problem must be described prior to the EXEC card.

Card Types

JOB TITLE

EX:

JOB SAMPLE PROBLEM

This card may be used to identify the problem. The information contained on this card is printed at the top of each page of output.

LINE FM TO DIAMETER · LENGTH "C" (Optional)

EX:

LINE 3 18 3.0 250.0

The line cards describe the pipe network to be analyzed. FM and TO are the user assigned junction numbers at the ends of the line. Only one line may be specified between any two junction numbers. The diameter must be given in inches and the length in feet. The Hazen-Williams coefficient "C" may be supplied. If it is omitted the general value supplied on the COEF card will be used for this pipe.

One line must be specified for each network.

PUMP JUNCTION PRESSURE (in psi)

TANK JUNCTION PRESSURE (in feet of head)

EX:

TANK 15 115.0

The TANK or PUMP card is used to specify the pressure at points of variable flow input or output.

INPU JUNCTION FLOW (in gpm)

EX:

INPU 12 25.0

The INPU card is used to specify a constant flow input at a particular junction.

OUTP JUNCTION FLOW (in gpm)

EX:

OUTP 25 30.0

The OUTP card is used to specify a constant flow output or take-off from the system.

ELEV JUNCTION ELEVATION (in feet)

EX:

ELEV 10 315.0

ELEV cards are used to specify the elevation of the junctions where the user desires to know the pressure in the system.

ACCU ITERATIONS CHANGE

EX:

ACCU 25 2.0

This card is used to specify the accuracy desired in the solution. The maximum number of iterations or the maximum change in flow in any pipe will be used to terminate the iterative solution. If this card is omitted, the number of iterations is set at a maximum of 50 and the change is set at 1 gpm.

COEF HAZEN-WILLIAMS "C"

EX:

COEF 110.0

This card is used to specify a standard Hazen-Williams coefficient.

EXEC

This card indicates that a complete problem has been specified and that solution may begin.

END

This card should be the last data card in the deck. It causes control of the computer to be returned to the executive system.

¹This program with slight alterations was written by Corey, M. W. "A Problem Oriented Computer Program for the Analysis of Pipe Networks (PNET)," Civil Engineering, Mississippi State University.

Multiple Executions

This feature allows the user to analyze several modifications of a system in a single computer run.

Inputs and outputs may be changed, added or deleted by use of the INPU or OUTP cards.

Variable flow information may be added, changed or deleted by use of the PUMP or TANK card. Deletion is accomplished by specifying a zero pressure.

Elevations may be added, changed or deleted by use of ELEV cards. Deletion is accomplished by specifying a zero elevation.

A new problem description may be entered with a JOB card.

The accuracy parameters may be changed with an ACCU card.

The standard Hazen-Williams coefficient may be changed with a COEF card.

New pipes may be added or pipe characteristics may be changed by use of the LINE cards. Pipes may be deleted by specifying a zero diameter.

The new solution will begin when an EXEC card is encountered. There is no limit on the number of solutions which may be specified.