

Distribution network reconfiguration for loss reduction using PSO method

Yahiaoui Merzoug, Bouanane Abdelkrim, Boumediene Larbi

L. G. E Laboratory, Department of Electrical Engineering, Dr. Moulay Taher University of Saida, Algeria

Article Info

Article history:

Received Sep 13, 2019

Revised Mar 29, 2020

Accepted Apr 11, 2020

Keywords:

Loss reduction

Particle swarm optimization

distribution network

reconfiguration

Voltage profile

ABSTRACT

In recent years, the reconfiguration of the distribution network has been proclaimed as a method for realizing power savings, with virtually zero cost. The current trend is to design distribution networks with a mesh network structure, but to operate them radially. This is achieved by the establishment of an appropriate number of switchable branches which allow the realization of a radial configuration capable of supplying all of the normal defects in the box of permanent defect. The purpose of this article is to find an optimal reconfiguration using a Meta heuristic method, namely the particle swarm optimization method (PSO), to reduce active losses and voltage deviations by taking into account certain technical constraints. The validity of this method is tested on a 33-IEEE test network and the results obtained are compared with the results of basic load flow.

Copyright © 2020 Institute of Advanced Engineering and Science.

All rights reserved.

Corresponding Author:

Yahiaoui Merzoug,

L. G. E Laboratory, Department of Electrical Engineering,

Dr. Moulay Taher University of Saida,

BP 138 En-Nasr, (20000 Saida), Algeria.

Email: myahiaoui2001@yahoo.fr

1. INTRODUCTION

Electric power has become a consumer good worldwide for both everyday life and the economy of the country, and the smallest electrical problems have a great influence on the continuity of economic activities. Therefore, the possession of reliable and cost-effective electricity networks that function properly and ensure continuity of service and good quality energy has become essential to make a positive contribution to the development of our modern societies.

The distribution network must evolve into a flexible and intelligent network that best integrates local and/or renewable energies. The opening of the electricity market and growing environmental concerns related to global climate change are driving significant changes, particularly in the distribution networks, with the massive influx of decentralized products. This development can be envisaged by developing intelligent systems capable of minimizing the impacts generated by the insertion of decentralized productions and/or the search for new architectures. These two solutions should make it possible to increase the rate of decentralized production in the distribution network in the best economic and security conditions [1].

The major problem for network managers is to propose better planning for a better management of the transit of power. From the production centers to the consumer, transmission lines inflict large losses of energy, whether active or reactive, much more in the distribution networks where about 14% of the power transiting these lines is lost [2]. All of these losses affect the quality of the voltage delivered to customers. For this purpose, the study of the power flow (Load flow) makes it possible to have the solution of the magnitudes of an electrical network in normal operation balanced in steady state. Load flow analysis in an electrical grid consisting of a number of generators, transmission lines and loads is very important for the design, planning and operation of an electrical network [3, 4]. The scheduler of this network can easily evaluate the impact of different transmission and generation configurations for any desired load level.

This makes it possible to know the conditions of production and load and the levels of the voltages of the network and several remediation techniques are put into use to circumvent this problem. Among these solutions, we mention the decentralized productions that are increasingly present on the market. The conventional techniques used in decentralized production offer the network a better quality of energy, on the other hand their need for raw material as well as their impacts on the environment make of them undesirable means of production, on top of that their time and cost of realization are excessive [5, 6]. For this decentralized production based on renewable energy is a promising alternative, the cost of implementation and maintenance is much lower than those mentioned before, their completion time is far shorter. On top of that, renewable energies are non-polluting. However, these are not magical solutions, because their impacts on the network and on the quality of energy impose the insertion of filtering, regulation and compensation means.

The incorporation of components such as FACTS devices and capacitors into the distribution system to reduce power losses comes with a high cost of implementation [7, 8]. It is necessary to reduce unnecessary expenses if there are better and cheaper alternatives to the costly options. Therefore, network reconfiguration which does not require any other additional components apart from switch manipulation of the already existing network system has been considered.

2. MATHEMATICAL MODEL

A single line diagram of the distribution power system is displayed in Figure 1 and the mathematical equation for the power flow of the system can be stated as [9, 10]:

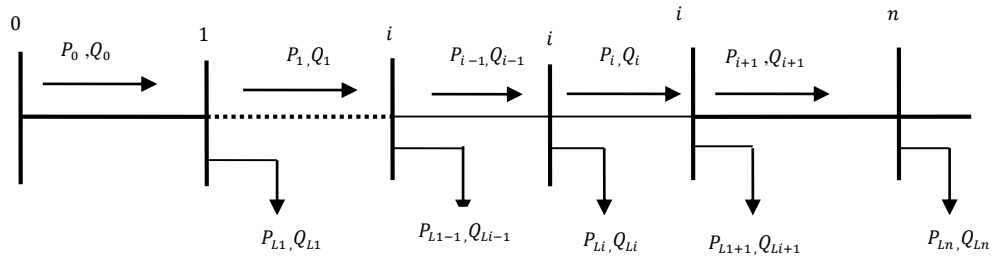


Figure 1. Single line diagram of a radial distribution network

The aim of this paper is to find the optimal reconfiguration of the network that will offer minimum power loss and voltage deviations. Single line diagram of a simple feeder-line configuration is shown in Figure 1. A set of recursive equations for computation of power flow is given by:

$$P_{i+1} = P_i - P_{Li+1} - R_{i,i+1} \cdot \frac{P_i^2 + Q_i^2}{|V_i|^2} \quad (1)$$

$$Q_{i+1} = Q_i - Q_{Li+1} - X_{i,i+1} \cdot \frac{P_i^2 + Q_i^2}{|V_i|^2} \quad (2)$$

$$|V_{i+1}|^2 = |V_i|^2 - 2(R_{i,i+1} \cdot P_i + X_{i,i+1} \cdot Q_i) \cdot \frac{P_i^2 + Q_i^2}{|V_i|^2} \quad (3)$$

where, P_i and Q_i are the real and reactive power flowing out of bus i ; P_{Li+1} and Q_{Li+1} are the real and reactive load powers at bus $i + 1$. Line section between buses i and $i + 1$ has resistance $R_{i,i+1}$ and reactance $X_{i,i+1}$. Voltage magnitude of bus i is $|V_i|$. For convergence of power flow, the power balance (1) and (2) must be satisfied in addition, magnitudes of sending and receiving end bus voltages must satisfy (3).

The well known generalized formulas for real and reactive power loss in the line section between buses i and $i + 1$ are calculated by using the following equations:

$$P_{Loss(i,i+1)} = R_{i,i+1} \cdot \frac{P_i^2 + Q_i^2}{|V_i|^2} \quad (4)$$

$$Q_{Loss(i,i+1)} = X_{i,i+1} \cdot \frac{P_i^2 + Q_i^2}{|V_i|^2} \quad (5)$$

The total active and reactive power loss of the distribution system can be easily found by summing all of the branch power loss and it is expressed as:

$$P_{tloss} = \sum_{i=1}^{nbr} P_{Loss}(i, i + 1) \quad (6)$$

$$Q_{tloss} = \sum_{i=1}^{nbr} Q_{Loss}(i, i + 1) \quad (7)$$

where, P_{tloss} is the total real power loss and Q_{tloss} is the loss incurred due to reactive power throughout the network [11, 12].

3. PARTICLE SWARM OPTIMIZATION

3.1. Introduction

PSO particle swarm optimization is a parallel optimization technique developed by Kennedy and Eberhart [13-16]. It is inspired by the social behavior of individuals who tend to imitate the successful behaviors they observe around them, while bringing their personal variations. Kennedy and Eberhart, proposed in 1995 a new optimization method called Optimization by Swarm of Particle PSO, is a stochastic optimization method based on a population of particles a Swarm groups together several particles. Each particle makes its decision using its own experience and the experiences of its neighborhood. PSO is inspired by the social behavior of flocks of birds and schools of fish which tend to imitate the successful behaviors they observe around them, while bringing their personal variations to it. PSO starts the process of optimization by a population of random solutions that move in the search space. The position of each particle is represented by its coordinates along the two XY axes and also by its speed which is expressed by Vx (the speed along the x axis) and Vy (the speed along the x axis) [17-19].

In PSO, two different definitions are used: the individual best and the global best. As a particle moves through the search space, it compares its fitness value at the current position to the best fitness value it has ever attained previously. In PSO, to adjust the position, velocity of each particle is calculated using current position x_i , best position of particle so far $Pbest$ and global best position of particle in population $Gbest$. Velocity of each particle in the next generation can be calculated as:

$$V_i^{k+1} = wV_i^k + c_1r_1(Pbest - x_i^k) + c_2r_2(Gbest - x_i^k) \quad (8)$$

where r_1 and r_2 are random numbers between 0 and 1 while c_1 and c_2 are positive constants, respectively. Inertia weight w is formulated as follows:

$$w = w_{max} - \frac{w_{max} - w_{min}}{iter_{max}} iter \quad (9)$$

where w_{max} and w_{min} are maximum and minimum of inertia weight, $iter_{max}$ and $iter$ are maximum iteration number and current iteration, respectively. Current position or searching point can be modified by the following equation.

The objective function to consider is to minimize active power losses and minimize deviations from nodal voltages that can be formulated as being the overlay of two separate objective functions. Where,

$$F = f_1 + f_2 \quad (10)$$

The first function f_1 represents the power loss sensitivity index obtained by the ratio of losses after reconfiguration to power losses before reconfiguration which can be formulated as follows:

$$f_1 = \frac{P_{loss}^{reconf}}{P_{loss}^{initial}} \quad (11)$$

The power losses before reconfiguration are determined by the following equation:

$$P_{loss}^{initial} = \sum_{i=1}^{nl} R_i \left(\frac{P_i^2 + Q_i^2}{V_i^2} \right) \text{ for } i = 1, 2 \dots nl \quad (12)$$

The second function represents the voltage sensitivity index it is also obtained by

$$f_2 = \frac{\Delta V_{total}^{reconf}}{\Delta V_{total}^{initial}} \tag{13}$$

with V_{dev}^{reconf} deviation value after reconfiguration and $V_{dev}^{initial}$ initial deviation before reconfiguration. The voltage difference is calculated as

$$\Delta V_{total}^{initial} = \sum_{j=1}^{NB} |1 - V_j| \text{ for } j = 1, 2, \dots, NB \tag{14}$$

Taking into account technical constraints to solve the problem to find the optimal reconfiguration.

4. CONSTRAINTS [20-22]

The constraints are listed as follows:

- a) Distribution line absolute power limits:

$$|P_{ij}^{Line}| \leq P_{ijmax}^{Line} \tag{15}$$

$|P_{ij}^{Line}|$ and P_{ijmax}^{Line} Are the absolute power and its corresponding maximum allowable value flowing over the distribution line between the nodes i and j , respectively.

- b) Bus voltage limit:

Bus voltage amplitudes are limited as

$$Vmin \leq Vi \leq Vmax \tag{16}$$

where $Vmin$ and $Vmax$ are the minimum and maximum values of bus voltage amplitudes, respectively.

4.1. Case Studies

The system used for this method is tested on standard IEEE 33 bus test system as shown in Figure 2. The system load is assumed to be constant with $Sbase = 100MVA$ and $Vbase = 12.66kV$. The load and line data is referred in [23-25]. The total load of the system is 3715kW and 2300kVar. All calculation is in per unit. The simulations were carried out by using MATLAB. The result with minimum power loss is selected as shown in Table 1. The result show that the power losses for case 1 are 208.4592 kW and reduce to 33.355% for case 2. Figure 3 shows the network reconfiguration switchers.

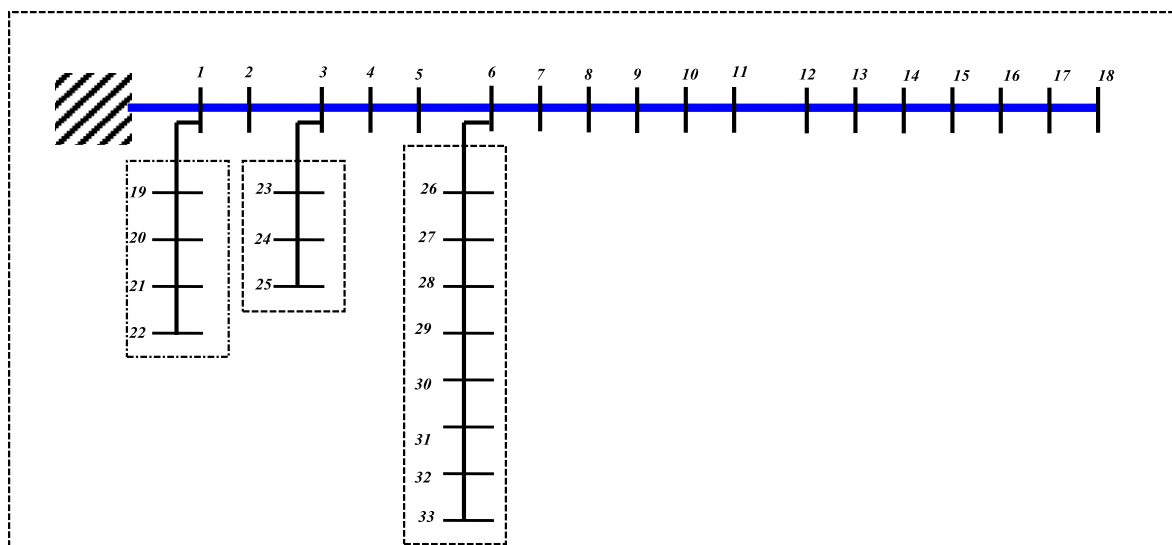


Figure 2. Single line diagram of 33 bus electric distribution

Table 1. The result consists of 5 opened switches, total power losses, voltage profile

	Before Reconfiguration	After Reconfiguration
Tie switches	33 34 35 36 37	7 9 14 32 37
Power loss	208.4592 kW	138.9275 kW
Minimum voltage	0.91075 pu	0.94234 pu
Power loss reduction	-	33.355 %

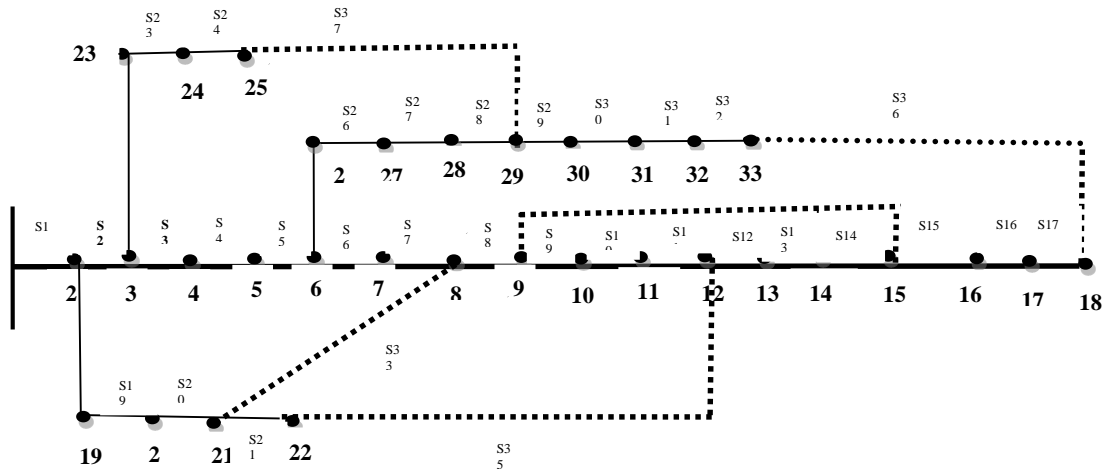


Figure 3. Optimized configuration of 33 bus test system

Figure 4 shows the comparison of the voltage profile before and after network reconfiguration for case 1 and case 2, respectively. The network before reconfiguration is represented by case 1. The minimum voltage in case 1 was 0.91075p.u at node 18. With the PSO algorithm for optimum switching, the configuration in case 1 was converted into case 2. The result of voltage improvement became 0.94234 p.u at node 32 as shown in case 2 of Figure 4.

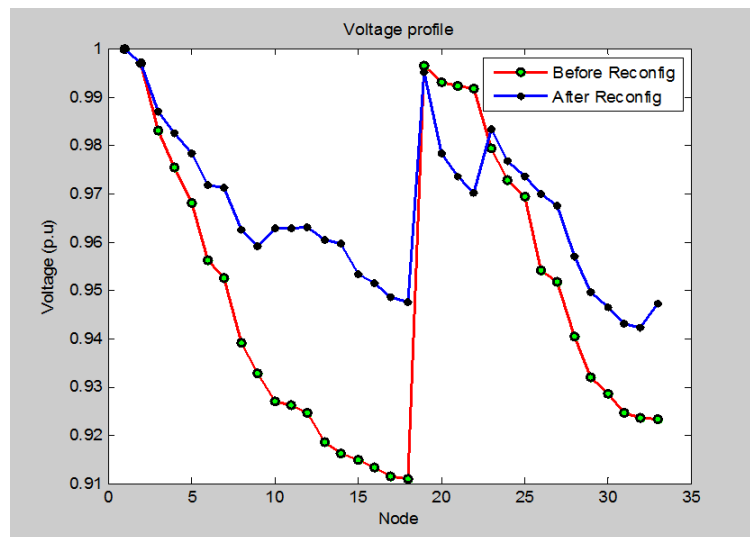


Figure 4. Voltage profile

The comparison for the real power losses in the branches is shown in Figure 5 for the initial network before and after reconfiguration (case 1 and case 2), respectively. The power losses in almost every branch in case 2 reduced, except at 18, 19, 20, 21, 33, 34 and 35, where there was a small increase in losses due to load shifting of the feeders altered by the switching as depicted in Figure 5.

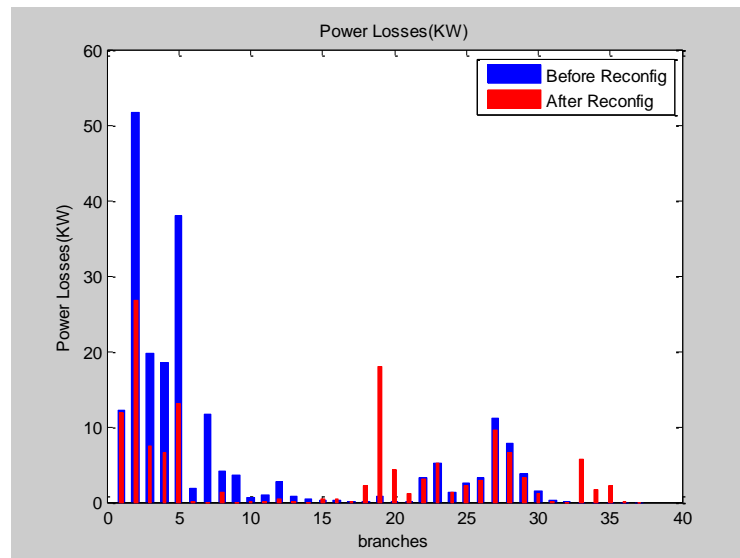


Figure 5. Real power losses in 33-bus system

5. CONCLUSION

Finally, based on the result, we went from an initial configuration with high power losses and unstable voltage at an optimal configuration including lower power losses and more stable voltage, and therefore the optimal result shows us the efficiency of the reconfiguration process in terms of reducing power losses and improving the voltage profile, and this represents a great economic and technical advantage. As a prospect, apply this approach to a large distribution network in the presence of renewable sources and determine their size and location in the distribution network.

REFERENCES

- [1] F. Bouffard and D. S. Kirschen, "Centralised and distributed electricity systems," *Energy Policy*, vol. 36, no. 12, pp. 4504-4508, 2008.
- [2] Liu M., "Public transportation proportion of Beijing reached 46 % in 2013," Beijing Daily, 2014.
- [3] O. A. Afolabi, et al., "Analysis of the Load Flow Problem in Power System Planning Studies," *Energy and Power Engineering*, vol. 7, pp. 509-523, 2015.
- [4] A. Keyhani, et al., "Evaluation of power flow techniques for personal computers," *IEEE transactions power systems*, vol. 4, no. 2, pp. 817-826, 1989.
- [5] M. S. Arkan and H. Salehi, "Application of Particle Swarm Optimization for Optimal Distributed Generation Allocation to Voltage Profile Improvement and Line Losses Reduction in Distribution Network," *Research Journal of Applied Sciences, Engineering and Technology*, vol. 5, no. 20, pp. 4791-4795, 2013.
- [6] J. Kennedy and R. Eberhart, "Particle Swarm Optimization," *Proceedings of International Conference on Neural Networks (ICNN'95)*, vol. 4, pp. 1942-1948, 1995.
- [7] C. T. Su and C. S. Lee, "Network reconfiguration of distribution systems using improved mixed-integer hybrid differential evolution," *IEEE Transaction on Power Delivery*, vol. 18, no. 3, pp. 1022-1027, Jul 2003.
- [8] M. A. Kashem, et al., "A Novel Method for Loss Minimization in Distribution Networks," in *Proceedings of International Conference on Electric Utility Deregulation and Restructuring and Power Technologies*, pp. 251-255, 2000.
- [9] Y. Merzoug, et al., "Optimal Placement of wind turbine in a Radial Distribution Network using PSO Method," *International Journal of Power Electronics and Drive System*, vol. 11, no. 2, pp. 1074-1081, 2020.
- [10] P. P. Biswas, et al., "A multiobjective approach for optimal placement and sizing of distributed generators and capacitors in distribution network," *Applied Soft Computing*, vol. 60, pp. 268-280, 2017.
- [11] A. D. T. Le, et al., "Maximising Voltage Support in Distribution Systems by Distributed Generation," in *TENCON 2005 - 2005 IEEE Region 10 Conference*, Melbourne, Qld., pp. 1-6, 2005.
- [12] M. H. Moradi and M. Abedini, "A Combination of Genetic Algorithm and Particle Swarm Optimization for Optimal DG location and Sizing in Distribution System," *Electrical Power and Energy System*, vol. 34, pp. 66-74, 2012.
- [13] D. Ramey, et al., "Use of FACTS Power Flow Controllers to enhance Transmission Transfer Limits," *Proceedings American Power Conference*, vol. 56, no. 1, pp. 712-718, Apr 1994.
- [14] A. B. Kunya, et al., "Distribution Network Reconfiguration for Loss Reduction and Voltage Profile Improvement using B-PSO," *ICAT'16 International Conference on Advanced Technology & Sciences*, vol. 3, 2016.

- [15] M. P. Lalitha, et al., "Optimal DG Placement for Minimum Real Power Losses in Radial Distribution System Using PSO," *Journal of Theoretical and Applied Information Technology*, vol. 13, no. 2, pp. 107-116, 2010.
- [16] R. K. Singh and S. K. Goswami, "Optimum Allocation of Distributed Generation based on Nodal Pricing for Profit, Loss Reduction, and Voltage Improvement including Voltage Rise Issue," *International Journal of Electrical Power and Energy System*, vol. 32, no. 6, pp. 637-644, 2010.
- [17] Z. Yan, et al., "A Novel Two-subpopulation Particle Swarm Optimization," *Proceedings of the 10th World Congress on Intelligent Control and Automation*, pp. 4113-4117, 2012.
- [18] H. Li, et al., "An improved distribution network reconfiguration method based on minimum spanning tree algorithm and heuristic rules," *International Journal of Electrical Power and Energy Systems*, vol. 82, pp. 466-473, 2016.
- [19] Y. C. Huang, "Enhanced genetic algorithm-based fuzzy multi objective approach to distribution network reconfiguration," *IEE Proceedings Generation, Transmission and Distribution*, vol. 149, no. 5, pp. 615-620, 2002.
- [20] L. W. de Oliveira, et al., "Optimal reconfiguration of distribution systems with representation of uncertainties through interval analysis," *International Journal Electrical Power and Energy Systems*, vol. 83, pp. 382-391, 2016.
- [21] O. Badran, et al., "Optimal switching sequence path for distribution network reconfiguration considering different types of distributed generation," *IEEEJ Transaction on Electrical and Electronic Engineering*, vol. 12, no. 6, pp. 874-882, 2017.
- [22] S. Jena and S. Chauhan, "Solving Distribution Feeder Reconfiguration and concurrent DG Installation problems for Power loss Minimization by MultiSwarm Cooperative PSO algorithm," 2016 *IEEE/PES Transmission and Distribution Conference and Exposition*, pp. 1-9, 2016.
- [23] J. P. Chiou, et al., "Variable scaling hybrid differential evolution for solving network reconfiguration of distribution systems," *IEEE Transactions on Power Systems*, vol. 20, no. 2, pp. 668-674, 2005.
- [24] V. Vita, "Development of a Decision-Making Algorithm for the Optimum Size and Placement of Distributed Generation Units in Distribution Networks," *Energies*, vol. 10, no. 9, pp. 1433-1445, 2017.
- [25] Test Case Archive. Available: <https://www.ee.washington.edu/research/pstca/>.

BIOGRAPHIES OF AUTHORS



Yahiaoui Merzoug is born in Saida (Algeria) in 1966. I obtained a diploma of engineer in Electrotechnics in 1992. He received his master Department of Electrical Engineering at the ENSET, in Oran, Algeria. He received "Doctorat Es-Science" in Electrical Control from the University of Sciences and Technology of Oran (Algeria) in 2014. He is an associate professor at university of Saida. His fields of interest include: FACTS power flow in radial distribution system and Renewable Energies. I am a member in electro technical engineering Laboratory (L.G.E)). Post address: Yahiaoui Merzoug , lecturer, University of Saida, BP 138 En-Nasr, (20000 Saida), ALGERIA
Email: myahiaoui2001@yahoo.fr



Bouanane Abdelkrim is born in SAIDA, Algeria in 1970 he obtained a diploma of engineer in Electrotechnics in 1995. I received my Master in 2006 at the ENSET Oran and PHD at the ENPO oran in 2013. I am a teacher in the Department of Electrical Engineering, Faculty of Technology at the Dr. Moulay Taher University of SAIDA. My research interests include intelligent control of power system and FACTS, Electrical Machines and Renewable Energies. I am a member in electrotechnical engineering Laboratory (L.G.E))



Larbi Boumediene is born in Saida (Algeria) in 1964. He obtained a diploma of engineer in Electrotechnics in 1990. He received his master Department of Electrical Engineering at the ENSET, in Oran, Algeria. He received "Doctorat Es-Science" in Electrical Control from the University of Sciences and Technology of Oran (Algeria) in 2007. He is an associate professor at university of Saida. His fields of interest include: harmonic power flow in distribution system, quality of energy. Post address: Larbi Boumediene, lecturer, University of Saida, BP 138 En-Nasr, (20000 Saida) , ALGERIA
Email: lboumediene2005@yahoo.fr