

Evaluation of PV, Wind, Diesel Hybrid Energy Potential for GSM Tower in Myanmar

Zin Mar Nyo

Departementof Electrical Power Engineering, Mandalay Technological University, Myanmar

Article Info

Article history:

Received May 28, 2015

Revised Jul 14, 2015

Accepted Aug 6, 2015

Keyword:

Hybrid
Photovoltaic
Rural areas
Solar energy
Wind energy

ABSTRACT

Not only GSM, WCDMA but also CDMA technology can be used in Myanmar but GSM pre-dominates in the market. There are over million unique subscribers across the country in 2013. Power supply for telecom becomes main challenges in Myanmar where the electricity can not access in rural area. To minimize deficit of power, the government has set a target to covert some of tower sites to renewable solutions by 2015. This paper proposes the use of a PV, wind and diesel generator hybrid system with storage element in order to determine the optimal configuration of renewable energy in Myanmar. This paper discusses the development of a renewable energy sources (RES) that can be used for electric power supply of GSM base station site at any given time and considers the feasibility of developing Solar (photovoltaic)-Wind-Diesel hybrid power systems for supplying electricity to off-grid rural telecommunication. The Hybrid Optimization Model for Electric Renewables (HOMER) was used to simulate and generate feasible solution through combinations of photovoltaic, Wind Turbines and Diesel Generator with a minimum levelised cost of electricity supply and to determine the technical feasibility of the system.

Copyright © 2015 Institute of Advanced Engineering and Science.
All rights reserved.

Corresponding Author:

Zin Mar Nyo,
Departementof Electrical Power Engineering,
Mandalay Technological University, Myanmar
Email: zinmarnyo.pku@gmail.com

1. INTRODUCTION

Myanmar has very intermittent renewable sources. It mentions that wind generation system may not be currently economically attraction. Nevertheless, it would be useful for potential hybrid situations such as remote area. On the other hand, generally 70% of the population lives in rural areas which are not commonly use electricity. In fact, this paper hands out hybrid system combination diesel generators with battery, converter subsystems in the usage of rural telecommunication, Myanmar. The hybrid system design was investigated depending on factors such as consumer requirement, site location, and system economic in the proposed area, Pathein. The purpose of this paper is not only to develop renewable energy usage in Myanmar but also to provide electricity for rural telecommunications which couldn't access to connect to the national grid in the remote area, Myanmar. Solar, wind and hybrid systems with battery backup for energy storage are the most cost effective reliable solution to power for telecommunication site in remote areas. The off-grid network in Myanmar is expected to grow from 540 sites in 2013 to 2850 sites by 2015 based on current network rollout plans by mobile operators. The economic feasibility of the case study area, Pathein is determined by HOMER model imputed from existing data: such as local status and resource availability. The selection component of PV-wind-diesel hybrid system is apparatus based on optimal design. To ensure the feasibility target of this project, electrical demand for telecommunication in rural area and socio-economic development are provided, at the sametime, additional benefits of this project are to reduce carbon dioxide and particulates entering into the atmosphere.

2. RENEWABLE ENERGY IN MYANMAR

Myanmar is situated in the south eastern part of the Asian continent. It enjoys abundant sun shine all year round, especially in the Central Myanmar Dry Zone Area. Myanmar has vast measure of renewable energy resource in various kinds. Solar, Hydro, Wind and Biomass are at great potential to utilize easily for the benefit of the poor to fulfill their basic needs of fuel for cooking and lighting in rural area. Among them, wind pattern in Myanmar is generally not regular and low in capacity to produce sustainable energy at the current availability of technology. Potential available solar energy of Myanmar is around 51973.8TWh per year. Myanmar Electric Power Enterprise experimental measurement indicated that irradiation intensity of more than $5\text{ kWh/m}^2/\text{day}$ was observed during the dry seasons New Energy and Industrial Technology Development Organization (NEDO) of Japan performed in 1997 a study on renewable energy potential in GMS region and assessed that Myanmar has potentially available Wind Energy of 360.1Wh per year. Promising areas to harness wind energy are in three regions, namely Hilly Regions of Chin and Shan states, Coastal regions in the south and Western part of the country and central part of Myanmar. General observation shows that wind power potential in Myanmar is relatively low and irregular. There is a considerable measurement of stagnant period which occur even in generally windy areas. Solar power is found to be a most potential one to hybrid with wind power in Myanmar [08Win].

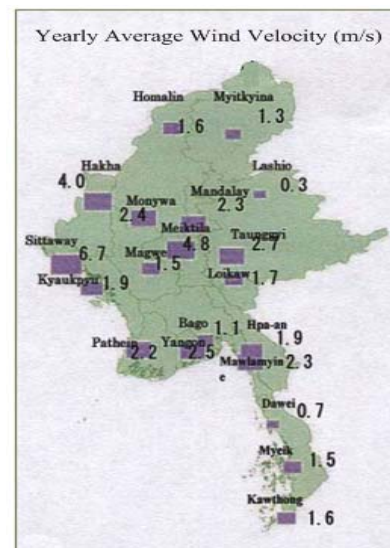
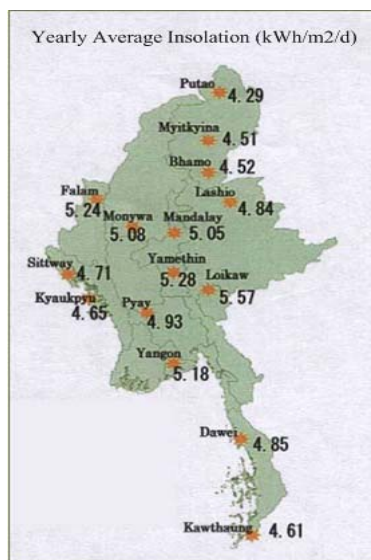


Figure 1. Yearly average insolation in Myanmar [08 Win] Figure 2. Yearly average wind speed in Myanmar [08 Win]

3. PROPOSED SITE LOCATION FOR CASE STUDY

In order to assess the viability of wind or solar powered systems, information must be gathered on the resource usually obtained locally. The cost of hybrid systems is currently high compared to conventional diesel minigridd systems. However, as it is typical for emerging technologies and markets, system design and industry structure will continue to evolve in concert with the growth in demand, technology development funding, and costs which can be expected to decrease significantly. In this study was performed for Patheingyi, Ayeyarwady Division. The geographical location of Patheingyi is located between North Latitude of $16^{\circ} 48'$ and East Longitude of $94^{\circ} 42'$. The daily average of wind speed and sun shine hour is recorded from this proposed site as shown in Table 1. The proposed hybrid system is intended for supplying electricity to telecommunication of this proposed site. Based on NASA data, a feasibility study for PV-wind-diesel hybrid system at Patheingyi is prepared to optimal design model for telecommunication system in this paper.

Table 1. Parameters of Solar and Wind data for proposed site

Month	Solar (KWh/m ² /d)	Wind (m/s)
January	5.47	2.2
February	6.16	2.2
March	6.78	2.3
April	6.83	2.3
May	5.23	2.7
June	3.43	4.3
July	3.45	3.9
August	3.20	4.1
September	4.10	2.7
October	4.84	2.2
November	4.95	2.6
December	5.16	2.5

4. HYBRID SYSTEM COMPONENTS

The hybrid system after the prefeasibility study consists of the following components:

- 1) KYOCERA (KD 250 GX-LFB2)
- 2) BWC Excel-S wind turbine
- 3) Cellcube FB 20-40 battery
- 4) Converter.
- 5) Diesel generator
- 6) GSM Load.

4.1. Photovoltaic Module

Kyocera (kd 250 gx-lfb2) photovoltaic panel is considered in the scheme, with initial capital cost 2000/kW and O & M cost \$ 50/yr with rated power 250 Watt and rated voltage 29.8 V. Its lifetime is estimated at 20 years.

4.2. Wind Turbine

In this study, Pathein Wind Power is considered BWC Excel-S model. It has a rated capacity of 10 kW AC as an output. Its initial cost is \$28895, replacement at \$2000 and O & M cost is \$50/yr.

4.3. Battery

The batteries must be suitable to withstand the heavy daily cycling required for this application. From the datasheet given by HOMER software, the minimum state of charge of the battery is 40%. Its round trip efficiency is 80%. Cellcube FB 20-40 battery is selected for this study. Cellcube FB 20-40 battery models (48V, 833Ah). The capital cost is \$ 800/batt and O & M cost is \$30/yr.

4.4. Converter

Converter is used which can work both as an inverter and rectifier depending on the direction of flow of power. In the present case, the size of the converter used is 9 kW for simulation purposes. Its initial cost is \$900/KW and its replacement cost is \$800/kW and O & M cost is \$20/yr.

4.5. Diesel Generator

Diesel generator technology is wide spread and the development of the power plant is relatively easy. The diesel back-up system is operated at times when the output from wind, hydro and solar systems fails to satisfy the load and when the battery storage is depleted. The size of diesel generator is 2kW. The initial cost and replacement cost are respectively (\$700, \$600), O & M cost is of 0.001\$/hr.

4.6. Power Consumption Load for GSM

This paper indicates the approximate power consumption for telecommunication system is 29kWh/day with 2.4kW peak and the system runs on 48V DC bus. There is a constant load of telecom equipment's work for 24 hours in a day. The daily load power consumption is 42.01kWh/day. Total power consumption of GSM (Global System for Mobile Communications) load is 29640 Watts. To provide uninterruptable service and therefore these sites require continuous power throughout the year, therefore, the hourly load is almost a constant, as the power consumption remains the same. Telecommunication monthly load profile is shown in Figure 3 which is produced by HOMER software. Table 2 shows the power consumption of 800W/900MHz GSM/UMTS dual mode. In this configuration, Base band Processing board type C (BPC), Universal Base band Processing board for GSM (UPBG), Circuit Switching Call (CS) are

included. Radio Mode GSM (Global System for Mobile Communications)/UMTS (Universal Mobile Telecommunication System) are used for telecommunications system in Pathein, Ayeyarwady Division.

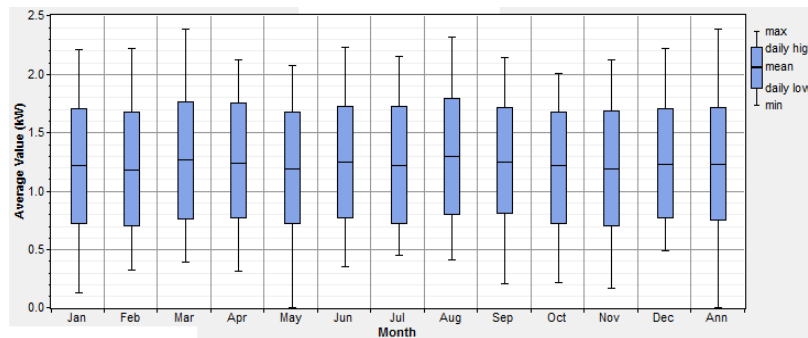


Figure 3. Monthly load profile for GSM tower

Table 2. Power Consumption for GSM/UMTS

Configuration	Power Consumption (800W/900MHz)
6CS + 12TRX/1BPC+1UBPG	95 W
12CS + 24TRX/2BPC+2UBPG	145 W
GSM S1 + 1UMTS CS	300 W
GSM S2+ 1UMTS CS	245 W
GSM S3 + 1UMTS CS	235 W
GSM S4 + 1UMTS CS	215 W
Total Power Consumption	1235 W

5. WIND AND SOLAR RESOURCES

The annual average wind speed and the annual average insolation level at Pathein are 5.29 m/s and 5.71 kWh/m²/day, respectively. The monthly wind speed variation is shown in Figure 4. The monthly clearness index and the daily radiation are shown in Figure 5.

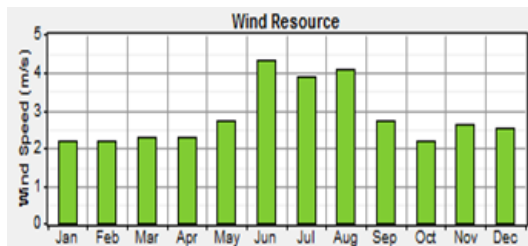


Figure 4. Wind speed for proposed site by using HOMER

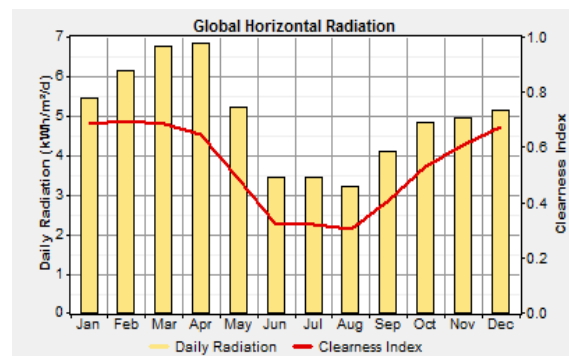


Figure 5. Daily radiation and clearness index for proposed site by using HOMER

6. HYBRID SYSTEM WITH HOMER SOFTWARE

HOMER software simulates the operation of the proposed system along the year by making an energy balance between the generation and the load to determine the feasible system architecture which meet the load demand under the site condition beside specifying the cost-effective combination based on the total net present cost [TNPC] which is the summation of all the costs and revenue all over the project life time which is assumed 25 years.

Numbers of combinations are to be considered as follows:

- 1) Wind turbine, Batteries and Diesel generation.

- 2) PV panel, Batteries and Diesel generation.
- 3) Wind turbine, Batteries and PV panels.
- 4) Wind turbine, Batteries, PV panels and Diesel generation.

Then simulated using HOMER software to determine the most optimum combination for telecommunication load.

6.1. Wind and Diesel Generation

Figure 6 shows Wind and Diesel system design using HOMER. The simulation results present the optimum combination: two 10kW AC wind turbine, 2kW generator, 20 batteries and 10kW converter. In this work, the amount of possible pollutants arising from the use of diesel fuel in powering the GSM Base Station Site was simulated with HOMER software. Wind and Diesel have total net present cost of \$187625, operating cost of \$3914/yr, and the levelized cost of energy of \$1.368/ kWh as shown in Table 3. Excess electricity for this combination is 8.46kWh/yr (0.07%).

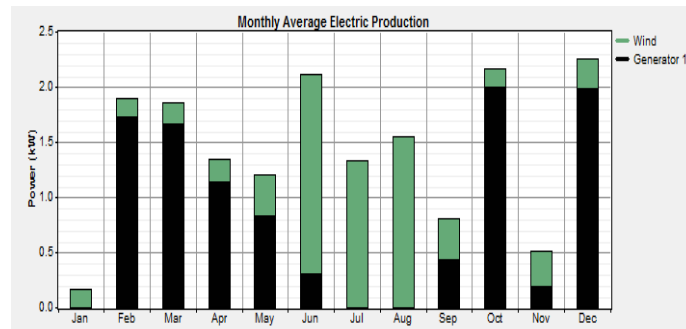


Figure 6. Wind and diesel electric production

6.2. PV and Diesel Generation

The Figure 7 shows PV and Diesel system design using HOMER. The simulation results present the optimum combination: 10kW PV, 1kW Diesel Generator, 10 battery unit and 10kW Converter. Photovoltaic/Diesel/Battery has total net present cost of \$102775 operating cost of \$886/yr, and the levelized cost of energy of \$0.749/kWh as shown in Table 3. Excess electricity for this combination is 2872kWh/yr (17.6%).

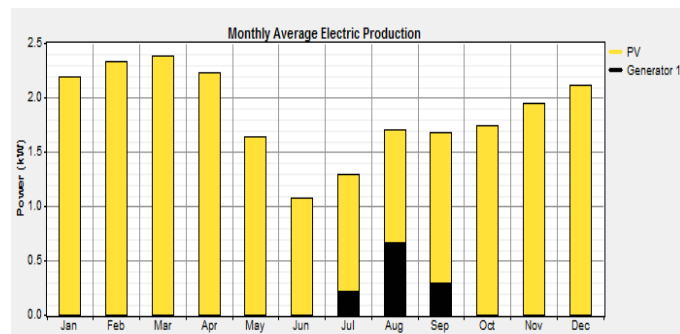


Figure 7. PV and diesel electric production

6.3. PV and Wind

Figure 8 shows PV and Wind system design using HOMER. The simulation results present the combination: 10kW PV, one 10kW AC wind turbine, 10 battery unit and 10 kW converter. PV and Wind have total net present cost of \$135282, operating cost of \$1196/yr, and the levelized cost of energy of \$0.986/ kWh as shown in Table 3. Excess electricity for this combination is 4760kWh/yr (26.5%).

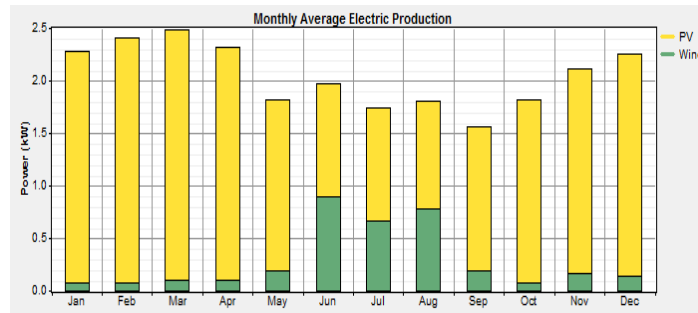


Figure 8. PV and Wind electric production

6.4. PV, Wind and Diesel

The Figure 9 shows PV, Wind and Diesel system design using HOMER. The simulation results present the optimum combination: 10 kW PV, one 10kW AC wind turbine, 1kW generator, 10 battery unit and 10kW converter. Photovoltaic/Wind/Diesel has total net present cost of \$135564 operating cost of \$1191/yr, and the levelized cost of energy of \$0.988/kWh as shown in Table 3. Excess electricity for this combination is 4760kWh/yr (26.5%).

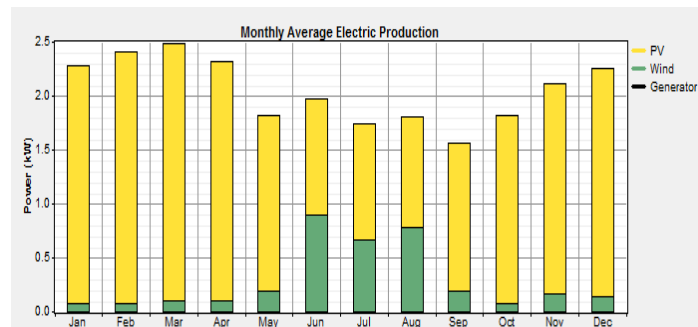


Figure 9. PV, wind and diesel electric production

7. OPTIMIZATION RESULTS

The combination of energy system components are 7kW PV-Array, 2kW Diesel Generator, 3x833Ah and 9kW Converter. The hybrid system combination are simulated with their costing and sizing compared with a PV/wind/battery/diesel system. It can be seen from the simulation results in Table 3. It can meet the demand requirements cost effectively. From the optimization results, the best optimal combination of energy system components are 10kW PV-Array, 1kW Diesel Generator, 10x833Ah and 10kW Converter. In this work, the amount of possible pollutants arising from the use of diesel fuel in powering the GSM tower was simulated with HOMER software. PV/Diesel/Battery has total NPC of \$102775, operating cost of \$886/yr, and the levelized cost of energy of \$0.749 per kWh as shown in Table 3.

Table 3. Comparison Results of Different Combinations

Description	Case	Case	Case	Case
	Study I Wind and Diesel	Study II PV and Diesel	Study III PV and Wind	Study IV PV, Wind and Diesel
Total Net Present Cost (\$)	187625	102775	135282	135564
Levelized Cost of Energy (\$/kWh)	1.368	0.749	0.986	0.988
Operation Cost (\$/yr)	3914	886	1196	1191
Excess Electricity (kWh/yr)	8.46(0.07%)	2872(17.6%)	4760(26.5%)	4760(26.5%)
PV array (kWh/yr)	-	15411(95%)	15411(86%)	15411(86%)
Wind turbine(kWh/yr)	5.063(40%)	-	2531(14%)	2531(14%)
Generator (kWh/yr)	7490(60%)	876(5%)	-	-
CO2 Emission (kg/yr)	6511	848	-	-
Fuel Consumption (L/yr)	2473	322	-	-

8. CONCLUSION

In hybrid Photovoltaic/Diesel/Battery system, the Photovoltaic system supplies 95% of the annual electricity production. Diesel generator contributes 5% of the total electricity and the excess electricity is 17.6%, respectively. Total net present cost, energy cost and operation cost are less than other combination system. Therefore Case II is chosen as the best optimal design for telecommunication system. The selected optimum combination is sized to meet the power consumption of telecommunication system for about 100% availability. The given load characteristic and diesel generator a methodology, which uses the site-climatic conditions, is developed to calculate the optimum mix of the system components. The optimum design of this system is based on: a pre-defined load pattern to be supplied; the pertinent weather data; the relevant market prices; and the applicable recent economic rates (diesel-battery hybrid system). It is generally a viable option for off-grid area of Patheingyi Region, Myanmar. This paper, one solution, is to use combinations of renewable and conventional power technologies, or hybrid systems, to provide electricity for telecommunication in off-grid areas where it is too expensive to extend the grid, or where the grid cannot operate without high losses.

ACKNOWLEDGEMENTS

Special thanks are offered to Dr. Khin Thuzar Soe, Associate Professor, Department of Electrical Power Engineering, Mandalay Technological University, for her encouragement, constructive guidance and kindly advice throughout the preparation of this paper. The author's special thanks are sent to her parents, U Mg Nyo and Daw Cho Mar, for their guidance and support from childhood till now. And the author would like to convey her gratitude to all persons who were directly or indirectly involved towards the successful completion of this paper.

REFERENCES

- [1] Souissi Ahmed, Hasnaoui Othman, and Sallami Ani, "Optimal Sizing of a Hybrid System of Renewable Energy for a Reliable Load Supply without Interruption," *European Journal of Scientific Research*, Vol. 45 No. 4, pp. 620-629, 2010.
- [2] Dike U. Ike, Anthony U. Adoghe, and Ademola Abdulkareem, "Analysis of Telecom Base Stations Powered By Solar Energy"
- [3] Pragya Nema, Saroj Rangnekar, and R. K. Nema, "Prefasibility Study of PV-Solar/Wind Hybrid Energy System for GSM Type Mobile Telephony Base Station In Central India," 2010.
- [4] Ani Vincent Anayochukwu, Nzeako, and Anthony Ndubueze, "Energy Optimization at GSM Base Station Sites Located in Rural Areas," 2012.
- [5] Amherst, "Renewable Energy Research Laboratory," 2006.
- [6] Win Khaing, "Renewable Energy and Rural Development in Myanmar," *TCDPAP & FIDIC/ASPAC Seoul Conference*, 2008.
- [7] "Myanmar: Energy Sector Initial Assessment", Available: www.adb.org. [Accessed: June, 2013].
- [8] Zeraia Hassiba, Larbes Cherif, and Malek Ali, "Optimal Operational Strategy of Hybrid Renewable Energy System for Rural Electrification of a remote," *Algeria Energy Procedia*, 2013.

BIOGRAPHY OF AUTHOR



Zin Mar Nyo, she received ME degree in electrical power engineering from Mandalay Technological University. Her research interests are renewable and energy engineering. She is doing Ph.D (Thesis) at Electrical Engineering Department of Mandalay Technological University, Myanmar. Her email address is zinmarnyo.pku@gmail.com.