

## Mitigation of Voltage Flicker and Reduction in THD by using STATCOM

S. Chandrasekhar\*, J. Brahmam\*\*, M. Srinu\*

\* Departement of Electrical and Electronics Engineering, Anurag Engineering College, AP, INDIA

\*\* Departement of Electrical and Electronics Engineering, Anurag Engineering College

---

### Article Info

#### Article history:

Received Nov 12, 2012

Revised Dec 22, 2012

Accepted Jan 12, 2013

---

#### Keyword:

Power quality

Voltage flicker

STATCOM

Harmonic filter

Total harmonic distortion

---

### ABSTRACT

Voltage flicker is considered as one of the most severe power quality problems (especially in loads like electrical arc furnaces) and much attention has been paid to it lately. Due to the latest achievements in the semiconductors industry and consequently the emergence of the compensators based on voltage source converters, FACTS devices have been gradually noticed to be used for voltage flicker compensation. This paper covers the contrasting approaches; dealing with the voltage flicker mitigation in three stages and reduction in total harmonic distortion and assessing the related results in details. Initially, the voltage flicker mitigation, using FCTCR (Fixed Capacitor Thyristor Controlled Reactor), was simulated. Secondly, the compensation for the six-pulse as well as 12-pulse Static Synchronous Compensator (STATCOM) has been performed. In this case, injection of harmonics into the system caused some problems which were later overcome by using 12-pulse assignment of SATCOM and RLC filter (three phase harmonic filter). The obtained results show that STATCOM is very efficient and effective for the flicker compensation as well as harmonic spectrum. All the simulations have been performed on the MATLAB Software.

Copyright © 2013 Institute of Advanced Engineering and Science.  
All rights reserved.

---

### Corresponding Author:

M.Srinu,

Departement of Electrical and Electronics Engineering,

Anurag Engineering college,

Kodad, AndhraPradesh, India.

Email: [srinumudusu@gmail.com](mailto:srinumudusu@gmail.com)

---

## 1. INTRODUCTION

Power quality is the combination of voltage quality and current quality, thus power quality is concerned with deviations of voltage and or current from ideal. Power quality (PQ) related issues are of most concern nowadays. The widespread use of electronic equipment and Electrical equipment susceptible to power quality or more appropriately to lack of power quality [2] would fall within a seemingly boundless domain. All electrical devices are prone to failure or malfunction when exposed to one or more power quality problems. The electrical device might be an electric motor, a transformer, a generator, a computer, a printer, communication equipment, or a household appliance.

The relationship between power quality and distribution system has been a subject of interest for several years. The concept of power quality describes the quality of the supplier voltage in relation to the transient breaks, falling voltage, harmonics and voltage flicker. Voltage Flicker [1] is the disturbance of lightning induced by voltage fluctuations. Very small variations are enough to induce lightning disturbance for human eye for a standard 230V, 60W coiled-coil filament lamp. The disturbance becomes perceptible for voltage variation frequency of 10 Hz and relative magnitude of 0.26%. Huge non-linear industrial loads such as the electrical arc furnaces [9], pumps, welding machines, rolling mills and others are known as flicker generators.

In this respect, the quality of supplied voltage is significantly reduced in an electrical power system and the oscillation of supplied voltage appears to be a major problem. Voltage variation at the common point of supply to other consumers. The relative voltage drop is expressed by equation(1):

$$\frac{\Delta U}{U_n} = \frac{R\Delta P + X\Delta Q}{U_n^2} \quad (1)$$

Where  $\Delta P$  and  $\Delta Q$  are the variation in active and reactive power;  $U_n$  is the nominal voltage and  $R$  and  $X$  are short circuit resistance and reactance. Since  $R$  is usually very small in comparison to  $X$ ,  $\Delta U$  is proportional to  $Q$  (reactive power). Therefore, voltage flicker mitigation depends on reactive power control.

Two types of structures can be used for the compensation of the reactive power fluctuations that cause the voltage drop:

A: shunt structure [7]: in this type of compensation, the reactive power consumed by the compensator is kept constant at a sufficient value.

B: series structure: in this type, all the efforts are done to decrease the voltage drop mentioned above, and finally the reactive power is kept constant despite the load fluctuations by controlling the line reactance.

In addition to the aforesaid procedures for the compensators, the active filters are used for the voltage flickers mitigation as well. Furthermore, the mitigating devices based on Static VAR Compensator (SVC) such as Static Synchronous Compensator (STATCOM) is the most frequently used devices for reduction in the voltage flickering. SVC devices achieved an acceptable level of mitigation, but because of their complicated control algorithms, they have problems such as injecting a large amount of current harmonics to the system and causing spikes in voltage waveforms.

A new technique based on a novel control algorithm, which extracts the voltage disturbance to suppress the voltage flicker as well as Total Harmonic Distortion, is presented in this paper. The technique is to use STATCOM [8] along with a harmonic filter for voltage flicker compensation as well as harmonic distortion to overcome the aforementioned problems related to other techniques. The concept of instantaneous reactive power components is used in the controlling system.

A two-bus system is exploited to fulfill the investigation of the presented procedure. All the simulations are done according to the usage of MATLAB software. The related compensation was performed first by 6-pulse VSC STATCOM [8]. Afterwards, a 12-pulse voltage-source converter STATCOM [8] was used to compensate for the voltage flicker. With respect to the harmonic problem in this stage, a 12-pulse voltage-source converter STATCOM along with a Harmonic filter was designed to isolate load harmonics and mitigate the propagation of voltage flicker to the system in the next stage. The obtained results clearly confirmed the efficiency of the 12-pulse STATCOM to complete the voltage flicker mitigation and the harmonic filter reduces the total harmonic distortion at minimum possible value.

## 2. COMPENSATION

In this project a two bus system is considered to investigate the voltage flicker compensation using STATCOM. This configuration block diagram is illustrated in fig:1 which consists of 3Ø programmable voltage source and STATCOM [1]. The voltage oscillation is produced by the programmable voltage source which is connected to the main bus-bar, by specifying the amplitude of modulation the signal increments and decrements with respect to unit value.

Two 6-pulse bridges are connected in parallel, forming a 12-pulse converter for a complete voltage flicker compensation design. In this case, the first converter is connected with a wye-wye transformer and the second one with a wye-delta transformer. These are linked together using a three winding transformer. Moreover, the delta-connected secondary of the second transformer must have  $\sqrt{3}$  times the turns compared to the wye-connected secondary and the pulse train to one converter is shifted by 30 degrees with respect to the other.

Three-phase harmonic filters are shunt elements that are used in power systems for decreasing voltage distortion. Nonlinear elements such as power electronic converters generate harmonic currents or harmonic voltages, which are injected into power system. The resulting distorted currents flowing through system impedance produce harmonic voltage distortion. Harmonic filters [8] reduce distortion by diverting harmonic currents in low impedance paths. Harmonic filters are designed to be capacitive at fundamental frequency, so that they are also used for producing reactive power required by converters and for power factor correction.

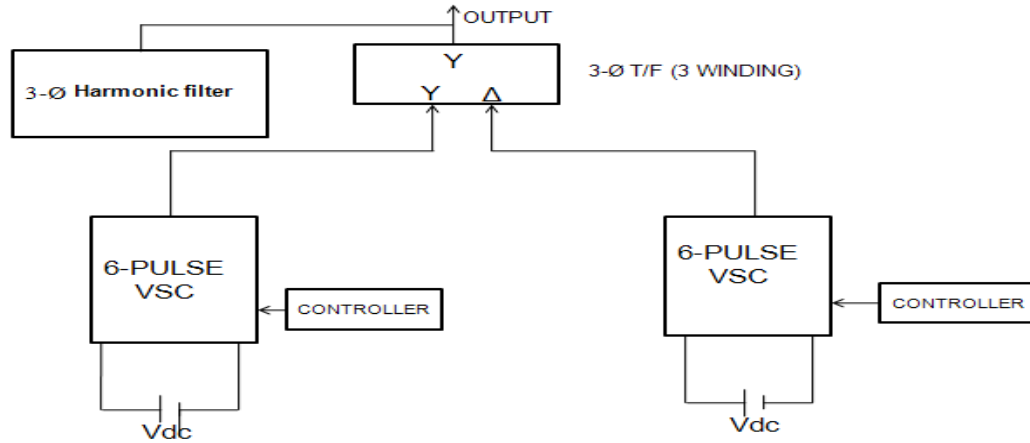


Figure 1. Block diagram of 12-pulse voltage source converter STATCOM with harmonic filter

### 3. CONTROLLING SYSTEM

The concept of instantaneous reactive power is used for the controlling system. Following this, the 3-phase voltage upon the use of the park presented by Akagi has been transformed to the synchronous reference frame (Park or dq0 transformation). This transformation leads to the appearances of three instantaneous space vectors:  $V_d$  on the d-axis (real or direct axis),  $V_q$  on the q-axis (imaginary or quadrature axis) and  $V_0$ , from the 3-phase voltage of  $V_a$ ,  $V_b$  and  $V_c$ . The related equations of this transformation, expressed in the MATLAB software, are as follows:

$$V_d = \frac{2}{3} (V_a \sin(\omega t) + V_b \sin(\omega t - \frac{2\pi}{3}) + V_c \sin(\omega t + \frac{2\pi}{3})) \quad (2)$$

$$V_q = \frac{2}{3} (V_a \cos(\omega t) + V_b \cos(\omega t - \frac{2\pi}{3}) + V_c \cos(\omega t + \frac{2\pi}{3})) \quad (3)$$

$$V_0 = \frac{1}{3} (V_a + V_b + V_c) \quad (4)$$

A dynamic computation shows that the voltage oscillations in the connecting node of the flicker-generating load to the network are created by 3 vectors: real current ( $i_p$ ), imaginary current ( $i_q$ ) and the derivative of the real current with respect to time  $di_p/dt$ . In general, for the complete voltage flicker compensation, the compensating current ( $i_c$ ) regarding the currents converted to the dq0 axis is given as [3]:

$$i_c = j(i_q + i_p \frac{R}{X} f + \frac{1}{\omega} \frac{di_p}{dt} f + k) \quad (5)$$

where  $R$  and  $X$  are the synchronous resistance and reactance of the line and  $f$  is the correcting coefficient. The constant  $k$  is also used to eliminate the average reactive power of the network [3]. If the compensation current of the above equation is injected to the network, the whole voltage flicker existing in the network will be eliminated. Regarding the equation related to the dq-transformation of the 3-phase-voltages to the instantaneous vectors, it is obvious that under the conditions of accessing an average voltage flicker,  $V_d$  and  $V_0$ , the obtained values are close to zero and  $V_q$  is a proper value adapting to the voltage oscillation of the network.

### 4. RESULTS AND ANALYSIS

In this project 69kv 3Ø voltage source, 100 km 3-Ø section power system line are used and are connected to the step-down 3Ø transformer, which supplies a 3Ø parallel RL load. 3Ø programmable Voltage source is used to produce voltage flicker or voltage fluctuation into the system. Block parameters of 3Ø programmable voltage source are as follows, amplitude of modulation is 0.3 pu, frequency of the modulation is 10 HZ, Variation timing is 0 to 0.4 sec. with these specified parameter values, the variation in the output load voltage is shown in the Fig. 4 SIMULINK diagram of a two bus power system without STATCOM is shown in the Fig. 3.

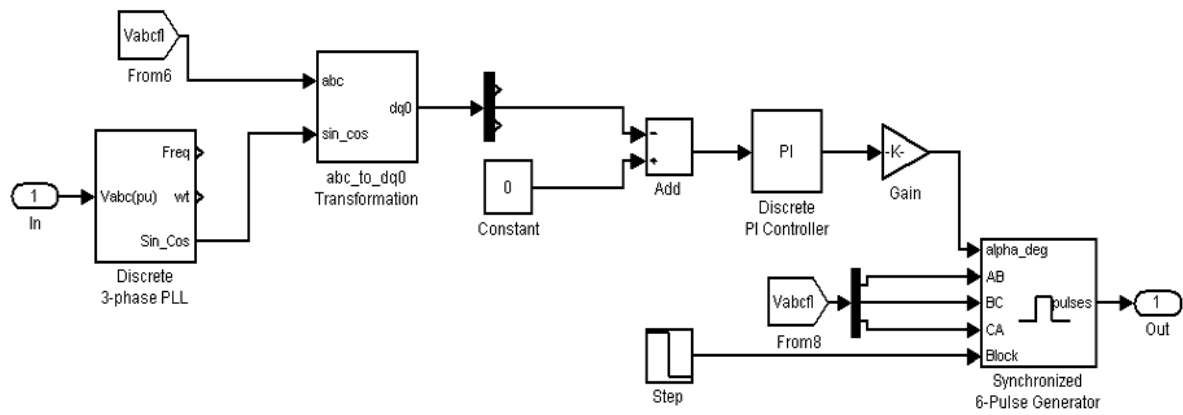


Figure 2. Control circuit

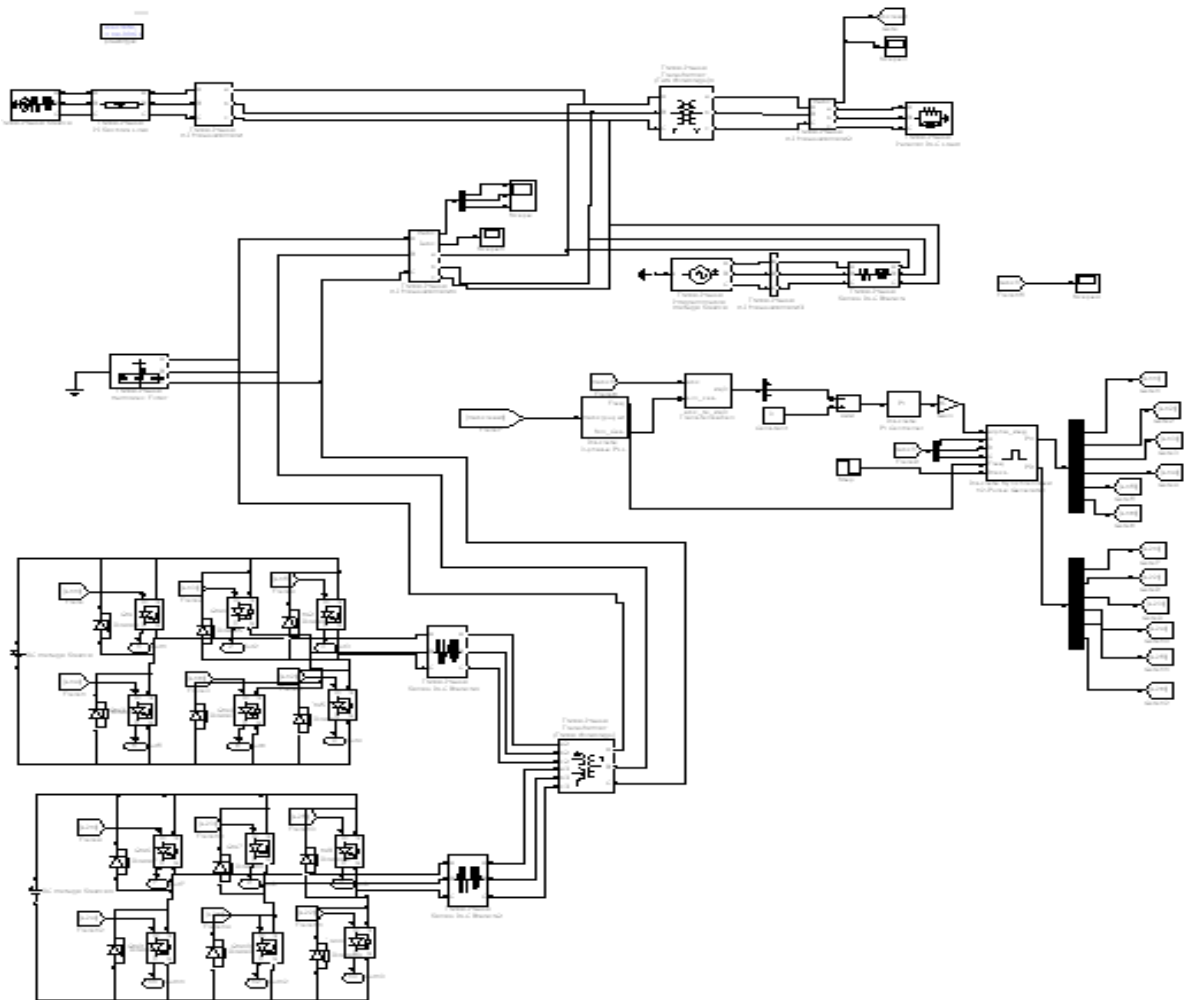


Figure 3. SIMULINK diagram of 12 pulse Voltage source converter STATCOM with 30 harmonic filter connected to the power system.

To eliminate lowest order harmonics such as 11<sup>th</sup> and 13<sup>th</sup> harmonic, double tuned band pass filter is connected across the 12 pulse voltage source converter output. Fig 4 shows SIMULINK diagram of 12 pulse voltage source converters STATCOM with 30 harmonic filter connected to the power system. The output

load voltage mitigated by 12-pulse voltage-source converter STATCOM with 3 $\emptyset$  harmonic filter and its harmonic spectrum is shown in figures 4 and 5 respectively. In this respect, the voltage flicker is completely removed from the output load voltage and a sinusoidal waveform is obtained. It can be observed from the harmonic spectrum that THD is 2.30%.

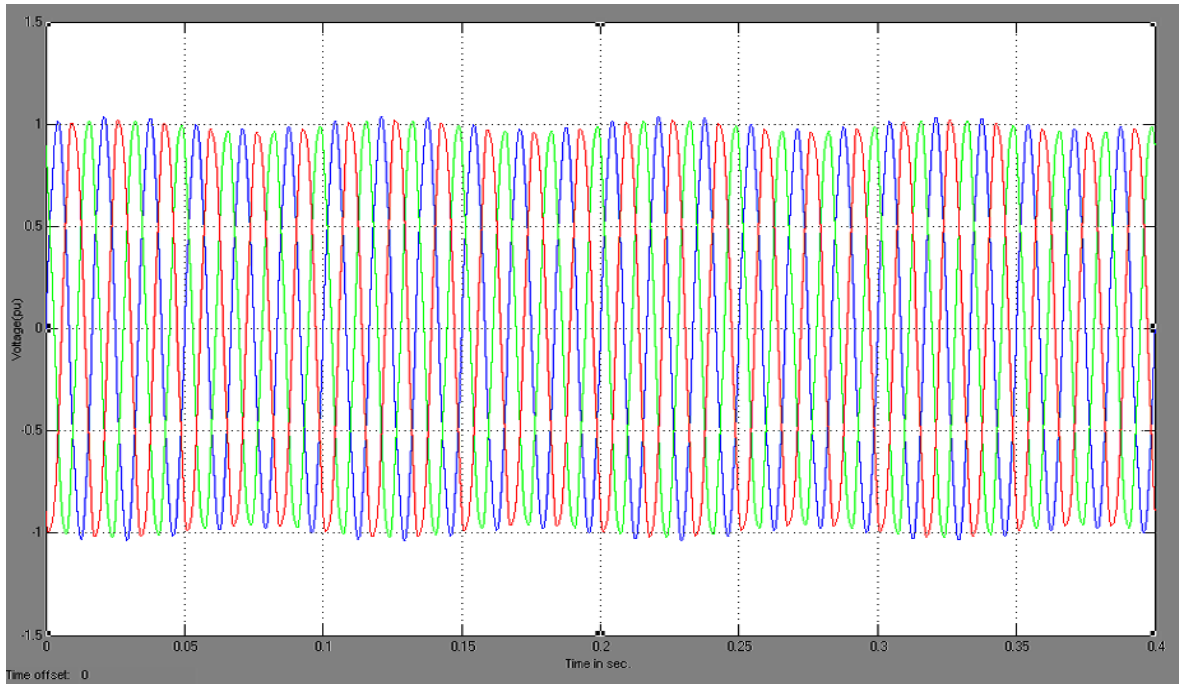


Figure 4. Output load voltage mitigated by 12-pulse voltage source converter STATCOM with 3 $\emptyset$  harmonic filter

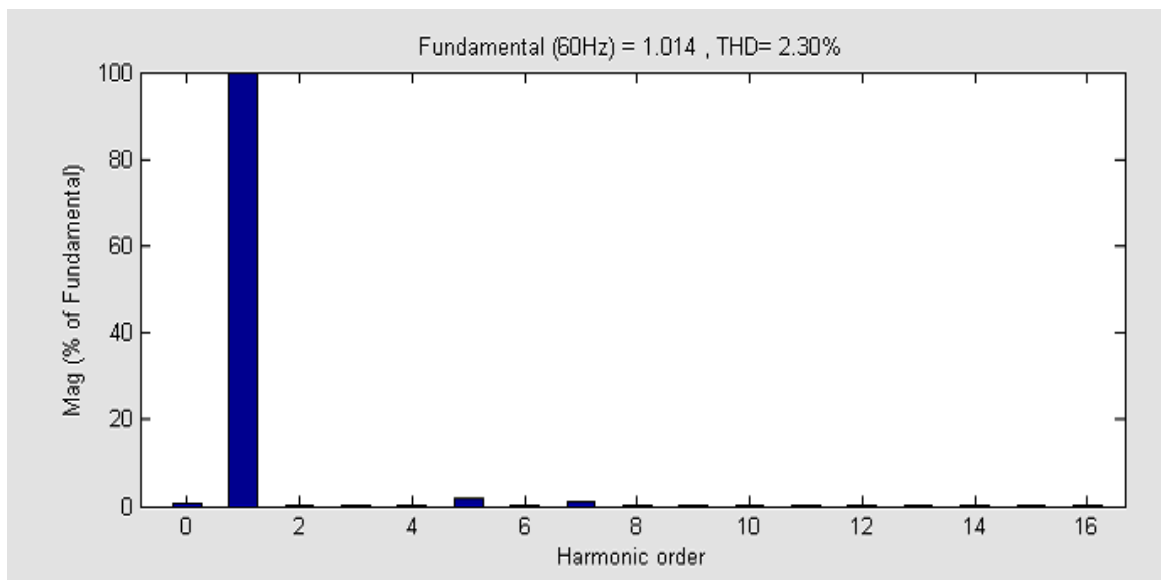


Figure 5. Harmonic spectrum of the output load voltage mitigated by 12-pulse voltage-source converter STATCOM equipped with a harmonic filter.

Voltage flicker mitigation using 6 pulse voltage source converter STATCOM, 12 pulse voltage source converter STATCOM, and 12 pulse VSC STATCOM with 3 $\emptyset$  harmonic filter are simulated. The output load voltage without STATCOM and with STATCOM is obtained and compared.

The results obtained are as follows:

*Mitigation of Voltage Flicker and Reduction in THD by using STATCOM (S. Chandrasekhar)*

### I. Without STATCOM:

The output load voltage is 1.3 Pu (maximum value). The voltage flicker existing in the output load voltage (exerted to the system) is 0.3 Pu (30%).

### II. With STATCOM:

Table 1. Comparison of voltage flicker mitigation and THD value of STATCOM compensators.

Compensator	Compensated output load voltage (maximum value)	Voltage Flicker	THD
6 pulse VSC STATCOM	1.15 pu	Existing is 0.15 pu (15%) (or) Mitigated by 50%	8.95%
12 pulse VSC STATCOM	1.0 pu	Completely mitigated	4.47%
12 pulse VSC STATCOM with 3 $\phi$ harmonic filter	1.0 pu	Completely mitigated	2.30%

## 5. CONCLUSION

In this thesis, the application of STATCOM technology based on voltage-source converters for voltage flicker mitigation has been investigated and simulation results emphasized its significant effect. A 6-pulse STATCOM is decreasing the voltage flicker by 50%. However, there is injection of the harmonic from 6-pulse STATCOM into the system which can be improved with the increase of the voltage source converters of STATCOM using a 12-pulse STATCOM equipped with a harmonic filter. The obtained results clearly demonstrate that 12-pulse STATCOM equipped with a harmonic filter can reduce the voltage flicker completely and the output is obtained with minimum THD Value.

## REFERENCES

- [1] T. Larsson, C. Poumarede, "STATCOM, an efficient means for flicker mitigation" *IEEE Power Engineering Society Winter Meeting, Vol.2, (Jan-4Feb 1999)*, pp. 1208-1213.
- [2] R. Mienski, R. Pawelek, I. Wasiak "Shunt Compensation for Power Quality Improvement using a STATCOM controller: Modelling and simulation", *IEE Proc.-Gener. Transm. Distrib. No.2, Vol.151, (2004)*, pp. 274-280.
- [3] Z. Zhang, N. R. Fahmi, W. T. Norris, "Flicker Analysis and Methods for Electric Arc Furnace Flicker (EAF) Mitigation (A Survey)", *IEEE Power Tech Proceedings, Vol.1, (10-13 Sept. 2001)*.
- [4] Y. Hamachi, M. Takeda, "Voltage Fluctuation Suppressing System Using Thyristor Controlled Capacitors", *8th U.I.E. Congress, (1976)*.
- [5] C. S. Chen, H. J. Chuang, C. T. Hsu, S. M. Tscng, "Stochastic Voltage Flicker Analysis and Its Mitigation for Steel Industrial Power Systems", *IEEE Power Tech Proceedings, Vol.1, (10-13 Sept. 2001)*.
- [6] J. Dolezal, A. G. Castillo, V. Valouch, "Topologies and control of active filters for flicker compensation", *International Symposium on Industrial Electronics, IEEE Proceedings, Vol.1, (4-8 Dec, 2000)*, pp. 90-95.
- [7] L. Gyugi, A. A. Otto, "Static Shunt Compensation for Voltage Flicker Reduction and Power Factor Correction", *American Power Conference (1976)*, pp. 1272-1286.
- [8] Mahamood jorabian, Davar Mirabbasi, Alireza Sina, "Voltage Flicker Compensation using STATCOM" *IEEE proceedings, 2009*.
- [9] Le Tang, Sharma Kolluri, Mark F. McGranaghan, "Voltage flicker prediction for two simultaneously operated arc furnaces", *IEEE Transactions on Power Delivery, Vol. 12, No. 2, April 1997*.
- [10] R.C. Seebald, 9.F. Buch, and D.J. Ward, "Flicker Limitations of Electric Utilities", *IEEE Transactions on Power Apparatus and Systems, Vol. PAS-104, No. 9, September 1985*.

## BIOGRAPHIES OF AUTHORS



**Mr. S. Chandrasekhar** was born in 1978. He received his M.Tech (High Voltage Engineering) degree in Electrical and Electronics Engineering from Jawaharlal Nehru Technological University, Kakinada. Presently he is working as assistant professor in Anurag engineering college, Kodad. He is guiding both undergraduate and post graduate student projects. His area of interest includes High voltage transmission, Power Electronics and Drives.  
E-mail: hod.eee@anurag.ac.in



**Mr. J. Brahmam** was born in 1986. He is pursuing his M.Tech in Power electronics and electrical drives in Anurag Engineering College, Kodad. Received Bachelor degree in Electrical and Electronics Engineering from Jawaharlal Nehru Technological University, Hyderabad. His area of interest includes Power Electronics and Drives, power systems.  
E-mail: brahma550@gmail.com



**Mr. M. Srinu** was born in 1983. He received his M.Tech (Power and Industrial Drives) degree in Electrical and Electronics Engineering from Jawaharlal Nehru Technological University, Kakinada. Presently he is working as assistant professor in Anurag engineering college, Kodad. He is guiding both undergraduate and post graduate student projects. His area of interest includes Power Electronics and Drives, Control systems.  
E-mail: srinumudusu@gmail.com