



LEEDS
BECKETT
UNIVERSITY

Citation:

Beggs, CB and Avital, EJ (2020) Upper-room ultraviolet air disinfection might help to reduce COVID-19 transmission in buildings: a feasibility study. PeerJ, 8. e10196-e10196. ISSN 2167-8359
DOI: <https://doi.org/10.7717/peerj.10196>

Link to Leeds Beckett Repository record:

<http://eprints.leedsbeckett.ac.uk/7157/>

Document Version:

Article

Creative Commons: Attribution 4.0

The aim of the Leeds Beckett Repository is to provide open access to our research, as required by funder policies and permitted by publishers and copyright law.

The Leeds Beckett repository holds a wide range of publications, each of which has been checked for copyright and the relevant embargo period has been applied by the Research Services team.

We operate on a standard take-down policy. If you are the author or publisher of an output and you would like it removed from the repository, please [contact us](#) and we will investigate on a case-by-case basis.

Each thesis in the repository has been cleared where necessary by the author for third party copyright. If you would like a thesis to be removed from the repository or believe there is an issue with copyright, please contact us on openaccess@leedsbeckett.ac.uk and we will investigate on a case-by-case basis.

Upper-room ultraviolet air disinfection might help to reduce COVID-19 transmission in buildings: a feasibility study

Clive B. Beggs^{1,*} and Eldad J. Avital^{2,*}

¹ Carnegie School of Sport, Leeds Beckett University, Leeds, UK

² School of Engineering and Materials Science, Queen Mary University of London, London, UK

* These authors contributed equally to this work.

ABSTRACT

As the world's economies come out of the lockdown imposed by the COVID-19 pandemic, there is an urgent need for technologies to mitigate COVID-19 transmission in confined spaces such as buildings. This feasibility study looks at one such technology, upper-room ultraviolet (UV) air disinfection, that can be safely used while humans are present in the room space, and which has already proven its efficacy as an intervention to inhibit the transmission of airborne diseases such as measles and tuberculosis. Using published data from various sources, it is shown that the SARS-CoV-2 virus, the causative agent of COVID-19, is highly likely to be susceptible to UV-C damage when suspended in air, with a UV susceptibility constant likely to be in the region 0.377–0.590 m²/J, similar to that for other aerosolised coronaviruses. As such, the UV-C flux required to disinfect the virus is expected to be acceptable and safe for upper-room applications. Through analysis of expected and worst-case scenarios, the efficacy of the upper-room UV-C approach for reducing COVID-19 transmission in confined spaces (with moderate but sufficient ceiling height) is demonstrated. Furthermore, it is shown that with SARS-CoV-2, it should be possible to achieve high equivalent air change rates using upper-room UV air disinfection, suggesting that the technology might be particularly applicable to poorly ventilated spaces.

Submitted 15 July 2020
Accepted 25 September 2020
Published 13 October 2020

Corresponding author
Eldad J. Avital, e.avital@qmul.ac.uk

Academic editor
Todd Anderson

Additional Information and
Declarations can be found on
page 14

DOI 10.7717/peerj.10196

© Copyright
2020 Beggs and Avital

Distributed under
Creative Commons CC-BY 4.0

Subjects Microbiology, Virology, Infectious Diseases, Environmental Contamination and Remediation

Keywords COVID-19, SARS-CoV-2, Ultraviolet, Air transmission mitigation, Upper room UV-C, Presence of humans

INTRODUCTION

Since the emergence of COVID-19 in January 2020 there has been considerable interest in the use of ultraviolet (UV) light to disinfect blood plasma (*Eickmann et al., 2020; Keil et al., 2020; Ragan et al., 2020*), equipment (*Card et al., 2020; Derraik et al., 2020; Hamzavi et al., 2020; Heimbuch & Harnish, 2019*) and air (*Morawska et al., 2020*), in the hope that this might reduce transmission of the disease. In particular, upper-room ultraviolet germicidal irradiation (UVGI), a technology that disinfects room air, has

OPEN ACCESS

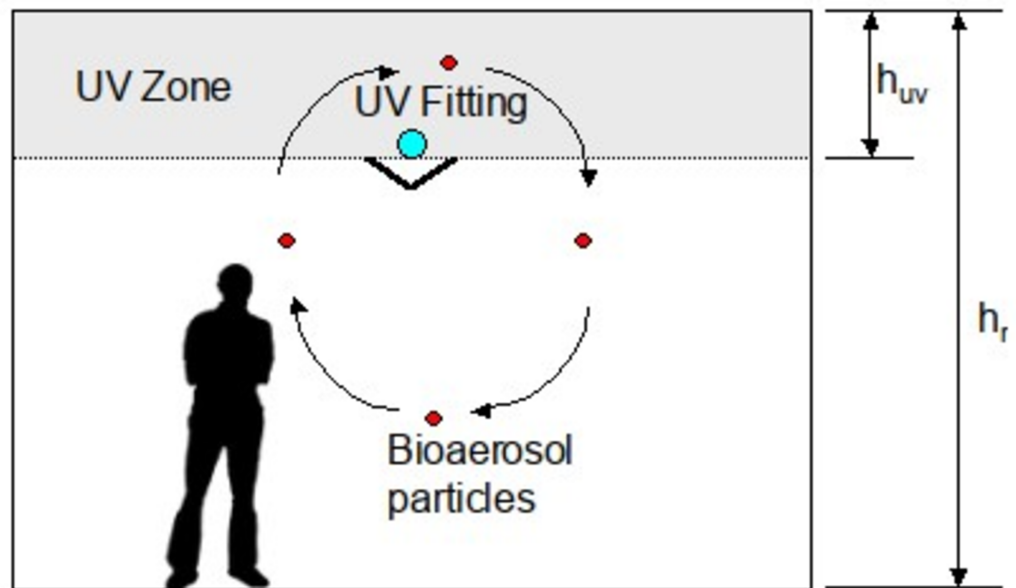


Figure 1 An upper-room UVGI installation.

Full-size DOI: 10.7717/peerj.10196/fig-1

been muted as a potential intervention that might prove effective against COVID-19 (Morawska *et al.*, 2020; Nardell & Nathavitharana, 2020; Skorzewska, 2020). Upper-room UVGI utilizes UV-C light at wavelengths close to 254 nm to create an irradiation field above the heads of room occupants (Fig. 1) that disinfects aerosolised bacteria and viruses suspended in the air (Beggs *et al.*, 2006; Beggs & Sleight, 2002; Noakes, Khan & Gilkeson, 2015). Because UV-C light is harmful to humans, such systems utilize louvers or shields that obscure the UV lamps from eyesight so that room occupants are kept safe. As such, upper-room UVGI is a well-established technology (First *et al.*, 1999a, 1999b) that has proven effective as a public health intervention to prevent the spread of airborne diseases such as measles (Nardell & Nathavitharana, 2019) and tuberculosis (TB) (Escombe *et al.*, 2009; Mphahlele *et al.*, 2015) in buildings.

Given that COVID-19 can be transmitted by the inhalation of aerosolised respiratory droplets containing the SARS-CoV-2 virus (Beggs, 2020; Miller *et al.*, 2020; Morawska *et al.*, 2020; Stadnytskyi *et al.*, 2020), and that several studies have recovered viral RNA from hospital air samples (Chia *et al.*, 2020; Guo *et al.*, 2020; Jiang *et al.*, 2020; Santarpia *et al.*, 2020), there is reason to believe that upper-room UVGI might be effective at “killingx201D; (inactivating) SARS-CoV-2 virions in the air, thus reducing the transmission of COVID-19 in buildings and other enclosed spaces. However, this presupposes that the technology is capable of delivering irradiation doses high enough to inactivate SARS-CoV-2 virions in respiratory droplets suspended in the air, something that has not yet been proven. Given this and the urgent need to develop interventions to break the chain of infection associated with COVID-19, we designed the short feasibility study reported here with the aim of evaluating whether or not upper-room UVGI might be an effective intervention against COVID-19.

METHODS

Theory

At any point in time the amount of viral inactivation (disinfection) achieved for a given UV radiant flux (irradiance) can be described using the following first order decay equation (*McDevitt, Rudnick & Radonovich, 2012*).

$$N_t = N_0 \times e^{-Z.E.t} \quad (1)$$

where: N_0 and N_t are the number of viable viral particles (virions) at time zero and t seconds respectively; Z is the UV susceptibility constant for the virus (m^2/J); E is the radiant (irradiation) flux (W/m^2); and t is time in seconds.

The UV irradiation dose received by the virus is simply:

$$H = E \times t \quad (2)$$

where: H is the observed UV irradiation dose (J/m^2).

By combining [Eqs. \(1\) and \(2\)](#), and rearranging we can obtain a value for Z .

$$Z = -\frac{1}{H} \times \ln\left(\frac{N_t}{N_0}\right) = -\frac{1}{H} \times \ln(f) \quad (3)$$

where: f is the survival fraction.

Because the relationship between the UV dose and the natural logarithm of the survival fraction is broadly linear for most viral species, it means that the behavior of any given virus exposed to UV-C light can be succinctly described by the value of Z , irrespective of the actual UV dose applied. As such, for any given viral species, if the value of Z is known, then it should be possible to predict with reasonable accuracy how the virus will behave when exposed to a given UV-C dose in any context. Microbes that exhibit larger Z values are more susceptible to UV damage, whereas those with small Z values are more difficult to inactivate.

UV inactivation plots for most viral species tend to be straight lines, although some might exhibit a curve (*Kariwa, Fujii & Takashima, 2006*). Notwithstanding this, the model described in [Eq. \(1\)](#) is still a good approximation for most viral species (*McDevitt, Rudnick & Radonovich, 2012*) up until the point where the “target” becomes saturated with UV photons. At this point, because all the virions have already been inactivated, increasing the UV dose further has no effect and so the linear relationship between UV dose and the log reduction becomes decoupled, with the result that the Z value no longer applies.

Instead of quantifying UV inactivation in terms of survival fraction, many researchers, particularly those working in biology, describe the reduction in the microbial count in terms of log reduction, which can be converted to survival fraction as follows:

$$f = \frac{1}{10^A} \quad (4)$$

where: A is the \log_{10} reduction in the number of virions.

Specifically, with regard to upper-room UVGI, once the Z value has been obtained for the target microbe, it is then possible to determine the irradiation flux required to disinfect

it, using the methodology described in *Beggs & Sleigh (2002)*. This method makes the assumption that the room air is well mixed, which is a reasonable approximation for most applications (*Beggs & Sleigh, 2002*). If this is the case, then the average particle residence time, t_{res} (in seconds) in the room space will be:

$$t_{\text{res}} = \frac{1}{n} \times 3,600 \quad (5)$$

where: n is the room ventilation rate in air changes per hour (AC/h).

From [Eq. \(5\)](#) it can be approximated that the average particle residence time in the upper-room UV field, t_{uv} (in seconds) will be:

$$t_{\text{uv}} = t_{\text{res}} \times \frac{h_{\text{uv}}}{h_r} \quad (6)$$

where: h_r is the floor-to-ceiling height (m), and h_{uv} is the depth of the upper-room UV zone (m) (see [Fig. 1](#)).

Because Z values are often determined experimentally using microbes suspended in liquids or on surfaces, it may be necessary to adjust the Z value for use with upper-room UVGI systems (*Beggs et al., 2006; Yang et al., 2017*), as follows:

$$Z_{\text{ur}} = Z \times c_{\text{ur}} \quad (7)$$

where: Z_{ur} is the effective upper-room Z value (m^2/J), and c_{ur} is a correction coefficient.

For practical purposes, Z_{ur} can be assumed to be the same as the Z value achieved when a given microbe is irradiated in an aerosol.

So if we assume that the air in a room is well mixed, by combining [Eqs. \(2\), \(3\)](#) and [\(6\)](#) it is possible to compute the average irradiation flux, E_r , that is required to achieve a desired survival fraction, f_r .

$$E_r = -\frac{1}{(Z_{\text{ur}} \times t_{\text{uv}})} \times \ln(f_r) \quad (8)$$

Alternatively, the disinfection achieved by an upper-room UVGI system can be thought of as being equivalent to additional air changes in the room space (*McDevitt et al., 2008*). In this scenario, the UV rate constant, k_{uv} , which can be thought of as the equivalent air change rate per second, can be determined using (*Beggs et al., 2006*):

$$k_{\text{uv}} = Z_{\text{ur}} \times E \times \frac{h_{\text{uv}}}{h_r} \quad (9)$$

So, in a ventilated room in which contamination ceases at time zero, we can utilize both the UV rate constant, k_{uv} , and a rate constant, k_v , for the ventilation (i.e., $n \div 3,600$), to produce a decay model for the room space.

$$C_t = C_0 \times e^{-(k_v+k_{\text{uv}}+k_d)t} \quad (10)$$

where: C_0 and C_t are the concentrations of viable viral particles in the room space (virions/ m^3) at time zero and t seconds respectively; k_v is the ventilation rate constant; k_d is

the particulate deposition rate constant (e.g., 0.0014 s^{-1} (Stadnytskyi et al., 2020)); and t is time in seconds.

Analysis of published data

A search of the relevant scientific literature (i.e., published literature, pre-prints and relevant websites) was undertaken to identify published data relating to the UV irradiation of the three closely related coronaviruses: SARS-CoV-2, the causative agent of COVID-19; SARS-CoV-1, the causative agent of severe acute respiratory syndrome (SARS); and MERS-CoV, the causative agent of middle east respiratory syndrome (MERS).

Because the experimental methods used in the various UV studies varied greatly, as did the level of detail reported, it was necessary to adopt a standardized approach so that valid comparisons could be made. It was therefore decided that, rather than estimating the Z value for a nominal log one reduction (i.e., D_{90}) as others have done (Kowalski, 2010), we would instead use the log reduction values and UV doses reported in the various studies to calculate the respective Z values using Eq. (3). In so doing, we were able to utilize the results from studies that would otherwise be excluded because the log reductions achieved were far in excess of one. Where researchers performed experiments using a range of UV doses, we calculated the Z value for two UV doses, one near the start of the inactivation process and the other just before the saturation point. So as to avoid bias due to pseudo-replication, when computing the average Z values for the respective viral species, we first aggregated the Z values reported for the various individual studies and then used the aggregated values to calculate the overall mean Z values for the respective viruses.

In order to compare the Z values for the coronaviruses with those for influenza, we utilized experimental results produced by Heimbuch & Harnish (2019) who irradiated coupons of respirator material inoculated with SARS-CoV-1 and MERS-CoV, as well as four strains of influenza A, allowing direct comparisons to be made between the viral species.

Estimating an effective upper-room Z value for aerosolised SARS-CoV-2

In order to evaluate how SARS-CoV-2 might behave in the presence of UV-C when aerosolised, we reviewed the available literature on the subject (Jensen, 1964; Kowalski, 2010; Kowalski et al., 2000; McDevitt, Rudnick & Radonovich, 2012; Walker & Ko, 2007) with the aim of estimating a value for the coefficient, c_{ur} , in Eq. (7), which we then used to estimate the effective upper-room Z value, Z_{ur} . In order to reflect the uncertainty associated with this, we compared effective Z values for aerosolised coronaviruses reported in the literature with values obtained for SARS-CoV-2 in liquids to obtain the range of possible values for c_{ur} .

Computation of required upper-room UV irradiation flux

Having estimated the value of Z_{ur} for SARS-CoV-2 from the literature, we then used Eqs. (6) and (8) to estimate the average upper-room irradiation flux that would be required

Table 1 UV-C doses applied and log reductions achieved in various studies relating to the SARS-CoV-1 and MERS-CoV viruses.

Virus	UV wave length (nm)	Medium & context	Irradiance ($\mu\text{W}/\text{cm}^2$)	Duration (min & s)	UV Dose (mJ/cm^2)	Inactivation (log reduction)	References
SARS-CoV-1	UV-C (nr)	Liquid in well plate	>90	15 min	>81	>log 0.602	<i>Duan et al. (2003)</i>
SARS-CoV-1	254	Liquid in well plate	4,016	1 min	241	log 1.4*	<i>Darnell et al. (2004)</i>
SARS-CoV-1	254	Liquid in well plate	4,016	6 min	1,446	log 4.5*	<i>Darnell et al. (2004)</i>
SARS-CoV-1	254	Liquid in well plate	4,016	20 min	4,819	log 4.1*	<i>Darnell & Taylor (2006)</i>
SARS-CoV-1	UV-C (nr)	Liquid in well plate	134	5 min	40	log 3.2*	<i>Kariwa, Fujii & Takashima (2006)</i>
SARS-CoV-1	UV-C (nr)	Liquid in well plate	134	15 min	121	log 5.325	<i>Kariwa, Fujii & Takashima (2006)</i>
SARS-CoV-1	254	Respirator surface	2,300	7.25 min	1,000	\geq log 4.81	<i>Heimbuch & Harnish (2019)</i>
SARS-CoV-1	254	Platelet concentrates	nr	nr	50	log 3.05	<i>Eickmann et al. (2020)</i>
SARS-CoV-1	254	Platelet concentrates	nr	nr	100	\geq log 3.5	<i>Eickmann et al. (2020)</i>
MERS-CoV	254	Respirator surface	2,300	7.25 min	1,000	\geq log 4.5	<i>Heimbuch & Harnish (2019)</i>
MERS-CoV	UV-C (nr)	Droplet on glass slip	nr	5 min	nr	\geq log 5.91	<i>Bedell, Buchaklian & Perlman (2016)</i>
SARS-CoV-2	254	Liquid in well plate	1,082	nr	3.7	log 3.3	<i>Bianco et al. (2020)</i>
SARS-CoV-2	UV-C (nr)	Inoculated material	nr	6 s	5.0	log 2.0	<i>Signify (2020)</i>
SARS-CoV-2	UV-C (nr)	Inoculated material	nr	25 s	22.0	log 6.0	<i>Signify (2020)</i>
SARS-CoV-2	280	Liquid in petri dish	3,750	1 s	3.75	log 0.9	<i>Inagaki et al. (2020)</i>
SARS-CoV-2	280	Liquid in petri dish	3,750	10 s	37.5	log 3.0	<i>Inagaki et al. (2020)</i>

Notes:

* Estimated from plots and data presented in source material.
nr, not reported in source material.

to achieve a 50–90% reduction in aerosolised SARS-CoV-2 virions (through the action of the UV-C alone) in a $4.2 \times 4.2 \times 2.5$ m high room space for a range of ventilation rates. These dimensions were chosen because they are typical for an upper-room UVGI installation in which the lamp height is 2.1 m above the floor (*First et al., 1999b*). In the model we assumed that the air was completely mixed, which meant that according to Eq. (6), aerosol particles would spend on average 16% of their room residency time in the UV zone.

In addition to computing the required UV flux, we also wanted to know how a standard upper-room UV fitting might perform when challenged by SARS-CoV-2. In accordance with the guidelines stated by *First et al. (1999b)*, we assumed that the room contained a single 30 W (input) UV-C fitting capable of delivering an average upper-room flux of $50 \mu\text{W}/\text{cm}^2$, and modeled its performance in terms of equivalent ventilation rate using Eq. (9).

RESULTS

Analysis of the published literature

The results of the literature search are summarized in Table 1, which shows the UV-C (254 nm) doses applied and log reductions achieved in six studies investigating SARS-CoV-1 (*Darnell et al., 2004; Darnell & Taylor, 2006; Duan et al., 2003; Eickmann et al., 2020; Heimbuch & Harnish, 2019; Kariwa, Fujii & Takashima, 2006*), two studies investigating MERS-CoV (*Bedell, Buchaklian & Perlman, 2016; Heimbuch & Harnish, 2019*), and two studies investigating SARS-CoV-2 (*Bianco et al., 2020; Signify, 2020*). Table 1 also includes the results of one study that investigated the impact of

Table 2 UV-A/B doses applied and log reductions achieved in the various studies relating to the disinfection of SARS-CoV-2 and MERS-CoV in blood products when riboflavin is used.

Virus	UV wave length (nm)	Medium & context	Irradiance ($\mu\text{W}/\text{cm}^2$)	Duration (min)	UV Dose (mJ/mL)	Inactivation (log reduction)	References
MERS-CoV	270–360	Blood plasma + riboflavin (pooled)	nr	nr	6,240	$\geq \log 4.07$	<i>Keil, Bowen & Marschner (2020)</i>
MERS-CoV	270–360	Blood plasma + riboflavin (single donor)	nr	nr	6,240	$\geq \log 4.42$	<i>Keil, Bowen & Marschner (2020)</i>
SARS-CoV-2	270–360	Blood plasma + riboflavin	nr	4	1,872	$\geq \log 2.61$	<i>Ragan et al. (2020)</i>
SARS-CoV-2	270–360	Blood plasma + riboflavin	nr	4	3,744	$\geq \log 4.72$	<i>Ragan et al. (2020)</i>
SARS-CoV-2	270–360	Blood plasma + riboflavin	nr	nr	6,240	$\geq \log 3.4$	<i>Keil et al. (2020)</i>
SARS-CoV-2	270–360	Platelets + riboflavin	nr	nr	6,240	$\geq \log 4.53$	<i>Keil et al. (2020)</i>

Note:

nr, not reported in source material.

deep-UV light at 280 nm (i.e., the boundary between UV-B and UV-C) on SARS-CoV-2 (*Inagaki et al., 2020*). In addition, three studies were found that used a combination of UV-A and UV-B light (270–360 nm), together with the photosensitiser, riboflavin, to disinfect SARS-CoV-2 (*Keil et al., 2020; Ragan et al., 2020*) and MERS-CoV (*Keil, Bowen & Marschner, 2020*) in blood products (Table 2). Although these studies did not utilize UV-C light, it was nevertheless decided to report the results of these studies here so that direct comparisons could be made between SARS-CoV-2 and MERS-CoV. The MERS-CoV irradiation study by *Bedell, Buchaklian & Perlman (2016)* is included for completeness, even though the authors did not report the UV dose received by the virus, making it impossible to compute a Z value for this study.

The computed Z values for the respective experiments are shown in Table 3 (UV-C and deep-UV) and Table 4 (UV-A/B plus riboflavin). From these it can be seen that the Z values for the MERS-CoV virus were similar in magnitude to those for both SARS-CoV-1 (UV-C) and SARS-CoV-2 (UV-A/B). With UV-C irradiation the mean Z value for SARS-CoV-1 was 0.00489 (SD = 0.00611) m^2/J , whereas that for MERS-CoV was 0.00104 m^2/J . Likewise, for UV-A/B plus riboflavin the corresponding Z values were 0.00020 (SD = 0.00009) m^2/J and 0.00016 m^2/J for SARS-CoV-2 and MERS-CoV respectively. However, by comparison SARS-CoV-2 appeared to be more susceptible to UV damage than either SARS-CoV-1 or MERS-CoV when irradiated with UV-C (mean Z = 0.14141 (SD = 0.09045) m^2/J) and deep-UV light (mean Z = 0.03684 m^2/J).

The calculated Z values for influenza UV-C irradiation experiments undertaken by *Heimbuch & Harnish (2019)* are presented in Table 5. These experiments, which were carried out using inoculated coupons of respirator material, revealed that in this context the Z values for the various influenza A strains were of the same order of magnitude as those for SARS-CoV-1 and MERS-CoV.

Effective upper-room Z values for aerosolised SARS-CoV-2

A review of the literature revealed that relatively few experimental studies have been performed involving the UV irradiation of aerosolised viruses, with only three undertaken

Table 3 Calculated Z values for the UV-C irradiation experiments.

Virus	UV Dose (mJ/cm ²)	Inactivation (log reduction)	UV susceptibility constant, Z (m ² /J)	References
SARS-CoV-1	>81	>log 0.602	0.00171	<i>Duan et al. (2003)</i>
SARS-CoV-1	241	log 1.4*	0.00134*	<i>Darnell et al. (2004)</i>
SARS-CoV-1	1,446	log 4.5*	0.00072*	<i>Darnell et al. (2004)</i>
SARS-CoV-1	4,819	log 4.1*	0.00020*	<i>Darnell & Taylor (2006)</i>
SARS-CoV-1	40	log 3.2*	0.01833*	<i>Kariwa, Fujii & Takashima (2006)</i>
SARS-CoV-1	121	log 5.325	0.01017	<i>Kariwa, Fujii & Takashima (2006)</i>
SARS-CoV-1	1,000	≥log 4.81	0.00111	<i>Heimbuch & Harnish (2019)</i>
SARS-CoV-1	50	log 3.05	0.01405	<i>Eickmann et al. (2020)</i>
SARS-CoV-1	100	≥log 3.5	0.00806	<i>Eickmann et al. (2020)</i>
MERS-CoV	1,000	≥log 4.5	0.00104	<i>Heimbuch & Harnish (2019)</i>
SARS-CoV-2	3.7	log 3.3	0.20536	<i>Bianco et al. (2020)</i>
SARS-CoV-2	5	log 2.0	0.09210	<i>Signify (2020)</i>
SARS-CoV-2	22	log 6.0	0.06280	<i>Signify (2020)</i>
SARS-CoV-2	3.75**	log 0.9	0.05526	<i>Inagaki et al. (2020)</i>
SARS-CoV-2	37.5**	log 3.0	0.01842	<i>Inagaki et al. (2020)</i>

Notes:

* Estimated from plots and data presented in source material.

** Using deep-UV light at 222 nm.

Table 4 Calculated Z values for the UV-A/B irradiation plus riboflavin experiments.

Virus	UV Dose (mJ/mL)	Inactivation (log reduction)	UV susceptibility constant, Z (m ² /J)	References
MERS-CoV	6,240	≥log 4.07	0.00015	<i>Keil, Bowen & Marschner (2020)</i>
MERS-CoV	6,240	≥log 4.42	0.00016	<i>Keil, Bowen & Marschner (2020)</i>
SARS-CoV-2	1,872	≥log 2.61	0.00032	<i>Ragan et al. (2020)</i>
SARS-CoV-2	3,744	≥log 4.72	0.00029	<i>Ragan et al. (2020)</i>
SARS-CoV-2	6,240	≥log 3.4	0.00013	<i>Keil et al. (2020)</i>
SARS-CoV-2	6,240	≥log 4.53	0.00017	<i>Keil et al. (2020)</i>

on a coronavirus (*Buonanno et al., 2020; Walker & Ko, 2007*). A summary of the findings of several key studies are presented in [Table 6](#), which reveals that most viral species appear to be relatively easy to disinfect when suspended in droplets in the air. In particular, aerosolised viruses appear to be more vulnerable to UV damage than when they are suspended in a liquid or on a substrate. For example, for the 24 irradiation experiments involving adenoviruses suspended in liquid, reported by *Kowalski (2010)*, the average Z value was 0.00586 m²/J, which is an order of magnitude less than the values of 0.0546 and 0.0390 m²/J for aerosolised adenoviruses, attributed to *Jensen (1964)* and *Walker & Ko (2007)* respectively. Regarding coronaviruses, *Walker & Ko (2007)* also performed experiments on aerosolised murine (mouse) hepatitis virus (MHV) coronavirus in a single pass test rig. This revealed a Z value of 0.377 ± 0.119 m²/J for this virus.

Table 5 Calculated Z values for the UV-C irradiation experiments for different strains of influenza A tested by Heimbuch & Harnish.

Virus	Medium & context	UV Dose (mJ/cm ²)	Inactivation (log reduction)	UV susceptibility constant, Z (m ² /J)
Influenza A (H1N1)	Respirator surface	1,000	≥log 6.01	0.00138
Avian influenza A (H5N1)	Respirator surface	1,000	≥log 4.46	0.00103
Influenza A (H7N9), A/Anhui/1/2013 strain	Respirator surface	1,000	≥log 5.15	0.00119
Influenza A (H7N9), A/Shanghai/1/2013	Respirator surface	1,000	≥log 5.31	0.00122

Table 6 Summary of reported effective Z values for single-pass UV irradiation experiments performed on aerosolised viruses in air.

Researchers	Virus	UV-C wavelength (nm)	Effective Z value (m ² /J)	Reporter
<i>Jensen (1964)</i>	Adenovirus	254	0.0546	<i>Kowalski et al. (2000)</i>
<i>Jensen (1964)</i>	Coxsackie B-1	254	0.1108	<i>Kowalski et al. (2000)</i>
<i>Jensen (1964)</i>	Influenza A	254	0.1187	<i>Kowalski et al. (2000)</i>
<i>Jensen (1964)</i>	Sindbis virus	254	0.1040	<i>Kowalski (2010)</i>
<i>Jensen (1964)</i>	Vaccinia virus	254	0.1528	<i>Kowalski et al. (2000)</i>
<i>Walker & Ko (2007)</i>	Adenovirus	254	0.0390	<i>Walker & Ko (2007)</i>
<i>Walker & Ko (2007)</i>	MHV coronavirus	254	0.3770	<i>Walker & Ko (2007)</i>
<i>McDevitt, Rudnick & Radonovich (2012)</i>	Influenza A	254	0.2700	<i>McDevitt, Rudnick & Radonovich (2012)</i>
<i>McDevitt et al. (2007)</i>	Vaccinia virus	254	2.5400	<i>McDevitt et al. (2007)</i>
<i>Buonanno et al. (2020)</i>	Human coronavirus 229E	222	0.4100	<i>Buonanno et al. (2020)</i>
<i>Buonanno et al. (2020)</i>	Human coronavirus OC43	222	0.5900	<i>Buonanno et al. (2020)</i>

Buonanno et al. (2020) also performed irradiation experiments on aerosolised coronaviruses, but using UV light at 222 nm (far-UV) rather than 254 nm. They found the Z values for human coronavirus 229E and human coronavirus OC43 to be 0.410 m²/J and 0.590 m²/J respectively. Collectively, these Z values are an order of magnitude greater than the values obtained for SARS-CoV-2 in liquid, implying that when aerosolised, coronaviruses in general and SARS-CoV-2 in particular, are much easier to disinfect compared with when they are presented in liquids or on surfaces. Although we are comparing different species of coronavirus here, evidence from *Bedell, Buchaklian & Perlman (2016)*, who irradiated MHV coronavirus and MERS-CoV in Petri dishes, suggests that it is nonetheless valid. They found that 5 min exposed to a UV-C light source resulted in a 2.71 log reduction for the MHV coronavirus, whereas the same exposure resulted in a 5.91 log reduction for MERS-CoV. This suggests that MHV coronavirus is actually more resistant to UV damage than MERS-CoV, and as such, supports *Walker & Ko (2007)* conclusion that coronaviruses are much easier to inactivate in the air compared with on surfaces and in liquids.

Table 7 Predicted average upper-room UV irradiance fluxes required to achieve 50%, 70% and 90% inactivation for SARS-CoV-2 assuming a range of Z_{ur} values and ventilation rates (Assuming $Z_{ur} = 0.377$ or 0.0377 m²/J).

Ventilation rate (AC/h)	Average particle residence time in UV field. (min)	UV susceptibility constant, Z_{ur} (m ² /J)	Average irradiance required for 50% inactivation (μ W/cm ²)	Average irradiance required for 70% inactivation (μ W/cm ²)	Average irradiance required for 90% inactivation (μ W/cm ²)
1	9.6	0.3770	0.319	0.554	1.060
2	4.8	0.3770	0.638	1.109	2.121
4	2.4	0.3770	1.277	2.218	4.241
6	1.6	0.3770	1.915	3.327	6.362
8	1.2	0.3770	2.554	4.436	8.482
1	9.6	0.0377	3.192	5.544	10.604
2	4.8	0.0377	6.384	11.088	21.207
4	2.4	0.0377	12.768	22.177	42.414
6	1.6	0.0377	19.152	33.266	63.621
8	1.2	0.0377	25.536	44.355	84.829

Comparing the computed Z values for UV-C irradiation experiments on the MHV coronavirus conducted in air (0.37700 m²/J (*Walker & Ko, 2007*)) with those for the SARS-CoV-2 virus in liquid ranging from 0.06280 m²/J (*Signify, 2020*) to 0.20536 m²/J (*Kariwa, Fujii & Takashima, 2006*), it would appear that irradiating the coronavirus in liquid requires a UV-C dose that is in the region 1.8–6.0 times higher than that required when the virus is suspended in air. From this we estimated that the value of the adjustment coefficient c_{ur} would be in a range 0.167–0.545.

Upper-room UVGI computation results

Because no UV irradiation experiments have to date been performed on aerosols containing the SARS-CoV-2 virus, it was necessary when undertaking the feasibility study to make assumptions regarding an appropriate value of Z_{ur} to use in the upper-room UVGI analysis. With respect to this, because the published mean Z values for the aerosolised coronaviruses were all in the region 0.377 – 0.590 m²/J, we felt that an assumed Z value in this range would be indicative of how airborne SARS-CoV-2 might behave in a UV-C field. A decision was therefore made to use Walker and Ko's Z value figure of 0.377 m²/J to evaluate the expected performance of the upper-room UVGI installation, because this was considered a conservative value. In addition, because of the uncertainty associated with this assumed value, we introduced a "factor of safety" into our analysis by also modeling a worst-case scenario in which Z_{ur} was 0.0377 m²/J.

Table 7 presents the results of the room analysis using these two values for Z_{ur} , for a range of ventilation rates. From this it can be seen that there is a direct inverse relationship between particle residence time in the UV field, t_{uv} , and the required irradiation flux, E_r , as predicted by [Eq. \(8\)](#). This means that for any given Z value, the value of E_r will double as the room ventilation rate doubles. The table also reveals that there is a direct inverse relationship between Z_{ur} and E_r . From the calculated values in this table it can be seen

that if $Z_{ur} = 0.377 \text{ m}^2/\text{J}$, then with an average UV flux of just $10 \text{ }\mu\text{W}/\text{cm}^2$ it should be possible to achieve >90% inactivation of SARS-CoV-2, even at a ventilation rate of 8 AC/h. However, if in reality, Z_{ur} , is $0.0377 \text{ m}^2/\text{J}$, then all the calculated fluxes would have to increase by a factor of ten to achieve the same results. Given that accepted guidelines (*First et al., 1999b*) recommend for a room 2.5 m high, one 30 W (input) UV lamp per 18.58 m^2 of floor area, which will produce an average flux in the region $50 \text{ }\mu\text{W}/\text{cm}^2$, this means that even under this worst-case scenario it should still be possible to achieve disinfection rates >90% for all but the highest ventilation rates.

When we fixed the UV flux at an average of $50 \text{ }\mu\text{W}/\text{cm}^2$, we found that for $Z_{ur} = 0.377 \text{ m}^2/\text{J}$ the upper-room UVGI installation produced an equivalent air change rate of 108.6 AC/h, whereas if $Z_{ur} = 0.0377 \text{ m}^2/\text{J}$ this fell to 10.9 AC/h. These values were constant and unaffected by the actual room ventilation rate.

DISCUSSION

Analysis of the literature relating to the UV irradiation of coronaviruses clearly reveals that SARS-CoV-2, when in a liquid assay, is relatively easily inactivated by UV light at both 254 nm (*Bianco et al., 2020; Signify, 2020*) and 280 nm (*Inagaki et al., 2020*). Indeed, the results in [Table 3](#) suggest that the virus is likely to be more susceptible to UV-C damage than either SARS-CoV-1 or MERS-CoV. Furthermore, the results of the experiments where SARS-CoV-2 was exposed to UV-A/B and riboflavin, suggest that the virus is susceptible to damage, albeit to a lesser extent, caused by UV light at other wavelengths. As such, this appears to support the finding of *Sagripanti & Lytle (2020)* that SARS-CoV-2 is vulnerable to sunlight.

One problem frequently encountered when comparing UV irradiation results from disparate researchers is that experimenters often utilize different methodologies to evaluate log reductions in microbial species, with varying doses of UV administered. In particular, the type of substrate or media used can greatly influence the outcome of the experiment. This is because the substrate or media can absorb the UV photons and shield the virus. Given this, it is important to compare like with like, if this is possible. For this reason we included the results of *Heimbuch & Harnish (2019)* in [Tables 3](#) and [5](#), because they performed the same irradiation experiment on SARS-CoV-1 and MERS-CoV, as well as on four strains of influenza A, thus allowing direct comparisons to be made. From [Tables 3](#) and [5](#) it can be seen that the Z values for the influenza strains are of a similar order of magnitude as those for the coronaviruses, implying that in this context SARS-CoV-1 and MERS-CoV were about as difficult to inactivate as influenza A. This is a surprising finding, because others have suggested that the UV dose required to inactivate SARS-CoV-2 might be lower than that required to disinfect influenza A (*Sagripanti & Lytle, 2020*). This is because coronaviruses have genomes that are approximately twice as long as that of influenza A, making them in theory much more vulnerable to damage from UV-C (*Sagripanti & Lytle, 2020*). Indeed, in a summary collated from hundreds of published studies by *Kowalski (2010)*, the Z values for influenza A in water were reported as being in the range $0.04800\text{--}0.13810 \text{ m}^2/\text{J}$, much higher than the values achieved by *Heimbuch & Harnish (2019)*. As such, this suggests that the substrate or medium in which

microbes are irradiated plays an important role in influencing the magnitude of the Z value achieved. Indeed, it is well known in other contexts that UV-C light can be attenuated as it passes through liquids (Mamane, 2008). When UV light passes through a suspension of particles in water, its intensity is reduced due to both scattering and absorption of the light (Gregory, 2005). Absorption occurs because the light beam interacts with atoms and molecules in the liquid to raise their energy level, with the result that energy is lost from the beam, whereas scattering occurs when particulates in the fluid interfere with the UV light making it more diffuse (Mamane, 2008). Particulates can also shield microbes from UV light. This means that UV inactivation of microbial suspensions in liquid films >1.2 mm can be greatly inhibited, due to the low penetration depth of UV light through concentrated suspensions (Cheng et al., 2020). Consequently, when interpreting the Z values for SARS-CoV-1, SARS-CoV-2 and MERS-CoV in Table 3, it is important to view them as being strictly contextual.

With regard to UV irradiation of aerosolised viruses, very few published experimental studies exist, with only three specifically relating to coronaviruses (Buonanno et al., 2020; Walker & Ko, 2007). As a result there is a paucity of good quality data relating to UV-C irradiation of SARS-CoV-1, SARS-CoV-2 and MERS-CoV in the air. Consequently, we had to establish whether or not Walker & Ko (2007) published Z value of 0.377 m²/J was valid for SARS-CoV-2 in air. Comparison with the Z values presented in Table 3 reveals that this value is considerably greater in magnitude than those achieved for the coronaviruses when they were irradiated in liquid or on equipment substrates. This however, is to be expected given that liquids attenuate UV penetration (Mamane, 2008). Also the finding appears to be broadly in keeping with the behavior of adenoviruses when irradiated in air and in liquid. Furthermore, because Bedell, Buchaklian & Perlman (2016) found MERS-CoV to be more susceptible to UV-C damage than MHV coronavirus, this strongly supports the use of Walker & Ko (2007) Z value for MHV coronavirus as a valid surrogate for SARS-CoV-2 in air. Having said this, because the UV susceptibility of the target microbe is crucial to the performance of any upper-room UVGI installation, our use of Walker and Ko's Z value for the MHV coronavirus to represent SARS-CoV-2 should be treated with caution. For this reason, when we assessed the performance of the upper-room UVGI in our hypothetical room, we used both 0.377 and 0.0377 m²/J in our simulations. In so doing, we effectively modeled both the expected and worst-case scenarios.

The results for the expected and worst-case scenarios in Table 7, strongly suggest that upper-room UVGI, if applied correctly, should be effective at disinfecting SARS-CoV-2 virions suspended in respiratory droplets in the air. This finding is of course very much dependent on the surrogate Z_{ur} value being truly representative for SARS-CoV-2. With respect to this, one limitation of our study is that we did not distinguish between the Z values achieved using a single-pass test rig, such as that used by Walker & Ko (2007), and those achieved in real-life by an upper-room UVGI system. With the latter, because the irradiation process is fragmented, compared with a single-pass system, it is thought that higher UV doses might be required to achieve equivalent levels of inactivation (Beggs et al., 2006; Yang et al., 2017). However, while this specifically applies to aerosolised

bacteria that can rapidly repair UV damage when the irradiation process becomes fragmented (Beggs, 2002), it is not known to what extent this applies to viruses, which are not metabolically active, although it is known that through photoreactivation viruses can repair UV damage (Weinbauer et al., 1997). Notwithstanding this, because the Z values achieved for coronaviruses irradiated in air (Buonanno et al., 2020; Walker & Ko, 2007) are very similar in magnitude to those exhibited by *Mycobacterium tuberculosis* (the causative agent of TB) in air (i.e., 0.33–0.48 m²/J (Riley, Knight & Middlebrook, 1976)), there is good reason to believe that upper-room UVGI might be effective at mitigating the spread of COVID-19 indoors.

Upper-room UVGI air disinfection is highly dependent on good air mixing occurring between the upper and lower portions of the room space (Beggs & Sleigh, 2002; Nicas & Miller, 1999; Noakes, Beggs & Sleigh, 2004; Zhu et al., 2013). In the study presented here we assumed that complete mixing occurred, which although a reasonable approximation in many instances, is not always the case because short circuiting can occur (Beggs & Sleigh, 2002). If the room air mixing factor is low, say for example due to stratification in a poorly ventilated space, then this can greatly impair the disinfection performance of an upper-room UVGI system (Beggs & Sleigh, 2002; Noakes, Beggs & Sleigh, 2004). It is therefore important when designing such systems to carefully consider the air movement in the room space, in order to eliminate stagnant regions and maximize air movement through the UV field. In the context of COVID-19, this is particularly important because, unlike TB which is spread via the inhalation of droplet nuclei <5 µm in diameter, it is thought that COVID-19 can be transmitted through the exhalation of larger respiratory droplets <100 µm, which rapidly reduce in size due to evaporation (Beggs, 2020; Liu et al., 2017; Xie et al., 2007) to become aerosols, say, <50 µm in diameter (Nicas, Nazaroff & Hubbard, 2005). These larger aerosol particles have settling velocities <0.1 m/s and as such can readily be transported on convective room air currents, with the result that they can remain suspended in room air for many minutes. However, if the velocities of the convection currents drop, then some of the larger aerosol particles may decouple from the air stream and settle out due to gravitational deposition, potentially passing through the breathing zone where they can be inhaled by the room occupants. This is particularly the case if the air is poorly mixed and stagnant regions exist within the room space. Under such circumstances larger aerosol particles might be inhaled without being fully irradiated by the upper-room UV field, undermining the effectiveness of the whole UVGI installation. Consequently, if upper-room UVGI is to be effective against COVID-19, it is important to both promote good room air mixing and also ensure that larger aerosol particles (e.g., <50 µm in diameter) receive the required UV irradiation dose. As such, this may require upper-room UVGI systems to be supplemented with ceiling mounted fans (Zhu et al., 2013) or other devices to promote the necessary air movement to ensure that larger aerosol particles are adequately irradiated.

One major advantage of upper-room UVGI is that it can be retrospectively fitted into buildings provided that the floor to ceiling height is large enough to ensure that the UV field does not impinge on room occupants (First et al., 1999b). By installing such a system it is possible to effectively “turbo-charge” the efficacy of the ventilation system.

Indeed, in keeping with the findings of *McDevitt et al. (2008)*, our analysis suggests that it is possible to achieve >100 equivalent AC/h by installing upper-room UVGI. Using Eq. (9), we can calculate the UV rate constant, k_{uv} , which can be thought of as the equivalent air change rate per second. Once known, this in turn can be used, together with the ventilation and particulate deposition rate constants, k_v , and k_d , in Eq. (10), to compute the concentration of viral particles in the room space at any point in time.

While our analysis has been able to show that upper-room UVGI has the potential to disinfect the SARS-CoV-2 virus when suspended in room air, we are nonetheless conscious of the limitations of the feasibility study. Chief among these is the fact that we had to assume the value of the upper-room UV susceptibility constant, Z_{ur} , for SARS-CoV-2. Although the true value of this constant is likely to be similar to that exhibited by other aerosolised coronaviruses, we cannot know its exact magnitude without further experimental work. Consequently, the results of the study should be considered as indicative only. Also, in the study it was assumed that the room air is well mixed, which, as discussed above, may not necessarily be the case in some applications. In particular, because the model used was relatively simple, we were not able to assess how upper-room UVGI might perform in situations where aerosol particles decouple from the air stream due to gravitational deposition, or remain suspended in the breath zone. It is therefore recommended that future studies investigating the use of upper-room UVGI to prevent COVID-19 transmission use computational fluid dynamics (CFD) to assess the limitations of the technology with respect to the disinfection of larger aerosol particles that might decouple from room air convection currents.

CONCLUSIONS

In conclusion, we have been able to demonstrate that the SARS-CoV-2 virus is relatively easily inactivated by UV-C light and that when aerosolised the virus is likely to have a UV susceptibility constant, Z_{ur} , that is similar to that exhibited by other coronaviruses in air. This suggests that SARS-CoV-2 when suspended in air should be reasonably easy to inactivate using UV light at 254 nm. As such, upper-room UVGI may have potential as an intervention to inhibit the transmission of COVID-19 in buildings, especially in situations where achieving high ventilation rates might otherwise be impractical.

ADDITIONAL INFORMATION AND DECLARATIONS

Funding

The authors received no funding for this work.

Competing Interests

The authors declare that they have no competing interests.

Author Contributions

- Clive B. Beggs conceived and designed the experiments, performed the experiments, analyzed the data, prepared figures and/or tables, authored or reviewed drafts of the paper, and approved the final draft.

- Eldad J. Avital conceived and designed the experiments, performed the experiments, analyzed the data, prepared figures and/or tables, authored or reviewed drafts of the paper, and approved the final draft.

Data Availability

The following information was supplied regarding data availability:

Data is available in [Tables 1–7](#).

REFERENCES

- Bedell K, Buchaklian AH, Perlman S. 2016.** Efficacy of an automated multiple emitter whole-room ultraviolet-C disinfection system against coronaviruses MHV and MERS-CoV. *Infection Control & Hospital Epidemiology* **37**(5):598–599 DOI [10.1017/ice.2015.348](#).
- Beggs CB. 2002.** A quantitative method for evaluating the photoreactivation of ultraviolet damaged microorganisms. *Photochemical & Photobiological Sciences* **1**(6):431–437 DOI [10.1039/b202801h](#).
- Beggs CB. 2020.** Is there an airborne component to the transmission of COVID-19? A quantitative analysis study. *medRxiv* DOI [10.1101/2020.05.22.20109991](#).
- Beggs CB, Noakes CJ, Sleight PA, Fletcher LA, Kerr KG. 2006.** Methodology for determining the susceptibility of airborne microorganisms to irradiation by an upper-room UVGI system. *Journal of Aerosol Science* **37**(7):885–902 DOI [10.1016/j.jaerosci.2005.08.002](#).
- Beggs CB, Sleight PA. 2002.** A quantitative method for evaluating the germicidal effect of upper room UV fields. *Journal of Aerosol Science* **33**(12):1681–1699 DOI [10.1016/S0021-8502\(02\)00117-9](#).
- Bianco A, Biasin M, Pareschi G, Cavalleri A, Cavatorta C, Fenizia C, Galli P, Lessio L, Lualdi M, Redaelli E. 2020.** UV-C irradiation is highly effective in inactivating and inhibiting SARS-CoV-2 replication. *medRxiv* DOI [10.1101/2020.06.05.20123463](#).
- Buonanno M, Welch D, Shuryak I, Brenner DJ. 2020.** Far-UVC light (222 nm) efficiently and safely inactivates airborne human coronaviruses. *Scientific Reports* **10**(1):1–8 DOI [10.1038/s41598-020-67211-2](#).
- Card KJ, Crozier D, Dhawan A, Dinh M, Dolson E, Farrokhian N, Gopalakrishnan V, Ho E, Jagdish T, King ES. 2020.** UV sterilization of personal protective equipment with idle laboratory biosafety cabinets during the Covid-19 pandemic. *medRxiv* DOI [10.1101/2020.03.25.20043489](#).
- Cheng Y, Chen H, Basurto LAS, Protasenko VV, Bharadwaj S, Islam M, Moraru CI. 2020.** Inactivation of *Listeria* and *E. coli* by Deep-UV LED: effect of substrate conditions on inactivation kinetics. *Scientific Reports* **10**(1):1–14 DOI [10.1038/s41598-019-56847-4](#).
- Chia PY, Coleman KK, Tan YK, Ong SWX, Gum M, Lau SK, Sutjipto S, Lee PH, Young BE, Milton DK. 2020.** Detection of air and surface contamination by severe acute respiratory syndrome coronavirus 2 (SARS-CoV-2) in hospital rooms of infected patients. *medRxiv* DOI [10.1101/2020.03.29.20046557](#).
- Darnell MER, Subbarao K, Feinstone SM, Taylor DR. 2004.** Inactivation of the coronavirus that induces severe acute respiratory syndrome, SARS-CoV. *Journal of Virological Methods* **121**(1):85–91 DOI [10.1016/j.jviromet.2004.06.006](#).
- Darnell MER, Taylor DR. 2006.** Evaluation of inactivation methods for severe acute respiratory syndrome coronavirus in noncellular blood products. *Transfusion* **46**(10):1770–1777 DOI [10.1111/j.1537-2995.2006.00976.x](#).

- Derraik JGB, Anderson WA, Connelly EA, Anderson YC. 2020.** Rapid evidence summary on SARS-CoV-2 survivorship and disinfection, and a reusable PPE protocol using a double-hit process. *medRxiv* DOI 10.1101/2020.04.02.20051409.
- Duan SM, Zhao XS, Wen RF, Huang J-J, Pi GH, Zhang SX, Han J, Bi SL, Ruan L, Dong X-P. 2003.** Stability of SARS coronavirus in human specimens and environment and its sensitivity to heating and UV irradiation. *Biomedical and Environmental Sciences* 16:246–255.
- Eickmann M, Gravemann U, Handke W, Tolksdorf F, Reichenberg S, Muller TH, Seltsam A. 2020.** Inactivation of three emerging viruses—severe acute respiratory syndrome coronavirus, Crimea-Congo haemorrhagic fever virus and Nipah virus—in platelet concentrates by ultraviolet C light and in plasma by methylene blue plus visible light. *Vox Sanguinis* 115(3):146–151 DOI 10.1111/vox.12888.
- Escombe AR, Moore DAJ, Gilman RH, Navincopa M, Ticona E, Mitchell B, Noakes C, Martinez C, Sheen P, Ramirez R. 2009.** Upper-room ultraviolet light and negative air ionization to prevent tuberculosis transmission. *PLOS Medicine* 6(3):e43.
- First MW, Nardell EA, Chaisson W, Riley R. 1999a.** Guidelines for the application of upper-room ultraviolet germicidal irradiation for preventing transmission of airborne contagion-Part I: basic principles. *Transactions-American Society of Heating Refrigerating and Air Conditioning Engineers* 105:869–876.
- First MW, Nardell EA, Chaisson W, Riley R. 1999b.** Guidelines for the application of upper-room ultraviolet irradiation for preventing transmission of airborne contagion. Part II: design and operation guidance. *ASHRAE Transactions* 105:1–10.
- Gregory J. 2005.** *Particles in water: properties and processes*. Boca Raton: CRC Press.
- Guo Z-D, Wang Z-Y, Zhang S-F, Li X, Li L, Li C, Cui Y, Fu R-B, Dong Y-Z, Chi X-Y. 2020.** Aerosol and surface distribution of severe acute respiratory syndrome coronavirus 2 in hospital wards. *Emerging Infectious Diseases* 26(7):10–3201 DOI 10.3201/eid2607.200885.
- Hamzavi IH, Lyons AB, Kohli I, Narla S, Parks-Miller A, Gelfand JM, Lim HW, Ozog D. 2020.** Ultraviolet germicidal irradiation: possible method for respirator disinfection to facilitate reuse during COVID-19 pandemic. *Journal of the American Academy of Dermatology* 82(6):1511–1512 DOI 10.1016/j.jaad.2020.03.085.
- Heimbuch B, Harnish D. 2019.** *Research to mitigate a shortage of respiratory protection devices during public health emergencies*. Panama City: Applied Research Associates, Inc..
- Inagaki H, Saito A, Sugiyama H, Okabayashi T, Fujimoto S. 2020.** Rapid inactivation of SARS-CoV-2 with Deep-UV LED irradiation. *Emerging Microbes & Infections* 9(1):1744–1747.
- Jensen MM. 1964.** Inactivation of airborne viruses by ultraviolet irradiation. *Applied and Environmental Microbiology* 12(5):418–420 DOI 10.1128/AEM.12.5.418-420.1964.
- Jiang Y, Wang H, Chen Y, He J, Chen L, Liu Y, Hu X, Li A, Liu S, Zhang P. 2020.** Clinical data on hospital environmental hygiene monitoring and medical staff protection during the coronavirus disease 2019 Outbreak. *medRxiv* DOI 10.1101/2020.02.25.20028043.
- Kariwa H, Fujii N, Takashima I. 2006.** Inactivation of SARS coronavirus by means of povidone-iodine, physical conditions and chemical reagents. *Dermatology* 212(1):119–123 DOI 10.1159/000089211.
- Keil SD, Bowen R, Marschner S. 2020.** Inactivation of Middle East respiratory syndrome coronavirus (MERS-CoV) in plasma products using a riboflavin-based and ultraviolet light-based photochemical treatment. *Transfusion* 56:2948–2952.
- Keil SD, Ragan I, Yonemura S, Hartson L, Dart NK, Bowen R. 2020.** Inactivation of severe acute respiratory syndrome coronavirus 2 in plasma and platelet products using a riboflavin and ultraviolet light-based photochemical treatment. *Vox Sanguinis* DOI 10.1111/vox.12937.

- Kowalski W. 2010.** *Ultraviolet germicidal irradiation handbook: UVGI for air and surface disinfection*. Berlin: Springer Science & Business Media.
- Kowalski W, Bahnfleth WP, Witham DL, Severin BF, Whittam TS. 2000.** Mathematical modeling of ultraviolet germicidal irradiation for air disinfection. *Quantitative Microbiology* 2(3):249–270 DOI 10.1023/A:1013951313398.
- Liu L, Wei J, Li Y, Ooi A. 2017.** Evaporation and dispersion of respiratory droplets from coughing. *Indoor Air* 27(1):179–190 DOI 10.1111/ina.12297.
- Mamane H. 2008.** Impact of particles on UV disinfection of water and wastewater effluents: a review. *Reviews in Chemical Engineering* 24(2–3):67–157 DOI 10.1515/REVCE.2008.24.2-3.67.
- McDevitt JJ, Lai KM, Rudnick SN, Houseman EA, First MW, Milton DK. 2007.** Characterization of UVC light sensitivity of vaccinia virus. *Applied and Environmental Microbiology* 73(18):5760–5766 DOI 10.1128/AEM.00110-07.
- McDevitt JJ, Milton DK, Rudnick SN, First MW. 2008.** Inactivation of poxviruses by upper-room UVC light in a simulated hospital room environment. *PLOS ONE* 3(9):e3186 DOI 10.1371/journal.pone.0003186.
- McDevitt JJ, Rudnick SN, Radonovich LJ. 2012.** Aerosol susceptibility of influenza virus to UV-C light. *Applied and Environmental Microbiology* 78(6):1666–1669 DOI 10.1128/AEM.06960-11.
- Miller SL, Nazaroff WW, Jimenez JL, Boerstra A, Buonanno G, Dancer SJ, Kurnitski J, Marr LC, Morawska L, Noakes C. 2020.** Transmission of SARS-CoV-2 by inhalation of respiratory aerosol in the Skagit Valley Chorale superspreading event. *medRxiv* DOI 10.1101/2020.06.15.20132027.
- Morawska L, Tang JW, Bahnfleth W, Bluysen PM, Boerstra A, Buonanno G, Cao J, Dancer S, Floto A, Franchimon F. 2020.** How can airborne transmission of COVID-19 indoors be minimised? *Environment International* 142:105832.
- Mphahlele M, Dharmadhikari AS, Jensen PA, Rudnick SN, Van Reenen TH, Pagano MA, Leuschner W, Sears TA, Milonova SP, Van der Walt M. 2015.** Institutional tuberculosis transmission. controlled trial of upper room ultraviolet air disinfection: a basis for new dosing guidelines. *American Journal of Respiratory and Critical Care Medicine* 192(4):477–484 DOI 10.1164/rccm.201501-0060OC.
- Nardell E, Nathavitharana R. 2019.** Air disinfection in measles transmission hotspots. *Lancet* 394(10203):1009–1010 DOI 10.1016/S0140-6736(19)31889-6.
- Nardell EA, Nathavitharana RR. 2020.** Airborne spread of SARS-CoV-2 and a potential role for air disinfection. *JAMA* 324(2):141–142 DOI 10.1001/jama.2020.7603.
- Nicas M, Miller SL. 1999.** A multi-zone model evaluation of the efficacy of upper-room air ultraviolet germicidal irradiation. *Applied Occupational and Environmental Hygiene* 14(5):317–328 DOI 10.1080/104732299302909.
- Nicas M, Nazaroff WW, Hubbard A. 2005.** Toward understanding the risk of secondary airborne infection: emission of respirable pathogens. *Journal of Occupational and Environmental Hygiene* 2(3):143–154 DOI 10.1080/15459620590918466.
- Noakes CJ, Beggs CB, Sleight PA. 2004.** Effect of room mixing and ventilation strategy on the performance of upper room ultraviolet germicidal irradiation systems. In: *Proceedings of ASHRAE IAQ*. 1–13.
- Noakes CJ, Khan MAI, Gilkeson CA. 2015.** Modeling infection risk and energy use of upper-room Ultraviolet Germicidal Irradiation systems in multi-room environments. *Science and Technology for the Built Environment* 21(1):99–111 DOI 10.1080/10789669.2014.983035.

- Ragan I, Hartson L, Pidcoke H, Bowen R, Goodrich RP. 2020.** Pathogen reduction of SARS-CoV-2 virus in plasma and whole blood using riboflavin and UV light. *PLOS ONE* **15(5)**:e0233947 DOI [10.1371/journal.pone.0233947](https://doi.org/10.1371/journal.pone.0233947).
- Riley RL, Knight M, Middlebrook G. 1976.** Ultraviolet susceptibility of BCG and virulent tubercle bacilli. *American Review of Respiratory Disease* **113**:413–418.
- Sagripanti J-L, Lytle CD. 2020.** Estimated inactivation of coronaviruses by solar radiation with special reference to COVID-19. *Photochemistry and Photobiology* **96(4)**:731–737 DOI [10.1111/php.13293](https://doi.org/10.1111/php.13293).
- Santarpia JL, Rivera DN, Herrera V, Morwitzer MJ, Creager H, Santarpia GW, Crown KK, Brett-Major D, Schnaubelt E, Broadhurst MJ. 2020.** Transmission potential of SARS-CoV-2 in viral shedding observed at the University of Nebraska Medical Center. *medRxiv* DOI [10.1101/2020.03.23.20039446](https://doi.org/10.1101/2020.03.23.20039446).
- Signify. 2020.** Signify and Boston University validate effectiveness of Signify's UV-C light sources on inactivating the virus that causes COVID-19. Guildford: Signify.
- Skorzewska N. 2020.** A clinician's view from the frontline: UV light and other strategies to reduce aerosol transmission of COVID-19 and protect health workers. *Global Biosecurity* **1(3)**:gbio.60 DOI [10.31646/gbio.60](https://doi.org/10.31646/gbio.60).
- Stadnytskyi V, Bax CE, Bax A, Anfinrud P. 2020.** The airborne lifetime of small speech droplets and their potential importance in SARS-CoV-2 transmission. *Proceedings of the National Academy of Sciences* **117(22)**:11875–11877 DOI [10.1073/pnas.2006874117](https://doi.org/10.1073/pnas.2006874117).
- Walker CM, Ko G. 2007.** Effect of ultraviolet germicidal irradiation on viral aerosols. *Environmental Science & Technology* **41(15)**:5460–5465 DOI [10.1021/es070056u](https://doi.org/10.1021/es070056u).
- Weinbauer MG, Wilhelm SW, Suttle CA, Garza DR. 1997.** Photoreactivation compensates for UV damage and restores infectivity to natural marine virus communities. *Applied and Environmental Microbiology* **63(6)**:2200–2205 DOI [10.1128/AEM.63.6.2200-2205.1997](https://doi.org/10.1128/AEM.63.6.2200-2205.1997).
- Xie X, Li Y, Chwang AT, Ho PL, Seto WH. 2007.** How far droplets can move in indoor environments: revisiting the Wells evaporation-falling curve. *Indoor Air* **17(3)**:211–225 DOI [10.1111/j.1600-0668.2007.00469.x](https://doi.org/10.1111/j.1600-0668.2007.00469.x).
- Yang Y, Lai ACK, Kong RYC, Deng Q. 2017.** Experimental and numerical study of the performance of upper-room ultraviolet germicidal irradiation with the effective Z-value of airborne bacteria. *Aerosol Science and Technology* **51(10)**:1123–1134 DOI [10.1080/02786826.2017.1334108](https://doi.org/10.1080/02786826.2017.1334108).
- Zhu S, Srebric J, Rudnick SN, Vincent RL, Nardell EA. 2013.** Numerical investigation of upper-room UVGI disinfection efficacy in an environmental chamber with a ceiling fan. *Photochemistry and Photobiology* **89(4)**:782–791 DOI [10.1111/php.12039](https://doi.org/10.1111/php.12039).