



LJMU Research Online

Karyono, K, Abdullah, BM, Cotgrave, AJ and Brás, A

The Adaptive Thermal Comfort Review from the 1920s, the Present, and the Future

<http://researchonline.ljmu.ac.uk/id/eprint/13920/>

Article

Citation (please note it is advisable to refer to the publisher's version if you intend to cite from this work)

Karyono, K, Abdullah, BM, Cotgrave, AJ and Brás, A The Adaptive Thermal Comfort Review from the 1920s, the Present, and the Future. Developments in the Built Environment. ISSN 2666-1659 (Accepted)

LJMU has developed **LJMU Research Online** for users to access the research output of the University more effectively. Copyright © and Moral Rights for the papers on this site are retained by the individual authors and/or other copyright owners. Users may download and/or print one copy of any article(s) in LJMU Research Online to facilitate their private study or for non-commercial research. You may not engage in further distribution of the material or use it for any profit-making activities or any commercial gain.

The version presented here may differ from the published version or from the version of the record. Please see the repository URL above for details on accessing the published version and note that access may require a subscription.

For more information please contact researchonline@ljmu.ac.uk

<http://researchonline.ljmu.ac.uk/>

The Adaptive Thermal Comfort Review from the 1920s, the Present, and the Future

Kanisius Karyono^{1,a,b}, Badr M. Abdullah^{2,a}, Alison J. Cotgrave^{3,a}, Ana Bras^{4,a}

^a*Faculty of Engineering and Technology, Liverpool John Moores University, Byrom Street
Campus, Liverpool, L3 3AF, United Kingdom*

^b*Faculty of Engineering and Informatics, Universitas Multimedia Nusantara
Scientia Garden, Gading Serpong, Tangerang, 15810 Indonesia*

Highlights:

- The adaptive method is used to accommodate a specific group of people like the elder, temporary ill and disable people for thermal comfort.
- The adaptive method has the potential to alter the comfort zone to minimise energy use.
- Artificial Intelligence can be dangerous if the learning process is not correctly done.
- Minimising the computational load can be done by changing the approach of Explainable AI by the use of PMV-PPD for learning validation.


¹k.karyono@2019.ljmu.ac.uk, karyono@umn.ac.id

²B.M.Abdullah@ljmu.ac.uk

³A.J.Cotgrave@ljmu.ac.uk

⁴A.M.ArmadaBras@ljmu.ac.uk

Graphical Abstract

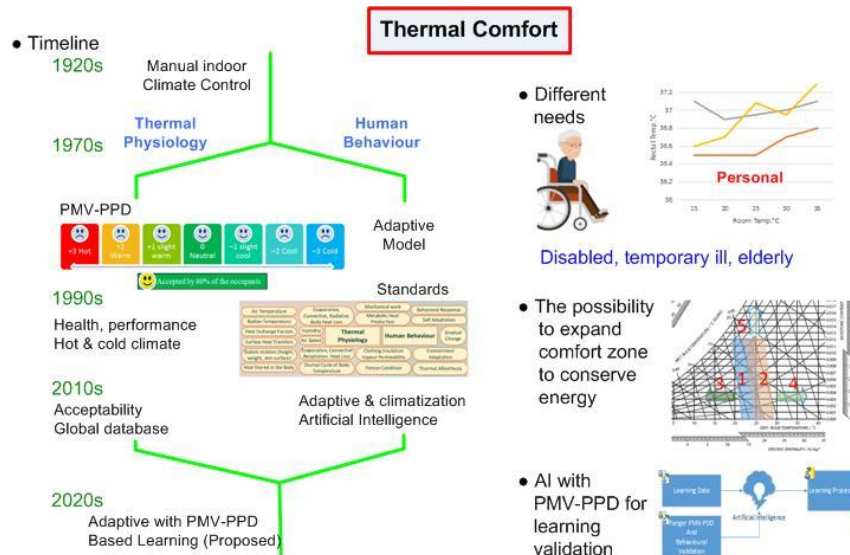

25 Abstract

The typical method for comfort analysis is the Predicted Mean Vote and Predicted Percentage Dissatisfied (PMV-PPD). However, they present limitations in accommodating the comfort of a disabled and elder group of people, which are the most vulnerable to climate change and energy poverty. The adaptive method can give flexibility and personalisation needed to overcome the problem due to the variability of the people's metabolism, historical and behavioural preferences. Investments to upgrade the indoor environmental quality and building design can then be effectively used and, for the first time, it will be possible to tailor the solutions for these particular groups of people. The adaptive approach uses Artificial Intelligence (AI), where it can introduce the imperfect learning process. Overcoming this, instead of going further for the Explainable AI, the PMV-PPD approach can be used for the learning validation and verification needed for the adaptive setting point and standards.

Keywords: Thermal comfort, PMV-PPD, adaptive approach, Explainable AI, action on The Global Climate Change, Disabled and elder group of people

40 2010 MSC: 00-01,99-00

1. Introduction

About eighty-seven per cent of the population spends their time in an artificial climate (indoor), according to the research of NHAPS [1]. This justifies that over the past fifty years, there has been a dramatic increase in research on thermal comfort methods. Human comfort is a state of mind expressing satisfactory adaptation with the immediate environment. Human comfort can be divided into smaller aspects of comfort, such as lighting comfort, acoustics comfort, air quality, and thermal comfort. These aspects are not independent, but there are relations between these comforts which are being visualised in Building Bulletin 101 Guidelines on ventilation, thermal comfort and indoor air quality in schools [2] as shown in Figure 1. The arrows represent the relations of each aspect of comfort.

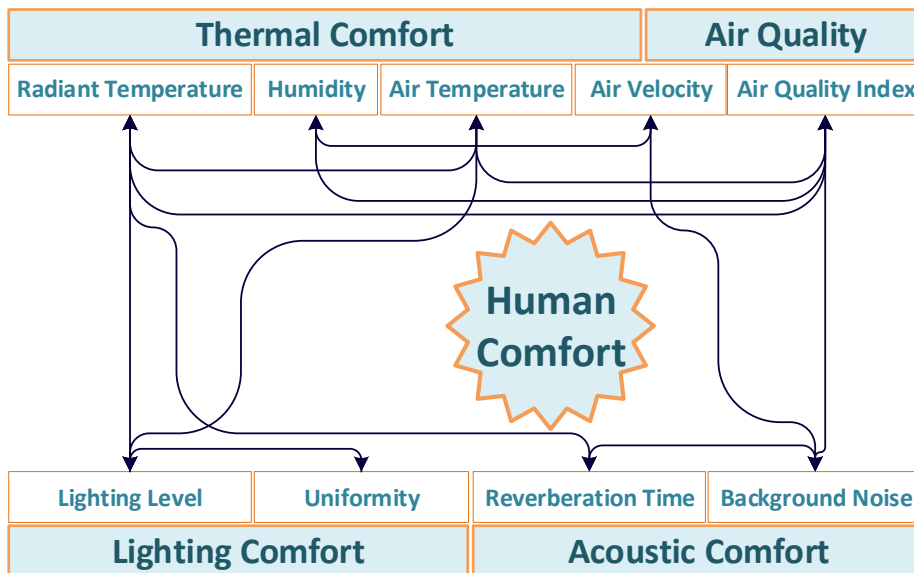


Figure 1. Human comfort aspects and their relations.

55

Although outdoor comfort is also studied in some of the papers from Höppe [3], Cocolo [4] and Lai [5], the majority of research is focussed on indoor thermal comfort. Based on the Scopus search result, “indoor” “thermal comfort” returns 73.3% more dominant compared to “outdoor” “thermal comfort due to the nature of human living.

60 Based on this fact, this paper will focus mainly on indoor thermal comfort.

1.1 Thermal Comfort impact on humans life

The thermal comfort is one of the primary concerns in the design process of the artificial climate inside the building and has a significant impact on health and safety. Some of the research found the strong relationship between ambient temperature and the cause of specific morbidities. The lag effect of hot temperature on morbidity was shorter than the cold and will also be affected by sociodemographic and pollution factors. There are enough studies to claim that mortality can be associated with cold and heat waves [6]. Heat exposure was identified to be associated with increased risk of cardiovascular, cerebrovascular and respiratory mortality. Cold-induced cardiovascular morbidity increased in youth and the elderly [7].

In the past 30 years, The World Health Organization estimates that yearly over 150,000 morbidities are caused by climate change [8]. Besides the human factors, the dwelling has a significant influence on the protection against heat and cold waves. Many existing dwelling stocks can not provide enough protection against the heat and cold waves [9]. Besides health and safety risks, thermal comfort will be beneficial also for productivity. If people work in an uncomfortable environment, they will behave unsafely due to the deterioration of their physical performance and thinking ability. The probability of committing an error will be higher due to the lower concentration. The indirect effect of thermal comfort is to improve morale in the working environment [10].

1.2 Thermal comfort and climate change

The previous references show that thermal comfort has been mainly focused on health and safety concerns. Nowadays, there also a complementary shift for research focused on lowering energy consumption and climate change. The CO₂ emission has grown 1.7% to reach 33.1 Gt and become the highest growth since 2013. This is due to the higher energy consumptions [11]. The growth in the global economy and the increase of the energy demand for heating and cooling are the leading cause of this increase. Global climate change (GCC) can decrease by 2% of heating needs.

On the contrary, the need for air conditioning increased, especially in cooling during
90 summer, due to the effects of increased humidity [12]. An increase in the global mean
surface air temperature would benefit some countries but will trigger higher loss to
others. In the United States, the weather condition triggered about 60% in the increase
of CO₂ emissions [13]. The UK Climate Projections 2018 (UKCP18) which gives the
UK climate projection tools also predicts that the future will have warmer, wetter
95 winters and hotter, drier summers [14]. Using globally averaged values, world impact
would be excess spending of 3% to compensate the GCC [15]. The GCC impact will be
worse in the later years and will make a worse impact on the more impoverished regions
[13]. The development of energy-efficiency scenarios should differ from one location
to another due to the effectiveness of such designs will not be the same for each case
100 [12].

HVAC (Heating Ventilation and Air Conditioning) system is employed to maintain
comfort. In Europe, the primary use of energy by households is for HVAC. It can reach
more than 64% of final energy consumption for the residential [11], which is very
significant. The more power being produced will always contribute to the carbon
105 footprint and will have a consequence on climate change and temperature rise. The
household sector represents 27.2 % of final energy consumption in Europe.
Anticipating these trends, the UK will introduce a Future Homes Standard, mandating
the end of fossil-fuel heating systems in all new houses from 2025 [16], drive zero
carbon emission and leveraging the Paris Agreement. The target is to keep the global
110 temperature rise this century below 2 degrees Celsius and even further to limit the
temperature increase for 1.5 degrees Celsius [17]. More energy-efficient systems are
proposed without leaving the aspect of human comfort. There has been a tremendous
increase in the paper published from the 1970s to 2010s [18].

This review paper presents the comparative development timelines between the
115 human thermal physiology approach and the human behaviour approach for thermal
comfort. These are not presented clearly in other papers. This paper also proposes the
work in progress for improving the adaptive approach by using Artificial Intelligence
(AI). The work will use the Artificial Neural Network (ANN) and employs the
combination of the Predicted Mean Vote and Predicted Percentage Dissatisfied (PMV-
120 PPD) method and behavioural aspects in the AI learning process. The aim is producing

a better smart system by coping with the limitation of AI. The approach is becoming the other alternative for the Explainable AI, which is resource consuming.

2. The research progress on thermal comfort

125 Thermal comfort term beginning to gain attention in the early 1920s when it became possible to control the microclimate of the indoor environment directly. In the traditional approach, the use of fireplaces to control the temperature was mandatory. In the second half of the nineteenth century, it was necessary to model the building as an open system and apply the laws of thermodynamics [19]. Various electronic controllers were developed, which leads to the evolution of comfort monitoring. Fanger's comfort model introduced in the 1970s, based on physically based determinism and formulate 130 comfort equation. The quality of air movement and sophisticated models which map both physics and physiology of the human body were also developed to build coherent, global thermal perception. These developments also are driven by energy efficiency [20]. In the twentieth century, the focus goes to humans as the centre point of the design to improve the health and comfort of men and their homes [19], [20]. 135

The equivalent temperature of an environment corresponds to the same temperature there would be in an environment where the temperature is uniform, the air is stationary, and the moisture content corresponds to 100 %. Therefore the human body cannot exchange energy with the environment. If the actual temperature of an environment is 140 22 °C with a relative humidity of 50 % and airspeed of 0.2 m/s, it is equal to the temperature of 19.6 °C with relative humidity 100 % and no airspeed [8].

It is now becoming essential to review the progress of thermal comfort due to the growth of low-cost sensing solutions. The provision of lighting and thermal comfort has been widely increased to existing and future smart buildings to aid productivity, 145 health, and wellbeing. Thermal cameras, for example, has the potential to be used widely in the home comfort system nowadays. It was costly that only the military, firefighters, and surveyors were able to use it due to its price [21-23]. Besides sensors, artificial intelligence also plays a vital role in creating smarter solutions for human

comfort. The system can perform smartly to maintain comfort while still lower down
150 the energy usage.

Figure 2 presents the evolution in the enhancement of the thermal comfort approach. PMV-PPD is the typical method for comfort analysis. It focussed on the thermal physiology. The other method, the adaptive method, is based on human behaviour. The adaptive method can give flexibility and personalisation needed to overcome the
155 problem due to the variability of the people's metabolism, historical and behavioural preferences.

There are three thermal adaptation types [24]:

- Physiological which is related to the body reaction due to the temperature change
- Psychological which is derived from the state of mind of previous experiences
- 160 • Behaviour related adaptation

Figure 2 also highlights the two clusters of research in thermal comfort: thermal physiology and the human behavioural aspect. With this approach, many thermal comfort methods studies can be associated with these two clusters. The ASHRAE standard 55 also acknowledges both approaches. The physiological was acknowledged
165 in ASHRAE 55 (1981), ISO 7730 (1984), and adaptive behavioural aspect in ASHRAE 55 (2004). This simplification is becoming the special attention of this review paper. With this approach, it will be easier for the researchers to classify the positioning of their work.

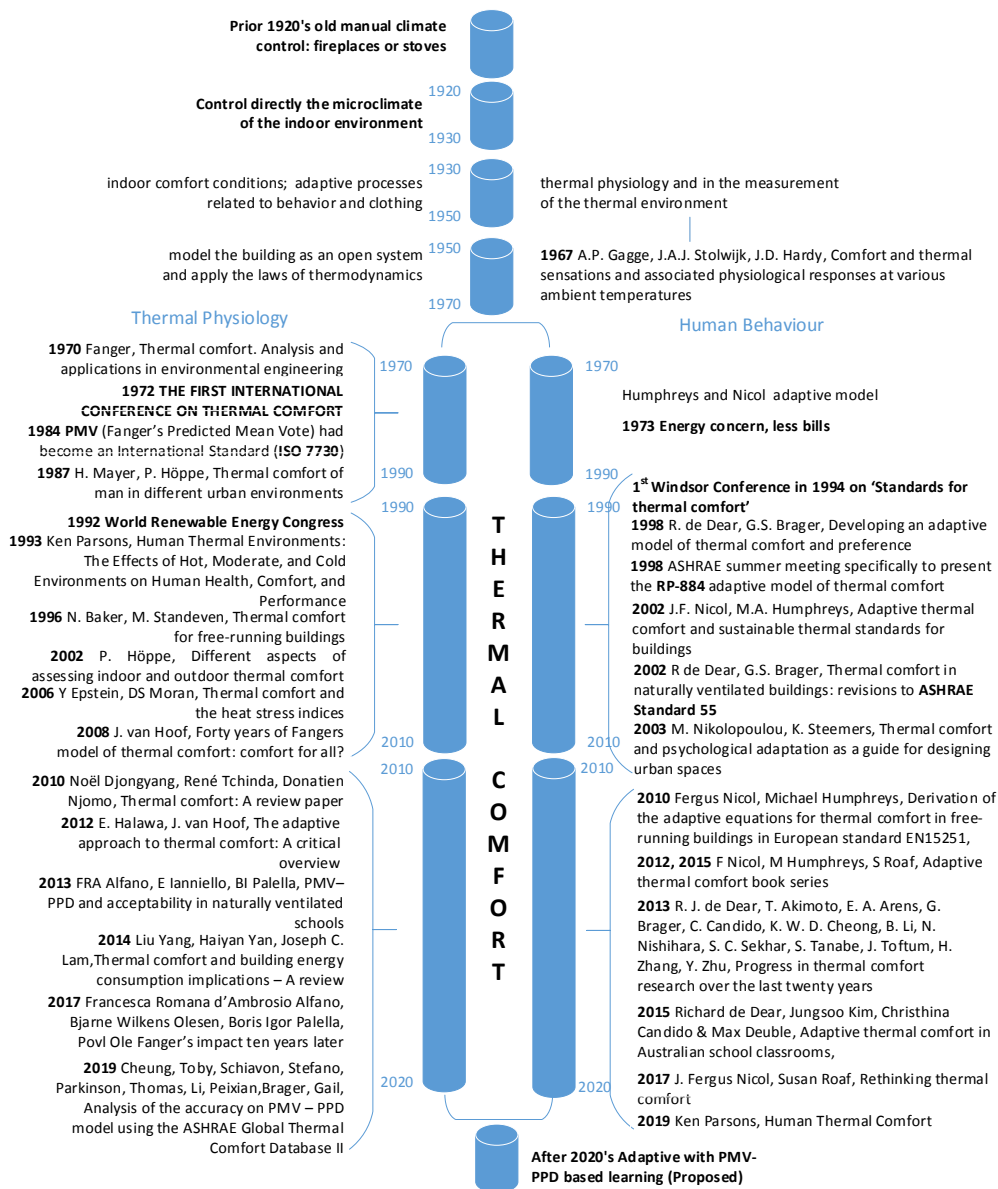


Figure 2. Timeline diagram for the development of the methods in “Thermal Comfort” from 1920 until now.

3. Fanger's Equation, PMV, PPD, and Adaptive Approaches

3.1 Fanger's Equation, PMV, and PPD

175 The development of a thermal model considered to be the milestone is by Fanger in
1970 [25]. This work becomes a standard reference work on the thermal comfort, due
to the experiments and model it has presented. The experiments were conducted in a
controlled room condition. The formulated model makes it possible to calculate the
effect of variables to gain comfort. This model stated that no significant difference
180 generated by sex, age, body build, menstrual cycle, ethnic differences, food, circadian
rhythm, crowding, and colour. This model is known as the Predicted Mean Vote (PMV)
/Predicted Percentage of Dissatisfied (PPD). This model has also become the basis of
the ISO 7730-2005 [3]. The mean radiant temperature and radiation data can be
calculated for human comfort.

185 Fanger's equation shows the relation of the parameters that can have effects on
human comfort. This equation also being acknowledged by ASHRAE, comprises the
PMV-PPD model into the ASHRAE-55 Standard [26]. This standard mentions about
the parameters which can have effects on human comfort. Six parameters are mandatory
for thermal comfort.

190 Two parameters are related to the occupants, which are:

- metabolic rate
- clothing insulation

Four others are related to the surrounding environment, which are:

- air temperature
- 195 • radiant temperature
- airspeed
- humidity

The met unit represents the individual metabolic rate. Writing for example, equal to
1.0 met unit or 60 W/m² or 18 Btu/h.ft². The activities within 0.1 met units can be
200 grouped into one entity. The limitation for this for the occupants, whose time-averaged

metabolic rate is more than 2.0 met. The basic equation for thermal balance can be calculated using the formula presented in equation 1 [25].

$$M - W = C + R + E + (C_{res} + E_{res}) + S \quad (1)$$

Where:

- M : the metabolic rate
- W : mechanical work is done
- C : convective heat loss from the clothed body
- R : radiative heat loss from the clothed body
- E : evaporative heat loss from the clothed body
- C_{res} : convective heat loss from respiration
- E_{res} : evaporative heat loss from respiration
- S : the rate at which heat is stored in the body tissues

There is an empirical table that lists common activities, and their met units [27]. Clothing insulation also presented in the form of a table which consists of the clothing items and its clothing insulation values in clo units. The limit of occupants grouping is when the clothing difference is more than 0.15 clo. However, to use the table values, there are some limitations for the clothes with high impermeable to sweat, value more than 1.5 clo, and if the occupants are in contact with bedding. The seven levels of people's thermal sensation can be seen in Figure 3.

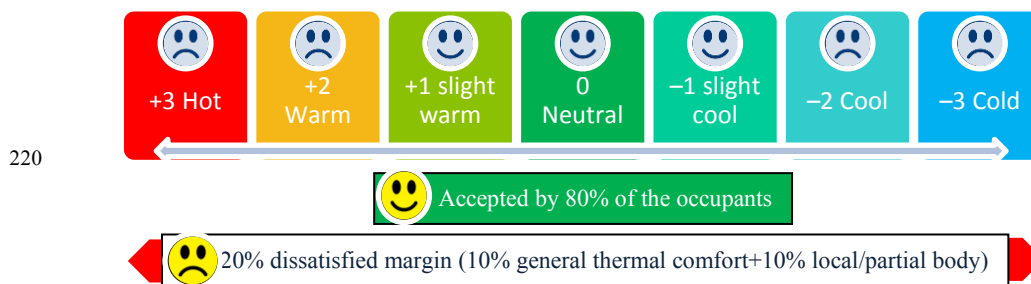


Figure 3. Thermal comfort definition from PMV-PPD acknowledged in ASHRAE standard

In the cold environment, the additional 0.1 clo or 0.1 met will have an impact on saving the energy because it can lower the operating temperature at approximately 0.8°C or 0.5°C. On the contrary, with a decrease of 0.1 clo or 0.1 met corresponds

230 approximately to a 0.8°C or 0.5°C increase in operative temperature [26]. Achieving
comfort can be done by maintaining a humidity ratio below or the same as 0.012. The
lower level is not specified, but if the humidity is very low, it can cause skin drying,
irritation of mucous membranes, dryness of the eyes, and static electricity generation.
The high airspeed can extend the thermal comfort range. This approach can be used if
235 the occupants' condition is slightly warm. When the sunray falls on the occupant, the
mean radiant temperature should be considered with regards to the type of window
gazing, the shade and the body which is exposed to sunray.

Regarding the procedure for measurement, the sample location should be selected
where the occupants are spending their time. The measurement has to include the centre
240 of the room and the 1 m inward from the centre of each of the room's walls. The
measurement height shall be 0.1, 0.6, and 1.1 m above the floor for seated occupants
and 0.1, 1.1, and 1.7 m for the standing occupants.

Since Fanger's trial was done in the chamber, it was unable to capture the difference
between sex, age and special populations like disabilities, elderly people, babies, and
245 children, the sick, pregnant women and people from different cultures. In reality,
sometimes noted that males and females have different thermal comfort responses and
related to the clothes that they wear. Some work is carried out to improve the PMV
regarding these matters [28] or focus on the particular aspects of the comfort factors
like the inversely determined metabolic rate [29]. Some of the works also lead to the
250 adaptive approach, which will be clarified in the next subsection.

3.2 *The Adaptive Approach*

The other method, which is the adaptive method, was introduced by Nicol and
Humphreys [18], [26]. The adaptive model is formulated on the nature of humans who
can adapt. Beside acknowledge the PMV-PPD method, ASHRAE-55 Standard also
255 acknowledges the adaptive method [27]. This model defines the comfort zone, which
also related to thermal experiences changes in clothing and activities, unlike Fanger's
model. In this model, gender, age, physical disabilities will affect thermal comfort.
There are three thermal adaptation types. They are physiological, which is related to the

body reaction due to the temperature change, psychological which is derived from the
260 state of mind of previous experiences and behaviour related adaptation [24]. This model
can become the solution if the PMV cannot easily be obtained due to the properties that
PMV is not individual, not adaptable and no input modification. This model is based
on the work being done by Macpherson, which considers the heat balance of the body.
This balance is affected by the personal parameters representing characteristics of the
265 occupants and ambient parameters. The personal parameters can include the clothing
insulation, metabolic heat rate or activity level. The temperature, air velocity, and
relative humidity can become the ambient parameters considered for comfort [26].
Based on this model, the ambient parameters can be controlled by opening windows or
fans [18]. Besides the fan, which can be used to give, influence to the ambient condition,
270 there is some equipment, for example misting fan, heater (centralised or personal
heating) and air conditioning. The parameter which affects the thermal experiences can
be in the form of gender [30] and age, for example, the elder or disable user group,
which needs a higher temperature setting [31]. In this case, a particular group of people
has to be considered in the design of the human comfort system.

275 Regarding the adaptive behaviours for assessing energy-efficient building indoor
cooling and lighting environment towards buildings sustainability, many techniques are
available. However, these tools have not yet measure energy efficiency index by
involving user satisfaction from adaptive behaviours dependently, which can determine
the actual energy consumption versus the planned energy consumption of the building.
280 Sensor technology development is crucial. A list of adaptive behaviours already
identified from users regarding energy-efficient systems for an indoor environment is
provided below [32]:

- a) Self-adaptation category: drinking cold beverages, less-sweating lifestyle,
285 restraining physical activity level, changing or adjusting clothes from warm to
cool, decreasing the level of body skin moisture.
- b) Adaptation to the environment category: taking a break and moving to a cooler
location, changing position and direction, adjusting furniture/finishing
material, opening or closing doors using a feedback system, opening or closing
operable windows (with/without feedback system), using the portable fan,

290 using had fan, adjusting room's thermostat, adjusting air-condition operative
hours.

All of these are adaptive behaviours or actions to control the environment and combine it with physiological reactions. Time is essential for these behavioural interactions and the periods can be grouped into four distinct period's groups as follows:

- 295 1) Immediate, for example, the use of coat in anticipation of a thermal change
- 2) Within-day, for example, the clothing changes to cope with changing environments within a particular day.
- 3) Day-to-day, for example, the learning process from one day to the next to cope with changing conditions such as the weather.
- 300 4) Longer-term, for example, the clothing adaptation with the seasonal changes and activities learned over a more extended period.

The value will change with climate, place and time dynamically and interactively [33].

The following Figure 4 presents the parameters taking into consideration for the Thermal Physiology methods (PMV-PPD) (left-hand side, horizontal stripes) and the Human Behaviour adaptive methods (right-hand side, vertical stripes area).

305

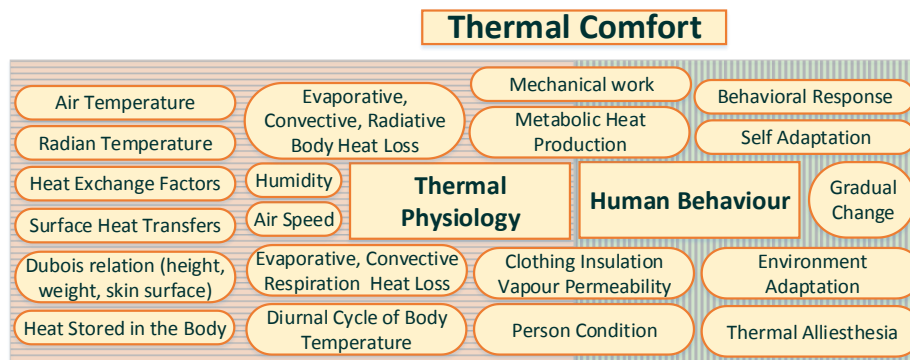


Figure 4. The Thermal Comfort Parameters.

Parameters listed in the left-hand side are considered unimportant by the adaptive approach since people will always behave to make themselves comfortable as far as it is possible [34]. This work also addresses that comfortable temperature are changeable rather than fixed. Discomfort also can be caused by excessive constraints on these choices and adjustment process, rather than merely the surrounding temperature.

310

Comfort can be reached if there are sufficient opportunities for people to adapt. Only with the adaptive approach, all parts of the whole system become part of the comfort solution [34].

Many adaptive thermal comfort models using the black box approach without integrating it to the thermal physiology models. This makes the model incompatible one another [35]. The quantitative characteristics of building occupants thermal adaptation has been studied and found that full thermal adaptation requires a more extended period. It is difficult for people from the warm thermal conditions to adapt to cold indoor conditions in a short period.

People can still be in comfort if the change in skin temperature happens gradually. The skin temperature will be non-uniform. The cold is comforting for overheated bodies but unpleasant for already cold bodies. The hot sensation is pleasant if we are cold, but give discomfort if we are already hot. The sensation effect will depend on time, clothing and the temperature of the surroundings. The adaptive action is to drink much water to maintain thermal balance in hot, dry weather. A sudden change in weather conditions will require people to act accordingly and avoid the danger of heatstroke [33].

Regarding the adaptive behaviour effect on assessing energy-efficient building indoor environment, quantitative indicators or methods and works should support the verbal qualitative analysis where they are determined. Instead of static set points for standard thermal comfort setting value, the study to use adaptive comfort values have been carried out [36]. The model is being validated and fed with temperatures in 2050 and 2080. Another approach for the model is based on the exergy comfort temperature calculation [37]. Both of the models present the acceptability and the possibility to decrease the energy demand for thermal comfort. However, the human adaptability to the temperatures in 2050 and 2080 is not predicted in this work.

Another work also focuses on exergy analysis of human with their environment [38]. The relation between building physics with human biology is referred to as bioclimatology [39]. It will be possible to use the exergetic comfort model for assisting the quantitative analysis of the physiological part of the adaptive comfort model. However, this approach and the PMV model still cannot fully explain the observed sensation votes, especially in the cases of higher outdoor temperature [40]. The following works which implement the model also acknowledge the effect of variations caused by weight,

345 stature, age or gender differences [41]. These individual differences are also
 350 acknowledged to have significant influence by the research conducted temperate
 climate zone [42].

Further conducted study also acknowledged that decreasing ambient temperature
 would increase exergy consumption within the human body. The comfortable air
 temperature will remain the same, and the reference environment can be chosen equal
 to the ambient temperature [43]. The analysis of adaptive comfort and the changes in
 human exergy consumption will have an impact on building energy performance and
 saving whilst considering the comfortable indoor temperature.

Parameters listed in Figure 4 shows that the adaptive approach is a goal-based
 355 method, and the PMV-PPD is prescriptive. The comfort zone for the PMV-PPD and
 potential adaptive comfort zone can be seen in Figure 5.

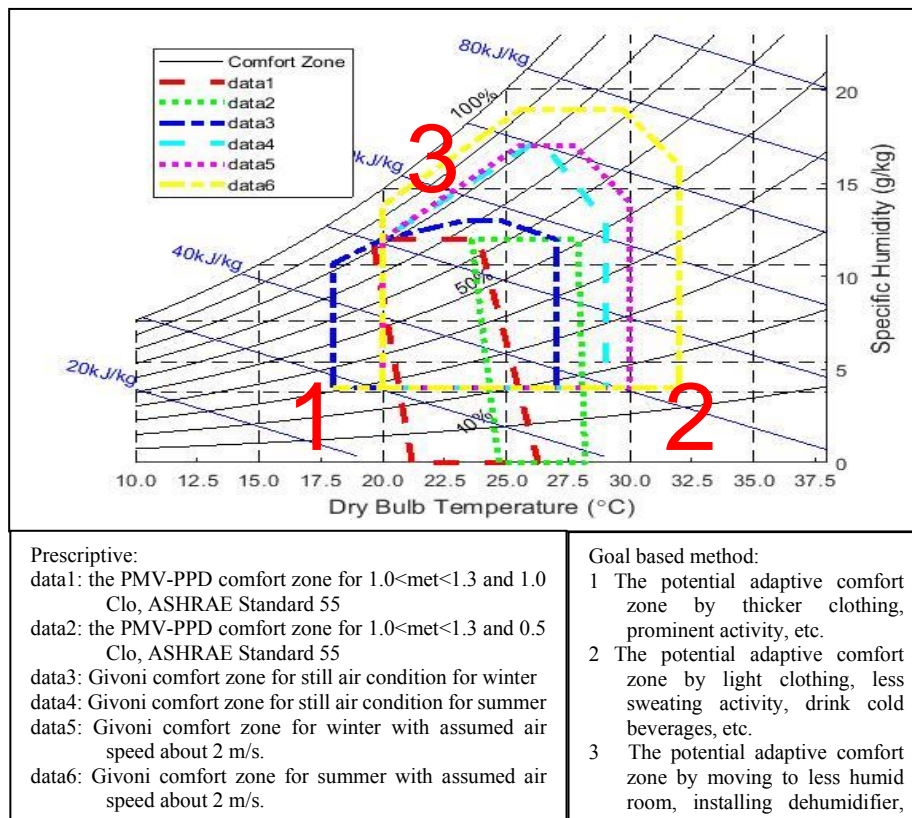


Figure 5. Psychometrics chart showing the comfort zone (PMV-PPD [44]) and Givoni [45]) and potential adaptive comfort zone.

The difference in the methods will give different impacts on comfort temperature values. PMV-PPD approach will give more exact definitions of comfortable temperature [27], while adaptive methods will not give exact boundaries on the comfortable temperature. This potential zone can be elaborated to minimise energy use.

3.3 The Adaptive Approach focused on Disabled, Temporarily Ill and Elderly Groups.

The group of people who are the most vulnerable to climate change and energy poverty is the disabled and elderly people group [46], [47]. Nowadays, the elder people group is reaching 8.5 per cent of people worldwide (617 million) and continues to grow in the number and percentage. It is predicted to reach about 17% of the world's population by 2050, which is about 1.6 billion [48]. The number of disabled people is also significant. Based on the WHO and World Bank report, there are about 15% or more than 1 billion of the world's population lives with some form of disability. To be more specific, 2-4% of them living in significant difficulties in functioning [49].

PMV-PPD method is the comprehensive analytical methods which have limitations if the clothing/insulation exceeds 1.5 clo; having high impermeable to moisture transport; in contact with bedding (sleeping) [27] or having difficulties in dealing with a specific group of people like young, elder, disabled or temporary ill people group.

The disabled, temporarily ill and elderly groups are known to have different standards of thermal comfort [50], [51]. These previous studies also show that:

- the mean body temperature and the mean weighted skin temperature of the elder group are lower than the young
- the elder group preferences will be different from the standard because of the relatively low level of activity
- the elder group is in the risk of cold because of inadequate thermoregulatory responses and blunted perception of temperature changes
- the clothing level has no influence on the elderly's satisfaction (open space) and more on their activity level [52]
- the body temperature is not related to the heart rate, but the activity level [53]

- the correct comfort setting can also be considered to be uncomfortable because of the perception.
- thermal alliesthesia which is an alliesthesia of the thermic perception related to thermoregulation will give complex parameterisations in defining thermal comfort [54], [55], [56]

The illustration in Figure 6 shows the difference between the temperature needs for disabled, temporarily ill, and elderly groups compared to people without the disability group mentioned in the previous research [52], [53].

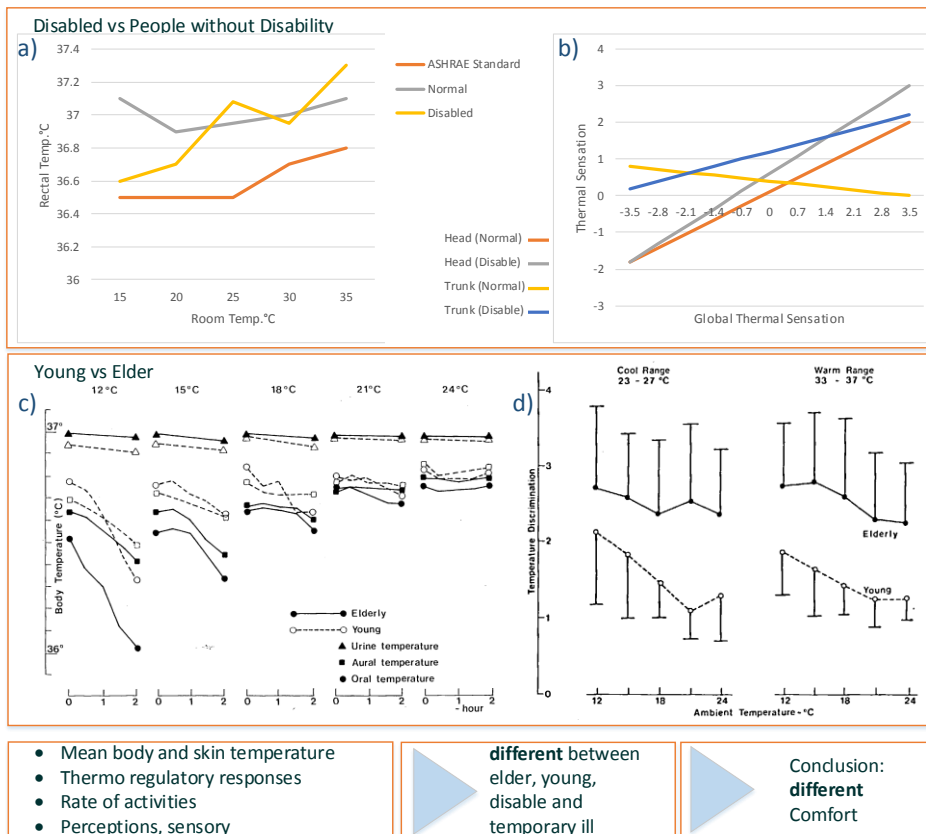


Figure 6. Illustration for showing the difference of comfort temperature from previous research [52], [53].

Figure 6.a) shows that there is a gap between the behaviours of disabled people in comparison to people without disability. Besides this, the figure emphasizes that the gap seems more significant for room temperatures below 23°C and above 30°C, which are

more frequent temperature domains due to climate change (cold and heat waves tend to happen often). This highlights the importance of this study.

415 Figure 6.a) also shows that there is a gap between human temperature and the prediction from ASHRAE. This means that the PMV-PPD comfort zone is far away from this research result. However, the figure 6.a) results may not have enough data to develop a more detailed analysis and generalise the result for all disabled people group.

420 Figure 6.b) shows a further comparison of the thermal sensation between the disabled and people without disability. For the head thermal sensation, the disabled feel that the thermal sensation is higher than people without the disability. The very different result happened in the trunk thermal sensation. Not just the gap, the tendency of the disabled people is flipped compared to the people without disability. Again, figure 6.b) is based on a limited amount of data and cannot be generalised for all disabled people groups.

425 Align with the result in figure 6.a and b; figure 6.c shows that the young people group also has a different average temperature compared to the elder people group. This difference gap is not proportional so that the approach of thermal setting or regulation cannot be set based on the percentage of the correction based on the standard thermal settings. This again emphasises the importance of this study. The thermal setting cannot be generalised and become more personal. This thermal sensation also being validated
430 by the trial shown in Figure 6.d). The temperature discrimination between the young and elder people group is not proportional, and there are significant gaps between the two people groups.

The work which acknowledges similar result from the disabled people group is also
435 being stated in [24], [57] and for elder people [58]. In the case of the elder people, thermoregulatory responses to both cold and hot temperatures were delayed. This is caused by the degradation of vascular regulation ability and thermogenesis due to the ageing process. The seasonal change and seasonal characteristics are also significant in the thermal sensation of the elder people group [31], [59].


440 Defining the correct setting of thermal will be difficult because of individual variability in temperature [60]. ASHRAE releases an Open Database of Global Thermal Comfort Database II (The Comfort Database) to simplify the implementation of the thermal comfort approach. The database maps the cooling strategy, building type,

meteorological context, indoor climatic physical parameter ranges, along with various
445 human factors. The human factors consider characteristics such as sex, age, clothing
insulation, and metabolic rate and the availability of indoor environmental controls, such
as operable windows, doors, thermostats, blinds, heaters, and fans [10]. This database is
not targeted for the disabled, temporarily ill and elderly groups.

This complex and personalised parameterisation will be ideal to be solved with an
450 adaptive approach. Personalised parameter settings can also be supported by intelligent
technology for minimising frequent user manipulation, which can generate
uncomfortable activities and will provide optimum thermal comfort for everyone,
without significantly increasing energy use [61].

4. Adaptive Approach improvement by the use of AI

455 The previous studies emphasise the need to improve the thermal comfort methods,
namely for particular groups of people. Those methods have a focus on the way to
achieve comfort, to maintain health and safety within the energy efficiency corridor.
Besides the variety of human physiology, there is also the human behaviour factor,
which can be different from one to another. The researcher also uses some methods in
460 order to make the system able to cope with such variability and able to adapt to get the
optimal performances. These methods are giving the capability for the system to act
like uninterrupted human control, and being called as having artificial intelligence (AI)
[62]. Supported by AI features, the control system can gain a better solution and can
cope with people's preferences. The setting adjustment can be made based on the setting
465 for the specific use of the system as training data. The simplified system for thermal
comfort can be seen in Figure 7. There are currently two most common methods in AI
for thermal comfort. The first method is Fuzzy Logic or fuzzy in short, and the second
method is an Artificial Neural Network (ANN).

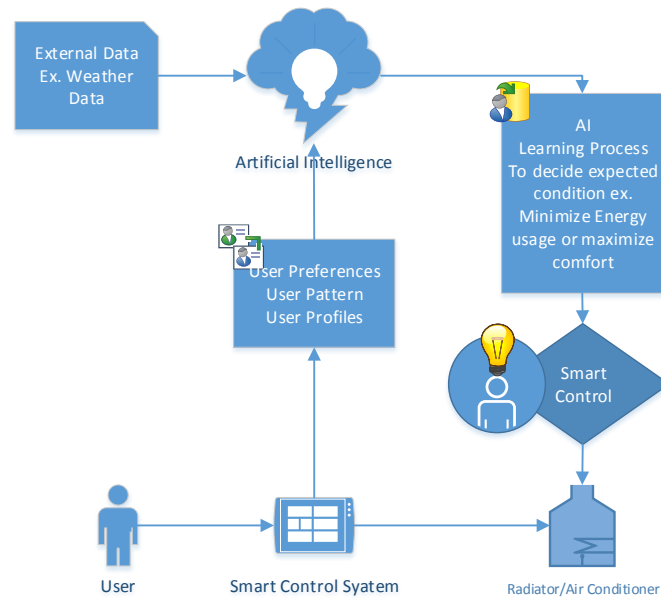

470

Figure 7. Simplified AI System for Thermal Comfort.

4.1 Fuzzy Logic

This method can interpret the verbal human perception or preferences such as ‘warm’ or ‘cool’ which are not easily interpreted by the control system. The fuzzy methods are being used in the control system to give more human comfort while trying to minimise energy use. This approach is used to get a better result compared to the Proportional Integral Differential (PID) control. Some of the previous work results are implemented in the form of simulation, which is MATLAB based [63], [64], [65], [66], [62] and [67]. These methods have also implemented in the form of the prototype for controlling the air conditioning operations [68], [69] or heater [70]. The comfort parameter is based on the PMV model. The fuzzy method is also used in the research of material/fabric [71] and comfort in the automotive industry [72], [73]. This system will also have the drawback if the data are widely varied so that the fuzzy membership function cannot be clearly defined. Some methods like genetic algorithm [74] or ANN are being used to compensate for the drawback of fuzzy methods [75]. This ANN and fuzzy hybrid method are becoming the most popular methods [26].

475

480

485

4.2 Artificial Neural Network

In ANN, deep learning or shallow learning, the intelligence of the system is gained from the human sensory analogy. This method can work as a black box by giving a set of learning processes, especially with supervised or directed learning. The learning
490 process is essential for this method. The same system can perform differently when trained with a different set of training data. This method is preferable by the system developer to build the thermal comfort system where not all of the connections between all of the thermal comfort factors are well known and well defined. The ANN / deep learning research has been widely used and give significant results in thermal comfort.
495 Some of the previous work is implemented in the form of model and simulation [76], [77], [62], [78], [79], [80], and [81]. Some of these models are developed to be implemented in tropical region [82], [83], [84], [85] or to overcome the extreme condition [76], [77]. The result from the system prototype also presented in [86], [87], and [88] which implement the ANN to overcome individual preferences. This method
500 also being used for the research in fabric/materials [89], [90] and also in lighting comfort [91].

The ANN methods being used is a typical feedforward neural network architecture for example backpropagation (BP) [76], [86], [87], [82], [83], [62], [84], [79], [85], [88], and [81]. BP is the most common because of the simplicity of the model. There
505 are other types of ANN methods such as Multilayer Feed Forward [75], Radial Basis Function [77], Nonlinear Autoregressive Model [84], C-Mantec [78] and Deep Neural Network [80]. The ANN has also come in hybrid with another model such as with Fuzzy [65], [26] and with genetic algorithm [82]. ANN approach also has a better performance in thermal comfort applications rather than the Fuzzy approach [62].

510 Although this system is very powerful in processing the unclearly defined relations, it has a negative impact due to the learning process. If the training process is not done with proper data, or the data is not defined correctly with all of the cases available, the system can perform falsely. In the system for recognising male or female, for example, if all data provided for women are always in the kitchen and men are always in the
515 office, the system can interpret wrongly. If the new case appears that the man is inside the kitchen, it can be interpreted as a woman. That is why it can also be said that one


pixel can make the wrong interpretation [92]. The classification can be easily altered by adding relatively small perturbations to the input vector and can become the source of an attack by only altered one pixel. This matter is one aspect that can be associated with producing natural stupidity in AI.

4.3 *Quality assurance for ANN tailored for thermal comfort.*

Thermal comfort is crucial to support the health and safety of all people groups. The young generation and mostly the elderly are susceptible to sickness because of the heat-or cold-related causes [6]. The wrong thermal arrangement can be fatal for some groups of people, especially on the GCC when there can be sudden cold or hot waves. ANN can give the personalisation setting, but the result should be controlled and validated.

The system, which is targeted for precision and fault-tolerant, and wants to use ANN methods now use the novel approach called explainable artificial intelligence (XAI). The process can backtrack the learning process, whether it has the wrong interpretation [93], [94]. This process of tracking will require the use of excessive resources. The devices used in the thermal comfort subsystems will have difficulties to implement this method due to the limited processing power and memory. Strengthening the learning process for the neural network while still maintain the processing power and memory usage will be the challenging part. This is the work in progress for using the combination between the human physiology method and human behaviour methods (Fanger PMV-PPD model along with the human behaviour AI system) to achieve a faster and more reliable solution for thermal comfort. Instead of backtracking the whole learning process. The PMV-PPD model can be used to check the training parameters and processes. If it deviates over certain levels from the standard or the comfort guidelines, the PMV-PPD equation can then be referred for the validation of the learning process, which will involve the user or the user stored parameters. The learning process will then be updated with the most recent data before the controlling result being sends to the controller for thermal correction actions. This will make the outliers can be validated and accommodated, increase security protection, to lead to a more comfortable user, and gain more thrust. This approach has the potential to perform

better compared with the XAI approach. In the future, it will introduce a safer environment and a lower probability of error triggered by the limitations of AI and probably AI hacking. The diagram of the approach is presented in figure 8.

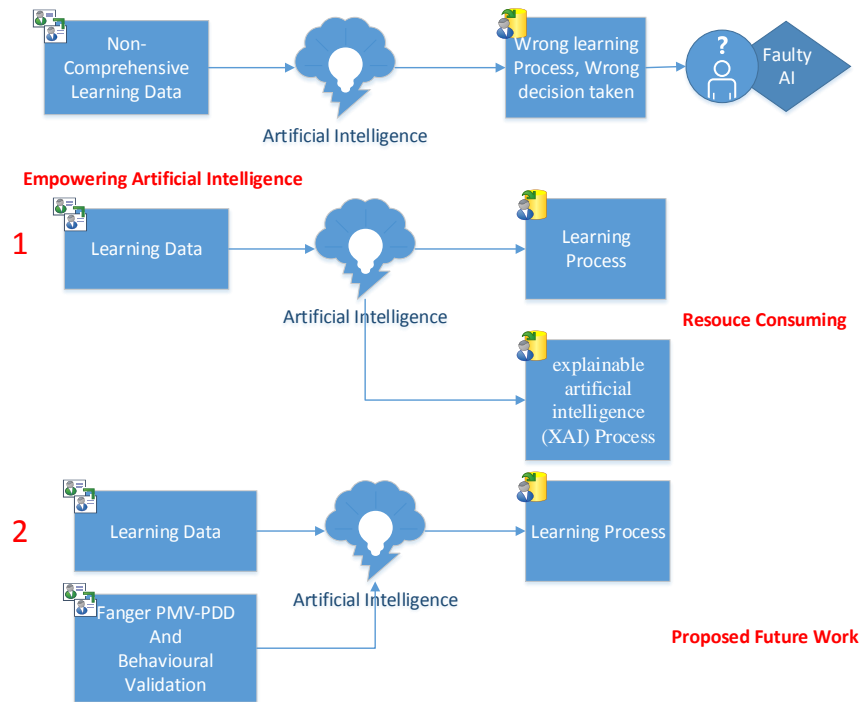

550 Figure 8. Proposed Solutions for Empowering AI using Fanger PMV-PPD and Behavioural Validation.

5. Conclusion and Future Work

555 Many researchers are still conducting research to produce a better solution for thermal comfort. It is now inseparable between the necessities to get better settings achieving health, wellbeing and the ability to minimise energy use. The approach of Fanger's equation (the physiological aspect of the human) will give comprehensive analytical methods but have limitations in accommodating the disabled and elder group of people. The elder people group is predicted to reach about 17%, and the disabled people group is about 15% of the world population.

560 The adaptive approach is used to achieve a solution for those groups of people.
The adaptive approach will give the PMV and PPD flexibility and personalisation
needed to overcome the problem due to the variability of the people's metabolism,
historical and behavioural preferences. The adaptive method acknowledges the
different needs of thermal comfort between different people group, young, elder,
565 disable and temporary ill. The adaptive method has the potential to alter the comfort
zone to minimise energy use. The adaptive approach uses Artificial Intelligence (AI),
where it can introduce the imperfect learning process.

Instead of going further for the Explainable AI to validate the learning process,
which is resource consuming, the PMV–PPD validation approach is proposed for the
570 learning validation. Fanger's equation and the PMV-PPD will give base setting,
calculation and learning verification needed for the adaptive method to perform better.
The thermal comfort system design will become more robust because they use the
proper calculation standard, yet flexible enough to cope with the psychological aspect
of human beings when using the combination of these approaches. Our future work will
575 focus on creating the model, the prototype and test this approach so that the
performance of this system can be compared with the existing system.

References

- [1] N. E. Klepeis *et al.*, "The National Human Activity Pattern Survey (NHAPS):
a resource for assessing exposure to environmental pollutants," *Journal Of
580 Exposure Analysis And Environmental Epidemiology*, Original Article vol. 11,
p. 231, 07/24/online 2001, doi: 10.1038/sj.jea.7500165.
- [2] R. Daniels, *Building Bulletin 101 Guidelines on ventilation, thermal comfort
and indoor air quality in schools*. United Kingdom: the Education and Skills
Funding Agency (ESFA), 2018.
- 585 [3] P. Höppe, "Different aspects of assessing indoor and outdoor thermal
comfort," *Energy and Buildings*, vol. 34, no. 6, pp. 661-665, 2002/07/01/
2002, doi: [https://doi.org/10.1016/S0378-7788\(02\)00017-8](https://doi.org/10.1016/S0378-7788(02)00017-8).
- [4] S. Coccolo, J. Kämpf, J.-L. Scartezzini, and D. Pearlmutter, "Outdoor human
comfort and thermal stress: A comprehensive review on models and
590 standards," *Urban Climate*, vol. 18, pp. 33-57, 2016, doi:
10.1016/j.uclim.2016.08.004.
- [5] D. Lai, W. Liu, T. Gan, K. Liu, and Q. Chen, "A review of mitigating strategies
to improve the thermal environment and thermal comfort in urban outdoor

- spaces," *Sci Total Environ*, vol. 661, pp. 337-353, Apr 15 2019, doi: 10.1016/j.scitotenv.2019.01.062.
- 595 [6] X. Ye, R. Wolff, W. Yu, P. Vaneckova, X. Pan, and S. Tong, "Ambient Temperature and Morbidity: A Review of Epidemiological Evidence," *Environmental Health Perspectives*, vol. 120, no. 1, pp. 19-28, 2012/01/01 2012, doi: 10.1289/ehp.1003198.
- 600 [7] X. Song *et al.*, "Impact of ambient temperature on morbidity and mortality: An overview of reviews," *Science of The Total Environment*, vol. 586, pp. 241-254, 2017/05/15/ 2017, doi: <https://doi.org/10.1016/j.scitotenv.2017.01.212>.
- [8] J. A. Patz, D. Campbell-Lendrum, T. Holloway, and J. A. Foley, "Impact of regional climate change on human health," *Nature*, vol. 438, no. 7066, pp. 310-317, 2005/11/01 2005, doi: 10.1038/nature04188.
- 605 [9] D. Ormandy and V. Ezzratty, "Thermal discomfort and health: protecting the susceptible from excess cold and excess heat in housing," *Advances in Building Energy Research*, vol. 10, no. 1, pp. 84-98, 2016/01/02 2016, doi: 10.1080/17512549.2015.1014845.
- 610 [10] t. H. a. S. Executive. "Thermal comfort." The Health and Safety Executive. <http://www.hse.gov.uk/temperature/thermal/> (accessed 13 November 2019, 2019).
- [11] Eurostat. "Energy consumption in households." https://ec.europa.eu/eurostat/statistics-explained/index.php/Energy_consumption_in_households (accessed 16 April 2019, 2019).
- 615 [12] M. J. Scott, L. E. Wrench, and D. L. Hadley, "Effects of Climate Change on Commercial Building Energy Demand," *Energy Sources*, vol. 16, no. 3, pp. 317-332, 1994/07/01 1994, doi: 10.1080/00908319408909081.
- 620 [13] R. S. J. Tol, "Estimates of the Damage Costs of Climate Change, Part II. Dynamic Estimates," *Environmental and Resource Economics*, journal article vol. 21, no. 2, pp. 135-160, February 01 2002, doi: 10.1023/a:1014539414591.
- [14] D. B. Jason A. Lowe, Philip Bett, Lucy Bricheno, Simon Brown, Daley Calvert, Robin Clark, Karen Eagle, Tamsin Edwards, Giorgia Fosser, Fai Fung, Laila Gohar, Peter Good, Jonathan Gregory, Glen Harris, Tom Howard, Neil Kaye, Elizabeth Kendon, Justin Krijnen, Paul Maisey, Ruth McDonald, Rachel McInnes, Carol McSweeney, John F.B. Mitchell, James Murphy, Matthew Palmer, Chris Roberts, Jon Rostron, David Sexton, Hazel Thornton, Jon Tinker, Simon Tucker, Kuniko Yamazaki, and Stephen Belcher, "the UK Climate Projections 2018 (UKCP18) National Climate Projections," Met Office, United Kingdom, 2018. [Online]. Available: <https://www.metoffice.gov.uk/binaries/content/assets/metofficegovuk/pdf/research/ukcp/ukcp18-overview-slidepack.ff.pdf>
- 625 [15] R. S. J. Tol, "Estimates of the Damage Costs of Climate Change. Part 1: Benchmark Estimates," *Environmental and Resource Economics*, journal article vol. 21, no. 1, pp. 47-73, January 01 2002, doi: 10.1023/a:1014500930521.
- 630 [16] H. Treasury, "Spring Statement 2019: Philip Hammond's speech." [Online]. Available: <https://www.wired->
- 635 640

[gov.net/wg/news.nsf/articles/Spring+Statement+2019+Philip+Hammonds+s
peech+13032019155100?open](https://www.gov.uk/government/news/spring-statement-2019-philip-hammond-speech)

- [17] U. N. F. C. o. C. Change. Process and Meetings -- Paris Agreement [Online] Available: <https://unfccc.int/process-and-meetings/the-paris-agreement/the-paris-agreement>
- 645 [18] R. F. Rupp, N. G. Vásquez, and R. Lamberts, "A review of human thermal comfort in the built environment," *Energy and Buildings*, vol. 105, pp. 178-205, 2015, doi: 10.1016/j.enbuild.2015.07.047.
- [19] K. Fabbri, *Indoor thermal comfort perception: A questionnaire approach focusing on children*. 2015.
- 650 [20] R. J. de Dear *et al.*, "Progress in thermal comfort research over the last twenty years," *Indoor Air*, vol. 23, no. 6, pp. 442-461, 2013, doi: 10.1111/ina.12046.
- [21] A. villo, *Fireground Strategies*. USA: PennWell Books, 2002.
- [22] J. I.-C. Tu, "Technology At Work -- Firefighters Look Into The Future -- New Computers, Camera Can Spot Hidden Dangers," in *Seattle Times* ed, August 18, 1997.
- 655 [23] BBC. "1985: Gas blast kills eight in Putney." http://news.bbc.co.uk/onthisday/hi/dates/stories/january/10/newsid_4045000/4045495.stm (accessed 18 April 2019, 2019).
- 660 [24] G. S. Brager and R. J. de Dear, "Thermal adaptation in the built environment: a literature review," *Energy and Buildings*, vol. 27, no. 1, pp. 83-96, 1998/02/01/ 1998, doi: [https://doi.org/10.1016/S0378-7788\(97\)00053-4](https://doi.org/10.1016/S0378-7788(97)00053-4).
- [25] P. O. Fanger, *Thermal comfort: Analysis and applications in environmental engineering*. Copenhagen Denmark: Danish Technical Press, 1970, p. 244.
- 665 [26] D. Enescu, "A review of thermal comfort models and indicators for indoor environments," *Renewable and Sustainable Energy Reviews*, vol. 79, pp. 1353-1379, 2017, doi: 10.1016/j.rser.2017.05.175.
- [27] ASHRAE, "ANSI/ASHRAE Standard 55 Thermal Environmental Conditions for Human Occupancy," ed, 2017.
- 670 [28] K.C.Parsons, *Human Thermal Environments*, 3rd edition ed. (The effects of hot, moderate, and cold environments on human health, comfort and performance). United Kingdom: Taylor & Francis, 2003.
- [29] S. Zhang, Y. Cheng, M. Olaide Oladokun, Y. Wu, and Z. Lin, "Improving predicted mean vote with inversely determined metabolic rate," *Sustainable Cities and Society*, vol. 53, p. 101870, 2020/02/01/ 2020, doi: <https://doi.org/10.1016/j.scs.2019.101870>.
- 675 [30] W. F. Song, C. J. Zhang, D. D. Lai, F. M. Wang, and K. Kuklane, "Use of a novel smart heating sleeping bag to improve wearers' local thermal comfort in the feet," *Sci Rep*, vol. 6, p. 19326, Jan 13 2016, doi: 10.1038/srep19326.
- 680 [31] F. Salata, I. Golasi, W. Verrusio, E. de Lieto Vollaro, M. Cacciafesta, and A. de Lieto Vollaro, "On the necessities to analyse the thermohygro-metric perception in aged people. A review about indoor thermal comfort, health and energetic aspects and a perspective for future studies," *Sustainable Cities and Society*, vol. 41, pp. 469-480, 2018, doi: 10.1016/j.scs.2018.06.003.
- 685 [32] A. Keyvanfar *et al.*, "User satisfaction adaptive behaviors for assessing energy efficient building indoor cooling and lighting environment," *Renewable and*

- Sustainable Energy Reviews*, vol. 39, pp. 277-295, 2014/11/01/ 2014, doi: <https://doi.org/10.1016/j.rser.2014.07.094>.
- 690 [33] M. H. Fergus Nicol, Susan Roaf, *Adaptive Thermal Comfort: Principles and Practice*. London: Routledge, 2012, p. 208.
- [34] M. H. Fergus Nicol, Susan Roaf, *adaptive thermal comfort foundations and analysis*. London: Routledge, 2015.
- [35] M. Luo, *The Dynamics and Mechanism of Human Thermal Adaptation in Building Environment: A Glimpse to Adaptive Thermal Comfort in Buildings*. Springer Nature, 2019.
- 695 [36] D. Sánchez-García, C. Rubio-Bellido, M. Trisancho, and M. Marrero, "A comparative study on energy demand through the adaptive thermal comfort approach considering climate change in office buildings of Spain," *Building Simulation*, vol. 13, no. 1, pp. 51-63, 2020/02/01 2020, doi: 10.1007/s12273-019-0560-2.
- 700 [37] N. A. Buyak, V. I. Deshko, and I. O. Sukhodub, "Buildings energy use and human thermal comfort according to energy and exergy approach," *Energy and Buildings*, vol. 146, pp. 172-181, 2017/07/01/ 2017, doi: <https://doi.org/10.1016/j.enbuild.2017.04.008>.
- 705 [38] M. Shukuya, "Exergetic approach to the understanding of built environment—state-of-the-art review," *Japan Architectural Review*, vol. 2, no. 2, pp. 143-152, 2019.
- [39] M. Shukuya, *Bio-climatology for built environment*. CRC press, 2019.
- [40] M. Schweiker and M. Shukuya, "Adaptive comfort from the viewpoint of human body exergy consumption," *Building and Environment*, vol. 51, pp. 351-360, 2012/05/01/ 2012, doi: <https://doi.org/10.1016/j.buildenv.2011.11.012>.
- 710 [41] H. Guo, Y. Luo, F. Meggers, and M. Simonetti, "Human body exergy consumption models' evaluation and their sensitivities towards different environmental conditions," *Energy*, vol. 183, pp. 1075-1088, 2019/09/15/ 2019, doi: <https://doi.org/10.1016/j.energy.2019.05.045>.
- 715 [42] C. Turhan and G. Gokcen Akkurt, "The relation between thermal comfort and human-body exergy consumption in a temperate climate zone," *Energy and Buildings*, vol. 205, p. 109548, 2019/12/15/ 2019, doi: <https://doi.org/10.1016/j.enbuild.2019.109548>.
- 720 [43] V. Deshko, N. Buyak, I. Bilous, and V. Voloshchuk, "Reference state and exergy based dynamics analysis of energy performance of the "heat source - human - building envelope" system," *Energy*, vol. 200, p. 117534, 2020/06/01/ 2020, doi: <https://doi.org/10.1016/j.energy.2020.117534>.
- 725 [44] R. American Society of Heating and I. Air Conditioning Engineers, "ANSI/ASHRAE Standard 55-2017," in *Thermal Environmental Conditions for Human Occupancy*, ed: ASHRAE, 2017.
- [45] B. Givoni, "Comfort, climate analysis and building design guidelines," *Energy and Buildings*, vol. 18, no. 1, pp. 11-23, 1992/01/01/ 1992, doi: [https://doi.org/10.1016/0378-7788\(92\)90047-K](https://doi.org/10.1016/0378-7788(92)90047-K).
- 730 [46] G. Wolbring, "A Culture of Neglect: Climate Discourse and Disabled People," 2009, disabled people; people with disabilities; climate; IPCC; neglect vol. 12,

- no. 4, 2009-08-28 2009. [Online]. Available: <http://journal.media-culture.org.au/index.php/mcjournal/article/view/173>.
- 735 [47] T. Radford. "Why The Poor And Elderly Are The Most Vulnerable To A Warming Climate." Climate News Network. <https://innerself.com/content/living/health/environmental/9899-why-the-poor-and-elderly-are-the-most-vulnerable-to-a-warming-climate.html> (accessed.
- 740 [48] D. G. Wan He, and Paul Kowal, "An Aging World: 2015, International Population Reports," U.S. Census Bureau, Washington, DC, 2016. [Online]. Available: <https://www.census.gov/content/dam/Census/library/publications/2016/demo/p95-16-1.pdf>
- 745 [49] W. H. O. W. Bank, "WORLD REPORT ON DISABILITY," World Health Organization, Malta, 2011. [Online]. Available: file:///C:/Users/buekkary/Downloads/9789240685215_eng.pdf
- [50] F. HAGHIGHAT, MEGRI, A.C., DONNINI, G. and GIORGI, G., "Responses of disabled, temporarily ill, and elderly persons to thermal environments.," *ASHRAE Transactions*, vol. 106, p. 329, 2000.
- 750 [51] F. Haghighat, "THERMAL COMFORT IN HOUSING AND THERMAL ENVIRONMENTES."
- [52] E. H. K. Yung, S. Wang, and C.-k. Chau, "Thermal perceptions of the elderly, use patterns and satisfaction with open space," *Landscape and Urban Planning*, vol. 185, pp. 44-60, 2019, doi: 10.1016/j.landurbplan.2019.01.003.
- 755 [53] R. Basu and J. M. Samet, "An exposure assessment study of ambient heat exposure in an elderly population in Baltimore, Maryland," (in eng), *Environmental health perspectives*, vol. 110, no. 12, pp. 1219-1224, 2002, doi: 10.1289/ehp.021101219.
- 760 [54] R. de Dear, "Revisiting an old hypothesis of human thermal perception: alliesthesia," *Building Research & Information*, vol. 39, no. 2, pp. 108-117, 2011, doi: 10.1080/09613218.2011.552269.
- [55] T. Parkinson and R. de Dear, "Thermal pleasure in built environments: physiology of alliesthesia," *Building Research & Information*, vol. 43, no. 3, pp. 288-301, 2014, doi: 10.1080/09613218.2015.989662.
- 765 [56] T. Parkinson, R. de Dear, and C. Candido, "Thermal pleasure in built environments: alliesthesia in different thermoregulatory zones," *Building Research & Information*, vol. 44, no. 1, pp. 20-33, 2015, doi: 10.1080/09613218.2015.1059653.
- 770 [57] K. Parsons, *Human Thermal Comfort*. Boca Raton, USA: CRC Press, 2020
- [58] T. Maeda, T. Kobayashi, K. Tanaka, A. Sato, S.-Y. Kaneko, and M. Tanaka, "Seasonal differences in physiological and psychological responses to hot and cold environments in the elderly and young males," in *Elsevier Ergonomics Book Series*, vol. 3, Y. Tochihara and T. Ohnaka Eds.: Elsevier, 2005, pp. 35-41.
- 775 [59] A. K. Mishra and M. Ramgopal, "Field studies on human thermal comfort — An overview," *Building and Environment*, vol. 64, pp. 94-106, 2013, doi: 10.1016/j.buildenv.2013.02.015.

- 780 [60] K. J. Collins and E. Hoinville, "Temperature requirements in old age," *Building Services Engineering Research and Technology*, vol. 1, no. 4, pp. 165-172, 1980, doi: 10.1177/014362448000100401.
- [61] v. Hoof, J., & Hensen, J. L. M., "Thermal comfort and older adults.," *Gerontechnology*, vol. 4(4), pp. 223-228, 2006, doi: DOI: 10.4017/gt.2006.04.04.006.00.
- 785 [62] J. W. Moon, S. K. Jung, Y. Kim, and S.-H. Han, "Comparative study of artificial intelligence-based building thermal control methods – Application of fuzzy, adaptive neuro-fuzzy inference system, and artificial neural network," *Applied Thermal Engineering*, vol. 31, no. 14-15, pp. 2422-2429, 2011, doi: 10.1016/j.applthermaleng.2011.04.006.
- 790 [63] M. H. a. G. Lachiver, "A fuzzy control system based on the human sensation of thermal comfort," in *1998 IEEE International Conference on Fuzzy Systems Proceedings IEEE World Congress on Computational Intelligence*, USA, 1998, pp. 487-492.
- [64] F. Calvino, M. La Gennusa, M. Morale, G. Rizzo, and G. Scaccianoce, "Comparing different control strategies for indoor thermal comfort aimed at the evaluation of the energy cost of quality of building," *Applied Thermal Engineering*, vol. 30, no. 16, pp. 2386-2395, 2010, doi: 10.1016/j.applthermaleng.2010.06.008.
- 795 [65] M. Nowak and A. Urbaniak, "Utilization of intelligent control algorithms for thermal comfort optimization and energy saving," in *2011 12th International Carpathian Control Conference (ICCC)*, 25-28 May 2011 2011, pp. 270-274, doi: 10.1109/CarpathianCC.2011.5945862.
- [66] M. I. M. Rawi and A. Al-Anbuky, "Development of Intelligent Wireless Sensor Networks for Human Comfort Index Measurement," *Procedia Computer Science*, vol. 5, pp. 232-239, 2011/01/01/ 2011, doi: <https://doi.org/10.1016/j.procs.2011.07.031>.
- 800 [67] R. Zhang, X. Chu, W. Zhang, Y. Liu, and Y. Hou, "Fuzzy control design for thermostatically controlled loads considering consumers' thermal comfort," in *2014 11th International Conference on Fuzzy Systems and Knowledge Discovery (FSKD)*, 19-21 Aug. 2014 2014, pp. 165-170, doi: 10.1109/FSKD.2014.6980826.
- [68] N. L. Yonghong Huang, "Indoor Thermal Comfort Control Research Based on Adaptive Fuzzy Strategy," in *IMACS Multiconference on "Computational Engineering in Systems Applications"(CESA)*, China, 2006, pp. 1969-1972.
- 805 [69] L. Ciabattoni, G. Cimini, F. Ferracuti, and G. Ippoliti, "Humidex based multi room thermal comfort regulation via fuzzy logic," in *2015 International Symposium on Consumer Electronics (ISCE)*, 24-26 June 2015 2015, pp. 1-2, doi: 10.1109/ISCE.2015.7177826.
- [70] B. Walek, J. Žáček, M. Janošek, and R. Farana, "Adaptive fuzzy control of thermal comfort in smart houses," in *Proceedings of the 2014 15th International Carpathian Control Conference (ICCC)*, 28-30 May 2014 2014, pp. 675-678, doi: 10.1109/CarpathianCC.2014.6843690.
- 820 [71] H. Huang, L.-p. Sun, L.-j. Kong, and G.-h. Wang, "Research on Thermal and Moisture Comfort of Fabrics Based on Fuzzy Mathematics," presented at the

- 825 2008 Fifth International Conference on Fuzzy Systems and Knowledge
Discovery, 2008.
- [72] Y. Farzaneh and A. A. Tootoonchi, "Intelligent control of thermal comfort in
automobile," in *2008 IEEE Conference on Cybernetics and Intelligent
Systems*, 21-24 Sept. 2008 2008, pp. 510-514, doi:
830 10.1109/ICCIS.2008.4670809.
- [73] I. Beinarts, "Fuzzy logic control method of HVAC equipment for
optimization of passengers' thermal comfort in public electric transport
vehicles," in *Eurocon 2013*, 1-4 July 2013 2013, pp. 1180-1186, doi:
10.1109/EUROCON.2013.6625130.
- 835 [74] P. H. Shaikh, N. B. M. Nor, P. Nallagownden, and I. Elamvazuthi, "Optimized
intelligent control system for indoor thermal comfort and energy management
of buildings," in *2014 5th International Conference on Intelligent and
Advanced Systems (ICIAS)*, 3-5 June 2014 2014, pp. 1-5, doi:
10.1109/ICIAS.2014.6869454.
- 840 [75] P. Duan and H. Li, "A novel data-based control strategy of dynamic thermal
comfort for inhabited environment," in *2010 8th World Congress on
Intelligent Control and Automation*, 7-9 July 2010 2010, pp. 4865-4869, doi:
10.1109/WCICA.2010.5554901.
- [76] G. Liu, J. Zhou, G. Wang, S. Hu, and R. Liu, "Human Thermal Comfort
Assessment Model under Lower-Pressure Environment Based on BP
845 Network," in *2009 International Conference on Information Engineering and
Computer Science*, 19-20 Dec. 2009 2009, pp. 1-4, doi:
10.1109/ICIECS.2009.5363514.
- [77] Y. Yalong, F. Qiansheng, W. Xiaolong, Z. Zhenya, and Y. Qinyan, "Research
850 on thermal comfort model of hot summer and cold winter zone based on RBF
neural network," in *Proceedings of 2011 International Conference on
Computer Science and Network Technology*, 24-26 Dec. 2011 2011, vol. 3,
pp. 2052-2055, doi: 10.1109/ICCSNT.2011.6182374.
- [78] J. Rodríguez-Alabarce, F. Ortega-Zamorano, J. M. Jerez, K. Ghoreishi, and
855 L. Franco, "Thermal comfort estimation using a neurocomputational model,"
in *2016 IEEE Latin American Conference on Computational Intelligence (LA-
CCI)*, 2-4 Nov. 2016 2016, pp. 1-5, doi: 10.1109/LA-CCI.2016.7885703.
- [79] J. W. Moon and S. K. Jung, "Development of a thermal control algorithm
860 using artificial neural network models for improved thermal comfort and
energy efficiency in accommodation buildings," *Applied Thermal
Engineering*, vol. 103, pp. 1135-1144, 2016, doi:
10.1016/j.applthermaleng.2016.05.002.
- [80] W. Zhang, W. Hu, and Y. Wen, "Thermal Comfort Modeling for Smart
Buildings: A Fine-Grained Deep Learning Approach," *IEEE Internet of
865 Things Journal*, pp. 1-1, 2018, doi: 10.1109/jiot.2018.2871461.
- [81] R. Escandón, F. Ascione, N. Bianco, G. M. Mauro, R. Suárez, and J. J. Sendra,
"Thermal comfort prediction in a building category: Artificial neural network
generation from calibrated models for a social housing stock in southern
870 Europe," *Applied Thermal Engineering*, vol. 150, pp. 492-505, 2019, doi:
10.1016/j.applthermaleng.2019.01.013.

- [82] M. Bingxin, S. Jiong, and W. Yanchao, "Experimental design and the GA-BP prediction of human thermal comfort index," in *2011 Seventh International Conference on Natural Computation*, 26-28 July 2011 2011, vol. 2, pp. 771-775, doi: 10.1109/ICNC.2011.6022146.
- 875 [83] J. Zeng, L. Jin, C. Chen, and Q. Meng, "Thermal comfort of naturally ventilated houses in countryside of subtropical region," in *2011 International Conference on Electric Technology and Civil Engineering (ICETCE)*, 22-24 April 2011 2011, pp. 6371-6375, doi: 10.1109/ICETCE.2011.5776421.
- [84] T. Songuppakarn, W. Wongsuwan, and W. San-um, "Artificial neural networks based prediction for thermal comfort in an academic classroom," in *2014 International Conference and Utility Exhibition on Green Energy for Sustainable Development (ICUE)*, 19-21 March 2014 2014, pp. 1-8.
- 880 [85] T. Chaudhuri, Y. C. Soh, H. Li, and L. Xie, "Machine learning based prediction of thermal comfort in buildings of equatorial Singapore," in *2017 IEEE International Conference on Smart Grid and Smart Cities (ICSGSC)*, 23-26 July 2017 2017, pp. 72-77, doi: 10.1109/ICSGSC.2017.8038552.
- 885 [86] K. Kojima, "Study on sensor fusion for detecting human's thermal comfort considering of individuals," in *2010 10th International Conference on Intelligent Systems Design and Applications*, 29 Nov.-1 Dec. 2010 2010, pp. 1355-1360, doi: 10.1109/ISDA.2010.5687098.
- 890 [87] K. Kojima, "Sensor network for detecting human's thermal comfort considering of individuals," in *2011 International Conference on Electronic Devices, Systems and Applications (ICEDSA)*, 25-27 April 2011 2011, pp. 176-181, doi: 10.1109/ICEDSA.2011.5959089.
- 895 [88] D. Zhai, T. Chaudhuri, and Y. C. Soh, "Energy efficiency improvement with k-means approach to thermal comfort for ACMV systems of smart buildings," in *2017 Asian Conference on Energy, Power and Transportation Electrification (ACEPT)*, 24-26 Oct. 2017 2017, pp. 1-6, doi: 10.1109/ACEPT.2017.8168568.
- 900 [89] K. Baozhu and C. Shan, "Prediction of Fabric Subjective Thermal-wet Comfort Properties Based on BP Neural Network," presented at the 2010 International Conference on Artificial Intelligence and Computational Intelligence, 2010.
- [90] K. Baozhu, "Prediction of Fabric Subjective Thermal-Wet Comfort Properties by Inputting the Objective Parameters," presented at the 2011 International Conference on Network Computing and Information Security, 2011.
- 905 [91] N. K. Kandasamy, G. Karunagaran, C. Spanos, K. J. Tseng, and B.-H. Soong, "Smart lighting system using ANN-IMC for personalized lighting control and daylight harvesting," *Building and Environment*, vol. 139, pp. 170-180, 2018, doi: 10.1016/j.buildenv.2018.05.005.
- 910 [92] J. Su, D. V. Vargas, and K. Sakurai, "One Pixel Attack for Fooling Deep Neural Networks," *IEEE Transactions on Evolutionary Computation*, vol. 23, no. 5, pp. 828-841, 2019, doi: 10.1109/TEVC.2019.2890858.
- [93] W. T. Samek W, Müller KR "Explainable artificial intelligence: understanding, visualizing and interpreting deep learning models.," *ITU J ICT Discov Special Issue 1 Impact Artif Intell (AI) Commun Netw Serv 1(1)*, pp. 39-48, 2018.
- 915

- 920 [94] A. S. Joel Vaughan, Erind Brahim, Jie Chen, and Vijayan N Nair, "Explainable neural networks based on additive index models.," *The RMA Journal*, pp. 40–49, October 2018.