

See discussions, stats, and author profiles for this publication at: <https://www.researchgate.net/publication/283052138>

# Application of multi-objective optimization to a long-term design of Croatian national energy system

Conference Paper · October 2015

CITATIONS

0

READS

81

3 authors:



[Pero Prebeg](#)

University of Zagreb

17 PUBLICATIONS 61 CITATIONS

[SEE PROFILE](#)



[Goran Gasparovic](#)

University of Split

15 PUBLICATIONS 62 CITATIONS

[SEE PROFILE](#)



[Goran Krajacic](#)

University of Zagreb

83 PUBLICATIONS 764 CITATIONS

[SEE PROFILE](#)

Some of the authors of this publication are also working on these related projects:



INTERGEORES [View project](#)



The 12th Conference on Sustainable Development of Energy, Water and Environment Systems – SDEWES2017 [View project](#)

All content following this page was uploaded by [Goran Gasparovic](#) on 21 October 2015.

The user has requested enhancement of the downloaded file.

# Application of multi-objective optimization to a long-term design of Croatian national energy system

Pero Prebeg, Goran Gašparovic<sup>\*</sup>, Goran Krajacic  
Faculty of Mechanical Engineering and Naval Architecture  
University of Zagreb, Zagreb, Croatia  
[pero.prebeg@fsb.hr](mailto:pero.prebeg@fsb.hr), [goran.gasparovic@fsb.hr](mailto:goran.gasparovic@fsb.hr), [goran.krajacic@fsb.hr](mailto:goran.krajacic@fsb.hr)

## ABSTRACT

This paper presents results of an ongoing research effort with the goal of investigating the possibility of improving of the planning of the supply side of energy system with a high share of Renewable Energy Sources (RES). The problem consists in identifying appropriate generating and storage technologies and their sizing for a long-term scenario of twenty years or more. Due to the stochastic nature of RES, it is necessary to integrate expensive storage capacities into an energy system with a high share of RES and to model appropriate energy market. While all energy carriers are considered, only the electricity carrier is modelled in this study, with notion taken for the heating demand. There are provisions for additional energy carriers, which are not used at this moment.

A two-level approach in which multi-objective optimization was used on the global level to design a complex Croatian Energy System (CES), where electric vehicles (EVs) are integrated to serve as battery storage in Vehicle-to-Grid (V2G) mode for a scenario between 2015 and 2050. In addition, case study includes nine aggregated hydro power plants, one for each river basin in Croatia. Also, case study includes solar and wind power plants modelled for six locations in Croatia: Osijek, Zagreb, Rijeka, Šibenik, Split and Dubrovnik. The resulting Pareto front suggests that certain level of conventional energy sources will have to remain in the energy system to take into the account unfavourable weather conditions and to cover heating demand, which also results in significantly lower load factors for those power plants. Also, variants with more RES share have lower total energy system load factor and significantly higher installed capacity.

## KEYWORDS

renewable energy sources, electric vehicles, vehicle to grid, long-term design of energy system, multi-objective optimization

## INTRODUCTION

Energy supply is responsible for 26% of all greenhouse gases (GHG) [1]. In order to reduce the harmful emissions of GHG, European Commission [2] has brought forward a package of climate and energy measures known as 20-20-20, setting three goals for the year 2020; 20% reduction in GHG emissions compared to 1990, 20% share of renewable power generation and 20% improvement in energy use efficiency. Declared as a strategic goal, for energy production from RES certain assumptions are taken regarding the layout of future energy systems. Higher emphasis is placed on improved possibilities of transmission, transport and storage of energy in the energy system and matching of demand and production in two

---

<sup>\*</sup> Corresponding author

dimensions. First dimension is the time component, where a surplus of production in night-time or a shortage in day-time occurs. Similar effects are visible in seasonal and annual differences, such as hydrological differences. The changes require use of energy storage, such as hydro accumulation, various types of chemical batteries, ultra-capacitors, flywheels, compressed air storages, heat or cold storage and conversion to synthetic fuels. Second dimension is the geographical one, in which the location of production does not overlap with the location of demand. Electrical system solution requires the development of a robust transmission network, capable of handling the transfer of more units of energy in time than ever before. An ever increasing number of long-distance power lines are proposed, with nominal voltage above the standard 400 kV, as well as a switch from AC transmission to DC, with voltages of 400 kV up to 1000 kV.

Aside from these dimensions, a question of choice of an energy vector, or energy carrier is asked, which implies transformation of energy between energy vectors with optimal performance. Stated problems require a unified approach to optimization and regulation of a system, and it is assumed that by better defining individual parameters significant savings could be achieved in the process. Integration of RES and the electrification of the transport sector pose further requirements on the system. Transport sector has a 13% share of global GHG emissions, and it is the sector with most possibilities for energy rationalization. Similar demands exist in the building industry, where electrification could be achieved by converting electrical energy into heat energy via heat pumps or electro resistive heaters, in individual or centralised systems. Synthetic fuels are one of the solutions for long-range transport needs in shipping and airline industries.

### **State of the art**

Previous research in this area was oriented towards development of software models to predict demand, production management and decision support systems. A set of over 40 models was analysed by Connolly [3]. EnergyPLAN model was applied to a large number of studies for increasing RES production [4], [5], [6]. Those insights led to the development of the H2RES model, which through iterations became one of the models to enable precise modelling of energy systems by means of modelling individual components of the energy system [7]. The work consisted of modelling of primarily isolated and island systems [8]–[11]. Basic difference of H2RES and other related models is in the ability to model individual power plants. Most of the existing models consider all installations of a single type of technology in an aggregated form, while H2RES offers optimization of an individual component of the power system. Accordingly, H2RES demands more computer resources, and for those reasons the research continued towards the optimization of the super-structure, firstly by applying domain knowledge through RenewIslands methodology [12]–[14] in combination with the optimization software TOP Energy [15]. A general overview of existing methodologies was described by Manfren [16]. Another issue addressed through H2RES is the ability to model differently each year of the scenario. These aspects depend on the fact that the optimization determines what resources to install and when. Specific goals can be set to enable entry into service or decommissioning of components in a given year, and demand is automatically changed for each year regarding user inputs. Most advanced model of that kind was developed and tested by Zhang [17]. The aim of H2RES model is to integrate multi-year calculation with advanced optimization methods to produce the most accurate model for long-term energy planning of energy systems of all sizes.

Other research showed it was possible to scale the dimensions of the system for even larger systems, such as national energy systems, with a higher number of power plants and optimize them in terms of installed capacity and management. Results by Bussar [18] assumes an

installation size for a 100% sustainable European energy system of 2500 GW of RES, and an energy storage capacity of 240 TWh. Current capacities are nowhere near the scale mentioned in the work, and further analysis is required.

Of particular interest is the energy storage component of the energy system. As an arbitrage mechanism, the optimization focuses on the higher levels of RES integration to supplement the work of storages. Critical aspect of this component is determining the appropriate costs, expressed in terms of Levelised Cost of Energy (LCoE), as described by Pawel [19]. For electrical grids with low capacities of transmission, it is beneficial to complement it with a storage technology to mitigate variations in the load and production, specifically in high-RES and microgrid levels, stated in the work of Etxeberria [20]. A growing market for energy storage is in the area of EVs, with their benefits in smart grid environment determined by Stadler [21], and shortfalls when coordinated charging and discharging for Vehicle-to-Grid (V2G) operation is not properly implemented [22]. Comparison of two national energy systems with significant classical storage technologies and scenarios with and without EVs V2G implemented were conducted by Kempton [23]. The main issue of this approach lies in the aggregated battery model which does not take into account the variability of storage capacity created by non-stationary battery application. Secondary problem is that of EV driving cycles, for which there is still no good substitute apart from poll-based modelling and traffic flow estimates. These can be mitigated by properly applying long-term forecasting of demand in the transport sector [24], as modelled by Puksec. The paper was used as a basis for input data into H2RES for the national case study. Latest research from Connolly [25] shows the techno-economical analysis of converting Ireland to 100% RES in the near future. While there are some similarities, Croatia's system is less in need of an overall heating sector overhaul due to climate conditions, however it is comparable in the areas of grid regulation. A more correct comparison to the view taken by the authors is in the work Mathiesen [26], especially with the proposal on smart energy systems in the electricity sector and management of energy storages.

The optimization part of the model was based on the classification of optimization problems and preferred solutions in the work of Biegler [27] and problems in the global optimization and mixed-integer calculation for large-scale optimization [28]. The presented case was initially oriented towards microgrid optimization [29], due to system complexity, with references to work of Obara and Ippolito [30], [31]. Sinha provided a general overview of hybrid energy systems [32]. The work of Perera [33] describes multi-objective and multi-criterial aspects of hybrid system optimization. Initial methodology of the optimization was given in the work of Prebeg [34], [35], while the optimisation criteria were given by Østergaard [36]. H2RES model is in that aspect more similar to the Energy Hub approach of Schulze [37], relying on mathematical modelling and setting aside implementation of evolutionary algorithms used in the previously mentioned super-structure model, as implemented by Voll [38]. Super-structure still has the advantage of being automated in terms of topography [39], where H2RES requires more detailed inputs. On the other hand, the model is not constrained by practical aspects of the need to be converted into a GAMS model, and all solvers are kept within the framework of H2RES.

## **LONG-TERM ENERGY SYSTEM DESIGN METHODOLOGY**

The long-term energy system design is intended for the period from 2015 to 2050. Formulation of the total optimization problem is similar as in Dubrovnik regional study [29]:

$$\begin{aligned}
& \min NPV \\
& \min \overline{NPV} \quad (P_{N0i}, \Delta P_i, r_{i,t}) \\
& \max RESSh \\
& \quad \quad \quad s. t. \\
& \sum_{i=1}^{N_p} e_{i,t}(P_{N0i}, \Delta P_i, r_{i,t}) \geq D_t \\
& \quad R_{wHESh}_{2020} \geq 39\% \\
& \quad t = 1, 2, \dots, 24 \cdot 365 \cdot 36 \\
& \quad i = 1, 2, \dots, N_p
\end{aligned} \tag{1}$$

where:

$P_{N0i}$	Nominal power of power plant $i$ (in starting year $y_{0i}$ ) (in MW)
$\Delta P_i$	Yearly increase of nominal power of power plant $i$ (in MW)
$r_{i,t}$	Regulation of power plant $i$ in a hour $t$
$NPV$	Net present value of designed energy system (in EUR/MWh)
$\overline{NPV}$	Net present value normalized by the total energy produced to cover demand (in EUR/MWh)
$RESSh$	Ratio of energy produced by the RES in designed energy system (in %)
$R_{wHESh}_{2020}$	Ratio of energy produced by the RES (with included hydro) in year 2020

The RES share with and without hydro energy is calculated separately since there is an ongoing debate whether to define hydro power plants as RES or not. In case they are, there is an additional need to define which types of hydro power are considered RES. Since achieving of the EU goal of 39% production of electrical energy is not feasible for CES without hydro power, those power plants are included in constraint given in (1). The nominal power of power plant  $i$  in year  $y$  ( $P_{Ni,y}$ ) is determined by the simple model:

$$P_{Ni,y} = \begin{cases} P_{N0i} & |y = y_{0i} \\ P_{Ni,y-1}, & |y \% u_i \neq 0 \\ P_{Ni,y-1} + u_i \Delta P_i, & |y \% u_i = 0 \\ 0 & |y \geq y_{Di} \end{cases} \tag{2}$$

where:

$P_{Ni,y}$	Nominal power of power plant $i$ in year $y$ (MW)
$P_{N0i}$	Nominal power of power plant $i$ in starting year (in MW)
$y_{0i}$	Starting year in which power plant start energy production
$y_{Di}$	Power plant $i$ decommission year
$\Delta P_i$	Yearly increase of nominal power of power plant $i$ (MW)
$u_i$	Update interval of power plant $i$ (years)
%	Modulus operator

This model enables start-up and decommission of power plant inside of the energy system design period. All parameters of this model could be treated as variable, however in presented case study only  $P_{N0i}$  and  $\Delta P_i$  are used as design variables.

As described in [29], practical solution for an energy system design is usually obtained using the hour-based merit-order approach (designated as Problem solution 1 in [29]), however, the other presented approach, (designated as Problem solution 2 in [29]), clearly outperforms the first approach for energy systems with high RES share and available storage capacity from EV. The global problem of the Problem solution 2 is the same as in Problem solution 1. On the local level, the problems are divided in 24-hour local single-objective (minimization of operating costs) optimization problems in which regulation variables of non-RES power plants and EV storage secures availability of electricity to satisfy the demand side of the

energy system. Choice of a 24-hour period for the extent of each of optimization problems is governed by the behaviour of the EV drivers, and is mostly determined by their day-based obligations. Electrical energy demand forecast and meteorological forecast are very accurate with today's approximation/prediction models.

The disadvantage of the Problem solution 2 is the computational complexity, which have been reduced by the practically applicable sequence in the regional case study (see Figure 6 in [29]). However, even that procedure was too time-consuming for application in the national case study.

The approach presents an additional modification, given as Problem solution 3 in (3) and (4) that reduces number of local optimizations that handles storages. Instead of finding regulation variables that handles storage charging for each day,  $s_{lc,j}$  variables at global level determines days with level of load for which storage needs to be fully charged for the full discharge during the days' peak-load. In that way the storage charging has been eliminated from ~ 70-90 % level 2 problems.

For the realistic optimization of the national case study it was necessary to include the realistic optimization problem formulation that includes the electrical energy market. Problem solution 3 given in (3) and (4), replaces constraints that have secure that total produced electricity satisfies total energy consumption in each hour by the penalization of energy insufficiency. The penalization is added to Level 1 objective function in a way that energy insufficiency in hour  $t$  is multiplied by the price of electricity available at market at the same hour.

At global level, calculation of NPV now includes cost of the purchased energy while dependence on the electricity from market is regulated by the constraints which specify that imported energy in each year of scenario has to be less than 4% of produced electrical energy.

### Problem solution 3

Level 0 (Global problem)

$$\begin{aligned}
 & \min NPV \\
 & \min \overline{NPV} \quad (P_{N0i}, \Delta P_i, s_{lc,j}, {}^1e_{i,t}, {}^1Mc_t) \\
 & \max RESH \\
 & E_{im,y} = \frac{\sum_{t=1}^{1,2,..,24 \cdot 365} (D_t - \sum_i^{N_p} {}^1e_{i,t})}{\sum_{t=1}^{1,2,..,24 \cdot 365} (\sum_i^{N_p} {}^1e_{i,t})} \leq 4\% \\
 & R_{wHESsh_{2020}} \geq 39\% \\
 & t = 1, 2, \dots, 24 \cdot 365; \\
 & i = 1, 2, \dots, N_p \\
 & j = 1, 2, \dots, N_s \\
 & y = 1, 2, \dots, 36
 \end{aligned} \tag{3}$$

Level 1 (Local problems,  $T=24h$ )

$$\begin{aligned}
 & \min \sum_{i,t}^{N_p, 24} [f_{i,t} ({}^0P_{N0i}, {}^0\Delta P_i, {}^0s_{lc,j}, r_{i,t}) + Mc_t] \\
 & \quad \text{s. t.} \\
 & Mc_t = [D_t - \sum_i^{N_p} e_{i,t} ({}^0P_{N0i}, {}^0\Delta P_i, {}^0s_{lc,j}, r_{i,t})] mc_t \\
 & \quad t = 1, 2, \dots, 24; i = 1, 2, \dots, N_p
 \end{aligned} \tag{4}$$

where:

- $s_{lc,j}$  Storage load centile (1-100) identifies days in which storage  $j$  will be forced to charge in order to enable maximum daily discharge
- $mc_t$  unit electricity price on electric energy market at hour  $t$
- $Mc_t$  Price of the energy bought on the market to cover insufficient energy production in hour  $t$

$f_{i,t}$  Total variable expenses (operating maintenance and fuel) of energy production for power plant  $i$  in a hour  $t$

$r_{i,t}$  regulation of power plant  $i$  in a hour  $t$

Note: left superscript denotes parameters determined at another problem level, e.g.  ${}^0P_{Ni}$  in (4) means that  $P_{Ni}$  is determined at level 0 (global level). That means that regulation variables  $r_{i,t}$  are the only design variables present on local level optimization problems.

## LONG-TERM DESIGN OF CES

### Overview of current state of CES

As of year 2015 the CES's installed capacity consists of primarily large hydro power plants (HPP – 48.29% capacity, size over 1 MW) and thermal power plants (TPP – 37.70%). The rest of the balance is covered by 50% co-shared nuclear power plant (NPP – 7.84%) Krško, situated in Slovenia, and renewable energy systems (RES – 6.17%). Under RES, small hydro power (sHPP) (under EU regulation <10 MW, for the case and national legislature <1 MW), wind power plants (WPP), solar power plants (SPP), geothermal power plants and biomass power plants are included. All data in this chapter is acquired from the 2013 yearbook of Croatian utility provider HEP [40], and the website of HEP [41], unless otherwise noted.

In terms of capacity, HPP has 2143 MW of installed power, TPP 1673 MW, with additional 1428 MWt for district heating, hot water and industrial purposes on three locations in the country. Sole NPP, Krško has a full capacity of 696 MW, with 348 MW available to Croatia, while RES installations are currently at 274 MW, as presented in Figure 1.

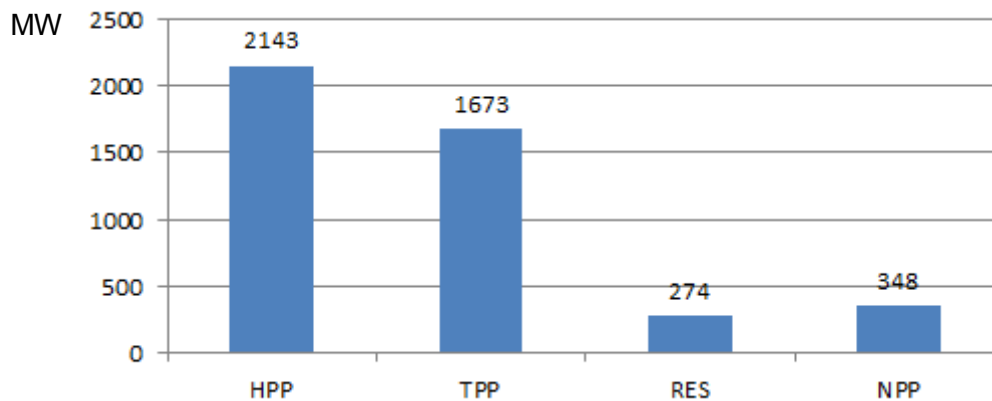


Figure 1. Installed capacity of power generators in CES

In terms of numbers of installations, HPP is represented by several major Croatian rivers (Drava, Krka, Cetina, and interconnected rivers of Dobra/Mrežnica/Kupa, Lokvarka/Ličanka, Lika/Gacka) with several minor rivers (Rječina, Zrmanja) and one river in the neighbouring Bosnia and Hercegovina (Trebišnjica). Several other rivers, such as Sava, offer potential for further development of around 150 MW installed capacity. Current installed capacity per river basin is shown in Figure 2.

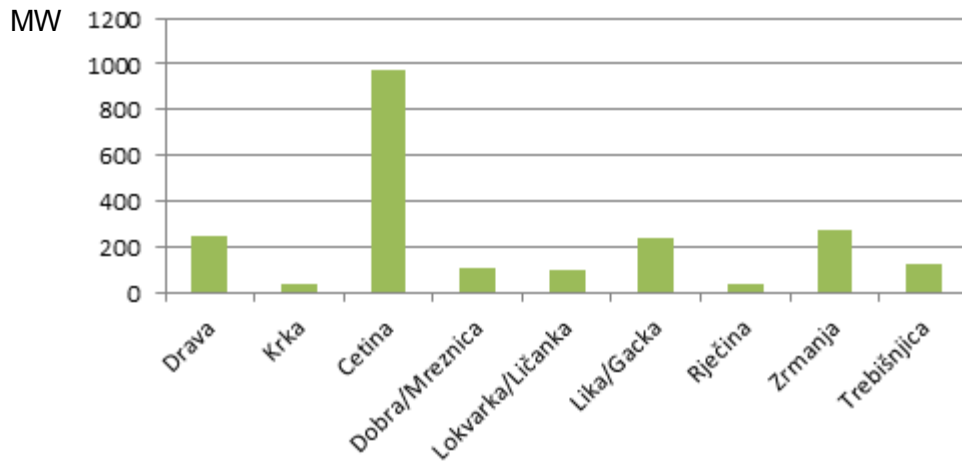


Figure 2. Installed capacity per river basin

Regarding TPP, these can generally be divided into three categories. Classic coal-fired TPP for base-load power, classic open-cycle gas cycle TPP which are used as peak-load plants, and combined-cycle gas TPP which are used for supplying district heating, hot water and industrial use of steam or hot water. Combined-cycle TPPs are located close to the major areas of urbanisation in the continental part of Croatia. Most of the boilers are fitted to use either natural gas or light fuel oil, although fuel oil is only used in extreme conditions. The cities with district heating grid connected to large TPP are Zagreb, Osijek and Sisak. Other smaller cities use district heating on a local-level, such as Velika Gorica, Zaprešić, Slavonski Brod and Karlovac. The TPP capacities are displayed in Figure 3.

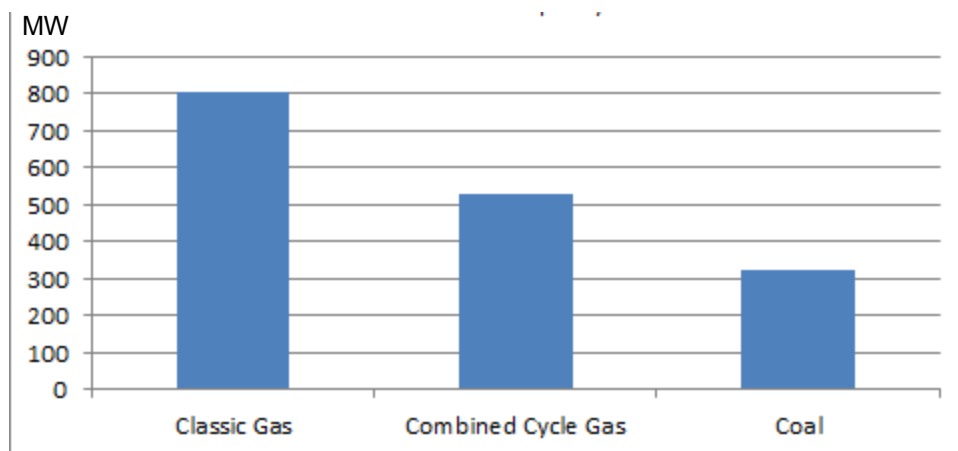


Figure 3. Installed capacity of TPP generators

RES in CES is heavily oriented towards wind power, with the Feed-in-Tariffs (FiT) for wind solar, biomass and geothermal installations, and the current quota of 400 MW of installations for wind has been allocated, with 258.45 MW in operation at the moment (May 2015). In second place solar PV power is represented with 12.66 MW. The major obstacle in the previous years was very limited FiT for solar of only 1 to 2 MW annually. The quota has been raised to a total of 54 MW until 2020. Other RES contributors are biomass and biogas plants and small HPP. The overview of current and planned installations [42] is given in Figure 4.



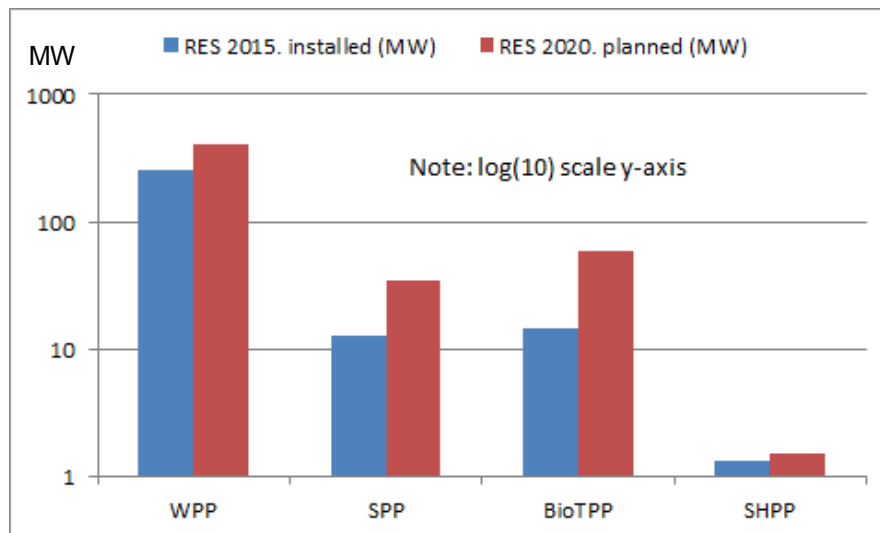


Figure 4. RES capacity in 2015 and 2020 (planned)

### Demand of CES in the referent year and future projections of demand

Two types of energy consumption demands are investigated for CES. Primary concern is given to the electrical consumption, which was on the order of 17.59 TWh in 2011 [43]. As a referent, year 2011 was taken into account. The average yearly increase was taken from NeD model and established at 0.05%, with an overall increase of 19.68% in 2050 in regards to demand from 2011, or 17.68% with the estimated demand of 17.89 TWh in starting year 2015. Yearly average increase ranges from 0.0048% to 0.081%. The load curve is presented in Figure 5, while the basic statistics for the data from figure are listed in Table 1.

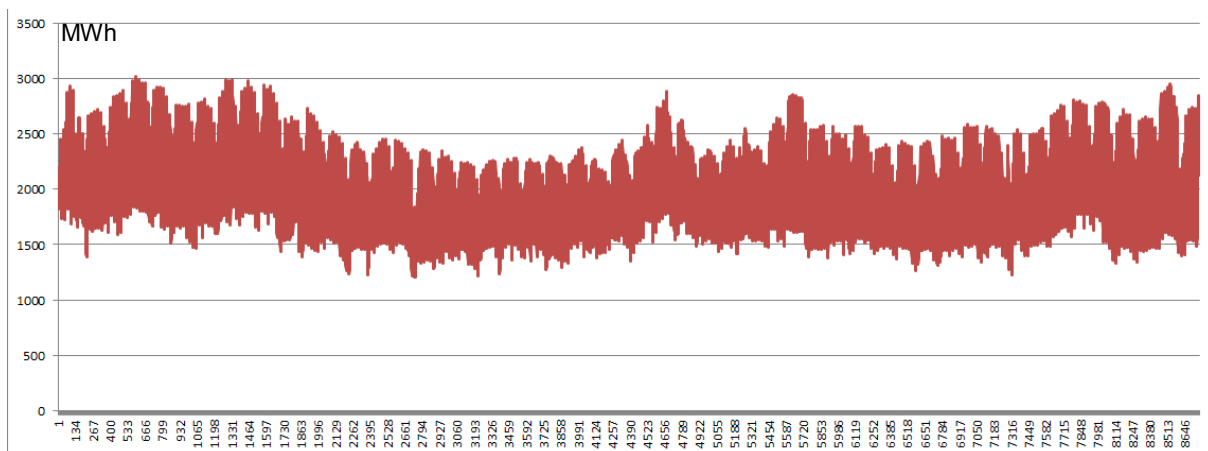


Figure 5. Anticipated electrical energy consumption for CES in 2015 (scenario starting year)

Table 1. Demand statistics for referent year 2011 and scenario starting year 2015

	<i>2011</i>	<i>2015</i>
Maximum (MWh)	2970	3021
Minimum (MWh)	1185	1205
Average (MWh)	2008	2042
Sum (TWh)	17.59	17.89

Secondary demand is the heating demand. This demand consists mainly for supplying the heating needs of urban centres with combined-cycle TPP (Zagreb, Osijek, and Sisak). The Heating Degree Days (HDD) curve is given in Figure 6.

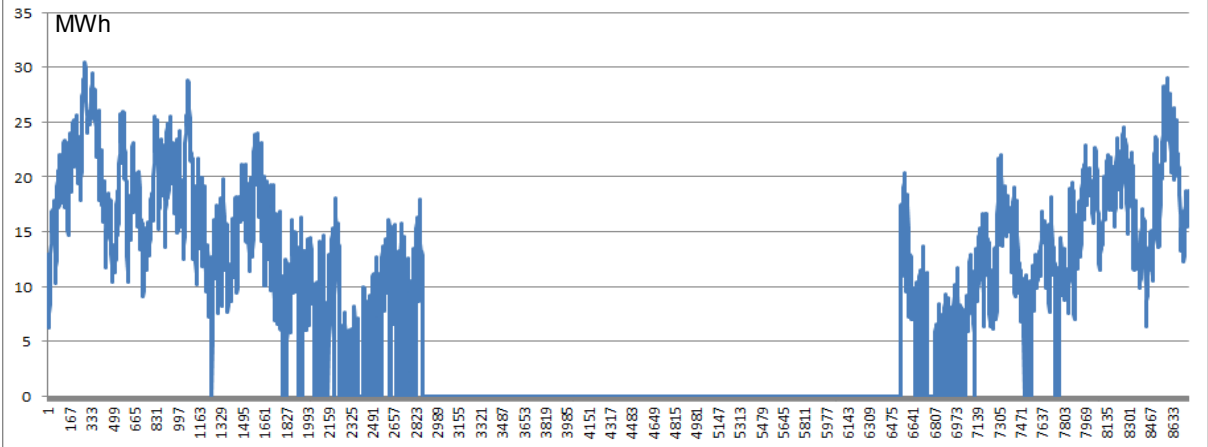


Figure 6. Anticipated heat consumption for CES in 2015 (scenario starting year)

As the national case study incorporates a time horizon until 2050, a degree of dynamics must be included to account for change in population, increased demand, and variance in the inflation. The long-term predictions are based on the study given in [24] and [44]. The estimated consumptions for the period 2015-2050 are given in Figure 7 for electricity demand and Figure 8 for heating demand. It is important to mention that given electricity consumption is without electricity consumption of EV. Charging and discharging of EVs is defined in EV model below.

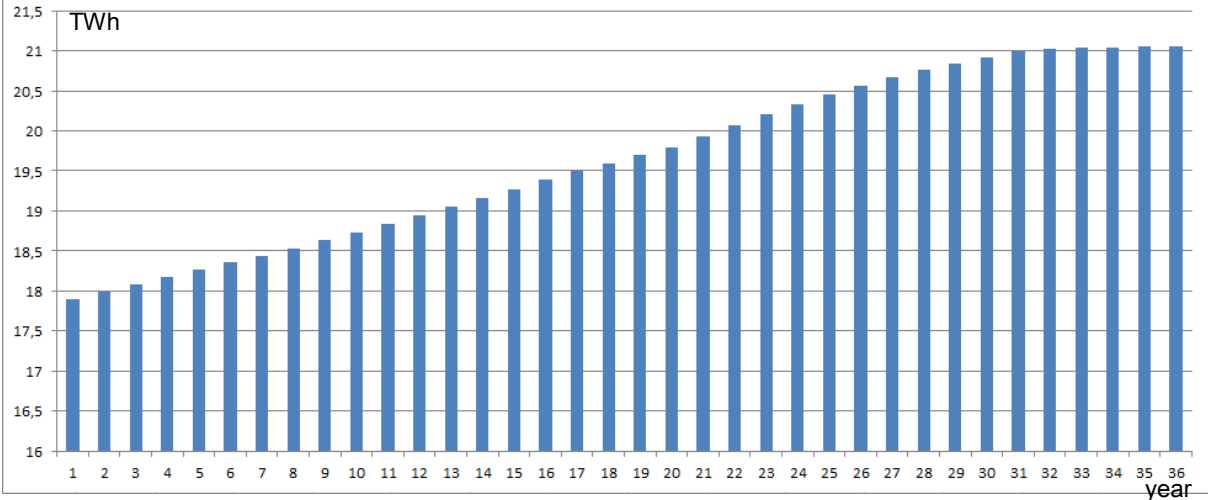


Figure 7. Estimated electrical energy consumption in TWh up to 2050 (36<sup>th</sup> year of scenario)

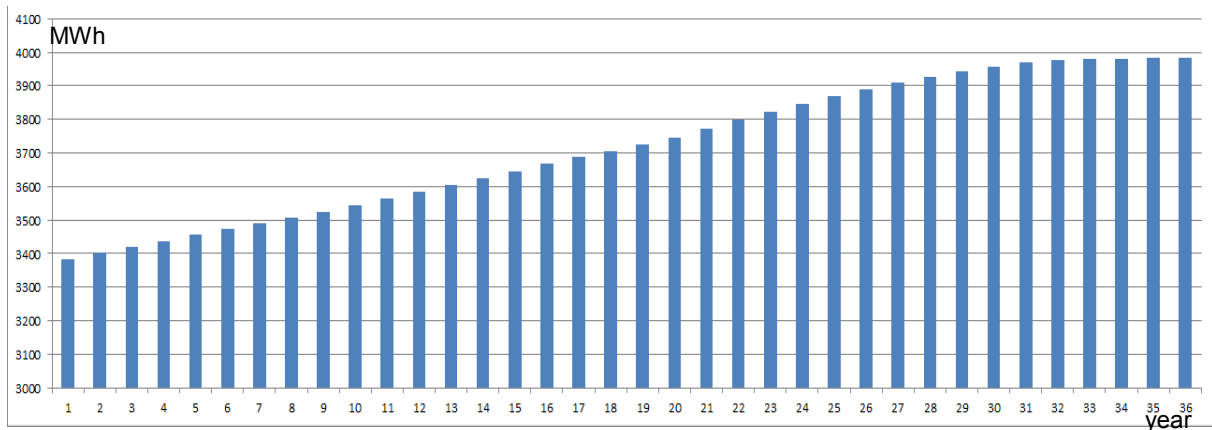


Figure 8. Estimated heating demand for CES up to year 2050 (36<sup>th</sup> year of scenario)

### Hydropower modelling in H2RES

The description of the used power plant models in H2RES are given in references [7], [9], [10] and [29]. As a part of research presented in this paper, hydro power plant model has been developed since HPP produces dominant part of CES electrical energy.

Typical HPP types are run-of-river, accumulation and reversible (pumped hydro) HPP. Each is represented in CES, with the following setup in Table 2. The representation of type refers to P – run-of-river, A – accumulation, R – reversible or pumped hydro type installation.

As it is noticeable, the largest portion of HPP fleet is of the accumulation type, and requires good understanding of HPP abilities to compensate for the daily demand diagram with the accumulation that is available to each HPP. As most of the HPP are situated on the same river or river basin, these operations are interconnected. The list of accumulation bodies of water along with their groupings according to the river basins is given in

Run-of-river HPP in CES are typical installations using the available flow of the river and in some cases utilise a small basin to divert the water needed for operation.

Small HPP are a subject of constant investigation in CES. There is limited investment with only 2.47 MW of installed capacity, some more than 100 years old. The main obstacle remains in the area of legislature, where it is very difficult to obtain a building permit. Most investments at this moment are being developed on existing dams using biological minimum water flow to add further generator sets with small installed power (typically <2 MW). For the purposes of the national case, all sHPP are regarded as run-of-river installations, associated with the basin they are installed at.

Table 3. For Lake Bileća on Trebišnjica River, the actual useful accumulation capacity is 1082 million m<sup>3</sup>, however, the hydrology data was not available, and it was modelled only with the compensation basin at disposal.

Generally, accumulations and their adjoining HPP can be divided into daily, weekly, monthly and seasonal accumulations. The type is determined by the amount of time it is possible to operate an HPP in nominal power. This factor is constrained by the capacity of the lake behind the HPP, and the amount of flow in the river, determined by the hydrology of the system in question.

Reversible or pumped HPP installations in CES are limited to one large installation (RHE Velebit) that was planned as a part of the nuclear power plant installation which was never realised. Other installations are smaller units in the order of <10 MW serving various river basins and artificial lakes in order to balance the inflow and outflow of the temporary accumulation. One major pumped HPP installation is RHE Velebit, situated close to Zadar; with 276/240 MW installed turbine/pump power. The round-trip efficiency of that installation is on average 76.6%, with the down flow in turbine mode of 60 m<sup>3</sup>/s, while the pump mode up flow of up to 40 m<sup>3</sup>/s.

Table 2. Existing HPP production historical data and load factors

<i>Type</i>	<i>Name</i>	<i>Nominal Power (MW)</i>	<i>Average production 2009-2013 (GWh)</i>	<i>Average 5-year Load Factor</i>
P	HE Varaždin	94.58	486.66	58.74
P	HE Čakovec	77.44	391.20	57.67
P	HE Dubrava	77.78	388.32	56.99
P	HE Rijeka	36.8	93.48	29.00
A	HE Vinodol	90	145.82	18.50
R	CHE Fužine	4.6	3.82	9.48
R	RHE Lepenica	0.8	0.40	5.72
A	HE Zeleni Vir	1.7	6.91	46.37
A	HE Senj	216	904.68	47.81
A	HE Sklope	22.5	76.16	38.64
P	HE Gojak	55.5	198.18	40.76
P	HE Ozalj	5.5	21.72	45.08
A	HE Lešće	42.3	55.62	15.01
R	RHE Velebit	276	488.66	20.21
P	HE Golubić	7.5	19.94	30.35
P	mHE Krčić	0.375	1.04	31.66
P	HE Miljacka	19.2	77.88	46.30
P	HE Jaruga	7.2	26.46	41.95
A	HE Peruća	61.4	136.98	25.47
A	HE Orlovac	237	414.48	19.96
A	HE Đale	40.8	142.98	40.00
P	HE Kraljevac	46.4	65.84	16.20
A	HE Zakučac	576	1649.12	32.68
A	HE Dubrovnik	126	686.68	62.21
A	HE Zavrelje	2	5.73	32.68

Run-of-river HPP in CES are typical installations using the available flow of the river and in some cases utilise a small basin to divert the water needed for operation.

Small HPP are a subject of constant investigation in CES. There is limited investment with only 2.47 MW of installed capacity, some more than 100 years old. The main obstacle remains in the area of legislature, where it is very difficult to obtain a building permit. Most investments at this moment are being developed on existing dams using biological minimum water flow to add further generator sets with small installed power (typically <2 MW). For the purposes of the national case, all sHPP are regarded as run-of-river installations, associated with the basin they are installed at.

Table 3. Accumulation capacity of HPP in CES

<i>River</i>	<i>Accumulation</i>	<i>Capacity (million m<sup>3</sup>)</i>	<i>h of operation at nominal power</i>
<b>Drava</b>	Varaždin	2.80	1.56
<b>Drava</b>	Čakovec	10.50	5.83
<b>Drava</b>	Dubrava	16.60	9.22
<b>Drava</b>	TOTAL river	29.90	
<b>Trebišnjica</b>	Bileća	9.30	57.41
<b>Zrmanja</b>	Štikada	13.65	63.19
<b>Zrmanja</b>	Razovac	1.84	12.78
<b>Cetina</b>	Peruća	543.00	1256.94
<b>Cetina</b>	Buško Blato	782.00	3103.17
<b>Cetina</b>	Đale	3.70	4.67
<b>Cetina</b>	Prančevići	6.80	8.59
<b>Cetina</b>	TOTAL river	1335.50	
<b>Rječina</b>	Valići	0.60	7.94
<b>Lokvarka/Lokve</b>	Bajer	40.59	675.20
<b>Gacka/Lika</b>	Kruščica	128.00	592.59
<b>Gacka/Lika</b>	Sklope	142.00	876.54
<b>Gacka/Lika</b>	TOTAL river	270.00	
<b>Dobra/Mrežnica</b>	Lešće	25.70	59.49

*Hydrology of the rivers and river basins.* River hydrology is necessary to determine the proper dynamics of inflow and for assessing the proper capacities for a certain river flow. The data acquired for this case is provided online by the National Hydro-Meteorological Department (DHMZ) [45]. The format is given as hourly average of flow in m<sup>3</sup>/s. Most of the measurements extend in a time period 1947-2013, and are averaged statistically to provide a single representative year of flow as input for the model. Some of the measurement stations have been combined to provide a full account of all the tributaries in cases where it is not possible to obtain measurements from downstream stations. A composite hydrology of all rivers is presented in Figure 9.

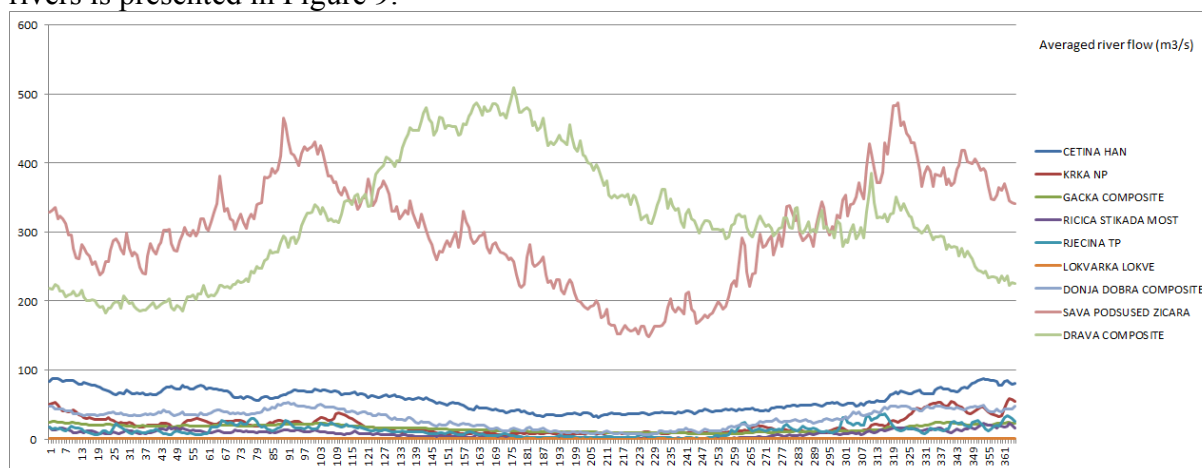


Figure 9. Aggregated flow for all rivers used in CES

Significant differences can be found between rivers. For example, the larger continental rivers of Sava and Drava, belonging to the Black Sea basin are much more stable in average flows during the year, therefore making it more suitable for run-of-river installations. On the other hand, rivers of the Adriatic Sea basin, like Cetina and Krka, are characterised by the high

seasonality in flow volumes, due to the carst geography and accentuated by the sudden inflow of either large volume of rain or melting of the snow in the adjacent mountains. Aggregated river flow for the Cetina and Krka are given in separate Figure 10. due to their important role in CES. In the summer, prolonged periods of low precipitation lead almost to drying up of the river beds. Central and Western Croatia's rivers such as Rječina and Dobra exhibit also increased seasonality due to precipitation, with an added difficulty of having very low volume of flow in total.

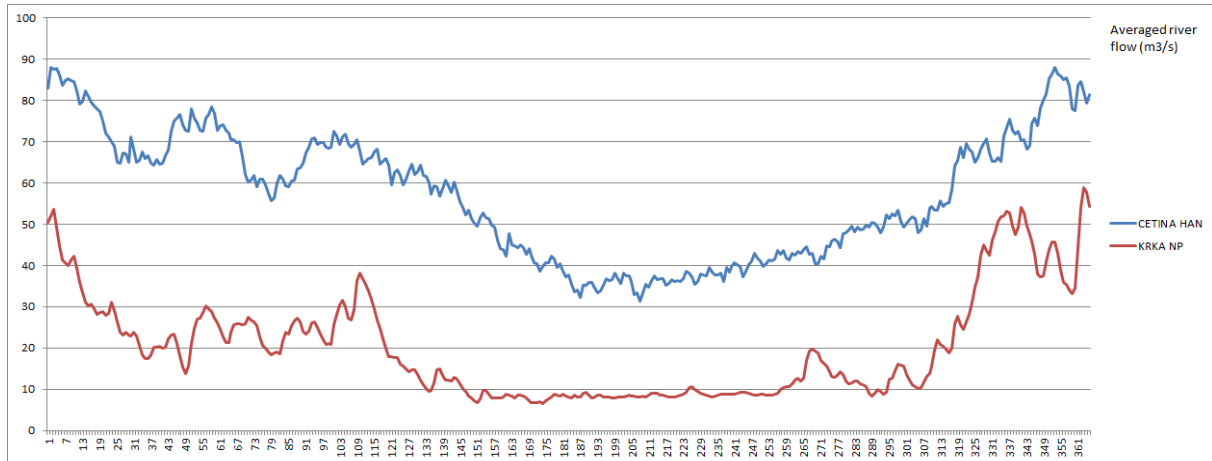


Figure 10. Aggregated flow for Cetina and Krka river

### RES model in CES

Other RES inputs for the model and the national case include wind and solar resources. All data was acquired from Meteonorm software for six locations:

- Osijek
- Zagreb
- Rijeka
- Šibenik
- Split
- Dubrovnik.

The parameters from Meteonorm database were:

- FF – wind speed [m/s]. The raw data was used as an input for wind power production data and converted to wind power potential at 100 m height.
- G\_T – Global radiation tilted [ $W/m^2$ ]
- G\_H – Global radiation horizontal [ $W/m^2$ ]

The horizontal radiation data was used to define solar power potential with data from the tilted radiation for verification. It was assumed  $135 W/m^2$  is the nominal output of  $1 m^2$  of PV panels. Figure 11 and Figure 12 show the raw data from Meteonorm for wind and solar.

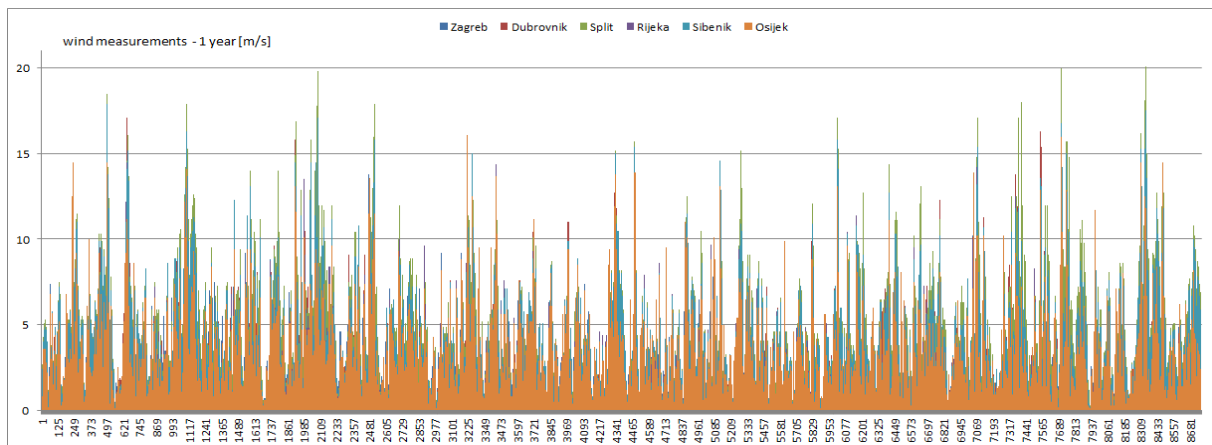


Figure 11. Meteonorm raw data for wind speeds on six locations

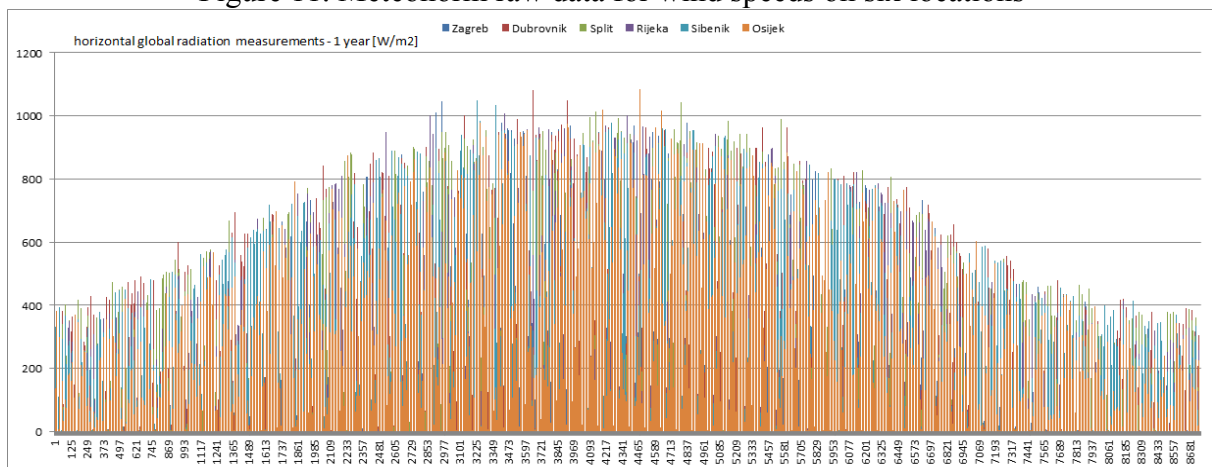


Figure 12. Meteonorm raw data for solar radiation on six locations

### Economic model and data

All investment, operation and maintenance, fixed and variable production costs, as well as fuel costs for the model were acquired from the SETIS calculator, a free tool on the European Commission website [46].

Market prices for simulation of import/export were obtained from European Energy Exchange (EEX) [47] in the time period of 2000-2006, which are scaled to an average of 45 EUR/MWh, representing current levels of electricity prices in the European system.

Additionally, for all the data in the study, an average inflation rate of 3.5% was considered. For payment periods of new installations, a 20-year period was assumed for new RES installations, and 30 years for new capital objects, such as TPP or HPP.

For existing installations, almost all capital objects have been paid off, except for a smaller part of TPP Plomin 2 (built 2000) and HPP Lešće (2010). The significance of their share in the overall CES in terms of capital investment was too small to consider assigning current capital value, therefore only the residual value is regarded. That is why installation costs for those power plants are not considered in the model. This is the reason why the solutions in the previously presented regional case study, which takes all installation costs into account, have much higher  $\overline{NPV}$ .

For RES installations, the current fleet is on average 4-5 years old, and as is regarded as not paid off in total. Again, a 3.5% inflation rate was assumed for all values obtained from SETIS.



### Phase-in and phase-out of capital energy objects in CES up to 2050

As a vast majority of CES capital objects has been built well over 20 years ago, a detailed plan of phasing-out has been given, as according to the plans of the generating operator and given knowledge of technical feasibility of revitalization and modernization. The list phase-out of TPP is given in Table 4. After 2030, around 120 MW of installed TPP only in TPP-DH will remain active. All TPP-Conventional plants will either shutdown or convert to a combined-cycle generation. Note that none of HPP is slated for phase-out, only for revitalization at regular intervals.

Table 4. Decommission timetable for existing generators

<i>Decommission</i>	<i>MW</i>	<i>time</i>	<i>Decommission</i>	<i>MW</i>	<i>time</i>
EL-TO Zagreb A	12.5	2011	TE-TO Osijek A	45	2019
TE Sisak A	210	2013	TE Sisak B	210	2019
TE Plomin A	105	2015	EL-TO Zagreb B	32	2019
TE-TO Osijek A	25	2017	TE Rijeka	320	2020
TE-TO Osijek B	25	2017	EL-TO Zagreb A	25.6	2025
KTE Jertovec A	42.5	2018	EL-TO Zagreb B	25.6	2025
KTE Jertovec B	42.5	2018	TE-TO Zagreb K	210	2030
TE-TO Zagreb C	110	2019	NPP Krško	348	2043

The phase-in plan calls for between 192 and 928 MW of new or refurbished HPP capacity until 2035, with 500 MW of coal TPP and 1500 MW of gas TPP. New TPPs are meant to replace existing conventional TPPs with a combined-cycle gas-fired setup, phasing out conventional-cycle gas and oil-fired installations. A single coal TPP of 500 MW is stated for commissioning in 2020.

Special case for consideration is NPP. Sole installation of that is NPP Krško, built in 1983 and recently given approval for extended operation until 2043. The price of electricity from NPP is given at 45 EUR/MWh fixed until 2023, the end of regular operation, and 65 EUR/MWh fixed in the period 2023-2043, reflecting enhanced investment in security and maintenance.

### EVs in Croatian Energy System

The long-term predictions of number of EVs in the system are based on the study given in [24] and shown in Figure 13. Based on those data, the approximate years of Entry-Into-System (EIS) for pure EV that can work in V2G mode are given in Figure 14.

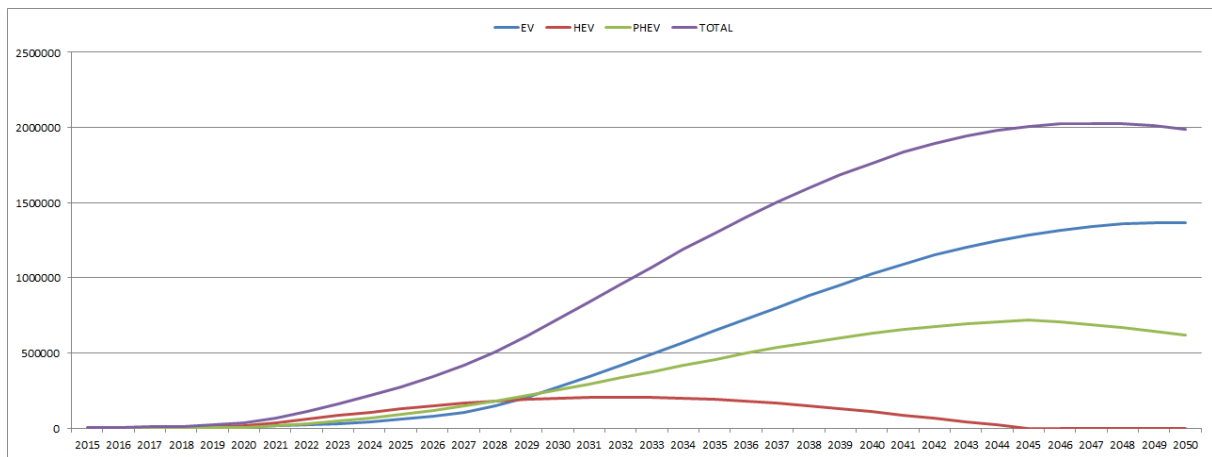


Figure 13. Estimated total number of EV and hybrid vehicles in CES

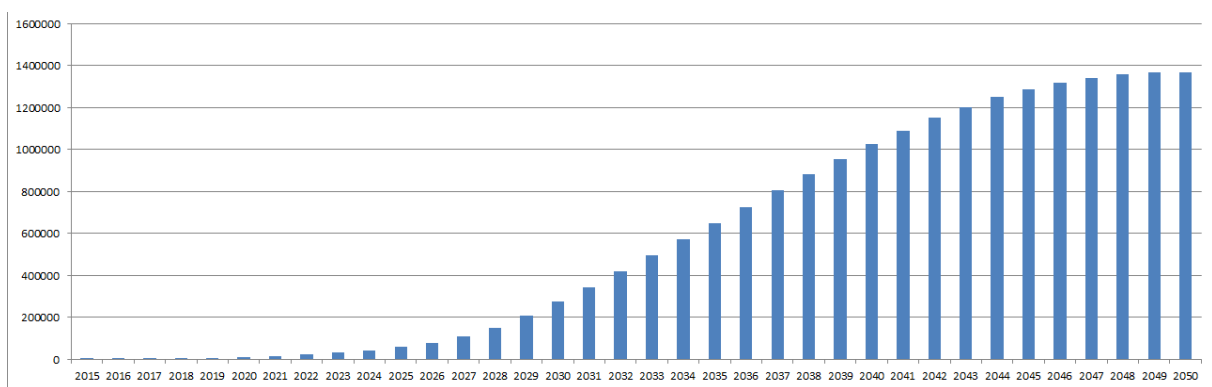


Figure 14. Estimated EVs EIS in CES

Battery capacity of EVs has been determined by an overview of average capacities of available models (see [29] for details), with the mean value of 21 kWh, which was increased to 24 kWh for the purpose of the scenario, as the trend in EV battery capacity shows a clear increase in newer generations of EVs. 24 kWh battery is currently the highest capacity battery for an EV on the market, disregarding the Tesla Model S type (60-85 kWh) and newly introduced Toyota RAV EV 2014 model (41 kWh).

Concerning the available capacity of batteries available for V2G operations, two assumptions are proposed. First one is regarding the amount of EVs actually using the feature of V2G. This option would require some sort of a binding contract with the utility serving the specific area or specific charging points. The second envisions a feature of what amount of capacity left over after the driving cycle are the owners willing to commit for V2G operations. The figures are assumed to be 50% of all owners and 50% of available capacity committed to V2G. Therefore, no more than 25% of the entire fleet's available battery capacity is ever committed to V2G in any given hour.

Final parameters for V2G operation are dedicated to number of vehicles, in time and space coordinates. The options are:

- Driven
- Parked
- Parked & Connected

The driven percentage can be determined by the driving cycle. The ratio between parked and parked with a connection is determined on an hourly time scale for one day, with no distinction between workday and weekend (see Figure 15). This differs from the approach of EnergyPLAN, which uses a defined daily curve for the distribution. It was decided to

approach it in this way to add flexibility for various scenarios. The hourly values are as follows:

- between 00h-05h - 95% at disposal for V2G,
- between 06h-07h - 70% at disposal for V2G,
- between 08h-15h - 50% at disposal for V2G,
- between 16h-17h - 70% at disposal for V2G,
- between 18h-23h - 90% at disposal for V2G.

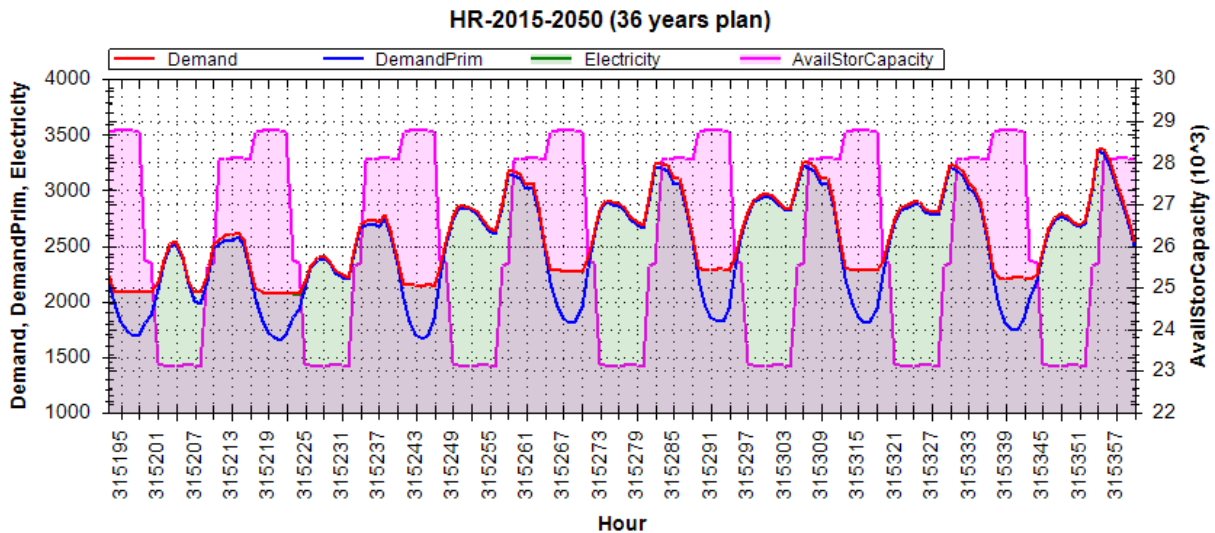


Figure 15. H2RES modelled of primary electrical demand, total demand with energy for EV transport, and available capacity for use in energy system

### CES long-term design optimization problem

Optimization problem formulation for CES long-term design is given by equations (3) and (4). Identified design variables in CES optimization problems are presented in Table 5 together with their bounds. It can be seen that only regulation variables are present for currently available power plants, while the year increase of nominal power is the variable for wind and solar power plants in the main regions in Croatia. Only one new conventional power plant (Gas with district heating) is set for the variable, as explained above. The first block is scheduled for the year 2025 with 5 years update interval for the building of additional blocks. In this study only SPP and WPP were treated as renewable energy sources (RES), while HPP are included in renewable sources (RwHES) only for specific purposes, as previously described.

Table 5. Design variables in CES optimization problems

Powerplant	Storage	Name	$P_{Ni}$		$\Delta P_i$			$S_{lc,j}$		$r_{i,t}$	
			i	j	lower	upper	lower	upper	$(u_i)$	lower	upper
1		HES Drava	-	-	-	-	-	-	-	0	1
2		HES Dubrovnik	-	-	-	-	-	-	-	0	1
3		HES Krka	-	-	-	-	-	-	-	0	1
4		HES Cetina	-	-	-	-	-	-	-	0	1
5		HE Rijeka	-	-	-	-	-	-	-	0	1
6		HES Vinodol	-	-	-	-	-	-	-	0	1
7		HES Senj	-	-	-	-	-	-	-	0	1
8		HES Dobra	-	-	-	-	-	-	-	0	1
9		HES Sava	-	-	-	-	-	-	-	0	1
10		HE Ombla	-	-	-	-	-	-	-	0	1
11		TPP Gas	-	-	-	-	-	-	-	0.1-0.3	1
12		TPP Gas-DHOld	-	-	-	-	-	-	-	0.1-0.3	1
13		TPP Coal	-	-	-	-	-	-	-	0.3	1
14		NPP Krško	-	-	-	-	-	-	-	1	1
15		WPP Šibenik	-	-	1	10	1	-	-	/	/
16		WPP Rijeka	-	-	1	10	1	-	-	/	/
17		WPP Split	-	-	1	10	1	-	-	/	/
18		WPP Dubrovnik	-	-	1	10	1	-	-	/	/
19		WPP Zagreb	5	50	1	10	1	-	-	/	/
20		WPP Osijek	5	50	1	10	1	-	-	/	/
21		SPP Šibenik	-	-	1	20	1	-	-	/	/
22		SPP Rijeka	-	-	1	20	1	-	-	/	/
23		SPP Split	-	-	1	20	1	-	-	/	/
24		SPP Dubrovnik	-	-	1	20	1	-	-	/	/
25		SPP Zagreb	1	20	1	20	1	-	-	/	/
26		SPP Osijek	1	20	1	20	1	-	-	/	/
27		TPP Gas-DHNew (short name Gas)	100	600	10	100	5	-	-	0.1-0.3	1
28	1	EVs	-	-	-	-	-	80	99	-1	1
29	2	Rev Hydro	-	-	-	-	-	70	99	-1	1

## RESULTS AND DISCUSSION

The following figures present obtained non-dominated solutions for Global problems displayed in *DeMak* graphical interface. The first figure display Pareto solutions in attribute/objective space where the three used objectives ( $\min NPV$ ,  $\min \overline{NPV}$ ,  $\max RESSh$ ) are on  $x y z$  coordinate axis. In order to help the reader to position presented solutions in 3D space, the figures also show projections of those solutions on 2D planes (in black). Ideal design is also shown in Figure 16 (large sphere in upper left corner) for the reference purpose.

The best value according to each objective is on one of the edges of attribute space and satisfaction for each objective monotonously decreases with distance from the relevant edge.

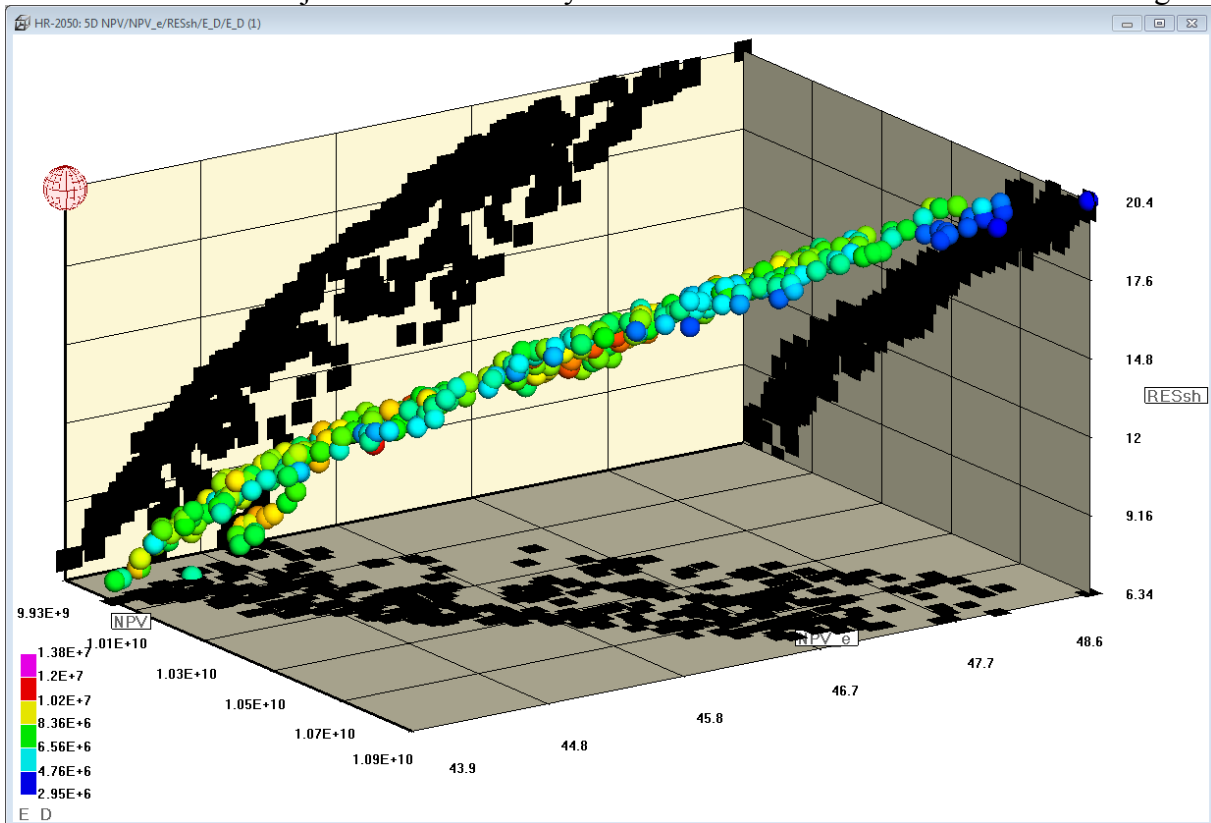


Figure 16. *Non-dominated solutions in attribute space ( $\overline{NPV}$ ,  $NPV$  and  $RESSh$ )*

Figure 17. shows interesting, yet expected characteristics that variants with higher share of conventional power sources still produces more expensive energy ( $\overline{NPV}$ ). Although variable expenses are much smaller for RES, investment cost is still much higher and plays dominant role.

Another interesting aspect of obtained non-dominated solutions is the relation between RES share, total installed nominal power of new Gas power plant with district heating and its load factor (see Figure 18.). It is evident that nominal power and its load factor decreases as the share of RES increase. However, certain level of nominal power always needs to be in the system to cover bed weather conditions (cloudy days without wind), and to cover heating demand.

Two selected projects which will be used for the further study are presented in Figure 19. Design B is the variant of national energy system with the lowest value of  $\overline{NPV}$ , while design A is energy system with almost doubled RES share compared with design B, and some (arguably) reasonable  $\overline{NPV}$ . More details on two selected designs are given in Table 6.

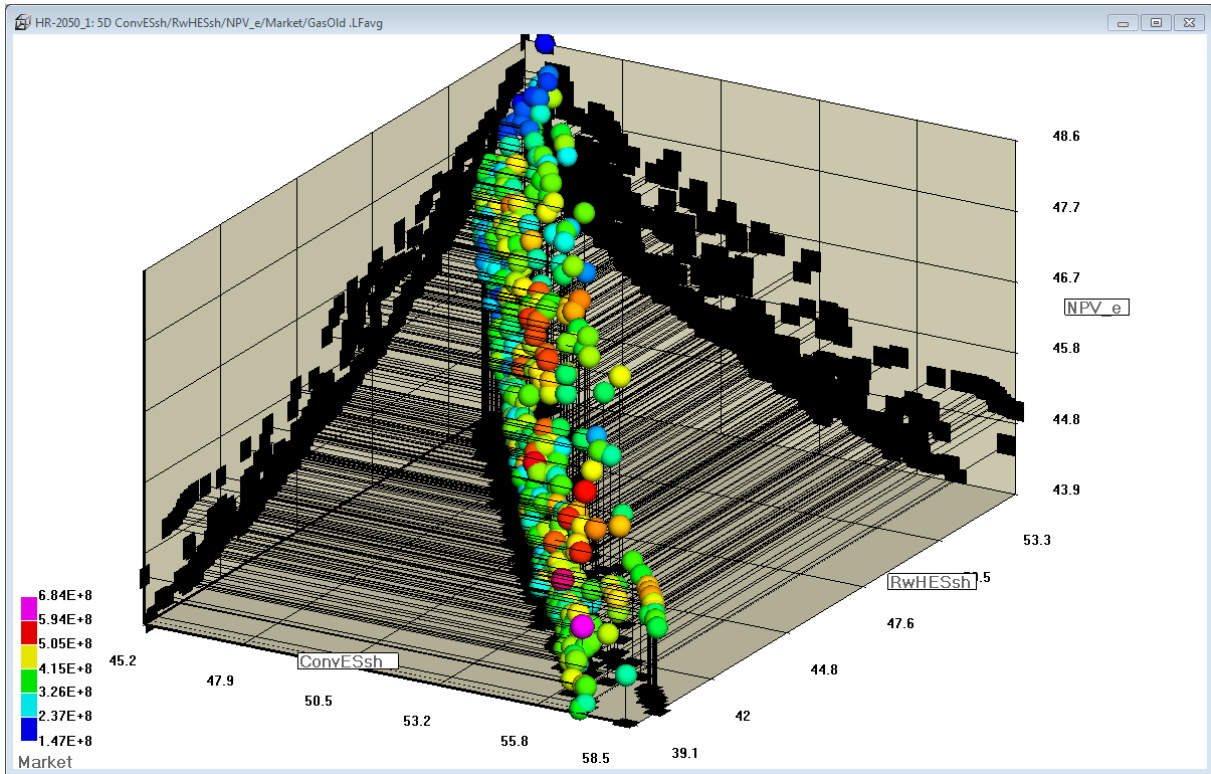


Figure 17. Relation between  $\overline{NPV}$  and ratios of energy produced by conventional and renewable power sources

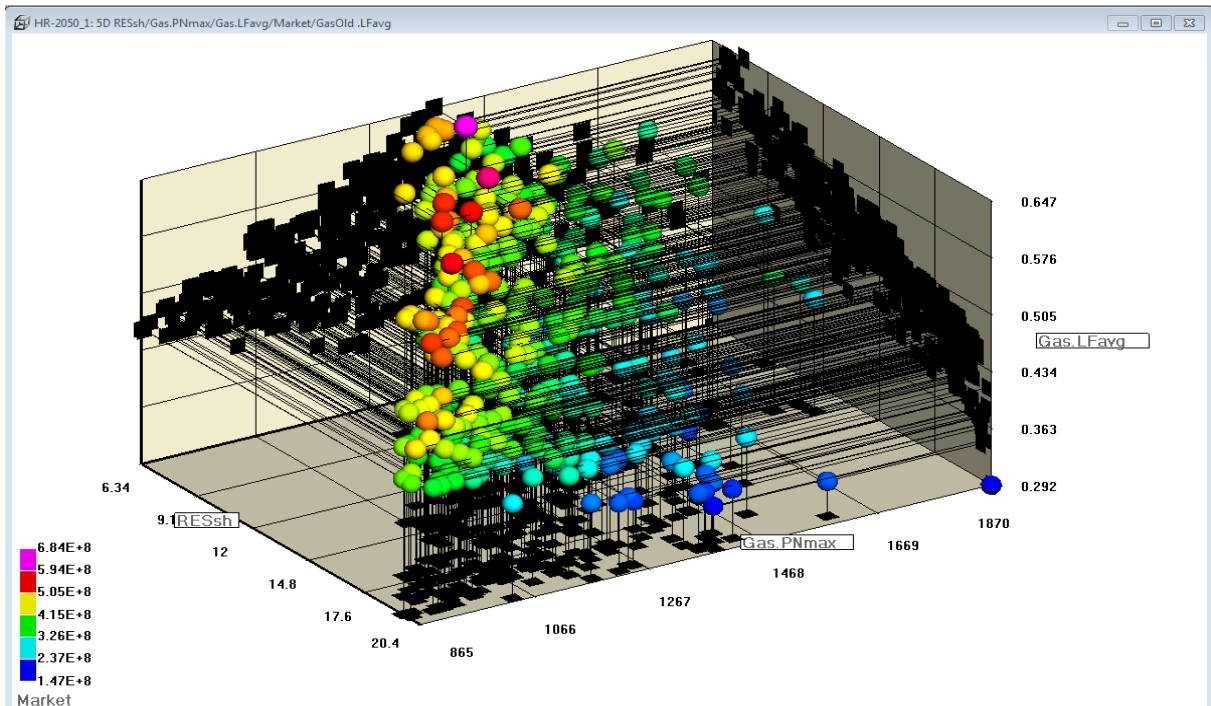


Figure 18. Relation between  $\overline{NPV}$  and ratios of energy produced by conventional and renewable power sources

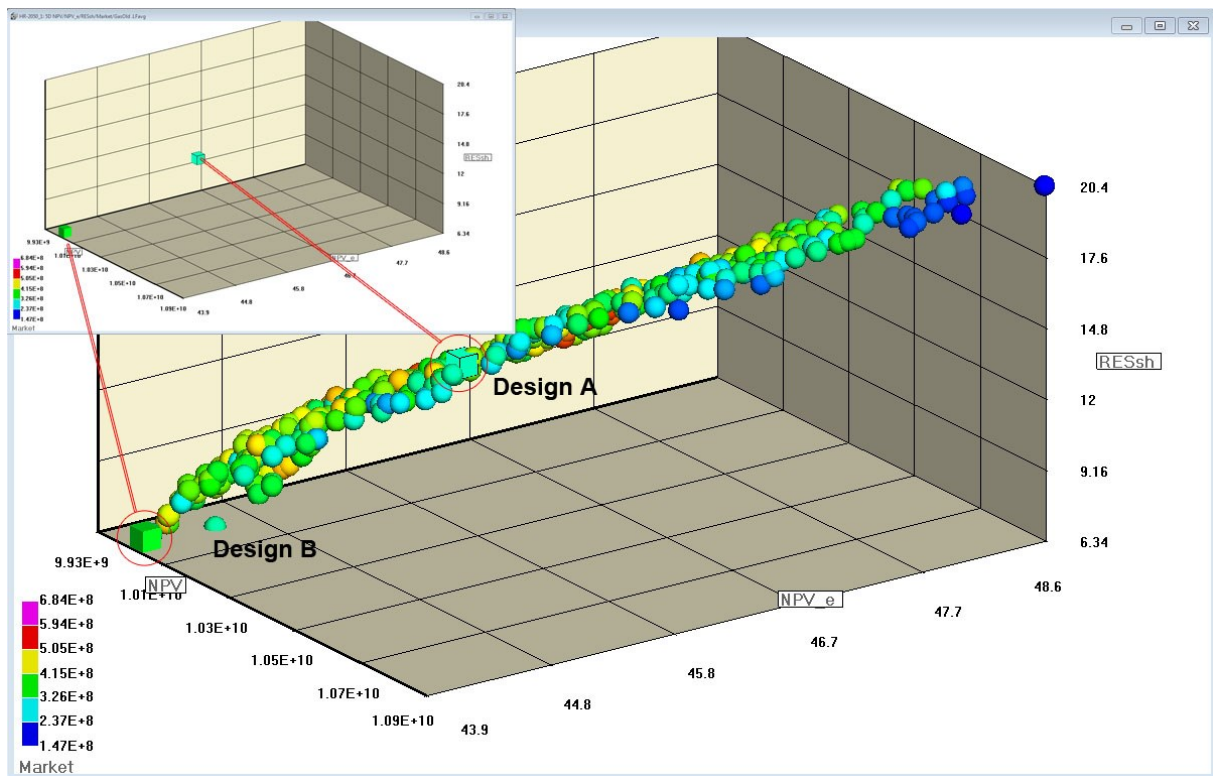


Figure 19. Pareto front with identified designs A and B

Figure 20. presents Design A cumulative total electricity Demand and cumulative produced energy for each year in 36 years-long scenario, together with cumulative Primary Electricity Demand, which does not include demand for charging of EVs for their transportation needs. On the left y axis is the cost of the electricity purchased on the market. The largest gap between produced electricity and demand is between fifth and tenth year of scenario due to decommissioning of several conventional power plants (see Table 4). One smaller gap is between 28<sup>th</sup> and 29<sup>th</sup> year of scenario due to decommissioning of NPP Krško as identified in Figure 21. The same figures also presents cumulative produced energy of the new Gas TPP with district heating, which adds a new block each five years (the last in the 29<sup>th</sup> year of scenario). For comparison, Figure 22. and Figure 23. present the same outputs for Design B. The only visible difference is a slightly higher price of energy purchased on the market in the last part of the scenario. It is interesting to notice that Design B install 175 MW more nominal power in the new Gas TPP than Design A, while having a 20% higher load factor (see Table 6). The reason for that probably lies in the fact that Design A still needs to cover unfavourable weather conditions and heating demand. That is the reason why the load factor of combined-cycle gas TPP is much smaller for Design A.

Some additional interesting aspects of Design A are shown in the next several figures. Figure 24. illustrates how electrical energy stored in EV helps to cover increased demand in the first and third quarter of the last year. This is especially useful in the third quarter when HPP produce less energy due to smaller water inflow during summer.

Table 6. *The main characteristics of designs A and B*

Optimization Component	A	B
Gas.PN (MW)	260	395
Gas.PndY (MW)	52	54
WPP Sibenik.PNdY (MW)	9	8
WPP Rijeka.PNdY (MW)	2	1
WPP Split.PNdY (MW)	10	4
WPP Dubrovnik.PNdY (MW)	9	4
WPP Zagreb.PN (MW)	22	18
WPP Zagreb.PNdY (MW)	1	1
WPP Osijek.PN (MW)	20	13
WPP Osijek.PNdY (MW)	4	1
SPP Sibenik.PNdY (MW)	16	1
SPP Rijeka.PNdY (MW)	14	1
SPP Split.PNdY (MW)	16	1
SPP Dubrovnik.PNdY (MW)	10	1
SPP Zagreb.PN (MW)	5	1
SPP Zagreb.PNdY (MW)	12	8
SPP Osijek.PN (MW)	15	1
SPP Osijek.PNdY (MW)	8	1
Rev-OpLev (%)	77	72
EV-OpLev (%)	86	88
NPV (EUR/MWh)	1.04E+10	1.01E+10
NPV_e (EUR/MWh)	45.35	43.9
RESsh (%)	14.6	7.07
RwHESsh (%)	46.64	39.34
ConvESsh (%)	49.85	56.83
EE (MWh)	12343	1546
E_D (MWh)	5656516	7041469
Market (MWh)	2.83E+08	3.50E+08
MaxPN (MW)	8403	6061
EndPN (MW)	8403	6061
MinLF (relative)	0.329	0.3408
MaxLF (relative)	0.4868	0.4881
AvgLF (relative)	0.3622	0.371
EndLF (relative)	0.329	0.341
Gas.Pnmax (MW)	1300	1475
Gas.Lfavg (relative)	0.4824	0.5813



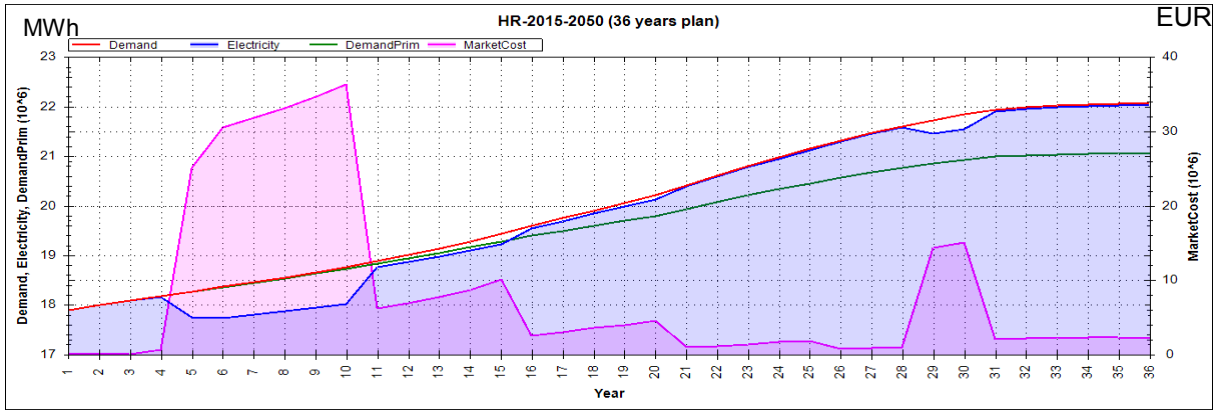


Figure 20. Design A – Cumulative Primary and Total Demand, Produced and Purchased Electrical Energy

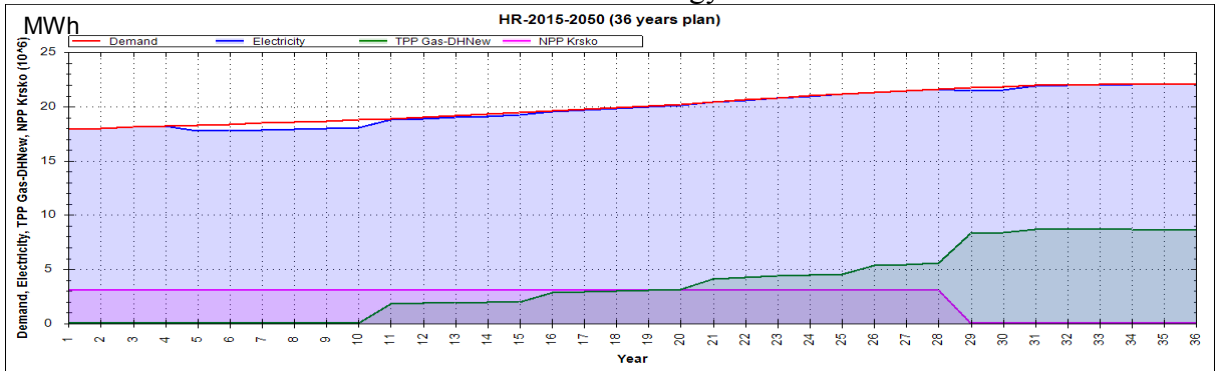


Figure 21. Design A – Cumulative Primary and Total Demand, NPP Krško and new DH GAS Powerplant

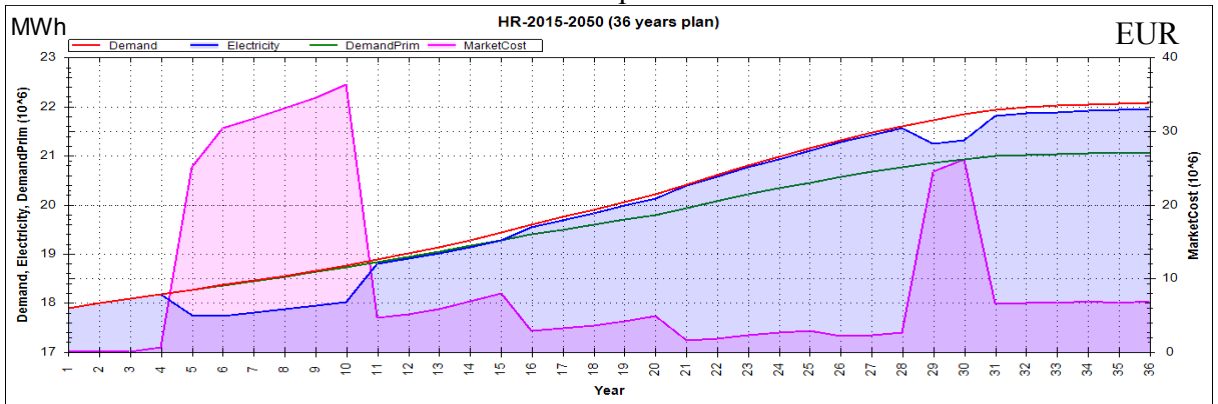


Figure 22. Design B – Cumulative Primary and Total Demand, Produced and Purchased Electrical Energy

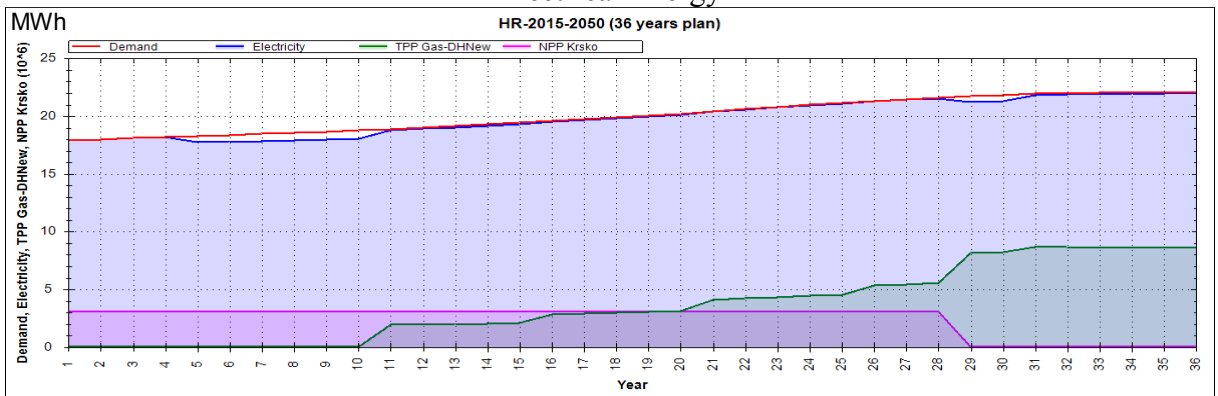


Figure 23. Design B - Cumulative Primary and Total Demand, NPP Krško and new DH GAS Powerplant

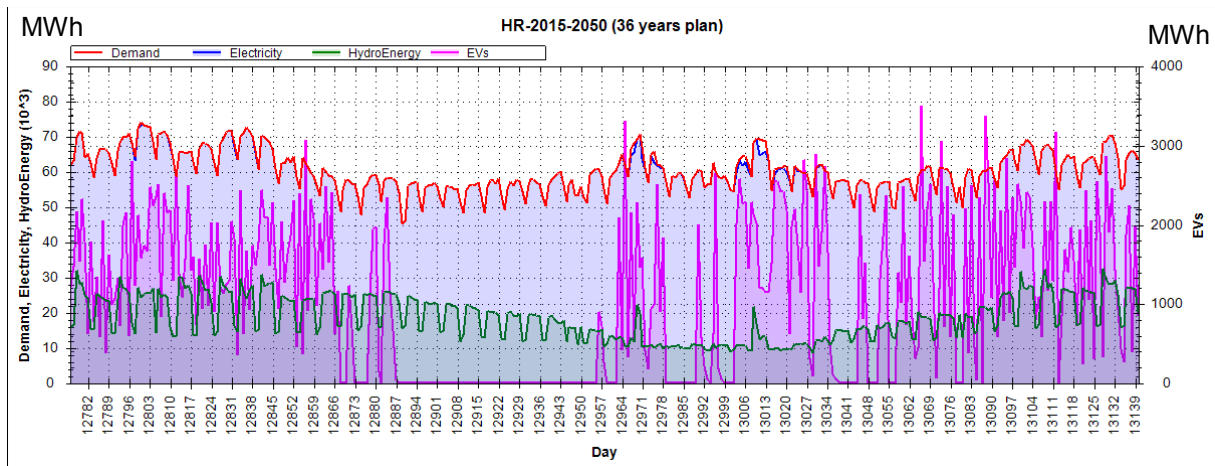


Figure 24. Design A – Last year Cumulative Demand, Total Electrical Energy, Hydro and EV Energy

Figure 25. shows production of the largest aggregated HPP in the scenario – HES Cetina. This aggregated HPP also has the largest accumulation. The figure shows how water aggregated during the rainy season is kept for the summer. However, since during the summer season the two highest energy demand peaks exist, HPP does not have enough accumulated water to produce satisfactory amount of electricity, as it does in the first quarter when sufficient amount of water exists. Figure 26. shows how those inadequacies in hour production during the critical week in summer are supplemented from the market.

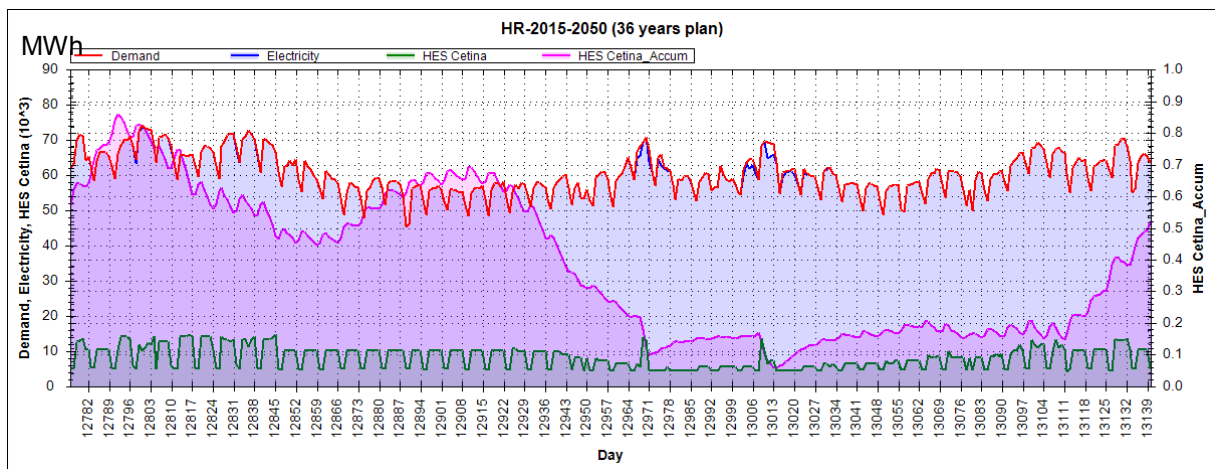


Figure 25. Design A – Last year Cumulative Demand, Total Electrical Energy, Hydro Energy and Accumulation

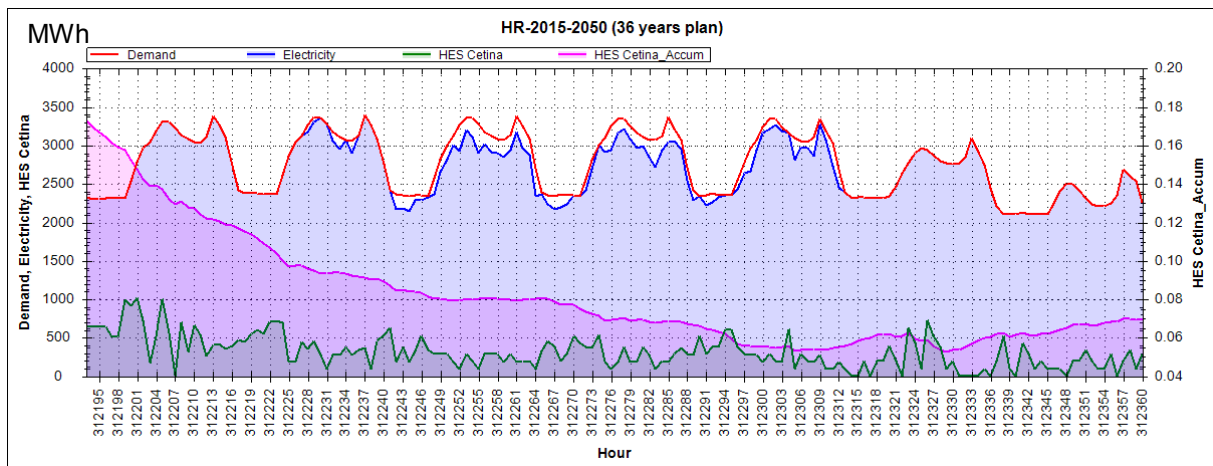


Figure 26. Design A – Demand, Total Electrical Energy, Hydro Energy and Accumulation in each hour for the critical week in the last year

## CONCLUSION

Comprehensive CES long-term design is presented as one of the results of three year national research project iRESEV. The project has enabled collection of various sources of data that are necessary for preparation of national energy system model, such as transportation system, meteorological data for solar insolation and wind characteristics in several regions, hydrology of river basins, heating and cooling demand, etc.

Two-level energy system design problem formulation which is presented in this paper enables generation of Pareto front even for an energy system of significant size, with more than thirty individual components. Possibility of generation of Pareto front with relevant objectives gives deeper insight on energy system characteristics to the designer of an energy system as shown in the discussion on obtained results of national case study.

The results of national case study suggests that certain level of conventional energy sources will have to remain in the energy system to cover unfavourable weather conditions and to cover heating demand. Also, variants with more RES share have lower total energy system load factor and significantly higher installed capacity.

EVs, as seen from the case study, do not have only negative impacts on the energy system, in terms of consumption, while having a positive influence by discharging energy into the system in times of peak demand. Total cost of the system can be brought down by utilizing periods of low demand to shift vehicle charging (usually night time), thereby keeping peak demand values as they are. The mentioned can only be achieved through V2G operation. The current two-tariff pricing in Croatia is unsustainable, as without regulation charging, the peak demand value would surge by almost 6 GW.

Future work could include further steps in validation of the long-term energy system planning model which was developed during this project. Additionally, some method for securing of energy supply could be implemented in the model in order to obtain more realistic energy system behaviour. The proposed problem solutions suggested in the regional and national case studies should be further investigated and improved regarding the efficiency and stability of the solutions. One of the important goals is accommodation of mathematical model for parallelization in order to exploit multi-processor/multi-core capabilities of today's computers.

Regarding the national case study modelling, data inputs for meteorological and hydrology time series should be further adapted and analysed statistically, especially in the area of hydrology concerning river basins shared with neighbouring states (Bosnia and Hercegovina, Slovenia, and to some extent Serbia and Hungary). Also the model could include the sHPP, which are not considered here, since some of the recent studies from EIHP suggest that Croatia still has potential for ~200 MW or ~550 GWh/year in that field. Biomass and biogas TPP are also under consideration for modelling as a valuable addition economic multiplier to the power sector, taking in a large amount of biomass otherwise exported or wasted.

## ACKNOWLEDGMENT

It is gratefully acknowledged that this work has been supported by the Croatian Science Foundation through the "ICT-aided integration of Electric Vehicles into the Energy Systems with a high share of Renewable Energy Sources" iRESEV, collaborative research project grant No. 09/128. and "Optimization of Renewable Electricity Generation Systems Connected in a Microgrid" collaborative research project, grant No. HRZZ 08/40. One of the authors is currently funded by the European IEE project "BEAST" (Beyond Energy Action Strategies).

## REFERENCES

1. "IPCC AR4 WG1." [Online]. Available: <http://www.ipcc.ch/pdf/assessment-report/ar4/wg1/ar4-wg1-chapter10.pdf>. [Accessed: 01-Apr-2015].
2. "EU Directive 2009/28/EC." [Online]. Available: <http://eur-lex.europa.eu/legal-content/EN/ALL/?uri=CELEX:32009L0028>.
3. D. Connolly, H. Lund, B. V. V. Mathiesen, and M. Leahy, "A review of computer tools for analysing the integration of renewable energy into various energy systems," *Appl. Energy*, vol. 87, no. 4, pp. 1059–1082, Apr. 2010.
4. H. Lund and E. Münster, "Modelling of energy systems with a high percentage of CHP and wind power," *Renew. Energy*, vol. 28, no. 14, pp. 2179–2193, Nov. 2003.
5. H. Lund, P. A. Østergaard, and I. Stadler, "Towards 100% renewable energy systems," *Appl. Energy*, vol. 88, no. 2, pp. 419–421, Feb. 2011.
6. H. Lund and B. V. Mathiesen, "Energy system analysis of 100% renewable energy systems—The case of Denmark in years 2030 and 2050," *Energy*, vol. 34, no. 5, pp. 524–531, 2009.
7. G. Gasparovic, G. Krajacic, N. Duic, and M. Baotic, 24th European Symposium on Computer Aided Process Engineering, vol. 33. Elsevier, 2014.
8. G. Krajacic, R. Martins, A. Busuttill, N. Duic, and M. da G. Carvalho, "Hydrogen as an energy vector in the islands' energy supply," *Int. J. Hydrogen Energy*, vol. 33, no. 4, pp. 1091–1103, Feb. 2008.
9. R. Segurado, G. Krajacic, N. Duic, and L. Alves, "Increasing the penetration of renewable energy resources in S. Vicente, Cape Verde," *Appl. Energy*, vol. 88, no. 2, pp. 466–472, Feb. 2011.
10. G. Krajacic, N. Duic, and M. da G. Carvalho, "H2RES, Energy planning tool for island energy systems – The case of the Island of Mljet," *Int. J. Hydrogen Energy*, vol. 34, no. 16, pp. 7015–7026, Aug. 2009.
11. N. Duic', Z. Guzovic', V. Kafarov, J. J. Klemes, B. vad Mathiessen, J. Yan, K. Suomalainen, C. Silva, P. Ferrão, and S. Connors, "Wind power design in isolated energy systems: Impacts of daily wind patterns," *Appl. Energy*, vol. 101, pp. 533–540, 2013.
12. N. Duic, G. Krajacic, and M. da G. Carvalho, "RenewIslands methodology for sustainable energy and resource planning for islands," *Renew. Sustain. Energy Rev.*, vol. 12, no. 4, pp. 1032–1062, May 2008.

13. F. Chen, N. Duic, L. Manuel Alves, and M. da Graça Carvalho, "Renewislands—Renewable energy solutions for islands," *Renew. Sustain. Energy Rev.*, vol. 11, no. 8, pp. 1888–1902, Oct. 2007.
14. Z. Bacelic Medic, B. Cosić, and N. Duić, "Sustainability of remote communities: 100% renewable island of Hvar," *J. Renew. Sustain. Energy*, vol. 5, no. 4, p. 041806, Jul. 2013.
15. P. Petruschke, G. Gasparovic, P. Voll, G. Krajacic, N. Duic, and A. Bardow, "A hybrid approach for the efficient synthesis of renewable energy systems," *Appl. Energy*, Apr. 2014.
16. M. Manfren, P. Caputo, and G. Costa, "Paradigm shift in urban energy systems through distributed generation: Methods and models," *Appl. Energy*, vol. 88, no. 4, pp. 1032–1048, 2011.
17. Q. Zhang, B. C. Mclellan, T. Tezuka, and K. N. Ishihara, "An integrated model for long-term power generation planning toward future smart electricity systems," *Appl. Energy*, vol. 112, pp. 1424–1437, Dec. 2013.
18. C. Bussar, M. Moos, R. Alvarez, P. Wolf, T. Thien, H. Chen, Z. Cai, M. Leuthold, D. U. Sauer, and A. Moser, "Optimal Allocation and Capacity of Energy Storage Systems in a Future European Power System with 100% Renewable Energy Generation," *Energy Procedia*, vol. 46, pp. 40–47, 2014.
19. I. Pawel, "The cost of storage - How to calculate the levelized cost of stored energy (LCOE) and applications to renewable energy generation," *Energy Procedia*, vol. 46, pp. 68–77, 2014.
20. a. Etxeberria, I. Vechiu, H. Camblong, and J. M. Vinassa, "Comparison of three topologies and controls of a hybrid energy storage system for microgrids," *Energy Convers. Manag.*, vol. 54, no. 1, pp. 113–121, Feb. 2012.
21. M. Stadler, C. Marnay, R. Sharma, G. Mendes, M. Kloess, G. Cardoso, O. Megel, and a. Siddiqui, "Modeling electric vehicle benefits connected to smart grids," in *2011 IEEE Vehicle Power and Propulsion Conference, VPPC 2011*, 2011, pp. 1–8.
22. K. Clement-Nyns, E. Haesen, and J. Driesen, "The impact of vehicle-to-grid on the distribution grid," *Electr. Power Syst. Res.*, vol. 81, no. 1, pp. 185–192, Jan. 2011.
23. H. Lund and W. Kempton, "Integration of renewable energy into the transport and electricity sectors through V2G," *Energy Policy*, vol. 36, no. 9, pp. 3578–3587, Sep. 2008.
24. T. Pukšec, G. Krajacic, Z. Lulic, B. V. Mathiesen, and N. Duic, "Forecasting long-term energy demand of Croatian transport sector," *Energy*, vol. 57, no. null, pp. 169–176, Aug. 2013.
25. Connolly, D., Mathiesen, B. V. (2014). A technical and economic analysis of one potential pathway to a 100% renewable energy system. *International Journal of Sustainable Energy Planning and Management*, 1, 7-28. 10.5278/ijsepm.2014.1.2
26. B.V. Mathiesen, H. Lund, D. Connolly, H. Wenzel, P.A. Ostergaard, B. Möller, S. Nielsen, I. Ridjan, P. Karnoe, K. Sperling, F.K. Hvelplund. Smart Energy Systems for coherent 100% renewable energy and transport solutions. *Applied Energy* (145), 139-154.
27. L.T. Biegler., I.E. Grossmann. Retrospective on optimization. *Computers and Chemical Engineering* 28 (2004) 1169-1192
28. L.T. Biegler., I.E. Grossmann. Part II. Future perspective on optimization. *Computers and Chemical Engineering* 28 (2004) 1193-1218
29. G. Gašparovic, P. Prebeg, G. Krajacic and N. Duic, "Multi-objective long-term optimization of energy systems with high share of renewable energy resources." *SDEWES 2014*, Ohrid.
30. S. Obara and S. Watanabe, "Optimization of equipment capacity and an operational method based on cost analysis of a fuel cell microgrid," *Int. J. Hydrogen Energy*, vol. 37, no. 9, pp. 7814–7830, May 2012.

31. M. G. Ippolito, M. L. Di Silvestre, E. Riva Sanseverino, G. Zizzo, and G. Graditi, "Multi-objective optimized management of electrical energy storage systems in an islanded network with renewable energy sources under different design scenarios," *Energy*, vol. 64, pp. 648–662, Jan. 2014.
32. S. Sinha and S. S. Chandel, "Review of software tools for hybrid renewable energy systems," *Renew. Sustain. Energy Rev.*, vol. 32, pp. 192–205, Apr. 2014.
33. A. T. D. Perera, R. A. Attalage, K. K. C. K. Perera, and V. P. C. Dassanayake, "A hybrid tool to combine multi-objective optimization and multi-criterion decision making in designing standalone hybrid energy systems," *Appl. Energy*, vol. 107, pp. 412–425, Jul. 2013.
34. P. Prebeg, V. Zanic, and B. Vazic, "Application of a surrogate modeling to the ship structural design," *Ocean Eng.*, vol. 84, pp. 259–272, Jul. 2014.
35. V. Zanic, J. Andric, P. Prebeg, and P. Zanic, V.; Andric, J.; Prebeg, "Design synthesis of complex ship structures," *Ships Offshore Struct.*, vol. 8, no. 3–4, pp. 383–403, Jun. 2013.
36. P. A. Østergaard, "Reviewing optimisation criteria for energy systems analyses of renewable energy integration," *Energy*, vol. 34, no. 9, pp. 1236–1245, Sep. 2009.
37. M. Schulze and G. Gasparovic, "Network Flow Model for Multi-Energy Systems," *EE'10 Proc. 5th IASME/WSEAS Int. Conf. Energy {&} Environ.*, pp. 172–177, Feb. 2009.
38. P. Voll, M. Lampe, G. Wrobel, and A. Bardow, "Superstructure-free synthesis and optimization of distributed industrial energy supply systems," *Energy*, vol. 45, no. 1, pp. 424–435, Sep. 2012.
39. P. Voll, C. Klaffke, M. Hennen, and A. Bardow, "Automated superstructure-based synthesis and optimization of distributed energy supply systems," *Energy*, vol. 50, pp. 374–388, Feb. 2013.
40. HEP yearbook 2013 [Online]  
<http://www.hep.hr/hep/publikacije/godisnje/2013godisnje.pdf>
41. HEP Power Generation Ltd. <http://www.hep.hr/proizvodnja/>
42. MINGO-OIEKPP - <http://oie.mingo.hr/default.aspx?id=8>
43. ENTSO-E - <https://www.entsoe.eu/data/data-portal/production/Pages/default.aspx>
44. Irsag B., Pukšec T., Duić N., Long term energy demand projection and potential for energy savings of Croatian tourism–catering trade sector, *Energy*, Vol. 48, pp 398-405, 2012
45. DHMZ - Hydrology sector - <http://161.53.81.21/>
46. SETIS Energy Calculator - <http://setis.ec.europa.eu/EnergyCalculator/>
47. European Energy Exchange EEX - <https://www.eex.com/en/>