

ANALITICAL METHOD OF PID CONTROLLER TUNING FOR A CLASS OF UNSTABLE PLANT

Tomasz NARTOWICZ*

*Białystok University of Technology, Faculty of Electrical Engineering, ul. Wiejska 45 D, 15-351 Białystok, Poland

tomek.nartowicz@gmail.com

Abstract: The aim of the paper is to present the synthesis method of classic PID controller for a class of unstable plant. The proposed method based directly on Skogestad paper, where analytical synthesis of PID controllers is described. This paper is generalization of that approach on a class of unstable plants with delay. Analytical method for synthesis of fractional controllers is given. The considerations are illustrated by numerical example and results of computer simulation with MATLAB/Simulink.

Key words: PID Controller, Skogestad, Stability, Delay

1. INTRODUCTION

PID controllers are so far widely used in practice, because of well known simple structure. Many methods of tuning PID controllers for satisfactory behavior have been proposed in the literature (Johnson and Moradi, 2005). The methods are based on knowledge of mathematical description of process (O'Dwyer, 2003).

This paper is generalization of Skogestad method for a class of unstable plant. The starting point has been the IMC PID tuning rules of Rivera (1986). Furthermore Skogestad starts by approximating the process by a first-order plus delay processes. He proposed analytic tuning rules, simply but still result in a good closed-loop behavior.

2. METHOD

Consider the feedback control system shown in Fig. 1:

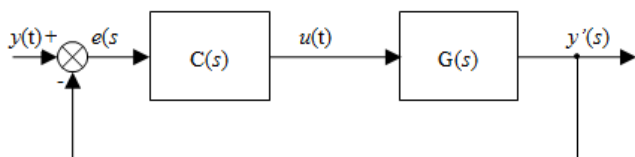


Fig. 1. Feedback control system structure

The process to be controlled is described by (1):

$$G(s) = \frac{k}{1 + T_1 s} \frac{1}{1 + T_2 s} e^{-sh} \quad (1)$$

where: $T_1 \geq 0$, $T_2 \geq 0$, $h \geq 0$, and $C(s)$ – transfer function of the controller.

The method proposed by Skogestad is based on approximating the process by a first- or second-order plus delay model, where: k – plant gain, τ_1 – dominant time constant, h – effective

time delay.

Skogestad method is based directly on analytical set of the controller parameters (Skogestad, 2001):

$$C(s) = K_c \frac{(1 + \tau_I s)}{\tau_I s} (1 + \tau_D s) \quad (2)$$

with following rules:

– Controller gain K_c :

$$K_c = \frac{1}{k} \frac{T_1}{\tau_c + h} \quad (3)$$

– Time constant τ_I :

$$\tau_I = \min\{T_1, 4(\tau_c + h)\} \quad (4)$$

– Time constant τ_D :

$$\tau_D = T_2 \quad (5)$$

In equation (3) parameter τ_c is recommended as follows:

$$\tau_c \geq h \quad (6)$$

In the paper the synthesis method of PID controller for an unstable plant described with transfer function (7) is proposed.

$$G(s) = \frac{k}{1 + T_1 s} \frac{1}{1 + T_2 s} e^{-sh}, \quad (7)$$

where $T_1 \geq 0$, $T_2 \geq 0$, $h \geq 0$.

To make generalization of Skogestad method for a class of unstable plant (7), the controller gain K_c is described with:

$$K_c = \frac{1}{k} \frac{-T_1}{\tau_c + h} \quad (8)$$

Equations (4)-(6) take their form unchanged.

Compare proposed method with synthesis method of fractional order controller proposed in Nartowicz (2011).

In that paper transfer function of the controller follows directly

from the use of Bode's ideal transfer function as a reference transfer function for the open loop system:

$$K(s) = \left(\frac{\omega_c}{s} \right)^\beta \quad (9)$$

To obtain an open loop system in the form (9) the controller transfer function should have a structure:

$$C(s) = -k_c \frac{s(1+sT)}{s^\alpha} = -k_c s^{1-\alpha} (1+sT) \quad (10)$$

where α is real number, and $\tau_2 = T$.

Open loop transfer function is given by:

$$K(s) = C(s)G(s) = \frac{kk_c e^{-sh}}{\tau s^\alpha} \quad (11)$$

Knowing $(j\omega)^\alpha = |\omega|^\alpha e^{j\alpha\pi/2}$ gain and phase for a transfer function (7) was written:

$$|K(j\omega)| = \frac{kk_c}{\tau \omega^\alpha} \quad \phi(\omega) = \arg K(j\omega) = -h\omega - \alpha \frac{\pi}{2} \quad (12)$$

For a gain ω_g and ω_p phase crossover frequency terms was given:

$$|K(j\omega_g)| = 1 \quad \phi(\omega_p) = \arg K(j\omega_p) = -\pi. \quad (13)$$

Using (12) the equations (13) was rewritten as:

$$\frac{kk_c}{\tau \omega_g^\alpha} = 1 \quad -h\omega_p - \alpha \frac{\pi}{2} = \pi \quad (14)$$

By solving equations (14) gain ω_g and ω_p phase crossover frequency:

$$\omega_g^\alpha = \frac{kk_c}{\tau} \quad \omega_p = \frac{(2-\alpha)\frac{\pi}{2}}{h} \quad (15)$$

For a given A_m gain and ϕ_m phase margins:

$$\frac{kk_c}{\tau \omega_p^\alpha} = \frac{1}{A_m} \quad \phi_m = \pi - h\omega_g - \alpha \frac{\pi}{2} \quad (16)$$

Transformed equation (16) were written in a form:

$$\omega_p = \left(\frac{A_m kk_c}{\tau} \right)^{1/\alpha} \quad \omega_g = \frac{(2-\alpha)\frac{\pi}{2} - \phi_m}{h} \quad (17)$$

Using given equations gain margin A_m was given by:

$$A_m = \left(\frac{(2-\alpha)\frac{\pi}{2}}{(2-\alpha)\frac{\pi}{2} - \phi_m} \right)^\alpha \quad (18)$$

Nonlinear equation (18) is handling A_m gain and ϕ_m phase margins and fractional order of the considerable controller (4) α .

Parameter α can be determined by solving equation (18) using computer methods.

By solving one of the first equations of (14) or (16):

$$k_c = \frac{\tau \omega_g^\alpha}{k} = \frac{\tau \omega_p^\alpha}{k A_m} \quad (19)$$

where: k – gain of the transfer function (1).

3. RESULTS

Example 1: $T_1 \gg h$

Consider the feedback control system shown in Fig. 1 in which the process to be controlled is described by transfer function:

$$G(s) = \frac{4}{(1-6s)(1+1.2s)} e^{-0.25s} \quad (20)$$

Determine controller parameters for a given transfer function (20) to stabilize the closed loop control system. In that case: $k = 5$, $T_1 = 6$, $T_2 = 1.2$; $h = 0.25$.

Using equations (4)-(6) and (8) transfer function of the controller is given:

$$c(s) = -3 \frac{(1+2s)}{2s} (1+1.2s) \quad (21)$$

Fig. 2 shows step response for control system presented in Fig.1, where the process to be controlled is described by (20), controller (21), and fractional controller proposed using Bode transfer function (Nartowicz, 2011), where:

$$C(s) = -2.56/s^{0.13385} - 3.07s^{0.8661}.$$

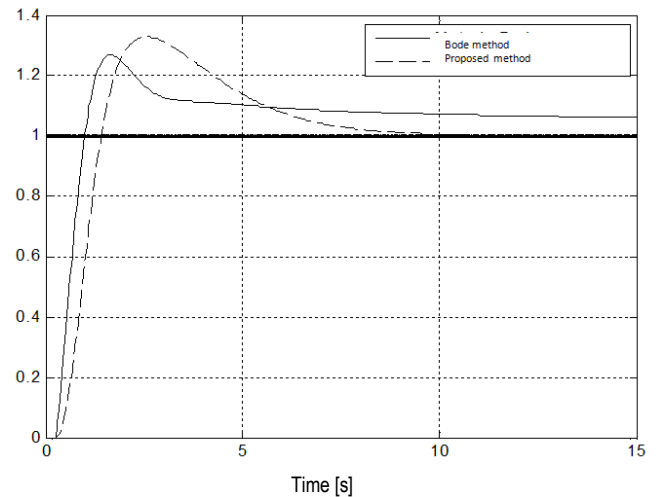


Fig. 2. Step response of the closed loop system with object (20) and controller (21), and fractional order controller synthesis with Bode method

Overshoot of step response drawn with method proposed in the paper is 10% bigger than drawn using Bode's method. Settling time is 8 sec. The time is much longer while Bode method using. Fig 3 shows step response for control system with controller (21), fractional order controller proposed with Bode method for a few values of parameter k (Fig.3a), and few values of delay h for a controlled process described with transfer function (20)

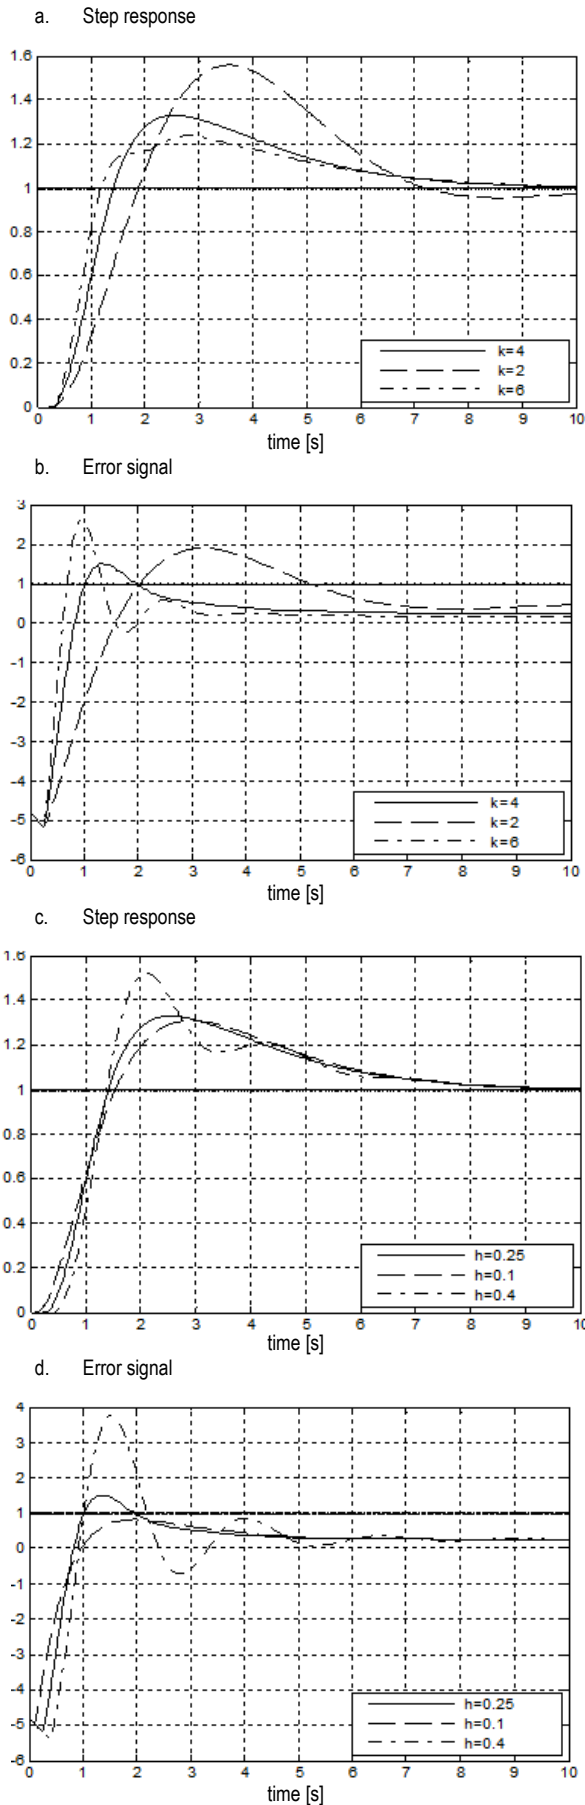


Fig. 3. Step response of the closed loop system with object (20) and controller (21) for a few different values of parameters k and h : a), b) step response; c), d) error signal

Fig 3b and 3d shows error signal of the controlled system. Overshoot for $k = 2$ is 55% bigger than for original value ($k = 4$), and moreover settling time is growing. There is no overshoot change while k is bigger, settling time also the same.

For a few values of time delay h settling time is const, but when the time is growing, the overshoot is also growing, for $h = 0.4$ even to 50%.

Example 2: $T_1 > h$

Consider the feedback control system shown in Fig.1 in which the process to be controlled is described by transfer function:

$$G(s) = \frac{0.55}{(1 - 62s)(1 + 36s)} e^{-10s} \quad (22)$$

Determine controller parameters for a given transfer function (22) to stabilize the closed loop control system.

In that case: $k = 0.55, T_1 = 62, T_2 = 36; h = 10$.

Using equations (4)-(6) and (8) transfer function of the controller is given:

$$c(s) = -5.64 \frac{(1 + 62s)}{62s} (1 + 36s) \quad (23)$$

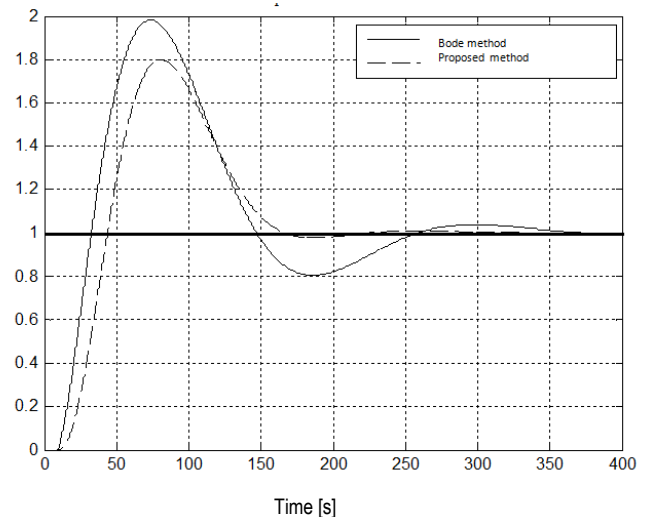


Fig. 4. Step response of the closed loop system with object (20) and controller (21), and fractional order controller syntheses with Bode method

Fig. 4 shows step response for control system presented in Fig. 1, where the process to be controlled is described by (22), controller (23), and fractional controller proposed using Bode transfer function:

$$C(s) = -2.9358/s^{0.13385} - 105.6888s^{0.8661}$$

Overshoot of step response drawn with method proposed in the paper is 20% bigger than drawn using Bode method. Fig. 5 shows step response for control system with controller (23), fractional order controller proposed with Bode method for a few values of parameter k (Fig. 5a), and few values of delay h for a controlled process described with transfer function (22). Settling time is ab. 160 sec, while the time for Bode method is 250 sec.

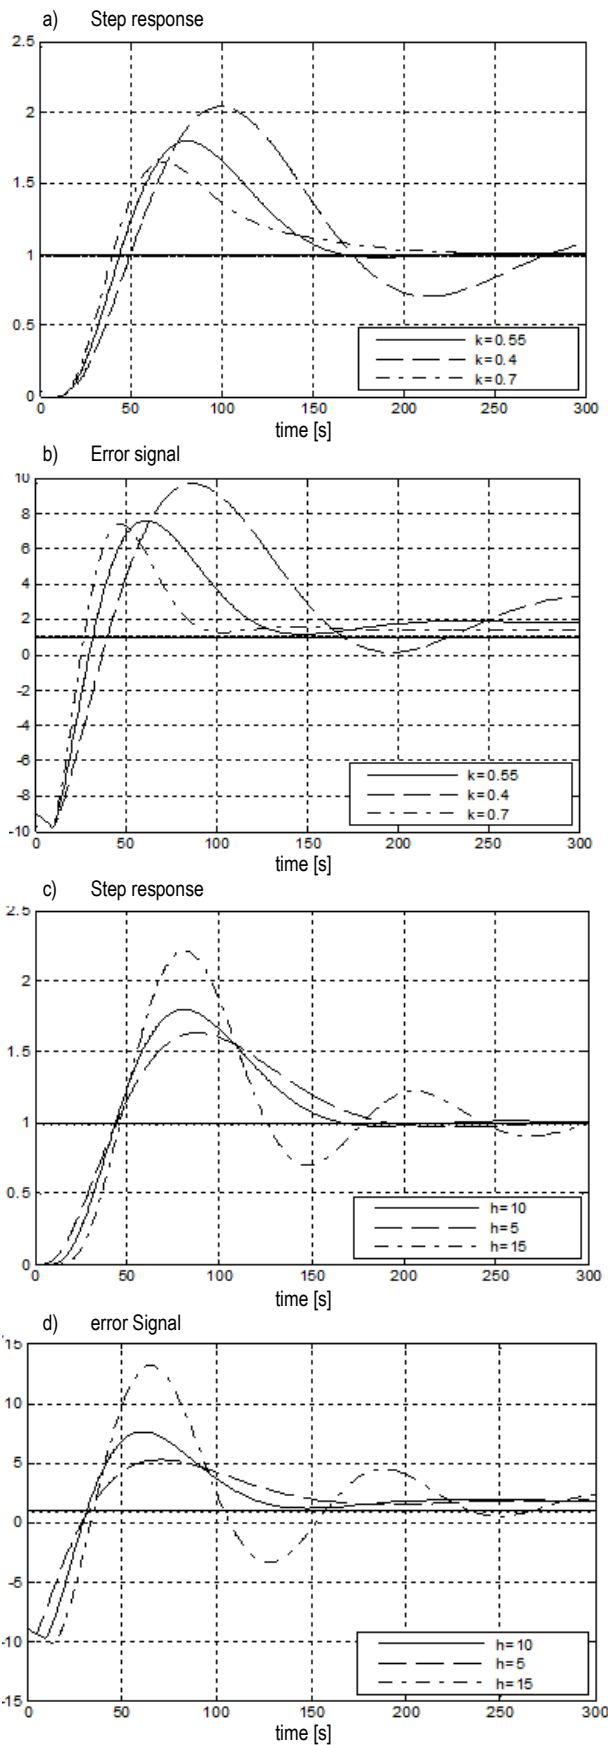


Fig. 5. Step response of the closed loop system with object (22) and controller (23) for a few different values of parameters k and h : a), b) step response; c), d) error signal

Fig. 5b and 5d show error signal of the controlled system. Overshoot for $k = 0.4$ is 100%, and moreover settling time is growing. For bigger value k overshoot value is decreasing, for $k = 0.7$ even to 60%. For a few values of time delay h settling time is const when time delay is decreasing.

4. CONCLUSIONS

Skogestad method is well known in the literature. That paper is a generalization of the Skogestad method for a class of unstable plants described by a transfer function (7). For an unstable plant the Skogestad analytical method is extended for a negative gain of the controller, which makes positive feedback while simulating. As in the Skogestad method, in that paper simulation for different time T_1, T_2 , and time delay h was drawn. Note that for simulation τ_c was positioned as: $\tau_c = h$. In the paper two cases were presented: $T_1 \gg h$, and $T_1 > h$. The proposed method was compared with the synthesis method of a fractional-order controller proposed in other authors' papers. A computer method for synthesis of fractional controllers is given. The considerations are illustrated by numerical examples and results of computer simulation with MATLAB/Simulink.

REFERENCES

1. Barbosa R. S., Machado J. A., Ferreira I. M. (2004), Tuning of PID controllers based on Bode's ideal transfer function, *Nonlinear Dynamics*, Vol. 38, 305-321.
2. Bode H. (1945), *Network Analysis and Feedback Amplifier*, Van Nostrand, New York.
3. Busłowicz M., Nartowicz T. (2009), Fractional controller synthesis for a class of inertial plant with delay, *Pomiary Automatyka Robotyka*, 398-405.
4. Farkh R., Laabidi K., Ksouri M. (2009), Computation of All Stabilizing PID Gain for Second-Order Delay System, *Mathematical Problems in Engineering*, Vol. 2009.
5. Johnson M. A., Moradi M. H. (2005), *PID Control: New Identification and Design Methods*, Springer.
6. O'Dwyer A. (2003), *Handbook of PI and PID Controller Tuning Rules*, Imperial College Press, World Scientific, New Jersey, London, Singapore, Hong Kong.
7. Oustaloup A., Sabatier J., Lanusse P., Malti R., Melchior P., Moreau X., Moze M. (2008), An overview of the CRONE approach in system analysis, modeling and identification, observation and control, *Proc. 17th World Congress IFAC*, Seoul, 14254-14265.
8. Rivera D.E., Morari M., Skogestad S. (1986), Internal model control, 4. PID controller design, *Ind. Eng. Chem. Res.*, 25(1).
9. Silva G. J., Datta A., Bhattacharyya S. P. (2005), *PID Controllers for Time Delay Systems*, Birkhäuser, Boston.
10. Skogestad S. (2001), *Probably the best simple PID tuning rules in the world*, AIChE Annual Meeting, Reno, Nevada.
11. Tan K. K., Wang Q. G., Hang C. C. (1999), *Advances in PID control*, Springer Verlag, London.
12. Xiang C., Wang Q.G., Lu X., Nguyen L.A., Lee T.H. (2007), Stabilization of second-order unstable delay processes by simple controllers, *Journal of Process Control*, 17, 675-682