

The 7th International Conference on Applied Energy – ICAE2015

Solid Waste Mixtures Combustion in a Circulating Fluidized Bed: Emission Properties of NO_x, Dioxin, and Heavy Metals

Hanfei Zhang^a, Caixia Lv^a, Jun Li^{b,*}, Wu Qin^c, Yukun Hu^d, Changqing Dong^c

^aState Nuclear Electric Power Planning Design & Research Institute, Beijing 100095, China

^bSystems, Power & Energy Research Division, University of Glasgow, Glasgow G12 8QQ, UK

^cNational Engineering Laboratory for Biomass Power Generation Equipment, North China Electric Power University, Beijing 102206, China

^dUniversity of South Wales, Llantwit Road, Pontypridd, CF371DL, UK

Abstract

To efficiently and environment friendly combust the domestic garbage, sludge, and swill waste fuels, five different fuels are prepared by mixing the waste fuels together with coal, and grass biomass at different mixing ratios, and finally those fuels were combusted in a circulating fluidized bed (CFB) reactor. The emission performances of NO_x, dioxin, and heavy metal during the combustion tests are studied. The results showed that a stable furnace temperature can be reached at approximately 850 °C when combusting all studied mixed fuels, benefiting the thermal processes of sludge and domestic garbage and thus realizing the purpose of waste-to-fuel. In addition, the dioxin emissions are much lower than the emission standards, and NO_x emissions could be reduced significantly by adjusting the ratio of waste fuels. However, the emissions of mercury, lead, and the combinations of chromium, tin, antimony, copper and manganese components all exceeded the pollution control standard for hazardous wastes incineration, a further technology is required for heavy metal reductions to achieve the emission standards.

© 2015 The Authors. Published by Elsevier Ltd. This is an open access article under the CC BY-NC-ND license (<http://creativecommons.org/licenses/by-nc-nd/4.0/>).

Peer-review under responsibility of Applied Energy Innovation Institute

Keywords: Solid wastes; CFB; NO_x; Heavy metal; Dioxin

1. Introduction

As one of the world's fastest developing countries, China has experienced a high growth rate in economic development and urbanization[1]. Waste treatment of the steady rising Municipal Solid Waste

* Corresponding author. Tel.: +44 (0)141 3304327

E-mail address: jun.li@glasgow.ac.uk.

(MSW) generation becomes a challenge in China. Currently, there are about 660 cities in China that produce about 190 million tonnes of solid waste annually, accounting for 29% of the world's MSW each year[2]. Most Chinese MSW usually includes residential, institutional, commercial, street cleaning and non-process waste from industries[2].

Fluidized bed combustion has been shown to be a versatile technology, capable of burning practically any waste combination with low emissions [3, 4]. Compared to conventional combustion, the fluidized bed combustors can efficiently process a wide variety of fuels, offering a relatively uniform temperature and benefiting a low NO_x and dioxin emissions[3, 5].

To efficiently and environment friendly combust the domestic garbage, sludge, and swill waste fuels, five different fuels are prepared by mixing the waste fuels together with coal, and grass biomass at different mixing ratios, and finally those fuels were combusted in a circulating fluidized bed (CFB) reactor. The emission performances of NO_x, dioxin, and heavy metal during the combustion tests are studied and discussed.

2. Fuel and test reactor

2.1. Fuel

5 fuel materials (Fuel-A, Fuel-B, Fuel-C, Fuel-D, and Fuel-E) are prepared by mixing of swill, domestic garbage, sludge, coal, and grass with varying mixture percentage, as shown in Table 1. The sludge is received as dry basis originally. The domestic garbage material is received without fermentation treatment. After mixture of raw materials, all 5 fuel materials are dried in air atmosphere for 15-20 days, their proximate and ultimate properties are presented in Table 2.

Table 1. Fuel preparing

	Sludge (%)	Domestic garbage (%)	Swill (%)	Coal (%)	Grass (%)	Others (%)
Fuel-A	40	20	0	10	20	10
Fuel-B	40	0	0	10	40	10
Fuel-C	30	40	10	10	0	10
Fuel-D	30	20	10	10	20	10
Fuel-E	40	40	10	0	0	10

Table 2. Proximate and ultimate analysis of prepared 5 fuels

	Proximate (% , as received basis)				Ultimate (% , dry basis)					LHV (kJ/kg)
	Moisture	VM	ASH	FC	C _d	H _d	O _d	N _d	S _d	
Fuel-A	5.65	41.83	33.81	19.22	40.49	3.95	14.08	4.03	0.72	14913
Fuel-B	6.84	46.55	30.44	16.5	40.17	4.47	16.56	4.03	0.78	14657
Fuel-C	3.48	44.09	36.17	16.69	38.9	3.97	14.08	3.3	0.64	14657
Fuel-D	5.4	44.46	31.71	18.88	41.4	4.2	15.45	3.23	0.65	15318
Fuel-E	5.33	47.65	35.84	11.45	36.66	4.15	15.89	3.38	0.6	13282

2.2. Test reactor

The test reactor is a 1.5 m long circulating fluidized bed (CFB) reactor with inner diameter of 114 mm for combustion characterizations of waste fuels. The scheme of CFB reactor is shown in Figure 1; electrically heated modules are installed for either ignition or furnace temperature control. A screw feeder is used to inject solid fuel into furnace from furnace bottom with a maximum capacity of 3 kg/h. 6 thermocouples are equally located along the furnace height to record the temperatures of the flue gas. Air is heated up to 350 °C for efficiency combustion. The excess air ratios for combustion processes of Fuel-A, Fuel-B, Fuel-C, Fuel-D, and Fuel-E are 1.72, 1.56, 1.56, 1.63, and 1.57, respectively.

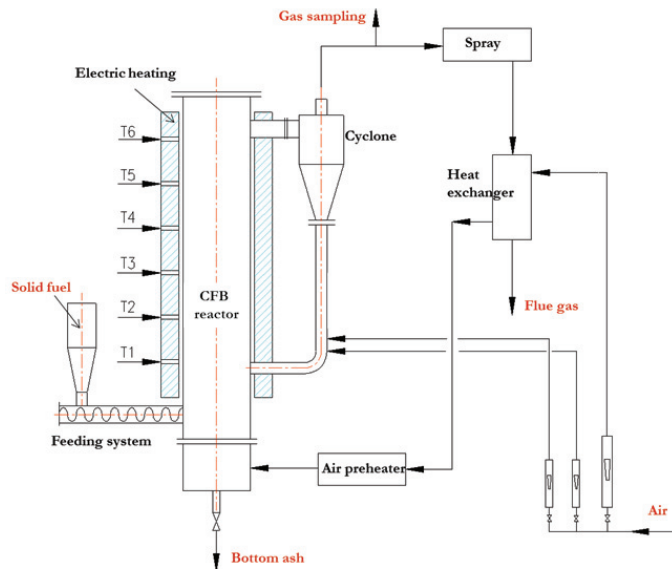


Fig. 1. CFB reactor scheme

The dioxin and heavy metal emissions during the studied combustion tests have been investigated. It is assumed that the dioxin (or heavy metal) contents in fly ash is converted as the dioxin (or heavy metal) contents in flue gas, since the fly ash normally remains in flue gas as the main pollutant emissions source. The conversions of emission source is simply calculated by below equation:

$$c_{1,i} = \frac{Ash}{2 V_{fg}} c_{0,i} \quad (1)$$

where, $c_{1,i}$ is the contents in flue gas, mg/Nm³, i refers to either heavy metal or dioxin; $c_{0,i}$ is the initial contents in solid fuel, mg/kg; Ash is the ash content in solid fuel in as received basis, %; V_{fg} is the volume of flue gas per kilogram solid fuel, Nm³/kg.

3. Results and discussions

3.1. Temperature profile

Figure 2 shows the temperature profiles along the furnace height when combusting studied 5 fuel materials. It clearly shows that a uniform temperature of 850 °C can be reached in the combustion

chamber for all studied fuels, which are slightly sensitive to the fuels. And the temperature at furnace exit is approximately 780 °C. The temperature is typical operating temperature for CFB reactor, which could effectively ensure a better combustion performances of the waste fuels, benefiting the thermal processes of sludge and domestic garbage and thus realizing the purpose of waste-to-fuel.

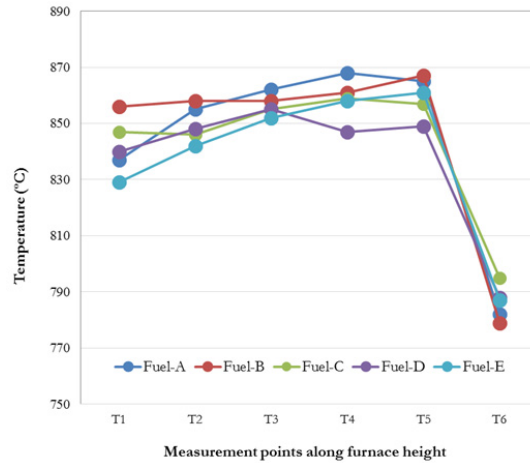


Fig. 2. Temperature profiles along furnace height of different fuels

3.2. NO_x emissions

As mentioned above, the varying ratios of swill, domestic garbage, and sludge with coal and grass could achieve an expected combustion condition with a stable temperature. NO_x, as one of typical emission during solid waste combustions, was investigated, the results are presented in Table 3, it should be noted that the NO_x emissions in Table 3 refer to a basis of 11% O₂ in flue gas. According to the pollution control standard for hazardous wastes incineration (GB 18484-2001) in China, the emission limit for NO_x is 500 mg/m³ at 11% O₂ in flue gas. Obviously, NO_x emissions from Fuel-A and Fuel-B combustions are over the emission limits, while that of the other solid waste mixtures combustion satisfy the limits. This could be explained by considering a relative high furnace temperatures for Fuel-A and Fuel-B combustion when compared to other fuel mixture combustions, as shown in Figure 2, which means that the NO_x emissions could be controlled and reduced by modifying solid waste mixture ratios.

3.3. Dioxin emissions

Solid waste combustion have traditionally been pointed out as one of the most important sources of toxic emissions, not only dioxins but also heavy metals[6]. Generally, the breakdown of dioxin requires a sufficiently high temperature to trigger thermal breakdown of the strong molecular bonds. However, small pieces of fly ash may be thick, and too brief an exposure to high temperature may only degrade dioxin on the surface of the ash, and thus a sufficient residence time is required to ensure heating completely through the thickness of the fly ash. In this work, the dioxin emissions are also investigated. The dioxin contents have been detected in fly ash, and were finally converted as the dioxin in flue gases based on Eq.(1), and the dioxin emissions data are shown in Table 3. It clearly shows the dioxin emissions for all studied fuel combustions satisfied not only the China standard and also EU standard. Accordingly, the mixture ratios of solid waste fuels are reasonable for dioxin reduction, because the high furnace temperature could be maintained to protect the dioxin formations.

Table 3. NO_x and dioxin emissions from different fuel combustion

	NO _x @ 11% O ₂ (mg/m ³)	Dioxin contents in Flue gas @ 11% O ₂ (ng TEQ/Nm ³)
Fuel-A	626.8	0.03~0.06
Fuel-B	635.0	~0.09
Fuel-C	361.1	0.05~0.08
Fuel-D	475.3	0.03~0.06
Fuel-E	475.3	0.02~0.06
CN standard ^[7]	500	0.5
EU standard ^[6]	/	0.1

3.4. Heavy metal emissions

Heavy metals are environment forever[8]. This work also examined the heavy metal emissions during those mixed waste fuels combustions. From Table 4, apart of the arsenic and nickel components emissions, the emissions of mercury, lead, and the combinations of chromium, tin, antimony, copper and manganese components all exceed the pollution control standard for hazardous wastes incineration. Those unexpected heavy metals emissions requires further technology application during the studied waste fuel combustions.

Table 4. Average heavy metal contents in flue gas (mg/Nm³, @11% O₂)

	Hg	Pb	As+Ni	Cr+Sn+Sb+Cu+Mn
Fuel-A	0.14	1.01	0.67	13.11
Fuel-B	0.16	1.13	0.69	11.60
Fuel-C	0.28	1.97	1.01	20.00
Fuel-D	0.16	1.13	0.64	21.15
Fuel-E	0.26	1.85	0.82	16.06
CN standard ^[7]	0.1	1	1	4

4. Conclusions

To efficiently and environment friendly combust the domestic garbage, sludge, and swill waste fuels, five different fuels are prepared by mixing the waste fuels together with coal, and grass biomass at different mixing ratios, and finally those fuels were combusted in a circulating fluidized bed (CFB) reactor. The emission performances of NO_x, dioxin, and heavy metal during the combustion tests are studied. The results showed that the furnace temperature can be reached at approximately 850 °C when combusting all studied mixed fuels, which could effectively improve the combustion performances of the waste fuels, benefiting the thermal processes of sludge and domestic garbage and thus realizing the purpose of waste-to-fuel. In addition, the dioxin emissions are much lower than the emission standards, and NO_x emissions could be reduced significantly by adjusting the ratio of waste fuels. However, the

emissions of mercury, lead, and the combinations of chromium, tin, antimony, copper and manganese components all exceeded the pollution control standard for hazardous wastes incineration, a further technology is required for heavy metal reductions to achieve the emission standards.

Acknowledgement

The authors would like to thank the financial support by the National Natural Science Foundation of China (51106051, 51206044, and 50976032) and National Key Technology R&D Program (2012BAA09B01)

References

- [1] C. M. Nickolas J. THEMELIS, "MUNICIPAL SOLID WASTE MANAGEMENT AND WASTE-TO-ENERGY IN THE UNITED STATES, CHINA AND JAPAN," presented at the 2nd International Academic Symposium on Enhanced Landfill Mining, Houthalen-Helchteren, 2013.
- [2] D. Q. Zhang, S. K. Tan, and R. M. Gersberg, "Municipal solid waste management in China: Status, problems and challenges," *Journal of Environmental Management*, vol. 91, pp. 1623-1633, 8// 2010.
- [3] E. J. Anthony, "Fluidized bed combustion of alternative solid fuels; status, successes and problems of the technology," *Progress in Energy and Combustion Science*, vol. 21, pp. 239-268, // 1995.
- [4] S. Patumsawad and K. R. Cliffe, "Experimental study on fluidised bed combustion of high moisture municipal solid waste," *Energy Conversion and Management*, vol. 43, pp. 2329-2340, 11// 2002.
- [5] S. C. Saxena and C. K. Jotshi, "Fluidized-bed incineration of waste materials," *Progress in Energy and Combustion Science*, vol. 20, pp. 281-324, // 1994.
- [6] A. Nzihou, N. J. Themelis, M. Kemiha, and Y. Benhamou, "Dioxin emissions from municipal solid waste incinerators (MSWIs) in France," *Waste Management*, vol. 32, pp. 2273-2277, 12// 2012.
- [7] "Pollution control standard for hazardous wastes incineration (GB 18484-2001)," 2001.
- [8] http://www.stefanomontanari.net/sito/images/pdf/heavy_metals.pdf.



Biography

Mr. HanFei Zhang is currently working in mechanical design department of State Nuclear Electric Power Planning Design & Research Institute, China. His research interests are in Combustion & Gasification of Biomass, Coal, and Solid Waste.