



Strathprints Institutional Repository

Panni, Omer and West, Graeme and Catterson, Victoria and McArthur, Stephen and Shi, Dongfeng and Mogridge, Ieuan (2016) Implementation of a Bayesian linear regression framework for nuclear prognostics. In: Third European Conference of the Prognostics and Health Management Society 2016, 2016-07-05 - 2016-07-08. (In Press) ,

This version is available at <http://strathprints.strath.ac.uk/56800/>

Strathprints is designed to allow users to access the research output of the University of Strathclyde. Unless otherwise explicitly stated on the manuscript, Copyright © and Moral Rights for the papers on this site are retained by the individual authors and/or other copyright owners. Please check the manuscript for details of any other licences that may have been applied. You may not engage in further distribution of the material for any profitmaking activities or any commercial gain. You may freely distribute both the url (<http://strathprints.strath.ac.uk/>) and the content of this paper for research or private study, educational, or not-for-profit purposes without prior permission or charge.

Any correspondence concerning this service should be sent to Strathprints administrator: strathprints@strath.ac.uk

Implementation Of A Bayesian Linear Regression Framework For Nuclear Prognostics

Omer Panni¹, Graeme West², Victoria Catterson³, Stephen McArthur⁴, Dongfeng Shi⁵ and Ieuan Mogridge⁶

^{1,2,3,4} *University of Strathclyde, Glasgow, G1 1XW, United Kingdom*

omer.panni@strath.ac.uk

graeme.west@strath.ac.uk

v.m.catterson@strath.ac.uk

s.mcarthur@strath.ac.uk

⁵ *Rolls-Royce Control and Data Services Ltd, Derby, DE24 8BJ, United Kingdom*

dongfeng.shi@controlsdata.com

⁶ *EDF Energy, Gloucester, GL4 3RS, United Kingdom*

ieuan.mogridge@edf-energy.com

ABSTRACT

Steam turbines are an important asset of nuclear power plants (NPPs), and are required to operate reliably and efficiently. Unplanned outages have a significant impact on the ability of the plant to generate electricity. Therefore, predictive and proactive maintenance which can avoid unplanned outages has the potential to reduce operating costs while increasing the reliability and availability of the plant.

A case study from the data of an operational steam turbine of a NPP in the UK was used for the implementation of a Bayesian Linear Regression (BLR) framework. An appropriate model for the deterioration under study is selected. The BLR framework was applied as a prognostic technique in order to calculate the remaining useful life (RUL). Results show that the accuracy of the technique varies due to the nature of the data that is utilised to estimate the model parameters.

1. INTRODUCTION

Steam turbines are expensive and an important part of a nuclear power plant. The consequences of technical failure could compromise the safe and economic operation of the plant. An effective condition monitoring system ensures that the plant is operating in acceptable condition by providing accurate information about the current health of the plant. This work

investigates the use of prognostic techniques to predict future health of steam turbine assets.

The main aim of prognostics is to estimate the remaining useful life of the asset and provide decision support for maintenance when the asset is in service. Prognostics have been successfully applied to a wide range of maintenance and reliability applications in the industries of aerospace (Zaidan et al., 2013; Qiancheng et al., 2011; Saha et al., 2009), power networks (Catterson et al., 2016; Rudd et al., 2011), defence (Hess & Fila, 2002), consumer electronics (Gu et al., 2009; Zheng et al., 2014) and nuclear generation (Di Maio et al., 2011; Coble et al., 2010). The main advantages of prognostics are reduction in unplanned outages, increased reliability and availability, and reduced life-cycle costs (Sun, Zeng, Kang, & Pecht, 2012).

There are several prognostics techniques that have been implemented to estimate the remaining useful life of pumps, electric motors and turbines (Kan, Tan, & Mathew, 2015). Different variants of data driven Bayesian regression frameworks were implemented by (Zaidan et al., 2013) and (Gebraeel et al., 2005) to estimate the RUL of a gas turbine engine and bearings respectively. The main motivation for developing a Bayesian Linear Regression (BLR) framework in this work was to utilise engineering judgement in combination with a single instance of the case study data (see Section 2).

This paper investigates the application of BLR to a particular case study of degradation within a nuclear steam turbine. The focus is on a slow progressing fault resulting in increased shaft vibrations introduced by an imbalance in the thermal ex-

Omer Panni et al. This is an open-access article distributed under the terms of the Creative Commons Attribution 3.0 United States License, which permits unrestricted use, distribution, and reproduction in any medium, provided the original author and source are credited.

pansion between the turbine casing and the supports. When investigating the fault, the broad engineering judgement was that this fault manifested itself as a linear relationship and hence the choice of a linear model. Subsequent analysis has shown this assumption to be incorrect over the full span of the degradation and an important outcome of this work is to recommend a more representative model of degradation be chosen. However, this case study is still useful for explaining the development and deployment of prognostic techniques within a nuclear environment.

2. APPLICATION REQUIREMENTS

This paper focuses on a particular case study fault within the High Pressure (HP) steam turbine of a nuclear power plant in the UK. Figure 1 shows the general representation of the arrangement for handling thermal expansion in a steam turbine. The outer casing palms of the HP cylinder lean on the transversal keys attached to the bearing pedestals. The transversal keys guide the lateral thermal expansion of the casing. The bottom of the bearing pedestals is attached to the longitudinal keys allowing the bearing pedestal to slide on the foundation frame when the metal temperature of the turbine varies during the start-up (runup) and stop (rundown) operating conditions (Leyzerovich, 2008).

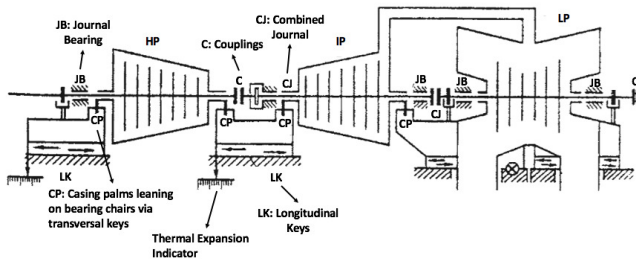


Figure 1. General Steam Turbine Arrangement (Leyzerovich, 2008)

The entire weight of the steam turbine rests on the bearing pedestals, as a result of which substantial frictional forces are produced which hinder the axial movement of the bearing pedestal along the foundation frame. As a result, this can manifest in an increased displacement of the HP shaft, and in an increased level of vibration within the bearings. The fault is slow and progressive, in that without intervention the level of displacement increases over time which can result in distortion of the casing, increased vibration, damage to the turbine bearings and couplings etc. However, if the turbine is taken offline or stopped and the casing cools sufficiently, the displacement may reduce as well.

This fault was observed within one turbine, fully analysed by the engineers, and corrective action taken by changing the interface between the pedestal and foundation from injected grease (which was inserted at first as a remedial solution to re-

duce friction) to a self-lubricating graphite-impregnated material. However, there is a desire to develop an automated system that can detect the presence of this specific fault, and predict the time remaining until the displacement reaches a level requiring intervention. The intervention threshold is derived from ISO 7919-2:2009 (BSI, 2009), an industry standard which defines a warning threshold at $82.5\mu m$ of displacement. Therefore, the aim of the prognostic system is to predict the RUL until displacement reaches $82.5\mu m$.

Since there is only a single case study instance of this fault captured, the approach to developing the prognostic system must utilise engineering judgement in combination with the case study data. Expertise from the plant engineer suggested that casing expansion was expected to increase linearly over time without intervention. This broadly matched the pattern seen within the case study data (see Section 3.1).

Another application requirement is that RUL prediction errors should tend to be early rather than late. If the prediction is late (ie failure occurs earlier than predicted), maintenance may not be scheduled in time to prevent the failure. On the other hand, if the prediction is early (ie failure occurs later than predicted), maintenance may be scheduled earlier than needed, leading to more interventions over time with associated higher costs and downtime. While the prediction should be as accurate as possible, the consequences of a late prediction are more significant than those of an early prediction, and therefore early predictions are preferred.

BLR was selected as a technique which can meet these criteria. The main advantage of using BLR is that it estimates RUL in the form of a probability distribution to avoid the risk of early failure. BLR updates the degradation model using the degradation history and current degradation data, as a result of which uncertainty in degradation model parameters is reduced.

3. DATA ANALYSIS

Data was captured from the turbine from various operational states, including online, run down, and run up conditions. For a typical day, data is usually recorded in a single file. However, during fault conditions, the data logging system can record multiple files within one day by changing the data logging frequency. The dataset studied here consisted of 6685 files, containing measurement parameters such as bearing velocity, shaft displacement, and generated power. The data was then segregated based on the operational states.

For data analysis, online data was selected as this was the largest dataset and it is anticipated that when operating in online mode, the machinery response should be fairly consistent and any unusual behaviour and degradation should be easier to identify. Mean values for each parameter in each file were calculated to allow this large volume of data to be

summarised. In other words, each parameter in each file was represented by one value. A window of the online profile of mean power is shown in Figure 2.

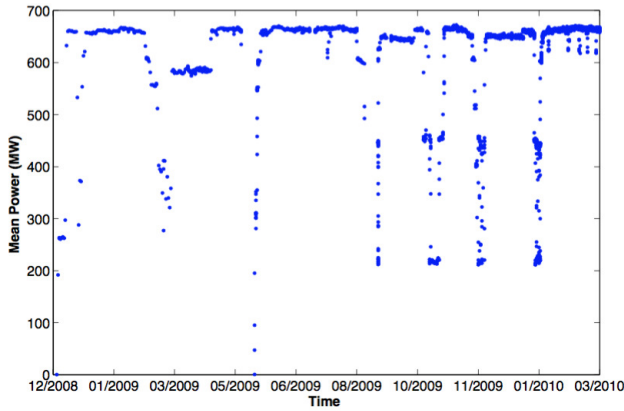


Figure 2. Mean Online Power

Figure 2 shows the variation in mean power across a period of approximately 15 months. The power fluctuates according to the operational state of the turbine. Most of the time it operates at full power, 660 MW approx. During refuelling outages the power is lowered to 70% of full power then dropped to 30% while fuel assemblies are exchanged. The data relating to refuelling events was removed, as changes in power were clearly seen to influence vibration data, and therefore made it difficult to identify any pattern visually by considering this full set of data across all power levels. From here on, this dataset is referred as the Full Power dataset.

3.1. High Pressure (HP) Turbine Displacement

Through visual analysis of the Full Power dataset, three patterns in HP displacement that are labelled with region numbers in Figure 3 were observed. In region 1, there is very low displacement and after this region a step change is observed which is due to a change in operational settings. In region 2, displacement tends to remain relatively steady with fluctuations towards the start. In region 3, a ramp up in displacement can be observed. This behaviour has been investigated by the diagnostic engineer, and is attributed to thermal expansion of the casing of the steam turbine.

The gaps in the HP Displacement data are due to the removal of the outages/stoppage durations, online data captured below full power, and other vibration data captured during the state of run up.

3.2. Change Point Analysis

Change point analysis is used to find the location of points within a data sequence where there are significant changes. The location of the change point is the maximum or minimum point in a vector of the sum of differences between each

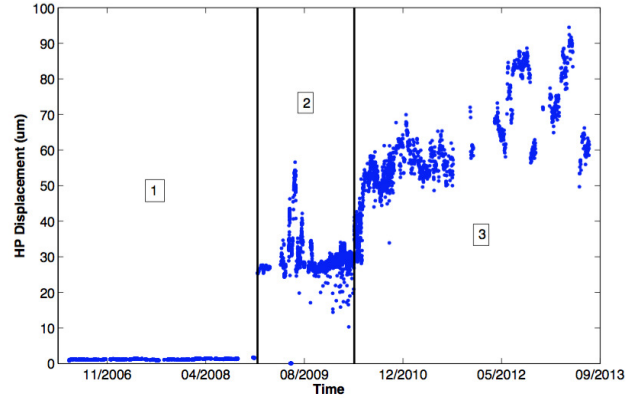


Figure 3. HP Displacement

data point and the mean of all data points. Additional change points can be determined within a region by repeating the process (Killick & Eckley, 2014).

Change point analysis was applied to the HP displacement to identify points of deviation. This technique identifies change points in iterations. For HP displacement, two iterations were performed based on the observation of the online full power HP displacement data. In the first iteration, the cumulative sum of the difference of the online full power HP displacement data from its mean was calculated, which resulted in the change point 1 as shown in Figure 4. This change point is the lowest cumulative sum of the difference between the data points and their mean.

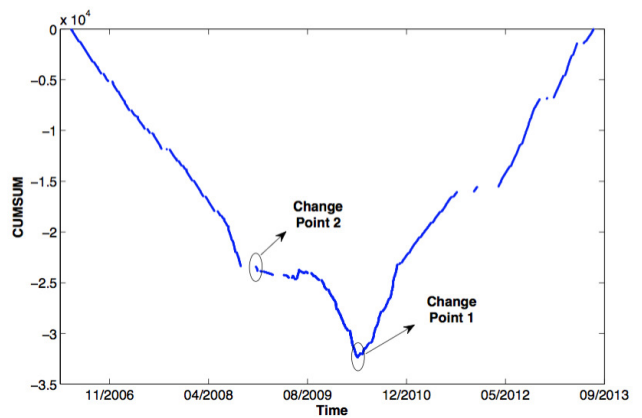


Figure 4. Cumulative Sum Of HP Displacement

In iteration 2, the lowest cumulative sum of the difference between data points before the change point 1 and their mean is calculated. The lowest cumulative sum in iteration 2 is change point 2. The first change point is used to isolate the online full power HP displacement data of region 3 as shown in Figure 4. This dataset forms the HP ramp case study, which is shown in Figure 5.

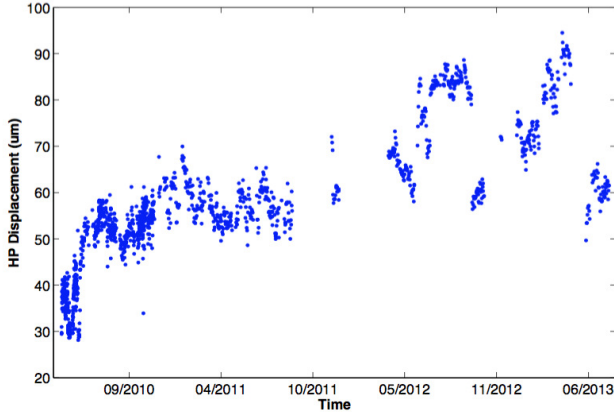


Figure 5. HP Ramp Case Study

4. BAYESIAN LINEAR REGRESSION

Based on the broad engineering judgement, the fault manifested itself as a linear relationship and therefore, first order polynomial is selected as a degradation model (see Section 2). A first order polynomial function is a straight line which has two parameters: the slope and the y-intercept which can be expressed as $w = \begin{bmatrix} w_0 \\ w_1 \end{bmatrix}$, where w_0 is the intercept and w_1 is the slope. Bayesian Linear Regression (BLR) starts with no knowledge about w , therefore, without any knowledge of a straight line representing the degradation trend. If predictions of RUL are made at this stage, the output will be random. This belief about w before any data is observed can be represented as a probability distribution. This probability distribution is known as a prior or prior probability distribution. As data is observed (i.e. measurements of HP Displacement are made), the likelihood of the data can be calculated as a conditional probability of the data given the straight line parameters. BLR uses observed data to update the prior probability of w to form a posterior distribution of w . The posterior distribution narrows down the set of likely straight lines which best fit the degradation trend. After enough data has been observed, the uncertainty in w (or the slope and the y-intercept) has been reduced so that relatively few straight lines are candidates for the “true” degradation trend. At this point, predictions of the RUL cover a fairly narrow range of values, since all candidate straight lines reach the threshold around the same time.

Bayesian Linear Regression (BLR) uses Bayes theorem to convert the prior probability of the model parameters (the slope and the y-intercept) into posterior probability by incorporating the evidence provided by the data in the form of the likelihood function. The Bayes theorem in generalised form (Bishop, 2006) is expressed as:

$$p(w|D) = \frac{p(D|w)p(w)}{p(D)} \quad (1)$$

where $p(w|D)$ is the posterior probability distribution, $p(D|w)$ is the likelihood function, $p(w)$ is the prior probability distribution and $p(D)$ is the probability of the data. Alternatively according to (Gelman et al., 2004), given the above definition of the likelihood function, Bayes theorem can be expressed as:

$$\text{posterior} \propto \text{likelihood} \times \text{prior} \quad (2)$$

4.1. Model Setup

According to (Murphy, 2012), before the application of BLR, degradation is modelled as:

$$y = \phi(x)^T w + \epsilon \quad (3)$$

where y is the degradation signal (HP displacement in our case), ϵ is random error, w is vector of weights (the slope and the y-intercept) and $\phi(x)^T$ is first order polynomial basis function with x denoting time. The first order polynomial basis function in reduced form can be represented as: $\phi(x)^T w = \begin{bmatrix} 1 & x^1 \end{bmatrix} \begin{bmatrix} w_0 \\ w_1 \end{bmatrix}$.

4.2. Bayesian Linear Regression Framework

As shown in Figure 6, there are six parts in the Bayesian Linear Regression (BLR) framework. For the first three parts of the BLR Framework, Bayes theorem is applied to update the prior probability distribution of the model parameters to form a posterior distribution with the likelihood of the observation data. Once the model parameters w (or the slope and the y-intercept) are updated, they are used to get the predicted signal over the desired time as shown by “predictive distribution” in Figure 6. In the final step of Figure 6, the warning threshold breach time distribution is obtained to estimate warning threshold breach time T , in order to calculate the remaining useful life.

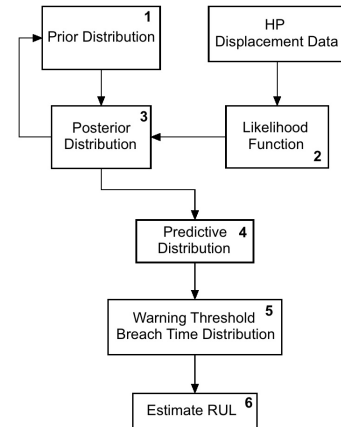


Figure 6. BLR Framework

The following subsections describe each step in more detail.

4.2.1. Prior Distribution

The weights are modelled as a multivariate normal distribution to capture the variable dependency. (In the case of a linear model there are two dimensions to the distribution, one each for w_0 and w_1). Therefore, the prior distribution can be specified as:

$$p(w) = \mathcal{N}(w|m_0, S_0) \quad (4)$$

For simplicity, the prior is modelled as a zero mean Gaussian distribution so that $m_0 = 0$ and $S_0 = \alpha^{-1}I$ with $\alpha \rightarrow 0$. Therefore, when no data is observed the posterior distribution is the same as the prior distribution. Also, when data points arrive sequentially, the posterior distribution acts as a prior distribution for the subsequent data point. In zero mean Gaussian distribution form, the prior can be expressed as:

$$p(w|\alpha) = \mathcal{N}(w|0, \alpha^{-1}I) \quad (5)$$

The value of the parameter α selected is 2. Several initial values of the parameter α were tested and it made little to no difference to the output as its effect tends to diminish very quickly.

4.2.2. Likelihood

The likelihood is the conditional probability of the observed data x and the model parameters (w, β) , and is given by:

$$p(y|x, w, \beta) = \mathcal{N}(\phi(x)^T w, \beta^{-1}) \quad (6)$$

where β is called the noise precision parameter. Similar testing was performed for parameter β as for α , and the value for parameter β selected is 25.

4.2.3. Posterior Distribution

According to Equation (5), the posterior distribution is proportional to the product of the likelihood function and the prior distribution. Mathematically it can be expressed as:

$$p(w|x, y, \alpha, \beta) \propto p(y|x, w, \beta)p(w|\alpha) \quad (7)$$

Due to the fact that the prior has been chosen to be a conjugate normal distribution, the posterior distribution is also normal and therefore can be expressed as:

$$p(w|x, y, \alpha, \beta) = \mathcal{N}(y|m(x), s^2(x)) \quad (8)$$

where $s^2(x)^{-1} = S_0^{-1} + \beta x^T x$ and $m(x) = s^2(x)(S_0^{-1}m_0 + \beta x^T y)$. Since the prior has been modelled as a zero mean Gaussian distribution, therefore, $s^2(x)^{-1} = \alpha I + \beta x^T x$ and $m(x) = \beta s^2(x)x^T y$. As mentioned earlier, due to the choice of prior, the posterior distribution acts as a prior distribution for the subsequent data point when data points arrive sequentially. The resulting posterior is also used to compute the pre-

dictive distribution.

4.2.4. Predictive Distribution

The posterior distribution results in update of the model parameters w , which can be used to make predictions of y at a given future point in time. Therefore, the predictive distribution is evaluated using the following equation:

$$p(y_{new}|y, \alpha, \beta) = \int p(y|x, w, \beta)p(w|x, y, \alpha, \beta) \quad (9)$$

This predictive distribution represents the predicted degradation signal y_{new} probabilistically. The predictive distribution can also be expressed as:

$$p(y_{new}|x, y, \alpha, \beta) = \mathcal{N}(y|m(x)^T x, \sigma_N^2(x)) \quad (10)$$

where $\sigma_N^2(x) = \frac{1}{\beta} + x^T s(x)x$. It should be noted that the predicted values of y_{new} correspond to a Normal distribution rather than one single value. This is fundamentally because of the uncertainty in the model parameters w : there is uncertainty in the slope of the linear trend w_1 and in the intercept w_0 . The distribution of y_{new} values is the result of combining predictions from all linear trends within the envelope of possible parameters. This is one of the key benefits of the BLR framework, i.e. that it can explicitly track the uncertainty in the linear model itself.

4.2.5. Warning Threshold Breach Time Distribution

As discussed in Section 2, the application places two requirements on the handling of the displacement threshold. First, the threshold itself is set to $82.5\mu m$, which is defined in ISO 7919-2:2009 as a warning limit. That means that when displacement breaches this threshold, y_{Thresh} , there is still time for the plant operator to intervene before more serious limits are reached.

Within the case study data, the point of threshold breach has been defined as the mean time of the first 20 data points to breach y_{Thresh} . This was chosen because a single data point may breach the threshold due to transient behaviour, but 20 data points represents a more consistent trend. This mean time of threshold breach is considered the true end-of-life point that the prognostic system should predict.

Secondly, early predictions are preferred over late predictions. In order to reduce the chance of late predictions, a Warning Threshold Breach Time Distribution is obtained by noting all possible predicted threshold breach times t . The predicted threshold breach time t is the predicted end-of-life point when the mean of the predictive distribution y_{new} reaches or exceeds the threshold y_{Thresh} . Together, all values of t give a distribution of predictions.

A final prediction, T , is chosen as the time two standard deviations below the mean of this distribution. If the mean of

breach times t was chosen as T , there would be an equal chance of early and late predictions. By selecting an earlier point, late predictions should be less likely.

4.2.6. Remaining Useful Life

RUL is the remaining time before the degradation signal crosses the threshold and can be calculated as:

$$RUL = T - x_t \quad (11)$$

where T is the warning threshold breach time and x_t is the current time or the time of the prognosis.

5. RESULTS & DISCUSSION

The HP displacement case study was used to assess the performance of the developed algorithm. Figure 7 and Figure 8 show RUL estimates when 300 and 400 data points of the HP displacement case study are used respectively. It can be seen that the implemented algorithm estimates the future health of the steam turbine using the case study data (blue dots).

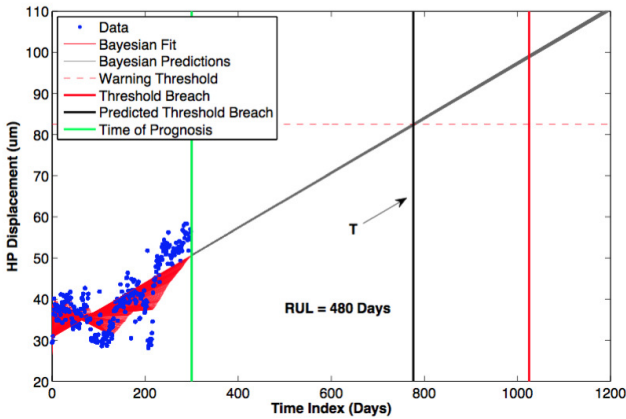


Figure 7. RUL Predictions: 300 Data Points

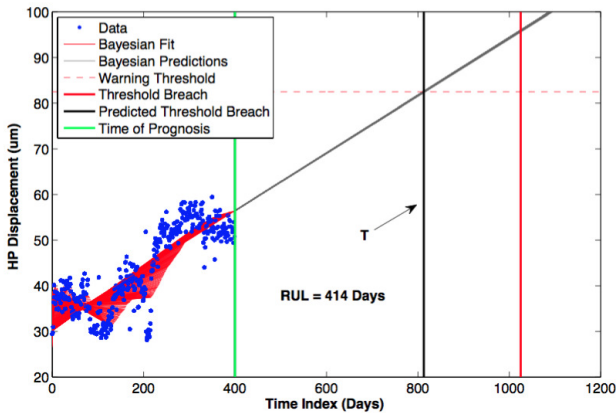


Figure 8. RUL Predictions: 400 Data Points

The distributions of warning threshold breach times t for the batch of 300 and 400 data points are shown in Figure 9 and Figure 10.

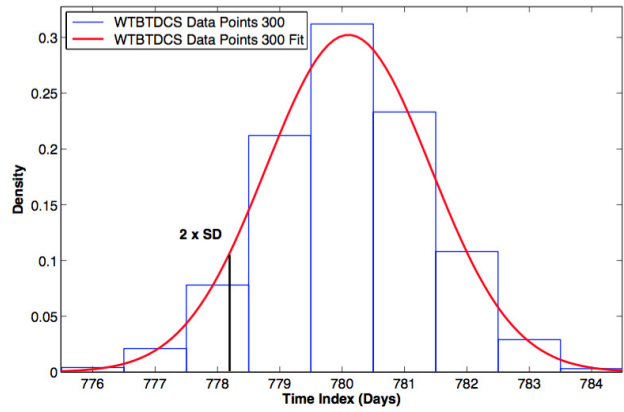


Figure 9. Warning Threshold Breach Time Predictions: 300 Data Points

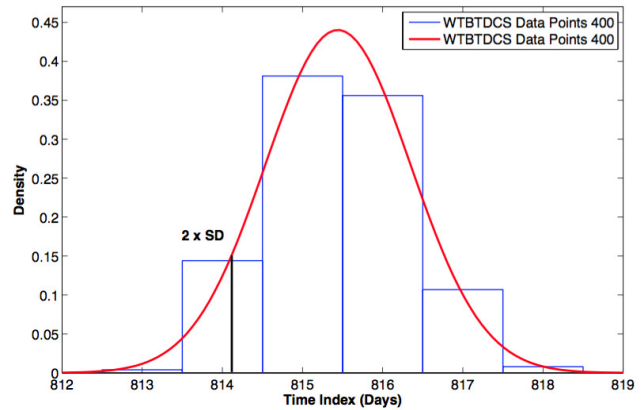


Figure 10. Warning Threshold Breach Time Predictions: 400 Data Points

As described in Section 4.2.5, a value of two standard deviations from the mean was chosen as the warning threshold breach time T .

The comparison of true RUL and predicted RUL is given in Table 1. The results show that when 300, 350, 400 and 450 data points of the HP displacement case study are fed into the BLR framework, early prediction of warning threshold breach is observed which is due to increase in HP displacement data just before the time of prognosis (represented as solid green lines in Figure 7 and Figure 8). It should also be noted that due to the slow and progressive nature of the fault, large values of RUL predictions are observed.

As mentioned above, the BLR algorithm can provide predictions of time remaining until displacement breaches the warning threshold. However, there are two crucial aspects to con-

Table 1. Early Prediction: Comparison of True RUL and Predicted RUL

Set Of Data Points	True RUL (Days)	Predicted RUL (Days)	Prediction (Early or Late)
300	726	478	248 Early
350	676	396	280 Early
400	626	414	212 Early
450	576	502	74 Early

sider further.

First, the errors in Table 1 are generally large. If the error is over 200 days, there is a significant amount of remaining life that may be lost through early scheduling of maintenance. While early predictions are preferred, overall accuracy is also important.

Secondly, and more critically, the performance of the algorithm tends to vary with different amounts of input data. For instance, when batches of 500 and 900 datapoints are used, the predictions are late as shown in Figures 11 and 12.

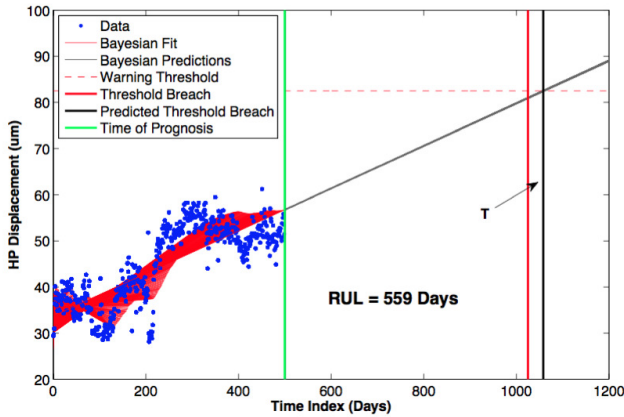


Figure 11. Late RUL Predictions: 500 Data Points

The comparison of true RUL and predicted RUL is given in Table 2. The results show that the technique does generate late predictions. When it may be expected that performance improves with more data, in fact the predictions become later and less accurate when derived from more data.

Table 2. Late Prediction: Comparison of True RUL and Predicted RUL

Set Of Data Points	True RUL (Days)	Predicted RUL (Days)	Prediction (Early or Late)
250	776	941	165 Late
500	526	559	33 Late
750	276	575	299 Late
900	126	745	619 Late

Reasons for this performance were considered in detail. The

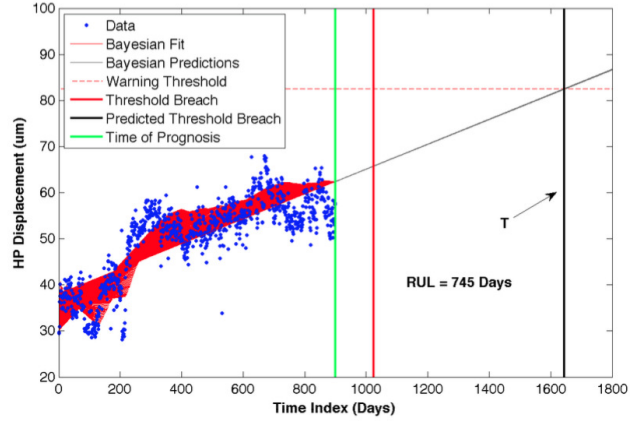


Figure 12. Late RUL Predictions: 900 Data Points

original case study data was re-examined alongside the BLR performance. It is clear that the technique is performing correctly, as the predicted linear trend updates as new data is added. However, while the case study exhibits an overall linear trend, the short term behaviour captures some additional process which causes deviations around the trend line. The BLR predictions are highly dependent on the trend of the data at the prediction time x_t , and the technique has difficulty in separating the long term and short term behaviour.

This suggests that a more appropriate technique for prognostics of this case study would better handle the non-linearities in the data, and more consistently produce only early predictions. As mentioned in Section 3, the raw data was transformed into the Full Power dataset by removing the refuelling data, outages/stoppage durations, online data captured below full power, and other vibration data captured during the state of run up which will almost certainly affect the degradation. The turbine will have the chance to cool down and therefore, a temporary reduction in vibration levels would be seen. In addition, the fault was recognised during the case study time period and remedial action was taken which may have introduced non-linearities into the process. While BLR is able to make predictions when this fault type occurs, specifics of the application domain mean that an alternative technique must be considered.

6. CONCLUSION & FUTURE WORK

In this paper, a BLR framework is presented as a prognostics technique. The first order polynomial function was selected as a degradation model based on broad engineering judgement of the fault manifesting itself as a linear relationship. The model parameters are updated by incorporating the evidence provided by the data in the form of the likelihood. Updated model parameters are then used to get the predictions of HP displacement.

As early predictions are preferred to late predictions, the thresh-

old breach time T was chosen to be at the earlier end of the range of all possible predicted threshold breaches t . A value of two standard deviations from the mean was chosen as a balance between avoiding late warning while maximising asset life.

The results of the implementation show that the technique is performing correctly. However, the short term behaviour causes deviations around the linear trend line. The BLR technique currently suffers from its inability to separate the long term and short term behaviour.

Future work will involve using alternative techniques for prognostics of this case study in order to better handle the non-linearities in the data, and more consistently produce only early predictions.

ACKNOWLEDGMENT

The authors would like to thank Rolls-Royce PLC and EDF Energy for their support and direction.

REFERENCES

- Bishop, C. M. (2006). *Pattern Recognition and Machine Learning*. Springer.
- BSI. (2009). *BS ISO 7919-2: Mechanical Vibration - Evaluation Of Machine Vibration By Measurements On Rotating Shafts* (Tech. Rep.). British Standards Institute.
- Catterson, V. M., Melone, J., & Gracia, M. S. (2016). Prognostics Of Transformer Paper Insulation Using Statistical Particle Filtering Of Online Data. *IEEE Electrical Insulation*.
- Coble, J., Humberstone, M., & Hines, J. W. (2010). *Adaptive Monitoring, Fault Detection And Diagnostics, And Prognostics System for The IRIS Nuclear Plant* (Tech. Rep.). DTIC Document.
- Di Maio, F., Ng, S. S., Tsui, K.-L., & Zio, E. (2011). Naïve Bayesian classifier for on-line remaining useful life prediction of degrading bearings. In *MMR2011* (pp. 1–14).
- Gebraeel, N. Z., Lawley, M. A., Li, R., & Ryan, J. K. (2005). Residual-Life Distributions From Component Degradation Signals: A Bayesian Approach. *IIE Transactions*, 37(6), 543–557.
- Gelman, A., Carlin, J. B., Stern, H. S., & Rubin, D. B. (2004). *Bayesian Data Analysis* (2nd ed.). Boca Raton, Florida.
- Gu, J., Barker, D., & Pecht, M. (2009). Health Monitoring And Prognostics Of Electronics Subject To Vibration Load Conditions. *IEEE Sensors Journal*, 9(11), 1479–1485.
- Hess, A., & Fila, L. (2002). The Joint Strike Fighter (JSF) PHM Concept: Potential Impact On Aging Aircraft Problems. In (p. 3021 - 3026). *IEEE Aerospace Conference*.
- Kan, M. S., Tan, A. C., & Mathew, J. (2015). A Review On Prognostic Techniques For Non-stationary and Non-linear Rotating Systems. *Mechanical Systems and Signal Processing*, 62–63, 1–20.
- Killick, R., & Eckley, I. (2014). Changepoint: An R Package For Changepoint Analysis. *Journal of Statistical Software*, 58(3), 1–19.
- Leyzerovich, A. S. (2008). *Steam Turbines for Modern Fossil-Fuel Power Plants*. Georgia, USA: The Fairmont Press, Inc.
- Murphy, K. P. (2012). *Machine Learning: A Probabilistic Perspective*. Cambridge, MA: The MIT Press.
- Qiancheng, W., Shunong, Z., & Rui, K. (2011). Research Of Small Samples Avionics Prognostics Based On Support Vector Machine. In *Prognostics and System Health Management Conference, Shenzhen, China* (pp. 1–5).
- Rudd, S., Catterson, V. M., McArthur, S., & Johnstone, C. (2011). Circuit Breaker Prognostics Using SF6 Circuit Breaker Prognostics Using SF6 Data. *IEEE Power and Energy Society General Meeting*.
- Saha, B., Celaya, J. R., Goebel, K., & Wysocki, P. F. (2009). Towards Prognostics For Electronics Components. In *IEEE Aerospace Conference, Montana, USA* (p. 1-7).
- Sun, B., Zeng, S., Kang, R., & Pecht, M. (2012). Benefits and Challenges of System Prognostics. *IEEE Transactions on Reliability*, 61(2), 323–335.
- Zaidan, M., Mills, A., & Harrison, R. (2013). Bayesian framework for aerospace gas turbine engine prognostics. In *IEEE Aerospace Conference, Montana, USA* (p. 1-8).
- Zheng, Y., Wu, L., Li, X., & Yin, C. (2014). A Relevance Vector Machine-Based Approach For Remaining Useful Life Prediction Of Power MOSFETs. In *Prognostics and System Health Management Conference, Hunan, China* (p. 642-646).

BIOGRAPHIES

Omer Panni is an EngD student within the Institute for Energy and Environment at the University of Strathclyde, UK. He received his M.Eng in Electronic & Electrical Engineering from the University of Strathclyde in 2012. His EngD focuses on prognostics for steam turbines in nuclear power plants, in collaboration with Rolls-Royce PLC and EDF Energy.

Graeme West is a Lecturer within the Institute for Energy and Environment at the University of Strathclyde, UK. He received his B.Eng. (Hons) and PhD degrees from the University of Strathclyde in 1998 and 2002 respectively. His research interests include condition monitoring, diagnostics and prognostics for nuclear power plant applications.

Victoria M. Catterson is a Lecturer within the Institute for Energy and Environment at the University of Strathclyde, UK.

She received her B.Eng. (Hons) and Ph.D. degrees from the University of Strathclyde in 2003 and 2007 respectively. Her research interests include condition monitoring, diagnostics, and prognostics for power engineering applications.

Stephen McArthur is a Professor within the Institute for Energy and Environment at the University of Strathclyde, UK. He received his B.Eng. (Hons) and Ph.D. degrees from the University of Strathclyde in 1992 and 1996 respectively. His

research interests include intelligent systems applications in power engineering, condition monitoring, and multi-agent systems.

Dongfeng Shi is a Technical Specialist with Rolls-Royce Control and Data Services Ltd, Derby, United Kingdom.

Ieuan Mogridge is a Rotating Plant & Dynamics Engineer with EDF Energy, Gloucester, United Kingdom.