



THE UNIVERSITY *of* EDINBURGH

Edinburgh Research Explorer

Assessing fire frequency and structural fire behaviour of England statistics according to BS PD 7974-7

Citation for published version:

Manes, M & Rush, D 2020, 'Assessing fire frequency and structural fire behaviour of England statistics according to BS PD 7974-7', *Fire Safety Journal*. <https://doi.org/10.1016/j.firesaf.2020.103030>

Digital Object Identifier (DOI):

[10.1016/j.firesaf.2020.103030](https://doi.org/10.1016/j.firesaf.2020.103030)

Link:

[Link to publication record in Edinburgh Research Explorer](#)

Document Version:

Peer reviewed version

Published In:

Fire Safety Journal

General rights

Copyright for the publications made accessible via the Edinburgh Research Explorer is retained by the author(s) and / or other copyright owners and it is a condition of accessing these publications that users recognise and abide by the legal requirements associated with these rights.

Take down policy

The University of Edinburgh has made every reasonable effort to ensure that Edinburgh Research Explorer content complies with UK legislation. If you believe that the public display of this file breaches copyright please contact openaccess@ed.ac.uk providing details, and we will remove access to the work immediately and investigate your claim.



1 **Assessing fire frequency and structural fire behaviour of England statistics according to**
2 **BS PD 7974-7.**

3 Martina Manes^{a*}, David Rush^{a*}

4 ^aSchool of Engineering, University of Edinburgh, Edinburgh, UK, m.manes@ed.ac.uk;
5 d.rush@ed.ac.uk

6 *Corresponding author

7 **Abstract:**

8 Contemporary structural fire statistics are fundamental in engineering design practice to
9 evaluate likelihood and consequence of fire for different property types, and to investigate how
10 different safety measures impact fire spread. British Standard PD 7974-7:2003 has recently
11 been updated using USA fire statistics; this paper compares PD 7974-7:2003 to current England
12 statistics (named UK statistics) using one public and one Home Office dataset. PD 7974-7:2003
13 overestimates fire frequency with values up to 5 times greater than the ones found in UK and
14 USA. When fire frequency is plotted against total floor space, for different property types,
15 power laws with positive or negative exponent and polynomial functions provide better
16 approximations of the data than the current codes. Average area damage from PD 7974-7:2003
17 has been compared to *fire* and *total* damage from UK datasets where fire size is usually well
18 confined to room of origin at 20% of fires based on the publicly available dataset. When fires
19 exceeding specific areas of damage are considered, PD 7974-7:2003 usually overestimates *fire*
20 *damage* and underestimates *total damage*, with more damage evident when sprinklers are
21 absent compared to when they are present.

22 **Keywords:** fire statistics, fire frequency, fire damage, total damage, fire safety systems,
23 sprinklers, probabilistic design

24 **1. Introduction**

25 The Building Regulations introduced in 1985 in England and Wales established the use of
26 performance- or functional- based building codes [1]. This allowed a change from prescription
27 to performance-based design, and can be interpreted as a reaction to the limits that a
28 prescriptive design framework can provide. As stated in the PSA 911:2007 [2], even if
29 prescriptive guidelines are easy to apply and provide a consistent approach and output, they
30 appear to be inflexible, do not necessary lead to an optimum solution, and are not representative
31 of current design and practice. Instead, performance-based approaches can be created on
32 specific property needs, allowing innovations and flexibility [3]. Moreover, with appropriate
33 design, holistic approaches can be developed albeit with potential higher initial costs [2].
34 Regardless of the cost, functional objectives of buildings must consider life safety, property
35 protection, business continuity and environmental impacts [4].

36 The criteria against which the functional objectives must be met could be set as deterministic
37 or probabilistic. Deterministic criteria are generally validated using experiments involving the
38 response of single elements [5] or using full-scale test [6] which could be expensive, time
39 consuming and not always able to recreate all the possible fire scenarios. Probabilistic risk
40 criteria are generally based on statistical data [7]. In order to have a representative dataset,
41 statistical analyses of real building fires are usually produced. Previous studies have considered
42 national fire statistics of UK, USA and New Zealand which have common mandatory fields
43 investigating pre and post-fire conditions [8] as well as direct financial losses [9]. Statistical
44 analyses convert fire data into information useful to predict the likelihood of occurrence and
45 consequences [10] where quantitative risk assessments are adopted to recreate fire scenarios,

46 system failure modes and provide insights about physical phenomena and human behaviour
47 facilitating risk treatment and management [11].

48 The British Standards PD 7974-7:2003 [12] provides a useful methodology and techniques to
49 develop probabilistic risk assessment (PRA). This document, updated in 2019, presents
50 flowcharts to evaluate risk assessment and reasons for acceptable criteria. However, no
51 absolute risk criteria are included where the evaluation of risk does not affect risk management
52 [13]. The tolerability limit is the combinations of possible consequences and associated
53 occurrence frequencies and it refers to societal and individual tolerability [14]. If statistical
54 analyses are assumed, data of real fire incidents in buildings are required and elaborated to
55 evaluate likelihood and consequences as specified in the data collection section of the PD 7974-
56 7:2019. In Annex B of the PD 7974-7:2019, some informative indicative probabilities are
57 presented related to: the reliability and effectiveness of sprinklers in the USA and New Zealand,
58 respectively; fire growth rate distributions; occupancy dependant fire load energy densities;
59 and extent of damage in USA fire incidents from 1989-1994. Table B.3 of PD 7974-7:2019
60 presents the overall probability of fire starting in various types of occupancy and it has been
61 created by a study of 2018 in which the PD 7974-7:2003 was compared to USA fire statistics
62 [15]. Therefore, Annex B presents some examples for PRA but the PD 7974-7:2019 document
63 is entirely informative and it is not imposed on engineering practice. Previous fire safety data
64 of PD 7974-7:2003 taken between 1968 and 1987 provide more detailed fields covering
65 probability of fire starting, fire frequency, fire spread, frequency distribution of area damage
66 according to presence or absence of safety systems, average loss per fire and discovery time
67 and fatal casualties in various occupancy types. This data from PD 7974-7:2003 could be used
68 as inputs data for PRA, however it is outdated. Therefore, this study redevelops the PD 7974-
69 7:2003 tables using contemporary fire statistics, for potential use in PRA presented in PD 7974-
70 7:2019.

71 The Home Office's fire statistics report for England from April 2017 to March 2018 showed
72 that the total number of fires attended by fire and rescue services decreased from around
73 474,000 in 2003/04 to 154,000 in 2012/13. Since then, the total number of fires has increased
74 from approximately 162,000 in 2016/17 to 167,000 in 2017/18 [16]. At the same time, the
75 average area of damage of dwellings (excluding those over 5,000 m²) in England decreased by
76 5% from 17.1 m² in the previous year to 16.2 m² [17]. In the USA, in 2017, fires in structures
77 are estimated to have increased by 5% to 499,000 compared to 2016 and an increase in
78 estimated property loss of 35% [18]. Individuals, organizations and Government have clear
79 responsibilities to manage and control fire risks where safety increases if the risk is reduced
80 [19].

81 This paper compares trends found in the England fire statistics to those of PD 7974-7:2003
82 (hereafter called UK statistics and PD 7974-7, respectively) and those from the USA fire
83 statistics with clear references to the research developed by Manes and Rush in 2018 [15]. The
84 data of PD 7974-7:2019 are only used for comparison for the overall probability of fire starting.
85 Several countries have different fire safety policies and mitigation systems and the analysis
86 presented herein evaluates analogies and differences seen. Moreover, the fire safety data
87 described in PD 7974-7 will be compared to current fire statistics to evaluate if their predictions
88 are applicable to the current building stock affected by fire incidents. In current fire design
89 practice, it is fundamental to have fire safety data able to represent the current behaviour of
90 buildings subjected to fires considering the effect of safety systems and quantifying structural
91 consequences. All the updated data could be used in the evaluation of fire frequency in different
92 property types, effectiveness of active safety systems, compartmentation in fire spread
93 reduction and business impact analysis or continuity plans to determine possible strategies to

94 improve prevention, absorption and recovery after a fire incident [20], [21]. Furthermore, this
95 paper provides contemporary fire statistical data that could be adopted within the updated
96 framework and data collection methods for PRA described in PD 7974-7:2019.

97 **2. Fire statistics and building stock**

98 The Home Office Incident Recording System (IRS) by the Home Office in UK collects
99 information on every incident attended by the fire and rescue services (FRSs) in England,
100 Wales and Scotland. The web-based forms are pre-populated with information from the
101 Command and Control systems, and are then completed and submitted by those present at the
102 time of the incident [22]. The Home Office publishes a quarterly release on Fire and rescue
103 service statistics which is a collection of national statistics on fires, casualties, false alarms and
104 non-fire incidents attended by the fire and rescue service in England and annual releases with
105 more-detailed analyses and non-fire incidents [23]. The Home Office works with the FRSs to
106 ensure the quality of data but the datasets may present a small number of unidentified
107 inconsistencies [22].

108 In this research, the *Other building* fires dataset has been adopted for the study and data are
109 collected from 2010/11 to 2016/17 including 121,558 fire incidents [24]. This dataset has been
110 used for all the analyses present in this paper except for the evaluation of fire frequency in
111 relation to the total floor space of the building. This is due to the published dataset not including
112 the total floor area of the building. For this reason, the Home Office provided the authors with
113 an additional dataset which includes information about the building dimension. In this
114 database, only the data of 2014/15 have been investigated to recreate a direct comparison with
115 the previous research developed for PD 7974-7 and USA statistics [15]. In order to guarantee
116 a data quality, the authors have removed entries in which the building room or floor of origin
117 are equal to 0 m², the number of floors above or below ground/main level are recorded as 99
118 or 999, and fires where the fire damage is greater than the total damage. Therefore, the *Other*
119 *building* fires dataset has been reduced by around a quarter from 15,561 to 11,168 fire incidents.
120 The National Fire Incident Reporting System has been considered for the USA fire statistics
121 for the 2014/15 provided by the US Fire Administration which collects approximately 600,000
122 fire incident data each year from all 50 States and more than 40 major metropolitan areas [25].

123 For the building stock classified according to the total floor space of the building, UK Valuation
124 Office Agency (VOA) of the 2017 rating list compiled on April 2017 for England and Wales
125 has been investigated. Every entry in the rating list includes a rateable value where 80% are
126 supported by regular site and building survey while 20% by specialised surveys or based on
127 construction costs or annual accounts. Bulk class properties are collected as particular use of
128 the property at the time of the valuation [26]. Only records still valid and with a rateable value
129 greater than zero have been considered and bulk class buildings distributed according to
130 specific total space. For USA building stock, US Energy Information Administration (EIA)
131 [27] have been adopted according to the Commercial buildings energy consumption survey
132 (CBECS) [28] and the Manufacturing energy consumption survey (MECS) [29].

133 **3. Methodology**

134 This paper recreates the tables present in Annex A of the PD 7974-7:2003 (Tables A.1, A.2,
135 A.4, A.5, A.6, A.7, A.8), adopting UK fire statistics. In PD 7974-7, the methodology with
136 which the fire safety data have been obtained is not explicitly described. However, research of
137 D'Addario in 1940 about the claims in frequency as a function of the sum insured [30],
138 Ramachandran in 1970 with the analysis of large fires for different occupancy types [31],
139 Rutstein in 1979 using fires reported by fire brigade [32] and others converged into the PD

140 7974-7 defining the principles and methodology able to create direct comparisons with current
 141 fire statistics.

142 Rutstein affirms that the fire probability is described by a power law according to the total
 143 space of the building with two empirical coefficients a and b , where a is defined as the ratio
 144 between the total number of fires and total number of building at risks, while b as the total
 145 number of fires divided by the building maximum floor space [32]:

$$146 \quad F = aA^b \quad (1)$$

147 This law is adopted for Table A.1 of the PD 7974-7 and has been recreated considering the UK
 148 IRS for the number of fires and the VOA building stock for the number of buildings according
 149 to specific ranges of floor space. In the USA statistics, the areas of total floor space are limited
 150 to the ones that are present in the NFIRS, whereas the IRS does not have this reported publicly,
 151 therefore, the authors have obtained data from the Home Office for the year 2014/15 to develop
 152 the necessary relationships with more classes of building area (from up to 50 m² to over 50,000
 153 m²) than those found in the USA statistics. This is the only analysis developed with the bespoke
 154 fire statistics dataset for 2014/15 while all the other PD 7974-7 Tables are generated using the
 155 *Other building* fires dataset published in 2017 with data from 2010/11 to 2016/17 [24].

156 The power law in Table A.1 of PD 7974-7 has always positive exponent, however analysis of
 157 USA statistics [15] showed that these trends could assume also a negative exponent and that a
 158 polynomial relationship better approximate the observed trends. Rutstein defined a power law
 159 with positive exponent to calculate the frequency of ignition only based on the total number of
 160 fires, floor area and buildings at risk. However, other potential factors could cause ignition as
 161 activities, amount and distribution of fuel loads, number of occupants, area of the building and
 162 others. This could be the reason why other functions are nowadays able to better describe the
 163 fire statistical distributions. Therefore, the UK fire data are plotted considering three trends:
 164 power law with positive exponent called [Power(UK-Rutstein)] based on Eq. 1 and two other
 165 laws (with the related R²) named [Power(UK-Improved)] for the power law with positive or
 166 negative exponent and [Poly.(UK-Improved)] for the polynomial relationship. The same
 167 analysis in USA have been previously developed considering the total number of fires in
 168 NFIRS and the building stock provided by the US Census Bureau [33].

169 **Table 1: UK fire statistics fields investigated**

| Spread of fire | Safety systems | Fire and total damage [m²] |
|---|---------------------------------------|--|
| No fire damage | Sprinklers presented, raised alarm | 0 |
| Limited to item 1 st ignited | Sprinklers operated, no alarm | Up to 5 |
| Limited to room of origin | Sprinklers present, did not operate | 6 to 10 |
| Limited to floor of origin | Other System presented, raised alarm | 11 to 20 |
| Limited to two floors | Other System operated, no alarm | 21 to 50 |
| Whole building or more than two floors | Other System present, did not operate | 51 to 100 |
| Roofs/Roof spaces | No Safety System | 101 to 200 201 to 500 501 to 1,000 Over 1,000 |

170
 171 Furthermore, Rutstein defines the probability of fire as the number of fire incidents attended
 172 by the fire brigade divided by the total number of buildings at risk [32]. This consideration is
 173 at the base of the recreated yearly frequency of Table A.2 where the total number of fires is
 174 obtained by the IRS for the year 2014/15, where the year is chosen to compare the results with
 175 the USA ones, and the total number of building at risk by the number of rateable properties as
 176 at 31st March 2016 of the 2010 Local rating List [26] in England and Wales.

177 All the other PD 7974-7 tables have been produced using the publicly available *Other building*
 178 fires datasets from 2010/11 to 2016/17. The fields considered are presented in Table 1 and
 179 involved fire spread, safety systems and fire and total damage.

180 **4. Overall probability of fire starting in various type of occupancy**

181 The overall probability of fire starting in various occupancy types present in Table A.2 of the
 182 PD 7974-7:2003 have been compared to 2014/15 UK and USA statistics evaluating the
 183 percentages as the total number of fires divided by the total number of buildings at risk where
 184 the values for the denominators have been found in the VOA for UK and in the US Census
 185 Bureau for the USA. The updated values are shown in Table 2 for non-residential buildings
 186 and the classes investigated are the ones presented in the PD 7974-7 but for *Storage* in UK and
 187 *Assembly non-residential* in UK and USA a direct comparison has not been possible.

188 Table 2: Table A.2 in PD 7974-7, USA and UK statistics

| Occupancy types | PD 7974-7:2003 | PD 7974-9:2019 | USA | UK |
|--------------------------|-----------------------|----------------------|------------------------|------------------------|
| Industrial | 4.4×10^{-2} | 0.9×10^{-2} | 1.121×10^{-2} | 0.953×10^{-2} |
| Storage | 1.3×10^{-2} | N/A | N/A | 0.132×10^{-2} |
| Offices | 0.62×10^{-2} | 0.4×10^{-2} | 0.423×10^{-2} | 0.166×10^{-2} |
| Assembly entertainment | 12×10^{-2} | 0.7×10^{-2} | 5.446×10^{-2} | 0.868×10^{-2} |
| Assembly non-residential | 2.0×10^{-2} | N/A | N/A | N/A |
| Hospitals | 30×10^{-2} | 2.6×10^{-2} | 0.363×10^{-2} | 5.856×10^{-2} |
| Schools | 4.0×10^{-2} | 1.4×10^{-2} | 5.512×10^{-2} | 1.362×10^{-2} |

189 Values for PD 7974-7:2003 seem to overestimate contemporary fire statistics for the UK and
 190 USA, in particular for *Industrial* when it appears to be 4 times, *Assembly entertainment*
 191 approximately 2 times and *Hospitals* 5 times greater than the maximum value in the other two
 192 statistics. PD 7974-7 only underestimates the probability in *Schools* where in USA statistics
 193 5.512×10^{-2} is found while in UK this is given by 1.362×10^{-2} as shown in Table 2.


194 The probabilities of fire starting in UK assume slightly different values than those in the
 195 updated PD 7974-7:2019 for two property types: in *Offices* where PD 7974-7:2019
 196 classification also includes retail premises and in *Hospitals* where the new analysis adopts the
 197 *Other buildings* dataset which was not available previously. In general, trends appear uniform
 198 where PD 7974-7 generally overestimates the overall probability of fire starting showing a
 199 reduction of fires in current fire statistics probably due to an improvement of fire safety
 200 measures in buildings.

201 **5. Frequency of fire starting in various occupancy types**


202 Table A.1 in PD 7974-7:2003 has been recreated as suggested by Rutstein [32] and described
 203 in Section 3. Rutstein in his research [32] possibly assumed the frequentistic definition where
 204 probability is defined as the relative frequency of occurrence of an event given by the number
 205 of times that it occurs divided by the number of experiments and it is obtained with the limit
 206 of the relative frequency if the number of experiments approaches infinity [34]. Therefore, the
 207 values obtained in the analysis are relative frequencies. Since increasing but finite total floor
 208 spaces are evaluated, the term frequency appears more appropriate than probability in Table
 209 A.1. In Table 3, the UK fire statistics are evaluated based on the bespoke Home Office datasets
 210 while the USA statistics [15] are provided for comparison. According to area ranges from up
 211 to 50 m² to over 50,000 m², 12 data points are obtained for *Shops* and *Offices*, 11 for *Industry*
 212 *and manufacturing* and *Miscellaneous*, 10 for *Storage*, *Schools* and *Leisure* and 9 for *Hospitals*.
 213 Due to high degrees of uncertainties, *Vehicle*, *Other manufacturing* and *Hotels* are not
 214 considered.

215 The Spearman's correlation [35] between total floor areas and fire frequencies is examined and
 216 values vary from 0.503 to 0.930 in the various property types proving a positive correlation.
 217 Instead, negative values of -0.209, -0.248 and -0.164 are obtained in *Industry and*
 218 *manufacturing*, *Storage* and *Miscellaneous*, respectively. The residuals [36] are evaluated for
 219 the two (UK-Improved) laws usually assuming random distribution showing that the model fits
 220 the data well.

221 In *Industry and manufacturing*, PD 7974-7 appears to overestimate the trends obtained in the
 222 UK and USA statistics and if a power law is applied it shows a negative exponent instead of a
 223 positive one with a R^2 equals to 0.055 in UK and to 0.482 in USA (Table 3). The law which
 224 better describes the trend in UK, although still poorly, is a polynomial of third order ($R^2 =$
 225 0.155) (Figure 1). In *Storage*, the highest curve is represented by the [Power(UK-Rutstein)]
 226 obtained considering a positive exponent but PD 7974-7 assumes higher values than the ones
 227 described in UK statistics where a second order polynomial function best approximates the
 228 data ($R^2 = 0.205$) (Figure 2). In USA, the third order polynomial function ($R^2 = 0.993$) well
 229 describes the distribution (Table 3).

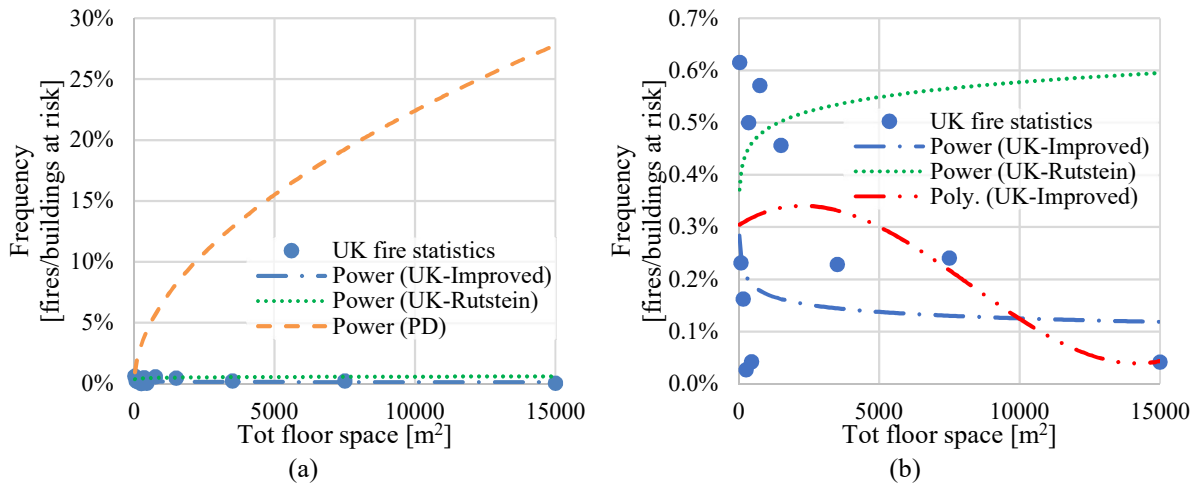


230 Figure 1: Frequency of fire starting *Industry and manufacturing* (a) PD 7974-7 and UK
 231 statistics, (b) only UK

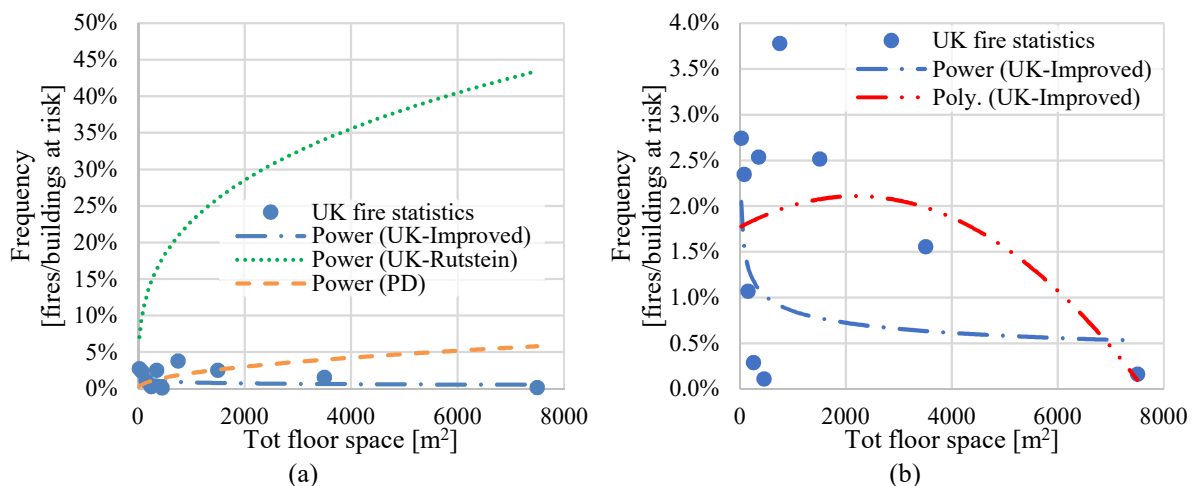


232 Figure 2: Frequency of fire starting *Storage* (a) PD 7974-7 and UK statistics, (b) only UK

233 The frequency of fire in *Shops* according to PD 7974-7 is equal to 100% for a total floor space
 234 greater than 15,000 m² and when the UK statistics trends are drawn, they usually have
 235 percentages lower than 2%. In particular, the functions which better describe the data are the

236 power law with positive exponent ($R^2 = 0.262$) and a second order polynomial ($R^2 = 0.449$)
 237 (Figure 3) where the building stock is concentrated up to 10,000 m² building total floor space.
 238 In *Offices*, considerations are as similar as the ones already expressed for *Shops* where the PD
 239 7974-7 power law presents a frequency of fire greater than 70% for a total floor space of 35,000
 240 m². The only difference in this property type is that the function which better describes the UK
 241 statistics is a power law ($R^2 = 0.835$) while the second order polynomial is less accurate ($R^2 =$
 242 0.588). As shown in Figure 4, the power law derived considering only a positive exponent
 243 [Power(UK-Rutstein)] always has values lower than 0.2% and it is not representative of the
 244 data. In USA, these two property types have been recreated according to the one of *Mercantile*,
 245 *Business* present in the USA statistics where the power law ($R^2 = 0.927$) and a third order
 246 polynomial function ($R^2 = 0.997$) provide very good approximations (Table 3). Again, PD
 247 7974-7 seems to be very conservative.

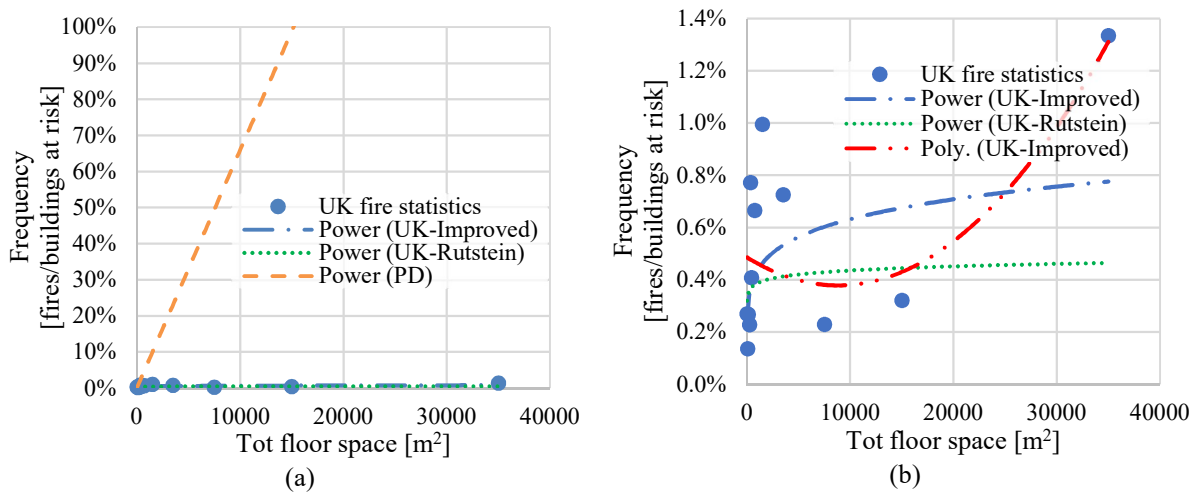


248 Figure 3: Frequency of fire starting *Shops* (a) PD 7974-7 and UK statistics, (b) only UK

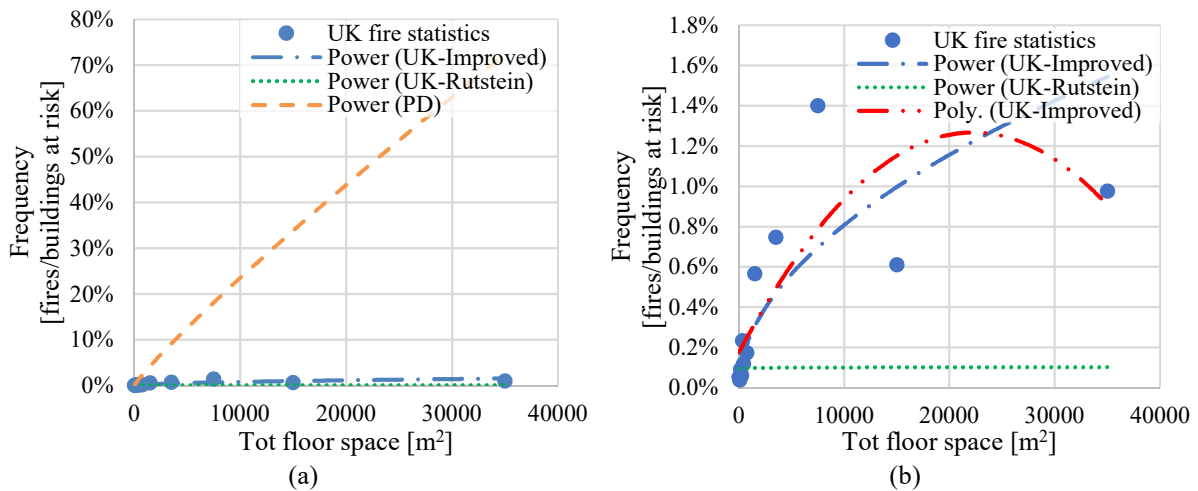


249 Figure 4: Frequency of fire starting *Offices* (a) PD 7974-7 and UK statistics, (b) only UK

250 While in the most property types PD 7974-7 overestimates contemporary UK statistics, in
 251 *Hospitals* this overestimation is not as obvious, as shown in Figure 5. When the UK statistics
 252 trends are plotted, it appears that the best fit is a third order polynomial ($R^2 = 0.999$) followed
 253 by a power law with positive exponent ($R^2 = 0.442$) which shows a systematic pattern of the
 254 residuals and fits the data poorly. In USA, the class of *Hospitals* has been compared to the one
 255 of *Health care, Detention and Correction* where even in this statistics, a power law and a
 256 second order polynomial function well approximate the distributions ($R^2 = 0.839$, and $R^2 =$

0.742, respectively) as shown in Table 3. Finally, as in *Hospitals*, the UK statistics for *Schools* again is similar to PD 7974-7 trends especially for the frequency of fire up to 2,000 m² as shown in Figure 6 (a). In Figure 6 (b), a power law of third order approximates the data with R² equals to 0.718, similar to USA where a cubic function presents a R² of 0.983 and a power law a R² of 0.768 (Table 3). The residuals for the improved laws *Hospitals* and *Schools* in UK show a pattern and the models appear as poor fit.

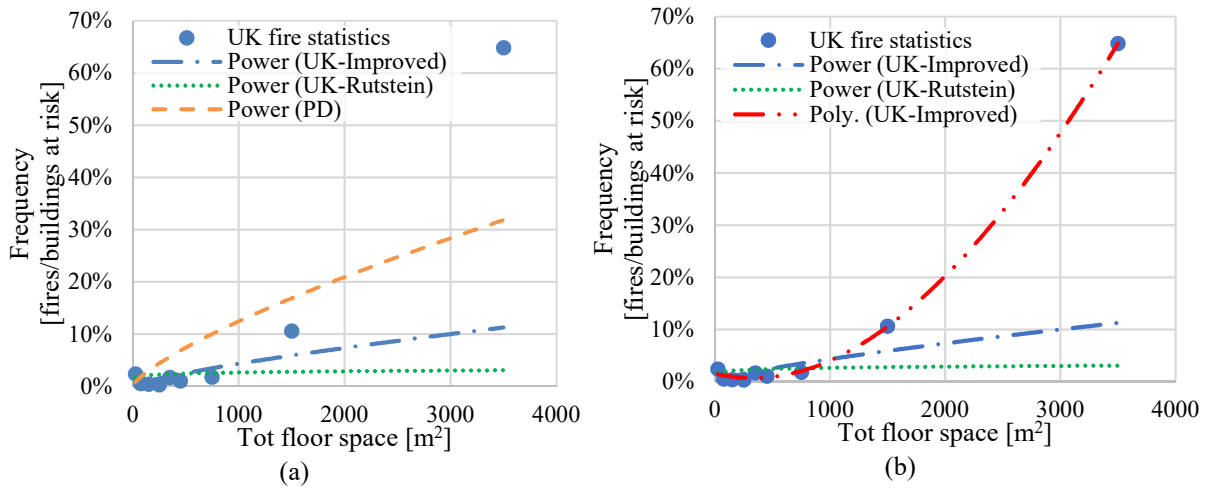

263 Figure 5: Frequency of fire starting *Hospitals* (a) PD 7974-7 and UK statistics, (b) only UK

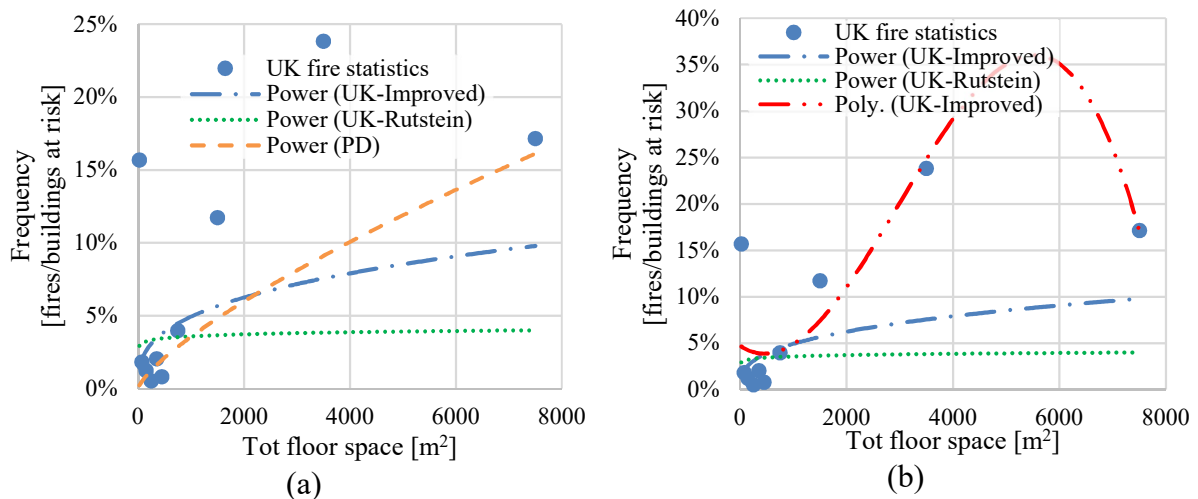

264 Figure 6: Frequency of fire starting *Schools* (a) PD 7974-7 and UK statistics, (b) only UK

265 According to the analyses for UK and USA statistics, PD 7974-7 generally overestimates fire
 266 trends. A power law with positive exponent is not always the best approximation of the
 267 distributions, as in *Industrial manufacturing* where it assumes a negative exponent in both UK
 268 and USA and in *Storage* in UK statistics. However, as seen with the USA data, the polynomial
 269 fitted relationships of second or third order, tend to be more accurate (Table 3). This could be
 270 due to the common distribution form found in the two statistics, where the frequency usually
 271 decreases to a minimum, then gradually increases again, or to different regulatory requirements
 272 as the size of building increases. Only few of the exponential or polynomial relationships in
 273 UK have R² greater than 0.85, with several lower than 0.4 in UK due to smaller area classes
 274 considered. This is markedly different to the results of USA fire statistics, where R² was often
 275 above 0.99. A non-uniform data scatter is generally present and the extreme data points are less
 276 dense. Therefore, data need to be used carefully and with consideration of the uncertainties
 277 within the data and the fitted curves.

Table 3: Frequency of fire starting in different occupancy types in PD 7974-7, UK and USA fire statistics

| UK fire statistics | | | | | | | | | |
|------------------------|--|------|-----------------------|--------|-----------------------|--------|----------------|--|----------------|
| Occupancy types | According to data points frequency of fire – total floor space | | | | | | | | |
| | [Power(PD)] | | [Power (UK-Rutstein)] | | [Power (UK-Improved)] | | | [Poly (UK-Improved)] | |
| | a | b | a | b | a | b | R ² | Law | R ² |
| Industry manufacturing | 0.0017 | 0.53 | 0.0029 | 0.0736 | 0.0044 | -0.137 | 0.055 | $4 \times 10^{-15}A^3 - 9 \times 10^{-11}A^2 + 3 \times 10^{-7}A + 0.003$ | 0.155 |
| Storage | 0.00067 | 0.5 | 0.0253 | 0.3187 | 0.0439 | -0.237 | 0.101 | $-7 \times 10^{-10}A^2 + 3 \times 10^{-6}A + 0.0177$ | 0.205 |
| Shops | 0.000066 | 1 | 0.0027 | 0.0515 | 0.0014 | 0.164 | 0.262 | $1 \times 10^{-11}A^2 - 2 \times 10^{-7}A + 0.0049$ | 0.449 |
| Offices | 0.000059 | 0.9 | 0.0009 | 0.0128 | 0.00007 | 0.518 | 0.835 | $-2 \times 10^{-11}A^2 + 1 \times 10^{-6}A + 0.0017$ | 0.588 |
| Hospitals | 0.0007 | 0.75 | 0.0117 | 0.1183 | 0.0002 | 0.764 | 0.442 | $-4 \times 10^{-12}A^3 + 8 \times 10^{-8}A^2 - 5 \times 10^{-5}A + 0.0157$ | 0.999 |
| Schools | 0.0002 | 0.75 | 0.0246 | 0.0544 | 0.0047 | 0.340 | 0.178 | $-5 \times 10^{-12}A^3 + 4 \times 10^{-8}A^2 - 4 \times 10^{-5}A + 0.0473$ | 0.718 |
| Leisure | N/A | N/A | 0.0079 | 0.0563 | 0.0012 | 0.321 | 0.228 | $-3 \times 10^{-13}A^3 + 2 \times 10^{-9}A^2 + 5 \times 10^{-6}A + 0.0059$ | 0.861 |
| Miscellaneous | N/A | N/A | 0.068 | 0.068 | 0.053 | -0.01 | 0.0005 | $-2 \times 10^{-10}A^2 + 9 \times 10^{-7}A + 0.0684$ | 0.068 |
| USA fire statistics | | | | | | | | | |
| Occupancy types | a | b | a | b | a | b | R ² | Law | R ² |
| Industry manufacturing | 0.0017 | 0.53 | 0.0039 | 0.1464 | 1.7584 | -0.831 | 0.482 | N/A | N/A |
| Storage | 0.00067 | 0.5 | 0.0023 | 0.0392 | 0.0001 | 0.349 | 0.405 | $-3.75 \times 10^{-17}A^3 + 7.26 \times 10^{-12}A^2 - 9.90 \times 10^{-8}A + 0.0019$ | 0.993 |
| Shops | 0.000066 | 1 | 0.001 | 0.0589 | 0.00005 | 0.451 | 0.927 | $4.88 \times 10^{-17}A^3 - 4.61 \times 10^{-12}A^2 + 2.25 \times 10^{-7}A + 0.0008$ | 0.997 |
| Offices | 0.000059 | 0.9 | 0.001 | 0.0589 | 0.00005 | 0.451 | 0.927 | $4.88 \times 10^{-17}A^3 - 4.61 \times 10^{-12}A^2 + 2.25 \times 10^{-7}A + 0.0008$ | 0.997 |
| Hospitals | 0.0007 | 0.75 | 0.0029 | 0.0115 | 0.0001 | 0.487 | 0.839 | $-2.37 \times 10^{-12}A^2 + 4.71 \times 10^{-7}A + 0.004$ | 0.742 |
| Schools | 0.0002 | 0.75 | 0.0012 | 0.0101 | 0.0002 | 0.218 | 0.768 | $2.92 \times 10^{-16}A^3 - 7.76 \times 10^{-12}A^2 + 1.04 \times 10^{-7}A + 0.0010$ | 0.983 |

279 Table 4: Area damage for *Industrial manufacturing* in different fire origin locations in PD 7974-7 and UK statistics [F=Fire, T=Total]

| Area damage [m ²] | | | | | | | | | | | | | | | | | | | |
|-------------------------------|------|------|---------------|---------|------|---------------|--------|------|---------------|--------|------|-------------|--------|------|---------------|--------|------|--------|--------|
| Production areas | | | | | | Storage areas | | | | | | Other areas | | | | | | | |
| Sprinklers | | | No Sprinklers | | | Sprinklers | | | No Sprinklers | | | Sprinklers | | | No Sprinklers | | | | |
| PD | UK F | UK T | PD | UK F | UK T | PD | UK F | UK T | PD | UK F | UK T | PD | UK F | UK T | PD | UK F | UK T | | |
| A | / | 2.91 | 12.28 | / | 9.16 | 23.90 | / | 0.00 | 0.00 | / | 4.65 | 18.50 | / | 2.43 | 4.65 | / | 4.64 | 16.57 | |
| B | 5 | 7.26 | 45.06 | 5 | 3.37 | 33.07 | 4 | 4.33 | 129.50 | 10 | 2.53 | 12.25 | 2 | 2.64 | 6.44 | 2 | 5.43 | 16.67 | |
| C | C1 | 13 | 39.67 | 163.34 | 17 | 21.24 | 98.65 | 19 | 39.00 | 176.50 | 17 | 16.58 | 36.23 | 11 | 7.18 | 33.20 | 4 | 17.84 | 59.85 |
| | C2 | 113 | | | 475 | | | | | 262 | | | | 68 | | | 68 | | |
| D | D1 | | 15.79 | 185.32 | | 80.04 | 163.25 | | 21.75 | 79.25 | | 80.83 | 171.36 | | 45.50 | 130.94 | | 53.41 | 136.20 |
| | D2 | 694 | 97.50 | 207.50 | 694 | 87.80 | 228.11 | 1712 | 75.50 | 150.50 | 1712 | 199.25 | 301.75 | 1007 | 35.50 | 55.50 | 1007 | 86.54 | 156.43 |
| | D3 | | 1000.00 | 1000.00 | | 350.23 | 401.41 | | 750.50 | 750.50 | | 420.85 | 457.54 | | 504.00 | 504.00 | | 354.41 | 389.03 |
| | D4 | | 212.30 | 225.80 | | 38.89 | 46.75 | | / | / | | 328.15 | 455.10 | | 37.83 | 62.83 | | 69.12 | 92.33 |
| Average | 40 | 29 | 100.20 | 153 | 29 | 72.43 | 76 | 87 | 163.73 | 533 | 101 | 137.97 | 49 | 21 | 39.89 | 165 | 47 | 77.86 | |
| Total fires | | 198 | 198 | | 2124 | 2124 | | 11 | 11 | | 172 | 172 | | 94 | 94 | | 1800 | 1800 | |

281 **6. Area damage and percentage of fires**

282 Table A.4 and Table A.5 of PD 7974-7 describe the area damage in m² according to a specific
 283 class of fire spread and the related percentage of fires respectively in *Textile industry* and *Pubs,*
 284 *clubs and restaurant* with different fire origin locations. These tables have been updated using
 285 the *Other buildings* dataset published by the Home Office, considering *Industrial*
 286 *manufacturing* (not including Factory) for Table A.4 and *Pub, wine bar, bar; Casino, club,*
 287 *nightclub; Restaurant, cafe and Takeaway, fast food* for Table A.5. In Table A.4, the fire origin
 288 locations investigated in UK statistics are: Production areas as Process/Production room;
 289 Storage areas as Store room/Laundry room/Cloakroom, Refuse store; Other areas as all the
 290 other fire origin locations.

291 The two PD 7974-7 tables are analysed for the presence or absence of sprinklers and the area
 292 damage has been further classified in UK statistics according to *fire* and *total damage*; where
 293 *fire damage* is defined as the total horizontal area damaged by the flame and heat in m² at the
 294 stop of the fire; and *total damage* as the area damaged by the flame, heat, smoke and water in
 295 m². In USA, only *fire damage* is recorded which does not include areas receiving only heat,
 296 smoke, or water damage. Table 5 presents the legend for Table 4, Table 6 and Table 7. The fire
 297 spread classes in PD 7974-7 have a distinction when the fire confined to the room of origin
 298 affects only the contents or involve the structure whereas current fire statistics have a detailed
 299 classification if the fire spreads beyond the room of origin (e.g. confined to the origin floor, to
 300 two floors, involve the whole building/more than two floors or roofs/roof spaces).
 301 Unfortunately, total number of fires in PD 7974-7 is not provided for Table A.4 and Table A.5.

302 Table 5: Legend for Table 4, Table 6 and Table 7

| | | | |
|-----------------------------|------------------------|------------------------------|-----------------------|
| A. No fire damage | C1. Contents only | D1. Confined to origin floor | D4. Roofs/Roof spaces |
| B. Confined to item ignited | C2. Structure involved | D2. Confined to two floors | F. Fire Damage |
| C. Confined to origin room | D. Spread beyond room | D3. Whole building | T. Total Damage |

303
 304 Table 4 and Table 6, present respectively the area damage and frequency for *Industrial*
 305 *manufacturing*. In Production areas, the total number of fires for sprinklers is 198, while for no
 306 sprinklers 2,124. The average area damaged in Table 4 for PD 7974-7 when sprinklers are
 307 present is 40 m² and is similar to the UK statistics for *fire damage* of 29 m², while no sprinklers
 308 in PD 7974-7 presents a typo: 153 instead of 152 m². When the spread affects the whole
 309 building in UK, one fire with 1,000 m² is recorded and may not represent the real scenario for
 310 presence of sprinklers. In Table 6, fire frequency appears confined up to the room of origin for
 311 more than 80% for both sprinklered and non-sprinklered production areas.

312 In Storage areas, 11 fires are reported for the presence of sprinklers and 172 for the absence in
 313 UK fire statistics, thus the focus will be on those fires where no sprinklers are present. [NB: In
 314 PD 7974-7 for presence of sprinklers and fire confined to room of origin, the area damage of
 315 19 m² and fire frequency of 24% are corrected values not repeated twice as in PD 7974-7 [15]].
 316 The average area damage in PD 7974-7 for absence of sprinklers is equal to 533 m² (not 539
 317 m² as wrongly evaluated in Table A.4) and it appears approximately four times greater than the
 318 one obtained for *total damage* in UK given by 137.97 m² (Table 4). Fire frequency in UK
 319 statistics with no sprinklers is confined to the room of origin in 65% of cases with a 13.95%
 320 affecting the whole building (Table 6).

321 In Table 4, when Other areas are evaluated, 94 fires are reported for sprinklers and 1,800 for
 322 no sprinklers in UK. In the latter case, the average area damage in PD 7974-7 is two times
 323 bigger than the one of *total damage* in UK (77.86 m²) with frequency confined within room of
 324 origin for 70% of cases and 13.72% confined to floor of origin in UK fire statistics (Table 6).

325
326

Table 6: Percentages of fires for *Industrial manufacturing* in PD 7974-7 and UK statistics related to Table 4

| | Frequency | | | | | | | | | | | | |
|---|------------------|--------|---------------|--------|---------------|--------|---------------|--------|-------------|--------|---------------|--------|--------|
| | Production areas | | | | Storage areas | | | | Other areas | | | | |
| | Sprinklers | | No Sprinklers | | Sprinklers | | No Sprinklers | | Sprinklers | | No Sprinklers | | |
| | PD | UK | PD | UK | PD | UK | PD | UK | PD | UK | PD | UK | |
| A | / | 19.70% | / | 24.86% | / | 18.18% | / | 20.93% | / | 24.47% | / | 22.50% | |
| B | 72% | 35.86% | 43% | 38.94% | 72% | 27.27% | 19% | 17.44% | 66% | 26.60% | 42% | 30.61% | |
| C | C1 | 18% | | 32% | | | | 18% | | 22% | | 25% | |
| | C2 | 6% | 29.29% | 13% | 22.36% | 24% | 18.18% | 38% | 26.74% | 8% | 31.91% | 18% | 18.50% |
| | | | 9.60% | | | 18.18% | | 10.47% | | 9.57% | | 13.72% | |
| D | D1 | | | | | | | | | | | | |
| | D2 | 4% | 2.53% | 12% | 1.51% | 4% | 9.09% | 25% | 4.65% | 4% | 2.13% | 15% | 2.33% |
| | D3 | | 0.51% | | 3.67% | | 9.09% | | 13.95% | | 2.13% | | 8.17% |
| | | | 2.53% | | | 0.00% | | 5.81% | | 3.19% | | 4.17% | |

327

328 In *Pubs, clubs, restaurants*, all fire origin locations are considered and in UK, 96 fires are
329 reported when sprinklers are present and 11,429 when they are absent. Again, considerations
330 on fires with presence of sprinklers will be avoided. In Table 7, both area damaged and
331 frequency are described for PD 7974-7 and UK statistics. In this property type, in the absence
332 of sprinklers, the average area damaged for PD 7974-7 (24 m²) is almost half of the value found
333 for the *total damage* (41.25 m²). *Total damage* for absence of sprinklers appears approximately
334 three times greater than *fire damage* in the various classes of fire spread that could indicate
335 firefighting activities to extinguish the fire having an impact on the damage of the building.
336 Fire frequency which spreads beyond the room of origin in absence of sprinklers is equal to
337 17% and 21.5% for PD 7974-7 and UK statistics, respectively; and is approximately 30%
338 confined to item first ignited and 25% for no fire damage in UK fire statistics for both presence
339 and absence of sprinklers showing similar trends in fire frequency despite the difference in
340 number of fires (Table 7).

341 Table 7: Area damage, percentages of fires for *Pubs, clubs, restaurants* in PD 7974-7 and UK
342 statistics [F=Fire, T=Total]

| | Area damaged [m ²] | | | | | | Frequency | | | | |
|-------------|--------------------------------|-------|--------|---------------|-------|--------|------------|--------|---------------|--------|--------|
| | Sprinklers | | | No Sprinklers | | | Sprinklers | | No Sprinklers | | |
| | PD | UK | T | PD | UK | T | PD | UK | PD | UK | |
| A | / | 2.24 | 16.26 | / | 3.92 | 12.43 | / | 28.13% | / | 22.85% | |
| B | 1 | 3.48 | 93.82 | 1 | 2.21 | 9.11 | 59% | 31.25% | 26% | 32.71% | |
| C | C1 | 1 | | 2 | | | 15% | | 12% | | |
| | C2 | 4 | 7.27 | 34.50 | 15 | 8.08 | 44.50 | 19% | 27.08% | 45% | 22.94% |
| | | 1.88 | 188.88 | | 25.72 | 73.53 | | 4.17% | | 10.02% | |
| D | D1 | | | | | | | 4.17% | | 4.10% | |
| | D2 | 50 | 12.13 | 388.00 | 101 | 52.24 | 121.93 | 7% | | 17% | |
| | D3 | | 255.50 | 255.50 | | 181.01 | 237.27 | | 3.13% | | 3.57% |
| | | 41.75 | 93.00 | | 69.07 | 114.97 | | 2.08% | | 3.81% | |
| Average | 5 | 13 | 77.19 | 24 | 17 | 41.25 | | | | | |
| Total fires | | 96 | 96 | | 11429 | 11429 | | | | | |

343


344 In UK statistics, fires when sprinklers are reported are very limited in number if compared to
345 the ones for un-sprinklered buildings. Therefore, general comments on the fire spread when
346 sprinklers are present are difficult to deduce but, as found in the analysis with the USA statistics
347 [15], the average damage for presence of safety systems is in general less than the one for their
348 absence. Moreover, the area damage in UK and USA statistics [15] increases with the increase
349 of the spread of fire with *total damage* usually greater than the *fire damage*. Fire frequency

350 generally presents the highest values of spread within the room of origin for both countries
 351 with some peaks found for fires affecting the whole building. The room of origin usually
 352 represent a compartment and the analysis developed shows that compartmentation is effective.

353 7. Frequency distribution of area damage

354 Tables A.6, A.7 and A.8 in PD 7974-7:2003 are related to the frequency distribution of area
 355 damage in terms of number of fires in *Office buildings*, *Retail premises* and *Hotels* respectively
 356 recreated considering *Other buildings* dataset as Offices and call centres, Retail and
 357 Hotel/Motel. Since in UK fire statistics there is a further distinction in *fire* and *total damage*,
 358 the analysis has been developed considering both of them and plotting the results against PD
 359 7974-7 and USA trends [15]. Unfortunately, it is not clear if the area damage of PD 7974-7 is
 360 referred to the fire or total one. Presence and absence of sprinklers have also been investigated.

362 In *Office buildings*, three different fire origin locations are present in Table A.6 and these have
 363 been compared as follows: Office rooms as Meeting room/Office and Other rooms as all the
 364 other fire origin locations. In Office rooms, the fires reported in PD 7974-7 are 18 and 1,860
 365 while in UK statistics 15 and 1,342 respectively for presence and absence of sprinklers. In
 366 Other rooms, PD 7974-7 reports 127 and 4,369 while UK statistics 64 and 3,051 for sprinklers
 367 and no sprinklers. Based on Figure 7, it can be seen that the PD 7974-7 data are usually located
 368 between the UK *fire damage* and *total damage*, where the frequency of exceeding the damage
 369 bands upper limit is always less than 30% when sprinklers are present. The trends found for
 370 PD 7974-7 and UK statistics are relatively close and whose percentages are considerably less
 371 when compared to USA statistics.

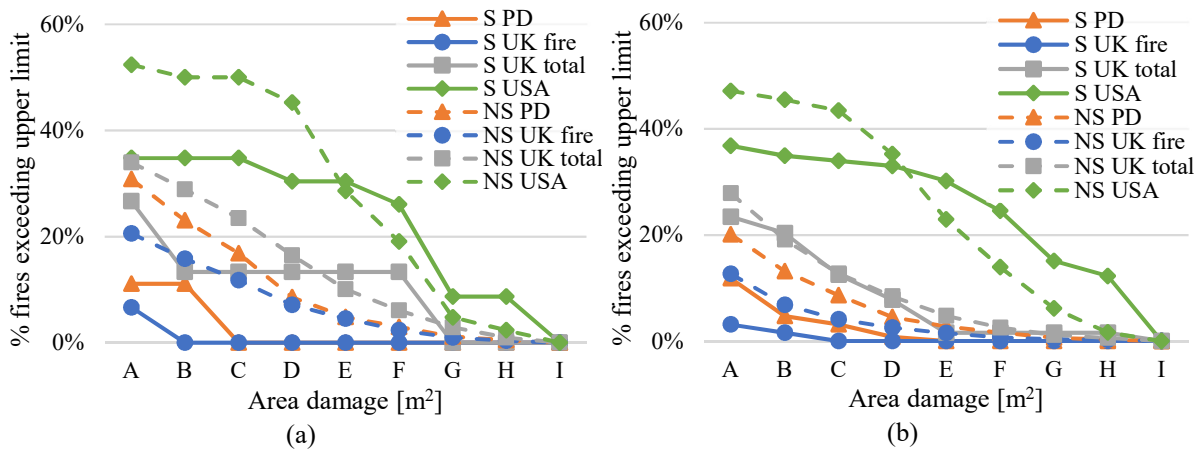


A. Up to 5 m²; B. 6 to 10 m²; C. 11 to 20 m²; D. 21 to 50 m²; E. 51 to 100 m²; F. 101 to 200 m²; G. 201 to 500 m²; H. 501 to 1000 m²; I. Over 1000 m²

372 Figure 7: Frequency distribution of area damage in *Office buildings* in (a) Office rooms and
 373 (b) Other rooms [S=Sprinklers; NS=No sprinklers] for PD 7974-7, UK and USA statistics
 374 [15]


375 Table A.7 for *Retail premises* considers three different fire origin locations: Assembly areas as
 376 Meeting room/Office and Corridor/Hall/Open Plan Area/Reception area; Storage areas as Store
 377 room/Laundry room/Cloakroom and Refuse store; Other areas as all the other fire origin
 378 locations. For the presence of sprinklers the fires recorded are 223 and 37 in Assembly areas,
 379 354 and 55 in Storage areas and 183 and 322 in Other areas, respectively for PD 7974-7 and
 380 UK fire statistics. When building fires with no sprinklers are considered, fires are 8,207 and
 381 851 in Assembly areas, 5,144 and 1,672 in Storage areas and 7,194 and 9,378 for Other areas
 382 in PD 7974-7 and UK statistics, respectively. In Figure 8, similar comments can be deduced
 383 for the three fire origins where the trends for sprinklers have lower values than the ones for no

384 sprinklers except for *total damage* which assumes an opposite trend with percentages of fires
 385 exceeding 20 m² usually greater than 10%. Furthermore, PD 7974-7 values are generally
 386 greater than the ones for UK *fire damage* but less than the one of UK *total damage*. USA
 387 statistics presents values greater than UK where despite the initial peaks for no safety systems,
 388 trends show a less rapid decrease for sprinklers.

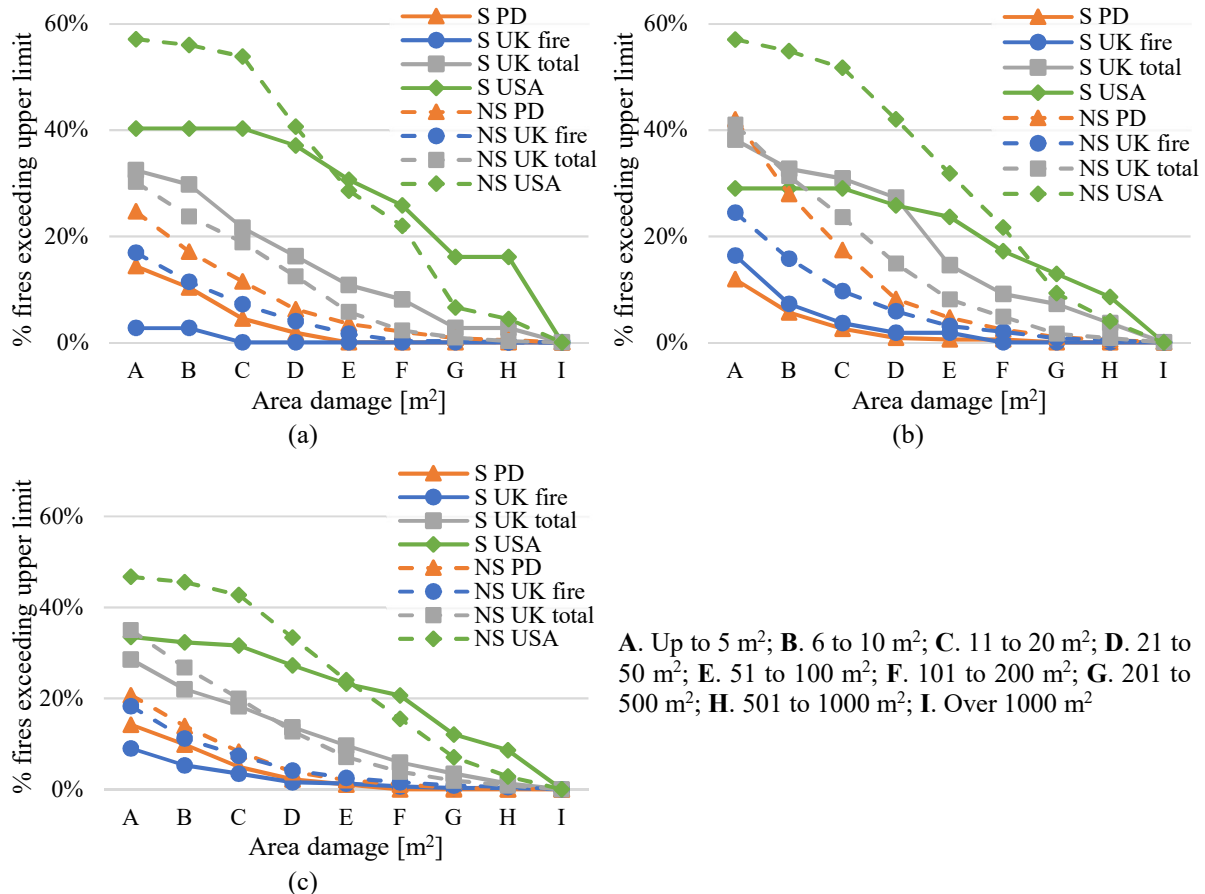

389 Figure 8: Frequency distribution of area damage in *Retail premises* in (a) Assembly areas, (b)
 390 Storage areas and (c) Other areas [S=Sprinklers; NS=No sprinklers] for PD 7974-7, UK and
 391 USA statistics [15]

392 Finally, for *Hotels*, three different fire origin locations are assessed: Storage and other areas as
 393 Store room/Laundry room/Cloakroom and Refuse store; Assembly areas as
 394 Corridor/Hall/Open Plan Area/Reception Area and Meeting Room/Office; Bedrooms as
 395 Bedroom/Bedsitting room. In Assembly areas and Bedrooms only fires in buildings without
 396 sprinklers are considered while for Storage and other areas, presence and absence of safety
 397 systems are evaluated in PD 7974-7. When fires in buildings with sprinklers are analysed, the
 398 total number recorded in Storage and other areas is 35 for PD 7974-7 and 10 for UK statistics
 399 and, due to the small sample, no comments are expressed. When sprinklers are absent, there
 400 are 3,821 and 304 in Storage and other areas, 518 and 167 in Assembly areas and 1,205 and
 401 366 in Bedrooms in PD 7974-7 and UK statistics, respectively. Even when *Hotels* are analysed,
 402 similar comments can be expressed as for the other two property types, with percentage of fire
 403 exceeding 100 m² damage approximately less than 10% in the three fire origin locations (Figure
 404 9). The only difference is found in Storage and other areas where percentages for sprinklers are
 405 higher than the ones for no sprinklers buildings for total fire possibly due to the limited number
 406 of fire recorded for presence of safety systems. Moreover, USA shows for these fire origin
 407 location, percentages relatively similar to the ones found for *total damage* in UK (Figure 9 (a)).

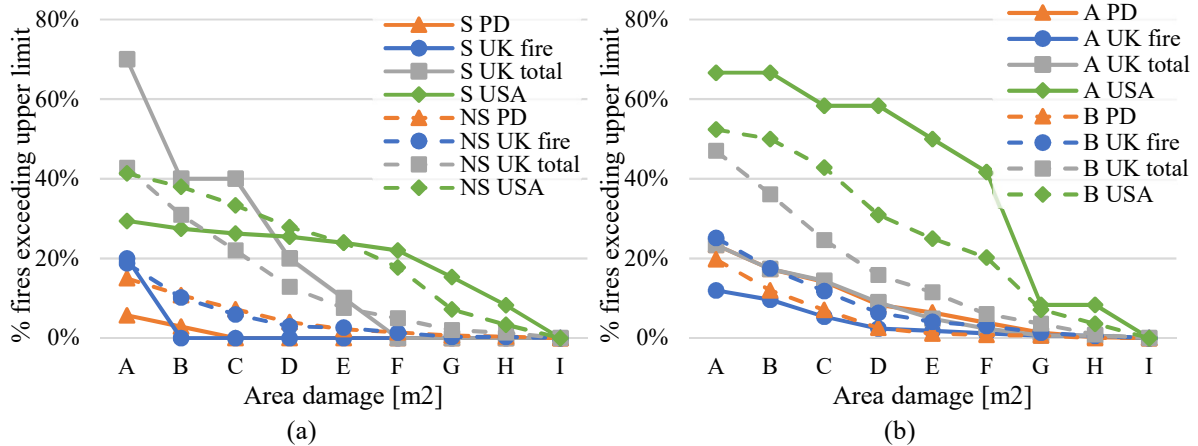

A. Up to 5 m²; B. 6 to 10 m²; C. 11 to 20 m²; D. 21 to 50 m²; E. 51 to 100 m²; F. 101 to 200 m²; G. 201 to 500 m²; H. 501 to 1000 m²; I. Over 1000 m²

408 Figure 9: Frequency distribution of area damage in *Hotels* in (a) Storage and other areas
 409 [S=Sprinklers, NS=No Sprinklers] and (b) Assembly areas (A) and Bedrooms (B) only for no
 410 sprinklers in PD 7974-7, UK and USA statistics [15]

411 Similar results have been found for the analysis of three property types and different fire
 412 locations when PD 7974-7 is compared to UK and USA statistics. In general, PD 7974-7 seems
 413 to overestimate the *fire damage* and underestimate the *total damage* if compared to UK
 414 statistics but it is closer to UK predictions than those found using USA statistics [15].

415 Conclusions

416 This paper has presented a comparison of fire statistics, developed from the UK and USA fire
 417 incident reporting systems, with historical data that can be found within the recently superseded
 418 British Standards Published Document on probabilistic fire risk assessments (PD 7974-
 419 7:2003). It appears that some significant improvements of fire safety in UK have been
 420 introduced over the last 30 to 50 years. This could be due to the modern technologies in safety
 421 devices, new construction techniques and materials or the application of performance based
 422 design approaches. However, it is difficult to define which of the abovementioned factors have
 423 an implication because it would be necessary to investigate the evolution of yearly data and
 424 more detailed fields of fire statistics related to the fire safety design of the building affected by
 425 fire. Moreover, the IRS was only recently introduced and before 2008 a different methodology
 426 was adopted for the collection of data. The aim is to provide contemporary fire statistics for
 427 use with the new BS PD 7974-7:2019 and to comment on any differences between the datasets.
 428 From this work it is possible to conclude:

- 429 • PD 7974-7:2003 fire frequency usually overestimates the values of both UK and USA
 430 fire statistics in 2014/15 except for *Schools* in USA which assumes a value of 5.512×10^{-2}
 431 fires per year compared to 4.0×10^{-2} .
- 432 • PD 7974-7:2019 fire frequency matches well with UK statistics data apart from for
 433 *Hospitals* where fires according to PD 7974-7:2019 are half as frequent as found from
 434 UK statistics, with a fire predicted every 18 years.
- 435 • When fire frequency is plotted against the total floor space, PD 7974-7:2003 positive
 436 exponent method is significantly different than the prediction provided by
 437 contemporary UK and USA statistics data.
- 438 • Polynomial relationships better represent fire frequency to floor space and are
 439 particularly accurate when assessing the USA data (R^2 values regularly greater than
 440 0.98), however are less accurate when assessing the UK fire statistics (R^2 values

441 regularly lower than 0.72). Despite the polynomial function well describes small total
442 floor space, further investigations could consider a constant conservative value to
443 address the scarce data present moving towards extreme total floor spaces.

- 444 • Analysing the area damage and percentage of fires for *Industrial manufacturing* and
445 *Pubs, clubs, restaurants*, PD 7974-7 is usually greater than data of UK fire statistics.
- 446 • In both PD 7974-7:2003 and UK statistics, fires are generally confined to the room of
447 origin between 65-80% of the time depending on occupancy type.
- 448 • In general, in UK and USA the average area damage increases with the fire spread.
- 449 • For the frequency of fires exceeding an upper limit of area damage, the UK *fire damage*
450 is in general, less than the frequencies presented in PD 7974-7:2003, whereas *total*
451 *damage* is in general higher; the exception is in *Hotels* where *fire damage* and PD 7974-
452 7 assume similar values.
- 453 • Comparing UK and USA data for the frequency of fires exceeding an upper limit of
454 area damaged, there is always more damage recorded in the USA (apart from the
455 sprinklered Storage and other areas in *Hotels* which suffer from a small UK dataset)

456 Further work will be focused on the application of fire safety data in the evaluation of
457 probabilistic risk assessments and future fire statistics investigated to ensure that data are
458 representative of fires and useful in the fire design of buildings in UK and USA.

459 **Acknowledgements**

460 The authors would like to thank the Home Office and the US Fire Administration for providing
461 their fire statistics datasets and enabling the development of this research.

462 **References**

- 463 [1] B. J. Meacham, “Risk-Informed Performance-Based Approach to Building Regulation
464 1,” *J. Risk Res.*, vol. 13, no. 7, pp. 877–893, 2010.
- 465 [2] The British Standards Institution, “PAS 911:2007 Fire strategies – Guidance and
466 framework for their formulation,” 2007.
- 467 [3] Y. Wang, I. Burgess, F. Wald, and M. Gillie, *Performance-Based Fire Engineering of*
468 *Structures*. CRC Press, 2012.
- 469 [4] The British Standards Institution, *BS 7974: Application of Fire Safety Engineering*
470 *Principles to the Design of Buildings - Code of Practice*. 2019.
- 471 [5] D. Rush, L. Bisby, I. Ioannou, and T. Rossetto, “Towards fragility analysis for concrete
472 buildings in fire: residual capacity of concrete columns,” in *8th SiF*, 2014, pp. 467–474.
- 473 [6] L. Bisby, J. Gales, and C. Maluk, “A contemporary review of large-scale non-standard
474 structural fire testing,” *Fire Sci. Rev.*, vol. 2, no. 1, 2013.
- 475 [7] G. V. Hadjisophocleous and N. Benichou, “Performance criteria used in fire safety
476 design,” *Autom. Constr.*, vol. 8, no. 4, pp. 489–501, 1999.
- 477 [8] M. Manes and D. Rush, “Meta-analysis of response times and safety systems to the fire
478 size, growth and damage, based on UK, USA and New Zealand fire statistics
479 databases.,” *2nd Int. Conf. Struct. Saf. under Fire Blast Load. (CONFAB 17)*, pp. 108–
480 117, 2017.
- 481 [9] M. Manes and D. Rush, “Meta-analysis of UK , USA and New Zealand fire statistics
482 databases with respect to damage and financial loss.,” in *Applications of Fire*
483 *Engineering: Proceedings of the International Conference of Applications of Structural*
484 *Fire Engineering (ASFE 2017)*, 2017, pp. 179–188.
- 485 [10] G. Ramachandran and D. Charters, *Quantitative risk assessment in fire safety*.
486 Routledge, 2011.
- 487 [11] Apostolakis G.E., “How Useful Is Quantitative Risk Assessment?,” *Risk Anal.*, vol. 24,

- 488 no. 3, pp. 515–520, 2004.
- 489 [12] The British Standards Institution, *PD 7974-7 Application of fire safety engineering*
490 *principles to the design of buildings — Part 7: Probabilistic risk assessment*. 2003.
- 491 [13] The British Standards Institution, *PD 7974-7 Application of Fire Safety Engineering*
492 *Principles to the Design of Buildings - Part 7: Probabilistic risk assessment*. 2019.
- 493 [14] R. Van Coile, D. Hopkin, D. Lange, G. Jomaas, and L. Bisby, “The Need for Hierarchies
494 of Acceptance Criteria for Probabilistic Risk Assessments in Fire Engineering,” *Fire*
495 *Technol.*, vol. 55, no. 4, pp. 1111–1146, 2019.
- 496 [15] M. Manes and D. Rush, “A Critical Evaluation of BS PD 7974-7 Structural Fire
497 Response Data Based on USA Fire Statistics,” *Fire Technol.*, vol. 55, no. 4, pp. 1243–
498 1293, Oct. 2018.
- 499 [16] Home Office, “Fire and rescue incident statistics: England, year ending March 2018.
500 FIRE 0102,” 2018.
- 501 [17] Home Office, “Fire and rescue incident statistics: England, year ending March 2018.
502 FIRE 0204,” 2018.
- 503 [18] Ben Evert, “Fire Loss In The United State During 2017,” *Natl. Fire Prot. Assoc.*, 2018.
- 504 [19] G. Ramachandran, “Fire safety management and risk assessment,” *Facilities*, vol. 17,
505 no. 9/10, pp. 363–377, 1999.
- 506 [20] The British Standards Institution, *BS EN ISO 22313 Societal security – Business*
507 *continuity management systems – Guidance*. 2014.
- 508 [21] The British Standards Institution, *BS EN ISO 22301 Societal security – Business*
509 *continuity management systems – Requirements*. 2014.
- 510 [22] Home Office, “Publishing Incident Recording System data on the fire and rescue service
511 at an incident level: Project overview,” 2017.
- 512 [23] Home Office, “Fire statistics collection,” 2019. [Online]. Available:
513 <https://www.gov.uk/government/collections/fire-statistics>. [Accessed: 11-Aug-2019].
- 514 [24] Home Office, “Publishing Incident Recording System data on the fire and rescue service
515 at an incident level: ‘Other building’ fires dataset guidance,” 2017.
- 516 [25] USFA, “National Fire Incident Reporting System,” vol. 2014, no. 12/31, 2014.
- 517 [26] Valuation Office Agency, “Non-domestic rating: Stock of Properties England and
518 Wales, 2010 Rating List,” 2016.
- 519 [27] U.S. Energy Information Administration, “Independent statistics & analysis.” [Online].
520 Available: <https://www.eia.gov>. [Accessed: 15-Jul-2019].
- 521 [28] U.S. Energy Information Administration, “Commercial Buildings Energy Consumption
522 Survey.” [Online]. Available: <https://www.eia.gov/consumption/commercial/>.
523 [Accessed: 15-Jul-2019].
- 524 [29] U.S. Energy Information Administration, “Manufacturing Energy Consumption
525 Survey.” [Online]. Available: <https://www.eia.gov/consumption/manufacturing/>.
526 [Accessed: 15-Jul-2019].
- 527 [30] R. D’Addario, *Considerazioni sul tasso di premio delle assicurazioni incendi*. Bari,
528 1940.
- 529 [31] G. Ramachandran, “Fire loss indexes,” *Fire Reserach Note No 839*, 1970.
- 530 [32] R. Rutstein, “The probability of fire in different sectors of industry,” *Fire Surv.*, vol. 8,
531 no. 1, pp. 20–23, 1979.
- 532 [33] United States Census Bureau, “Statistical Abstract of The United States 2012,” 2012.
- 533 [34] M. H. Faber, *Statistics and probability theory: in pursuit of engineering decision*
534 *support.*, vol. 18. 2012.
- 535 [35] A. Rebekić, Z. Lončarić, S. Petrović, and S. Marić, “Pearson’s or Spearman’s
536 Correlation Coefficient-Which One To Use?,” *Poljopr.*, vol. 21, no. 2, pp. 47–54, 2015.
- 537 [36] M. Lovric, *International Encyclopedia of Statistical Science*. 2011.
- 538

| | | |
|-----|--|----|
| 539 | Figure captions: | |
| 540 | Figure 1: Frequency of fire starting <i>Industry and manufacturing</i> (a) PD 7974-7 and UK | |
| 541 | statistics, (b) only UK | 6 |
| 542 | Figure 2: Frequency of fire starting <i>Storage</i> (a) PD 7974-7 and UK statistics, (b) only UK | 6 |
| 543 | Figure 3: Frequency of fire starting <i>Shops</i> (a) PD 7974-7 and UK statistics, (b) only UK..... | 7 |
| 544 | Figure 4: Frequency of fire starting <i>Offices</i> (a) PD 7974-7 and UK statistics, (b) only UK..... | 7 |
| 545 | Figure 5: Frequency of fire starting <i>Hospitals</i> (a) PD 7974-7 and UK statistics, (b) only UK . | 8 |
| 546 | Figure 6: Frequency of fire starting <i>Schools</i> (a) PD 7974-7 and UK statistics, (b) only UK | 8 |
| 547 | Figure 7: Frequency distribution of area damage in <i>Office buildings</i> in (a) Office rooms and (b) | |
| 548 | Other rooms [S=Sprinklers; NS=No sprinklers] for PD 7974-7, UK and USA statistics [15] | 12 |
| 549 | Figure 8: Frequency distribution of area damage in <i>Retail premises</i> in (a) Assembly areas, (b) | |
| 550 | Storage areas and (c) Other areas [S=Sprinklers; NS=No sprinklers] for PD 7974-7, UK and | |
| 551 | USA statistics [15] | 13 |
| 552 | Figure 9: Frequency distribution of area damage in <i>Hotels</i> in (a) Storage and other areas | |
| 553 | [S=Sprinklers, NS=No Sprinklers] and (b) Assembly areas (A) and Bedrooms (B) only for no | |
| 554 | sprinklers in PD 7974-7, UK and USA statistics [15] | 14 |
| 555 | | |