

Bulk water distribution power supply failures

D T Nel, J Haarhoff

This paper considers the probability of power supply failures at bulk water distribution pump stations. Electrical power supply is important within the bulk water distribution environment, particularly when pumping is required. Reliability of power supply is commonly expressed by means of indices, such as amongst others, the SAIDI and SAIFI indices as defined by the Institute of Electrical and Electronics Engineering (IEEE). These indices are used to calculate the probability of failure associated with power supply. Data was obtained from a number of sources and used to benchmark the reliability of South African power supply against that of other countries. The reliability of power supply from seven South African Water Board (Rand Water) pump stations is also analysed. Limited data seems to be available that allows one to quantify the reliability of pump systems, taking into account the reliability of the various system components.

INTRODUCTION

The reliability of bulk water distribution could be compromised by a number of factors. An obvious cause of service interruption is failure of the pipeline itself, while a less commonly encountered cause may be contributed to the failure of a pipeline that passes through a dolomitic area subject to sinkhole formation. For comprehensive risk management, bulk water suppliers have to consider all the possible factors that could impact on their reliability of supply, and find quantitative estimates of each.

This paper considers yet another risk factor, namely the probability of power supply failure at bulk water distribution pump stations. Electrical power supply is important within the bulk water distribution environment when pumping is required. Power supply failures have different causes, such as power generation plant failures, distribution system faults, substation failures, blown transformers, faulty fuses, faulty breakers, lightning storms, natural disasters, etc. From the perspective of the bulk water supplier, these distinctions are of less interest. This paper will therefore only consider their combined effect.

POWER SUPPLY RELIABILITY MEASURES

The characterisation of electricity supply performance is based upon the determination of the number of interruptions per year, as well as the sum of the duration of all interruptions during one year (Bollen *et al* 2006). Network operators use different definitions to express power supply reliability.

■ The electricity utility industry commonly uses the Institute of Electrical and Electronics Engineering (IEEE) reliability indices to track and benchmark power

supply reliability. The IEEE Standard 1366-2003 defines reliability indices to foster uniformity in the development of electricity distribution reporting practices by utilities (Eto *et al* 2008).

■ The recently completed NRS 048-8 specification provides the requirements for reporting the network interruption performance of high voltage and extra high voltage networks in the South African Electricity Supply Industry. The aim of the specification is to evaluate and track the overall performance of South African electricity supply systems (Chatterton *et al* 2009).

The two most frequently used indices are the System Average Interruption Duration Index (SAIDI) and the System Average Interruption Frequency Index (SAIFI), denoted by Equations (1) and (2) respectively (Bollen *et al* 2006; Chatterton *et al* 2009, Jadrijevic *et al* 2009). The SAIDI index gives information about the average time that customers are interrupted during a period of one year, and it is commonly referred to as the customer minutes of interruption. The SAIFI index gives information about the average frequency of sustained interruptions per customer. Both these indices are normally reported over a time period of one year for a particular area.

$$SAIDI = \frac{\sum_{i=1}^I K_i D_i}{K} \quad (1)$$

$$SAIFI = \frac{\sum_{i=1}^I K_i}{K} \quad (2)$$

where

SAIDI is the System Average Interruption Duration Index in minutes/consumer/year

TECHNICAL PAPER

JOURNAL OF THE SOUTH AFRICAN INSTITUTION OF CIVIL ENGINEERING

Vol 53 No 1, April 2011, Pages 55–60, Paper 765



DANIE NEL, who is a member of SAICE, obtained his bachelor and master's degrees in civil engineering at the then Rand Afrikaans University and his D Ing degree at the University of Johannesburg. He spent his career in the municipal and bulk water supply environment and is currently an independent consultant. He has vast experience in many of the disciplines

related to the provision, operation and maintenance of civil engineering infrastructure, bulk water supply infrastructure projects, risk assessment related to bulk water distribution, management, pipeline risk assessment in dolomitic areas, as well as bulk sanitation services.

Contact details:

PO Box 112
Meyerton
1961
South Africa
T: +27 (0)16 362 0772
F: +27 (0)86 550 3544
E: dacl@absmail.co.za



JOHANNES HAARHOFF, who is a Fellow of SAICE, graduated as civil and environmental engineer at the University of Stellenbosch and Iowa State University. Prof Haarhoff spent the first part of his career in municipal employ, civil construction, design and project management before joining the University of Johannesburg in 1990, where he leads the Water Research Group.

This group focuses on both applied and fundamental aspects of drinking water treatment and supply.

Contact details:

PO Box 524
Auckland Park
2006
South Africa
T: +27 (0)11 559 2148
F: +27 (0)11 559 2395
E: jhaarhoff@uj.ac.za

Keywords: bulk water supply, pump stations, power supply, failure probability, reliability

SAIFI is the System Average Interruption Frequency Index per year
 i represents an interruption event
 D_i is the restoration time for each interruption event.
 K_i is the number of interrupted customers for each sustained interruption event during the reporting period
 K is the total number of customers served for the area considered

The SAIDI and SAIFI indices, as defined above, allow utilities to integrate their performance across their entire customer base. The customer base can be demarcated into different areas, or may consider different groups of customers to assess and benchmark how they experience interruptions of different durations at different times. The indices do not portray an individual customer's unique experience with respect to power supply reliability, but represent average values as experienced by all the customers in an area. From the perspective of any single customer, however, the interest narrowly lies in the availability of power to that customer at any given moment. The SAIDI index then simplifies to the total minutes of interrupted power per year, and the SAIFI index to the number of interruptions per year.

Nevertheless, the SAIDI index can be used to calculate the average availability of the power supply at a point, and consequently also the probability of failure, as shown in Equations (3) and (4).

$$Availability = 1 - \frac{SAIDI}{365 * 24 * 60} \quad (3)$$

$$P_{ps}(failure) = 1 - Availability \quad (4)$$

The SAIFI index can be used to calculate the average frequency of power supply outages at a point, as follows:

$$Frequency_{pf}(d) = \frac{365}{SAIFI} \quad (5)$$

POWER SUPPLY RELIABILITY DATA

Data obtained from a number of sources that quoted values related to the SAIDI and SAIFI indices are given in Table 1, namely:

- Ramakrishna *et al* (2009) quote values related to the two above-mentioned indices for various countries.
- Eto *et al* (2008) provided average values in respect of the SAIDI and SAIFI indices, based on an assessment of information reported to the State Public Utility Commission in the USA during 2006 by 123 utilities. The USA is divided into nine census divisions and Table 1 summarises

Table 1 Power supply reliability criteria – selected countries / districts

Country / district / period	SAIDI (minutes)	SAIFI (number)	Power supply reliability			Frequency of power failures (days)
			Availability	$P_{ps}(failure)$		
				(-)	(hours/yr)	
Selected countries (after Ramakrishna <i>et al</i> 2009)						
Baltimore - USA	120	1,26	0,9998	0,0002	2,00	290
Netherlands	20	0,23	1,0000	0,0000	0,33	1587
New Zealand	120	1,00	0,9998	0,0002	2,00	365
India	1 00 800	40	0,8082	0,1918	1 680,00	9
USA census divisions (after Eto <i>et al</i> 2008)						
New England	198	1,44	0,9996	0,0004	3,30	254
Middle Atlantic	225	1,28	0,9996	0,0004	3,75	285
East North Central	498	1,46	0,9991	0,0009	8,30	250
West North Central	166	1,31	0,9997	0,0003	2,77	279
South Atlantic	320	1,86	0,9994	0,0006	5,33	196
West South Central	56	1,38	0,9999	0,0001	0,93	265
Mountain	58	1,22	0,9999	0,0001	0,97	299
Pacific	214	1,99	0,9996	0,0004	3,57	183
Eskom, South Africa (after Eskom 2007)						
2006	2 910	28,4	0,9945	0,0055	48,50	12,9
2007	3 084	25,2	0,941	0,0059	51,40	14,5

Table 2 Reliability of pump station components (after Cullinane 1985)

Pump unit sub-system	MTBF (years)	MTTR (hours)	Reliability (-)	$P(failure)$	
				(-)	(hours/year)
			Calculated from Equations (7) and (8)		
Pumps	3,66	9,54	0,99970	0,00030	2,61
Motors	7,61	6,85	0,99990	0,00010	0,90
Controls	9,54	3,69	0,99996	0,00004	0,39
Power transmission	4,07	2,20	0,99994	0,00006	0,54
Valves	1,65	11,61	0,99920	0,00080	7,03
Overall			0,99869	0,00131	11,46

the data associated with the reported power failures. The information collected represented over 77% of total electricity sales by state-regulated investor-owned utilities or nearly 60% of total US electricity sales. No data was provided for the East South Central census district.

- Data reported by Eskom (the power supply utility in South Africa) in respect of the SAIDI and SAIFI indices (Eskom 2007).

Equations (3), (4) and (5) were used to calculate the power supply availability, probability of failure and the frequency of power outages in respect of the data obtained, and the calculated values are reflected in Table 1.

The data provided above should be used to compare performance and reliability of power supply within an area, or even amongst different areas. It is not recommended that it is used to compare the performance of utilities with one another, since a range of issues could influence the values of the reported indices, such as local conditions, the network characteristics, the available operations and maintenance personnel, the definition of an interruption event, climate, etc.

THE OVERALL RELIABILITY OF PUMP UNITS

The reliability of a pump unit is a function of a number of sub-system reliabilities (Cullinane 1985). Cullinane indicated that the reliability of a pump unit, in essence a series system, can be calculated by applying Equation (6).

$$R_s = R_P * R_M * R_C * R_{PT} * (R_V)^2 \quad (6)$$

where

- R_s is the reliability of the pumping system
- R_P is the reliability of the pump
- R_M is the reliability of the motor
- R_C is the reliability of the control unit
- R_{PT} is the reliability of the power transmission
- R_V is the reliability of the valves (1 intake and 1 delivery valve)

Table 2 (Cullinane 1985) quotes failure values reported in 1981 by Schultz, namely the mean time between failure (MTBF) and mean time to repair (MTTR), related to the different pump system components. From these parameters, the reliability (R) was calculated using Equation (7), while the

Table 3 Rand Water distribution pump station power failure statistics (after Mbula 2008)

Pump station	External trip statistics				
	Year	Number of failure events	Minimum failure duration (minutes)	Average failure duration (minutes)	Maximum failure duration (minutes)
A	2005	15	7	113	767
	2006	37	2	110	1190
	2007	16	8	99	452
	Average	23	2	108	1190
B	2005	4	20	111	282
	2006	7	12	207	900
	2007	14	19	136	606
	Average	8	12	152	900
C	2005	13	1	88	475
	2006	9	1	126	855
	2007	5	15	55	95
	Average	9	1	94	855
D	2006	3	1	60	150
	2007	3	65	534	940
	Average	3	1	297	940
E	2005	11	2	80	190
	2006	11	15	54	108
	2007	19	1	63	248
	Average	14	1	65	248
F	2005	11	1	85	475
	2006	13	1	112	876
	2007	23	1	18	145
	Average	16	1	60	846
G	2005	3	30	78	135
	2006	6	25	34	60
	2007	5	20	84	180
	Average	5	20	62	180
All combined		11,4		96	

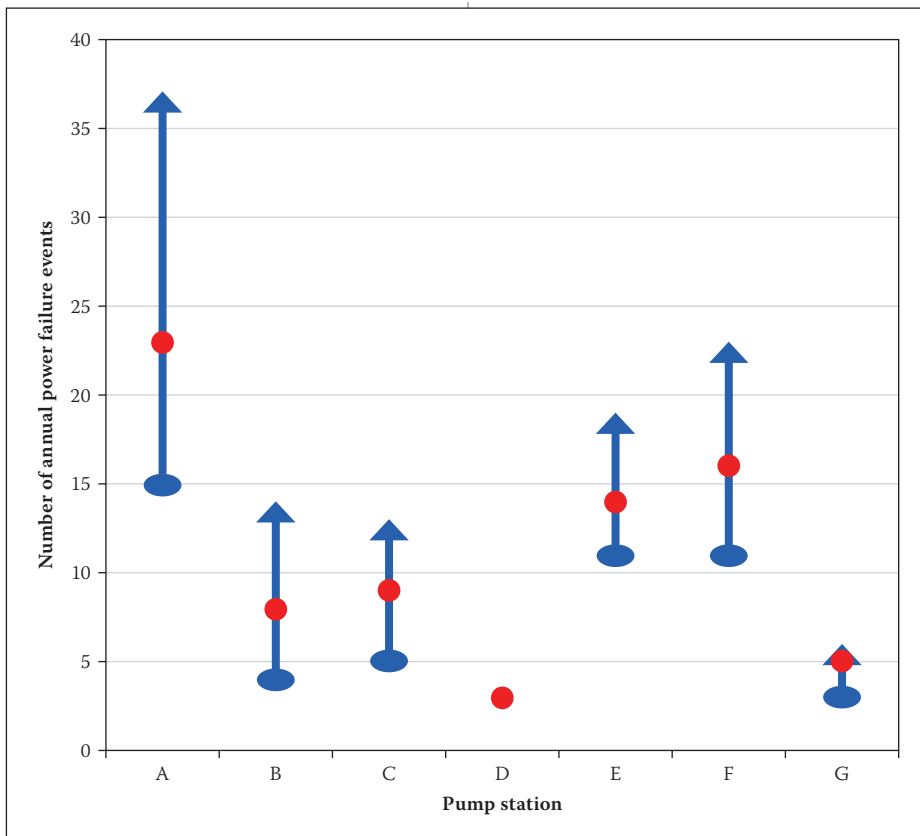


Figure 1 Range of power failure events occurring – Rand Water pump stations

probability of failure was calculated using Equation (8).

$$R = \left[\frac{MTBF * 8760}{MTTR + (MTBF * 8760)} \right] \quad (7)$$

$$P(failure) = (1 - R) * 8760 \quad (8)$$

where

R is the reliability of the relevant component of the pump system

MTBF is the mean time between failures in years

MTTR is the mean time to repair in hours

P(failure) is the probability of failure of the power supply in hours/year

BULK WATER DISTRIBUTION PUMP STATION POWER FAILURES

To provide more detailed insight into the reliability of power supply of a bulk water supply utility, data collected by Rand Water (a Water Board in South Africa) from seven of its pump stations was obtained. Rand Water uses the term “trip” to define any failure of a pump unit to operate (irrespective of the cause). Trips, in turn, are divided into internal and external trips (Fredericks *et al* 2007).

- An internal trip is caused by failure of direct components of the pump or motor (mechanical, electrical or structurally related). An internal trip can be overcome by utilising a standby pump unit.
- An external trip is associated with failure of power supply to the pump station itself. As stated before, power supply failures have different causes, such as power generation plant failures, distribution system faults, substation failures, blown transformers, faulty fuses, faulty breakers, lightning storms, natural disasters, etc. As such, the reliability of supply therefore considers their combined effect. In the event of an external trip, none of the duty and standby pump units affected will be operational.

The power supply failure data (external trips only) for seven of Rand Water’s large pump stations (Mbula 2008) were analysed and the results are summarised in Table 3. For strategic reasons, the names of the pump stations are omitted.

The minimum, average and maximum values in respect of the number of power failures and the power failure durations recorded at the various pump stations are presented graphically in Figures 1 and 2 respectively. Over all the pump stations the average number of external trips was 11,4 per year, and the average duration of the external trips was 96 minutes.

The data presented in Table 3 was used to determine the probability of failure associated with power failures at the Rand Water pump stations using Equations (7) and (8). The results thereof are presented in Table 4.

The probability of failure of power supply at the various pump stations, compared to the system average, is shown graphically in Figure 3.

THE STOCHASTIC NATURE OF POWER FAILURES

The data above merely presents the probability of a power failure and the duration thereof as single values. However, the statistics presented graphically in Figures 1 and 2 indicate that both the number of external trips, and their duration, show variability. This aspect is important for modelling power failure events within a hydraulic network simulation program using Monte Carlo simulation methods.

Monte Carlo simulation methods require that each stochastic variable be described by its cumulative frequency distribution function. A logical model of the system being analysed is repeatedly analysed, each time with a different set of input parameters for every time step. The selection of each of the stochastic input parameter values is made randomly, governed by the cumulative frequency distribution function of each variable parameter and its performance criterion.

The power failure data was analysed using a software program (EasyFit Professional Version 5.1) to select the numerical function that provides a good fit in respect of the number and duration of the power failures respectively. The Kolmogorov-Smirnov test was applied to test the goodness of fit of the data compared to a range of hypothesised distribution functions. The Kolmogorov-Smirnov statistic is based on the largest vertical difference between the theoretical and empirical cumulative distribution function. The program also calculates the so-called P-value, based on the test statistic, and this value is used to verify the threshold value of the significance level in the sense that the null hypothesis (H_0) will be accepted for all values of α less than the P-value. The respective cumulative distribution functions for the sample data, as well as the selected statistical distributions in respect of the number and duration power failure events, are reflected graphically in Figures 4 and 5 respectively. The parameters of the probability density functions that may be used to simulate the pipeline failure rates in respect of the power failure duration and the number of power failure events occurring,

Table 4 Reliability of Rand Water pump stations due to external trips

Pump station	Reliability (-)	P(failure)	
		(-)	(hours/year)
A	0,99530	0,00470	41,2
B	0,99769	0,00231	20,2
C	0,99839	0,00161	14,1
D	0,99831	0,00169	14,8
E	0,99827	0,00173	15,1
F	0,99818	0,00182	16,0
G	0,99976	0,00024	5,17
All pump stations combined*	0,99917	0,00083	18,24

* The calculated results are based on the statistical analysis of all the recorded failure events of all the pump stations

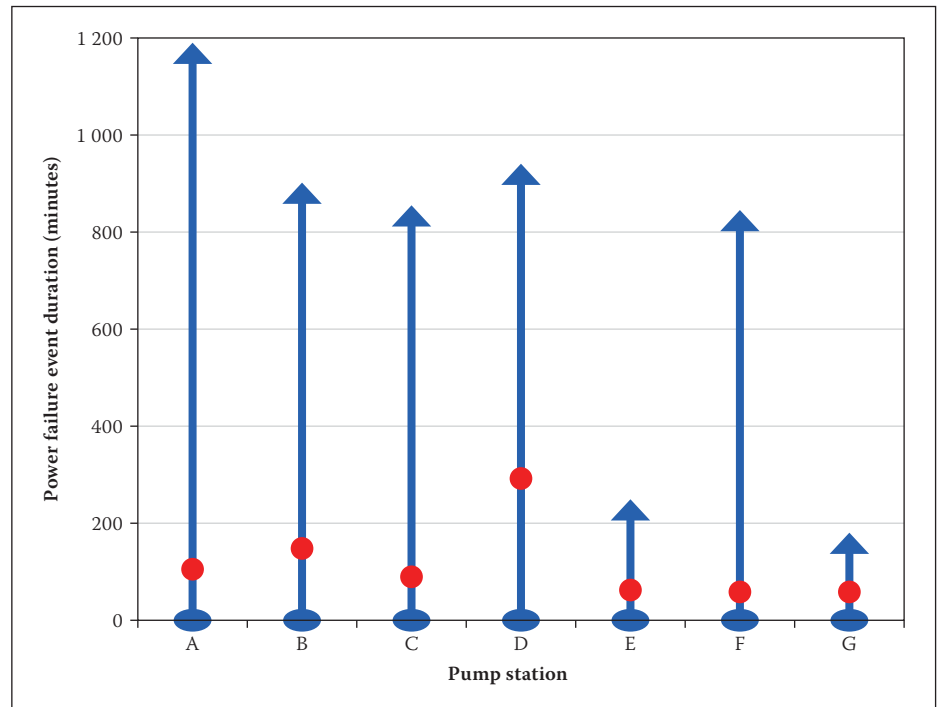


Figure 2 Range of power failure durations – Rand Water pump stations

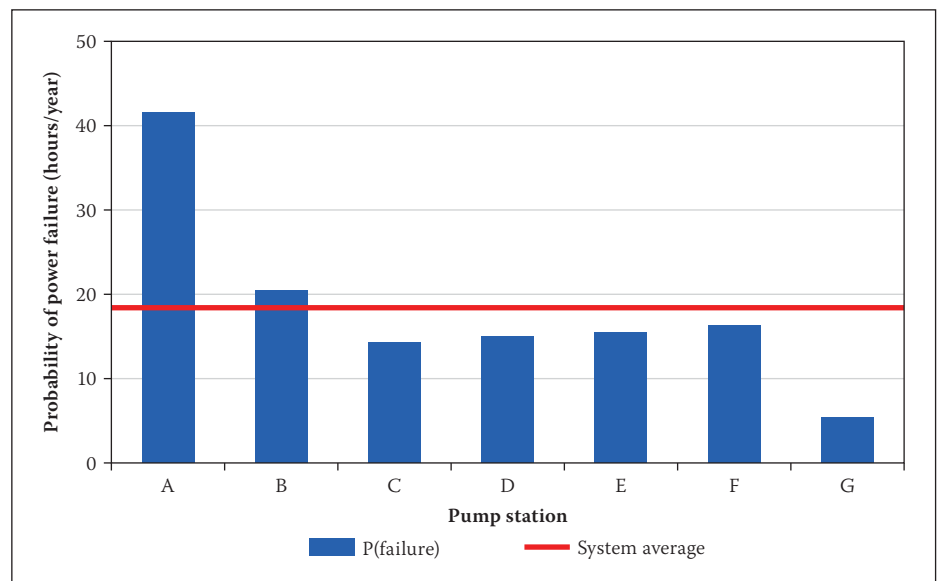


Figure 3 Rand Water pump station probability of failure associated with power failures

as well as the Kolmogorov-Smirnov statistic and the value of the highest significance level associated with the fitted distribution functions, are given in Table 5. The

variables in the lognormal distributions are to the base e.

Further credence to the lognormal fit obtained is given by the analysis of Zaretski

Table 5 Pump station power failures – fitted distributions

Parameter	Fitted distribution details			
	Distribution	Distribution parameters	Kolmogorov Smirnov statistic	Highest level of significance (α)
Number of annual power failures	Lognormal	$\sigma = 0,70$ $\mu = 2,20$	0,16	$\leq 0,2$
Duration of power failures (hours)	Lognormal	$\sigma = 1,54$ $\mu = -0,61$	0,04	$\leq 0,2$

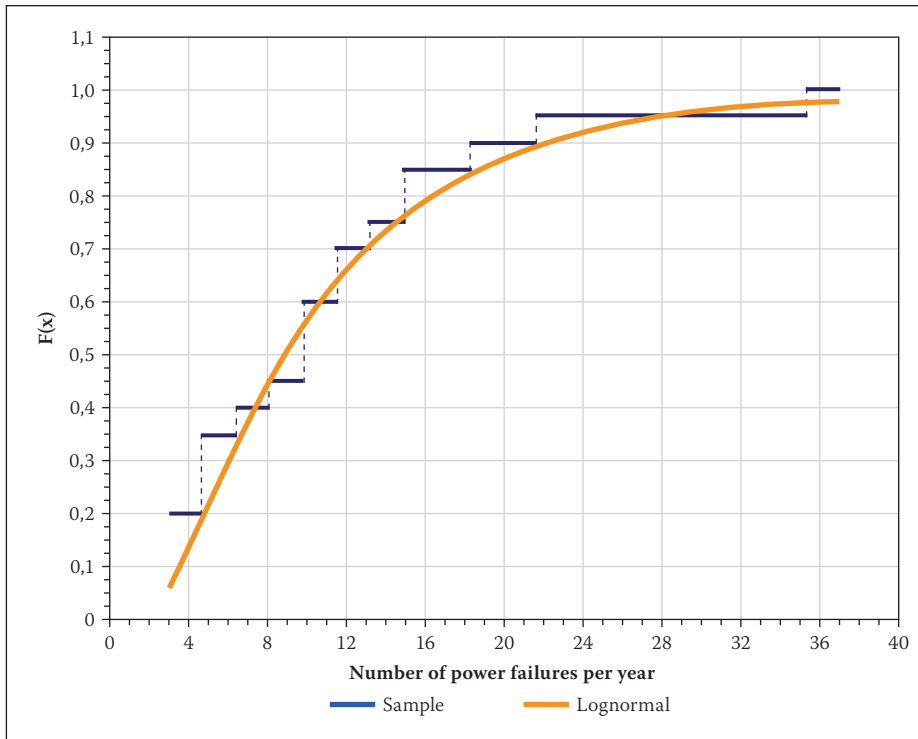


Figure 4 Number of power failures – cumulative distribution function (Rand Water pump stations)

et al (2009). The authors reported on large-scale power failures recorded in the USA during the period 1984 to 2006, using data obtained from the Department of Energy’s Information Administration website and the North American Electric Reliability Council Disturbance Analysis Working Group. The incident data was analysed in terms of the MW load lost. A total of 861 power failure events were reported, and in 277 events the load loss exceeded 300 MW. It was found that the lognormal distribution provided a good fit for the data set. This finding is significant if one were to assume that a linear relationship exists between the MW load lost and the duration of the power failure event. Incidentally, the Rand Water external trip duration data also follows a lognormal distribution.

SUMMARY AND CONCLUSIONS

This paper considered the effect of power outages on bulk water distribution. Reliability of power supply is commonly measured making use of indices, such as amongst others, the SAIDI and SAIFI indices as defined by the Institute of Electrical and Electronics Engineering (IEEE). It was

shown how the SAIDI and SAIFI indices can be used to determine the power supply availability, the power supply probability of failure, as well as the frequency of power supply failures at a point.

Data was obtained from a number of sources and used to benchmark the probable extent of power supply reliability. The probability of failure of power supply varied, but generally fell within a range of less than approximately 8,3 hours per year in developed countries. In South Africa, a developing country, the probability of failure of power supply is of the order of approximately 50 hours per year.

The reliability of power supply from seven of Rand Water’s (South Africa) pump stations was obtained and analysed, and it was noted that:

- The results suggest that the average number of power failure incidents was 11,4 per year and the lognormal distribution with base e and $\mu = 2,20$ and $\sigma = 0,70$ provided a good fit to the power failure incidents cumulative distribution function.
- The average duration of the power failures was 1,6 hours and the lognormal distribution with base e and $\mu = -0,61$ and $\sigma = 1,54$

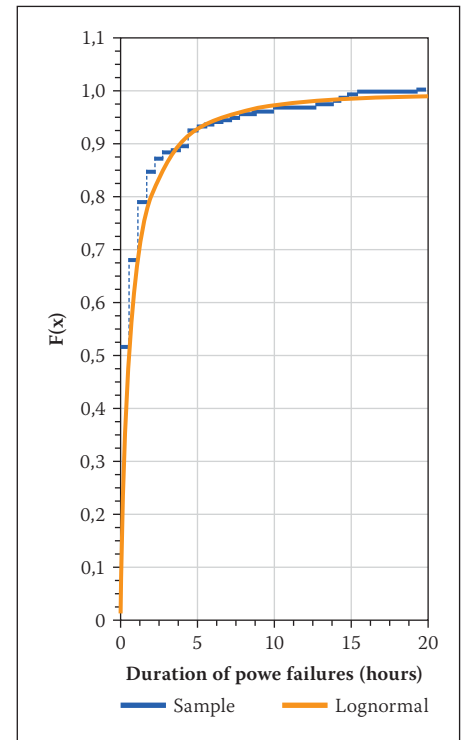


Figure 5 Duration of power supply failures – cumulative distribution function (Rand Water pump stations)

provided a good fit to the power failure duration cumulative distribution function.

- A previous study on the duration of large-scale power failures in the USA also found the lognormal distribution to provide a good fit.
- The Rand Water pump station power failure data analysis for all pump stations combined suggests a probability of power failure of approximately 18 hours of non-supply per year, which is better than the South African national average of approximately 50 hours as reported in Table 1. The lower failure rate experienced by Rand Water might be due to a possible higher level of service related to power supply reliability provided to critical services authorities in South Africa.

REFERENCES

Bollen, H J & Häger, M 2006. What is reliability? – Reliability and reliability indices in the viewpoint of the network operator and the viewpoint of the customer. *Electrical Power Quality and Utilization*, II(2): 14–20.

Chatterton, B, Koch, R & Mccurrach, R 2009. High-voltage (HV) and extra-high-voltage (EHV) network interruption performance measurement and reporting: Development of the NRS 048-8 specification. *Proceedings, Cigré 2009, 6th South African Regional Conference*, Paper P303.

Cullinane, M J 1985. Reliability evaluation of water distribution system components. In Waldrop, W (Ed), *Hydraulics and Hydrology in the Small Computer Age*, New York: ACE, Vol 1, pp 353–358.

- Eskom 2007. Annual Report – Directors' report: ensuring reliable electricity supply. <http://www.eskom.co.za>
- Eto, J H & LaCommare, K H 2008. Tracking the reliability of the U.S. Electric Power System: An assessment of publicly available information reported to State Public Utility Commissions. Sacramento, CA: Ernest Orlando Lawrence Berkeley National Laboratory, Report LBNL-1092E, 11.
- Fredericks, M & Khan, F 2007. Report on plant reliability for Rand Water for 2006/2007. Internal Rand Water report, 9 July, Johannesburg: Rand Water Head Office.
- Jadrijevic, Z, Majstrovic, M & Majstrovic, G 2009. The relationship between reliability indices and daily load curve. *Proceedings*, CIRED, 20th International Conference on Electricity Distribution, Prague, 8–11 June, Paper 0909.
- Mbula, V 2008. Rand Water pump stations external trip data. Maximo data sheets. Johannesburg: Rand Water Head Office.
- Ramakrishna, S V & Gupta, S A 2009. Reliability of power supply. <http://www.powermin.gov.in/distribution/apdrpbestprac/CEA-reliability.pdf>
- Zaretski, R L, Briggs, W M, Sterling, M & Shankar, M 2009. Distributions of large-scale power outages: Extreme values and the effect of truncation. *International Journal of Power and Energy Systems*, 29(1): 65–72.