



Aalborg Universitet

AALBORG UNIVERSITY
DENMARK

A Novel Dynamic Appliance Clustering Scheme in a Community Home Energy Management System for Improved Stability and Resiliency of Microgrids

Abbasi, Ayesha; Sultan, Kiran; Aziz, Muhammad Adnan; Khan, Adnan Umar; Khalid, Hassan Abdullah; Guerrero, Josep M.; Zafar, Bassam A.

Published in:
IEEE Access

DOI (link to publication from Publisher):
[10.1109/ACCESS.2021.3119538](https://doi.org/10.1109/ACCESS.2021.3119538)

Creative Commons License
CC BY 4.0

Publication date:
2021

Document Version
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

Citation for published version (APA):

Abbasi, A., Sultan, K., Aziz, M. A., Khan, A. U., Khalid, H. A., Guerrero, J. M., & Zafar, B. A. (2021). A Novel Dynamic Appliance Clustering Scheme in a Community Home Energy Management System for Improved Stability and Resiliency of Microgrids. *IEEE Access*, 9, 142276-142288. <https://doi.org/10.1109/ACCESS.2021.3119538>

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

Take down policy

If you believe that this document breaches copyright please contact us at vbn@aub.aau.dk providing details, and we will remove access to the work immediately and investigate your claim.

A Novel Dynamic Appliance Clustering Scheme in a Community Home Energy Management System for Improved Stability and Resiliency of Microgrids

AYESHA ABBASI¹, KIRAN SULTAN², MUHAMMAD ADNAN AZIZ³,
ADNAN UMAR KHAN¹, HASSAN ABDULLAH KHALID⁴,
JOSEP M. GUERRERO⁵, (Fellow, IEEE), AND BASSAM A. ZAFAR⁶

¹Electrical Engineering Department, International Islamic University Islamabad, Islamabad 44000, Pakistan

²Department of Computer and Information Technology, Faculty of Applied Studies, King Abdulaziz University, Jeddah 21551, Saudi Arabia

³Department of Electronic Engineering, Isra University, Islamabad 44000, Pakistan

⁴Center for Advanced Studies in Energy, National University of Science and Technology, Islamabad 44000, Pakistan

⁵Center for Research on Microgrids (CROM), AAU Energy, Aalborg University, 9220 Aalborg East, Denmark

⁶Information Systems Department, Faculty of Computing and Information Technology, King Abdulaziz University, Jeddah 21589, Saudi Arabia

Corresponding author: Kiran Sultan (kkhan2@kau.edu.sa)

ABSTRACT Power scheduling of domestic appliances is a vital preference for bridging the gap between demand and generation of electricity in a microgrid. For a stable microgrid, an acceptable mechanism must reduce the peak to average ratio (PAR) of power demand with supplementary benefits for consumers as reduced electricity charges. Recent studies have focused on PAR and cost reduction for a small consumer population. Furthermore, researchers have mainly considered homogeneous consumer loads. This study focuses on residential power scheduling for electricity cost reduction for consumers and load profile PAR curtailment for a relatively large consumer population with non-homogeneous loads. A sample population of 1000 consumers from various classes of society is considered. The proposed dynamic clustered community home energy management system (DCCHEMS) allows the clustering of appliances based on time overlap criteria. Comparatively flatter power demand is attained by utilizing the clustered appliances in conjunction with particle swarm optimization under the influence of user-defined constraints. Modified inclined block rates with real-time electricity pricing strategies are deployed to minimize the electricity costs. DCCHEMS achieved higher efficiency rates in contrast to the traditional non-clustering and static clustering optimization schemes. An improvement of 21% in peak to average ratio, 4% in cost reduction, and 19% in variance to mean ratio is obtained.

INDEX TERMS Smart grid, dynamic clustering, home energy management system, demand response, optimization, controllable appliances, microgrid.

I. INTRODUCTION

Ever since the deregulation of the electric power industry, smart grids have been envisioned to achieve effective electricity distribution and utilization [1], [2]. The smart grid framework encompasses all the smart appliances that generate and store electricity, thus allowing the consumer to participate and fulfill energy demands [3]. Demand response (DR) strategy is one such way that allows potential residential customers to minimize electrical costs by diverting their power usage

The associate editor coordinating the review of this manuscript and approving it for publication was Derek Abbott¹.

preferences from a peak to an off-peak period. The reliability of the smart grid is attributed to the efficiency of this load shifting criteria which in turn contributes to shrinking the peak to the average power.

Microgrid (MG) is an emerging concept in smart grids that enhances the effectiveness and resiliency of power systems by allowing smart control of consumer's power consumption while integrating distributed generation resources such as PV and wind [4]. A home energy management system (HEMS) warrants the steadiness and consistency of microgrids [5]. It is commonly referred to as the technique attributing to the use of home appliances by domestic users. HEMS plays a vital

role in a smart grid control system due to the widespread demand for electricity in the domestic sector [6]. It works by allowing variations in the demand curve according to each profile of a user. The variation occurs due to the partaking of a user in the electric power market. The whole process makes use of intelligent sensors that are located at the software running the database. The sensors help save the user's profile at various points of consumption. More specifically, an advanced metering infrastructure (AMI) or smart meter serves as a connecting junction between the electrical grid and appliances to enable the power supply. HEMS prioritizes this load consumption that concerns cost and energy [7].

Today, the integration of HEMS in an MG is an essential part of smart grid control as domestic consumers substantially contribute to the total electricity consumption. Also, there is a need to improve the existing conservative HEMS techniques to shrink the peak to the average power demand of smart grids. This would fulfill the increasing energy demand and overcome power deficit conditions in underdeveloped countries [8]. The grid generates a controlling signal known as demand response (DR) that reflects altered electricity prices during peak hours. HEMS responds to DR while maintaining a balance between power generation and electricity consumption across the entire grid. It reshapes the power usage pattern (PUP) by rescheduling load on the consumer end (demand-side management). The DR process generally comprises three pricing schemes; time of use pricing (TOUP), critical peak pricing (CPP), and real-time electricity pricing (RTEP). TOUP and CPP enable electricity price (EP) calculation in advance. The price calculation process can be performed quarterly in both the schemes. Due to hourly updates in the price, flexibility in RTEP can mirror load profiles or the generation costs. But using RTEP for consumer's electricity cost (EC) reduction may increase PAR during low price time slots. This is because the peak values in PUP will move to low EP slots [9]. Hu *et al.* have proposed a DR-based energy consumption scheduling scheme [10]. Price reduction is achieved but the customer's comfort is compromised with chances of peak load emergence in low price hours. Du *et al.* suggest an electricity reduction-based optimization model [11] that combines the two schemes of RTEP and inclined block rate (IBR). Despite achieving significant improvement in cost reduction, the scheme only operates for limited time span of one day or one-month. Also, the sample data set is small i.e. one household. Imran *et al.* propose a heuristic computation-based load scheduling mechanism. The main objective of the proposed approach is to improve PAR, minimize electricity bills, reduce carbon emissions, and increase user comfort [12]. But the simulations are presented for a small data set of a single house for a day only.

Many studies addressing various energy parameters have been conducted. The parameters studied include the daily energy cost, allowable home temperature ranges, energy usage, peak hours' energy usage, and consumer's comfort [13]–[15]. The effects and analysis of usage plans such as fixed pricing, time-of-use pricing and real-time pricing

have also been studied. To meet energy demand in real time, Homod *et al.* proposed the Takagi-Sugeno fuzzy based method. This energy based operational model was developed for heating, ventilation and air conditioning (HVAC) systems that used distributed energy resources, non-controllable appliances (NCAs) and battery storage systems. Clustering used by output variables made different groups of temperature average data for the entire year. The method was optimized for HVAC systems but it did not consider rest of the commonly used residential loads [16]. The authors have suggested performance improvements for HVAC systems [17]. Recent studies show the application of cluster-based optimization strategies at the MG level [18], [19]. Yet they fail to consider consumer's preferences at appliance level. Also, the algorithms have limitations in handling a large data set with variations in the types of communities.

Some proposed models use game theory [20] and fuzzy logic-based models [21] to solve energy management problems of residential buildings. But, these models are based on a very small data set of a day, a limited number of houses, and appliances that do not depict practical scenarios. Waseem *et al.* uses Grey Wolf and Crow Search Optimization (GWCSO) algorithm to reduce PAR and EC [22]. But the proposed technique considers only the HVAC loads for scheduling which limits the scope of GWCSO algorithm. Kim suggests a heuristic computation-based binary backtracking search algorithm to optimize the energy usage of controllable appliances. In comparison with particle swarm optimization (PSO), the algorithm shows higher energy efficiency. But it does not consider EC and PAR [23]. Dong reformulated the economic dispatch problem using data-driven energy management [24]. The model used an optimal algorithm at 30 minutes sampling time and did not consider PAR in the proposed algorithm. Javaid *et al.* and Hafeez *et al.* proposed heuristic algorithm-based optimization models for household load scheduling to reduce overall electricity bill and PAR [25]–[27]. But the models performed well for only small data sizes. The performance lowered as the size of the data increased. The models suggested no mechanism to handle large data. Hafeez *et al.* proposed an optimization scheme exploiting mixed-integer linear programming (MILP), binary backtracking search algorithm (BBSA), and artificial neural network (ANN) [28]. Although the objective of electricity bill reduction and PAR alleviation was attained but at the cost of increased system's complexity and execution time.

Jiang proposes an approach based on genetic algorithms to improve EC and PAR under step tariffs in a power system [29]. The simulation results shown depict a very small data set of three houses. Hussain suggests a genetic harmony-based search scheme to analyze the single-user and the multi-user but with a small population size of 30 [30]. A one-hour sampling time was used. The small data set cannot properly reflect the real-time operation of the appliances. The sampling time used is one hour that cannot reflect proper real time operation of the appliances. Paudyal suggests a load profile's peak reduction using a linear model [31]. But model

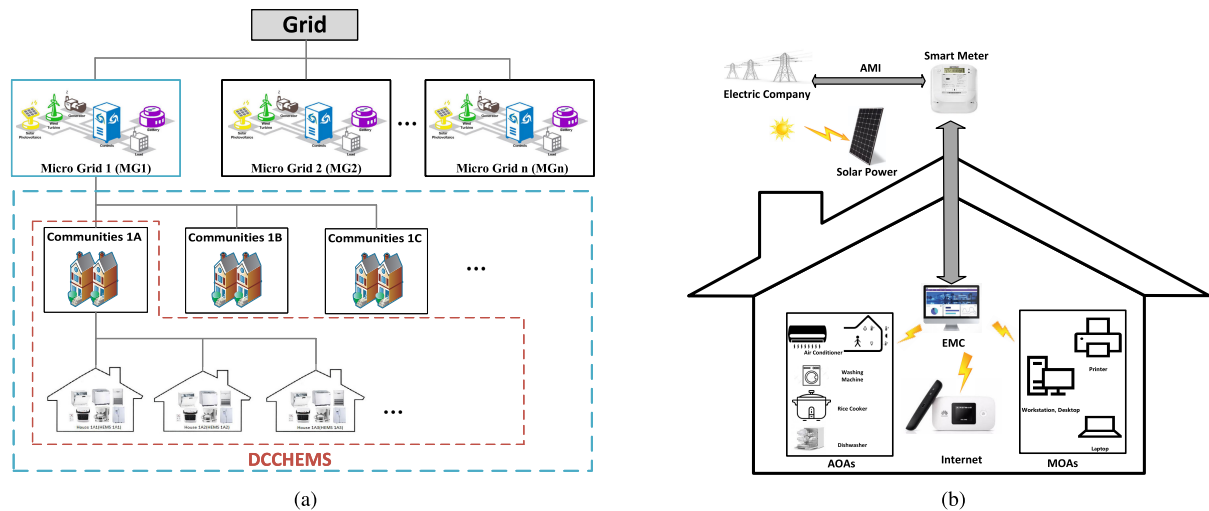


FIGURE 1. Community based HEMS framework (a) and energy management system architecture for home (b).

uses a population of only 25 houses. Aziz *et al.* presents a power scheduling methodology for a large population [32], [33]. However, the technique is based on the assumption of homogeneous consumption. This means that all appliances in the entire population have the same properties and belong to a similar class of consumers.

The literature review suggests that the majority of power scheduling strategies focus on a small population sample size, thus leaving the investigation of their behavior under a larger population size unexplored. In this paper, a dynamic clustered community-based home energy management system has been proposed. The system achieves improved performance for a large population set. The proposed load scheduling scheme decreases consumer EC and PAR of load profile for a large population. Consumers from different classes form communities and their appliances are gathered as clusters. Each cluster undergoes particle swarm optimization, and an optimum starting time is allocated to the appliances. To avoid unwanted peaks during any time slot, the fitness function of PSO also incorporates a modified IBR. PAR is reduced when appliances' overlapping time slots are tailored with IBR. Results of the proposed system are compared with the static clustering techniques suggested by Aziz *et al.*

The work contributes an efficient dynamic clustered community-based home energy management system (DCCHEMS). The model exhibits the following features;

- To make the model meaningful, realistic and practical, it uses a large data set of 1000 houses for three months. It implements a demand response-based strategy based on consumers' preferences for load scheduling of controllable appliances. Also, it considers the various types of consumable appliances that are commonly used in households.
- The model uses four classes of consumers i.e., lower class, middle class, upper-middle-class and higher class. Due to the non-identical properties of consumer appli-

ances and distinct user preferences from different classes, the load is non-homogeneous.

- The proposed model overcomes the underperformance of static clustering-based techniques. The proposed DCCHEMS algorithm significantly reduces the PAR and cost of electricity.

The paper is organized as follows. Section-II presents the structural design of EMS, Section-III presents the models and their equations, Section-IV presents the proposed approach of DCCHEMS, Section-V presents the simulation results and Section-VI is the conclusion.

A brief summary of a few papers from heuristic computation techniques is summarized in Table 1.

II. STRUCTURAL DESIGN OF ENERGY MANAGEMENT SYSTEM IN A HOME AREA NETWORK

The aim of an energy management system (EMS) is to limit electricity expenses and reduce PAR. It does so by scheduling power consumption in response to priority settled electricity prices. Such energy management systems warrant the stability and reliability of the power system. So, the main goal of any DR-based scheme is to reduce PAR and EC that profits utility as well as the consumer. An EMS consists of AMI, home gateway (HG), energy management controller (EMC), home appliances, and in-home display (IHD) appliances.

This paper proposes a community-based system architecture that is compatible with MGs. The proposed system is applicable for a community within an MG where several MGs are assumed to be connected to the grid. These MGs behave as substations that convey DR to users in the community center as per their proportion. The structure of the community-based scheme for HEMS utilization in smart grid is shown in Fig. 1a. The proposed scheme can apply in a power system that has multiple MGs, where each MG consists of communities. And there are houses in each community.

TABLE 1. Summary of comparison with existing heuristic computation based techniques.

Models of Energy Management	Techniques	Objectives	Limitations
Efficient Load scheduling for residential loads [12]	GA, MILP	Reduces energy expenses and PAR	<ul style="list-style-type: none"> • Simulations presented for small data set of a single house for a day • Reduces CO2 emissions and consumer discomfort level
Multi-objective bi-level optimization model [18]	MILP, IABC algorithm	To improve economic benefits of the MG cluster	<ul style="list-style-type: none"> • A static clustering approach used for making MG clusters • Reduce the operating risk of MG • No appliance level strategy involved for incorporating user preferences
HEMs involving fuzzy controller [21]	TOUP, RTEP and IBR	Curtailment of EC, PAR and energy consumption with affordable time	<ul style="list-style-type: none"> • Simulation results presented for a day only • Model is limited with a small number of appliances
Innovative home appliances scheduling framework [22]	GWCSO	Electricity bill curtailment and PAR improvement	<ul style="list-style-type: none"> • Scheduling tested on HVAC loads only
Heuristic based HEMs [26]	Heuristic optimization algorithm	EC and PAR reduction	<ul style="list-style-type: none"> • Homogeneous loads considered • The resident module is tested on a single house
Residential load scheduling using game theory [20]	Game theory-based TOUP	Reduction of EC and PAR	<ul style="list-style-type: none"> • Only three homes considered
Time based Domestic Power scheduling [33]	CCHEMS	EC, PAR and PVMR	<ul style="list-style-type: none"> • Homogeneous loads without consumer classification • Static clustering scheme implemented

The entire architecture of EMS with the help of a wireless home area network (HAN) is shown in Fig.1b. AMI is the most essential part of a smart grid. It connects the smart metering system to the utility of two-way communication and autonomous operations [34]. AMI is also responsible for collecting and transmitting real-time smart meter consumption data details and provides them to the utility. It also communicates DR pricing signals back to the smart meter after receiving from utility [35]. A smart meter is usually mounted outside of residential homes. It establishes a connection between EMC and AMI by receiving EMC consumption data and transmitting it to the utility. It also sends DR signals to EMC for further analysis.

This paper addresses two types of appliances; controllable appliances (CA) and non-controllable appliances (NCA). CA can run on their own and do not need any manual interruptions e.g. washing machines, dishwashers, clothes dryers, or air conditioners. The appliances can further be categorized into interruptible (clothes dryer) and non-interruptible (rice cooker) classes [36]. The NCA is consumer dependent and can be operated during use, e.g., Television, computer, and lawnmower. So CA can only be scheduled while NCA requires manual interference. Furthermore, the CA considered in this paper are assumed to be smart home appliances. In the architecture presented here, CAs do not have any interaction with each other, but only with HG. The HG would have scheduled all the CAs connected in the residential home at the start of the day.

Various wireless options are available to establish communication between the smart meter and HG. Possibilities include Wi-Fi, Z-Wave, Zig-Bee, or a wired (home plug) protocol [37]. HG via HAN can transmit an optimal power usage schedule to each CA. IHD or remote-controlled appliances such as laptops, mobile phones, etc., can be used to monitor the scheduling process.

The proposed technology assumes that smart meter and HG are merged as EMC that receives RTEP data from utility.

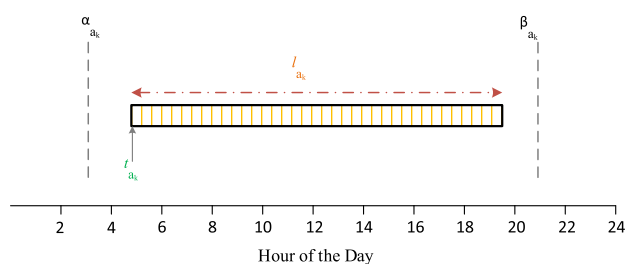


FIGURE 2. Appliance's parameter constraint.

III. SYSTEM MODEL AND PROBLEM FORMULATION

This section presents a load scheduling optimal approach for all CAs in the house. It exploits RTEP and modified IBR pricing schemes.

A. HOME ELECTRIC APPLIANCES USAGE PATTERN

The EMC can make decisions for appliances load scheduling once the utility sends DR information and RTEP profile to the HG. Consumers generally prefer to avoid peak hours and require certain tasks to be completed before some specific time slots. Some tasks, e.g., washing machines, can operate during the night when EP is low as the residents are sleeping at that time. So, consumers must set time parameters for each CA. Time parameters include activation time slot (ATS) t_{ak} , appliance operation time start (AOTS) α_{ak} , appliance operation time end (AOTE) β_{ak} , appliance operation time length (AOTL) l_{ak} , appliance operation time interval (AOTI) $[\alpha_{ak}, \beta_{ak}]$ during which the appliance is valid to be scheduled and appliance rating x_{ak} as depicted in Fig.2. The IHD appliance takes these parameters' information and transmits it to EMC via HG.

The proposed scheme only schedules CAs and does not schedule NCAs. However, the simulation results reflect that the scheme is still effective if NCAs are involved. The power

scheduling of CAs follows a specific pattern that is presented in the following section.

B. FINAL OBJECTIVE OF PROPOSED APPROACH

In an RTEP setup, EP rates are varied on an hourly basis. If the CAs are scheduled as per RTEP’s hourly basis then the degree of freedom for optimization of activation time slot (ATS) is reduced. Conversely, if a very short time slot is considered, heuristic optimization techniques, such as, PSO may have convergence issues due to large possibilities of optimization parameters. Therefore, the idea is to divide the time duration of 1 hour into 6 time slots i.e., 10 minutes length of each slot. Consequently, a day has 144 time slots denoted by the symbol $\tau \in T$ defined as $\{1, 2, 3 \dots 144\}$ [42]. PSO-based optimization problem becomes computationally efficient when a day is divided into 144 time slots. Therefore, 10 minutes time interval is selected to be the shortest operation time of any appliance. The operation times should be the numbers that denote integer multiples of 10.

A is used to denote CAs. We assume that each appliance $a_k \in A$ has the power consumption profile as,

$$P_{a_k} \triangleq [p_{a_k}(1), p_{a_k}(2), \dots, p_{a_k}(144)] \quad (1)$$

where $p_{a_k}(\tau)$ represents power consumption value for a^{th} appliance of k^{th} house, during τ^{th} time slot, and the unit is kWh. Since, there are 16 appliances considered for each house; $a \in \{1, 2, \dots, 16\}$. We assume that power consumption value for each appliance is fixed per hour as there exists a certain specification of each appliance, as shown in Fig. 8.

When the power consumption value per hour for appliance a_k is denoted by x_{a_k} , then the corresponding power consumption during τ^{th} time slot is

$$p_{a_k}(\tau) = \frac{x_{a_k}}{6} \quad (2)$$

Here, x_{a_k} is the a^{th} appliance power rating for k^{th} house. The power vector P_{a_k} will be scheduled for the a^{th} appliance of k^{th} house. This information is to be transmitted to the a^{th} appliance by HG through a suitable wireless connection.

As mentioned before, user preferences parameters are taken from consumers for each CA. Toward this aim, we assume α_{a_k} and $\beta_{a_k} \in U(\alpha_{a_k} < \beta_{a_k})$, as the indexes of the start and the end time slots, respectively. The power consumption of appliances is assumed to be valid for appropriate scheduling within this operation time interval. Let l_{a_k} be the AOTL, i.e., required time slots for appliance operation. The above-mentioned parameters are decided based on user preferences received through IHD and are transmitted to EMC later. In addition, $\beta_{a_k} - \alpha_{a_k}$ should be either equal to or greater than l_{a_k} . For example, if the washing machine needs one hour to finish its work, then the value of $\beta_{a_k} - \alpha_{a_k}$ could be any numbers that are greater than or equal to 6, and in the meantime less than or equal to 144. The greater the value of $\beta_{a_k} - \alpha_{a_k}$ is, the more possibilities for load scheduling there would be.

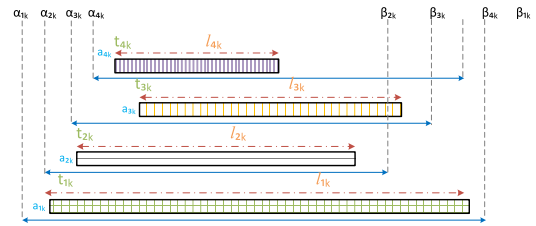


FIGURE 3. Examples showing the relationships among appliances parameters.

We define a variable t_{a_k} as the activation time slot (ATS) for the a^{th} appliance of k^{th} house. Since, α_{a_k} , β_{a_k} , l_{a_k} and x_{a_k} are all known already, the power consumption scheduling vector of an appliance ‘a’ can only be determined once t_{a_k} is known. Fig. 3 represents these relationships of the above-mentioned parameters for four different kinds of CAs for k^{th} house.

Now for each appliance $a_k \in A$, there exists a group of parameters comprising of AOTS α_{a_k} , AOTE β_{a_k} , AOTI $[\alpha_{a_k}, \beta_{a_k}]$, AOTL l_{a_k} and power consumption value per hour x_{a_k} . In addition, we also set ATS t_{a_k} as a variable. Having α_{a_k} , β_{a_k} , and l_{a_k} known already, t_{a_k} should be greater than or equal to α_{a_k} , and less than or equal to $\beta_{a_k} - l_{a_k}$. In other words, the adjustable parameter t_{a_k} is denoted as

$$t_{a_k} \in [\alpha_{a_k}, \beta_{a_k} - l_{a_k}] \quad (3)$$

The range of t_{a_k} , as an example for a^{th} appliance of fourth house, is shown in Fig. 4. For ATS of a^{th} appliance and k^{th} house, we need to find its optimum value for every CA subject to the constraint given in (3). A variable vector $[t_{a_1}, t_{a_2}, \dots, t_{a_k}]$ is constructed that consists of ATS for all the CAs. Therefore, a load profile based on power consumption scheduling matrix P for all CAs is defined as

$$P = \begin{cases} p & | p_{a_k}(\tau) = \frac{x_{a_k}}{6}, \quad \forall a_k \in A, \tau \in [t_{a_k}, t_{a_k} + l_{a_k}] \\ p_{a_k}(\tau) = 0, & \forall a_k \in A, \tau \notin [t_{a_k}, t_{a_k} + l_{a_k}] \end{cases} \quad (4)$$

where P denotes a matrix, each row of which carries power scheduling pattern of a certain appliance and variable τ represents the index of column. The term $\tau \notin [t_{a_k}, t_{a_k} + l_{a_k}]$ indicates that τ belongs to T excluding the range $[t_{a_k}, t_{a_k} + l_{a_k}]$. By summing up all the values of each column vector in the power consumption scheduling matrix, a total power consumption scheduling vector P_{scd} would be determined as

$$P_{scd} = \left\{ p_{scd} \mid p_{scd}(\tau) = \sum P(\tau), \forall \tau \in T \right\} \quad (5)$$

In Eq. (5), $P(\tau)$ stands for the τ^{th} column in the power consumption scheduling matrix.

The objective function of the power consumption scheduling problem defined for a single house can be presented as the following optimization problem

$$\begin{aligned} & \text{minimize EC}(P_{scd}) \\ & \text{s.t. } t_{a_k} \in [\alpha_{a_k}, \beta_{a_k} - l_{a_k}] \end{aligned} \quad (6)$$

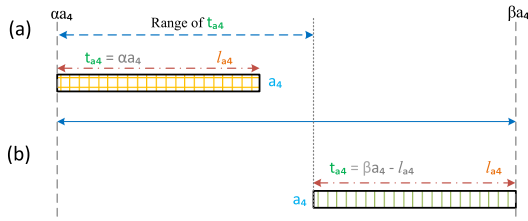


FIGURE 4. AOTS range illustration for home appliance ‘a’: (a) the earliest starting time and (b) the latest starting time.

where

$$EC(P_{scd}) = \sum_{\tau=1}^{144} rtep(\tau) \cdot p_{scd}(\tau) \quad (7)$$

In Eq. (7), $rtep$ denotes the EC at the τ^{th} time slot. The EP presented in (7) can be minimized through an optimization technique.

C. SELECTED PRICING SCHEME AND MODIFIED INCLINED BLOCK RATE

RTEP being superior in flexibility as compared to both TOUP and CPP, but has the drawback of concentrating many appliances at low EP areas. Considering this constraint, the proposed system combines IBR with RTEP which can vary EP rates in the low EP time slot based on the power consumption of the appliances [38]. This prevents another peak that can occur in low EP time slots.

Application of IBR pricing scheme affects RTEP rates by multiplying it with a factor $\lambda > 1$. This occurs whenever the PUP of any house goes beyond a predefined threshold range at any time slot. Otherwise, RTEP remains unaffected. IBR operates as a monitoring term to keep the scheduling algorithm from inducing sharp peaks in PUP. Undesired power peaks can occur in response to the scheduling algorithm optimization. This may occur when several appliances of a house operate with overlapping α_{a_k} and β_{a_k} . They may get scheduled to identical time slots where RTEP is offering low electricity prices. Thus, undesired power peaks get created. Occurrences of these undesired peaks increase the PAR of PUP. IBR controls such a situation by involving the penalty term and prevents the scheduling algorithm from creating power peak patterns. In the proposed approach, IBR is modified to reflect the penalty term which applies only when PUP crosses a γ_c scaled threshold i.e. the number of houses lying under the current community. Two EP levels are considered and there is a change in EP every hour. Modified IBR control is incorporated into the RTEP formulated as:

$$rtep_{pc}(\tau) = \begin{cases} rtep(\tau) & \text{if } p_c \leq th \times \gamma_c \\ rtep(\tau) \times \lambda & \text{if } p_c > th \times \gamma_c \end{cases} \quad (8)$$

where,

$$p_c = \sum_{\forall a \in C_c} \sum_{\forall k \in C_h} p_{a_k}(\tau) \quad (9)$$

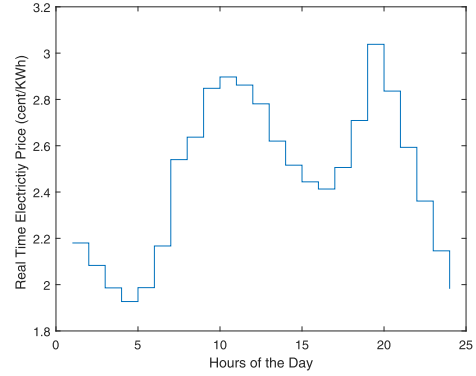


FIGURE 5. RTEP on 9th July 2015 [41].

Here $rtep(\tau)$ is the real-time EP received from electricity supply company for time slot τ , $rtep_{pc}(\tau)$ is the EP based on the power consumption p_c of the community being optimized, th is the threshold set to 2 kWh, and γ_c is the count of houses under current community. C_h represents a set of houses in the current community of consumers and C_c refers to the current cluster of CAs.

Though it seems impractical to propose EP ahead of a day, several price prediction schemes have been presented in the literature [39], [40]. The electricity pricing data: RTEP for 9th July 2015, accessed from Illinois is shown in Fig. 5 [41].

IV. PROPOSED PARTICLE SWARM OPTIMIZATION BASED APPROACH FOR MANAGEMENT OF ENERGY CONSUMPTION

A. PARTICLE SWARM OPTIMIZATION (PSO)

The PSO is an iterative method, proposed by Kennedy and Eberhart [43] is based on the concept of population of particles. The optimization is initiated by assigning initial values to position and velocities of the particles. PSO allows the candidate solutions; particles, to gather up around the optimum solution space. Particle best solution and the local best position are defined by global best (gbest) and particle best (pbest), respectively, to monitor the flight curves of the particles.

In our problem, EC is reduced using PSO for optimum ATS allocation of each house in the community. Optimization is aimed to work within the constraint of keeping AOTL within the range of AOTS and AOTE as given in (3). Here, AOTS is used as the initial value for optimization which is the user preference provided by the consumers. Then the cost function is saved that minimizes EC as shown in (7) and adjusts pbest location. This process continues until terminated due to the termination condition.

The velocity of particle i is updated as it moves around the search space as per (10). Suppose x_i^t denotes the position vector of particle i in the multidimensional search space (i.e. R_n) at the time step t then the position of each particle is updated in the search space by (11)

$$V_{ij}^{t+1} = \omega V_{ij}^t + c_1 r_1 (pbest_{ij}^t - x_{ij}^t) + c_2 r_2 (gbest_j^t - x_{ij}^t) \quad (10)$$

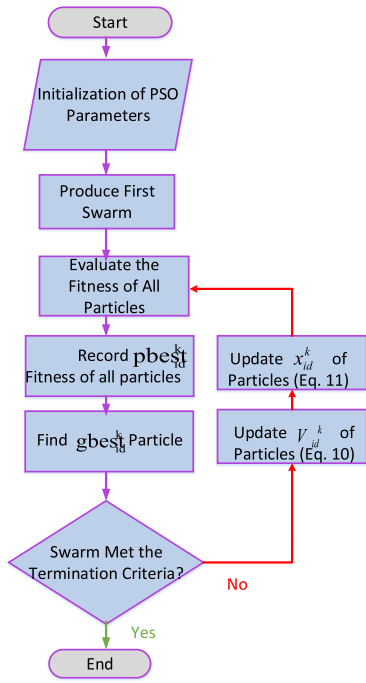


FIGURE 6. Flow chart for PSO.

$$x_{ij}^{t+1} = x_{ij}^t + v_{ij}^{t+1} \tag{11}$$

V_{ij}^t and x_{ij}^t are the velocity and position vectors of particle i in dimension j at time t . $pbest_{ij}^t$ is the personal best position of particle i in dimension j found from initialization through time t . Similarly, $gbest_j^t$ is the global best in dimension j found from initialization through time t . Uniformly generated random numbers in the interval $[0, 1]$ are represented by r_1 and r_2 , respectively. The particle weight is represented by the coefficients ω , momentum of pbest by c_1 and pull towards gbest is represented by c_2 , respectively. The constraint defined in (3) is used for random initialization of velocities and particles. The same initially generated population is expected to improve upon each iteration. Each particle improves its own version by keeping a check on pbest. If a newer version of pbest is better than the previous then it is replaced with the improved one. Also, if pbest better than gbest, it replaces gbest as well. The gbest is returned as the final solution when the process is completed after fulfilling any of the termination criteria as shown in Fig. 6.

B. FORMULATION OF DCHEMS

The IBR has been used as a pricing scheme from a long time by many companies like California Edison & Pacific Gas & Electric [44], [45]. PAR is reduced by the application of IBR which can control the power demand of one appliance by implying its penalty factor. But if many appliances appear in the same time slot then the PUP of the whole power grid will rise enormously. This scenario can be explained with the help of Fig. 7. For simplicity, we have considered only one appliance per house for a community of m houses.

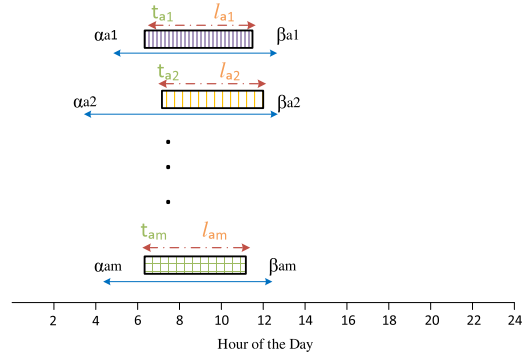


FIGURE 7. Example of appliance's cluster generating power peaks.

The considered appliances are assumed to have their α_{ak} around a time slot which has the lowest EP than its successor slots. In such a situation, the application of any scheduling algorithm in conjunction with the IBR will tend to settle down t_{ak} of all houses towards the slot of lowest EP. Despite the fact, IBR succeeds to limit the PUP of each house under the desired threshold. But the constellation of appliances t_{ak} scheduled around the lowest EP will produce a PUP peak in the overall community. Ultimately it occurs for the entire power grid. If we consider the RTEP in Fig. 5, EP is the lowest around hour 5 of the day, and the appliances of Fig. 7 will tend to be scheduled around hour 5 resulting in a higher peak. This situation demands for a power scheduling methodology that can look around in the neighborhood while optimizing ATS for all the appliances. Therefore, the proposed algorithm handles the situation as follows.

It is assumed that grid or electricity supply company communicates DR-related tasks to the substations. And they further communicate it to the respective communities. For incorporating analysis of non-homogeneous loads, the entire population of 1000 houses is divided into four types of community classes; lower-class (LC), middle class (MC), upper-middle-class (UMC), and higher class (HC). These classes consist of equal number of houses. All these four classes have their own user preferences as per their daily routines. For example, HC, usually the business class, has late-night routines as their morning chores start around noon. Their houses usually have heavy-duty loads, e.g., 2 to 5 tons ACs, automatic washing machines requiring plenty of water that enables longer water pump operation, generally enabled with automatic water heating. All these appliances are high-powered as compared to other classes of community types. In comparison, MC makes it a bit earlier with somewhat reduced power-rated appliances connected at their homes. For example, appliances like automatic washing machines and dishwashers are installed without electric water heating. So they use lesser power for their operation as compared to HC or UMC [46]. Power ratings used for CAs of all four classes are shown in Fig. 8. As a general trend, LC starts the day at 4 a.m. and ends up with all the chores around 9 p.m. These details for all four classes are reflected in Table 2.

TABLE 2. Typical usage parameters for CAs [33].

	Controllable Appliances	Operation Slots (scattered between)
LC	Air Conditioner	1 to 20, 120 to 144
	Electric Heater	90 to 120
	Washing Machine	1 to 40
	Clothes Dryer	50 to 80
	Dishwasher	110 to 144
	Water pump	60 to 90
	Electric Kettle	30 to 55, 90 to 110
	Rice Cooker	1 to 30, 50 to 70, 95 to 110
MC	Air Conditioner	1 to 35, 130 to 144
	Electric Heater	90 to 130
	Washing Machine	1 to 60
	Clothes Dryer	55 to 90
	Dishwasher	120 to 144
	Water pump	70 to 100
	Electric Kettle	40 to 65, 90 to 110
	Rice Cooker	10 to 30, 50 to 70, 95 to 120
UMC	Air Conditioner	1 to 50, 130 to 144
	Electric Heater	90 to 135
	Washing Machine	1 to 70
	Clothes Dryer	70 to 100
	Dishwasher	125 to 144
	Water pump	80 to 110
	Electric Kettle	50 to 75, 90 to 110
	Rice Cooker	20 to 50, 70 to 85, 100 to 130
HC	Air Conditioner	1 to 144
	Electric Heater	90 to 144
	Washing Machine	1 to 90
	Clothes Dryer	90 to 120
	Dishwasher	1 to 20
	Water pump	90 to 120
	Electric Kettle	60 to 80, 100 to 120
	Rice Cooker	30 to 60, 80 to 100, 100 to 130

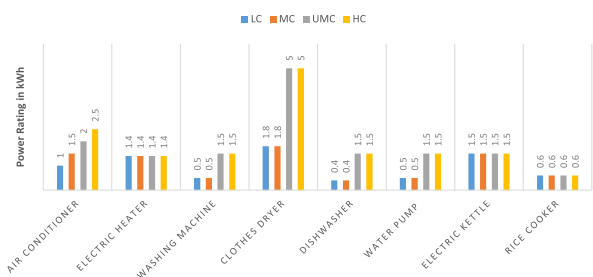


FIGURE 8. Power rating in kWh for appliances of non homogeneous load i.e. for all four classes.

We have assumed different percentages of CAs in each class. LC community is assumed to have 20% of CA, 40% for MC, 60% for UMC, and HC is assumed to have 80% of CA.

A randomly generated one-day load profile is subjected to PSO to find the best clustering set among all possible clustering combinations of C1, C2, and C3 as presented in Fig. 9. The C3 is varied from 2 to 7 clusters per community with both uniform and unequal cluster sizes [33]. Based on PARR best clustering combination is employed in randomly generated population load profile for 90 days as presented in simulations Section-V. The entire population of each class having 250 houses, is divided into their respective communities of size C1, the appliances within the communities are sorted as per C2 and then grouped into C3 clusters. Each community consists of 50 houses as per C1 optimum value. AOTE is

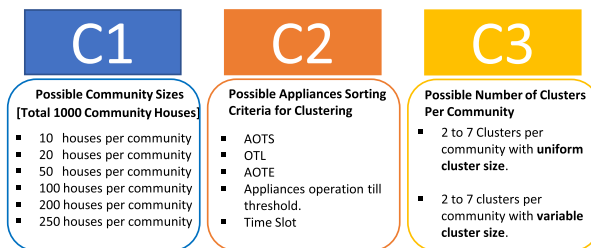


FIGURE 9. DCCHEMS parameters for clustering.

selected to be the sorting criterion under C2. The number of clusters of appliances in each community denoted by C3 is selected to be 5 as per the optimum value.

The developed algorithm broadly consists of two steps. First, a dynamic clustering based pre-processing stage for the data formulation. Second, dynamic clustering is employed on the formulated data for load scheduling of the CAs.

Pre-processing stage is highlighted in Fig. 10 that involves sorting of all houses before making sets of communities according to C1. The selection of houses into communities is dynamic as it is based on average PAR of each cluster. There are 16 appliances in each house. These 16 appliances per house are divided into 5 clusters as per their AOTS and AOTE. PAR is calculated for 5 clusters and all houses are sorted in ascending order based on maximum PAR. Secondly, entire population of 1000 houses is divided into 5 sets of 200 houses each. And all sets are sorted according to their second maximum PAR. Thirdly, the 10 sets of 100 houses each are sorted according to third maximum PAR. In order to bring variations of data under one community, every 21st house is picked out of the sorted list. Selection of houses at turns of 20 s is carried out in order to populate each community with a good diversity based on PARs. It facilitates the dynamic clustering due to availability of houses with diversified PAR values. Since the size of one community is 50 houses, therefore, the LC consists of 5 communities of 250 houses. Similarly, each of the other three classes consists of 250 houses. Therefore, the 5 communities belong to each class. One community of 50 houses has a total of 800 appliances, i.e. 50 × 16.

These appliances of each community are further divided into 5 clusters of various configurations as per criterion C3. Borders of cluster with highest average PAR is varied with even multiple of integer interval [-3, +3]. The combination resulting in lowest PAR is selected.

Following steps are followed by DCCHEMS:

Step 1: Entire population is divided into equal sized classes; lower class, middle class, upper-middle-class and higher class.

Step 2: C2 is used for sorting the appliances of each house.

Step 3: C3 decides a number of clusters of appliances in each house.

Step 4: For the entire population, sorting population with a staggered set of houses having to descend PARs in respective clusters.

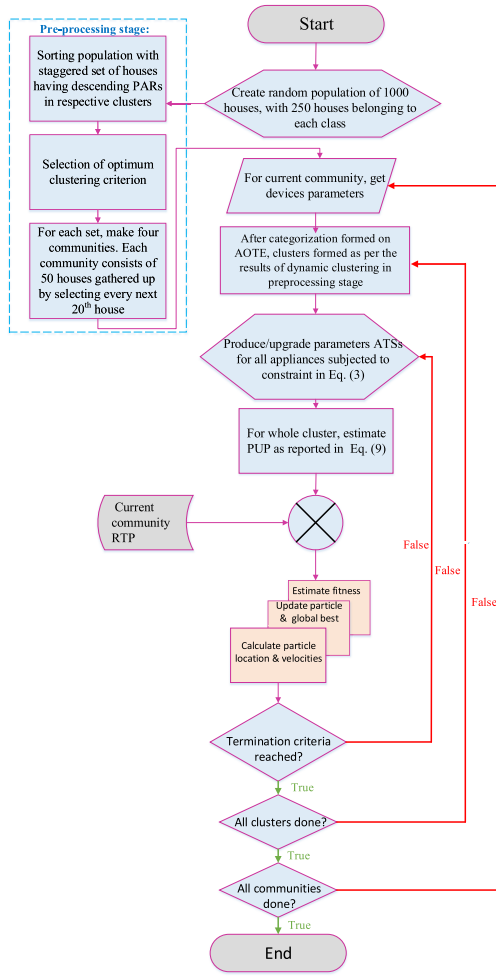


FIGURE 10. Flowchart for the proposed DCCHEMS method.

Step 5: Selection of optimum clustering criterion.

Step 6: C2 is used for sorting appliances under each community.

Step 7: C3 decides a number of clusters of appliances in each community.

Step 8: The parameters t_{a_k} belongs to the current cluster within the range $[\alpha_{a_k}, \beta_{a_k} - l_{a_k}]$ are initialized and **Step 6** till end is repeated until all clusters done. Sets of t_{a_k} are used as particles.

Step 9: Eq. (12) is used to calculate fitness for each cluster by evaluating P_{cc} and EC.

Step 10: The pbest is updated in case the new particle's fitness is better than that of the previous pbest. In case later is better, update gbest with pbest.

Step 11: Update velocities and positions of particles according to (10) and (11).

Step 12: Go to **Step 6** if the termination criterion is not reached.

Step 13: Repeat **Step 8** to **Step 11** until all communities scheduled.

Step 14: Terminate once the entire population is scheduled.

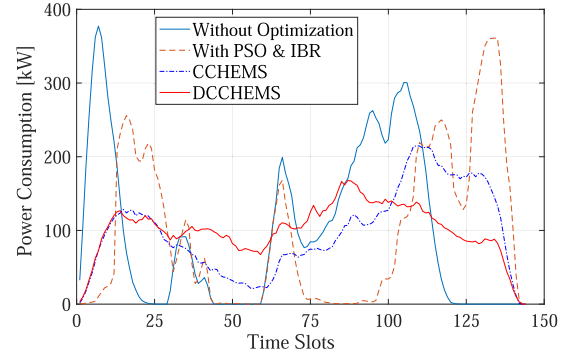


FIGURE 11. Power usage pattern (PUP) at 45th day.

The steps followed by the algorithm are shown in the flow diagram of Fig. 10. Overall power scheduling objective can be summarized as follows:

$$\begin{aligned} & \text{minimize } EC(P_{cc}) \\ & \text{s.t. } t_{a_k} \in [\alpha_{a_k}, \beta_{a_k} - l_{a_k}] \end{aligned} \quad (12)$$

$$EC(P_{cc}) = \sum_{\forall k \in C_h} \sum_{\forall a \in C_c} \sum_{\tau=1}^{144} r_{\text{tep}_{pc}}(\tau) \cdot p_{a_k}(\tau) \quad (13)$$

Here $EC(P_{cc})$ is the total EC based on PUP. The PUP for the cluster of the community being scheduled is denoted by P_{cc} , $r_{\text{tep}_{pc}}(\tau)$ represents electricity rate for the τ^{th} time slot according to (8). $p_{a_k}(\tau)$ is the power rating of CA for k^{th} house and a^{th} appliance. The houses in the current community are represented by C_h . Current cluster is denoted by C_c . Therefore, the objective function of our proposed algorithm is to minimize overall consumer EC of power consumption. IBR is applied on the entire community to keep the PAR under control, as the population is divided into several smaller communities.

V. SIMULATION RESULTS

This section describes the simulation results of our energy management system. We have used PSO that exploits tested parameters for a randomly generated house population of 1000 houses for 90 days. Out of these 1000 houses, each class of community consists of 250 houses. The clustering parameters are tuned for one day's load profile as proposed by Aziz et al. [33]. This section presents the results and simulation outcomes for the proposed algorithm. Results reflect improvement in PAR of PUP and EC as compared to existing techniques in the literature. To present the comparison with the existing techniques, three performance metrics have been used; cost reduction percentage (CRP), PAR reduction percentage (PARR), and PUP variance to mean ratio (PVMR). These metrics are calculated as:

$$\text{CRP} = \frac{\text{EC-PSEC}}{\text{EC}} \times 100 \quad (14)$$

$$\text{PARR} = \frac{\text{PAR-PARPS}}{\text{PAR}} \times 100 \quad (15)$$

$$PVMR = \left(\frac{\sum \sum_{\tau=1}^{144} (PUP(\tau) - \mu_{PUP})^2}{144} \right) \times \frac{1}{\mu_{PUP}} \quad (16)$$

Here, EC and PSEC are the electricity costs before and after power scheduling, PAR and PARPS are peak to average ratios before and after power scheduling, μ_{PUP} reflects mean PUP. The percentage improvements in the proposed technique as compared to reference techniques for these three performance metrics are shown in Table 3. For simulation purposes, maximum 16 and minimum of 8 appliances are considered for population load profile generation.

Some appliances can operate more than once a day according to the daily routines of the users. Table 2 represents the possible time slots utilized for power consumption of CAs. MATLAB is used for all the simulations carried out in this study. As per optimization algorithm requirements, PSO uses parameters as swarm size of 100, 0.25 as a neighbor minimum fraction, variable count 16, relative change tolerance value as 10⁻¹⁶ and the iteration terminates at 3200.

The best clustering set among all possible combinations of the clustering parameters as presented in Fig. 9 is generated using PSO when applied on a randomly generated load profile for a day. To achieve both uniform and unequal cluster sizes, C3 can achieve values ranging from 2 to 7 clusters per community. Results presented here are generated for 50 houses for each community for all four types of community classes. Home appliances are sorted based on AOTE. The number of clusters is decided to be 5. The selected parameters are claimed to be the best clustering combination for randomly generated load profiles for a period of 90 days [33].

In this study, following four types of profiles are generated. Profile for unoptimized data, profile with IBR included with PSO for load scheduling [33], profile with CCHEMS based appliance clustering [33] and profile with the proposed dynamic appliance clustering. Note that the electricity pricing data is taken from Ameren Illinois Power Company (2015) for the duration of 11th April 2015 to 9th July 2015.

An optimization for the 45th day PUP against time slots (TS), is shown in Fig. 11 which shows that proposed algorithm improves on PAR significantly as compared to static clustering-based approaches. The peak of 215 kW/TS in CCHEMS at TS 109 is reduced down to 168 kW/TS at the TS of 87 in DCCHEMS. The difference can be observed with an unoptimized and PSO-IBR techniques where sharp power consumption peaks are replaced by either no or very low power consumption peaks. The algorithm shifts the consumers' load from peak hours to off peak hours while preventing building up of new peaks. This witnesses the benefit of combining IBR with RTEP as claimed in the pricing scheme Section-IV-B. Once dynamic clustering applied, the diversity factor of the load curve improves. The load varies smoothly which leads to peak shaving and desert filling. In contrast to the static clustering-based approach, significant improvement in PAR is observed for the proposed technique as presented in Fig. 12(b) where mean PAR for unoptimized technique, optimized with PSO and IBR, CCHEMS and

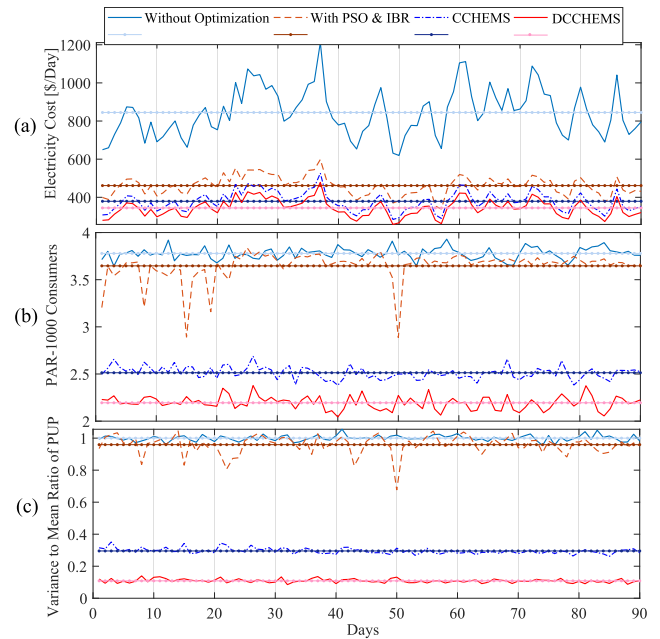


FIGURE 12. Simulation results for 90 days with PSO: (a) Electricity cost, (b) PAR and (c) variance to mean ratio of PUP.

DCCHEMS are 3.78, 3.65, 2.51, and 1.71, respectively, as shown in Fig. 12(b). The EC reduction for the reference and proposed technique in \$/Day for a period of 90 days is presented in Fig 12(a). Mean EC for unoptimized technique, optimized with PSO and IBR, CCHEMS and DCCHEMS are 844.82 \$/Day, 461.46 \$/Day, 379.13 \$/Day and 344.35 \$/Day, respectively. Mean EC reduction with non-dynamic clustering is about 4.12% as compared to dynamic clustering.

The PAR effects are presented in Fig. 12(b). Non-dynamic clustering reduces PAR by 33.49%, whereas dynamic clustering reduces PAR by 54.75%. The proposed DCCHEMS is 4.11% better than non-dynamic optimization in terms of cost reduction capability. Results are more encouraging when the PAR reduction is considered with DCCHEMS where an improvement of 21.26% as compared to the non-dynamic optimization is achieved. Considering the improvement of PAR and cost reduction, utility is encouraged to offer more incentives to the consumers for taking part in DR events. The last parameter PUP variance to mean ratio (PVMR) reveals that DCCHEMS is 19% superior to non-dynamic optimization in the smoothness of PUP. Therefore, our proposed DCCHEMS enables PUP smoothness as reflected in Fig. 12(c). Ideally, zero PVMR leads to a flat PUP and DCCHEMS brings PVMR further down to 0.11 from 0.3 in the case of CCHEMS, which was reduced only up to 0.85 on average for non-dynamic clustering. Stability and reliability of the entire system are ensured by smooth PUP and reduced PAR. Averaged results for 90 days of PSO optimization are shown in Table 3.

This significant reduction in PAR and EC with the proposed technique is due to two design improvements. Firstly,

TABLE 3. Summary of results.

Algorithms	CRP	PARR	PVMR
PSO Non-Clustered [33]	45.38	3.49	0.95
CCHEMS with PSO [33]	55.12	33.49	0.3
Proposed DCCHEMS with PSO	59.24	54.76	0.11

the segregation of consumers into various types of communities. Secondly, by further dividing the clusters of the appliances into various sets based on their operating time overlap and respective PAR values. The reduction in PAR ensures improvement in demand and supply balance which must be obtained for an MG to work resiliently [47].

VI. CONCLUSION

In this paper, a dynamic clustered community HEMS-based strategy is proposed to perform efficient energy management of residential consumers by involving demand response and user preferences. The proposed technique results in incentivized consumer and utility companies by exploiting the difference in user preferences and load consumption behaviors of various classes in society. Consumers relish the benefit of reduced EC and electricity supply company benefits through efficiently trimmed PAR augmenting reliability and stability in MGs. For performance validation, simulations were carried out and results of the proposed framework of DCCHEMS were compared with CCHEMS based strategy and PSO-IBR-based optimization. The proposed DCCHEMS based technique improves PAR by 21.26% and EC is improved by 4.11%. Variance to mean ratio is also improved by 19%.

NOMENCLATURE

ABBREVIATIONS

AMI	Advanced metering infrastructure.
AOTE	Appliance operation time end.
AOTL	Appliance operation time length.
AOTS	Appliance operation time start.
ATS	Activation time slot.
CA	Controllable appliance.
CCHEMS	Clustered community home energy management system.
CPP	Critical peak pricing.
CRP	Cost reduction percentage.
DCCHEMS	Dynamic clustered community-based home energy management system.
DR	Demand response.
EC	Electricity cost.
EP	Electricity price.
HAN	Home area network.
HC	Higher class.
HEMS	Home energy management system.
HG	Home gateway.
IBR	Inclined block rate.

IHD	In-home display.
LC	Lower class.
MC	Middle class.
MG	Microgrid.
NCA	Non-controllable appliance.
PAR	Peak to average ratio.
PARR	PAR reduction percentage.
PSEC	Power scheduled electricity cost.
PSO	Particle swarm optimization.
PUP	Power usage pattern.
PV	Photovoltaic.
PVMR	PUP variance to mean ratio.
RTEP	Real time electricity pricing.
TOUP	Time of use pricing.
UMC	Upper middle class.

SYMBOLS

α_{ak}	AOTL for appliance a of house k.
β_{ak}	AOTE for appliance a of house k.
P	Power consumption scheduling matrix of size 800*144.
P_{scd}	Power consumption scheduling vector.
P_{cc}	PUP for cluster of community.
γ_c	A threshold based on count of houses under current community.
λ	Penalty factor.
$gbest_j^t$	Global best in dimension j found from initialization through time t.
$pbest_{ij}^t$	Personal best position of particle i in dimension j found from initialization through time t.
$rte_{pc}(\tau)$	Real time electricity price of p_c .
μ_{PUP}	Mean PUP.
ω	Particle weight.
τ	Time slot.
A_k	Set of CAs of k^{th} house.
c_1	Momentum of pbest.
c_2	Pull towards gbest.
C_c	Current cluster of CAs.
C_h	Set of houses in current community.
l_{ak}	AOTL for appliance a of house k.
P_{ak}	Power consumption profile for appliance a of house k.
$p_{ak}(\tau)$	Power consumption value for a^{th} appliance of k^{th} house, during τ^{th} time slot.
p_c	Power consumption of community being optimized.
r_1, r_2	Random number in the interval [0, 1].
t_{ak}	ATS for appliance a of house k.
th	Threshold set for PUP at 2 kWh.
V_{ij}^t	Velocity vectors of particle i in dimension j at time t.
x_{ij}^t	Position vectors of particle i in dimension j at time t.
x_{ak}	Appliance rating for appliance a of house k.

ACKNOWLEDGMENT

The author Ayesha Abbasi is grateful to late Dr. Ijaz Mansoor Qureshi, who has been a great supervisor during her Ph.D. research. Mutual effort always brings productive results, for this she is really indebted to her fellows Nimra Noor and Bareera Qaseem for their support and help.

REFERENCES

- [1] B. Chen, J. Wang, X. Lu, C. Chen, and S. Zhao, "Networked microgrids for grid resilience, robustness, and efficiency: A review," *IEEE Trans. Smart Grid*, vol. 12, no. 1, pp. 18–32, Jan. 2021.
- [2] M. Ahmed, L. Meegahapola, A. Vahidnia, and M. Datta, "Stability and control aspects of microgrid architectures—A comprehensive review," *IEEE Access*, vol. 8, pp. 144730–144766, 2020.
- [3] E. Espina, J. Llanos, C. Burgos-Mellado, R. Cardenas-Dobson, M. Martinez-Gomez, and D. Saez, "Distributed control strategies for microgrids: An overview," *IEEE Access*, vol. 8, pp. 193412–193448, 2020.
- [4] F. S. Al-Ismael, "DC microgrid planning, operation, and control: A comprehensive review," *IEEE Access*, vol. 9, pp. 36154–36172, 2021.
- [5] F. Moazeni, J. Khazaee, and A. Asrari, "Step towards energy-water smart microgrids; buildings thermal energy and water demand management embedded in economic dispatch," *IEEE Trans. Smart Grid*, vol. 12, no. 5, pp. 3680–3691, Sep. 2021.
- [6] J. Leitao, P. Gil, B. Ribeiro, and A. Cardoso, "A survey on home energy management," *IEEE Access*, vol. 8, pp. 5699–5722, 2020.
- [7] B. Mahapatra and A. Nayyar, "Home energy management system (HEMS): Concept, architecture, infrastructure, challenges and energy management schemes," *Energy Syst.*, vol. 4, pp. 1–27, Nov. 2019.
- [8] A. Sangswang and M. Konghirun, "Optimal strategies in home energy management system integrating solar power, energy storage, and vehicle-to-grid for grid support and energy efficiency," *IEEE Trans. Ind. Appl.*, vol. 56, no. 5, pp. 5716–5728, Sep. 2020.
- [9] U. Zafar, S. Bayhan, and A. Sanfilippo, "Home energy management system concepts, configurations, and technologies for the smart grid," *IEEE Access*, vol. 8, pp. 119271–119286, 2020.
- [10] M. Hu, J.-W. Xiao, S.-C. Cui, and Y.-W. Wang, "Distributed real-time demand response for energy management scheduling in smart grid," *Int. J. Elect. Power Energy Syst.*, vol. 99, pp. 233–245, Jul. 2018.
- [11] Y. F. Du, L. Jiang, Y. Li, and Q. Wu, "A robust optimization approach for demand side scheduling considering uncertainty of manually operated appliances," *IEEE Trans. Smart Grid*, vol. 9, no. 2, pp. 743–755, Mar. 2018.
- [12] A. Imran, G. Hafeez, I. Khan, M. Usman, Z. Shafiq, A. B. Qazi, A. Khalid, and K.-D. Thoben, "Heuristic-based programable controller for efficient energy management under renewable energy sources and energy storage system in smart grid," *IEEE Access*, vol. 8, pp. 139587–139608, 2020.
- [13] K. Song, Y. Jang, M. Park, H.-S. Lee, and J. Ahn, "Energy efficiency of end-user groups for personalized HVAC control in multi-zone buildings," *Energy*, vol. 206, Sep. 2020, Art. no. 118116.
- [14] D. Danalakshmi, R. Gopi, A. Hariharasudan, I. Otola, and Y. Bilan, "Reactive power optimization and price management in microgrid enabled with blockchain," *Energies*, vol. 13, no. 23, p. 6179, Nov. 2020.
- [15] W. Feng, Z. Wei, G. Sun, Y. Zhou, H. Zang, and S. Chen, "A conditional value-at-risk-based dispatch approach for the energy management of smart buildings with HVAC systems," *Electr. Power Syst. Res.*, vol. 188, Nov. 2020, Art. no. 106535.
- [16] R. Z. Homod, H. Togun, H. J. Abd, and K. S. M. Sahari, "A novel hybrid modelling structure fabricated by using Takagi–Sugeno fuzzy to forecast HVAC systems energy demand in real-time for basra city," *Sustain. Cities Soc.*, vol. 56, May 2020, Art. no. 102091.
- [17] R. Z. Homod, K. S. Gaeid, S. M. Dawood, A. Hatami, and K. S. Sahari, "Evaluation of energy-saving potential for optimal time response of HVAC control system in smart buildings," *Appl. Energy*, vol. 271, Aug. 2020, Art. no. 115255.
- [18] Z. Zhang, Z. Wang, H. Wang, H. Zhang, W. Yang, and R. Cao, "Research on bi-level optimized operation strategy of microgrid cluster based on IABC algorithm," *IEEE Access*, vol. 9, pp. 15520–15529, 2021.
- [19] X. Dong, X. Li, and S. Cheng, "Energy management optimization of microgrid cluster based on multi-agent-system and hierarchical stackelberg game theory," *IEEE Access*, vol. 8, pp. 206183–206197, 2020.
- [20] A. Khalid, N. Javaid, M. Ilahi, T. Saba, A. Rehman, and A. Mateen, "Enhanced time-of-use electricity price rate using game theory," *Electron.*, vol. 8, p. 48, Jan. 2019.
- [21] R. Khalid, N. Javaid, M. H. Rahim, S. Aslam, and A. Sher, "Fuzzy energy management controller and scheduler for smart homes," *Sustain. Comput. Inform. Syst.*, vol. 21, pp. 103–118, Mar. 2019.
- [22] M. Waseem, Z. Lin, S. Liu, I. A. Sajjad, and T. Aziz, "Optimal GWCSO-based home appliances scheduling for demand response considering end-users comfort," *Electr. Power Syst. Res.*, vol. 187, Oct. 2020, Art. no. 106477.
- [23] M. S. Ahmed, A. Mohamed, T. Khatib, H. Shareef, R. Z. Homod, and J. A. Ali, "Real time optimal schedule controller for home energy management system using new binary backtracking search algorithm," *Energy Buildings*, vol. 138, pp. 215–227, Mar. 2017.
- [24] G. Dong and Z. Chen, "Data-driven energy management in a home micro-grid based on Bayesian optimal algorithm," *IEEE Trans. Ind. Informat.*, vol. 15, no. 2, pp. 869–877, Feb. 2019.
- [25] N. Javaid, G. Hafeez, S. Iqbal, N. Alrajeh, M. S. Alabed, and M. Guizani, "Energy efficient integration of renewable energy sources in the smart grid for demand side management," *IEEE Access*, vol. 6, pp. 77077–77096, 2018.
- [26] G. Hafeez, N. Islam, A. Ali, S. Ahmad, and M. U. A. K. S. Alimgeer, "A modular framework for optimal load scheduling under price-based demand response scheme in smart grid," *Processes*, vol. 7, no. 8, p. 499, Aug. 2019.
- [27] N. Javaid, M. Naseem, M. B. Rasheed, D. Mahmood, S. A. Khan, N. Alrajeh, and Z. Iqbal, "A new heuristically optimized home energy management controller for smart grid," *Sustain. Cities Soc.*, vol. 34, pp. 211–227, Oct. 2017.
- [28] G. Hafeez, K. S. Alimgeer, Z. Wadud, I. Khan, M. Usman, A. B. Qazi, and F. A. Khan, "An innovative optimization strategy for efficient energy management with day-ahead demand response signal and energy consumption forecasting in smart grid using artificial neural network," *IEEE Access*, vol. 8, pp. 84415–84433, 2020.
- [29] X. Jiang and C. Xiao, "Household energy demand management strategy based on operating power by genetic algorithm," *IEEE Access*, vol. 7, pp. 96414–96423, 2019.
- [30] H. Hussain, N. Javaid, and S. I. qbal, "An efficient demand side management system with a new optimized home Energy management controller in smart grid," *Energies*, vol. 11, no. 1, p. 190, Jan. 2018.
- [31] P. Paudyal and Z. Ni, "Smart home energy optimization with incentives compensation from inconvenience for shifting electric appliances," *Int. J. Elect. Power Energy Syst.*, vol. 109, pp. 652–660, Jul. 2019.
- [32] M. A. Aziz, I. M. Qureshi, T. A. Cheema, and E. A. Rashid, "Community based home energy management system," *IJUM Eng. J.*, vol. 18, no. 1, pp. 43–55, May 2017.
- [33] M. A. Aziz, I. M. Qureshi, T. A. Cheema, and A. N. Malik, "Time based device clustering for domestic power scheduling," *Int. J. Adv. Appl. Sci.*, vol. 4, no. 1, pp. 1–9, Dec. 2016.
- [34] H. Mohapatra and A. K. Rath, "A fault tolerant routing scheme for advanced metering infrastructure: An approach towards smart grid," *Cluster Comput.*, vol. 24, pp. 1–19, Mar. 2021.
- [35] P. Kanakaraja, S. Upadhyay, S. K. Kotamraju, G. V. S. Suneela, and R. Neelsh, "Design and implementation of smart energy meter using LoRa-WAN and IoT applications," *J. Phys., Conf. Ser.*, vol. 1804, Feb. 2021, Art. no. 12207.
- [36] M. Waseem, Z. Lin, S. Liu, Z. Zhang, T. Aziz, and D. Khan, "Fuzzy compromised solution-based novel home appliances scheduling and demand response with optimal dispatch of distributed energy resources," *Appl. Energy*, vol. 290, May 2021, Art. no. 116761.
- [37] Z. S. Ageed, S. R. M. Zeebaree, M. A. M. Sadeeq, M. B. Abdulrazzaq, B. W. Salim, A. A. Salih, H. M. Yasin, and A. M. Ahmed, "A state of art survey for intelligent energy monitoring systems," *Asian J. Res. Comput. Sci.*, vol. 1804, pp. 46–61, Apr. 2021.
- [38] A. Anees, I. Hussain, A. H. AlKhalidi, and M. Aslam, "Linear triangular optimization technique and pricing scheme in residential energy management systems," *Results Phys.*, vol. 9, pp. 858–865, Jun. 2018.
- [39] T. A. A. Victoire, "Week ahead electricity price forecasting using artificial bee colony optimized extreme learning machine with wavelet decomposition," *Tehnicki Vjesnik*, vol. 28, no. 2, pp. 556–567, Apr. 2021.
- [40] K. Arya and K. V. Chandrakala, *Day-Ahead Electricity Price Forecasting for Efficient Utility Operation Using Deep Neural Network Approach*. Boca Raton, FL, USA: CRC Press, 2021.

- [41] (2015). *Real-Time Pricing for Residential Customers*. Ameren Illinois Power Co. [Online]. Available: <https://www2.ameren.com/retailenergy/realtimprizes.aspx>
- [42] B. Hussain, Q. U. Hasan, N. Javaid, M. Guizani, A. Almogren, and A. Alamri, "An innovative heuristic algorithm for IoT-enabled smart Homes for developing countries," *IEEE Access*, vol. 6, pp. 15550–15575, 2018.
- [43] J. Kennedy and R. Eberhart, "Particle swarm optimization," in *Proc. IEEE Int. Conf. Neural Netw.*, vol. 4, Nov. 1995, pp. 1942–1948.
- [44] *Southern California Edison, Energy for What's Ahead*. Accessed: Mar. 5, 2021. [Online]. Available: www.sce.com
- [45] *Prepare for Power Shutoffs*. Accessed: Mar. 5, 2021. [Online]. Available: <https://www.pge.com>
- [46] *Matanuska Electric Association*. Accessed: Feb. 5, 2020. [Online]. Available: <http://www.me.a.coop/wp-content/uploads/2014/06/High-Bill-Packet.pdf>
- [47] A. Abbasi, I. M. Qureshi, and H. Abdullah, "An overview of control strategies with emphasis on demand response for stability and reliability enhancement of microgrids," in *Proc. Int. Conf. Power Gener. Syst. Renew. Energy Technol. (PGSRET)*, Sep. 2018, pp. 1–6, doi: 10.1109/PGSRET.2018.8686039.



energy, and microgrids.

AYESHA ABBASI received the B.S. degree in electrical engineering from Air University, in 2008, and the M.S. degree from the National University of Sciences and Technology (NUST), Islamabad, in 2013. She is currently pursuing the Ph.D.E.E. degree with IIUI Islamabad. She is also working as a Lecturer with the Department of Electrical Engineering, International Islamic University Islamabad. Her current research interests include energy management systems, renewable



interests include cognitive radio networks, cooperative communication, non-orthogonal multiple access techniques, detection and estimation techniques, evolutionary computation, chaos communication, cognitive Internet-of-Things, and performance analysis of wireless communication systems.

KIRAN SULTAN received the B.Sc. and M.Sc. degrees from the Department of Electrical Engineering, UET Taxila, Pakistan, in 2003 and 2008, respectively, and the Ph.D. degree from the Department of Electrical Engineering, Air University, Islamabad, Pakistan, in 2013. She is currently an Associate Professor with the Department of Computer and Information Technology (CIT), Faculty of Applied Studies (FAS), King Abdulaziz University, Jeddah, Saudi Arabia. Her research



MUHAMMAD ADNAN AZIZ received the B.S. degree in computer science from AIOU, Islamabad, Pakistan, in 2002, the M.S. degree in electronic engineering from Muhammad Ali Jinnah University, Islamabad, in 2008, and the Ph.D. degree in electronic engineering from Isra University, Islamabad, in 2017. He has been working as an Assistant Professor with Isra University, since 2019. His research interests include soft computing, power optimization, and signal processing.



ADNAN UMAR KHAN received the B.B. degree in electrical and electronic engineering from Eastern Mediterranean University, Cyprus, in 1994, the M.S. degree in communication system from the University of Portsmouth, U.K., in 1995, and the Ph.D. degree from De Montfort University, U.K. He is currently working as an Assistant Professor with the Department of Electrical Engineering, International Islamic University, Islamabad, Pakistan.



HASSAN ABDULLAH KHALID received the B.Sc. degree in electrical engineering from Air University, Islamabad, Pakistan, in 2007, the M.Sc. degree in electrical power engineering from the Chalmers University of Technology, Gothenburg, Sweden, in 2010, and the Ph.D. degree from the University of L'Aquila, L'Aquila, Italy, in 2016. Since 2016, he has been with the National University of Science and Technology, Islamabad, where he is currently an Assistant

Professor. His current research interests include systems control with applications in power electronics, energy conversion, renewable energy, and smart grids.



JOSEP M. GUERRERO (Fellow, IEEE) received the B.S. degree in telecommunications engineering, the M.S. degree in electronics engineering, and the Ph.D. degree in power electronics from the Technical University of Catalonia, Barcelona, in 1997, 2000, and 2003, respectively. Since 2011, he has been a Full Professor with the Department of Energy Technology, Aalborg University, Denmark, where he is currently responsible for the Microgrid Research Program. Since 2014, he has

been the Chair Professor with Shandong University, since 2015, he has been a Distinguished Guest Professor with Hunan University and since 2016, he has been a Visiting Professor Fellow with Aston University, U.K., and a Guest Professor with the Nanjing University of Posts and Telecommunications. In 2019, he became a Villum Investigator by The Villum Fonden, which supports the Center for Research on Microgrids (CROM), Aalborg University, where he is the Founder and the Director (www.crom.et.aau.dk). He has published more than 600 journal articles in the fields of microgrids and renewable energy systems, which are cited more than 60,000 times. His research interests is oriented to different microgrid aspects, including power electronics, distributed energy-storage systems, hierarchical and cooperative control, energy management systems, smart metering and the Internet of Things for ac/dc microgrid clusters, and islanded minigrids. He is specially focused on microgrid technologies applied to offshore wind, maritime microgrids for electrical ships, vessels, ferries, and seaports, and space microgrids applied to nanosatellites and spacecrafts. In 2015, he was elevated as an IEEE Fellow for his contributions on distributed power systems and microgrids. He received the Best Paper Award of the IEEE TRANSACTIONS ON ENERGY CONVERSION for the period 2014–2015, the Best Paper Prize of IEEE-PES in 2015, and the Best Paper Award of the *Journal of Power Electronics* in 2016. For seven consecutive years, from 2014 to 2020, he was awarded by Clarivate Analytics (former Thomson Reuters) as the Highly Cited Researcher with 50 highly cited papers. He is also an associate editor for a number of IEEE TRANSACTIONS.



BASSAM A. ZAFAR is currently a Full Professor with the Information System Department, Faculty of Computing and Information Technology, King Abdulaziz University, Jeddah, Saudi Arabia. His research interests include the IoT technologies, system modeling and simulation practices, artificial intelligent systems, and network communications.

...