

Article

# Oxidation of Selected Trace Organic Compounds through the Combination of Inline Electro-Chlorination with UV Radiation (UV/ECl<sub>2</sub>) as Alternative AOP for Decentralized Drinking Water Treatment

Philipp Otter <sup>1</sup>, Katharina Mette <sup>2</sup>, Robert Wesch <sup>2</sup>, Tobias Gerhardt <sup>2</sup>, Frank-Marc Krüger <sup>2</sup>, Alexander Goldmaier <sup>1</sup>, Florian Benz <sup>1</sup>, Pradyut Malakar <sup>3</sup> and Thomas Grischek <sup>4,\*</sup>

<sup>1</sup> AUTARCON GmbH, D-34117 Kassel, Germany; otter@autarcon.com (P.O.); goldmaier@autarcon.com (A.G.); benz@autarcon.com (F.B.)

<sup>2</sup> GNF e.V. Volmerstr. 7 B, 12489 Berlin, Germany; k.mette@gnf-berlin.de (K.M.); r.wesch@gnf-berlin.de (R.W.); t.gerhardt@gnf-berlin.de (T.G.); f.krueger@gnf-berlin.de (F.-M.K.)

<sup>3</sup> International Centre for Ecological Engineering, University of Kalyani, Kalyani, West Bengal 741235, India; pradyutmalakar2@gmail.com

<sup>4</sup> Division of Water Sciences, University of Applied Sciences Dresden, Friedrich-List-Platz 1, 01069 Dresden, Germany

\* Correspondence: thomas.grischek@htw-dresden.de; Tel.: +49-0351 4623350

Received: 6 October 2020; Accepted: 17 November 2020; Published: 21 November 2020



**Abstract:** A large variety of Advanced Oxidation Processes (AOPs) to degrade trace organic compounds during water treatment have been studied on a lab scale in the past. This paper presents the combination of inline electrolytic chlorine generation (ECl<sub>2</sub>) with low pressure UV reactors (UV/ECl<sub>2</sub>) in order to allow the operation of a chlorine-based AOP without the need for any chlorine dosing. Lab studies showed that from a Free Available Chlorine (FAC) concentration range between 1 and 18 mg/L produced by ECl<sub>2</sub> up to 84% can be photolyzed to form, among others, hydroxyl radicals ( $\cdot\text{OH}$ ) with an UV energy input of 0.48 kWh/m<sup>3</sup>. This ratio could be increased to 97% by doubling the UV energy input to 0.96 kWh/m<sup>3</sup> and was constant throughout the tested FAC range. Also the achieved radical yield of 64% did not change along the given FAC concentration range and no dependence between pH 6 and pH 8 could be found, largely simplifying the operation of a pilot scale system in drinking water treatment. Whereas with ECl<sub>2</sub> alone only 5% of benzotriazoles could be degraded, the combination with UV improved the degradation to 89%. Similar results were achieved for 4-methylbenzotriazole, 5-methylbenzotriazole and iomeprol. Oxipurinol and gabapentin were readily degraded by ECl<sub>2</sub> alone. The trihalomethanes values were maintained below the Germany drinking water standard of 50 µg/L, provided residual chlorine concentrations are kept within the permissible limits. The here presented treatment approach is promising for decentralized treatment application but requires further optimization in order to reduce its energy requirements.

**Keywords:** trace organic compounds; emerging pollutants; rural regions; electrochlorination; UV; AOP; energy per order

## 1. Introduction


Annually on average 15 g of pharmaceuticals are consumed per capita, but human bodies are unable to fully metabolize pharmaceuticals, which are then excreted as parental components or metabolites [1,2]. They are discharged into wastewater together with Personal Care Products

(PCPs), sweeteners, illicit and non-controlled drugs, complexing agents, nanoparticles, perfluorinated compounds, pesticides, flame retardants, fuel additives and endocrine disrupting chemicals and detergents [3,4]. Conventional wastewater treatment such as activated sludge processes, exhibits limitations in the removal of Trace Organic Compounds (TOrcs) [5,6]. TOrcs are additionally released into the environment from irrigation with treated or untreated wastewater [7], disposal of animal waste on agricultural sites [8] and artificial groundwater recharge [9]. World-wide studies have confirmed the occurrence of pharmaceutical residues in the effluents of wastewater treatment plants (WWTPs) as well as in surface and groundwaters [10–14].

The problem of water contamination with TOrcs is even more prevalent in some developing areas. E.g., in India, the amount of ciprofloxacin, sulfamethoxazole, amoxicillin, norfloxacin, and ofloxacin in treated wastewater was up to 40 times higher compared to other countries in Europe, Australia, Asia, and North America [5,8]. Here even remote rural areas are affected.

Conventional drinking water treatment processes such as coagulation and flocculation are not designed to effectively remove TOrcs [8]. Powdered activated carbon (PAC), membrane filtration technologies [15–17] or advanced oxidation processes (AOP) have been studied in the past to evaluate their efficiency on the removal of selected TOrcs [18]. Most studied AOPs are based on ozonation, Fenton oxidation, or UV based AOPs such as UV/H<sub>2</sub>O<sub>2</sub>. For the application of AOPs in water treatment, the supply of chemicals such H<sub>2</sub>O<sub>2</sub> in UV/H<sub>2</sub>O<sub>2</sub> AOP has been identified as major challenge and cost factor [19].

A relatively new AOP is the combination of chlorination with UV radiation (UV/Cl<sub>2</sub>) [20–24]. When aqueous chlorine solutions are exposed to UV, ·OH and ·Cl radicals are also formed (Figure 1). The reduction potential of ·OH radicals is with 2.8 V vs. Standard Hydrogen Electrode (SHE) substantially higher compared to the potential of ozone (2.07 V) or chlorine (1.37 V) [25]. UV/Cl<sub>2</sub> has proven to produce higher amounts of (·OH) radicals compared to UV/H<sub>2</sub>O<sub>2</sub> mainly due to the low absorbance of UV light by H<sub>2</sub>O<sub>2</sub> [20,26]. Whereas absorption coefficients (ε) for UV/H<sub>2</sub>O<sub>2</sub> of 19.6 M<sup>-1</sup>·cm<sup>-1</sup> have been identified for 254 nm [27] they have reached 59 M<sup>-1</sup>·cm<sup>-1</sup> and 66 M<sup>-1</sup>·cm<sup>-1</sup> for HOCl and OCl<sup>-</sup> [28]. Higher quantum yields with regards to radical generation for UV/Cl<sub>2</sub> where reported by [26]. When radiated with UV light hypochlorous acid and its anion hypochlorite react in water not only to OH, but also to the reactive chlorine species (RCS) ·Cl and Cl<sub>2</sub> as well as to oxygen radicals. At higher pH, hydroxyl radicals might be consumed by chlorine itself also forming RCS [29].

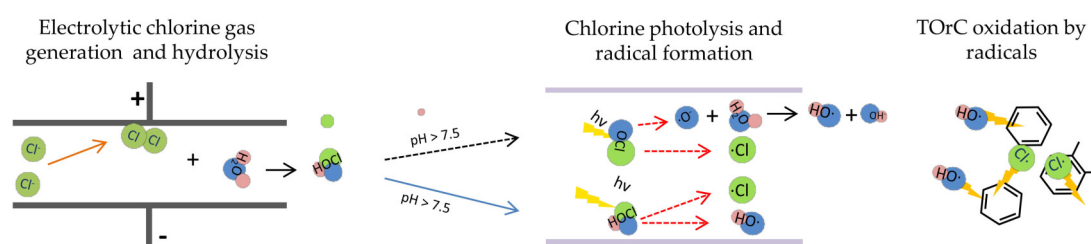

**Figure 1.** Pathway of chloride ions used for radical production (excerpt) in UV/ECl<sub>2</sub> process.

The RCS coexist with ·OH radicals and complement each other in degrading a wider variety of contaminants compared to e.g., UV/H<sub>2</sub>O<sub>2</sub> AOP [29,30]. Depending on the chlorine species present two reaction pathways (Equations (1)–(3)) for the production of ·OH and ·Cl exist [26].




However, the need to supply and dose chlorine reagents also persists for UV/Cl<sub>2</sub>-based AOPs. Here the production of chlorine through inline electrolysis (ECl<sub>2</sub>) could offer an alternative to

transportation, storage and handling of chlorine reagents. During  $\text{ECl}_2$  elementary chlorine is produced at the anode of an electrolytic cell from the natural chloride content of the water itself (Equation (4)). The chlorine immediately hydrolyses to form hypochlorous acid (Equation (5)) or hypochlorite (Equation (6)). Anodic side reactions and cathodic reactions are given in Equations (7) and (8):


Anodic reaction chlorine:



Hydrolysis of chlorine gas:



Equilibrium at pH = 7.5:



Anodic side reaction oxygen:



Cathodic reaction:



In past studies this approach has already proven feasible to meet the disinfection requirements for remote drinking water supply [31–33]. In the presented study  $\text{ECl}_2$  was combined with UV radiation (Figure 1).

The novelty of this approach is the operation of a chlorine based AOP for the degradation of TOrCs that is completely independent from any external chemical supply. On a small scale,  $\text{ECl}_2$  as well as UV could be easily operated by photovoltaic (PV) which makes the process also independent of any external energy supply.

Available, studies to evaluate the degradation potential of AOPs using chlorine have been generally carried out for single compounds investigating concentrations much higher than those found in real waters. Further, deionized water free of other organic substances was used as solvent and sophisticated equipment was applied for e.g., determining reaction constants ( $k'$ ). Therefore, uncertainties exist with regards to real case scenarios [24].

In this study a UV/ $\text{ECl}_2$  setting was tested under lab conditions in order to evaluate chlorine production and radical formation in dependence of chloride concentrations, pH, cell currents and UV energy input applied. Following the lab test a UV/ $\text{ECl}_2$  pilot setting was tested for the first time under real case conditions treating Elbe river water. In two short term sampling campaigns the removal efficiency of selected TOrCs, the energy consumption and the formation of disinfection by products (DBPs) by analyzing trihalomethanes (THM) was evaluated. The pilot system was operated long term to observe technical challenges that may occur under real case scenarios. The hypothesis of the here conducted work is, that the combination of  $\text{ECl}_2$  with UV poses a technically feasible alternative to reduce TOrCs without the need for any external chemicals and electricity supply, which can be applied in decentralized water treatment. The conducted trials hereby allow a first insight into the application of UV/ $\text{ECl}_2$  as part of an actual drinking water treatment system.


## 2. Methodology

To produce chlorine by means of  $\text{ECl}_2$  mixed oxide electrodes (MOX) (GNF, Berlin, Germany) coated with ruthenium (Ru) and iridium (Ir) oxides. Ru- and Ir-mixed oxide electrodes have been selected due to their low overpotential for the oxidation reaction of chloride to chlorine and therefore offer a higher current efficiency for chlorine evolution compared to e.g., platinum coated electrodes [34].

## 2.1. Lab Test Setting

In order to assure sufficient chlorine generated by inline electrolysis as precursors for the chlorine photolysis and disinfection, lab experiments were conducted. Those included the variation of chloride ion concentration, flow rate, current density, pH and electrical conductivity.

During lab tests water was pumped through an array of two MOX electrodes and up to two UV lamps (Figure 2). The distance between the cell plates was 5 mm. Currents of up to 8 A were applied on the electrodes. With a total surface area of 959 cm<sup>2</sup>, the current density accounted for 16.7 mA/cm<sup>2</sup>. These currents were chosen because previous (unpublished) studies showed that this is the maximum applicable current density for long term chlorine evolution without damaging the coating. The MOXs were powered using a BaseTech BT-305 power supply unit (Hirschau, Germany).

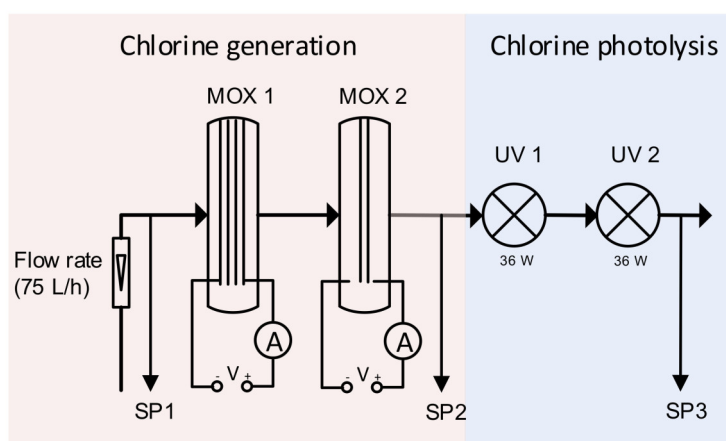

**Figure 2.** Lab test setting for performance evaluation of chlorine and radical formation.

Distilled water was pH adjusted with 10% HCl (Carl Roth, Karlsruhe, Germany) and 10% NaOH (Carl Roth). NaCl (Carl Roth) was added to the water to achieve concentrations of 25, 50 and 100 mg/L. The electric conductivity was adjusted to the desired value using NaHCO<sub>3</sub> (Carl Roth, Germany) and Na<sub>2</sub>SO<sub>4</sub> (Carl Roth). Samples for chlorine measurement were taken directly behind the MOXs at Sampling Point (SP) 2 and SP 3 (Figure 2). The chlorine was then photolyzed by up to two PURION<sup>®</sup> 2500 36 W low pressure UV-C reactors with a volume of 0.75 L which were equipped with a calibrated silicon semiconductor-based UV-irradiance sensor (SUV-13A1Y2C, Purion, Zella-Mehlis, Germany) on each UV unit to assure constant irradiation of the UV lamps. The radical yield was determined at SP3.

The input of the electrical energy for the UV photolysis was 0.48 kWh/m<sup>3</sup> for one and 0.96 kWh/m<sup>3</sup> for two lamps, respectively. Samples to evaluate radical formation were taken prior (SP2) and after the UV reactor(s) (SP3).

The amount of HOCl and OCl<sup>-</sup> decomposed (Equations (1) and (2)) during FAC photodegradation is directly related to the amount of ·OH radicals [35] and the radical yield factor  $\eta$  can thus be quantified following Equation (9):

$$\eta = \frac{\Delta n_{\cdot\text{OH}} + \Delta n_{\text{Cl}}}{\Delta n_{\text{FAC}}} \quad (9)$$


The quantification of radical formation was carried out following [36] as described below. The yield factors were calculated for pH values of 6, 7 and 8 in order to determine its dependence of chlorine species present (Equation (6)).

## 2.2. Field Test Settings

The field test was carried out for 10 months and was conducted with Elbe river water, which was filtrated by a UF system (150 kDa, 0.01  $\mu\text{m}$ , Pall, Port Washington, NY, USA) before the UV/ECl<sub>2</sub> AOP in order to provide turbidity free water.

As natural water matrices contain a variety of radical scavengers the here tested setting will generate only site-specific results. Better pre-treatment hereby is expected to generate higher degradation as shown in [37].

The water was pumped by the pilot system in a flow through setting through three MOX with a total area of 1918 cm<sup>2</sup> operated in series followed by up to two Purion<sup>®</sup> 2500 36 W low pressure UV-C lamps (Figure 3).

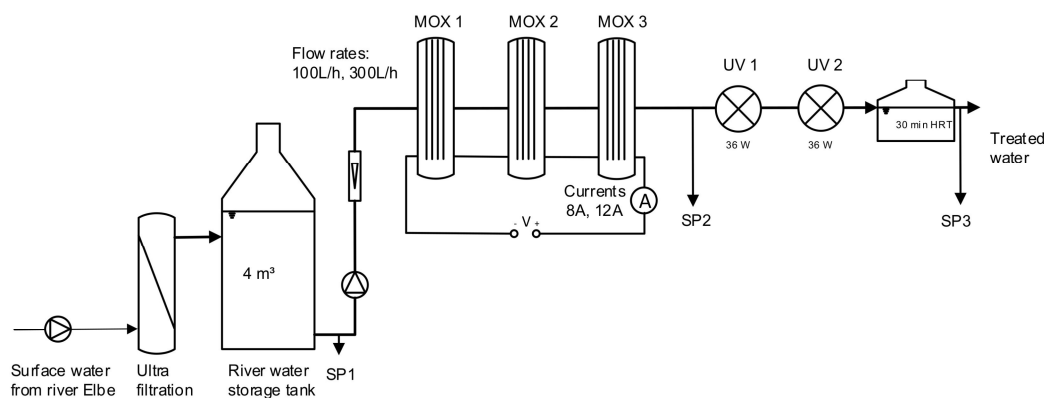

**Figure 3.** Pilot system tested with Elbe river water.

To release potentially formed calcareous deposits the polarity was inverted once every three hours. In own past studies, these comparable large intervals have proven to have a negligible effect on the lifetime of the electrolytic cells.

For the evaluation of TO<sub>r</sub>C degradation during drinking water treatment two short term sampling campaigns were conducted.

In order to evaluate the influence of the chlorine concentration and the UV irradiation on the degradation of TO<sub>r</sub>Cs the ECl<sub>2</sub> current and resulting current densities, the number of UV lamps and the flow rate were varied during the field test. This tested pilot settings are documented in Table 1 including the specific energy demand for each of the tested settings.

A current of 8 A was hereby selected to meet a minimum total chlorine concentration of 2 mg/L after the electrolytic cell. Sampling was done before treatment (SP1), behind the ECl<sub>2</sub> (SP2) and after a hydraulic retention time (HRT) of 30 min behind the respective number of UV reactors. Samples for TO<sub>r</sub>Cs, DOC, and THM analysis were quenched after 30 min using sulfite.

The MOX cell voltage was recorded in order to calculate energy demand and the “electric energy per order” (E<sub>EO</sub>) of the ECl<sub>2</sub> (Equation (10)). As handling of contaminants at a waterworks site was prohibited, no spiking of the water with TO<sub>r</sub>Cs was performed. Only selected substances, that were regularly present in the Elbe river water at sufficient concentrations (Table 2) were used for the evaluation of TO<sub>r</sub>C degradation. Due to the high costs of TO<sub>r</sub>C analysis the number of analyses and test settings was very limited in the here presented work and the results can only give a tendency of the degradation behavior.

Table 1. Test matrix and energy requirements for the different field test settings of UV/ECI<sub>2</sub>.

Test Setting	Pump				ECI <sub>2</sub>				UV			ECI <sub>2</sub> /UV Total Energy Input (kWh/m <sup>3</sup> )
	Flow Rate (L/h)	Energy Input (kWh/m <sup>3</sup> )	Linear Flow Velocity (m/h)	Current (A)	Voltage (V)	Current Density (mA/cm <sup>2</sup> )	Energy Input (kWh/m <sup>3</sup> )	No. of UV Lamps	Energy Input (kWh/m <sup>3</sup> )			
A	100	0.07	42	8	7.1	8.4	0.57	0	0.00	0.64		
								1	0.36	0.99		
								2	0.72	1.35		
B	100	0.07	42	12	9.5	12.6	1.14	0	0.00	1.21		
								2	0.72	1.93		
C	300	0.20	126	12	11.7	12.6	0.47	0	0.00	0.67		
								1	0.12	0.79		
								2	0.24	0.91		

**Table 2.** Analyzed TOrcs concentrations of UF Filtrate and relevant water quality parameters.

Parameter	Initial Concentrations/Values	Description
TOrc	1st and 2nd trial	
Benzotriazole (ng/L) CAS 95-14-7	410 and 440	Corrosion inhibitor
4-Methylbenzotriazole (ng/L) CAS 29878-31-7	190 and 170	Benzotriazole derivative used as a corrosion inhibitor
5-Methylbenzotriazole (ng/L) CAS 136-85-6	82 and 80	Antifreeze agent, corrosion inhibitor
Gabapentin (ng/L) CAS 60142-96-3	230 and 250	Anticonvulsant (Antiepileptic)
Iomeprol (ng/L) CAS 78649-41-9	380 and 520	X-ray contrast media
Oxipurinol (ng/L) CAS 2465-59-0	850 and 930	Active metabolite of Allopurinol (uricostatic)
Standard water quality parameters		
pH	8.1 and 7.9	
Temperature (°C)	18 and 25	
DOC (mg/L)	5.5 and 6.7	
Nitrate (mg/L NO <sub>3</sub> <sup>-</sup> ) *	13 ± 2.7	
Nitrite (mg/L NO <sub>2</sub> <sup>-</sup> )*	0.043 ± 0.02	
Ammonium (mg/L NH <sub>4</sub> ) *	0.082 ± 0.07	
Total Hardness (mg/L CaCO <sub>3</sub> )	67.5 ± 3.8	
Chloride (mg/L)	22.6 ± 3.7	

\* Elbe river data derived from [38] and calculated by authors.

### 2.3. Energy Demand and Energy Efficiency

In order to estimate the energetic efficiency of the UV/ECl<sub>2</sub> AOP, the “electric energy per order” (E<sub>EO</sub>), representing the electrical energy necessary for the degradation of one log unit of a contaminant, was calculated following Equation (10) [39]:



$$E_{EO} = \frac{P}{q \log\left(\frac{c_0}{c}\right)}, \quad (10)$$

where P: Electrical power applied to run the process (W), q: Flow rate (m<sup>3</sup>/h), c<sub>0</sub>: Initial contaminant concentration (µg/L) and c: Final contaminant concentration (µg/L)

The E<sub>EO</sub> of the here generated data allows a comparison with alternative AOPs and may serve as requisite data for the evaluation of their economic feasibility and sustainability. It should be considered that for the generation of E<sub>EO</sub> values of UV based AOPs in literature often only the energy required to power the UV lamp is considered. The energy required to produce, transport and dose e.g., H<sub>2</sub>O<sub>2</sub> or chlorine are often neglected. Therefore, the E<sub>EO</sub> calculated for the here presented approach distinguishes between the energy required for the UV and UV/ECl<sub>2</sub>. Further deviations are to be expected when varying process capacity and source water quality [40].

### 2.4. Water Analysis

The quantification of hydroxyl radicals was carried out following [36] by adding methanol (Carl Roth, Karlsruhe, Germany) in excess as radical scavenger. According to [41] methanol reacts with OH and Cl radicals to formaldehyde following the Equations (11)–(14):



Formaldehyde concentrations were analyzed following [42], where the extinction coefficient  $E_{DDL}$  caused by diacetyldihydrolutidin (DDL) formed during Hantzsch reaction was determined with a calibrated UV-VIS spectrometer (UV-1602, Shimadzu, Jena, Germany) using a 1 cm cuvette. Since the efficiency of  $\cdot\text{OH}$  radicals reacting with methanol is 93% [36], the OH radical production can be determined by the amount of DDL produced. As  $\cdot\text{Cl}$  is also an active species in this reaction [43], the calculated values only represent an upper limit of the  $\cdot\text{OH}$  production. Still, the obtained value is seen as useful to determine the capability of the formed radical species to react even with relatively inert C-H bonds like those of methanol.


Quantitative analysis of oxipurinol, gabapentin and iomeprol was done using HPLC-MS/MS following DIN 38407-47 using Agilent 1260 HPLC-System (Agilent Technologies, Waldbronn, Germany) und API 6500 MS/MS-System (AB Sciex, Darmstadt, Germany). Benzotriazoles were determined after automatic solid phase extraction with ASPEC (Gilson, Middleton, WI, USA) with HPLC-MS/MS Agilent 1200 HPLC-System (Agilent Technologies) and API 5500 MS/MS-System (AB Sciex) following TZW lab method. All substances had a Limit of Detection (LoD) of 0.01  $\mu\text{g/L}$  except oxipurinol with a LoD of 0.025  $\mu\text{g/L}$ . For analytic results below the LoD contaminant reduction rates and  $E_{EO}$  values were calculated by using the respective LoD.

The dissolved organic carbon (DOC) was analyzed with a TOC-V-CPH (Shimadzu, Kyoto, Japan) with integrated auto-sampler ASI-V (Shimadzu, Japan) following method DIN EN 1484:2019-04. The electrolytically produced Free Available Chlorine (FAC) and total chlorine was determined with AL410 photometer (Aqualytic, Dortmund, Germany) using Aqualytic DPD1 and DPD3 reagents with a measurement range between 0.01 and 6.0 mg/L. Electric conductivity (CDC401, Hach Düsseldorf, Germany) and pH (CDC401, Hach) were determined using a Hach HQ40d multimeter. THMs were analyzed following DIN EN ISO 10,301 using a 7890A GC/MS by Agilent Technologies (Santa Clara, CA, USA) with a detection limit of 0.1  $\mu\text{g/L}$ .

### 3. Results and Discussion

#### 3.1. Lab Test


Figure 4 shows the linear relation between current or current density applied at the MOX electrode and the formation of FAC at the given input chloride concentrations considering chloride concentration of 25, 50 and 100 mg/L in the synthetic water.

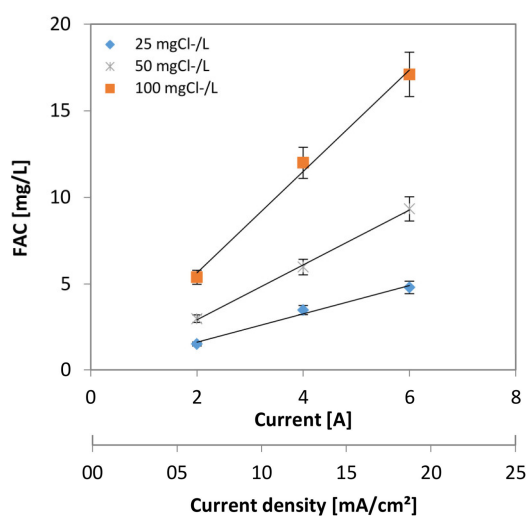

**Figure 4.** Relation between current and FAC concentration ( $n = 9$ ) ( $Q = 75$  L/h,  $EC = 400$   $\mu\text{S/cm}$ ,  $T = 19 \pm 1$  °C).




Figure 5 shows the linear relation between the chloride concentration and the FAC as well as the FAC production rate achieved at the applied currents of 2, 4 and 6 A.

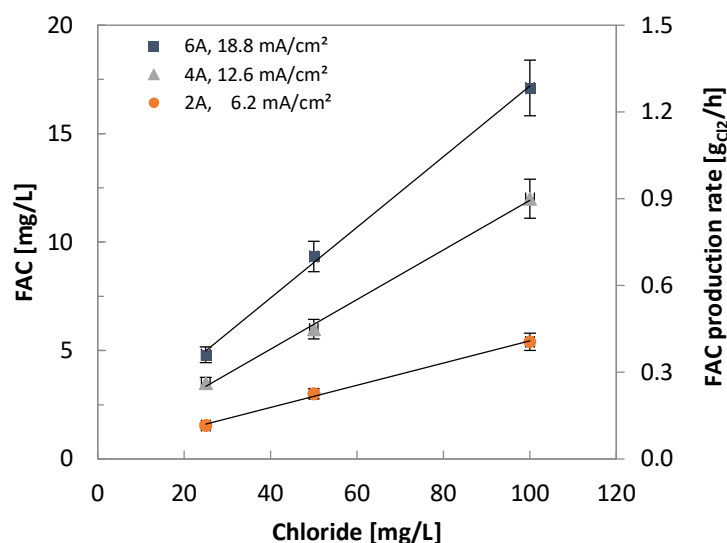

**Figure 5.** Relation between chloride concentration and FAC concentrations ( $n = 9$ ) ( $Q = 75$  L/h,  $EC = 400$   $\mu$ S/cm,  $T = 19 \pm 1$  °C).


Such relations were also derived in former studies as shown in [44]. The linearity largely simplifies the control of FAC generation, from an operational perspective. The currents at the MOX electrode can be easily adjusted in a treatment system within the here given current densities.

Figure 6 shows that charge specific chlorine production rates and current efficiencies are similar for currents of 2, 4, and 6 A with the applied cell. At higher currents, here shown with 8 A, the efficiency drops especially at higher chloride concentrations. This was related to the formation of gas bubbles at the anode surface.

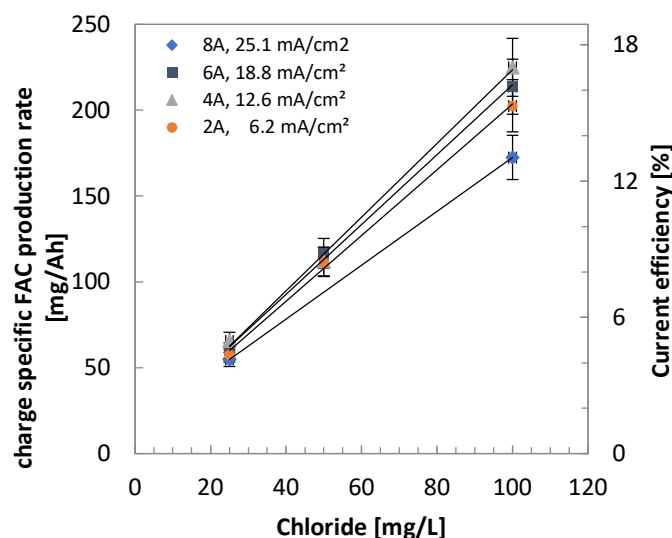

**Figure 6.** Relation of chloride concentration (with charge specific FAC production rate and current efficiency ( $n = 9$ )) ( $Q = 75$  L/h,  $EC = 400$   $\mu$ S/cm,  $T = 19 \pm 1$  °C).


Figure 7 shows the linear relation between the electrolytically produced FAC concentration and the resulting reduction in FAC when irradiated with 1 and 2 UV reactors.

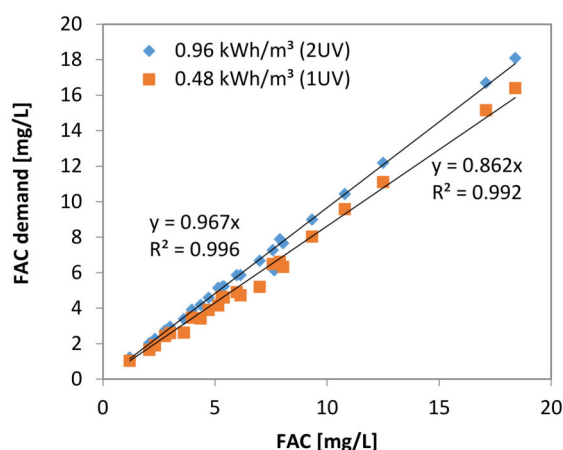

**Figure 7.** Chlorine consumption by UV treatment in dependence of FAC ( $Q = 75$  L/h,  $EC = 400$   $\mu$ S/cm,  $T = 19 \pm 1$  °C).

At the given FAC concentrations any additional FAC is readily photolyzed independent of its concentration. Already with the energy input of one UV lamp ( $0.48$  kWh/m<sup>3</sup>) 84% of the FAC is consumed. On average the chlorine concentration was reduced to  $1.0 \pm 0.5$  mg/L. The trials with two UV lamps achieved a FAC reduction of 96% and the chlorine concentration was further reduced on average to  $0.2 \pm 0.1$  mg/L, which would make FAC quenching as suggested by [24] dispensable. Whether the second UV lamp and with that the extra energy demanded is required, depends on the site-specific treatment targets, with regards to TO<sub>RC</sub> reduction, DBP formation potential, residual chlorine concentration and the design of the used UV-reactor.

Figure 8 shows the relation between FAC degradation and the radical formation by means of chlorine photolysis at the given pH values.

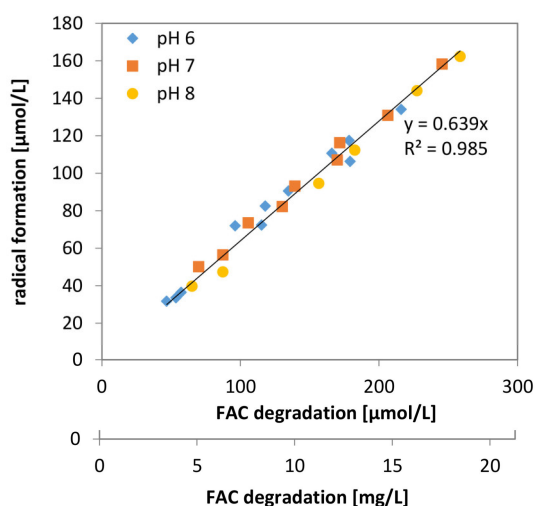

**Figure 8.** Radical formation in dependence of FAC demand at different pH ( $Q = 75$  L/h,  $EC = 400$   $\mu$ S/L,  $T = 19 \pm 1$  °C) ( $n = 26$ ).


The pH has no observable effect on the formation of radicals from photolyzed FAC. This relation has already been described by [28]. The average radical yield factor was constant over the here given FAC degradation range and with 64% ( $n = 26$ ) significantly higher than the reported values of [45].

From an operational perspective the here achieved constant radical yield factor in the examined FAC concentration range offers the possibility to evaluate the degradation of TO<sub>RC</sub> by monitoring the chlorine degradation.

However, with rising pH the concentration of  $\text{OCI}^-$  is increasing (Equation (6)). As  $\text{OCI}^-$  has a slightly higher adsorption coefficient at 254 nm [28] slightly higher radical concentrations can be expected at higher pH values. On the other hand radical scavenger effects of  $\text{HOCl}$  and  $\text{ClO}^-$  may result in additional chlorine degradation and the formation of oxy-chlorine radicals. Such scavenger effects are stronger at basic pH [29].

### 3.2. Field Tests

The total chlorine and FAC concentration measured directly after the  $\text{ECl}_2$  or the respective number of UV lamps (SP 3) during the treatment of Elbe river water is shown in Figure 9.

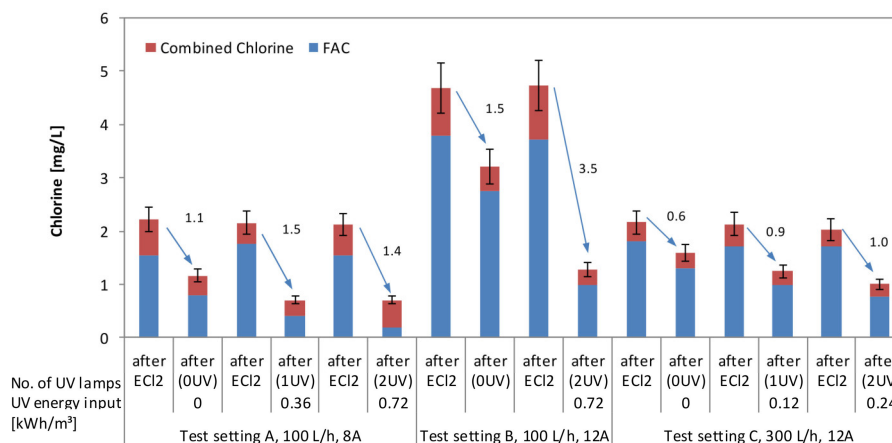


**Figure 9.** FAC and total chlorine concentrations measured in three different settings during field tests with Elbe river water.

The average concentrations of FAC directly after the  $\text{ECl}_2$  reached 1.6 ( $n = 3$ ), 3.8 ( $n = 2$ ), and 1.7 mg/L ( $n = 3$ ) for test settings A, B and C, respectively. Average total chlorine concentrations were 2.2 ( $n = 3$ ), 4.7 ( $n = 2$ ) and 2.1 mg/L ( $n = 3$ ). The chlorine degradation was dependent on the initial chlorine concentration and the UV energy input into the water as already shown in Figure 7.

The reduction in chlorine concentration of the tested water during the trials without UV radiation indicated with 1.1, 1.4 and 0.6 mg/L a high DBP formation potential, typical for surface waters. The lower chlorine demand values during test setting C were related to the shorter HRT in the final storage tank.

The degradation of the tested TOxCs after  $\text{ECl}_2$  only and after the photolysis of chlorine with the respective UV energy input is shown in Figure 10a–d.

The input concentrations for gabapentin and oxipurinol were 0.25 and 0.93  $\mu\text{g/L}$  respectively. These substances were nearly completely degraded at all given test settings alone by the produced chlorine. After passing the first UV lamp in test setting A, eventually still available quantities of gabapentin and oxipurinol were degraded below the LoD. In contrast to that benzotriazole and 5-methylbenzotriazole could be degraded by only by 5% and 4% with  $\text{ECl}_2$  alone during test setting A. Iomeprol and 4-methylbenzotriazole were degraded by 8% and 11%. Higher chlorine concentrations produced during test setting B did not substantially improve the degradation. However, in combination with UV radiation the degradation could be significantly increased. In test setting A the degradation of benzotriazole was increased to 49% and 73% with an energy input of 0.36 (1 UV) and 0.72 kWh/m<sup>3</sup> (2 UV), respectively. In combination with UV radiation the additional chlorine made available during test setting B further increased the degradation of benzotriazole to 89%. Iomeprol degradation could be increased to 83% and 82% during test settings A and B, respectively, with the energy of two UV lamps (0.72 kWh/m<sup>3</sup>). The behavior of 4-methylbenzotriazole and 5-methylbenzotriazole degradation was similar.

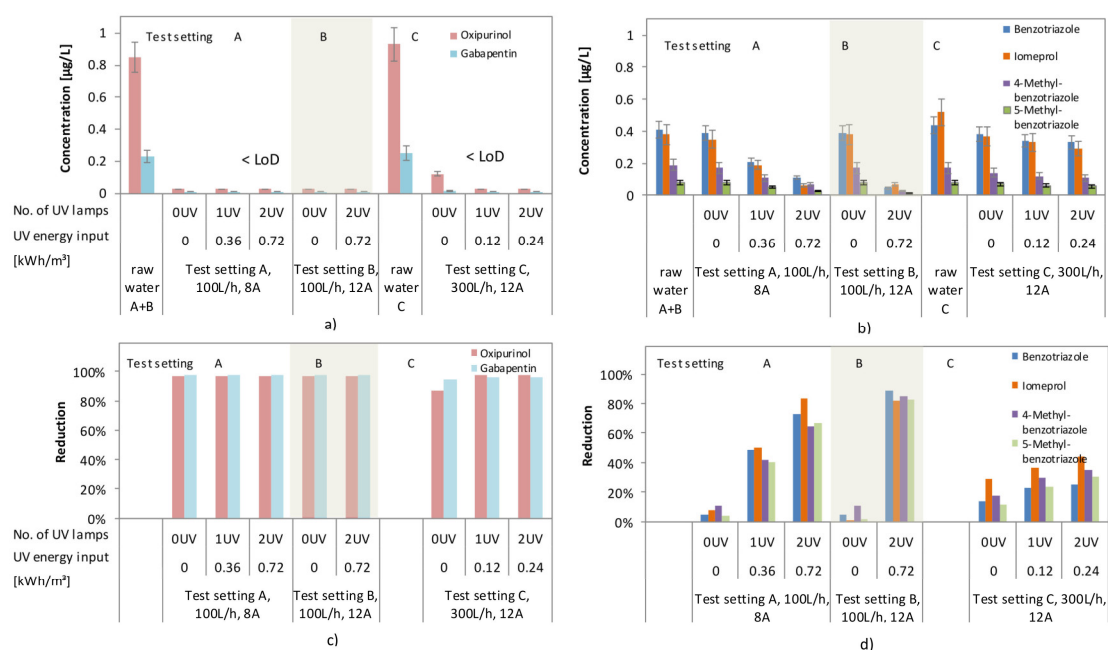

**Figure 10.** Concentrations of tested TOCs (a,b) and degradation percentages (c,d) concentrations measured in three different settings during field tests with Elbe river water.

Even though nearly equal amounts of chlorine were available, the degradation of all substances susceptible for the UV/ECl<sub>2</sub> AOP was largely reduced during test setting C. As also smaller amounts of chlorine were degraded, it can be concluded that at a flow rate of 300 L/h the HRT and by that the UV energy input was not sufficient to produce equal amounts of radicals as in test setting A.

### 3.3. Behavior of DOC and Formation of Disinfection-by-Products and Metabolites (Toxicity) during Field Tests

The mean DOC of Elbe river water in Dresden, Germany, is about 5.2 mg/L (4.6–6.0 mg/L,  $n = 325$ ) [46]. In test settings A and B the river water showed a slightly elevated DOC of 6.7 mg/L, and 5.6 mg/L in test setting C after ultrafiltration. The comparatively high DOC in test settings A and B was caused by runoff after heavy rainfall during the period of this test, whereas test setting C was performed a rainless period. DOC was reduced by 28% and 23% in test setting A and B and by only 3% in test setting C through ECl<sub>2</sub> alone as shown in Figure 11. The degradation of DOC without UV is explained by a direct oxidation of organics during the passage through the electrolytic cell as e.g., described in [47,48]. During test settings A and B the degradation of DOC was substantially higher compared to test setting C. This is related to the higher HRT and the nature of the DOC which is more easily degradable when containing runoff.

Figure 12 shows that DBPs measured as THMs have been formed after ECl<sub>2</sub> and for THMs the strict German threshold of 50 µg/L could not be adhered to for the majority of the tested settings. However, it was always possible to adhere to the EU guideline values of < 100 µg/L. The EU guideline values could always be maintained (Table 3). During the trials with UV applied the formation of THM was substantially lower compared to trials without UV radiation. Less THMs were formed because smaller amounts of chlorine were available after photolysis. During test setting A with 2 UV lamps the THM formation made up only 47% compared to the trial without UV radiation, by which the German guideline limits could be maintained. DBP formation is therefore related to residual chlorine levels rather than the AOP itself. This is confirmed by other studies where no significant increase of organic DBP formation during the application of UV/Cl<sub>2</sub> was found and most organic DBPs formed were related to the application of chlorine itself [49,50]. Also [24] found no significant quantities of THMs in UV/Cl<sub>2</sub> when adding 6 mg/L of chlorine prior to the UV lamp, using simulated

wastewater with a DOC of 46 mg/L (COD ~120 mg/L). In this study, residual chlorine was completely quenched after the UV lamp.


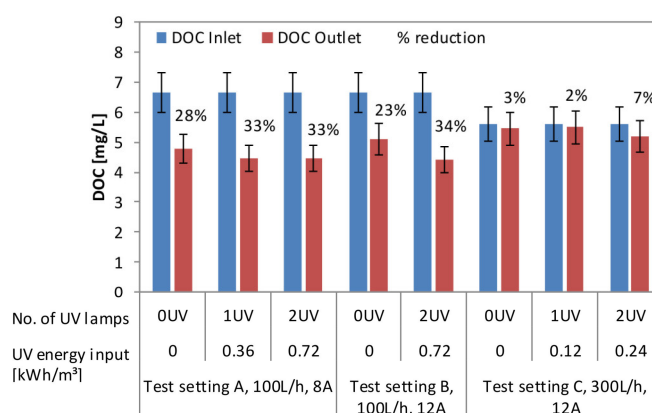


Figure 11. DOC concentrations measured in three different settings during field tests with Elbe river water.

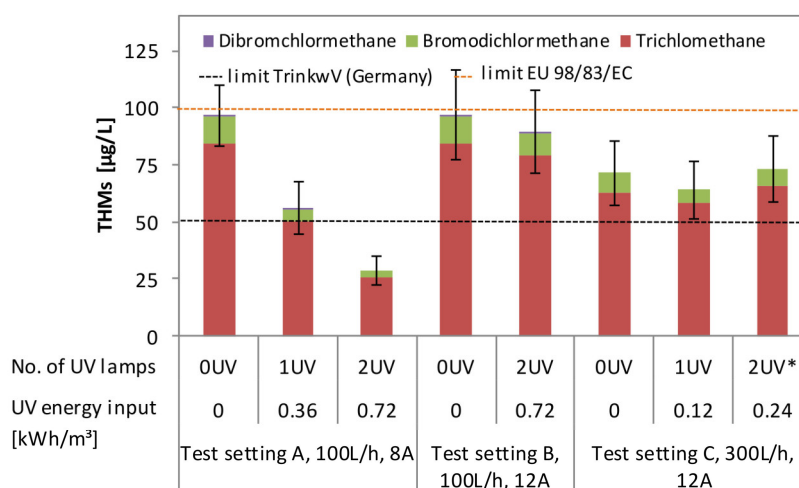

\* insufficient quenching of sample caused further generation of THMs and AOX

Figure 12. THM concentrations measured in three different settings during field tests with Elbe river water.

Table 3. Selected guideline values concerning the formation of THMs during drinking water disinfection.

Parameter	Germany [51]	EU [52]	India [53]	WHO [54]
THM (µg/L)	10 <sup>a</sup> /50 <sup>b</sup>	100	-	
Bromoform (µg/L)			100	100
Dibromochloromethane (µg/L)			100	100
Bromodichloromethane (µg/L)			60	60
Chloroform (µg/L)			200	300


<sup>a</sup> At the end of treatment, <sup>b</sup> Point of use.

To prevent excessive THM formation it is therefore suggested to closely monitor the residual chlorine concentration directly after the UV lamps and reduce the concentration whenever required by increasing the UV radiation or the flow rate. The field test data in Figure 9 indicate that residual chlorine concentrations around 0.2 mg/L, as required by many drinking water guidelines, seems to be promising to meet strict German guidelines for THMs.

From an operational perspective such chlorine levels must be monitored by integrating online probes into the algorithm controlling the chlorine production.

### 3.4. Energy Efficiency

Figure 13a,b and Table A1 (in Appendix A) show the  $E_{EO}$  values achieved for the degradation of the analyzed substances under the given conditions differentiating between the energy input into the chlorine production by means of  $ECl_2$  and photolysis of chlorine through UV radiation.

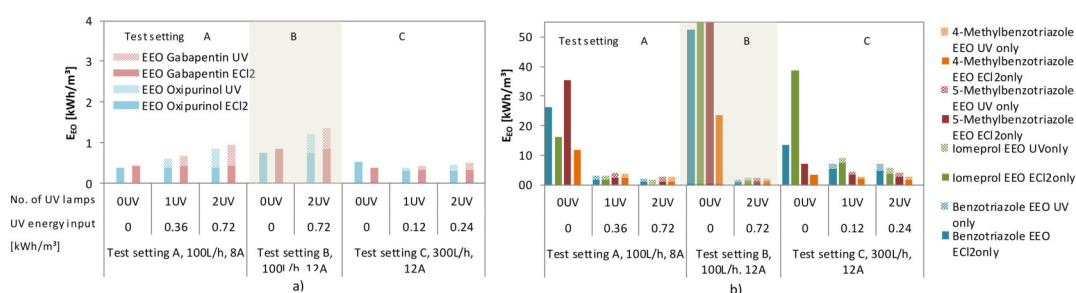

**Figure 13.**  $E_{EO}$ s for gabapentin and oxipurinol (a) and 4-methylbenzotriazole, 5-methylbenzotriazole iomeprol and benzotriazole (b) calculated from three different settings during field tests with Elbe river water.

For test setting A the  $E_{EO}$  for oxipurinol and gabapentin increased from 0.38 to 0.84 and from 0.42 to 0.95 kWh m<sup>-3</sup> order<sup>-1</sup> by increasing the energy input for chlorine photolysis from 0 to 0.72 kWh/m<sup>3</sup>. This increase is based on the fact that the additional energy input of the UV lamps does not substantially contribute to the degradation, as those substances are readily degraded by  $ECl_2$  alone as shown in Figure 10a. In contrast to that, the chlorine photolysis substantially reduced the  $E_{EO}$  for benzotriazole, iomeprol, 5-methylbenzotriazole, and 4-methylbenzotriazole during all test settings. In test setting A the  $E_{EO}$  for e.g., 5-methylbenzotriazole was reduced from 35.6 to 2.7 kWh m<sup>-3</sup> order<sup>-1</sup> with an energy input for chlorine photolysis caused by the UV lamps of 0.72 kWh/m<sup>3</sup> (2 UV). For benzotriazole the  $E_{EO}$  was reduced from 26.5 to 2.3 kWh m<sup>-3</sup> order<sup>-1</sup> with the same energy input. During test setting B the UV lamps reduced the  $E_{EO}$  for benzotriazole from a rather theoretical value of 52.5 without UV lamps to 1.9 kWh m<sup>-3</sup> order<sup>-1</sup> with an UV energy input of 0.72 kWh/m<sup>3</sup> (2 UV). This shows the positive effect of adding a minor quantity of additional energy in the form of UV light into the setting in order to substantially reducing the  $E_{EO}$ .

Despite the substantial improvement of TOrC degradation through the photolysis of chlorine the achieved  $E_{EO}$  values are higher compared to the literature reported  $E_{EO}$  values for e.g., UV/H<sub>2</sub>O<sub>2</sub> AOP. [24] reported an  $E_{EO}$  for benzotriazole for H<sub>2</sub>O<sub>2</sub>/UV of 0.52 kWh m<sup>-3</sup> order<sup>-1</sup>, neglecting hereby the energy required to produce and supply H<sub>2</sub>O<sub>2</sub>. However, even after removing the energy required for  $ECl_2$  from the UV/ $ECl_2$  AOP the resulting  $E_{EO}$  for e.g., benzotriazole was still higher with 1.0 and 1.2 kWh m<sup>-3</sup> order<sup>-1</sup> for test settings A and B. Whether this was related to the different water qualities tested cannot be evaluated here. Due to the limited data available the  $E_{EO}$  values calculated and the energy consumed can only be taken as an indication and further studies are required. A reduction of the energy demand by 30–70% by using UV/ $ECl_2$  instead of UV/H<sub>2</sub>O<sub>2</sub> as estimated by [24] seems not likely with the settings examined in this work.

### 3.5. Operational Experience and Optimization

The long term UV/ $ECl_2$  trial was conducted over a period of 10 months during which 1023 m<sup>3</sup> (3.4 m<sup>3</sup>/d) of water were treated. The system operated without any interruption caused by technical reasons. The only maintenance required was the manual cleaning of the quartz glass sleeves, from which deposits needed to be removed in a one-month interval, as those have reduced the UV dose. The components, and especially the electrolytic cells, did not show any sign of wear by the time the trial

was finished. The concentration of total hardness found in Elbe river water (Table 2) have proven to be harmless with regards the formation of calcareous deposits in the cell surface with the selected polarity inversion intervals of three hours. In future tests these intervals should be extended. No chemicals for the operation and maintenance of the system were required.

Considering the high degradation rates of TOxCs, the comparably low formation of organic DBPs and the low  $E_{EO}$  for the setting with a flow rate of 100 L/h, a current at the MOX of 8 A and the UV radiation of  $2 \times 36$  W lamps ( $0.72 \text{ kWh/m}^3$ ) was most promising and should constitute the base for further optimization. At this setting a total energy demand for the AOP process including pumping would sum up to  $1.35 \text{ kWh/m}^3$ . In remote regions this energy can be supplied easily with renewable PV Energy systems as already shown in [55].

#### 4. Conclusions

The photolysis of chlorine (UV/ $\text{Cl}_2$ ) was identified as promising AOP for the degradation of TOxCs present in drinking water sources. In the here presented work the chlorine required to run an UV/ $\text{Cl}_2$  AOP was produced by means of inline electrolysis from the natural chloride content of the water and by that substituted the external supply of chlorine, allowing the operation of an AOP without any additional need of chemicals.

For FAC concentrations between 1 and 18 mg/L an UV energy input of  $0.48 \text{ kWh/m}^3$  photolyzed 84% of the chlorine to form OH and Cl radicals. The degradation could be increased to 97% by doubling the UV energy input for the photolysis. The tests have further shown that the molar radical yield factor is about 64% and also very constant over the tested FAC range of 1–18 mg/L. In principle this allows to control the radical formation by adjusting the chlorine concentration simply through variation of the electric current at the MOX electrode.

By combining  $\text{ECl}_2$  with UV the degradation of benzotriazole and iomeprol can be increased from 5% to 89% and from 8% to 84%, respectively, compared to the application of  $\text{ECl}_2$  alone.

In most of the test settings the formation of organic DBPs measured as THMs have reached concentrations above the strict German guideline values for drinking water of  $50 \mu\text{g/L}$ . EU guideline values could be adhered to with all of the tested settings. The formation of such DBPs was related to elevated residual chlorine concentrations after the photolysis of chlorine and can be controlled by reducing the residual chlorine concentrations to levels that are adequate for drinking water disinfection. This requires site specific adaption of the treatment process.

The calculated  $E_{EO}$  values have found to be higher than literature values of alternative AOPs. The identified optimization potential should be considered to reduce the overall energy requirement of this technology. The main advantage of the here presented approach is the application of an effective AOP to degrade TOxC independent of any external chemical input. By that the UV/ $\text{ECl}_2$  AOP constitutes an alternative treatment approach especially for decentralized applications.

Further data and research is required to confirm the here presented results and the effect of the AOP on other TOxCs. Optimization potential is given by increasing the HRT in the UV reactors by adapting the reactor design.

Interesting for future application may also be further treatment of treated wastewater prior to its discharge into the environment.

**Author Contributions:** Conceptualization, methodology, investigation, P.O., F.-M.K., K.M., A.G., F.B., P.M. and T.G. (Tobias Gerhardt); writing—original draft preparation, P.O. and R.W.; writing—review and editing, P.O., T.G. (Thomas Grischek), F.-M.K., K.M. and T.G. (Tobias Gerhardt); supervision, T.G. (Thomas Grischek); funding acquisition, project administration, P.O. and F.-M.K. All authors have read and agreed to the published version of the manuscript.

**Funding:** This research was funded by the German Ministry of Education and Research (BMBF), program “KMU-Innovativ” grant no. 02WQ1395. The APC was funded by the Open Access Publication Fund of Hochschule für Technik und Wirtschaft Dresden, University of Applied Sciences, and the Deutsche Forschungsgemeinschaft (DFG, German Research Foundation)—432908064.

**Conflicts of Interest:** There are no conflicts to declare.

## Appendix A

Table A1.  $E_{EO}$  values achieved during field tests with Elbe river water considering  $E_{Cl_2}$  and  $UV/E_{Cl_2}$ .

	$E_{EO-(E_{Cl_2})}$ [kWh/(order·m <sup>3</sup> )]		Field test				$E_{EO-(E_{Cl_2} + UV)}$ [kWh/(Order·m <sup>3</sup> )]		Elimination [%]		Literature values $E_{EO-UV/Cl_2}$ [kWh/(Order·m <sup>3</sup> )]
	min	max	min	max	min	max	min	max	min	max	
Benzotriazole	13.6	52.5	5%	14%	1.9	7.3	25%	89%	0.5	[24]	
4-Methyl-benzotriazole	1.3	23.6	11%	18%	0.6	1.5	29%	85%	n.a.		
5-Methyl-benzotriazole	7.2	213.9	1%	11%	0.9	1.6	24%	83%	n.a.		
Iomeprol	16.1	996.2	0%	29%	1.7	9.3	37%	83%	n.a.		
Gabapentin	0.4	≤0.8	94%	≥98%	≤0.4	1.4	≥96%	≥98%	n.a.		
Oxipurinol	≤0.4	≤0.7	87%	≥97%	≤0.3	≤0.7	≥97%	≥97%	n.a.		



## References

1. Kümmerer, K. *Pharmaceuticals in the Environment*; Springer Berlin Heidelberg: Berlin/Heidelberg, Germany, 2008; ISBN 978-3-540-74663-8.
2. Ternes, T.; Joss, A. (Eds.) *Human Pharmaceuticals, Hormones and Fragrances. The Challenge of Micropollutants in Urban Water Management*; IWA Publ: London, UK, 2008; ISBN 9781843390930.
3. Houtman, C.J. Emerging contaminants in surface waters and their relevance for the production of drinking water in Europe. *J. Integr. Environ. Sci.* **2010**, *7*, 271–295. [[CrossRef](#)]
4. Montes-Grajales, D.; Fennix-Agudelo, M.; Miranda-Castro, W. Occurrence of personal care products as emerging chemicals of concern in water resources: A review. *Sci. Total Environ.* **2017**, *595*, 601–614. [[CrossRef](#)] [[PubMed](#)]
5. Mohapatra, S.; Huang, C.-H.; Mukherji, S.; Padhye, L.P. Occurrence and fate of pharmaceuticals in WWTPs in India and comparison with a similar study in the United States. *Chemosphere* **2016**, *159*, 526–535. [[CrossRef](#)] [[PubMed](#)]
6. Tran, N.H.; Reinhard, M.; Gin, K.Y.-H. Occurrence and fate of emerging contaminants in municipal wastewater treatment plants from different geographical regions—a review. *Water Res.* **2018**, *133*, 182–207. [[CrossRef](#)]
7. Kibuye, F.A.; Gall, H.E.; Elkin, K.R.; Ayers, B.; Veith, T.L.; Miller, M.; Jacob, S.; Hayden, K.R.; Watson, J.E.; Elliott, H.A. Fate of pharmaceuticals in a spray-irrigation system: From wastewater to groundwater. *Sci. Total Environ.* **2019**, *654*, 197–208. [[CrossRef](#)]
8. Balakrishna, K.; Rath, A.; Praveenkumarreddy, Y.; Guruge, K.S.; Subedi, B. A review of the occurrence of pharmaceuticals and personal care products in Indian water bodies. *Ecotoxicol. Environ. Saf.* **2017**, *137*, 113–120. [[CrossRef](#)]
9. Hellauer, K.; Mergel, D.; Ruhl, A.; Filter, J.; Hübner, U.; Jekel, M.; Drewes, J. Advancing Sequential Managed Aquifer Recharge Technology (SMART) using different intermediate oxidation processes. *Water* **2017**, *9*, 221. [[CrossRef](#)]
10. Hirsch, R.; Ternes, T.; Haberer, K.; Kratz, K.-L. Occurrence of antibiotics in the aquatic environment. *Sci. Total Environ.* **1999**, *225*, 109–118. [[CrossRef](#)]
11. Kolpin, D.W.; Furlong, E.T.; Meyer, M.T.; Thurman, E.M.; Zaugg, S.D.; Barber, L.B.; Buxton, H.T. Pharmaceuticals, hormones, and other organic wastewater contaminants in U.S. streams, 1999–2000: A national reconnaissance. *Environ. Sci. Technol.* **2002**, *36*, 1202–1211. [[CrossRef](#)]
12. Schwab, B.W.; Hayes, E.P.; Fiori, J.M.; Mastrocco, F.J.; Roden, N.M.; Cragin, D.; Meyerhoff, R.D.; D’Aco, V.J.; Anderson, P.D. Human pharmaceuticals in US surface waters: A human health risk assessment. *Regul. Toxicol. Pharmacol.* **2005**, *42*, 296–312. [[CrossRef](#)]
13. Avisar, D.; Levin, G.; Gozlan, I. The processes affecting oxytetracycline contamination of groundwater in a phreatic aquifer underlying industrial fish ponds in Israel. *Environ. Earth Sci.* **2009**, *59*, 939–945. [[CrossRef](#)]
14. Ebele, A.J.; Abou-Elwafa Abdallah, M.; Harrad, S. Pharmaceuticals and personal care products (PPCPs) in the freshwater aquatic environment. *Emerg. Contam.* **2017**, *3*, 1–16. [[CrossRef](#)]
15. Bolong, N.; Ismail, A.F.; Salim, M.R.; Matsuura, T. A review of the effects of emerging contaminants in wastewater and options for their removal. *Desalination* **2009**, *239*, 229–246. [[CrossRef](#)]
16. Dolar, D.; Gros, M.; Rodriguez-Mozaz, S.; Moreno, J.; Comas, J.; Rodriguez-Roda, I.; Barceló, D. Removal of emerging contaminants from municipal wastewater with an integrated membrane system, MBR-RO. *J. Hazard. Mater.* **2012**, *239–240*, 64–69. [[CrossRef](#)] [[PubMed](#)]
17. Snyder, S.A.; Adham, S.; Redding, A.M.; Cannon, F.S.; DeCarolis, J.; Oppenheimer, J.; Wert, E.C.; Yoon, Y. Role of membranes and activated carbon in the removal of endocrine disruptors and pharmaceuticals. *Desalination* **2007**, *202*, 156–181. [[CrossRef](#)]
18. Yang, Y.; Pignatello, J.J.; Ma, J.; Mitch, W.A. Comparison of halide impacts on the efficiency of contaminant degradation by sulfate and hydroxyl radical-based advanced oxidation processes (AOPs). *Environ. Sci. Technol.* **2014**, *48*, 2344–2351. [[CrossRef](#)]
19. Rosenfeldt, E.J.; Linden, K.G.; Canonica, S.; Gunten, U. von. Comparison of the efficiency of  $^{\bullet}\text{OH}$  radical formation during ozonation and the advanced oxidation processes  $\text{O}_3/\text{H}_2\text{O}_2$  and  $\text{UV}/\text{H}_2\text{O}_2$ . *Water Res.* **2006**, *40*, 3695–3704. [[CrossRef](#)]
20. Fang, J.; Fu, Y.; Shang, C. The roles of reactive species in micropollutant degradation in the UV/free chlorine system. *Environ. Sci. Technol.* **2014**, *48*, 1859–1868. [[CrossRef](#)]

21. Wang, W.-L.; Wu, Q.-Y.; Huang, N.; Wang, T.; Hu, H.-Y. Synergistic effect between UV and chlorine (UV/chlorine) on the degradation of carbamazepine: Influence factors and radical species. *Water Res.* **2016**, *98*, 190–198. [CrossRef]
22. Xiang, Y.; Fang, J.; Shang, C. Kinetics and pathways of ibuprofen degradation by the UV/chlorine advanced oxidation process. *Water Res.* **2016**, *90*, 301–308. [CrossRef]
23. Rott, E.; Kuch, B.; Lange, C.; Richter, P.; Kugele, A.; Minke, R. Removal of emerging contaminants and estrogenic activity from wastewater treatment plant effluent with UV/chlorine and UV/H<sub>2</sub>O<sub>2</sub> advanced oxidation treatment at pilot scale. *Int. J. Environ. Res. Public Health* **2018**, *15*, 935. [CrossRef] [PubMed]
24. Sichel, C.; Garcia, C.; Andre, K. Feasibility studies: UV/chlorine advanced oxidation treatment for the removal of emerging contaminants. *Water Res.* **2011**, *45*, 6371–6380. [CrossRef] [PubMed]
25. Latimer, W.M. *The Oxidation States of the Elements and Their Potentials in Aqueous Solutions*, 2nd ed.; Prentice-Hall: New York, NY, USA, 1952.
26. Watts, M.J.; Linden, K.G. Chlorine photolysis and subsequent OH radical production during UV treatment of chlorinated water. *Water Res.* **2007**, *41*, 2871–2878. [CrossRef] [PubMed]
27. Baxendale, J.H.; Wilson, J.A. The photolysis of hydrogen peroxide at high light intensities. *Trans. Faraday Soc.* **1957**, *53*, 344. [CrossRef]
28. Feng, Y.; Smith, D.W.; Bolton, J.R. Photolysis of aqueous free chlorine species (HOCl and OCl) with 254 nm ultraviolet light. *J. Environ. Eng. Sci.* **2007**, *6*, 277–284. [CrossRef]
29. Kishimoto, N. State of the art of UV/chlorine Advanced Oxidation Processes: Their mechanism, byproducts formation, process variation, and applications. *J. Wat. Environ. Tech.* **2019**, *17*, 302–335. [CrossRef]
30. Grebel, J.E.; Pignatello, J.J.; Mitch, W.A. Effect of halide ions and carbonates on organic contaminant degradation by hydroxyl radical-based advanced oxidation processes in saline waters. *Environ. Sci. Technol.* **2010**, *44*, 6822–6828. [CrossRef]
31. Haaken, D.; Dittmar, T.; Schmalz, V.; Worch, E. Influence of operating conditions and wastewater-specific parameters on the electrochemical bulk disinfection of biologically treated sewage at boron-doped diamond (BDD) electrodes. *Desalin. Water Treat.* **2012**, *46*, 160–167. [CrossRef]
32. Haaken, D.; Dittmar, T.; Schmalz, V.; Worch, E. Disinfection of biologically treated wastewater and prevention of biofouling by UV/electrolysis hybrid technology: Influence factors and limits for domestic wastewater reuse. *Water Res.* **2014**, *52*, 20–28. [CrossRef]
33. Kraft, A. Electrochemical water disinfection: A short review. *Platinum Metals Review* **2008**, *52*, 177–185. [CrossRef]
34. Kraft, A.; Stadelmann, M.; Blaschke, M.; Kreysig, D.; Sandt, B.; Schröder, F.; Rennau, J. Electrochemical water disinfection: Part I: Hypochlorite production from very dilute chloride solutions. *J. Appl. Electrochem.* **1999**, *29*, 859–866. [CrossRef]
35. Buxton, G.V.; Subhani, M.S. Radiation chemistry and photochemistry of oxychlorine ions. Part 2. Photodecomposition of aqueous solutions of hypochlorite ions. *J. Chem. Soc. Faraday Trans.* **1972**, *68*, 958. [CrossRef]
36. Asmus, K.D.; Moeckel, H.; Henglein, A. Pulse radiolytic study of the site of hydroxyl radical attack on aliphatic alcohols in aqueous solution. *J. Phys. Chem.* **1973**, *77*, 1218–1221. [CrossRef]
37. Abdelraheem, W.H.; Nadagouda, M.N.; Dionysiou, D.D. Solar light-assisted remediation of domestic wastewater by NB-TiO<sub>2</sub> nanoparticles for potable reuse. *Applied Catalysis B Environ.* **2020**, *269*, 118807. [CrossRef]
38. LfULG, online data base iDA, Saxon State Authority for Environment, Agriculture and Geology. 2020. Available online: <https://www.umwelt.sachsen.de/umwelt/infosysteme/ida/> (accessed on 5 August 2020).
39. Bolton, J.R.; Bircher, K.G.; Tumas, W.; Tolman, C.A. Figures-of-merit for the technical development and application of advanced oxidation technologies for both electric- and solar-driven systems. *Pure Appl. Chem.* **2001**, *2001*, 627–637. [CrossRef]
40. Bolton, J.R.; Stefan, M.I. Fundamental photochemical approach to the concepts of fluence (UV dose) and electrical energy efficiency in photochemical degradation reactions. *Res. Chem. Intermed.* **2002**, *28*, 857–870. [CrossRef]
41. Monod, A.; Chebbi, A.; Durand-Jolibois, R.; Carlier, P. Oxidation of methanol by hydroxyl radicals in aqueous solution under simulated cloud droplet conditions. *Atmos. Environ.* **2000**, *34*, 5283–5294. [CrossRef]
42. Nash, T. Colorimetric determination of formaldehyde under mild conditions. *Nature* **1952**, *170*, 976. [CrossRef]

43. Payne, W.A.; Brunning, J.; Mitchell, M.B.; Stief, L.J. Kinetics of the reactions of atomic chlorine with methanol and the hydroxymethyl radical with molecular oxygen at 298 K. *Int. J. Chem. Kinet.* **1988**, *20*, 63–74. [CrossRef]
44. Kraft, A.; Blaschke, M.; Kreysig, D.; Sandt, B.; Schröder, F.; Rennau, J. Electrochemical water disinfection. Part II: Hypochlorite production from potable water, chlorine consumption and the problem of calcareous deposits. *J. Appl. Electrochem.* **1999**, *29*, 895–902. [CrossRef]
45. Jin, J.; El-Din, M.G.; Bolton, J.R. Assessment of the UV/chlorine process as an advanced oxidation process. *Water Res.* **2011**, *45*, 1890–1896. [CrossRef] [PubMed]
46. Paufler, S.; Grischek, T.; Benso, M.; Seidel, N.; Fischer, T. The impact of river discharge and water temperature on manganese release from the riverbed during riverbank filtration: A case study from Dresden, Germany. *Water* **2018**, *10*, 1476. [CrossRef]
47. Houk, L.L.; Johnson, S.K.; Feng, J.; Houk, R.S.; Johnson, D.C. Electrochemical incineration of benzoquinone in aqueous media using a quaternary metal oxide electrode in the absence of a soluble supporting electrolyte. *J. Appl. Electrochem.* **1998**, *28*, 1167–1177. [CrossRef]
48. Johnson, S.K.; Houk, L.L.; Feng, J.; Houk, R.S.; Johnson, D.C. Electrochemical incineration of 4-chlorophenol and the identification of products and intermediates by mass spectrometry. *Environ. Sci. Technol.* **1999**, *33*, 2638–2644. [CrossRef]
49. Wang, D.; Bolton, J.R.; Andrews, S.A.; Hofmann, R. Formation of disinfection by-products in the ultraviolet/chlorine advanced oxidation process. *Sci. Total Environ.* **2015**, *518–519*, 49–57. [CrossRef]
50. Yang, X.; Sun, J.; Fu, W.; Shang, C.; Li, Y.; Chen, Y.; Gan, W.; Fang, J. PPCP degradation by UV/chlorine treatment and its impact on DBP formation potential in real waters. *Water Res.* **2016**, *98*, 309–318. [CrossRef]
51. Bundesministerium für Justiz und Verbraucherschutz. Verordnung über die Qualität von Wasser für den menschlichen Gebrauch (Trinkwasserverordnung-TrinkwV). 2001. Gesetze im Internet. Available online: [https://www.gesetze-im-internet.de/trinkwv\\_2001/BJNR095910001.html](https://www.gesetze-im-internet.de/trinkwv_2001/BJNR095910001.html) (accessed on 18 November 2020).
52. European Commission. COUNCIL DIRECTIVE 98/83/EC of 3 November 1998 on the quality of water intended for human consumption. 1998. EUR-lex. Available online: <https://eur-lex.europa.eu/legal-content/en/TXT/?uri=CELEX:52017PC0753> (accessed on 18 November 2020).
53. IS 10500. *Drinking Water—Specification*; Indian Standard; Bureau of Indian Standards: New Delhi, India, (Second Revision); 2012; Law-resource; Available online: <https://law.resource.org/pub/in/bis/S06/is.10500.2012.pdf> (accessed on 18 November 2020) Law-resource.
54. *Guidelines for Drinking-Water Quality*, 4th ed; World Health Organization: Geneva, Switzerland, Incorporating 1st Addendum; 2017; Available online: [https://apps.who.int/iris/bitstream/handle/10665/44584/9789241548151\\_eng.pdf;jsessionid=592F2A53BA42E1A3A26CABA04706353E?sequence=1](https://apps.who.int/iris/bitstream/handle/10665/44584/9789241548151_eng.pdf;jsessionid=592F2A53BA42E1A3A26CABA04706353E?sequence=1) ISBN 978-9241549950.
55. Otter, P.; Malakar, P.; Jana, B.; Grischek, T.; Benz, F.; Goldmaier, A.; Feistel, U.; Jana, J.; Lahiri, S.; Alvarez, J. Arsenic removal from groundwater by solar driven inline-electrolytic induced co-precipitation and filtration—A long term field test conducted in West Bengal. *IJERPH* **2017**, *14*, 1167. [CrossRef]

**Publisher’s Note:** MDPI stays neutral with regard to jurisdictional claims in published maps and institutional affiliations.



© 2020 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<http://creativecommons.org/licenses/by/4.0/>).