

MATEC Web of Conferences **37**, 01054 (2015)

DOI: 10.1051/mateconf/20153701054

© Owned by the authors, published by EDP Sciences, 2015

## THEORETICAL RESEARCH OF COAL GASIFICATION PRODUCTS BURNING IN BOILERS AT TOMSK THERMAL POWER PLANT-3

A.A. Somov<sup>1</sup>, D.A. Mel'nikov<sup>1</sup>, D.V. Gvozdjakov<sup>2</sup>, V.E. Gubin<sup>2</sup>, Yu.S. Borovikov<sup>2</sup>, A.S. Matveev<sup>2a</sup>

<sup>1</sup>Open joint stock company «VTI», 115280 Moscow, Russia

<sup>2</sup>National Research Tomsk Polytechnic University, 634050 Tomsk, Russia

**Abstract.** Mathematical modeling of primary fuel change into power gas in power generating boiler with productivity of steam 160 t/h was done. Research of aggregate work on some power modes was completed. Characteristic curves of efficiency coefficient at different loads and ratio on power and natural gases burning were made. Practicability of power gas use as fuel was proved.

### Statement of problem and its solution

In the last few years employees of VTI together with TPU have been developing the first domestic steam and gas installation with intracycle gasification of solid fuel. One peculiarity of steam and gas installation with intracycle gasification of solid fuel simultaneous working is that feeding of gasifier with air is done from gas turbine compressor. The biggest part of blasting air energy turns into power gas compression energy and then into revolution work by means of its combustion products expansion in steam path of gas generator turbine. It should be noted that researches in this sphere have been included into Program of electric power development in Russia till 2020.

Design results of Russian power boiler used at Tomsk thermal power plant-3 with steam productivity 160 t/h at power gas burning are presented in the work.

Mathematical model of boiler was developed with the help of software package Boiler Designer (a product of OPTSIM-K and KED) and its verification on plant design data and process flow test were completed. The main condition of the mathematical model was full equality of heating surface parameters, input into the model, to real construction and geometrical heating surfaces. Correlations were made on all points of boiler where heat carrier flow parameters measurements on gas, air and steam water paths were made. Variable parameters able to change the character of heat exchange in design model and make its adjustment are:

- burning parameter;
- screen heat efficiency coefficient;
- coefficients of use and pollution of separate heating surfaces.

Use of the parameters allows changing surface heat absorption and gas and environment temperatures on entering the following heating surface. Values burning parameter, screen heat

---

<sup>a</sup> Corresponding author : [matveev@tpu.ru](mailto:matveev@tpu.ru)

efficiency coefficient, coefficients of use and pollution of separate heating surfaces and are taken as standard at the first level of design.

Analysis of the received data illustrates a good matching of parameters on both steam water and air gas boiler paths. Small differences were due to the following conditions:

- the difference in design of heat absorption of evaporator platen;
- not correct modeling of crescent within plant design;
- simplified understanding of current environment behavior in overhead heating surface in plant design;
- not correct plant design of furnace irradiation absorption.

The above-described factors, in particular, destined a slightly bigger temperature of overheated steam past boiler (about 2°C) and a slightly less steam productivity of boiler (about 0.7 t/h) at given fuel rate on model data in comparison with plant design results.

The main parameters on paths and design schemes of gas and steam water paths are presented in fig. 1.

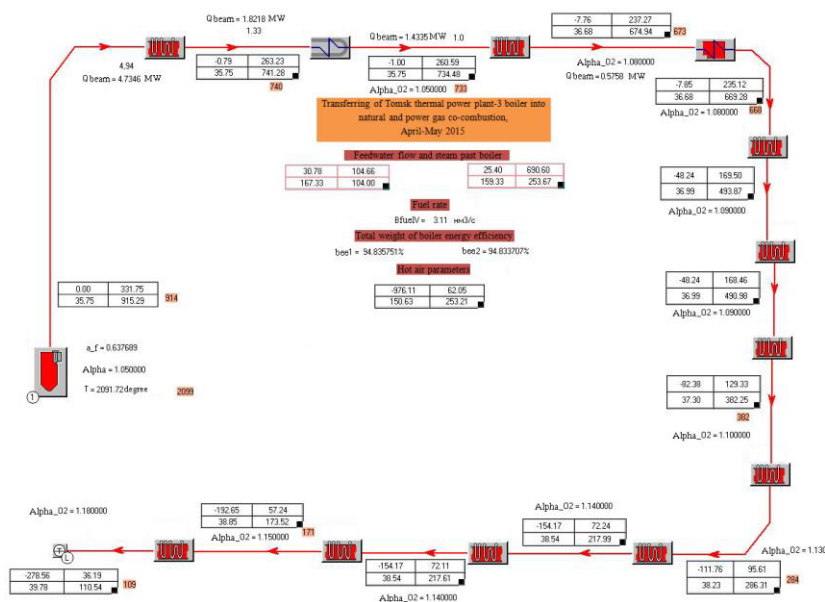


Figure 1. Design scheme of gas path


Research results done at developed and added mathematical model with an option imitating feeding in power gas furnace at 100% and 50% of nominal power are presented in table 1.

Table 1. Research results

Parameter	Power 100%		Power 100%	
	20	100	40	100
Share (on heat) of power gas, %	20	100	40	100
Main steam rate, t/h	153.1	153.2	80.1	80.1
Main steam pressure, kgs/cm2	25.4		18.35	
Main steam temperature, °C	285	287	271	272
Feedwater flow, t/h	154.8	154.9	81.75	82.27
Steam temperature past boiler (after injection), °C	285	287	271	272
Adiabatical burning temperature °C	2016	1841	1917	1800
Furnace exit gas temperature, °C	926	945	681	704
Exit-gas temperature, °C	128	161	105	120
Excess air factor in combustion products past furnace	1.02		1.02	

Parameter	Power 100%		Power 100%	
Excess air factor in combustion products past boiler	1.13		1.13	1.13
Power gas rate, nm <sup>3</sup> /h	5.42	24.36	5.42	12.42
Natural gas rate, nm <sup>3</sup> /m	2.52	0	0.94	0
Total weight of boiler energy efficiency, %	93.73	91.32	94.72	93.46

On the basis of the received data characteristic curves of boiler efficiency coefficient at different loads and ratio on power and natural gas burning was made (fig. 2).

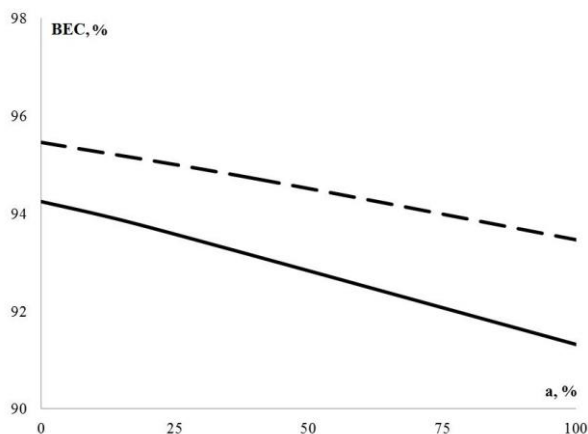

**Figure 2.** Boiler efficiency coefficient from a share of power gas – at 50% (broken line); - 100% (full line) load

The research of power generating boiler at nominal and 50% load at partial and full change of primary fuel into power gas was done. It was stated that design target values maintenance in these ranges is possible and does not need activities on reconstruction of heating surfaces and change of boiler heating scheme. The main expenses from utilization of low calories fuel are connected with vapor formation on hot end of economizer, and a small decrease of boiler efficiency coefficient in technical and economic change. Practicability of power gas use as fuel for change of natural gas can be set at economic design of gasification installation exploitation costs.

*The work has been done in FCAEI HE and open joint stock company 'VTI' in framework of federal focused program implementation "Research and Development on Priority Orientation of Science and Technology Complex Development in Russia 2014–2020", unique identifier 'Applied Research and Experimental Developments' RFMEFI58114X0001.*

## References

1. G.G. Ol'hovskij, SI. Suchkov, P.A. Berezinec, Heat engineering, **2**, 2 (2010)
2. D.D. Sulimov, Heat engineering, **2**, 27 (2010).
3. Technical report on the operational tests and commissioning of steam boiler equipment such as E-160-2.4-250 BT Art. №4, Tomsk 5 GEC-3 Ghazawi fuel on 30.08.2012