

# **Assessment of energy and economic effectiveness of photovoltaic systems operating in a dense urban contest**

Maurizio Cellura  
Dipartimento dell'Energia  
University of Palermo, Palermo, Italy  
e-mail: mcellura@dream.unipa.it

Alessandra Di Gangi\*  
Dipartimento dell'Energia  
University of Palermo, Palermo, Italy  
e-mail: alessandradigangi@dream.unipa.it

Aldo Orioli  
Dipartimento dell'Energia  
University of Palermo, Palermo, Italy  
e-mail: oriole@dream.unipa.it

## **ABSTRACT**

A methodology that permits to test the level of integration of the photovoltaic technology in urban areas is presented. The percentage of coverage of the electricity demand and the economic feasibility of grid-connected photovoltaic systems installed on the roofs of buildings were investigated in a district of the city of Palermo (Sicily). After classifying roofs according to their shape, orientation and pitch by means of satellite images provided by Google Earth™, the ratio of the productivity of the PV systems and the consumption of electricity of the households was analysed considering all economic aspects. As a result, it can be always identified the number of floors in correspondence of which the size of the PV system that may be installed, and the consequent production of electricity, does not recover the costs for installation and maintenance of the system.

## **INTRODUCTION**

The European Union (EU) set a series of climate and energy targets to be met by 2020, known as the "20-20-20" targets. With the Directive 2009/28/EC, the EU stated for each Member State the national overall target for the share of energy from renewable sources. For Italy the share of energy from renewable sources in gross final consumption of energy in 2020 would be at least 17%. To achieve the latter target the solar energy could play the main role in urban contests.

The problem involves different aspects that do not only concern the energy performances but also economic effects. It means that, according to the actual generation of electricity, the PV systems have to be a feasible economic investment. To attain and test these results it is basic to consider the size of the studied system. . Actually, when they refer to a specific PV system analysed such as one-family detached house, every single aspect of the problem can be considered (panels, inverters, orientation, pitch, obstructions, economic analysis) but the data

---

\* Corresponding author

of predictions cannot be used to extrapolate the results of the analysis to a whole city or region [1], [2], [3]. On the other hand, when the purpose of the study is analysing the energy potential of a nation, or even a continent, it is impossible to consider all details of the problem [4], [5], [6], [7]. The potential of solar electricity generation was assessed for areas whose surface varied from an apartment [8] to a whole city [9] or a continent [10]. To evaluate the roof collecting surfaces, Vardimon [11] considered that, for slanted roofs, 18-24% of the area was available, while flat roofs had an availability ratio of 50-70%. Ordóñez et Al. [12] estimated availability ratios of 79-98% for pitched roofs and of 65-80% for flat roofs, depending on the typology.

Many researchers have investigated the effectiveness of supporting measures for the production of electricity by PV systems. Papadopoulos et A. [13] discussed a quantitative assessment of the feed-in tariff (FIT) introduced in Greece. Campoccia et Al. [14] compared the supporting measures adopted by France, Germany, Italy and Spain. Dusonchet et Al. [15], [16] extended the comparison to 17 western and 10 eastern European Union countries.

## THE METHODOLOGY

The proposed methodology considers many aspects of the problem including the energy and economic ones. Actually, even if it is important to evaluate the energy cover factor of a PV system, could happen that the PV system does not harvest economic advantage from the operational phase. The joined analysis of energy and economic aspects is of basic importance for evaluating real outcomes of investments. To reach this result the proposed methodology follows the following steps:

- Architectonic aspects:
  - identification of buildings roof surfaces (flat and slanted);
  - estimation of number of floors for each building;
  - shape classification of roofs.
- Energy aspects:
  - estimation of the electricity produced by the PV systems as regards to each floor;
  - estimation of the electricity consumed by the homeowners;
  - estimation of the energy cover factor.
- Economic aspects
  - evaluation of costs of the PV systems (investment costs and costs for maintenance, servicing and insurance against damage) and benefits due to the gains for the avoided bill costs, the incentives and the sold electricity;
  - analysis of cash flows;
  - evaluation of the economically effective and ineffective roofs;
  - estimation of the energy cover factor related to the results of the economic analysis;
  - sensitivity analysis for the most significant physical and economic parameters.

## THE STUDY-ZONE

The methodology has been applied to the city of Palermo (Sicily) (Fig.1) and in particular to a district characterized by regular square layout of streets, well ordered orientation of buildings (117° East of South and 153° West of South) (Fig.2), and almost constant pitch of slanted roofs (about 25° above the horizontal).

### Architectonic aspects

Identification of buildings roof surfaces The maps of Google Earth™ were used to identify and measure the roofs of the analysed district (Figs.1-2).



Figure 1. The city of Palermo

The district area occupied by buildings measures 109,207 m<sup>2</sup> (Fig.3), i.e. 40% of the whole district's surface and it is subdivided into the following parts:

- slanted roofs : 60,145 m<sup>2</sup> (55.07 %)
- flat roofs : 37,902 m<sup>2</sup> (34.71 %)
- terraces : 11,017 m<sup>2</sup> (10.09 %)
- others : 143 m<sup>2</sup> (0.13 %)



Figure 2. The analysed district

*Estimation of number of floors of each building* The amount of roof surface that is available for any co-owner of the building to install a PV system derives from the number of floors of building. The figure 3 was determined by using the Street View function (technology featured in Google Maps™ and Google Earth™ that provides panoramic views from various positions along many streets in the world).

Most of roofs areas cover buildings of four floors. Moreover most of the slanted roofs belong to buildings of four floors whereas most of the flat roofs cover buildings with eight floors. This distribution disagreement is due to the different ages of buildings, and consequently to the different technologies used to build them.

The slanted roofs typically cover old stone buildings traditionally made with massive walls, with a thickness varying from 30 to 60 cm. In these buildings, which were built before Second World War without using reinforced concrete frame, for structural stability, two opposite thick walls cannot be more distant than about 4.5 metres; besides, because each room has at least a window, each building has a standard depth of about 9 metres. Buildings contain residential apartments that are regularly made with an entrance hall, a corridor, 5-6 rooms, a kitchen and bathrooms; for each apartment can be estimated a gross surface of about 150-170 m<sup>2</sup>.

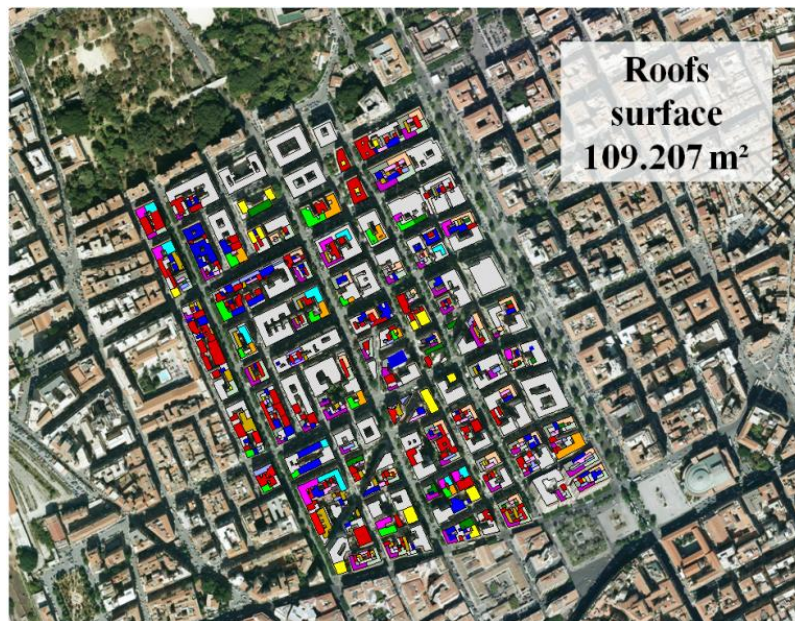


Figure 3. The area of district occupied by buildings

*Classification of slanted roofs* With the aim of classifying the roofs in the district it was necessary to study the disposition of the urban context. The roof of many buildings looks like a complex composition of different elementary roof shapes such as gable, hip and skillion. Some buildings have roofs orthogonally joined; besides, the roofs have different orientations. In order to classify the slanted roofs, the 16 types of shapes reported in Table 1 have been identified. The roof of each building was subdivided in parts similar to the roof types of Table 1; all parts were catalogued by assigning the corresponding roof type, the surface area and the

identification code of the building. The prevalent roof shapes are the simple gable roofs (T1: 14% - T2: 21%).

Table 1. Classification of roof shapes

T1 (8162 m <sup>2</sup> )	T2 (12901 m <sup>2</sup> )	T3 (2690 m <sup>2</sup> )	T4 (2031 m <sup>2</sup> )
T5 (2144 m <sup>2</sup> )	T6 (2219 m <sup>2</sup> )	T7 (1582 m <sup>2</sup> )	T8 (2880 m <sup>2</sup> )
T9 (2296 m <sup>2</sup> )	T10 (1683 m <sup>2</sup> )	T11 (3298 m <sup>2</sup> )	T12 (2906 m <sup>2</sup> )
T13 (3787 m <sup>2</sup> )	T14 (3765 m <sup>2</sup> )	T15 (3618 m <sup>2</sup> )	T16 (4183 m <sup>2</sup> )

*Classification of flat roofs* To classify flat roofs, which have different characteristics in comparison with the slanted roofs, a different criterion was used. Five classes containing almost the same number of buildings were identified. Once evaluated the area mean value for each class, five regularly shaped buildings, with a roof area near to the class mean values were selected to represent the five groups of buildings.

Table 2. Classification of flat roofs

FR1 265 m <sup>2</sup>	FR2 387 m <sup>2</sup>	FR3 482 m <sup>2</sup>	FR4 717 m <sup>2</sup>	FR5 1394 m <sup>2</sup>

As it is shown in Fig. 4, most of the slanted roofs belong to buildings of four floors whereas most of the flat roofs cover buildings with eight floors



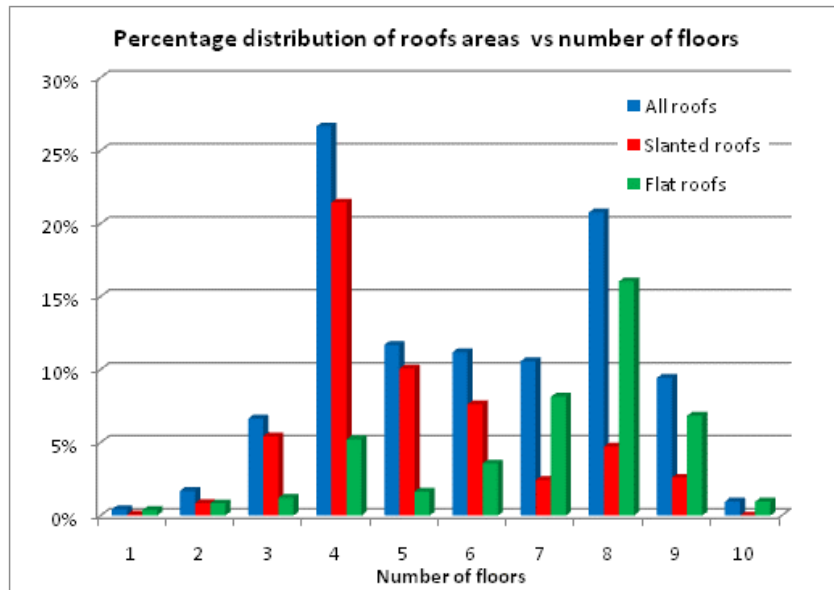


Figure 4. Distribution of roof areas versus number of floors.

### Energy aspects

Estimation of the electricity produced by the PV systems in slanted roofs as regards to each floor The electricity generation produced by PV systems of each floor was calculated using the software PVsyst 5.06 [17] which includes monthly data of the global irradiation, temperatures and wind velocity (Meteonorm, versions 4-5).

It was assumed that:

- each type of roof in Table 1 had a standard surface of 162 m<sup>2</sup> and a fixed dimension (width or length) of 9 metres;
- the commercial PV panel used (Kyocera KD210GH-2P) had dimensions 1.50 x 0.99 metres;
- PV panels were considered to be collocated with the same pitch of the roof surface.

In Tables 3 some results of the energy estimation are resumed.

Tab.3. Electricity produced by slanted roofs

number of floors	Total roofs area (m <sup>2</sup> )	Electricity produced (KWh)
1	64	5,266.96
2	934	41,300.53
3	5,923	149,476.55
4	23,316	512,594.78
5	10,947	163,643.40
6	8,320	784,56.53
7	2,658	224,70.96
8	5,158	44,347.64
9	2,825	10,223.05
Total	60,145	1,027,780.40

Estimation of the electricity produced by the PV systems in flat roofs as regards to each floor

The electricity produced by flat roofs was estimated considering:

- the panels oriented to the South with a pitch of 30°, which is considered the most efficient for the city of Palermo;
- the shadowing effect due to balustrades, elevator housings and other obstructions.

To compare the flat roofs to the slanted roofs, the PV field sized for the roof area of each selected representative buildings were resized to occupy the area of the standard apartment (162 m<sup>2</sup>). The results are shown in Table 4.

Tab.4. Electricity produced by flat roofs

number of floors	Total roofs area (m <sup>2</sup> )	Electricity produced (KWh)
1	0	0.00
2	0	0.00
3	0	0.00
4	2,319	43,090.88
5	320	3,014.04
6	3,581	45,646.84
7	8,011	89,973.85
8	15,911	165,323.55
9	6,718	55,099.39
10	1,042	7,572.44
Total	37,902	409,721.00

Estimation of the electricity consumed by the homeowners The electricity consumption of a household was derived by the information officially issued by TERNA [18], which is the major Italian electricity transmission grid operator, and the ISTAT - Italian National Institute of Statistics [19] (Table 5):

Table 5. Energy and statistic figures for Palermo

Electricity consumption in Palermo's province	1475,80 GWh/year
Area of inhabited apartments in Palermo	22,141,320 m <sup>2</sup>
Number of inhabitants in Palermo's province	1,244,680
Number of inhabitants in Palermo	686,711

On the basis of the above figures, in the standard apartment of 162 m<sup>2</sup> was calculated that a household of 5.02 people would live and averagely would consume **5957.3 kWh** of electricity every year.

Estimation of the energy cover factor A criterion to establish the level of integration of PV systems is the evaluation of the PV energy potential by comparing the electricity generated and the energy demands by means of the energy cover factor  $C_{PV}$  [20]:

$$C_{PV} = \frac{E_{PV}}{D_{Total}} \cdot 100 \quad (1)$$

in which  $E_{PV}$  represents the electricity produced by the PV system and  $D_{Total}$  is the electrical energy demand. Taking account of the available areas and the number of floors, the actual PV energy potential of all roofs of the district was computed. As it is shown in Fig.5, both slanted and flat roofs buildings seem to be adequate to produce enough electricity to meet the "20-20-20" targets. PV systems cover 35.8% of the district electricity demand; the energy production is mainly due to the sloped roofs covering buildings of four floors.

The results shown in Fig.5 are too optimistic because no shading and technical malfunctioning or unforeseeable solar energy unavailability were considered. Moreover, it may exist a problem related to the mismatch that happens when there is not an instantaneous generation and consumption of electricity. To describe opportunely the matter, we have to examine two conditions:

- 1) the PV system is undersized to cover the energy demands  $D_{Total}$  and consequently the electricity generated  $E_{PV}$  is less than the demand;
- 2) the PV system is not undersized but the generation does not fully covers the energy demand  $D_{Total}$  for lack of contemporaneousness.

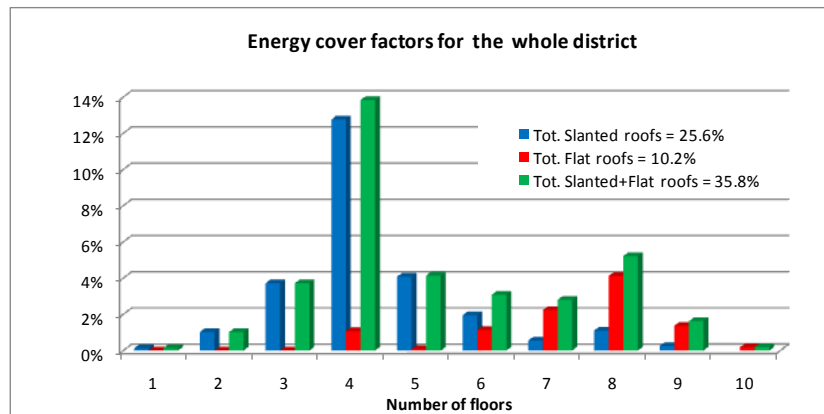


Figure 5. Yearly energy cover factors for the whole district, versus the number of floors.

First of all, both of conditions have been analysed by computing the night energy demand  $D_{night}$  which is always covered by the grid. It was assumed that the following users were working in the standard apartment [21], [22], [23], [24] during the night:

- Lamp 85 W from  $T_i$  to 23:00 – from 07.00 to  $T_f$
- Refrigerator : 90 W from  $T_i$  to 24:00 – from 00.00 to  $T_f$
- Television + P.C. : 75 W from  $T_i$  to 23:00 – from 07.00 to  $T_f$
- 

where  $T_i$  was assumed one hour before sunset time and  $T_f$  one hour after dawn time. It was calculated  $D_{night} = 716.5$  kWh/year and consequently the day energy demand  $D_{day} = 5240.8$  kWh/year.

When a significant amount of electricity is generated by a great number of PV systems the surplus of produced energy can be a complex problem for the public grid managers. The surplus also represents an economic disadvantage for the self-producers because the purchase



price is generally higher than the selling price. Moreover, as it will be shown by the economic assessment, the disadvantage related to the difference between purchase and selling prices is a reason why the households may decide do not install PV systems on their roofs.

### **Economic aspects**

When the aim of an investment is to install PV systems on building roofs, the main problem is to define a criterion that permits to assess the actual feasibility of the project. The benefits are related to the gain for the avoided bill cost, for incentives and for selling electricity. The disbursements are due to the costs for investments, system devices replacement, maintenance and management, and insurance.

The electricity bills were calculated considering the difference between the bills corresponding to the electricity demand  $D_{Total}$  and those referred to the difference between  $D_{Total}$  and  $E_{cons}$ , which is the energy consumed while the PV systems are producing electricity. The electricity tariffs issued by the AEEG - Italian Authority for electricity and gas for domestic consumers with an electricity capacity of 3 kW were used. For the incentives, the values of FIT given by the decree issued in 2011 by the Ministry for the Economic Development were assumed. For the first four-month period of 2011 incentives varying from 0.402 to 0.333 €/kWh are paid, depending on the rated power of the PV system. For the gain in selling electricity, which was calculated on the basis of the exported PV generation  $E_{PV} - E_{cons}$ , a mean selling price of 0.102 €/kWh was used. The net gain in selling the exported PV electricity was calculated charging an income tax of 30.22 %, which was estimated on the basis of the average income of the inhabitants of Palermo.

The costs of the investment were obtained from the market prices of components, considering the cost for labour and fitter's gain.

All above factors are connected to the cash flows that permit to assess the effectiveness of installing PV systems on building through the evaluation of the net present value (NPR), the internal rate of return (IRR) and the pay-back periods. The cash flows were calculated for 20 years, which is the time when incentives are provided in Italy. The economic analysis was performed by considering:

- the decreasing of the efficiency of the PV panels every year of 1% of the nominal initial value;
- the maintenance and management costs, estimated to be 2% of the investment cost every year;
- the replacement of 1 % of the PV panels every year and of all inverters every five years;
- the yearly increasing of 5.2 % in the price of electricity;
- the effect of inflation, assumed equal to 2.1 %, as deduced by the data issued by the ISTAT;
- the current value of 4.36 % of the weighted average cost of capital.

### **RESULTS**

In order to evaluate the actual values of the energy cover factor  $C_{PV}$  of the district, the results obtained from the energy assessment were filtered by using the results of the economic analysis. For this reason only the PV electricity generated by PV systems, whose installation had resulted economically convenient, was considered useful to cover the demand of the district.

Fig.6 shows the yearly energy cover factors filtered to take account of the economic assessment; the shading coefficient was set equal to zero. The comparison with Fig.5 shows the significant reduction of the energy cover factors due to the assessment of the economic

convenience of PV installations; the energy cover factor of the district lowers from 35.8 % to 24.1 %, with a percentage decrement of 32.7 %. The PV systems installed on modern buildings with flat roofs cover only 3.4 % of the district demand; they passed from 28.5 % of the global PV production to only 14.1 %. About 50% of the global PV electricity is generated by the PV systems installed on the slanted roofs of buildings with four floors. Because the contribution of the building with a number of floors greater than five is only 3 %, one may think that the PV systems on those buildings are not worth installing.

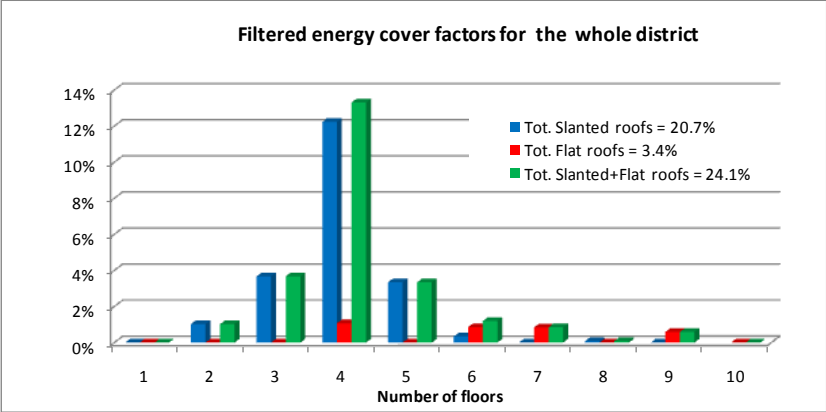


Figure 6. Yearly energy cover factors for the whole district, filtered by the economic assessment, versus the number of floors.

As it is shown in Fig.7, the reduction of the energy cover factors is even severer if the effects of shading are considered.

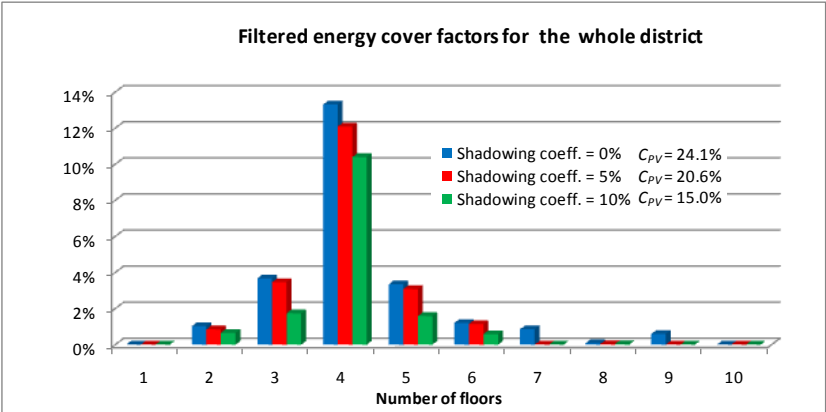


Figure 7. Yearly energy cover factors for the whole district, filtered by the economic assessment, at various values of the shading coefficient versus the number of floors.

Although the shadowing coefficient produces a reduction of the generated PV electricity that is directly proportional to its value, the effect on the cover factor is quite not proportional. With a reduction of 5 % in the electricity generated by the PV systems, the cover factor of the district changes from 24.1 % to 20.6 %, which is a reduction of 14.5 %. The reduction is even greater with higher values of the shading coefficient; a reduction of 10 % of the electrical

generation due to the shadowing causes a decrement of 37.8 in the energy cover factor of the district.

## CONCLUSION

The evaluation of the real energy and economic effectiveness of the PV systems for reaching ambitious targets of the European Union in the energy field is of paramount importance for addressing decision makers towards different options of financial supports. In the meantime scientists have developed much experience in the above field but still now it misses a simple methodology for assessing the effectiveness of the PV systems in urban contexts, where the complexity of the problem has to cope with the need to simulate PV systems in reliable, fast and effective ways. The shown methodology has the above requested features and permits to test the level of integration of the photovoltaic technology in urban areas. The methodology was applied in a district of the city of Palermo (Italy) and the percentage of coverage of the electricity demand and the economic feasibility of grid-connected photovoltaic systems installed on the roofs of buildings were investigated. The obtained results showed the difficult to size in a proper and effective way the PV systems in big urban contexts, and point out the suitability of the tool for energy planning of the above systems. Considering energy and economic parameters the cover factor varies 35.8 % to 24.1 %. The possibility to identify situations where the economic feasibility of investments is not convenient is an important feature of the method that can help decision makers to select effective alternatives in energy planning procedures.

## NOMENCLATURE

$C_{PV}$	Energy cover factor [%]
$E_{PV}$	Electricity produced by PV system [kWh]
$D_{Total}$	Electrical energy demand [kWh]
$D_{dayl}$	Day energy demand [kWh]
$D_{night}$	Night energy demand [kWh]

## REFERENCES

- [1] Celik A. N., 2006. Present status of photovoltaic energy in Turkey and life cycle techno-economic analysis of a grid-connected photovoltaic-house. *Renewable and Sustainable Energy Reviews* 10, 370–387.
- [2] Muñoz F.J., Echbarthi I., Nofuentes G., Fuentes M., Aguilera J., 2009. Estimation of the potential array output charge in the performance analysis of stand-alone photovoltaic systems without MPPT (Case study: Mediterranean climate). *Solar Energy* 83, 1985–1997.
- [3] Mavromatakis F., Makrides G., Georghiou G., Pothrakis A., Franghiadakis Y., Drakakis E., Koudoumas E., 2010. Modeling the photovoltaic potential of a site. *Renewable Energy* 35, 1387–1390.
- [4] Mardaljevic J., Rylatt M., 2003. Irradiation mapping of complex urban environments: an image-based approach. *Energy and Buildings* 35, 27–35.
- [5] Compagnon R., 2004. Solar and daylight availability in the urban fabric. *Energy and Buildings* 36, 321–328.
- [6] Robinson D., Stone A., 2004. Solar radiation modelling in the urban context. *Solar Energy* 77, 295–309.

- [7] Robinson D., 2006. Urban morphology and indicators of radiation availability. *Solar Energy* 80, 1643-1648.
- [8] Al-Salaymeh A., Al-Hamamre Z., Sharaf F., Abdelkader M.R., 2010. Technical and economical assessment of the utilization of photovoltaic systems in residential buildings: The case of Jordan. *Energy Conversion and Management* 51, 1719–1726.
- [9] Hofierka J., Kaňuk J., 2009. Assessment of photovoltaic potential in urban areas using open-source solar radiation tools. *Renewable Energy* 34, 2206–2214.
- [10] Šúri M., Huld T.A., Dunlop E.D., Ossenbrink H.A., 2007. Potential of solar electricity generation in the European Union member states and candidate countries. *Solar Energy* 81, 1295–1305.
- [11] Vardimon R., 2011. Assessment of the potential for distributed photovoltaic electricity production in Israel. *Renewable Energy* 36, 591-594.
- [12] Ordóñez J., Jadraque E., Alegre J., Martínez G., 2010. Analysis of the photovoltaic solar energy capacity of residential rooftops in Andalusia (Spain). *Renewable and Sustainable Energy Reviews* 14, 2122–2130.
- [13] Papadopoulos A.M., Karteris M.M., 2009. An assessment of the Greek incentives scheme for photovoltaics. *Energy Policy* 37, 1945–1952.
- [14] Campoccia A., Dusonchet L., Telaretti E., Zizzo G., 2009. Comparative analysis of different supporting measures for the production of electrical energy by solar PV and Wind systems: Four representative European cases. *Solar Energy* 83, 287–297.
- [15] Dusonchet L., Telaretti E., 2010. Economic analysis of different supporting policies for the production of electrical energy by solar photovoltaics in western European Union countries. *Energy Policy* 38, 3297–3308.
- [16] Dusonchet L., Telaretti E., 2010. Economic analysis of different supporting policies for the production of electrical energy by solar photovoltaics in eastern European Union countries. *Energy Policy* 38, 4011–4020.
- [17] PVsyst, Software for photovoltaic systems, University of Geneva ISE - Group Energy, FOREL Battelle, bât. D7, route de Drize CH-1227 Carouge Switzerland
- [18] “Dati Statistici sull'energia elettrica in Italia”, Terna S.p.A., [www.terna.it/default/Home/SISTEMA\\_ELETTRICO/statistiche/dati\\_statistici.aspx](http://www.terna.it/default/Home/SISTEMA_ELETTRICO/statistiche/dati_statistici.aspx)
- [19] “Dati statistici ISTAT: Popolazione residente - Censimento 2001 - Superficie delle abitazioni occupate da persone residenti”, ISTAT, Italian National Institute of Statistics, [dawinci.istat.it/MD/dawinciMD.jsp](http://dawinci.istat.it/MD/dawinciMD.jsp)
- [20] B. Verbruggen, R. De Coninck, R. Baetens, D. Saelens, L. Helsen, J. Driesen, “Grid impact indicators for active building simulation”, IEEE PES Innovation Smart Technologies Conference, Anaheim, USA, 17-19 January 2011.
- [21] Project EURECO “Demand-Side Management, End-use metering campaign in 400 households of the European Community, Assessment of the potential electricity savings”, (2002).
- [22] eERG, end-use Efficiency Research Group, Politecnico di Milano, MICENE “ Misure dei consumi di energia elettrica in 110 abitazioni italiane, curve di carico dei principali elettrodomestici e gli apparecchi di illuminazione, (2004).
- [22] IES, Institute for Environment and sustainability – JRC, Joint Research Centre - European Commission, “Electricity consumption and efficiency trends in the enlarged European Union”, Status Report (2006).
- [24] IEA, International Energy Agency, “Final report of Annex 42 – Energy conservation in buildings and community system programme”, (2008).