

# Economic and environmental assessment of small and decentralized wastewater treatment systems

R. Nogueira<sup>1</sup>, A. G. Brito<sup>1</sup>, A. P. Machado<sup>1</sup>, J.J. Salas<sup>2</sup>, L. Vera<sup>3</sup>, G. Martel<sup>3</sup>

1. IBB-Institute for Biotechnology and Bioengineering, Centre of Biological Engineering, University of Minho, Campus de Gualtar, 4705-057 Braga, Portugal. Emails: regina@deb.uminho.pt, agbrito@deb.uminho.pt

2. Department of Applied Research, New Water Technologies Centre (CENTA). Avda. Américo Vespuccio 5-A, 2<sup>a</sup>. Módulo 10. 41092. Seville, Spain. jjsalas@centa.org.es

3. Water Department – Instituto Tecnológico de Canarias (ITC). Playa de Pozo Izquierdo, s/n, 35119 Santa Lucía. Las Palmas. Spain. gmartel@itccanarias.org, lvera@itccanarias.org

## Abstract

The aim of the present work was the assessment of economic and environmental aspects of decentralised energy-saving wastewater treatment systems. The formulated investment and operation cost functions were adjusted by a power law function. The different wastewater systems serving population settlements between 50 p.e. and 250 p.e., presented associated investment costs varying from 400 €/p.e. to 200 €/p.e. and annual operation costs in the range of 70 €/p.e. to 20 €/p.e., respectively. A Life Cycle Analysis approach was used to compare the environmental impact alternative wastewater systems. The assessment was focused on two energy-saving systems (constructed wetland and slow rate infiltration) and a conventional one (activated sludge process). The low environmental impact of the energy-saving wastewater treatment systems was demonstrated, being the most relevant the global warming indicator. Options for reduction of life cycle impacts were assessed including materials used in construction and operation lifetime of the systems. A 10 % extension of operation lifetime of constructed wetland and slow rate infiltration systems lead to a 5 % and 7 % decrease in the abiotic depletion indicator, respectively, and to a 1 % decrease in CO<sub>2</sub> emissions in both systems. Replacing steel with HDPE in the activated sludge tank resulted in a 1 % reduction in CO<sub>2</sub> emission and 1 % in the abiotic depletion indicator. In the case of the Imhoff tank a 1 % reduction in CO<sub>2</sub> emissions and 5 % in abiotic depletion indicator were observed when concrete was replaced by HDPE. Therefore, considering the huge potential of energy saving wastewater treatment systems, the overall environmental impact of such design alternatives should not be discarded.

**Keywords:** wastewater treatment, slow rate infiltration, constructed wetland, cost function, life cycle assessment.

## INTRODUCTION

Eco-efficiency is characterized by a continuous effort towards the improvement of economical and environmental values and a long-term need for sustainability. Therefore, the goals for wastewater treatment systems are moving beyond the protection of human health and aquatic ecosystems to include minimizing loss of scarce resources, reducing the use of energy and water, reducing waste generation and enabling the recycling of nutrients (Lundin *et al.*, 2000). The directive 91/271/CE of the Council from May 1991 and the subsequent initiatives concerning municipal wastewater treatment are important guidelines for water resources protection in the European Union. Currently, most of the large scale problems are being solved or addressed and the challenge concerns wastewater treatment of communities located in rural areas. Under these conditions, it is hardly feasible, from an economical point of view, to build sewer systems and centralized wastewater treatment plants. Therefore, it is a priority the implementation of decentralised solutions and a pertinent question arises then concerning the selection of the most appropriate design. Two technological options are available for such purpose, the so-called natural or energy-saving wastewater treatment systems and the intensive treatment systems.

The energy-saving technologies are those that simulate the conditions of natural wetlands (e.g. constructed wetlands), the processes which occur in rivers and lakes (e.g. artificial lagoons) and the soil ecosystem (e.g. slow rate infiltration) (García *et al.*, 2006). Therefore, such wastewater treatments systems show different performances, result in different impacts on the environment and have different associated costs. Cost functions are essential to produce estimations based on a reduced number of variables, easily identifiable and quantifiable. Based on investment and operation costs, such tool should enable a first pre-selection among the existing wastewater treatment solutions. The Life Cycle Assessment methodology has been used to explore the sustainability of wastewater systems, allowing a comparison of different technical solutions in terms of the estimated environmental loads (Dennison *et al.*, 1999; Dixon *et al.*, 2003). The wastewater treatment in rural areas requires decentralized systems and different options and technologies are available for such purpose.

The aim of the present work was the assessment of economic and environmental aspects of decentralised energy-saving wastewater treatment processes. The specific objectives were: (i) to develop cost functions focused on energy-saving systems and (ii) to compare alternative wastewater treatment systems for small and decentralized rural communities. The work was carried out within the frame of DEPURANAT – Sustainable wastewater management in rural areas, an EU project co-financed by Interreg IIB Atlantic Arc Program.

## METHODS

The methodology applied in the present work contemplated several phases as depicted in Figure 1.

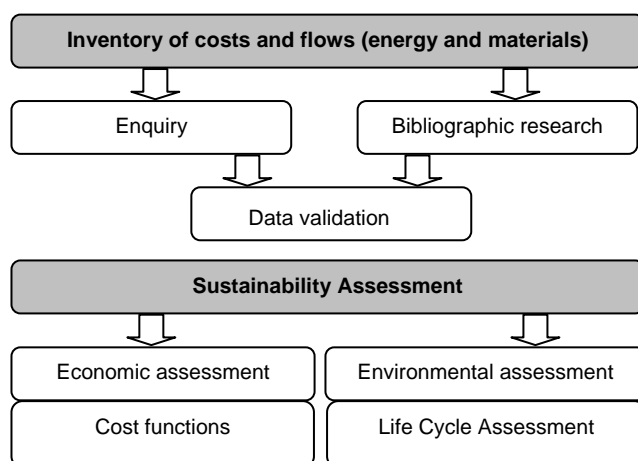


Figure 1 General methodology.

The layout of the twelve energy-saving wastewater treatment systems, constructed or upgraded under DEPURANAT project, included a pre-treatment for suspended solids removal (bar screening), an anaerobic biological process provided by a septic tank or an Imhoff tank, and a secondary treatment for wastewater polishing. The secondary treatment is carried out by different options, as follows: vertical- and horizontal-flow constructed wetland, free-water-surface constructed wetland, combination series/parallel of constructed wetlands, and slow rate infiltration. More detailed information about the systems is described in Nogueira *et al.* (2007). The formulation of cost functions of energy-saving wastewater treatment systems consisted in the assessment of the relationship between the dependent variables Y1 (Y1 = investment cost/served population) and Y2 (Y2 = annual operation cost/served population) and the independent variable X (X = served population) by regression analysis with a level of significance of 5 % using the statistical software tool SPSS version 14.0 (Nogueira *et al.*, 2007).

Life Cycle Assessment (LCA) is a quantitative methodology that evaluates the effects that a system has on the environment over the entire period of its life cycle. The LCA study carried out in the present work and described in detail elsewhere (Machado *et al.*, 2007) comprised an inventory analyses and an impact

assessment of resources and emissions associated with the treatment systems. The systems function according to the legal standards stated by the Portuguese authorities for discharge in surface waters (40 mg/L as BOD, 150 mg/L as COD, 15 mg/L of ammonium, and 10 mg/L of phosphorous), the functional unit was one population equivalent (p.e.) and the period of comparison was set at 10 years.

Three wastewater treatment plants were included in the scope of the present LCA study:

- a slow rate infiltration plant serves a population equivalent of 40 p.e. in winter and 120 p.e. in summer and processes a flow rate of 5 m<sup>3</sup>/d in winter and 15 m<sup>3</sup>/d in summer. The system occupies an area of 2000 m<sup>2</sup> and the biomass is *Populus euroamericana* (40) and *Eucalptos camaldulensis* (214). The irrigation is provided by a PE piping system. The biomass is harvested each 5 years and the wood shredded in order to be used to produce pulp,
- a constructed wetland plant serves a population equivalent of 120 p.e. and processes a flow rate of 15 m<sup>3</sup>/d. The plant comprises a vertical flow, 317 m<sup>2</sup>, and a horizontal flow, 277 m<sup>2</sup>, constructed wetlands in series both with *Phragmites australis*. An Imhoff tank is used as pre-treatment. The following materials are used: i) geotextile lining, ii) gravel (support), iii) PE, PP and PVC (piping), and iv) concrete and PVC (Imhoff tank). The biomass requires annual culling and the green waste is sent to a landfill. The sludge accumulated in the Imhoff tank is removed every 10 years and is used as soil amendment.
- an activated sludge plant is of the extended aeration type. It serves a population equivalent of 500 p.e. and processes a flow rate of 60 m<sup>3</sup>/d. The activated sludge tank was constructed in inox steel AISI 306 and has two surface aerators, functioning each 11 h/d. The sludge is purged from the settling area and is used as soil amendment.

## RESULTS AND DISCUSSION

One focus of the present study was on the economics of energy-saving systems used for wastewater treatment in rural areas with communities up to 250 p.e. The investment and annual operation costs depicted in Figure 2 and Figure 3, respectively, present a decreasing tendency with the increase of the served population. The wastewater treatment systems serving communities between 50 p.e. and 250 p.e. present associated investment costs varying from 400 €/p.e. to 200 €/p.e. and annual operation costs varying from 70 €/p.e. to 20 €/p.e.

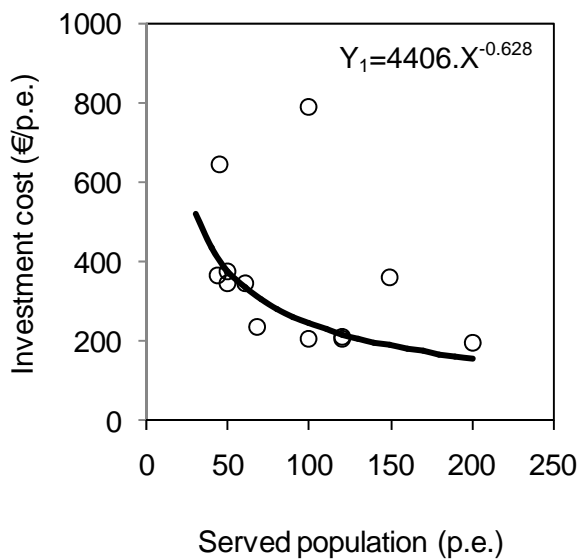


Figure 2. Investment cost as a function of served population.

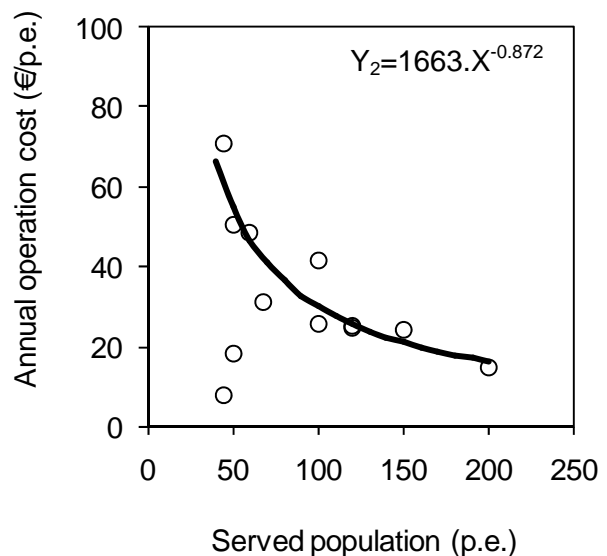


Figure 3. Annual operation cost as a function of served population.

Though the current study is focused on energy-saving wastewater treatment technologies, it is adequate to establish a comparison with the intensive technologies. Studies performed in Spain and France show that the investment costs of energy-saving systems are, in general, lower than those of intensive systems (Boutin *et al.*, 1998). The exploitation of energy-saving systems is, certainly, less expensive than the operation of intensive systems, in particular concerning the energy costs but, also, the sludge processing costs. The development of cost functions is crucial in pre-design studies as it allows the preparation of simplified budgets based on a reduced number of variables which are easily identifiable and quantifiable. Cost functions of investment and operation were both modelled using the power law because a higher  $R^2$  value was obtained in comparison with the  $R^2$  values obtained with other mathematical functions (Figures 2 and 3).

Another focus of the present study was to evaluate the environmental aspects of decentralised energy-saving wastewater treatment systems. Firstly an inventory analysis of resources and emissions of the different wastewater treatment systems was carried out. Afterwards, all emissions were sorted into impact categories according to their environmental effects. Finally, emissions within each impact category were aggregated using characterization factors that compared the effect of a specific emission with that of a reference emission (PRÉ Consultants, 2006). The characterization method was the CML 2 BASELINE 2000 because it is one of the few that considers nutrients (phosphorous and nitrogen) and organic matter as emissions. Figure 4 presents the inventory results per impact category expressed in relation to a functional unit of 1 p.e.

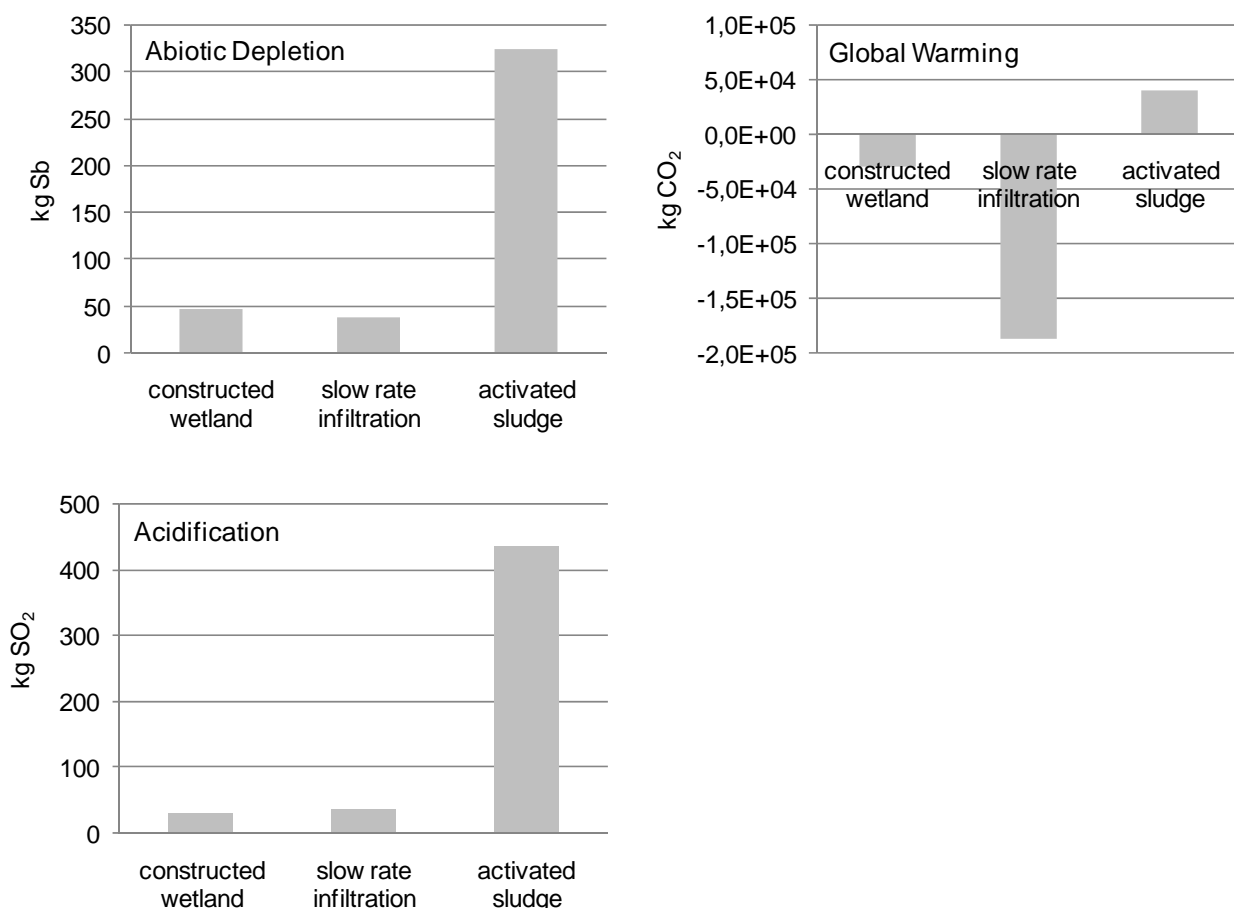


Figure 4 - Inventory results per impact category, expressed in relation to a functional unit of 1 p.e.

In the present study the materials used in higher amounts for plant construction were concrete (e.g., Imhoff tank), plastics (piping in all treatment systems and the geotextile membrane in the lining of the constructed wetland), and steel (activated sludge tank). All such items contributed to the impact category *abiotic*

*depletion* because they use raw materials in its production and to the impact category *global warming* since energy consumption is used in the production process. The activated sludge system presents the highest impact in both categories.

The energy usage of constructed wetland and slow rate infiltration systems is similar because both systems require a very low input. On the contrary, the activated sludge has much higher energy requirements because of the aeration equipment (22 h/d operation). These results agree with those reported by Dixon *et al.* (2003). Energy usage (fossil fuel and electricity) is the main contributor to the impact categories *abiotic depletion* and *global warming* which justifies the fact that activated sludge presents a higher impact in both categories.

The CO<sub>2</sub> emissions are directly related to the energy consumption. Again, the activated sludge system presents the highest environmental burden in the *global warming* category, when compared to the other systems, due to the high energy input for aeration. The constructed wetland and in particular the slow rate infiltration have significantly lower overall CO<sub>2</sub> emissions, due to the fact that biomass acts as a carbon sink, locking away atmospheric carbon.

The main sources of solid emission resulted from the land excavated during construction and from the surplus sludge production during system operation. Dixon *et al.* (2003) reported that the environmental impact of soil removal can be reduced by their reuse in the infill during the dismantling phase. Sludge spreading on soil was the procedure applied by Lundin *et al.* (2000) in order to reduce environmental impact of sludge disposal. Such a procedure can only be considered in non sensitive areas and might be questionable when large quantities are disposed off. The reuse of sludge is translated into a reduction in the *abiotic depletion* impact of constructed wetland and activated sludge systems.

The activated sludge system presents the highest impact in the impact category *acidification* derived from the combustion of fossil fuels to produce electricity with the consequent release of acid gases.

Options for reduction of life cycle impacts were assessed including materials used in construction and operation lifetime of the systems. A 10 % extension of operation lifetime of constructed wetland and slow rate infiltration systems lead to a 5 % and 7 % decrease in the abiotic depletion indicator, respectively, and to a 1 % decrease in CO<sub>2</sub> emissions in both systems. The effect of the materials used in the construction of activated sludge and Imhoff tanks (used as a pre-treatment in the constructed wetland), respectively steel and concrete, on the life cycle impact of the systems was assessed. In both units steel and concrete were substituted by HDPE, a material that can be used in construction. Replacing steel with HDPE in the activated sludge tank resulted in a 1 % reduction in CO<sub>2</sub> emission and 1 % in the *abiotic depletion* category considering a functional unit of 1 p.e. In the case of the Imhoff tank a 1 % reduction in CO<sub>2</sub> emissions and 5 % in the *abiotic depletion* category were observed when concrete was replaced by HDPE.

## CONCLUSIONS

The costs of construction, operation and maintenance of the several energy-saving wastewater treatment systems audited during the project were very competitive, namely when compared to intensive conventional systems. Additionally, because noise problems are minimized and landscape value and scenic quality are preserved, social acceptance tends to be high. Therefore, such wastewater treatment processes are good examples of sustainable technologies for environmental protection and resources valorisation.

The present study reveals that the LCA approach can be used as a decision tool in design studies. The LCA quantification identified the constructed wetland and the slow rate infiltration systems as appropriate technologies in rural areas. The key factor was the reduction of global warming impact due to carbon sequestration, as opposed to the activated sludge processes, which require a high energy input and present a negative carbon balance.

## ACKNOWLEDGMENTS

This work was supported by EU Program INTERREG III-B Atlantic Arc, Depuranat project (n° 54).

## REFERENCES

- Boutin C., Duchène P. and Liénard A. (1998). Filières d'épuration adaptées aux petites collectivités, Document technique FNDAE n°22, Ed. CEMAGREF, France.
- Dennison, F. J., Azapagic, A., Clift, R. and Colbourne, J. S. (1999). Life cycle assessment: comparing strategic options for the mains infrastructure - Part I. *Wat. Sci. Tech.* 39, 315-319.
- Dixon, A., Simon, M. and Burkitt, T. (2003). Assessing the environmental impact of two options for small scale wastewater treatment: comparing a reedbed and an aerated biological filter using a life cycle approach. *Ecol. Eng.*, 20, 297-308.
- García I., Rodríguez J., Rodríguez J., Suárez B., Bocado J. and Martín N. (2006). In: Guia sobre tratamientos de aguas residuales urbanas para pequeños núcleos e población, Instituto Tecnológico das Canarias, Canarias, pp. 55-101.
- Lundin, M., Bergtsson, M. and Molander, S. (2000). Life Cycle Assessment of wastewater systems: Influence of system boundaries and scale on calculated environmental loads. *Environ. Sci. Technol.*, 34, 180-186.
- Machado, A. P., Urbano, L., Brito, A.G., Janknecht, P., Salas, J.J., Nogueira, R. (2007) Life Cycle Assessment of Wastewater Treatment Options for Small and Decentralized Communities: energy-saving systems versus activated sludge. *Wat. Sci. Tech.*, 56 (3), 15-22.
- Nogueira, R., Ferreira, I., Janknecht, P., Salas, J.J., Oliveira, P., Brito A.G. (2007). Energy-saving wastewater treatment systems: formulation of cost functions. *Wat. Sci. Tech.*, 56 (3), 85-92.