

On the Application of Model-Order Reduction Algorithms

Viorel DUGAN, Robinson MEDINA, Clara M. IONESCU, Robin DE KEYSER

Abstract— The paper presents an application of methodologies for high order model reduction to obtain a lower-order model with performance preserved. An illustrative example is used to show the effectiveness of the methods. After some background theory, the algorithms are shown on an example of waste heat recovery for thermal water supply. The final aim of this study is to provide a basis platform for the development of a robust controller for the (uncertain) industrial-heat recovery.

I. INTRODUCTION

Ideally, the goal of a control system designer is to build a system that will perform well under real-life conditions and constraints. Hence, a designed control system or a *newly* designed control system must ensure stability and a high performance level in spite of uncertainties (real environment may change with time, parameters can vary, or unmodelled dynamics).

Typical classical frequency domain control design techniques have as design specifications only the gain margin and phase margin. In control engineering, the property of a control system to operate properly or least satisfactorily in realistic conditions is called *robustness*.

Historically speaking, on the one hand, the robustness issue was not strongly considered in the decades 1960s and 1970s; however, researchers as Horowitz, Houpis on the other hand, by their works, e.g. [1], have done a *first* point of view in the robustness field – the QFT (quantitative feedback theory). Step by step, researchers in analysis and design of multivariable (MIMO) control systems, as A. J MacFarlane, H.H. Rosenbrock, Postletwhaite, [2,-3], extended the principles of classical control to the MIMO case in the 1970s. Similarly, the robust control design concepts have been developed in time, and in 1980s, by works of Zames and Francis [4, -5], begins the *second* great step (and milestone) in the field of system robustness. Nowadays, after more than three decades, the robust control procedures from the practical field initiated by above pioneers [4, 5], and many others [6, 7, 8, 9], resulting in the new paradigms which are systematic, efficient and elegant:

H_2 control, H_∞ optimal control, loop shaping control, H_∞ optimization, μ -analysis and synthesis etc.

The robust controller resulting from any such procedure is a complex one and consequently, from practical reasons its order must be reduced. For a control system, both model reduction of initial orders (of the original plant model and of controller) obviously, are similar in procedure [10, 11, 12, 13]. In this paper, we use an illustrative example to show the methodology and its efficient model order reduction. Although simplistic, the example is a sufficient numerical support to show the procedure and its results.

The paper is organized as follows: the next section provides a description of the example employed throughout the exercise. The third section presents the theoretical background and motivations for developing model-order reduction techniques. The results are given and discussed in section four and some conclusions summarize the main outcome of this paper and point to some perspectives.

II. SYSTEM DESCRIPTION

The example proposed for this paper takes advantage of the re-use of industrial waste-heat. Metallurgical factories use high temperatures to melt and further process metals like aluminum, iron, copper etc. These high temperatures can be used to heat up water, that later, can be sent to the cities to provide heating to residential areas. However, because of the remoteness of the factories, long pipelines have to be used normally without good thermal insulation, causing heating losses. The hot water input flow Q is divided in two (or more) pipelines according to the parameter Alpha, and then it goes through 25 sections in each side. Each section has its own temperature because of the thermal losses. Finally the two pipelines join, through a mixing process, the output temperature of both sides.

From a practical point of view, this system is in fact more interesting with input the flow ratio regulation (α) for controlling the temperature at the end of the line. However, this implies a nonlinear model, which is far too complex for the illustrative purpose of this paper and makes the target of another future contribution.

Consider the distributed parameter system from figure 1. The energy balance for the first section is shown below:

$$\rho C_p V T'_{11} = \rho C_p Q_1 (T_{in} - T_{11}) - q_{11} \quad (1)$$

where:

V. Dugan is with the “Dunarea de Jos” University of Galati, Romania Faculty of Automatics, Informatics and Electrical Engineering, Stiintei no 2, 800800Galati,Romania,(vdugan@ugal.ro).

R. Medina, CM Ionescu and R. DeKeyser are with Ghent University, Faculty of Engineering and Architecture, EeSA – dept. of Electrical energy, System and Automation, Technologiepark 913, 9052 Gent, Belgium (Robinson.MedinaSanchez@ugent.be; ClaraMihaela.Ionescu@ugent.be; Robain.DeKeyser@UGent.be).

q_{nm} = Heat flow $\left[\frac{\text{Joul}}{\text{s}}\right]$ = External disturbances = Input

T_{in} = Input Temperature $[\text{°C}]$ = input

T_{nm} = Distributed Temperature $[\text{°C}]$ = States

T_{out1}, T_{out2} = Output temperatures $[\text{°C}]$ = Outputs

Q = input flow $\left[\frac{\text{m}^3}{\text{s}}\right]$

C_p = Specific Heat $\left[\frac{\text{Joul}}{\text{Kg}^\circ\text{C}}\right]$

ρ = density $\left[\frac{\text{Kg}}{\text{m}^3}\right]$

V = Volume $[\text{m}^3]$

V_1 = Volume in the left side $[\text{m}^3]$

V_2 = Volumen in the right side $[\text{m}^3]$

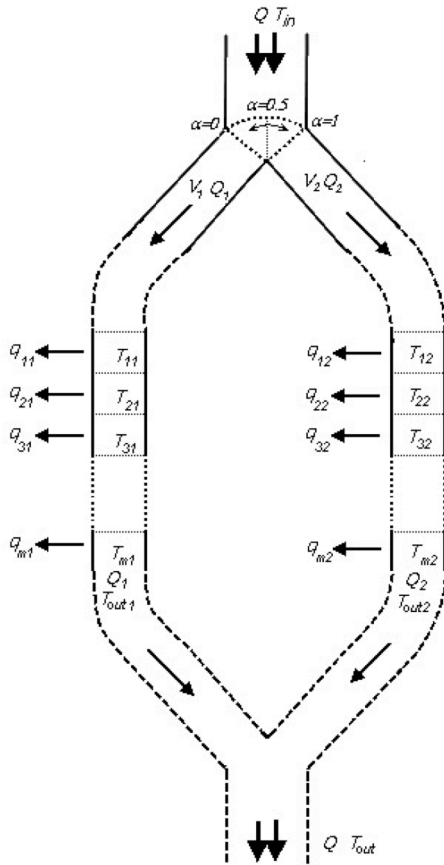


Figure 1. Schematic representation for the proposed system.

The ratio α is the relationship between the flows and volumes. It is defined in (2), and applied in (3), (4) and (5).

$$\alpha = \frac{Q_1}{Q} \quad (2)$$

$$1 - \alpha = \frac{Q_2}{Q} \quad (3)$$

$$V_1 = \alpha V \quad (4)$$

$$V_2 = V(1 - \alpha) \quad (5)$$

The full system can be represented as a set of differential equations, one for each section. They are presented from (6) until (13). Each one takes into account the temperature in the previous section, in order to compute the current section output. Finally, the total output of the system is computed in (14), as the mean value between the two output temperatures in each side.

$$\dot{T}_{11} = \frac{Q_1}{V_1} T_{in} - \frac{Q_1}{V_1} T_{11} - \frac{1}{\rho C_p V_1} q_{11} \quad (6)$$

$$\dot{T}_{21} = \frac{Q_1}{V_1} T_{11} - \frac{Q_1}{V_1} T_{21} - \frac{1}{\rho C_p V_1} q_{21} \quad (7)$$

$$\dot{T}_{31} = \frac{Q_1}{V_1} T_{21} - \frac{Q_1}{V_1} T_{31} - \frac{1}{\rho C_p V_1} q_{31} \quad (8)$$

$$\vdots$$

$$\dot{T}_{251} = \dot{T}_{out1} = \frac{Q_1}{V} T_{241} - \frac{Q_1}{V} T_{251} - \frac{1}{\rho C_p V} q_{251} \quad (9)$$

$$\dot{T}_{12} = \frac{Q_2}{V_2} T_{in} - \frac{Q_2}{V_2} T_{12} - \frac{1}{\rho C_p V_2} q_{12} \quad (10)$$

$$\dot{T}_{22} = \frac{Q_2}{V_2} T_{12} - \frac{Q_2}{V_2} T_{22} - \frac{1}{\rho C_p V_2} q_{22} \quad (11)$$

$$\dot{T}_{32} = \frac{Q_2}{V_2} T_{22} - \frac{Q_2}{V_2} T_{32} - \frac{1}{\rho C_p V_2} q_{32} \quad (12)$$

$$\vdots$$

$$\dot{T}_{252} = \dot{T}_{out2} = \frac{Q_2}{V_2} T_{242} - \frac{Q_2}{V_2} T_{252} - \frac{1}{\rho C_p V} q_{252} \quad (13)$$

$$T_{out} = \frac{T_{out1} + T_{out2}}{2} \quad (14)$$

The states for the state space notation are presented from (15) until (20). The system inputs are shown in (21).

$$x_1 = T_{11} \quad (15)$$

$$x_2 = T_{21} \quad (16)$$

\vdots

$$x_{25} = T_{251} = T_{out1} \quad (17)$$

$$x_{26} = T_{12} \quad (18)$$

$$x_{27} = T_{22} \quad (19)$$

\vdots

$$x_{50} = T_{252} = T_{out2} \quad (20)$$

$$\mathbf{u} = \begin{bmatrix} T_{in} \\ q_{11} \\ q_{21} \\ \vdots \\ q_{12} \\ q_{22} \\ q_{252} \end{bmatrix}_{51 \times 2} \quad (21)$$

From here it follows the state space matrices A,B,C and D, given below.

$$A = \begin{bmatrix} -\frac{Q_1}{V_1} & 0 & \dots & 0 & 0 & \dots & 0 & 0 \\ \frac{Q_1}{V_1} & -\frac{Q_1}{V_1} & \dots & 0 & 0 & \dots & 0 & 0 \\ \vdots & \vdots & \ddots & \vdots & \vdots & \ddots & \vdots & \vdots \\ 0 & 0 & \dots & -\frac{Q_2}{V_2} & 0 & \dots & 0 & 0 \\ 0 & 0 & \dots & \frac{Q_2}{V_2} & -\frac{Q_2}{V_2} & \dots & 0 & 0 \\ \vdots & \vdots & \vdots & \vdots & \vdots & \ddots & \vdots & \vdots \\ 0 & 0 & \dots & 0 & 0 & \dots & \frac{Q_2}{V_2} & -\frac{Q_2}{V_2} \end{bmatrix}_{50 \times 50} \quad (22)$$

$$B = \begin{bmatrix} \frac{Q_1}{V_1[1,1]} & -\frac{1}{\rho c_p V_1[1,2]} & 0 & \dots & 0 & 0 & \dots & 0 \\ 0 & 0 & -\frac{1}{\rho c_p V_1[2,3]} & \dots & 0 & 0 & \dots & 0 \\ \vdots & \vdots & \vdots & \ddots & \vdots & \vdots & \ddots & \vdots \\ \frac{Q_2}{V_2[26,1]} & 0 & 0 & \dots & -\frac{1}{\rho c_p V_2[26,27]} & 0 & \dots & 0 \\ 0 & 0 & 0 & \dots & 0 & -\frac{1}{\rho c_p V_2[27,28]} & \dots & 0 \\ \vdots & \vdots & \vdots & \ddots & \vdots & \vdots & \ddots & \vdots \\ 0 & 0 & 0 & \dots & 0 & 0 & \dots & -\frac{1}{\rho c_p V_2[50,51]} \end{bmatrix}_{50 \times 1} \quad (23)$$

$$C = \begin{bmatrix} \mathbf{0}_{[1,1]} & \dots & \mathbf{0}_{[1,24]} & \mathbf{1}_{[1,25]} & \mathbf{0}_{[1,26]} & \dots & \mathbf{0}_{[1,50]} \\ \mathbf{0}_{[2,1]} & \dots & \mathbf{0}_{[2,24]} & \mathbf{0}_{[2,25]} & \mathbf{0}_{[2,26]} & \dots & \mathbf{1}_{[2,50]} \end{bmatrix}_{[2 \times 50]} \quad (24)$$

$$D = \begin{bmatrix} \mathbf{0} & \dots & \mathbf{0} \\ \vdots & \ddots & \vdots \\ \mathbf{0} & \dots & \mathbf{0} \end{bmatrix}_{50 \times 51} \quad (25)$$

The model represented by (22)-(25) is the full model of the system, of order 50, which will be reduced using the proposed technique in the following sections.

III. CONTEXT OF LOW-ORDER CONTROLLERS

A. Theoretical Background.

Today, a mathematical model (MM) derived to represent the system dynamics for a plant is more complex compared to the same model which could have been obtained several decades ago. The reasons are: i) increasing the performance specifications, ii) increasing demands on productivity, iii) increasing demands on quality, iv) increasing demands on accuracy of modeling, etc. For these MM (often MIMO) which are more complex and therefore more accurate, the obtained controllers are of the same complexity and usually numerically high-order.

However, complex models are not always required in order to achieve good control performance. For example, an unfortunate fact is that optimization methods (i.e. procedures

based on H_∞ , H_2 , H_∞ control, μ - analysis and synthesis, etc) tend to produce controllers with an order at least as many states as the plant model [10, 11, 12, 13]. These high-order controllers are difficult to implement, have a high cost, low numerical reliability, many maintenance problems etc.

Because in control engineering practice a good controller often requires simple and low order functions, the remainder of the paper enumerates the main methods to find less-complex, low-order approximations for plant and controller models [10-16].

Thus, to obtain a lower-order plant model or a lower-order controller for a high-order plant in literature one can find the following logical ideas: (a) plant model reduction and just after controller design; (b) first step is controller design and the second is controller- order reduction; (c) a direct design of low-order controllers. As in all approaches with many possibilities, each of them has different advantages and dis-advantages. However, only the above mentioned (a) and (b) methodologies are useful within the robust control field.

B. When should we employ a model-order reduction?

Not all designs of robust controllers for high-order plant or relatively high-order plant (i.e. for all complex systems) require model reduction. However, there are some cases in which this step is mandatory:

(i) – a smaller size model but representative (with dynamics preserved) is desirable for the control designer to *speed up* the simulation process in design stage;

(ii) - a smaller size model but representative is necessary to be used to *obtain some specifications*;

(iii) – as above, when the resultant controller using an optimization method (based on H_∞ , H_2 , μ) is one with an order at least as many states as the plant model, i.e. *greater than needed*, and as a result they are hard to be implemented in practice.

C. Classes of Approximation Methods

Hitherto, there are a manifold of methods available for model-order reduction. From these, for *stable* systems only, the most used three methods, based on absolute – error approximation, are:

(a)-Balanced Truncation-method which gives a good approximation over high-frequency ranges;

(b)-Singular Perturbation Approximation (or Balanced residualisation) - method which perform better approximation of Bode characteristic over low-frequency and medium frequency ranges; and

(c)-Hankel-Norm Approximation - method which usually perform better approximation at high frequency.

When a system $G(s)$ is *unstable*, first one can apply modal decomposition to find a stable $G_{st}(s)$ and an *unstable* part G_{unst} (all poles in RHCP), $G(s) = G_{st}(s) + G_{unst}(s)$. It is then possible for $G(s)$ to be reduced to $G_{stRED}(s)$ with any from above methods. Another method applicable to the *unstable* systems is

the one obtained through reduction of normalized coprime factors of the system.

When a reduced-order model is necessary for a practical application to approximate equally well the Bode magnitude over the whole frequency range, the method used is a stochastic one, namely *balanced stochastic truncation (BST)* [20, 21].

Finally, in those cases when it is necessary not only to obtain a particular reduced-order controller, but also some design specifications of the closed-loop system, the controller-order reduction problem can be better formulated in a frequency framework, i.e. as a frequency-weighted model reduction [11].

D. Practical model reduction methods

Two categories from above methods are to minimize the H_∞ norm between the full order model and the reduced order model, $\|G(s) - G_{RED}(s)\|_\infty$.

The *first* algorithm for model approximation and order reduction, controls the *absolute approximation error*, and is based on the Hankel singular values of the system. In this case (the additive error), the reduction algorithm returns a reduced order model G_{RED} of the original model G with a bound on the error, the peak gain across frequency. In [22] is shown that the reduced order model $G_{RED}(s)$ of the original model $G(s)$ has a bound on the infinity norm of the error, $\|G(s) - G_{RED}(s)\|_\infty$, which must satisfy the inequality

$$\|G(s) - G_{RED}(s)\|_\infty \leq 2 \sum_{k+1}^n (\sigma_i) \quad (26)$$

where σ_i is i^{th} Hankel singular value of the original system G .

The *second* algorithm for model approximation and order reduction, controls the *multiplicative (or relative) approximation error*, and is based on the Hankel singular values of the system. In the latter case (the multiplicative (relative) error), the reduction algorithm returns a reduced order model G_{RED} of the original model G with a bound on the relative error $\|G^{-1}(s)(G(s) - G_{RED}(s))\|_\infty$, which must satisfy the inequality, [12]:

$$\|G(s) - G_{RED}(s)\|_\infty \leq \prod_{k+1}^n \left(1 + 2\sigma_i \left(\sqrt{1 + \sigma_i^2} + \sigma_i \right) \right) - 1 \quad (27)$$

If in control theory, the eigenvalues (λ_i) show the system *stability*, in robust control the Hankel singular values (σ_H) show the "energy" of each state in the system. The idea is to keep (only) larger "energetic" states of a system, i.e. states which preserves most of the system characteristics (as stability, frequency and time responses etc).

Most model reduction techniques from software packages such as MATLAB or Slicot, used in practical applications, are based on the Hankel singular values (HSVs) of a system. The HSVs can obtain a reduced order model that preserves the majority of the system dynamic characteristics (see above idea). For a stable state-space system (A,B,C,D), its HSVs are defined, [22], as

$$\sigma_H = (\lambda_i(PQ))^{1/2}, \quad (28)$$

where P and Q are *Controllability* and *Observability Grammians* satisfying following Lyapunov equations:

$$AP + PA^T = -BB^T \quad (29)$$

$$A^TQ + QA = -C^TC \quad (30)$$

As a conclusion, for practical applications, the most used model reduction methods are: (a) *absolute-error approximation* (or *additive error method*), and (b) *relative-error approximation* (or *multiplicative error method*). In both of the above categories, the reduced order model has: in (a) - an additive error bounded by an error criterion and in (b) - a multiplicative (or relative error) bounded by an error criterion. In both methods, the error is measured in terms of peak gain across frequency, i.e. H_∞ norm, and the error bounds are a function of the neglected Hankel singular values, $\|G(s) - G_{RED}(s)\|$. In other words: performance preservation indicates that the H_∞ norm bound of the closed loop transfer function with *reduced-order* controller is not greater than the H_∞ norm bound of the closed loop transfer function with *full order* controller. In any case from the two above, is assumed *additive*, respectively *multiplicative* perturbation to the closed loop transfer function, to obtain sufficient conditions for performance preservation.

IV. RESULTS AND DISCUSSIONS

In this section we apply the method described in section III on the model from section II.

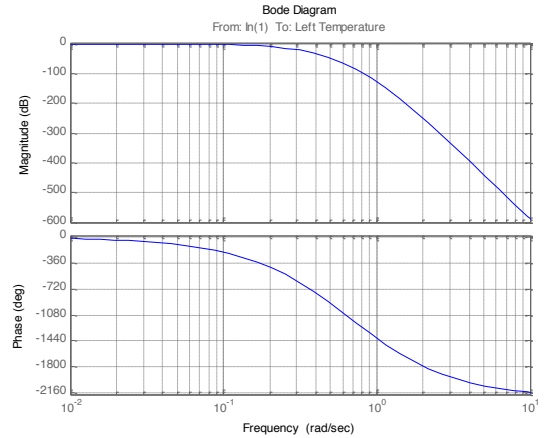


Figure 2. Bode Plot of the full-order system from figure 1, with 25 states in one branch.

Figure 2 depicts the Bode characteristic of the full system from figure 1. The application of the Hankel matrix decomposition delivers the information that of the total of 50 states, only 16 are dominant, as shown in figure 3 below. From figure 3, one may observe that the number of states with high energy in the Hankel singular value matrix can be reduced to 6, while preserving the

original dominant dynamic characteristics of the original system from section II. Figure 4 depicts these 6 dominant states.

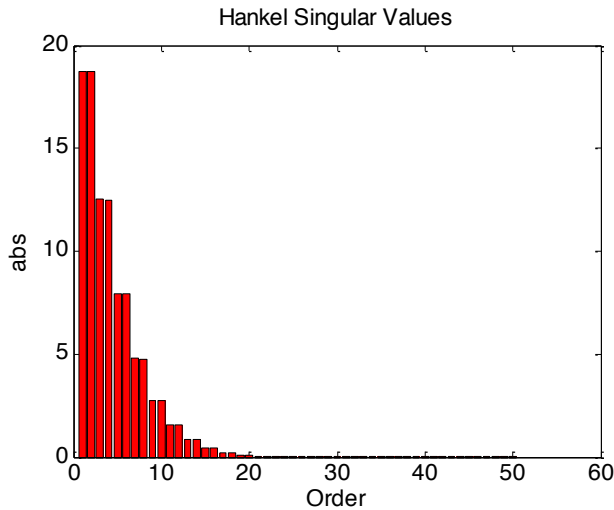


Figure 3. The result of the Hankel matrix decomposition in singular values, suggesting a lower order model from the full one with 50 states.

Method 1: In order to realize the reduced model, we use the absolute error method (also known as additive error method). We therefore apply a balanced truncation algorithm, by means of the Matlab^(R) function **balancmr**. This method has the advantage that the error introduced by the remaining states (25-6=19) is uniformly minimized in the frequency interval of interest. From the Bode plot (not shown) it can be observed that the method works well in the low frequency range. However, above 0.5rad/s, the reduced order model does not capture well the original dynamics of the system.

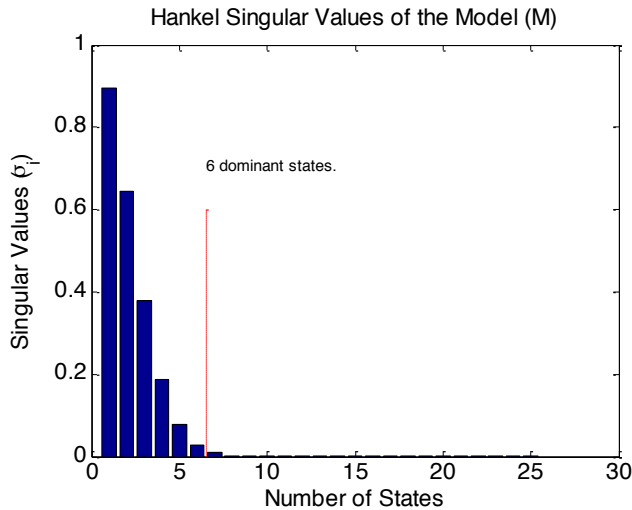


Figure 4. Selection of the 6 dominant states minimally necessary to preserve the dominant dynamics of the original system over one branch of figure 1 computed through the first method (additive error method).

Method 2: We also employ a second method, namely that of relative error (also known as multiplicative error method). Such

algorithm employs a balanced stochastic truncation (Schur method) and is very effective for all kinds of processes (linear, nonlinear, continuous or discrete). The Matlab^(R) function which applies this method is **bstmr**. The algorithm computes the infinity-norm of $\|M^{-1}(M-M_r)\|_{\infty}$, hence it may cause numerical issues if the gain is close to 0dB (not in our case). Figure 5 depicts the selection of the 8 dominant states and from the Bode plot (not shown) we also conclude that the low frequency range is well approximated.

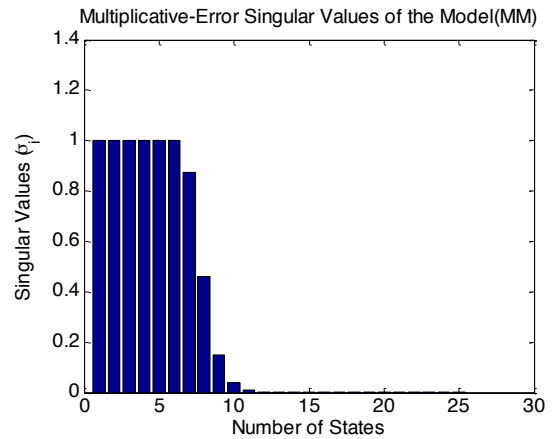


Figure 5. Selection of the 8 dominant states minimally necessary to preserve the dominant dynamics of the original system over one branch of figure 1 computed through the second method (multiplicative error method).

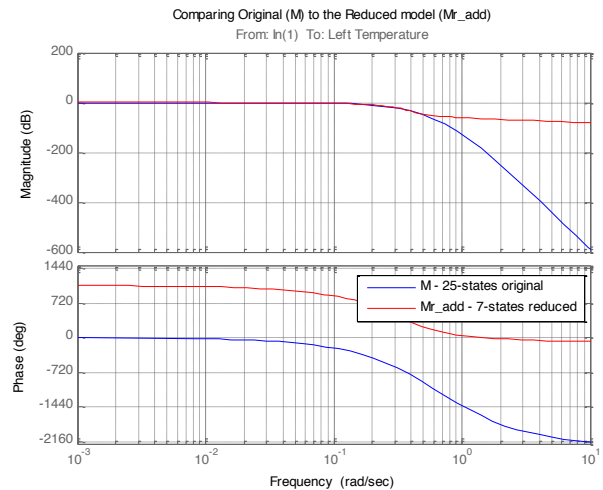


Figure 6. Bode plot of the reduced order model with 7 states.

However, when results from both methods are compared in terms of time-domain (i.e. step response), they deliver unstable results. Therefore, we apply one more step and select 7 states with a balanced truncation method for both additive and

multiplicative error methods. The Bode plot result is given in figure 6. The step response is given in figure 7 for the methods employed, where is shown clearly that the additive error method outperforms the multiplicative error method.

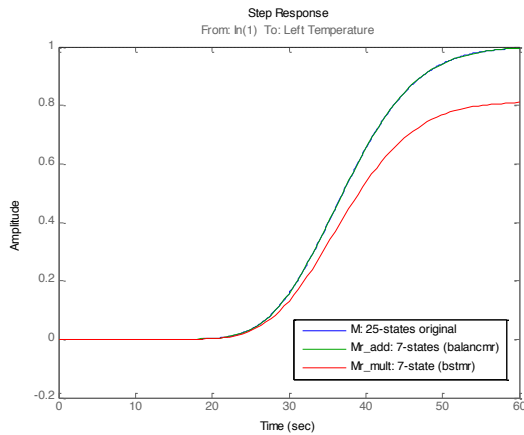


Figure 7. Step response of the original method and the reduced methods. Notice that the reduced model with additive error method outperforms the multiplicative error method result.

V. CONCLUSIONS

To conclude, we have presented in this paper an overview of simple yet effective methods for model order reduction. The next objective is to test these methods on a nonlinear system (through linearization techniques) and design robust controllers.

REFERENCES

- [1] I. Horowitz. *Synthesis of Feedback Systems*, Academic Press, New York, 1963, ISBN
- [2] H.H. Rosenbrock. *Computer-Aided Control System Design*. Academic Press, New York, 1974. ISBN 0-125-97450-7
- [3] Postlethwaite, J.M. Edmunds, and G.J. MacFarlane. Principal gains and principal phases in the analysis of linear multivariable systems, *IEEE Transactions on Automatic Control*, AC-26, 32-46 (1981)
- [4] G. Zames. Feedback and optimal sensitivity: Model reference transformations, multiplicative seminorms and approximate inverses. *IEEE Transactions on Automatic Control*, AC-26:301-320, 1981.
- [5] G. Zames and B.A. Francis. Feedback, minimax sensitivity, and optimal robustness. *IEEE Transactions on Automatic Control*, AC-28:585-600, 1983.
- [6] J.C. Doyle, B.A. Francis, and A.R. Tannenbaum. *Feedback Control Theory*. Macmillan Publishing Co., New York, 1992. ISBN 0-02-330011-6.
- [7] J.C. Doyle. A review of μ : For case studies in robust control. In *Proceedings of 10th IFAC World Congress*, pages 395-402, Munich, Germany, July 1987.
- [8] M.G. Safonov, D.J.N. Limebeer, and R.Y. Chiang. Simplifying the *H1* theory via loop-shifting, matrix-pencil and descriptor concepts. *International Journal of Control*, 50:2467-2488, 1989.

- [9] R.Y. Chiang, and M.G. Safonov, *User's Guide to the Robust Control Toolbox for MATLAB*, South Natick, MA: MathWorks, Inc, 1988
- [10] B.W. Choi, D.W. Gu, and I. Postlethwaite. Low-order *H1* Sub-Optimal Controllers. *IEE Proceedings - Part D*, 141:243-248, 1994.
- [11] D.W. Gu, P.H. Petkov and M.M. Konstantinov. *Robust Control Design with MATLAB*. Springer-Verlag London Ltd, 2005, ISBN 1-85233-983-7
- [12] K. Zhou, J.C. Doyle, and K. Glover. *Robust and Optimal Control*. Prentice Hall, Upper Saddle River, NJ, 1996. ISBN 0-13-456567-3.
- [13] M.G. Safonov and R.Y. Chiang. A Schur method for balanced-truncation model reduction. *IEEE Transactions on Automatic Control*, AC-34:729-733, 1989
- [14] M.G. Safonov, R.Y. Chiang, and D.J.N. Limebeer. Hankel model reduction without balancing - A descriptor approach. In *Proceedings of the 26th IEEE Conference on Decision and Control*, Los Angeles, CA, December 1987.
- [15] S. Skogestad and I. Postlethwaite. *Multivariable Feedback Control*. John Wiley and Sons Ltd, Baffins Lane, Chichester, UK, 1996, ISBN 0-471-94330-4.
- [16] G.J. Balas, J.C. Doyle, K. Glover, A. Packard, and R. Smith. μ -*Analysis and Synthesis Toolbox: User's Guide*. MUSYN Inc. and The Mathworks, Inc., 1995.
- [17] G. Wang, V. Sreeram, and W.Q. Liu. Performance Preserving Controller Reduction via Additive Perturbation of the Closed-Loop Transfer Function, In *IEEE Transactions on Automatic Control*, Vol. AC 46, No.5, May, 771-775, 2001
- [18] T.E. Pare and J.P. How. Algorithms for Reduced Order Robust H_∞ Control Design. In *Proceedings of the 38th Conference on Decision & Control*, Phoenix, Arizona, USA, December 1999, 1863-1868
- [19] M. Mirzaei, H.H. Niemann, and N.K. Poulsen. *DK-Iteration Robust Control design of a Wind Turbine*. In *IEEE International Conference on Control Application (CCA)*, Denver, CO, USA, September 28-30, 1493-1498, 2011
- [20] U.B. Desai and D. Pal. A transformation approach to stochastic model reduction. *IEEE Transactions on Automatic Control*, AC-29:1097-1100, 1984.
- [21] M. Green. A relative error bound for balanced stochastic truncation. *IEEE Transactions on Automatic Control*, AC-33:961-965, 1988.
- [22] K. Glover, All Optimal Hankel Norm Approximation of Linear Multivariable Systems, and Their L_∞ - error Bounds, *Int. J. Control*, vol. 39, no. 6, 1145-1193, 1984.