

Coordination of community electricity markets and distribution network operation

Citation for published version (APA):

Dukovska, I., Slootweg, J. G., & Paterakis, N. G. (2023). Coordination of community electricity markets and distribution network operation. In *27th International Conference on Electricity Distribution, CIRED 2023* (pp. 1540-1544). Article 10267685 (IET Conference Proceedings; Vol. 2023, No. 6). Institution of Engineering and Technology (IET). <https://doi.org/10.1049/icp.2023.0928>

Document license:

CC BY

DOI:

[10.1049/icp.2023.0928](https://doi.org/10.1049/icp.2023.0928)

Document status and date:

Published: 29/09/2023

Document Version:

Accepted manuscript including changes made at the peer-review stage

Please check the document version of this publication:

- A submitted manuscript is the version of the article upon submission and before peer-review. There can be important differences between the submitted version and the official published version of record. People interested in the research are advised to contact the author for the final version of the publication, or visit the DOI to the publisher's website.
- The final author version and the galley proof are versions of the publication after peer review.
- The final published version features the final layout of the paper including the volume, issue and page numbers.

[Link to publication](#)

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal.

If the publication is distributed under the terms of Article 25fa of the Dutch Copyright Act, indicated by the "Taverne" license above, please follow below link for the End User Agreement:

www.tue.nl/taverne

Take down policy

If you believe that this document breaches copyright please contact us at:

openaccess@tue.nl

providing details and we will investigate your claim.

COORDINATION OF COMMUNITY ELECTRICITY MARKETS AND DISTRIBUTION NETWORK OPERATION

Irena Dukovska
TU Eindhoven & Alliander - Netherlands
i.dukovska@tue.nl

J.G. (Han) SLOOTWEG
Enexis & TU Eindhoven - Netherlands
han.slootweg@enexis.nl

Nikolaos G. PATERAKIS
TU Eindhoven - Netherlands
n.paterakis@tue.nl

ABSTRACT

Community electricity markets are dedicated markets in which small electricity prosumers can directly trade electricity among themselves. The interest in such markets is growing in recent years as indicated by the increasing number of research studies, pilot projects and commercial implementations of community markets. The large-scale deployment of community markets may contribute to problems in the distribution grid, in combination with the increased electrification of the energy demand. Therefore, a coordinated approach with the DSO's operational activities is preferred in order to avoid network problems. This paper proposes a method for such coordination that is straightforward, effective and considers the electricity deregulation. The results of the case study demonstrate how flexibility from prosumers can be utilized by the DSO to solve network problems. The coordinated approach has a small negative effect on the community market which can be overcome with adequate remuneration policy.

INTRODUCTION

The increasing number of prosumers in the energy system opens the possibility for the development of new, user-centric market models. Community markets in which a group of prosumers can trade electricity among themselves are one type of such markets [1]. Especially for residential prosumers that enable the direct participation of prosumers in dedicated electricity markets. To facilitate the energy exchanges, participants use energy management systems that offer decision support and have control capabilities over a number of household devices, such as electric vehicles. This controllability and market clearing signals will have an impact on the behavior of the residential market participants and their corresponding power injections and withdrawals. Due to the separation of the market and network operation activities, the community market operates unaware of the conditions in the distribution network. This can cause problems in the low voltage (LV) network to which the market participants are connected, such as voltage deviations and line overloading.

It would be beneficial if there is some coordination between the market actions and the operation of the distribution network. First, such coordination will benefit the distribution system operator (DSO) as it will ensure that the distribution network is operated within the

technical limits. Second, through this coordination, DSOs can tap into the flexibility of users in the LV network. Third, it will benefit the market operation which will not be compromised by grid outages or result in user complaints for causing network problems. Finally, the business case of community markets will not suffer from failure to deliver its commitments.

In the existing literature, the role of the DSO has been considered in different ways. A DSO is checking whether the trades do not surpass the technical limits of the network continuously in a continuous market in [2]. A DSO can more easily directly influence the outcomes of a community market if its role is combined with the role of a retailer, in an electricity utility as in [3]. In parallel to the research in community markets, flexibility markets are also an active area of research [4]. Therefore, methods that enable coordinated participation of prosumers in both markets are proposed recently [5].

This paper proposes a method for the coordination of the operation of community electricity markets and the operation of the distribution network. In order to perform this coordination in a realistic and practical manner, the division of activities by different stakeholders is taken into account. The method does not require multiple iterations and the communication of information between stakeholders is limited. The applicability of the method is demonstrated in a case study using measurements and other data from residential prosumers as well as low voltage (LV) distribution network from the Netherlands.

METHODOLOGY

Overview

This paper proposes coordination of the operation of the community market and the distribution network while considering the separation of the non-regulated market-based activities and the regulated operation of the DSO. This is achieved by establishing communication between the DSO and the market operator. The overview of the process is shown in Figure 1. A detailed description of the different steps and the coordination process is provided in the subsequent subsections.

Prosumers optimization

The community electricity market is comprised of a

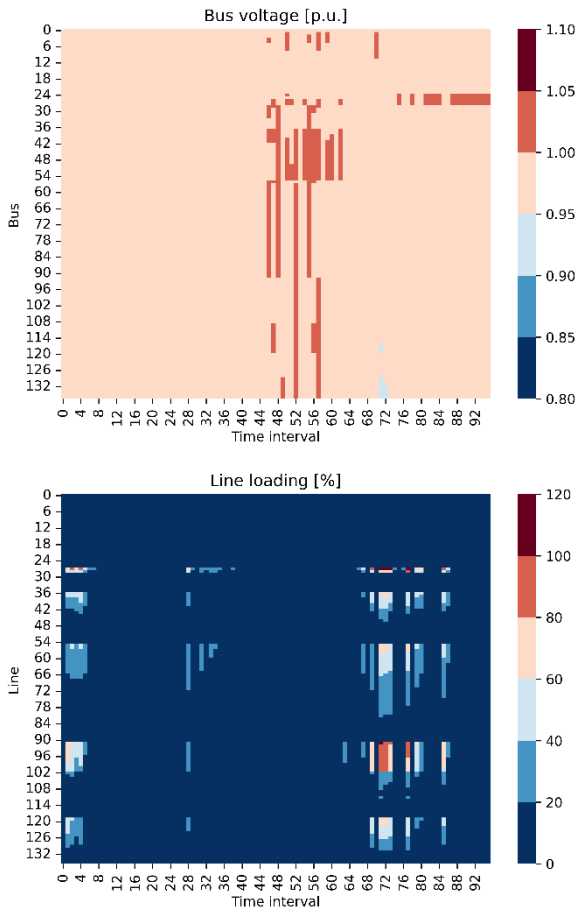


Figure 2 Power flow results before load adjustment

clearing. Moreover, it is possible that the electricity planned to be bought or sold to the retailer is also modified.

In this study, it is assumed that the prosumers will implement the required adjustments by the DSO if possible, without considering whether the financial benefit of the remuneration outweighs their other objectives. In practice, the power adjustments are incorporated as constraints in the re-optimization of the prosumers, with consideration of the limits imposed by the inflexible load and generation. As a final step, the DSO receives the updated planned load injections and performs another power flow to validate whether the requested adjustment are implemented and whether they succeed in preventing the expected problems.

CASE STUDY

Description and input data

The proposed methodology is applied to a case study for which data from the Netherlands is used. To model the prosumers connected to the distribution network, smart meter measurements from the month of August provided by a Dutch DSO are used EV charging profiles are

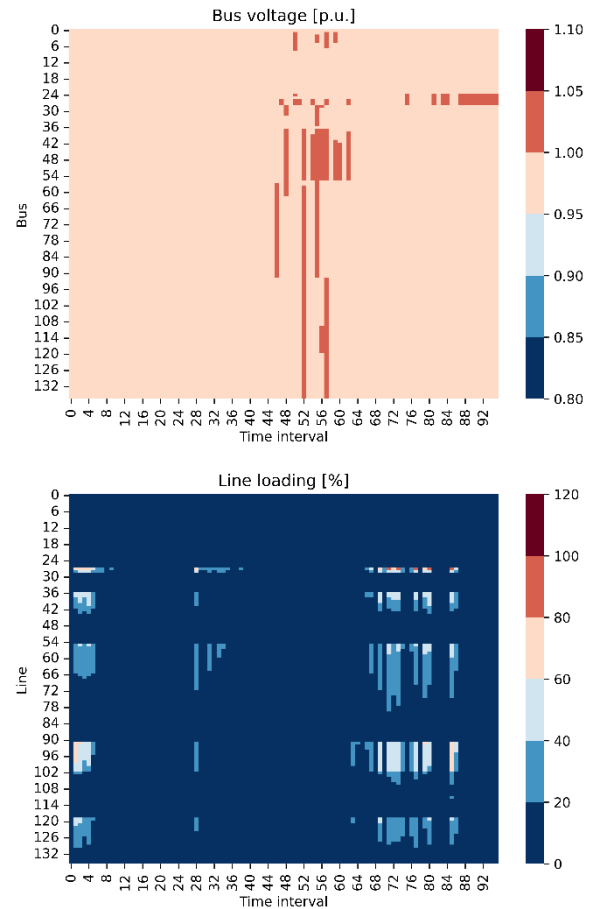


Figure 3 Power flow results after load adjustment

extracted from the open dataset. by ElaadNL [7].The maximum (dis)charging rate of the EVs is 3.7 kW. Average retail electricity prices from the Netherlands are used.

The LV distribution network that is used is a typical Dutch suburban residential network. There are 129 residential customers that are connected to this network. It is assumed that 100 customers participate in the community market, whereas the remaining customers do not. The network is connected to the medium voltage distribution grid via 400 kVA 10kV/0.4 kV distribution transformer. The limits for the voltage magnitude are between 0.95 and 1.05 [p.u.].

Results

The power flow results from the network check with the planned load injections are shown in . In general, there are very few expected problems in the network. This means that the network is not severely affected by the increasing electricity demand due to EV charging nor it is negatively affected by the activities of the community market, even in the case when the majority of customers are active prosumers. Nevertheless, in the evening hours, there are

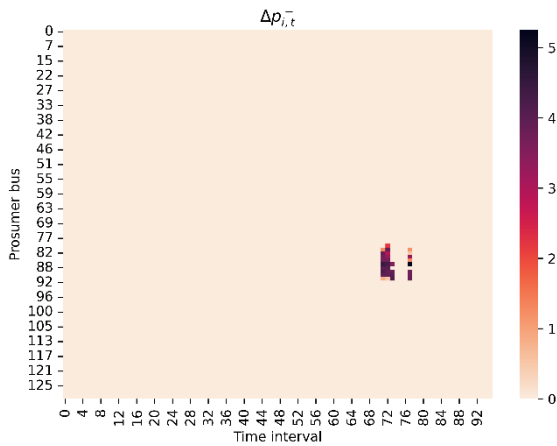


Figure 4 Power reduction requests by DSO

some undervoltage events. Moreover, around the same time intervals, some of the cables are overloaded. These problems can be attributed to the early evening peak and the fact that there is almost no electricity generated by the PVs. Finally, the distribution transformer does not get overloaded at any moment of the simulated day.

As a next step, the required adjustments are calculated using the optimization model in (1)-(9). The DSO only requires decrease in the net load injections to resolve the congestion and undervoltage problems in the early evening hours. The requested power reductions are shown in. Only few customers are requested to adjust their power and for small number of time intervals. This means that the impact of the proposed coordination on the customers is likely to be very limited. These adjustment are forwarded to the respective prosumers connected to those buses. They consequently reoptimize their electricity usage and generate new bids and offers which are forwarded to the community market.

The prosumers further communicate their updated net load injections to the DSO and the DSO performs another power flow to validate whether the undertaken actions prevent the forecasted problems. The results of this analysis are shown in **Error! Reference source not found.** Both the undervoltage problems and the overloading of the cables are resolved. This means that customers were able to implement the required power adjustments and the flexibility they provided to the DSO was sufficient to resolve the problems.

Next, the influence of the power adjustments due to the requested flexibility on the community market are analyzed. The results of the market clearing using the initial bids and offers as well as the updated bids and offers are shown in Table Table 1. The total electricity that is traded in the market is reduced after the adjustment. It is probable that some of the network

Table 1 Traded electricity and average market clearing price in

the Community market.

	Traded electricity [kWh]	Av. market price [€/kWh]
Before adjustment	118.14	0.185
After adjustment	115.81	0.195

problems are partially due to planned trades in the community market. After the adjustment the bids and offers have been reduced which results in lower quantity that is cleared. The average market clearing price has increased after the flexibility adjustment. Due to the changes in the bids, the demand for electricity has shifted to other time intervals. The increased demand has resulted in higher market clearing price.

The reduction of the traded electricity in combination with an increased average market clearing price is a negative effect of the coordination between the market operation and the DSO operation. Due to the foreseen network problems in the case study, this change is an expected outcome. Nevertheless, the difference between the two situations is not very large. Simulations over longer period of time are required to determine the extent of the impact on the community market. The negative impact can be overcome by adequate pricing of the flexibility service provided by prosumers, which will make the power adjustment an attractive option for residential customer.

CONCLUSION

Coordination between the market activities of a community electricity market and the operational activities of a DSO are the focus of this paper. Uncoordinated functioning of the community market may lead to network problems, such as undervoltage and cable overloading. Therefore a methodology to integrate a network check and a request flexibility service by the DSO to solve expected network problems day-ahead is proposed. The proposed methodology takes into account the division of activities between the different stakeholders. The DSO requires prosumers to adjust their net load injections to prevent network problems. The prosumers implement these requests if possible. The proposed approach does not require multiple iterations. The provided flexibility is sufficient to resolve the network problems as shown in the case study using data and LV network from the Netherlands. Such coordination of activities has somewhat negative effect on the quantity and price that are cleared on the market. However, this can be compensated by an adequate remuneration for the provided service. Future work will consider the uncertainty in the power injections from the perspective of determining the required adjustments. Moreover, alternative ways for implementing the flexibility provision will be considered.

ACKNOWLEDGEMENTS

This work is part of the research program "Enabling peer-

to-peer energy trading by leveraging prosumer analytics" with project number 647.003.003, partly supported by the Netherlands Organization for Scientific Research (NWO).

REFERENCES

- [1] T. Sousa, T. Soares, P. Pinson, F. Moret, T. Baroche and E. Sorin, "Peer-to-peer and community-based markets: A comprehensive review Tiago," *Renewable and Sustainable Energy Reviews*, vol. 104, pp. 367-378, 2019.
- [2] J. Guerrero, A. C. Chapman and G. Vervic, "Decentralized P2P Energy Trading Under Network Constraints in a Low-Voltage Network," *IEEE Transactions on Smart Grid*, vol. 10, no. 5, pp. 5163-5173, 2019.
- [3] J. Kim and Y. Dvorkin, "A P2P-Dominant Distribution System Architecture," *IEEE Transactions on Power Systems*, vol. 35, no. 4, pp. 2716-2726, 2020.
- [4] A. Sanjab, Y. Mou, A. Virag and K. Kessels, "A Linear Model for Distributed Flexibility Markets and DLMPs: A Comparison with the SOCP Formulation," in *CIRED 2021 Conference*, 2021.
- [5] M. Khorasny, A. S. Gazafroudi, R. Razzaghi, T. Morstyn and M. Shafie-khah, "A framework for participation of prosumers in peer-to-peer energy trading and flexibility markets," *Applied Energy*, vol. 314, 2022.
- [6] M. Farivar and S. H. Low, "Branch Flow Model: Relaxations and Convexifications - Part I," *IEEE Transactions on Power Systems*, vol. 28, no. 3, pp. 2554-2564, 2013.
- [7] ElaadNL, "ElaadNL Open Data," [Online]. Available: <https://elaad.nl/>.