

Operation, Maintenance, and Decommissioning Cost in Life-Cycle Cost Analysis of Floating Wind Turbines

Yildiz, Nurullah; Hemida, Hassan; Baniotopoulos, Charalampos

DOI:
[10.3390/en17061332](https://doi.org/10.3390/en17061332)

License:
Creative Commons: Attribution (CC BY)

Document Version
Publisher's PDF, also known as Version of record

Citation for published version (Harvard):
Yildiz, N, Hemida, H & Baniotopoulos, C 2024, 'Operation, Maintenance, and Decommissioning Cost in Life-Cycle Cost Analysis of Floating Wind Turbines', *Energies*, vol. 17, no. 6, 1332.
<https://doi.org/10.3390/en17061332>

[Link to publication on Research at Birmingham portal](#)

General rights

Unless a licence is specified above, all rights (including copyright and moral rights) in this document are retained by the authors and/or the copyright holders. The express permission of the copyright holder must be obtained for any use of this material other than for purposes permitted by law.

- Users may freely distribute the URL that is used to identify this publication.
- Users may download and/or print one copy of the publication from the University of Birmingham research portal for the purpose of private study or non-commercial research.
- User may use extracts from the document in line with the concept of 'fair dealing' under the Copyright, Designs and Patents Act 1988 (?)
- Users may not further distribute the material nor use it for the purposes of commercial gain.

Where a licence is displayed above, please note the terms and conditions of the licence govern your use of this document.

When citing, please reference the published version.

Take down policy

While the University of Birmingham exercises care and attention in making items available there are rare occasions when an item has been uploaded in error or has been deemed to be commercially or otherwise sensitive.

If you believe that this is the case for this document, please contact UBIRA@lists.bham.ac.uk providing details and we will remove access to the work immediately and investigate.

Article

Operation, Maintenance, and Decommissioning Cost in Life-Cycle Cost Analysis of Floating Wind Turbines

Nurullah Yildiz , Hassan Hemida  and Charalampos Baniotopoulos * 

School of Engineering, Civil Engineering Department, University of Birmingham, Edgbaston, Birmingham B15 2TT, UK; nxy799@alumni.bham.ac.uk (N.Y.); h.hemida@bham.ac.uk (H.H.)

* Correspondence: c.baniotopoulos@bham.ac.uk

Abstract: Offshore wind farms are great options for addressing the world's energy and climate change challenges, as well as meeting rising energy demand while taking environmental and economic impacts into account. Floating wind turbines, in specific, depict the next horizon in the sustainable renewable energy industry. In this study, a life-cycle cost analysis for floating offshore wind turbines is developed by combining the most recent data and parametric formulas from databases and relevant papers. The cost analysis models focused on cost minimization with special emphasis on Operation and Maintenance Cost (OPEX), Decommissioning Cost (DECOM), and Levelized Cost of Energy (LCOE), which are important factors in wind power economy. Given that floating wind energy is still developing, the presented scenarios should be beneficial in making future decisions. The cost analysis scenarios include on-site and off-site maintenance scenarios for OPEX. In addition, four alternative scenarios for DECOM have been examined: mechanical recycling, mechanical-incineration, incineration processes, and landfill. According to the findings of these scenarios, OPEX varies from 16.89 to 19.93 £/MWh and DECOM between 3.47 and 3.65 £/MWh, whilst the total LCOE varied from 50.67 to 66.73 £/MWh.

Keywords: barge-type floating wind turbine; decommissioning cost (DECOM); end of life; floating wind turbine; levelized cost of energy (LCOE); life cycle cost analysis (LCC); offshore wind energy; operation and maintenance cost (OPEX); renewable energy



Citation: Yildiz, N.; Hemida, H.; Baniotopoulos, C. Operation, Maintenance, and Decommissioning Cost in Life-Cycle Cost Analysis of Floating Wind Turbines. *Energies* **2024**, *17*, 1332. <https://doi.org/10.3390/en17061332>

Academic Editor: David Borge-Diez

Received: 28 January 2024

Revised: 2 March 2024

Accepted: 8 March 2024

Published: 10 March 2024



Copyright: © 2024 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<https://creativecommons.org/licenses/by/4.0/>).

1. Introduction

The electricity-generating industry is considered to be one of the primary producers of greenhouse gas emissions, accounting for 25% of total global emissions [1,2]. To address this problem, countries should focus on renewable energy sources [3]. Today, wind power is a rapidly expanding renewable energy resource, most notably in the United Kingdom, Germany, the United States of America (USA), and China [4]. Its capacity has increased significantly in recent decades, reaching 622 GW in 2019 and anticipated to rise to 903 GW by 2023, with a 12% annual growth rate [5]. Offshore and floating wind energy are deemed to have a high development potential and are likely to become one of the primary renewable energy sources [6–9].

Fixed foundations are the dominant type of offshore wind farms, installed in shallow water. However, research and development (R&D) works have risen dramatically in the last several years, with various models being developed for deep water operations. When wind turbines are installed in deep water, the supporting structures are of the floating type. Different floating platforms have been proposed, with the Semi-Submersible, Tension Leg Platform, Barge-Type, and Spar Buoy being the four most common forms [10–13]. Given the rapid advancement of floating wind turbine technology, research into economic feasibility and investment profitability is presently a high priority. Hence, life-cycle cost factors are becoming more important for operators, developers, and investors when evaluating floating wind turbine platforms [6].

A life-cycle cost analysis (LCC) is a cost analysis technique that was initially presented by the United States Department of Defense (DoD) in the 1970s. When it was first introduced, it was widely used in a broad range of industries involving construction, energy, manufacturing, and healthcare [14]. LCC analysis is a method of assessing a system or project's long-term economic viability. The potential of LCC analysis tools to identify, analyse, assess, and minimise the total cost of important activities makes it a useful tool in the conceptual phase of any project. Using the findings of an LCC analysis, managers may gain more detailed information about the financial life of assets while also assisting other stakeholders in making appropriate investment choices [15].

When conducting a Life Cycle Cost (LCC) assessment of offshore and floating wind farms, it is imperative to consider the key elements of wind power economics. Specifically, these entail the Capital Cost (CAPEX), Operation and Maintenance Cost (OPEX), and Decommissioning Cost (DECOM) [16]. CAPEX represents the largest portion of the LCC for wind power plants, encompassing all investment expenditures incurred before the start-up date. OPEX includes all expenses accrued after the commencement of commercial operations but before decommissioning, necessary for maintaining the project's operation and ensuring turbine efficiency [17,18]. CAPEX may constitute up to 80% of the overall cost of a wind power project over its lifetime and includes expenses related to turbines, substructures (platforms, mooring systems, and anchoring), and transmission systems (onshore and offshore substations, and cables) [17]. DECOM covers all the costs associated with cleaning up the land. Usually, following the deconstruction of offshore infrastructure, some elements, such as the steel of floating platforms or the aluminium, copper materials of electrical lines, may be sold for scrap, generating some income. Consequently, this operation generates a profit that could be deducted from the expenses [19]. Furthermore, DECOM handles the expenses of the end stage of a wind farm's life cycle, which amounts to approximately 1–3% of the total cost [20].

Literature Review of Life Cycle Cost Analysis for Offshore and Floating Wind Energy

As a consequence of the increased investment in new wind power projects over the past ten years, life cycle cost analysis modelling, and analysis of wind power systems have gained a great deal of interest. Madariaga et al. [21] indicated that developing a realistic and accurate technique for LCC analysis of large offshore wind farms that takes into consideration all relevant features of the associated project is an extremely difficult challenge. Mekhilef et al. [22] carried out an investigation to assess offshore wind farms in Malaysia. According to their reports, the locations bordering the South China Sea are financially efficient, with energy prices estimated based on a 2 MW of wind turbine assessment. Ibrahim and Albani [23] performed another investigation to assess the potential of wind energy in Kudat. They noted that with a payback time of fewer than 10 years, wind energy-generating capacity is 10 to 11% on average and found that the most favourable prices for wind projects with committed capital were in the range of MYR (Malaysian ringgit) 0.46 to 0.80 per kWh.

Nian et al. [24] indicated that cost reduction and performance improvement may help lower the LCOE of offshore wind generation. More crucially, their research showed that even under the worst-case climate scenarios, offshore wind can compete with solar PV on LCOE. Mytilinous and Kolios [25] concentrated on life cycle cost parameters that are directly related to the physical elements of each site, where three alternative offshore wind farm layouts and four kinds of wind turbines are taken into account. These have total costs ranging between £1.6 million and £1.8 billion.

In cost-cutting investigations [26–28], LCOE is used to calculate future costs based on technological learning curves or projections. These may be constrained by the small cumulative capacity of offshore wind farms against which to forecast cost reductions, as well as the limited number of site options, which specify the distance to transmission network and sea depth. While various wind turbine's component costs may decrease in price with time, real project costs may rise as projects advance into deeper waters and

further from shore. Moreover, while evaluations from international organisations [9,29] provide a worldwide view of cost comparisons, most studies do not explicitly address the cost of financing, which has a considerable influence on LCOE due to the capital-intensive nature of the wind energy sector. This is reported by Ebenhoch et al. [30], who found that a tiny percentage change in the weighted average cost of capital (WACC) had the greatest influence on the overall cost of a project, behind only generating capacity. Rinne et al. [31] indicated that when operational lifespan was expected to be 20 years and simulated expenses were less than 50 €/MWh, a change in interest rate produced the second-biggest loss in wind energy potential.

Some studies expressly address geographical factors. Cavazzi and Dutton [32], and Hdidouan and Staffel [33] undertook spatially detailed studies of the United Kingdom's LCOE of wind energy. Cavazzi and Dutton [32] evaluated the economics of the UK's offshore energy potential, while Hdidouan and Staffel [33] investigated the impact of weather and climatic variability on LCOE. The foundation and transmission expenditures of wind farms are determined by distance and depth-based functions in both studies.

Kaiser and Snyder [34] considered all elements of offshore wind facility installation and decommissioning and then established a methodological approach to quantify the associated costs. Nilsson and Bertling [35], and Judge et al. [36] also evaluated the LCC of wind farms, although, these studies primarily concentrate on analysing the expenditures during the operation and maintenance (O&M) stage.

With regard to floating wind turbine cost analysis, there has recently been considerable interest in the LCC analysis of floating wind turbines. Laura and Vicente [19] developed a thorough framework for cost analysis of floating wind turbines. They suggested a cost breakdown structure (CBS) to highlight the cost elements involved in the six stages of development of floating wind turbine technologies being conceptualization, development, manufacture, installation, usage, and disposal. Myhr et al. [37] developed an analytical model to analyse the levelized cost of energy of five different floating wind turbine platforms, including the Spar-Buoy, Tension-Leg-Spar, Semi-Submersible, Tension-Leg, and Tension-Leg-Buoy platforms. Moreover, they highlighted that floating turbine for rising depths may have a lower levelized cost of energy (LCOE) than bottom-fixed turbines. Baita-Saavedra et al. [38] concentrated on the economics of an offshore concrete floating wind platform, a 10 MW wind turbine in Europe's Atlantic Arc. As a consequence, their results indicated that the Canary Islands in Spain and Flores in Portugal are the most effective areas in a financial sense at which to erect a floating offshore wind farm constructed of concrete platforms in Europe's South Atlantic region. It is possible that these locations will contribute future advancements in the offshore wind sector. Maienza et al. [39] investigated the economics of Semi-Submersible, Spar-Buoy, and Tension Leg platforms in Southern Italy, taking into account their CAPEX, OPEX, and DECOM costs. Their research revealed that semi-submersible platforms are more cost-effective than other types of floating wind platforms, according to their observations.

In the light of the literature review, Laura and Vicente [19], Myhr et al. [37] and Maienza et al. [39] investigated the levelized cost of energy (LCOE) for various floating turbine platforms including Spar-Buoy, Tension-Leg-Spar, Semi-Submersible, Tension-Leg, and Tension-Leg-Buoy designs. Baita-Saavedra et al. [38] focused specifically on the LCOE of concrete Spar-Buoy platforms in certain European regions. Notably, the LCOE analysis of barge-type floating wind turbine models, another significant design, was not addressed in these studies. The present study considers the cost analysis of a barge-type floating wind turbine, evaluating the costs of various operating and maintenance scenarios as well as end-of-life scenarios. The aim of this study is to propose a method for the minimization of the levelized cost of energy for operation, maintenance, and decommissioning for barge-type floating wind turbines.

2. Methods

The cost analysis approach is structured around a breakdown of Life Cycle Cost (LCC) and utilizes the Levelized Cost of Energy (LCOE) methodology. LCC analysis encompasses three main components: Capital Expenditure (CAPEX), Operational Expenditure (OPEX), and Decommissioning Costs (DECOM) [40]. These components are further divided into five categories to represent the entirety of a floating wind project, spanning conceptualization to decommissioning [41]. Figure 1 illustrates the various stages of LCC, including predevelopment and consenting, production and acquisition, installation and commissioning, operation and maintenance, and decommissioning and disposal, while Table 1 summarizes the equations for those that. Equation (1) provides a standardized definition for the floating wind turbine's life cycle costs or economic viability cost (EC_v):

$$EC_v = \sum (C_{CAPEX} + C_{OPEX} + C_{DECOM}) \quad (1)$$

C_v = The total cost over a lifetime.

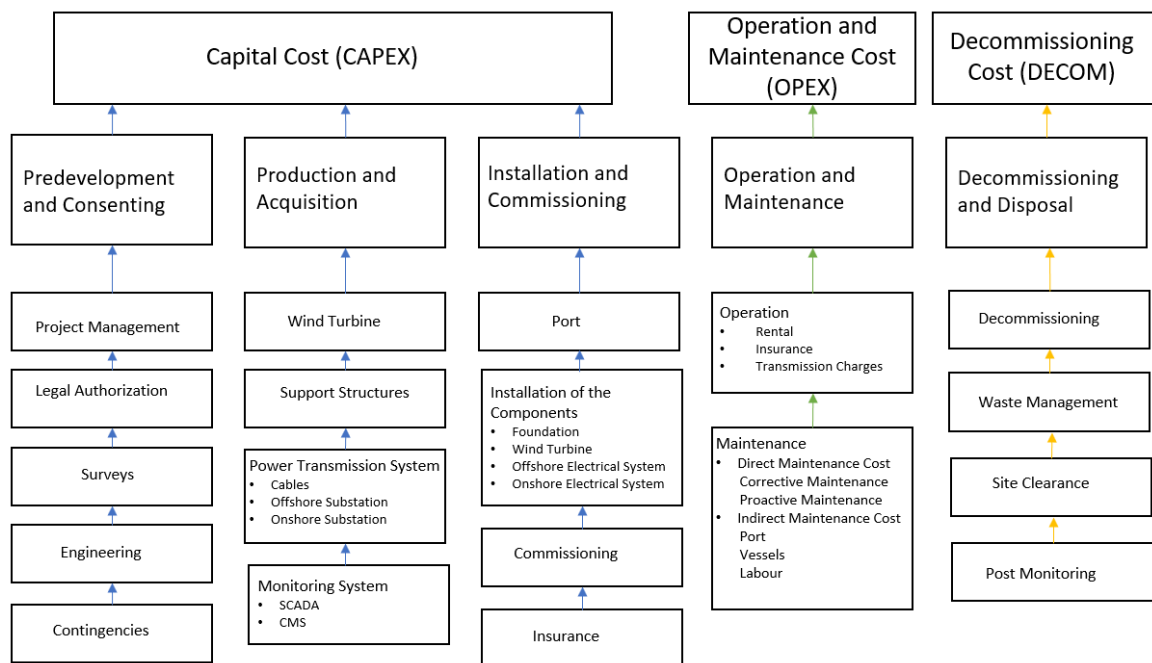


Figure 1. Life cycle cost analysis for offshore and floating wind farms.

The major characteristics of wind power economics are considered while calculating the LCC of offshore and floating wind farms. These are the Capital Cost (CAPEX), Operation and Maintenance Cost (OPEX), and Decommissioning Cost (DECOM) [18,39]. Wind farm capital expenditures (CAPEX) are the major contributor to the life cycle cost of wind farms and are defined as the initial investment costs incurred during the development and construction stages of a wind farm [16]. OPEX includes all expenses made after the start of commercial operations but before the end of the project's operational life, such as maintenance activities, which are required to keep the project running and its turbines operating at optimal efficiency [16]. DECOM is comprised of the costs associated with decommissioning and site clearing. Following the decommissioning stage, the site must be cleaned up in accordance with established rules. As a result, site clearing entails the removal of all assets associated with the offshore and floating wind farms from the construction site [39].

Table 1. Summarize of CAPEX, OPEX and DECOM.

Costs	Formulation
The total cost over a lifetime	$EC_v = \sum(C_{CAPEX} + C_{OPEX} + C_{DECOM})$
Predevelopment and consenting	$C_{P\&C} = C_{projM} + C_{legal} + C_{surveys} + C_{eng} + C_{contingency}$
Project management	$C_{projM} = 0.03 \times CAPEX$
Legal authorization	$C_{legal} = 0.0013 \times CAPEX$
Surveys	$C_{surveys} = C_{surv-EN} + C_{surv-CP} + C_{surv-SB} + C_{surv-MO}$
Engineering	$C_{eng} = C_{base} + C_{eng-verif} + C_{eng-unit} \times IC$
Contingencies	$C_{contingency} = 0.1 \times CAPEX$
Production and acquisition	$C_{P\&A} = C_{WT} + C_{SS} + C_{PTS} + C_{monitoring}$
Wind turbines	$C_{WT} = (C_{WT-mat} + C_{WT-trans}) \times N_{WT}$
Support structures	$C_{SS} = (C_{SS-mat} + C_{SS-trans}) \times N_{WT}$
Power transmission system	$C_{PTS} = C_{cables} + C_{of-sub} + C_{on-sub}$
Monitoring system	$C_{monitoring} = (C_{SCADA} + C_{CMS}) \times N_{WT}$
Installation and commissioning	$C_{I\&C} = C_{I\&C-comp} + C_{port} + C_{comm} + C_{I\&C-ins}$
Port cost	$C_{port} = C_{port-use} + C_{port-labour}$
Installation of the components	$C_{I\&C-comp} = C_{I\&C-foundation} + C_{I\&C-windturbine} + C_{I\&C-ofsubs} + C_{I\&C-onsubs}$
Operation and maintenance (O&M)	$C_{O\&M} = C_O + C_M$
Operational expenditures	$C_O = C_{rent} + C_{O\&M-ins} + C_{transmission}$
Maintenance	$C_M = C_{M-direct} + C_{M-indirect}$
Indirect maintenance	$C_{M-indirect} = C_{ind-port} + C_{ind-vessel} + C_{ind-labour}$
Decommissioning and disposal	$C_{D\&D} = C_{Decom} + C_{WM} + C_{SC} + C_{postM}$
Decommissioning	$C_{Decom} = C_{D\&D-port} + C_{remov}$
Waste management	$C_{WM} = C_{W-proc} + C_{W-trans} + C_{landfill} - SV$
Levelized cost of energy	$\frac{CAPEX + OPEX + DECOM}{AEP}$

2.1. CAPEX

Predevelopment and consenting (P&C), production and acquisition (P&A), and installation and commissioning (I&C) are the three main phases of CAPEX [2]. In this section, details of each phase are given.

2.1.1. Predevelopment and Consenting

The cost of predevelopment and consenting ($C_{P\&C}$) phase of a wind farm project is its initial stage cost. This stage begins with a concept and ends with the start of the project's implementation. In addition, five subcategories are included: cost of project management (C_{projM}), cost of legal authorization (C_{legal}), cost of surveys ($C_{surveys}$), cost of engineering activities (C_{eng}), and cost of contingency planning ($C_{contingency}$) [15].

$$C_{P\&C} = C_{projM} + C_{legal} + C_{surveys} + C_{eng} + C_{contingency} \quad (2)$$

- **Project management:** All administrative services, prefeasibility studies, funding, tenders, internal control systems, and agreements with subcontractors are included in the project management activities. It is common to express the overall cost of project management during CAPEX. Project management costs approximately 3% of the CAPEX, according to a study by Shafiee et al. [15].

$$C_{projM} = 0.03 \times CAPEX \quad (3)$$

- **Legal authorization:** The government or a regulatory authority must approve the establishment of a wind farm. The legal authorisation procedure is included in certain research as an element of project management. The cost of legal authorisation is expected to be around 0.13% of the CAPEX [15]. Thus,

$$C_{legal} = 0.0013 \times CAPEX \quad (4)$$

- **Surveys:** In evaluating the viability of offshore wind projects, several site-specific surveys should be performed. The sort of survey completed normally changes depending to the amount of information requested. Environmental ($C_{surv-EN}$), coastal process ($C_{surv-CP}$), seabed ($C_{surv-SB}$), and metocean conditions ($C_{surv-MO}$) surveys are now applied for offshore and floating wind farm projects [15]. The cost of surveying is determined by the following formulation:

$$C_{surveys} = C_{surv-EN} + C_{surv-CP} + C_{surv-SB} + C_{surv-MO} \quad (5)$$

- **Engineering:** Once a project is accepted and the final investment decision has been made, a multidisciplinary and experienced team is formed to design the offshore and floating wind farms. Many of the operations that are conducted throughout this phase encompass the aspects of structural design and selection of substructure, design of wind farm planning, and design of electrical system and grid connection [15,42]. Thus, the cost of engineering is given by the following formulation:

$$C_{eng} = C_{base} + C_{eng-verif} + C_{eng-unit} \times IC \quad (6)$$

where C_{base} , $C_{eng-verif}$, $C_{eng-unit}$, and IC present the sum of a fixed base cost, design verification process, the cost of a unit term, and the installation capacity [19].

- **Contingencies:** The contingency cost compensates for uncertain annual costs and provides for the replacement of the most expensive components prone to catastrophic failure. It is projected to constitute 10% of CAPEX costs [2].

$$C_{contingency} = 0.1 \times CAPEX \quad (7)$$

2.1.2. Production and Acquisition

Production and acquisition (P&A) are the second phase and contributes the highest share of lifecycle costs. This cost encompasses all costs related to the acquisition of wind turbines (C_{WT}), the support structure or foundation (C_{SS}), the power transmission system (C_{PTS}), and the monitoring system ($C_{monitoring}$) [2]. Thus,

$$C_{P\&A} = C_{WT} + C_{SS} + C_{PTS} + C_{monitoring} \quad (8)$$

- **Wind Turbines:** The cost of wind turbine procurements is stated as a function of the total number of wind turbines (N_{WT}) erected in the farm and can be obtained by the following equation:

$$C_{WT} = (C_{WT-mat} + C_{WT-trans}) \times N_{WT} \quad (9)$$

In Equation (9), C_{WT-mat} depicts the material costs for a wind turbine, including all of its component subsystems, and $C_{WT-trans}$ accounts for the transportation expenses incurred during the transfer of the wind turbine from the manufacturing place to the installation site [15]. The material costs of wind turbines are contingent upon the nominal power rating (PR). Shafiee et al. [15] utilised a logarithmic regression model applied to a comprehensive database containing the cost of various turbines to estimate the material cost (£) using Equation (10).

$$C_{WT-mat} = 3,000,000 \times \ln(PR) - 662,400 \quad (10)$$

- **Support structures:** The cost of a support structure is split into two parts: the material cost (C_{SS-mat}) and the transportation and assembly costs ($C_{SS-trans}$). Thus,

$$C_{SS} = (C_{SS-mat} + C_{SS-trans}) \times N_{WT} \quad (11)$$

The cost of support structures is mostly dependent on the type of platform (Semi-Submersible, Tension Leg, Spar Buoy, etc.) and the mooring and anchoring systems for floating wind turbines [39,41].

- Power transmission system: The electricity transmission system is made up of many cables that link wind turbines to the grid as well as onshore/offshore substations (C_{on-sub} / C_{of-sub}) [15]. As a result, the cost of the power transmission system is provided by

$$C_{PTS} = C_{cables} + C_{of-sub} + C_{on-sub} \quad (12)$$

- Monitoring system: To record condition data, a vast number of sensors and control devices are installed across offshore wind farms (sea-state, deterioration data, etc.). The information gathered is often sent to a supervisory control and data acquisition (SCADA) system and saved in databases. These condition data can be used by system analysts to arrange maintenance and inspection activities. The cost of offshore and floating wind farms' SCADA and condition monitoring systems (C_{CMS}) is determined by the number of wind turbines deployed [43]. Hence,

$$C_{monitoring} = (C_{SCADA} + C_{CMS}) \times N_{WT} \quad (13)$$

2.1.3. Installation and Commissioning

This consists of the expenses connected to the activities of construction and installation of offshore wind turbines, support structures, and electrical systems ($C_{I\&C-comp}$), port charges (C_{port}), commissioning cost (C_{comm}), and insurance cost ($C_{I\&C-ins}$). Hence,

$$C_{I\&C} = C_{I\&C-comp} + C_{port} + C_{comm} + C_{I\&C-ins} \quad (14)$$

- Port cost: The port is critical to the management of the supply chain for offshore and floating wind projects. Yearly fees must be paid to local governments for the use of port facilities, quayside docking, and crane usage authorization [44]. Furthermore, the annual fee to wind farm labourers who conduct project tasks (for example, pre-assembling the components) must be considered.

$$C_{port} = C_{port-use} + C_{port-labour} \quad (15)$$

$$C_{port-labour} = N_{I-d} \times Lr \quad (16)$$

N_{I-d} = Average labour-day

Lr = Daily labour rate

- Installation of the components: Some procedures must be carried out throughout the erection of offshore wind farm projects. The expenditure of any such installation is split into four categories based on the kind of components installed: foundation, wind turbine, and offshore and onshore electrical systems [15,34]. The costs associated with hiring chartered ships and technicians are included in all of the aforementioned cost categories. Hence,

$$C_{I\&C-comp} = C_{I\&C-foundation} + C_{I\&C-windturbine} + C_{I\&C-ofsubs} + C_{I\&C-onsubs} \quad (17)$$

- Commissioning: In order to discover early faults and enhance dependability, offshore wind farms must undergo extensive testing before to being put into operation. This includes testing the wind turbines, electrical systems, SCADA, and CMSs. In most cases, the expenses involved with renting vessels and staff personnel make up the bulk of the cost of commissioning [45].
- Insurance: Insurance is necessary at this stage to mitigate the effects of any unexpected occurrences. The insurance cost ($C_{I\&C-ins}$) is included in the capital cost. Insurance costs are calculated using the average worldwide cost for installation insurance of wind turbines, foundations, and electrical systems (including offshore and onshore electrical substations) [34,45,46].

2.2. OPEX

There are two aspects to the wind farm operation and maintenance (O&M) costs $C_{O\&M}$, namely operational expenditures (C_O) and maintenance expenditures (C_M) [15]. These are calculated by,

$$C_{O\&M} = C_O + C_M \quad (18)$$

2.2.1. Operational Expenditures

The rental/lease fees (C_{rent}), the insurance cost ($C_{O\&M-ins}$), and the transmission charges ($C_{transmission}$) associated with a wind farm are all included in the associated project's operating costs (C_O) [15].

$$C_O = C_{rent} + C_{O \& M-ins} + C_{transmission} \quad (19)$$

- Rental (lease): The wind farm contractors must pay fees to the local government and residents in exchange for the use of the seabed. Depending on the country, the amount of these fees might vary, but they are often expressed as a percentage of the wind farm's profits [2,15].
- Insurance: It is necessary to contract operational insurance coverage in order to protect offshore wind facilities from design flaws, collision accidents, and substation outages. When it comes to insurance packages, the cost is determined by the size of the wind farm in question [15].
- Transmission charges: A yearly fee must be paid to the authorities in control of the national electricity grid. Transmission costs are typically determined by the capacity of the wind farm [2,15].

2.2.2. Maintenance

Wind turbine maintenance aims to increase availability while reducing the expenses associated with unplanned breakdowns. There are two kinds of maintenance costs: direct ($C_{M-direct}$) and indirect ($C_{M-indirect}$) [39]. Thus,

$$C_M = C_{M-direct} + C_{M-indirect} \quad (20)$$

- Direct maintenance cost: Direct maintenance expenses include the costs of transporting malfunctioning components, maintenance specialists who conduct repair/replacement procedures, and all consumables and spare parts necessary for wind farm maintenance. Corrective maintenance (C_M) and proactive maintenance (P_M) are the two primary types of the wind farm maintenance process (P_{roM}) [47,48]. These are described as corrective maintenance, which occurs when a component fails, and proactive maintenance, which occurs before the component fails [48].
- Indirect maintenance: The cost of actions required to maintain the direct effort involved in delivering repair services is known as indirect maintenance cost. Port costs for replacement parts storage and quayside amenities must be paid regardless of the number of maintenance jobs to be accomplished. Aside from this, different procedures (such as weather forecasts and repair work scheduling) should need to be carried out onshore to coordinate maintenance tasks [47,48]. Thus, the cost of indirect maintenance can be expressed by,

$$C_{M-indirect} = C_{ind-port} + C_{ind-vessel} + C_{ind-labour} \quad (21)$$

$C_{ind-port}$, $C_{ind-vessel}$, and $C_{ind-labour}$ are the port fees, vessel recruitment expenses, and maintenance labour costs, respectively.

2.3. DECOM

The final step in a wind project's life cycle is decommissioning and disposal, which follows a protocol that is effectively the inverse of the installation and commissioning (I&C)

phase. In addition to decommissioning, wind farm equipment is removed or repurposed depending on the waste management method used. In addition, some materials may be sold, which results in a decrease in overall expenses. Following decommissioning, the site must be cleaned up in accordance with established rules. As a result, site clearing entails the dismantling of all assets associated with the offshore wind farm from the construction site [6,19,39]. Hence, the cost of decommissioning and disposal ($C_{D\&D}$) of the wind turbine can be expressed by,

$$C_{D\&D} = C_{Decom} + C_{WM} + C_{SC} + C_{postM} \quad (22)$$

C_{Decom} , C_{WM} , C_{SC} and C_{postM} are the costs of decommissioning, waste management, site clearing, and post-monitoring, respectively.

2.3.1. Decommissioning

The decommissioning cost (C_{Decom}) includes the expenditures of port preparation ($C_{D\&D-port}$) and removal activities (C_{remov}) [19]. Hence, the cost of decommissioning can be expressed by,

$$C_{Decom} = C_{D\&D-port} + C_{remov} \quad (23)$$

2.3.2. Waste Management

Wind farm materials are disposed of according to the waste management (C_{WM}) plan. There are four basic alternatives for disposing of waste: reuse, recycling, incineration with energy recovery, and landfilling [49]. Waste processing (C_{W-proc}) and waste transport ($C_{W-trans}$) expenses will be incurred regardless of the waste treatment method selected, since the materials must be first processed into smaller pieces and afterwards transported to pre-defined destinations. When the waste is transferred to a landfill ($C_{landfill}$), a predetermined charge must also be paid [6,19]. Hence, waste management cost is given by,

$$C_{WM} = C_{W-proc} + C_{W-trans} + C_{landfill} - SV \quad (24)$$

SV : The decommissioned assets' salvage (residual) value (£).

- Waste processing: Wind turbine waste should be handled under strict quality controls after decommissioning. The cost of waste processing varies according to the complexity and size and weight of the components [2,39].
- Waste transport: Following processing, waste materials undergo either landfill disposal or recycling. The transportation cost is calculated by multiplying the anticipated number of trucks required for waste transportation by the fixed fee for each truck [2,19].
- Landfill: Materials that cannot be recycled are disposed of in landfills, with the disposal cost determined by multiplying the predetermined landfill fee per tonne by the total weight of non-recyclable materials disposed of [2,19,39].
- Salvage value: The salvage value represents the anticipated value of a property at the end of its operational life. A considerable volume of the materials used in wind turbines, such as stainless steel and aluminium, can be recycled. The salvage value of materials recovered from a wind farm depends on the type, quantity (weight or volume), and quality (condition) of recyclable materials [2,39,50].

2.3.3. Site Clearing

After the wind farm has been decommissioned, the whole site should be removed in compliance with the authorised rules. Site clearance entails the elimination of all assets associated with the wind project [2,39].

2.3.4. Post Monitoring

Some offshore and floating wind components (for example, cables and anchors) may not be removed completely during the decommissioning process. As a result, a post-decommissioning monitoring and management strategy is necessary to detect and reduce the dangers caused by leftover materials on the seafloor. The cost of a post-

decommissioning monitoring programme (C_{postM}) is influenced by various parameters, including the size, type, and condition of the remains [15,51].

3. Levelized Cost of Energy Calculation

The Levelized Cost of Energy (LCOE) is a value used to evaluate the costs of energy from various sources (e.g., wind, solar, natural gas). The LCOE is the proportion of the average cost at which the energy generated during the whole life of the wind project must be sold to perfectly meet all expenditures paid for a farm's construct, administration, and dismantling. It is computed as the ratio of the levelized cost of the wind project (CAPEX, OPEX, and DECOM) to the Annual Energy Production (AEP), which correspond to the total electricity generation during the wind project's lifespan [30]. It was assumed that the barge-type platform would operate for 3000 h per year.

$$LCOE = \frac{CAPEX + OPEX + DECOM}{AEP} \quad (25)$$

4. Case Study

The suggested entire life cost methodology is applied to a 2 MW barge-type floating wind turbine in this study, and the costs of various maintenance and end-of-life scenarios are examined. A barge-type floating wind tower consists of two sections: the lower section, which is 25 m long, and the upper section, which is 35 m long. The tower and the transition piece weigh a total of 133 tonnes (t) and 50 tonnes (t), respectively. The turbine in this instance is a Vestas 80 V 2 MW (40 m blade length). The floating foundation is a barge-type platform built of concrete and steel reinforcement that is 36 m wide, 9.5 m high, and 7.5 m draft with square-ring shape. The square-ring shape is known as a damping pool, and its dimensions are 20 × 20 m. Semi taut moorings are used. The floating platform is attached to the seabed by synthetic fibre-nylon ropes in this mooring technique. The rope's major advantage is that it does not corrode [13].

The system's mass distribution is shown in Table 2. It is demonstrated that the platform housing the mooring system exhibits the highest mass. The construction of the floating wind turbine platform primarily involves concrete and steel, while the mooring system is composed of steel, cast iron, polyurethane foam, and nylon fibres to ensure platform stability. The nacelle structure incorporates materials such as steel, aluminium, cast iron, glass fibre-reinforced plastic, and copper. Additionally, the rotor's blades are constructed using a combination of glass fibre-reinforced plastic and cast iron [13,52,53]. Moreover, the study also considers the recycling rates of various materials within the wind turbine components. Specifically, steel and cast iron are assumed to have a recycling rate of 85%, while copper and aluminium are expected to be recycled at a rate of 90%. Polyurethane foam, utilized in certain parts, is assumed to have a recycling rate of 80%, and nylon fibre, another constituent material, is assumed to be entirely recyclable, with a recycling rate of 100% [13].

Table 2. The barge-type floating wind turbine's mass distribution [13,54].

Components	Unit	Value
Rotor	ton	28.5
Nacelle	ton	64
Tower	ton	183
Platform	ton	5472.5

The purpose of this study is to examine the economic performance of various maintenance and end-of-life scenarios for the barge-type floating wind turbine. According to maintenance cost scenarios, there are two different ways of taking notice of these scenarios: on-site and off-site. Depending on the maintenance scenario, it is also planned to extend the life of the barge-type floating wind turbine to between 25 and 30 years through using strict maintenance strategies. In some of these scenarios, the replacement of parts like the

turbine's gearbox and blades is also taken into consideration. In the replacement of parts, in the field maintenance, the wind turbine is maintained and parts are replaced on-site where the wind turbine is working. In off-site replacement, the wind turbine is transported to the repair area on the shore with the help of tugboats, and after the parts replacement and maintenance performed there, it is taken back to the old working location. Each of the OPEX scenarios in Table 3 includes specifics on the types of maintenance areas, the number of prevention and unscheduled maintenance visits, the type of vehicle, and the replacement components. With regard to the decommissioning scenario, examining the decommissioning and recycling of wind turbines properly is another crucial component from an environmental and economic aspect [55,56]. A wind turbine will be taken out of service when it has reached its designated life expectancy (20–30 years), can no longer carry out its intended function owing to failure or material fatigue, or no longer satisfies the needs or expectations of the user [53,57]. To lessen their impact on the environment, materials from decommissioned wind turbines must be managed in accordance with the European Waste Framework Directive [49]. The Directive lists five fundamental principles for disposal: waste reduction, reuse (of components, etc.), recycling, incineration, and landfill. This study applied four different recycling scenarios in accordance with the disposal principle, and the useable materials recovered from the scenarios are turned into a financial benefit. In the most basic scenario, DECOM 1, all waste material is shipped to a landfill. In the case of glass fibre, it is first transported to the cutting process to be sliced into little pieces. Because turbine blades are large in size, they could be chopped to ease transit and minimise storage space. The DECOM 2 scenario is that glass fibre is employed in a mechanical recycling process as an end-of-life scenario. The leftover waste from the mechanical process is disposed of at a landfill. In the DECOM 3 scenario, after implementing cutting and mechanical procedures to treat the glass fibre, the waste from all these processes is burned. As a result of this scenario, ash is conveyed to a landfill for safekeeping. After cutting the glass fibre, the incineration procedure is carried out in the DECOM 4 scenario. This combustion process produces a considerable quantity of heat and ash. The ash produced by the incineration process is disposed of in a landfill. Furthermore, Table 4 summarizes all DECOM scenarios in each process. The LCOE has been calculated for each scenario, taking into account the costs calculated by considering the maintenance and disposal scenarios, the materials used in both scenarios, labour, the usage of new components, the scrapping of materials, and the equipment used in these scenarios.

Table 3. Details of OPEX scenarios.

Scenario Name	Place of Maintenance Scenarios	Prevention Maintenance and Inspections (Year)	Unscheduled Maintenance (Year)	Lifetime of the Wind Turbine (Year)	Vehicles Used	Components Replaced
OPEX 1	On-site	12	1	20	Workboat	-
OPEX 2	On-site	12	1	25	Workboat and mother vessel	Gearbox
OPEX 3	On-site	12	1	25	Workboat and mother vessel	Gearbox and blades
OPEX 4	On-site	12	1	30	Workboat and mother vessel	Gearbox and blades
OPEX 5	Off-site	12	1	25	Workboat, crane, and tugboats	Gearbox
OPEX 6	Off-site	12	1	30	Workboat, crane, and tugboats	Gearbox and blades

Table 4. Details of DECOM scenarios.

Scenario Name	First Process	Second Process	Third Process	Last Process
DECOM 1	Cutting	-	-	Landfill
DECOM 2	Cutting	Mechanical recycling	-	Landfill
DECOM 3	Cutting	Mechanical recycling	Incineration	Landfill
DECOM 4	Cutting	Incineration	-	Landfill

5. Results and Discussion

In this paper, a life cycle cost analysis method for barge-type floating wind turbines was proposed, and then, the high-costs components of the barge-type floating wind turbine development were identified and analysed in detail. The cost components can be categorized into three groups: capital expenditure (CAPEX), operation and maintenance (OPEX), and decommissioning and disposal (DECOM).

The cost distribution of cost elements, as well as their contribution to the total CAPEX cost of the barge-type floating wind turbine, is reported in Table 5. The capital expenditure is composed of the P&C, P&A, and I&C project phases, with a total cost of around £5.402 m. It has been determined that the production and acquisition (P&A) phase accounted for about 62.67% of the total CAPEX cost, which was expended via the purchase of wind turbines, foundations, and electrical equipment. According to the findings, the wind turbine and support structures made the largest contributions, accounting for 26.23% and 24.67%, respectively, of the total CAPEX. The predevelopment and consenting cost were relatively less than other cost elements. Moreover, 15.02% of costs covered contingencies, project management, engineering work, surveys, and other elements. The highest cost among them was incurred by contingencies, i.e., 9.23% of total CAPEX costs.

Table 5. CAPEX of the barge-type floating wind turbine.

Cost Element	Cost (£)	Contribution of Phase (%)	Contribution of CAPEX (%)
Project Management (C_{projM})	166,896	20.57%	3.09%
Legal Authorizing (C_{legal})	65,842	8.12%	1.22%
Surveys ($C_{surveys}$)	75,556	9.31%	1.40%
Engineering Activities (C_{eng})	4510	0.56%	0.08%
Contingencies ($C_{contingency}$)	498,472	61.44%	9.23%
Predevelopment and Consenting (P&C)	811,276	100%	15.02%
Support Structures (C_{SS})	1,332,662	39.36%	24.67%
Wind Turbines (C_{WT})	1,417,041	41.85%	26.23%
Power Transmission Systems (C_{PTS})	625,914	18.48%	11.59%
Monitoring Systems ($C_{monitoring}$)	9888	0.29%	0.18%
Production and Acquisition (P&A)	3,385,505	100%	62.67%
Support Structures and Electrical Systems ($C_{I&C-comp}$)	58,756	4.87%	1.09%
Ports Charges (C_{port})	1,063,076	88.15%	19.68%
Commissioning Cost (C_{comm})	960	0.08%	0.02%
Insurance Cost ($C_{I&C-ins}$)	83,200	6.90%	1.54%
Installation and Commissioning (I&C)	1,205,992	100%	22.33%
CAPEX	5,402,773		

In the OPEX analysis, the costs of the various maintenance scenarios in Table 2 were computed, and their LCOE values for both the OPEX and the total cost phases were also calculated. Table 6 gives a full breakdown of the expenditures incurred throughout the operation and maintenance scenario phase, as well as their distribution. Following the analysis, it was indicated that transmission charge costs, which are paid to the local authority responsible for the national electrical grid, accounted for about 35 to 42% of the total operating expenses (OPEX). When the cost of operating expense (OPEX) scenarios are

taken into consideration, the OPEX 6 scenario has the highest overall cost, whilst the OPEX 1 scenario has the lowest. When the LCOE for OPEX scenarios is calculated, it is observed that OPEX 5 has the lowest value and OPEX 3 has the highest, at 16.89 £/MWh and 19.93 £/MWh, respectively, being the lowest and highest values in Figure 2. When the levelized cost of energy (LCOE) of the barge-type floating wind turbine is assessed, OPEX 6 has the lowest value. The most significant reason for this is the extension of the lifetime of the wind turbine to 30 years in maintenance scenario 6, which results in an increase in annual energy production and, as a consequence, a decrease in the cost per megawatt-hour generated.

Table 6. OPEX of the barge-type floating wind turbine.

Scenario Name and Cost Element for OPEX	Cost (£)	% Contribution	LCOE for OPEX ¹ (£/MWh)	Total LCOE (£/MWh)
C_{rent}	46,740	2.15%	0.388	
$C_{O\&M-ins}$	174,610	8.04%	1.452	
$C_{transmission}$	860,700	39.67%	7.168	
$C_{M-indirect}$	390,000	17.97%	3.247	
C_{ProM}	376,200	17.34%	3.133	
C_{CM}	321,100	14.80%	2.674	
Total OPEX 1	2,169,350	100%	18.07	66.73
C_{rent}	58,425	2.17%	0.389	
$C_{O\&M-ins}$	218,262.5	8.11%	1.454	
$C_{transmission}$	1,075,875	40.00%	7.172	
$C_{M-indirect}$	487,500	18.12%	3.248	
C_{ProM}	448,100	16.66%	2.987	
C_{CM}	401,375	14.92%	2.675	
Total OPEX 2	2,689,537.5	100%	17.93	56.85
C_{rent}	58,425	1.95%	0.388	
$C_{O\&M-ins}$	218,262.5	7.30%	1.454	
$C_{transmission}$	1,075,875	35.98%	7.170	
$C_{M-indirect}$	487,500	16.30%	3.248	
C_{ProM}	748,100	25.02%	4.986	
C_{CM}	401,375	13.42%	2.674	
Total OPEX 3	2,989,537.5	100%	19.93	58.85
C_{rent}	70,110	2.03%	0.387	
$C_{O\&M-ins}$	261,915	7.61%	1.452	
$C_{transmission}$	1,291,050	37.55%	7.168	
$C_{M-indirect}$	58,5000	17.01%	3.247	
C_{ProM}	748,100	21.76%	4.153	
C_{CM}	481,650	14.01%	2.674	
Total OPEX 4	3,437,825	100%	19.09	51.54
C_{rent}	58,425	2.30%	0.388	
$C_{O\&M-ins}$	218,262.5	8.61%	1.454	
$C_{transmission}$	1,075,875	42.46%	7.171	
$C_{M-indirect}$	487,500	19.24%	3.249	
C_{ProM}	292,100	11.52%	1.945	
C_{CM}	401,375	15.84%	2.675	
Total OPEX 5	2,533,537.5	100%	16.89	55.81
C_{rent}	70,110	2.13%	0.388	
$C_{O\&M-ins}$	261,915	7.98%	1.454	
$C_{transmission}$	1,291,050	39.33%	7.169	
$C_{M-indirect}$	585,000	17.82%	3.248	
C_{ProM}	592,100	18.04%	3.288	
C_{CM}	481,650	14.67%	2.674	
Total OPEX 6	3,281,825	100%	18.23	50.67

¹ Weighted-average cost of capital is assumed to be 2.72%.

This study handled four different end-of-life scenarios for barge-type floating wind turbine materials and determined their DECOM and LCOE. Table 7 reports all of the expenditures incurred throughout the end-of-life scenarios phase, as well as the LCOE contribution of each scenario. When considering the cost of the decommissioning and disposal (DECOM) scenarios, the DECOM 3 scenario has the greatest overall cost, whereas the DECOM 4 scenario has the lowest. In addition, in the incineration scenario (DECOM 4), which has the lowest cost, the cost of the equipment used is lower than in mechanical recycling, and in the mechanical process, more cutting is used to send the parts to mechanical recycling. But in the incineration process, there are fewer cutting processes than in mechanical recycling, resulting in lower costs. The high cost of the DECOM 3 scenario is due to the fact that two different processes are used in this end-of-life scenario, namely mechanical and incineration, and the transfer of waste material between these processes incurs additional transportation costs. In comparison to incineration, mechanical recycling is more expensive. Mechanical recycling is only practicable with composite materials, and the amount of material used for mechanical processing represents only a very small percentage when compared to other components of the wind turbine. When comparing the LCOE values of the decommissioning and disposal (DECOM) scenarios, the difference between the largest and smallest LCOEs was reported to be quite small, at 3.693 £/MWh and 3.647 £/MWh, respectively, in Figure 3.

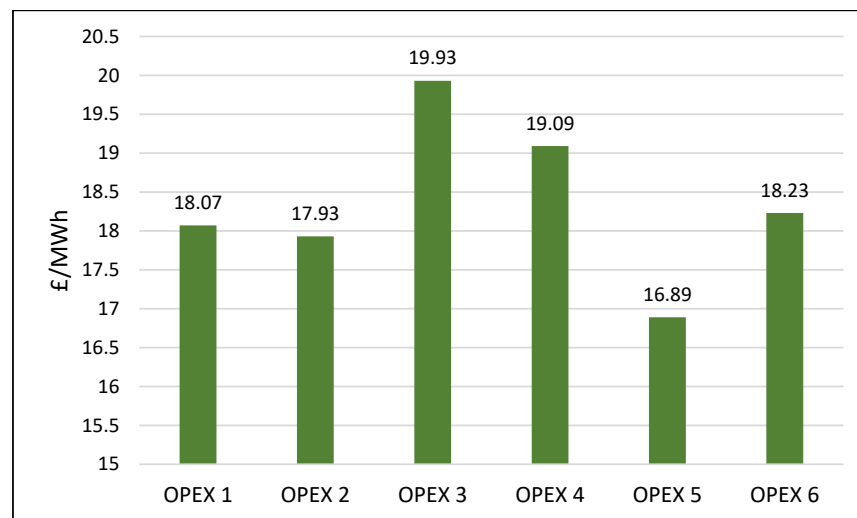


Figure 2. OPEX results for the barge-type floating wind turbine.

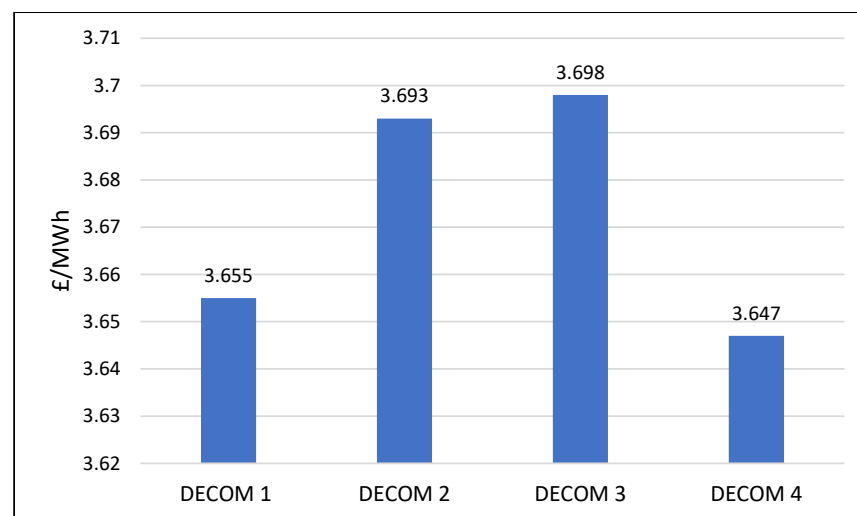


Figure 3. DECOM results for the barge-type floating wind turbine.

Table 7. DECOM of the barge-type floating wind turbine.

Scenario Names and Cost Element for DECOM	Cost (£)	% Contribution	LCOE for DECOM ¹ (£/MWh)
$C_{D\&D-port}$	99,278	22.63%	0.827
C_{remove}	729,190.8	166.23%	6.075
C_{WM}	−407,008	−92.78%	−3.391
C_{postM}	17,178	3.91%	0.142
Total DECOM 1	438,638.8	100%	3.655
$C_{D\&D-port}$	99,278	22.40%	0.827
C_{remove}	729,190.8	164.53%	6.076
C_{WM}	−402,462.775	−90.81%	−3.353
C_{postM}	17,178	3.87%	0.142
Total DECOM 2	443,184.025	100%	3.693
$C_{D\&D-port}$	99,278	22.37%	0.827
C_{remove}	729,190.8	164.31%	6.076
C_{WM}	−401,870.05	−90.55%	−3.348
C_{postM}	17,178	3.87%	0.143
Total DECOM 3	443,776.75	100%	3.698
$C_{D\&D-port}$	99,278	22.68%	0.8271
C_{remove}	729,190.8	166.58%	6.075
C_{WM}	−407,917.4	−93.18%	−3.398
C_{postM}	17,178	3.92%	0.142
Total DECOM 4	437,729.4	100%	3.647

¹ Weighted-average cost of capital is assumed to be 2.72%.

6. Conclusions

In this study, LCC, LCOE, OPEX, and DECOM have been analysed to evaluate the economic performance of a barge-type floating wind turbine. These analyses include a detailed examination of the costs and energy generation costs over the project's lifetime. Different scenarios involving operation and maintenance (OPEX) and end-of-life and disposal (DECOM) phases of the wind turbine have been investigated, and the results of these scenarios have been compared. The OPEX scenarios include on-site and off-site maintenance requirements at different durations (20 to 30 years) over the lifetime of the wind turbine. The DECOM scenarios examined the processes to be followed at the end of the lifetime of the wind turbine, including landfill, mechanical, mechanical and incineration and incineration processes. In light of the results of this study, the following conclusions were reached:

- Based on the findings of the total operating expenses scenarios and whole LCOE results, the OPEX scenario that includes off-site maintenance and a wind turbine lifetime of 30 years, is the most cost-effective (£/MWh). The main reasons for this result are that the rental costs of the equipment used for on-site maintenance (motherships, etc.) are higher than those used for onshore maintenance, and sea conditions (wind, weather, etc.) increase the duration of on-site maintenance.
- In terms of decommissioning and disposal scenarios, the incineration scenario was found to contribute the least to DECOM's LCOE compared to the other scenarios. However, increasing the recycling rate in the mechanical process and reducing the cost per tonne of the process could lead to a scenario with a lower LCOE.
- The lowest cost alternatives are OPEX 6 for maintenance and DECOM 4 for end-of-life, according to the total cost analysis. The total LCOE of these two scenarios is calculated at £50.66/MWh. Compared to the baseline scenario, a cost reduction of approximately 24.08% was achieved with these two scenarios.

This study has made a substantial contribution to determining the best cost-effective offshore wind energy generation strategies. This study contributes significantly to the identification of economically efficient ways for offshore wind power generation. These

studies provide ideas for providing energy that is both inexpensive and sustainable in the energy business.

Author Contributions: Conceptualization, N.Y.; methodology, N.Y.; software, N.Y.; validation, N.Y.; formal analysis, N.Y.; investigation, N.Y.; resources, N.Y.; data curation, N.Y.; writing—original draft preparation, N.Y.; writing—review and editing, N.Y., H.H. and C.B.; visualization, N.Y. All authors have read and agreed to the published version of the manuscript.

Funding: This research received no external funding.

Data Availability Statement: Data are included in the paper, and no further data are stored anywhere.

Acknowledgments: The authors acknowledge with thanks the Ministry of Education of Turkey and COST Action 20109 MODENERLANDS for their support to this research work.

Conflicts of Interest: The authors declare no conflicts of interest.

References

1. Salah Alaloul, W.; Ali Musarat, M. Impact of Zero Energy Building: Sustainability Perspective. In *Sustainable Sewage Sludge Management and Resource Efficiency*; IntechOpen: Rijeka, Croatia, 2020.
2. Alsubal, S.; Alaloul, W.S.; Shawn, E.L.; Liew, M.S.; Palaniappan, P.; Musarat, M.A. Life Cycle Cost Assessment of Offshore Wind Farm: Kudat Malaysia Case. *Sustainability* **2021**, *13*, 7943. [CrossRef]
3. Kucaj, E.; Susaj, E.; Qaja, B. Renewable Energy—A Great Energizing Potential that Eliminates Environmental Pollution. *Eur. J. Econ. Bus. Stud.* **2017**, *9*, 40–45. [CrossRef]
4. Wang, C.M.; Utsunomiya, T.; Wee, S.C.; Choo, Y.S. The IES Journal Part A: Civil & Structural Engineering Research on Floating Wind Turbines: A Literature Survey. *Science (1979). IES J. Part A Civ. Struct. Eng.* **2010**, *3*, 267–277.
5. IRENA Insights on Renewables: Installed Capacity Trends. 2022. Available online: <https://www.irena.org/Data> (accessed on 10 January 2024).
6. Pantusa, D.; Francone, A.; Tomasicchio, G.R. Floating Offshore Renewable Energy Farms. A Life-Cycle Cost Analysis at Brindisi, Italy. *Energies* **2020**, *13*, 6150. [CrossRef]
7. European Commission. *An EU Strategy to Harness the Potential of Offshore Renewable Energy for a Climate Neutral Future*; European Commission: Brussels, Belgium, 2020.
8. GWEC Global Wind Report 2019. 2020. Available online: <https://gwec.net>. (accessed on 20 January 2023).
9. IRENA Offshore Renewables: An Action Agenda for Deployment. 2021. Available online: <https://www.irena.org/Publications/2021/Jul/Offshore-Renewables-An-Action-Agenda-for-Deployment> (accessed on 10 May 2022).
10. Viselli, A.M.; Goupee, A.J.; Dagher, H.J. Model Test of a 1:8-Scale Floating Wind Turbine Offshore in the Gulf of Maine. *J. Offshore Mech. Arct. Eng.* **2015**, *137*. [CrossRef]
11. Liu, Z.; Fan, Y.; Wang, W.; Qian, G. Numerical Study of a Proposed Semi-Submersible Floating Platform with Different Numbers of Offset Columns Based on the DeepCwind Prototype for Improving the Wave-Resistance Ability. *Appl. Sci.* **2019**, *9*, 1255. [CrossRef]
12. Liu, Y.; Ishihara, T. Numerical Study on Sectional Loads and Structural Optimization of an Elastic Semi-Submersible Floating Platform. *Energies* **2021**, *14*, 182. [CrossRef]
13. Yildiz, N.; Hemida, H.; Baniotopoulos, C. Life Cycle Assessment of a Barge-Type Floating Wind Turbine and Comparison with Other Types of Wind Turbines. *Energies* **2021**, *14*, 5656. [CrossRef]
14. Fuller, S.K.; Petersen, S.R. Life-Cycle Costing Manual of the US Federal Energy Management Program 1995. In *NIST Handbook*; US Department of Energy: Gaithersburg, MD, USA, 1996; p. 135.
15. Shafiee, M.; Brennan, F.; Espinosa, I.A. A parametric whole life cost model for offshore wind farms. *Int. J. Life Cycle Assess.* **2016**, *21*, 961–975. [CrossRef]
16. Maienza, C.; Avossa, A.M.; Ricciardelli, F.; Scherillo, F.; Georgakis, C.T. A Comparative Analysis of Construction Costs of Onshore and Shallow- and Deep-Water Offshore Wind Farms. In *Lecture Notes in Civil Engineering*; Springer: Berlin/Heidelberg, Germany, 2019; Volume 25, pp. 440–453.
17. Blanco, M.I. The Economics of Wind Energy. *Renew. Sustain. Energy Rev.* **2009**, *13*, 1372–1382. [CrossRef]
18. Ioannou, A.; Angus, A.; Brennan, F. Parametric CAPEX, OPEX, and LCOE expressions for offshore wind farms based on global deployment parameters. *Energy Sources Part B Econ. Plan. Policy* **2018**, *13*, 281–290. [CrossRef]
19. Laura, C.-S.; Vicente, D.-C. Life-cycle cost analysis of floating offshore wind farms. *Renew. Energy* **2014**, *66*, 41–48. [CrossRef]
20. Topham, E.; McMillan, D. Sustainable decommissioning of an offshore wind farm. *Renew. Energy* **2017**, *102*, 470–480. [CrossRef]
21. Madariaga, A.; De Alegría, I.M.; Martín, J.L.; Eguía, P.; Ceballos, S. Current Facts about Offshore Wind Farms. *Renew. Sustain. Energy Rev.* **2012**, *16*, 3105–3116. [CrossRef]
22. Mekhilef, S.; Safari, A.; Chandrasegaran, D. Feasibility Study of Off-Shore Wind Farms in Malaysia. *Energy Educ. Sci. Technol. Part A Energy Sci. Res.* **2012**, *28*, 519–530.

23. Ibrahim, M.; Albani, A. The Potential of Wind Energy in Malaysian Renewable Energy Policy: Case Study in Kudat, Sabah. *Energy Environ.* **2014**, *25*, 881–898. [[CrossRef](#)]
24. Nian, V.; Liu, Y.; Zhong, S. Life cycle cost-benefit analysis of offshore wind energy under the climatic conditions in Southeast Asia – Setting the bottom-line for deployment. *Appl. Energy* **2018**, *233*, 1003–1014. [[CrossRef](#)]
25. Mytilinou, V.; Kolios, A.J. Techno-economic optimisation of offshore wind farms based on life cycle cost analysis on the UK. *Renew. Energy* **2019**, *132*, 439–454. [[CrossRef](#)]
26. Junginger, M.; Faaij, A.; Turkenburg, W.C. Cost Reduction Prospects for Offshore Wind Farms. *Wind. Eng.* **2004**, *28*, 97–118. [[CrossRef](#)]
27. Valpy, B.; Hundleby, G.; Freeman, K.; Roberts, A.; Logan, A. *Future Renewable Energy Costs: Offshore Wind*; BVG Associates, Inno Energy: Swindon, UK, 2017.
28. McAuliffe, F.D.; Murphy, J.; Lynch, K.; Desmond, C.; Norbeck, J.A.; Nonås, L.M.; Attari, Y.; Doherty, P.; Sorensen, J.D.; Giebardt, J.; et al. *Driving Cost Reductions in Offshore Wind: The Leanwind Project Final Publication*; Driving Cost Reduction on Offshore Wind; Leanwind: Brussels, Belgium, 2017; p. 72.
29. Darwish, A.S. Floating Offshore Wind Technology Development: Current State and Future Vision. In *Sustainable Energy Development and Innovation: Selected Papers from the World Renewable Energy Congress (WREC) 2020*; Springer International Publishing: Berlin/Heidelberg, Germany, 2022; pp. 651–659. [[CrossRef](#)]
30. Ebenhoch, R.; Matha, D.; Marathe, S.; Muñoz, P.C.; Molins, C. Comparative Levelized Cost of Energy Analysis. *Proc. Energy Procedia* **2015**, *80*, 108–122. [[CrossRef](#)]
31. Rinne, E.; Holttinen, H.; Kiviluoma, J.; Rissanen, S. Effects of turbine technology and land use on wind power resource potential. *Nat. Energy* **2018**, *3*, 494–500. [[CrossRef](#)]
32. Cavazzi, S.; Dutton, A. An Offshore Wind Energy Geographic Information System (OWE-GIS) for assessment of the UK's offshore wind energy potential. *Renew. Energy* **2016**, *87*, 212–228. [[CrossRef](#)]
33. Hdidouan, D.; Staffell, I. The impact of climate change on the levelised cost of wind energy. *Renew. Energy* **2017**, *101*, 575–592. [[CrossRef](#)]
34. Kaiser, M.J.; Snyder, B.F. Offshore Wind Energy Cost Modeling: Installation and Decommissioning. *Green Energy Technol.* **2012**, *85*, 135–154.
35. Nilsson, J.; Bertling, L. Maintenance Management of Wind Power Systems Using Condition Monitoring Systems—Life Cycle Cost Analysis for Two Case Studies. *IEEE Trans. Energy Convers.* **2007**, *22*, 223–229. [[CrossRef](#)]
36. Judge, F.; McAuliffe, F.D.; Sperstad, I.B.; Chester, R.; Flannery, B.; Lynch, K.; Murphy, J. A lifecycle financial analysis model for offshore wind farms. *Renew. Sustain. Energy Rev.* **2019**, *103*, 370–383. [[CrossRef](#)]
37. Myhr, A.; Bjerkseter, C.; Ågotnes, A.; Nygaard, T.A. Levelised cost of energy for offshore floating wind turbines in a life cycle perspective. *Renew. Energy* **2014**, *66*, 714–728. [[CrossRef](#)]
38. Baita-Saavedra, E.; Cordal-Iglesias, D.; Filgueira-Vizoso, A.; Castro-Santos, L. Economic Aspects of a Concrete Floating Offshore Wind Platform in the Atlantic Arc of Europe. *Int. J. Environ. Res. Public Health* **2019**, *16*, 4122. [[CrossRef](#)] [[PubMed](#)]
39. Maienza, C.; Avossa, A.; Ricciardelli, F.; Coiro, D.; Troise, G.; Georgakis, C. A life cycle cost model for floating offshore wind farms. *Appl. Energy* **2020**, *266*, 114716. [[CrossRef](#)]
40. Levitt, A.C.; Kempton, W.; Smith, A.P.; Musial, W.; Firestone, J. Pricing offshore wind power. *Energy Policy* **2011**, *39*, 6408–6421. [[CrossRef](#)]
41. Castro-Santos, L.; Martins, E.; Soares, C.G. Methodology to Calculate the Costs of a Floating Offshore Renewable Energy Farm. *Energies* **2016**, *9*, 324. [[CrossRef](#)]
42. Effiom, S.; Nwankwojike, B.; Abam, F. Economic cost evaluation on the viability of offshore wind turbine farms in Nigeria. *Energy Rep.* **2016**, *2*, 48–53. [[CrossRef](#)]
43. TTavner, P. *Offshore Wind Turbines Reliability, Availability and Maintenance*; The Institution of Engineering and Technology: London, UK, 2012. [[CrossRef](#)]
44. Maples, B.; Saur, G.; Hand, M.; Pietermen, R.; van Obdam, T. *Installation, Operation, and Maintenance Strategies to Reduce the Cost of Offshore Wind Energy*; Technical Report Nrel/Tp-5000-57403; National Renewable Energy Lab. (NREL): Golden, CO, USA, 2013.
45. Dinmohammadi, F.; Shafiee, M. A Fuzzy-FMEA Risk Assessment Approach for Offshore Wind Turbines. *Int. J. Progn. Health Manag.* **2013**, *4*, 59–68. [[CrossRef](#)]
46. Ahn, D.; Shin, S.-C.; Kim, S.-Y.; Kharoufi, H.; Kim, H.-C. Comparative evaluation of different offshore wind turbine installation vessels for Korean west-south wind farm. *Int. J. Nav. Arch. Ocean Eng.* **2017**, *9*, 45–54. [[CrossRef](#)]
47. Kang, J.; Sobral, J.; Soares, C.G. Review of Condition-Based Maintenance Strategies for Offshore Wind Energy. *J. Mar. Sci. Appl.* **2019**, *18*, 1–16. [[CrossRef](#)]
48. Ren, Z.; Verma, A.S.; Li, Y.; Teuwen, J.J.; Jiang, Z. Offshore wind turbine operations and maintenance: A state-of-the-art review. *Renew. Sustain. Energy Rev.* **2021**, *144*, 110886. [[CrossRef](#)]
49. European Council Directive 2008/98/EC on Waste (Waste Framework Directive)—Environment—European Commission. *Off. J. Eur. Union* **2008**, *312*, 6–36.
50. Topham, E.; McMillan, D.; Bradley, S.; Hart, E. Recycling offshore wind farms at decommissioning stage. *Energy Policy* **2019**, *129*, 698–709. [[CrossRef](#)]

51. James Floating Offshore Wind: Installation, Operation & Maintenance Challenges. Available online: <https://blackfishengineering.com/2020/07/29/floating-offshore-wind-installation-operation-maintenance-challenges/> (accessed on 10 November 2023).
52. Yildiz, N.; Hemida, H.; Baniotopoulos, C. Floating Versus Offshore Wind Turbines: A Comparative Life Cycle Assessment. In *Proceedings of the CESARE Conference Publications*; University of Birmingham: Birmingham, UK, 2022.
53. Yildiz, N.; Hemida, H.; Baniotopoulos, C. Maintenance and End-of-Life Analysis in LCA for Barge-Type Floating Wind Turbine. *Wind* **2022**, *2*, 246–259. [[CrossRef](#)]
54. Vargas, A.; Zenón, E.; Oswald, U.; Islas, J.; Güereca, L.; Manzini, F. Life cycle assessment: A case study of two wind turbines used in Mexico. *Appl. Therm. Eng.* **2015**, *75*, 1210–1216. [[CrossRef](#)]
55. Martínez, E.; Sanz, F.; Pellegrini, S.; Jiménez, E.; Blanco, J. Life cycle assessment of a multi-megawatt wind turbine. *Renew. Energy* **2009**, *34*, 667–673. [[CrossRef](#)]
56. Ortegon, K.; Nies, L.F.; Sutherland, J.W. Preparing for end of service life of wind turbines. *J. Clean. Prod.* **2013**, *39*, 191–199. [[CrossRef](#)]
57. Echavarria, E.; Hahn, B.; Van Bussel, G.J.W.; Tomiyama, T. Reliability of Wind Turbine Technology through Time. *J. Sol. Energy Eng.* **2008**, *130*, 031005. [[CrossRef](#)]

Disclaimer/Publisher’s Note: The statements, opinions and data contained in all publications are solely those of the individual author(s) and contributor(s) and not of MDPI and/or the editor(s). MDPI and/or the editor(s) disclaim responsibility for any injury to people or property resulting from any ideas, methods, instructions or products referred to in the content.