



Aalborg Universitet

AALBORG UNIVERSITY
DENMARK

Ultrasonic Reflectometry for Monitoring the Effect of Pressure on Sludge Fouling of MF Membranes

Jørgensen, Mads Koustrup; Kujundzic, Elmira; Greenberg, Alan

Publication date:
2014

Document Version
Early version, also known as pre-print

[Link to publication from Aalborg University](#)

Citation for published version (APA):

Jørgensen, M. K., Kujundzic, E., & Greenberg, A. (2014). Ultrasonic Reflectometry for Monitoring the Effect of Pressure on Sludge Fouling of MF Membranes. Poster session presented at ICOM 2014, Suzhou, China.

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- ? Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- ? You may not further distribute the material or use it for any profit-making activity or commercial gain
- ? You may freely distribute the URL identifying the publication in the public portal ?

Take down policy

If you believe that this document breaches copyright please contact us at vbn@aub.aau.dk providing details, and we will remove access to the work immediately and investigate your claim.

BACKGROUND


- Fouling layers formed during membrane filtration of activated sludge are compressible, which significantly reduces membrane performance [1].
- Surprisingly little information has been reported regarding the dynamics of such highly compressible fouling layers.
- Ultrasonic reflectometry (UR) is now a well-established technique that has been successfully used to quantify membrane fouling [2] by calcium sulfate [3], yeast [4], proteins [5] and biofilm [6] among other foulants.

OBJECTIVES

- Based on the advantages of real-time measurement [7], utilize UR for characterization of the fouling dynamics of municipal activated sludge on microfiltration (MF) membranes.
- Quantify the effect of pressure on the sludge fouling layer.

UR RESPONSE TO SLUDGE FOULING

- As expected, flux decreased with increased filtration time.
- Through the membrane compaction phase with DI water, UR amplitude reached a constant level after 10-h filtration.
- With subsequent addition of sludge, UR amplitude declined significantly.
- There was no significant difference between the degree of membrane fouling near the feed inlet (upstream) and retentate outlet (downstream).
- The degree of fouling can be appropriately represented by either the flux or UR amplitude response.

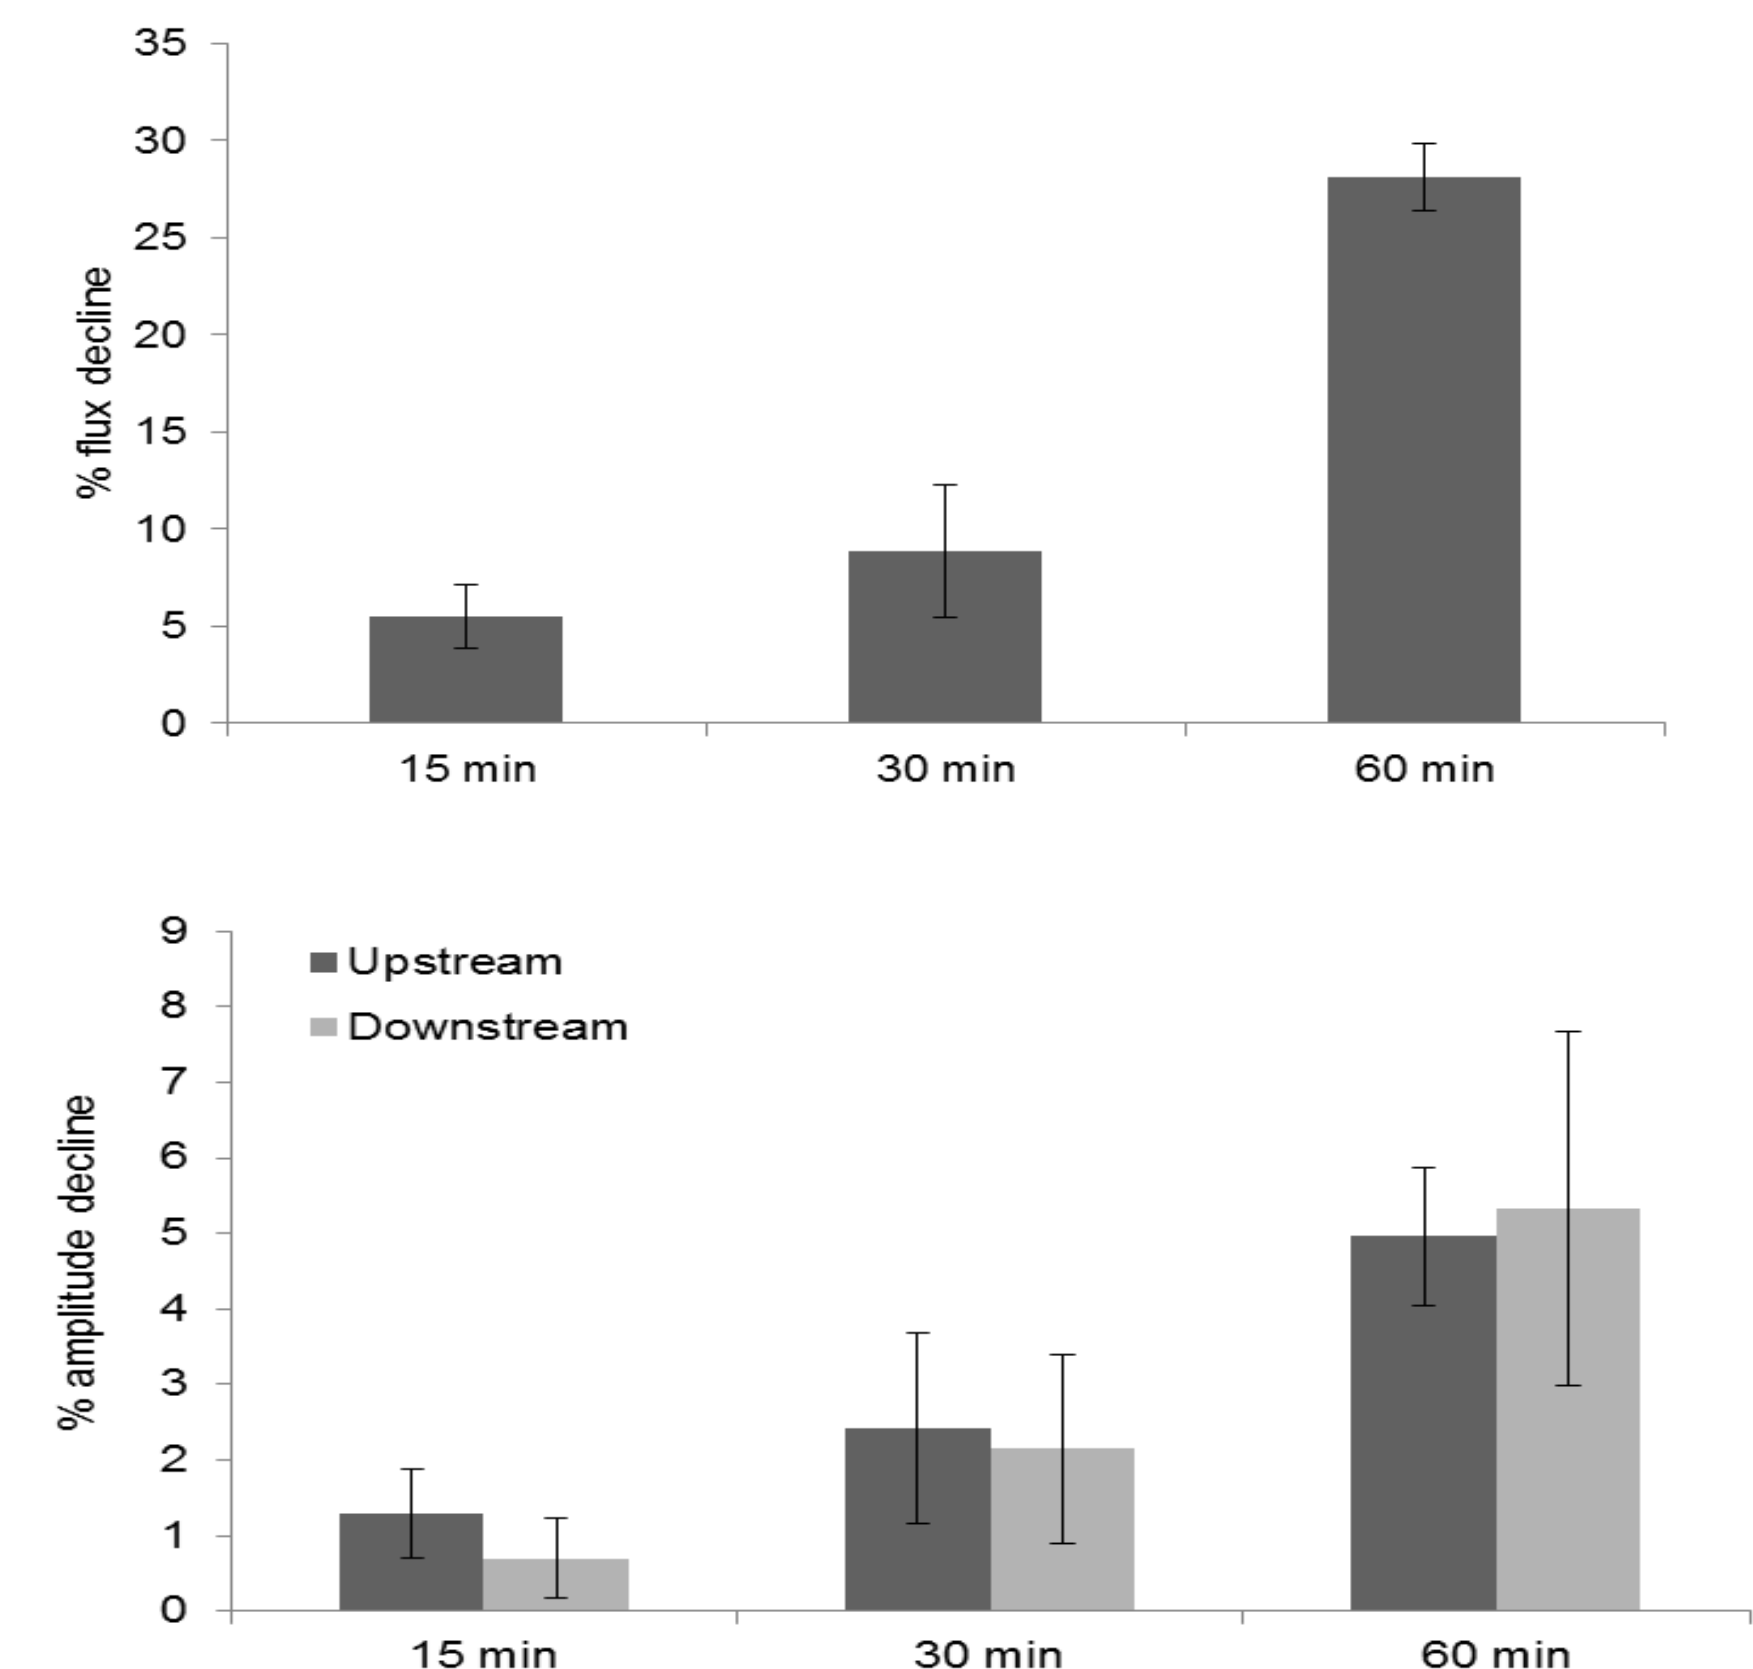

METHODOLOGY

Membrane System	Compaction Phase Duration	Diluted Sludge Concentration	Crossflow Velocity
Sidestream PVDF	15 h	0.2 g/L	0.085 m/s

Time-Series Experiments:


Constant-pressure sludge filtrations at 15 kPa for 15, 30 and 60 min to correlate the change in UR amplitude to the degree of fouling.

Constant-Pressure Experiments:

Constant-pressure sludge filtrations for 5 h at 15 and 25 kPa.


Pressure-Step Experiments:

Pressure-step experiments were performed by alternating pressures between 15 and 25 kPa.

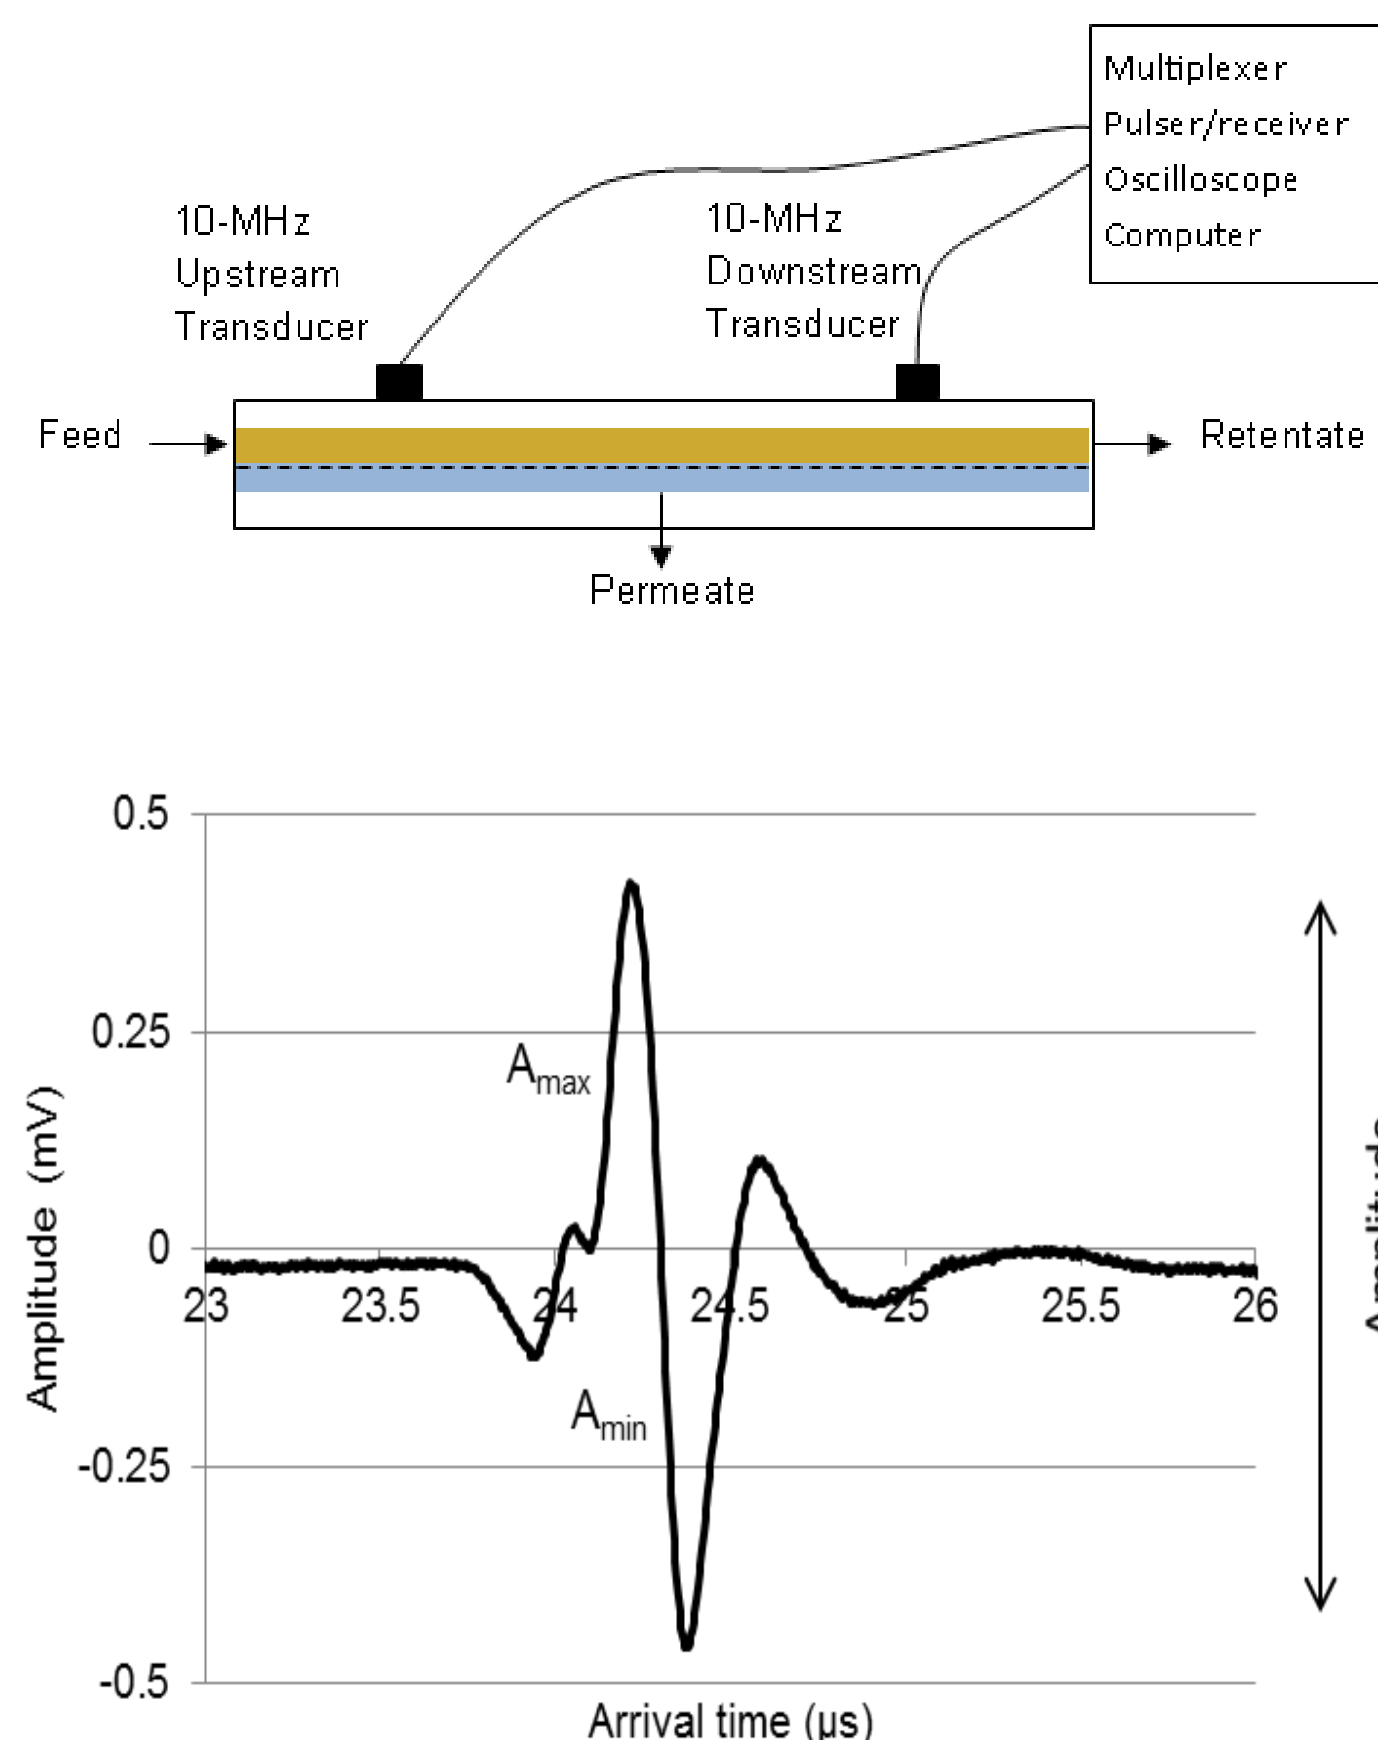

INFLUENCE OF PRESSURE

- UR results show that the reduction of amplitude is higher for the fouling layer formed at 15 than 25 kPa, although the fouling layer resistance is lower, i.e., $R_{f,15kPa} = 1.2 \pm 0.27 \times 10^{12} \text{ m}^{-1}$ vs. $R_{f,25kPa} = 2.1 \pm 0.33 \times 10^{12} \text{ m}^{-1}$.
- Pressure-step experiments show a similar trend where an increase in pressure generates higher hydraulic resistance and lower UR amplitude reduction.
- As pressure is released, cake resistance decreases and the UR amplitude reduction increases.

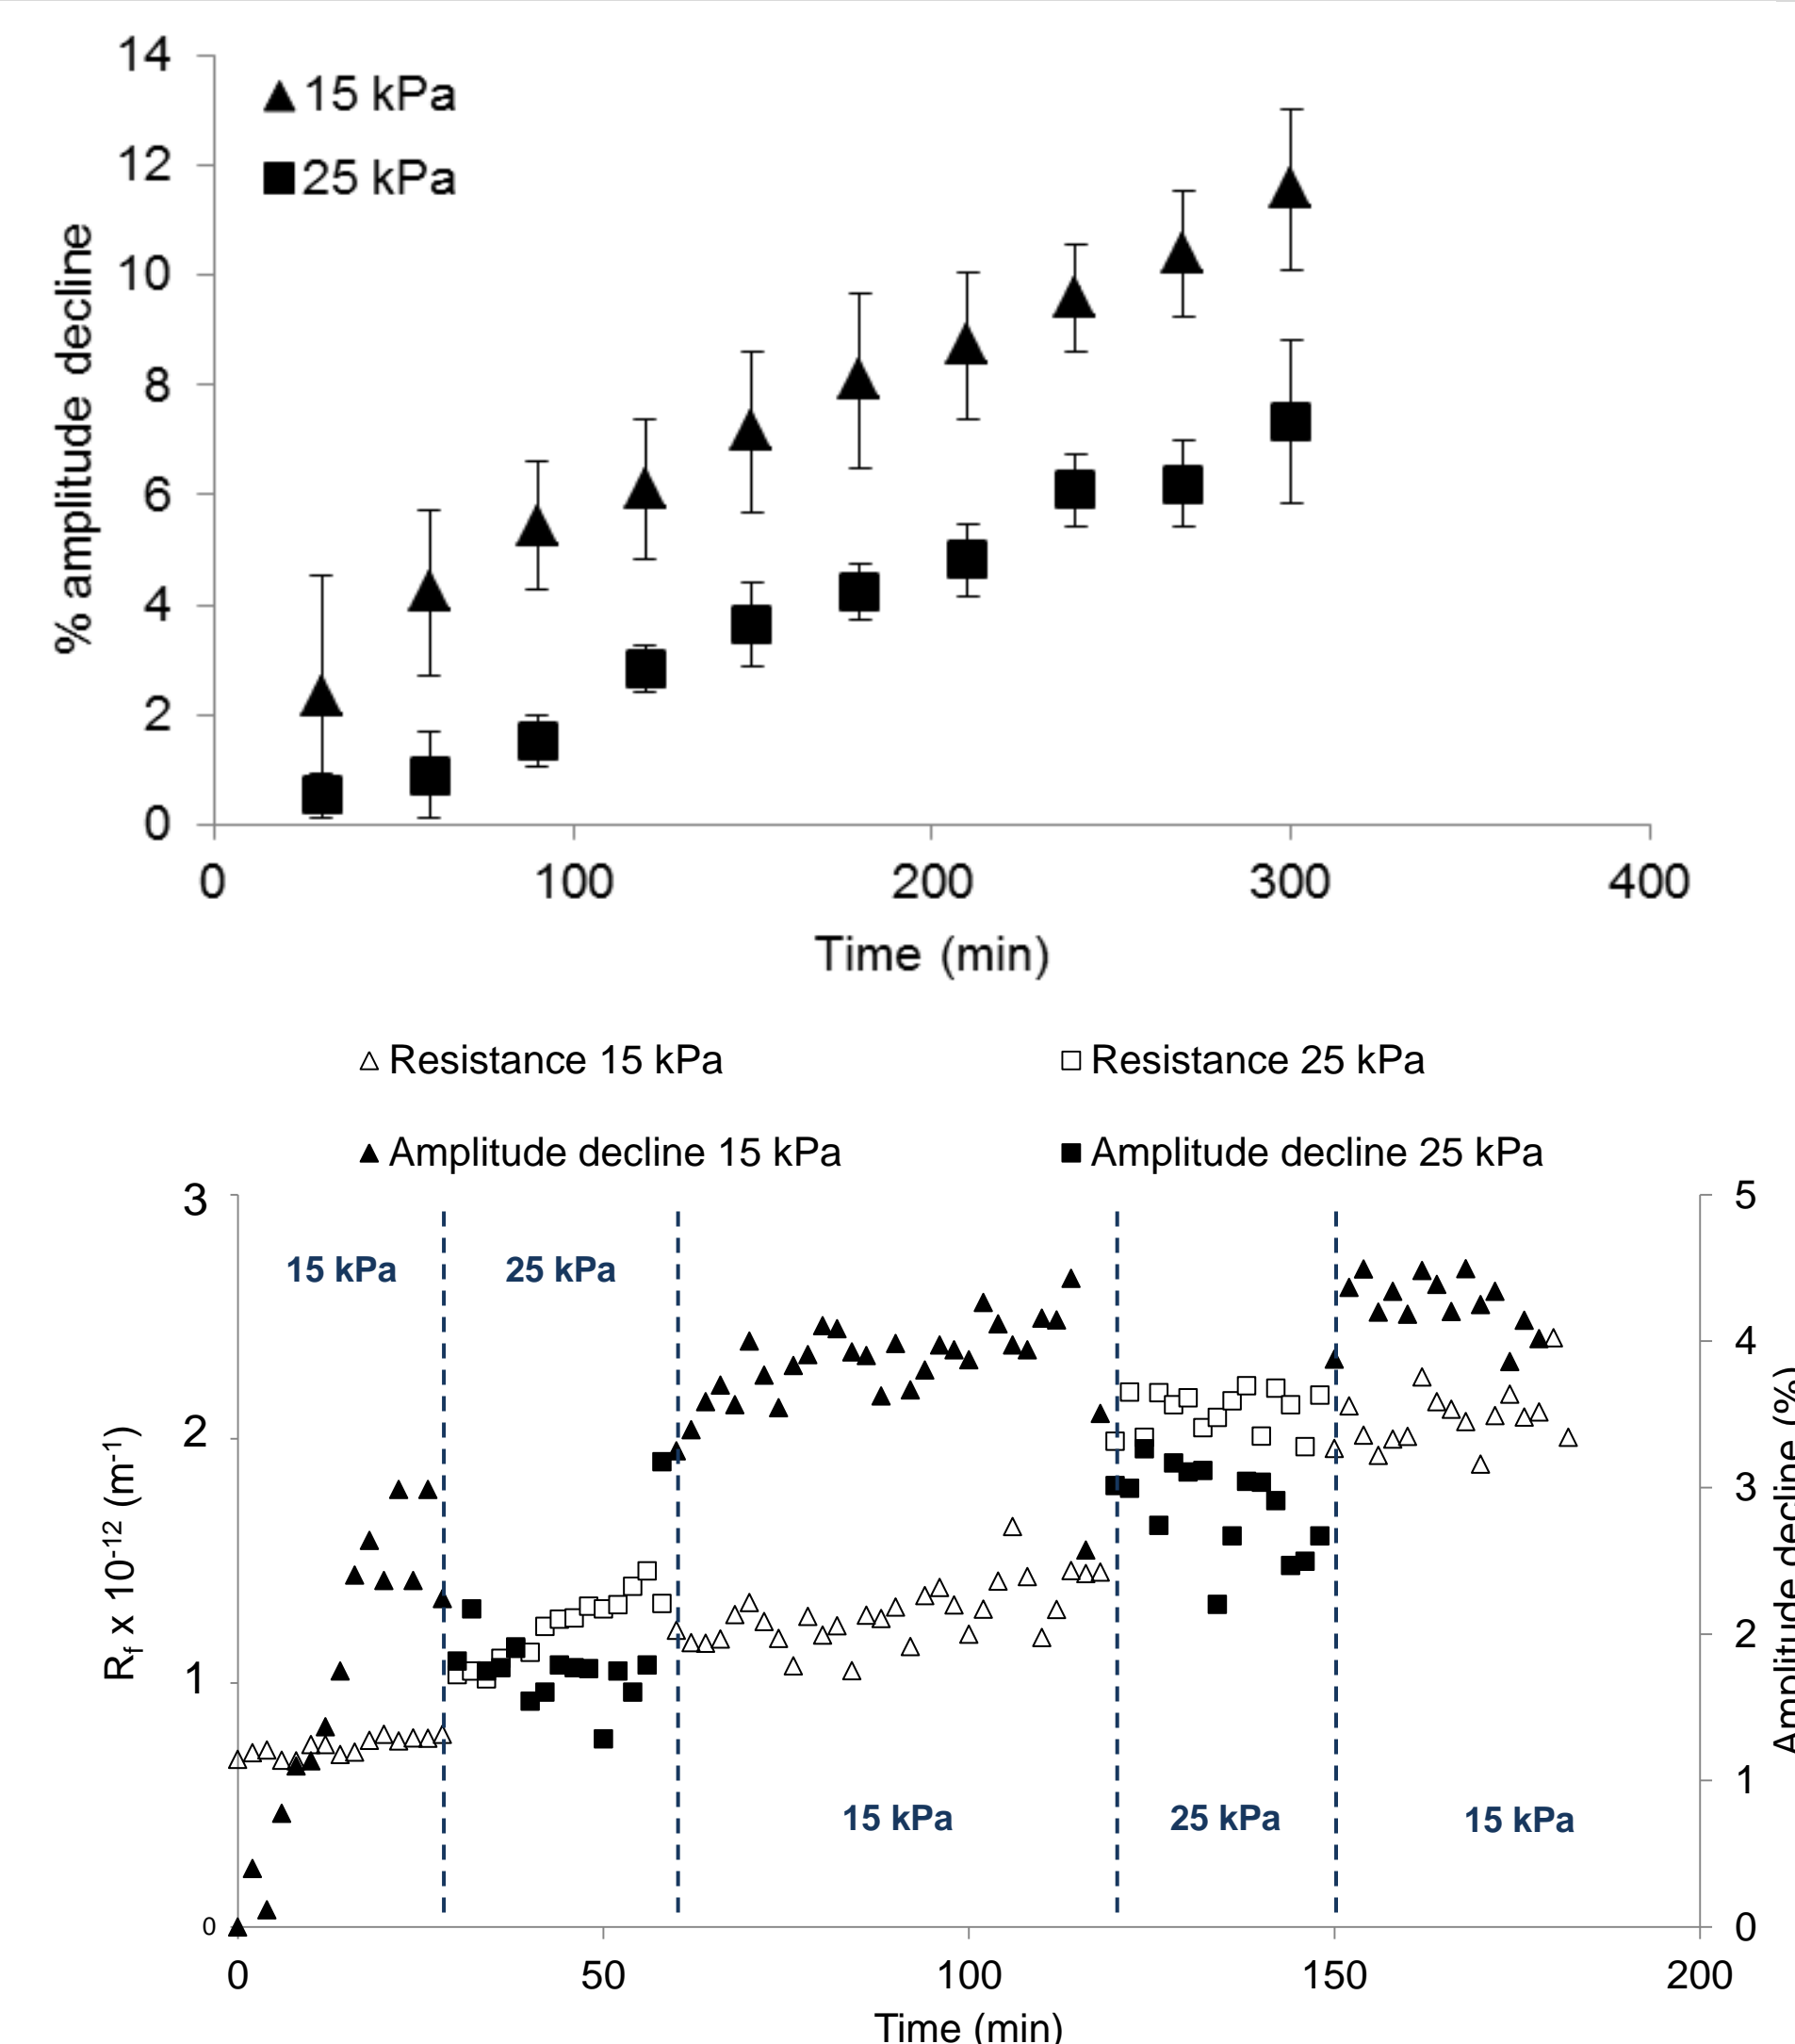

SIGNIFICANT FINDINGS

- Fouling of MF membranes with activated sludge was successfully monitored using ultrasonic reflectometry.
- At lower pressure, UR amplitude reduction is higher but fouling layer resistance is lower.
- Lower-pressure UR behavior is due to formation of a less-compacted fouling layer that provides better impedance matching, which in turn translates to higher signal attenuation layer as compared to that at high pressure.
- Pressure-step experiments indicate that the cake compression is partly reversible with cake swelling after the release of pressure.

ACKNOWLEDGEMENTS

This study is funded by The Royal Danish Academy of Sciences and Letters, Niels Bohr Foundation and the EcoDesign MBR strategic research center. We thank the Boulder Wastewater Treatment Facility for providing sludge for the experiments, and the Membrane Science, Engineering and Technology (MAST) Center at the University of Colorado at Boulder for technical assistance with ultrasonic reflectometry.

REFERENCES

- T.V. Bugge, M.K. Jørgensen, M.L. Christensen, K. Keiding, *Water Res.*, **46**, 4330-4338 (2012).
- E. Kujundzic, A.R. Greenberg, M. Peterson, *Desalination and Water Treatment*, **52**, 1217-1249 (2014).
- X.Y. Lu, E. Kujundzic, G. Mizrahi, J. Wang, K. Cobry, M. Peterson, J. Gilon, A. Greenberg, *J. Mem. Sci.*, **419**, 20-32 (2012).
- X.H. Li, J.X. Li, J. Wang, H.W. Zhang, Y.D. Pan, *J. Mem. Sci.*, **411**, 137-145 (2012).
- E. Kujundzic, A.R. Greenberg, R. Fong, B. Moore, D. Kujundzic, M. Hernandez, *J. Mem. Sci.*, **349**, 44-55 (2010).
- E. Kujundzic, A.C. Fonseca, E.A. Evans, M. Peterson, A.R. Greenberg, M. Hernandez, *J. Microbiol. Meth.*, **68**, 458-467 (2007).
- V. Chen, H. Li, A.G. Fane, *J. Mem. Sci.*, **241**, 23-44 (2004).