

ORNL/TM-12294/V4

ornl

OAK RIDGE
NATIONAL
LABORATORY

MARTIN MARIETTA

MANAGED BY
MARTIN MARIETTA ENERGY SYSTEMS, INC.
FOR THE UNITED STATES
DEPARTMENT OF ENERGY

**SCALE-4 Analysis of Pressurized Water
Reactor Critical Configurations:
Volume 4 – Three Mile Island
Unit 1 Cycle 5**

M. D. DeHart

This report has been reproduced directly from the best available copy.

Available to DOE and DOE contractors from the Office of Scientific and Technical Information, P.O. Box 62, Oak Ridge, TN 37831; prices available from (615) 576-8401.

Available to the public from the National Technical Information Service, U.S. Department of Commerce, 5285 Port Royal Rd., Springfield, VA 22161.

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

Computational Physics and Engineering Division

**SCALE-4 ANALYSIS OF PRESSURIZED WATER REACTOR CRITICAL
CONFIGURATIONS: VOLUME 4 – THREE MILE ISLAND UNIT 1 CYCLE 5**

M. D. DeHart

Date Completed: February 1995

Date Published: March 1995

Prepared under the direction of
Sandia National Laboratories
under Memorandum Purchase Orders 66-0162 and AD-4072
with Oak Ridge National Laboratory

Prepared by the
OAK RIDGE NATIONAL LABORATORY
managed by
MARTIN MARIETTA ENERGY SYSTEMS, INC.
for the
U.S. DEPARTMENT OF ENERGY
under contract DE-AC05-84OR21400

CONTENTS

	<u>Page</u>
LIST OF FIGURES	v
LIST OF TABLES	vi
ABSTRACT	vii
1. INTRODUCTION	1
2. OVERVIEW OF THE METHODOLOGY	3
2.1 FUEL ASSEMBLY GROUPS	5
2.2 DEPLETION CALCULATIONS	5
2.3 BURNUP-DEPENDENT NUCLIDE CONCENTRATIONS	8
2.4 SUBGROUP CROSS-SECTION PROCESSING	10
2.5 PREPARATION OF THE KENO V.a CORE MODEL	11
3. PREPARATION OF THE TMI-1 CORE MODEL	12
3.1 CORE DESCRIPTION	12
3.2 SAS2H ASSEMBLY GROUPS	16
3.3 SIMILAR-BURNUP SUBGROUPING	19
3.4 SAS2H DEPLETION CALCULATIONS	19
3.5 BURNUP-DEPENDENT INTERPOLATION OF ISOTOPICS	22
3.5.1 Assembly Isotopics	22
3.5.2 Subgroup Isotopics	24
3.6 GENERATION OF SUBGROUP CROSS SECTIONS USING CSASN	25
3.7 COMBINING SUBGROUP CROSS SECTIONS USING WAX	25
3.8 PREPARATION OF A KENO V.a CORE MODEL	27
3.8.1 KENO V.a Mixture Specifications	27
3.8.2 KENO V.a Geometry Specifications	28
4. RESULTS AND CONCLUSIONS	32
REFERENCES	36
APPENDIX A. SAS2H CASE INPUT EXAMPLE	39
APPENDIX B. SNIKR EXECUTION AND OUTPUT	43
B.1 Automated SNIKR Execution Script	44
B.2 Sample SNIKR Output - Assembly Calculation	45
B.3 Sample SNIKR Output - Subzone Calculation	48
B.4 SNIKR1 Source Listing	51
B.5 SNIKR3 Source Listing	65

APPENDIX C. SCALE CSASN-SEQUENCE INPUT LISTINGS	73
C.1 TMISUBZ1 Listing	74
C.2 TMISUBZ2 Listing	75
C.3 TMISUBZ3 Listing	76
APPENDIX D. WAX INPUT LISTING	77
APPENDIX E. KENO V.a INPUT LISTING	79

LIST OF FIGURES

<u>Figure</u>	<u>Page</u>
1. Overview of the reactor critical calculation procedure.	4
2. SAS2H burnup model of assemblies within a fuel group.	7
3. TMI Unit 1 configuration.	13
4. TMI Unit 1 assembly geometry.	13
5. One-eighth core representation of TMI Unit 1, BOC 5.	15
6. Dimensions of a partial control rod (APSR).	17
7. Full-core assembly positions and core former configuration.	29
8. Unit definitions based on assembly/core former component arrays.	30
9. KENO V.a relative fission density in TMI-1 one-eighth core.	33
10. Relative change in concentration for select fission products.	34

LIST OF TABLES

<u>Table</u>	<u>Page</u>
1. Nuclides updated by SAS2H	8
2. Set of fuel nuclides used in KENO V.a calculations	10
3. Three Mile Island Unit 1 fuel/assembly design	14
4. Assembly group data for BOC-5	18
5. Isotopic content of fresh fuel for 2.64 and 2.85 wt % enrichments	18
6. Light-element masses used in SAS2H calculations	19
7. Subgroup burnups for BOC-5	20
8. Fuel group burn model used in SAS2H	21
9. Fuel assembly data for one-eighth core geometry	23
10. Subgroups for one-eighth core assemblies	26
11. Mixture numbers used in KENO V.a core model	28
12. Unit numbers used in KENO V.a core model	31

ABSTRACT

The requirements of ANSI/ANS-8.1 specify that calculational methods for away-from-reactor criticality safety analyses be validated against experimental measurements. If credit is to be taken for the reduced reactivity of burned or spent fuel relative to its original "fresh" composition, it is necessary to benchmark computational methods used in determining such reactivity worth against spent fuel reactivity measurements. This report summarizes a portion of the ongoing effort to benchmark away-from-reactor criticality analysis methods using relevant and well-documented critical configurations from commercial pressurized water reactors.

The analysis methodology utilized for all calculations in this report is based on the modules and data associated with the SCALE-4 code system. Isotopic densities for spent fuel assemblies in the core were calculated using the SCALE-4 SAS2H analytical sequence. The sources of data and the procedures for deriving SAS2H input parameters are described in detail. The SNIKR code family was used to extract the necessary isotopic densities from SAS2H results and to provide the data in the format required for SCALE criticality analysis modules. The CSASN analytical sequence in SCALE-4 was used to perform resonance processing of cross sections. The KENO V.a module of SCALE-4 was used to calculate the effective multiplication factor (k_{eff}) for the critical configuration. The SCALE-4 27-group burnup library containing ENDF/B-IV (actinides) and ENDF/B-V (fission products) data was used for all calculations.

This volume of the report documents a reactor critical calculation for GPU Nuclear Corporation's Three Mile Island Unit 1 (TMI-1) during hot, zero-power startup testing for the beginning of cycle 5. This unit and cycle were selected because of their relevance in spent fuel benchmark applications: (1) cycle 5 startup occurred after an especially long downtime of 6.6 years; and (2) the core consisted primarily (75%) of burned fuel, with all fresh fuel loaded on the core outer periphery. A k_{eff} value of 0.9978 ± 0.0004 was obtained using two million neutron histories in the KENO V.a model. This result is close to the known critical k_{eff} of 1.0 for the actual core and is consistent with other mixed-oxide criticality benchmarks. Thus this method is shown to be valid for spent fuel applications in burnup credit analyses.

1. INTRODUCTION

In the past, criticality analysis of pressurized-water-reactor (PWR) fuel in storage or transport has assumed that the fuel is fresh with the maximum allowable initial enrichment. This assumption has led to the design of widely spaced and/or highly poisoned storage and transport arrays. If credit is assumed for fuel burnup, more compact and economical arrays can be designed. Such reliance on the reduced reactivity of spent fuel for criticality control is referred to as "burnup credit." If burnup credit is applied in the design of a cask for use in the transport of spent light-water-reactor (LWR) fuel to a repository, a significant reduction both in the cost of transport and in the risk to the public can be realized.¹ These benefits caused the U.S. Department of Energy (DOE) to initiate a program to investigate the technical issues associated with burnup credit in spent fuel cask design. These efforts have been led by Sandia National Laboratories (SNL) and carried out as part of the Cask Systems Development Program within the Office of Civilian Radioactive Waste Management. This four-volume report documents work performed at Oak Ridge National Laboratory (ORNL) as part of a larger effort to demonstrate an acceptable approach for validating computational tools to be used in burnup credit cask design.

The computational tools of interest for burnup credit cask design are initially those currently used and accepted for spent fuel characterization (prediction of isotopics) and criticality safety (prediction of the effective multiplication factor, k_{eff}) in away-from-reactor (AFR) applications. The criticality analysis tools accepted for fresh fuel cask design have typically been validated per the requirements of the ANSI/ANS-8.1 criticality safety standard² (i.e., comparison against experimental data). Numerous critical experiments for fresh PWR-type fuel in storage and transport configurations exist and can be used as part of a validation data base. However, there are no critical experiments with burned PWR-type fuel in storage and transport configurations that can be directly used to extend the data base to the realm of burned fuel. Thus as part of the effort to extend the validation of existing criticality analysis tools to the domain of burned fuel, it was decided to investigate the performance of AFR analysis methods in the prediction of measured reactor critical configurations. Even though elements of a reactor critical analysis do not correspond directly to analyses of spent fuel assemblies in transportation and storage casks (e.g., elevated temperatures in reactor configurations or poison plates in cask designs), comparison against measured critical configurations can be used to validate aspects of spent fuel cask configurations which are not addressed in other experiments (i.e., fission-product interactions and the prediction of time-dependent actinide and fission-product inventories). Reactor critical configurations contain a diverse range of nuclides, including fissile and fertile actinides, fission products, and activation products. Thus nuclear reactor core criticals can be used to test an analysis methodology's ability to generate accurate burned fuel isotopics and handle the reactivity effects of complex heterogeneous systems containing burned fuel.

To date, the SCALE code system³ developed at ORNL has been the primary computational tool used by DOE to investigate technical issues related to burnup credit.⁴ SCALE is a well-established code system that has been widely used in AFR applications for spent fuel characterization via the SAS2H/ORIGEN-S analysis sequence⁵ and criticality safety analyses via the CSAS/KENO V.a analysis sequence.⁶ The isotopic composition of the spent fuel is derived from a SAS2H/ORIGEN-S calculation that simulates two-dimensional (2-D) effects in a one-dimensional

(1-D) model of an LWR fuel assembly. The depletion model is a spatially independent point model using cross sections and neutron flux parameters derived from the 1-D fuel assembly model. The KENO V.a Monte Carlo code⁷ is used to calculate the neutron multiplication factor for complex multidimensional systems. KENO V.a has a large degree of flexibility in its geometrical modeling capabilities which enables spent fuel arrays and container geometries to be modeled in explicit detail. The SCALE-4 27-group burnup library containing ENDF/B-IV (actinides) and ENDF/B-V (fission products) data was used for all calculations.

Early efforts to analyze reactor criticals⁸ using the SCALE modules concentrated on using utility-generated isotopic data although some analyses were performed using isotopes calculated with SAS2H. Based on this initial work, a consistent SCALE-based analysis methodology that simplifies both the data requirements and the calculational procedure was developed. The criteria used to select the reactor critical configurations were (1) applicability to the PWR fuel to be used in burnup credit cask design (e.g., long downtimes for decay of short-lived isotopes, large percentages of burned fuel in the configuration), the need to verify consistency in calculated results for different reactor conditions, and the need to provide a comparison with the results of ref. 5. Acceptable performance of the SCALE system in the prediction of k_{eff} will be judged relative to established SCALE performance for fresh fuel systems; if agreement is seen within the range typical for fresh fuel systems, then it will be concluded that the methodology described herein is valid in terms of its treatment of depletion and decay calculations and fission-product interactions, within the range of application defined by the reactor conditions.

The purpose of this volume is to describe the analysis of the hot, zero-power (HZP) critical configuration obtained during startup testing for Cycle 5 operation of GPU Nuclear Corporation's Three Mile Island Unit 1 (TMI-1). This particular unit and cycle were chosen because the unit had a significantly long downtime of 6.63 years prior to restart. Even though one fuel batch consisted of fresh fuel, the three remaining fuel batches had been exposed for one to three cycles prior to the extended downtime. These conditions closely represent those expected in spent fuel transportation scenarios where such fuel is expected to have been stored 5 to 10 years prior to shipment. A methodology resulting in proper characterization of in-core exposure and postexposure decay is necessary to accurately predict criticality for this configuration. Successful prediction of the critical condition may therefore be used as an indication of the validity of this methodology for spent fuel applications where long decay times are involved.

Section 2 of this volume presents an overview of the methodology employed in the reactor critical analyses. Section 3 provides the details of the analysis performed for TMI Unit 1 Cycle 5. The results and conclusions are discussed in Sect. 4.

2. OVERVIEW OF THE METHODOLOGY

The methodology applied in reactor critical analyses can be broken into five steps: (1) grouping of fuel assemblies into similar-content groups and similar-burnup subgroups; (2) calculation of burnup-dependent isotopes for each group; (3) interpolation of decay calculations from results of the previous step to obtain both individual assembly and subgroup isotopes; (4) cross-section processing based on subgroup isotopes; and (5) preparation of a KENO V.a model based on the actual core geometry, individual assembly isotopes, and subgroup-evaluated cross sections. The model developed in step 5 is used to calculate the effective multiplication factor, k_{eff} , for the reactor.

Figure 1 provides a graphical overview of these steps, showing the relationships between the data and codes used in each stage of the calculation. The first step shown in the figure represents the process of collecting assembly information from reactor documentation. Eighth-core symmetry is assumed to reduce the number of unique assembly models, such that the burnup of each assembly in an eighth-core segment represents the average burnup of all assemblies located in the corresponding symmetric position across the core. Using the reactor information, "groups" of assemblies are identified which are of cognate background (i.e., same initial loading and burn cycles). These assembly groups are then further categorized into "subgroups" consisting of assemblies within a group with similar (± 2 GWd/MTU) burnups.

The second step shown in the figure involves the calculation of isotopic contents using the decay and depletion steps of the SAS2H calculational sequence of SCALE. Calculations are performed for each assembly group based on the initial fresh fuel content and operating history of the group. Output consists of calculated isotopic contents for each of a number of user-specified timesteps.

In the third step, the SNIKR code package (not a part of the SCALE system) is used to interpolate between isotopes for appropriate timesteps in order to obtain the assembly-specific isotopic contents for each assembly to be used in the KENO V.a core model. (SNIKR is a simple tool used to automate the task of extracting, interpolating, and formatting data; however, this process can be performed manually.) SNIKR is also used to calculate the isotopes for the average burnup of each assembly subgroup.

The results of step 3 are used in step 4 to create fuel-pin models based on the average composition of an assembly subgroup; the CSASN sequence in SCALE is then used to calculate the problem-dependent group-weighted cross sections for each subgroup. The SCALE WAX module is then used to combine all subgroup-based cross sections into a single working library, where cross-section identifiers are assigned such that each numeric identifier indicates both a specific isotope and the subgroup upon which it was based.

Finally, in step 5 a KENO V.a model is created based on the core geometry, again assuming eighth-core symmetry. Thus while a full-core model is prepared each eighth-core segment of the core is identical in composition to the other eighth-core segments. (A full-core model in KENO V.a is more computationally efficient than an eighth-core model with reflective boundary conditions.) Fuel assemblies are assumed to be uniform in composition (all fuel pins are comprised of the same material), and isotopes are obtained from the burnup-specific results obtained in step 3. Assembly isotopes are assigned cross-section identifiers corresponding to the appropriate subgroup-based cross sections derived in step 4. Remaining core information is obtained from the reactor documentation.

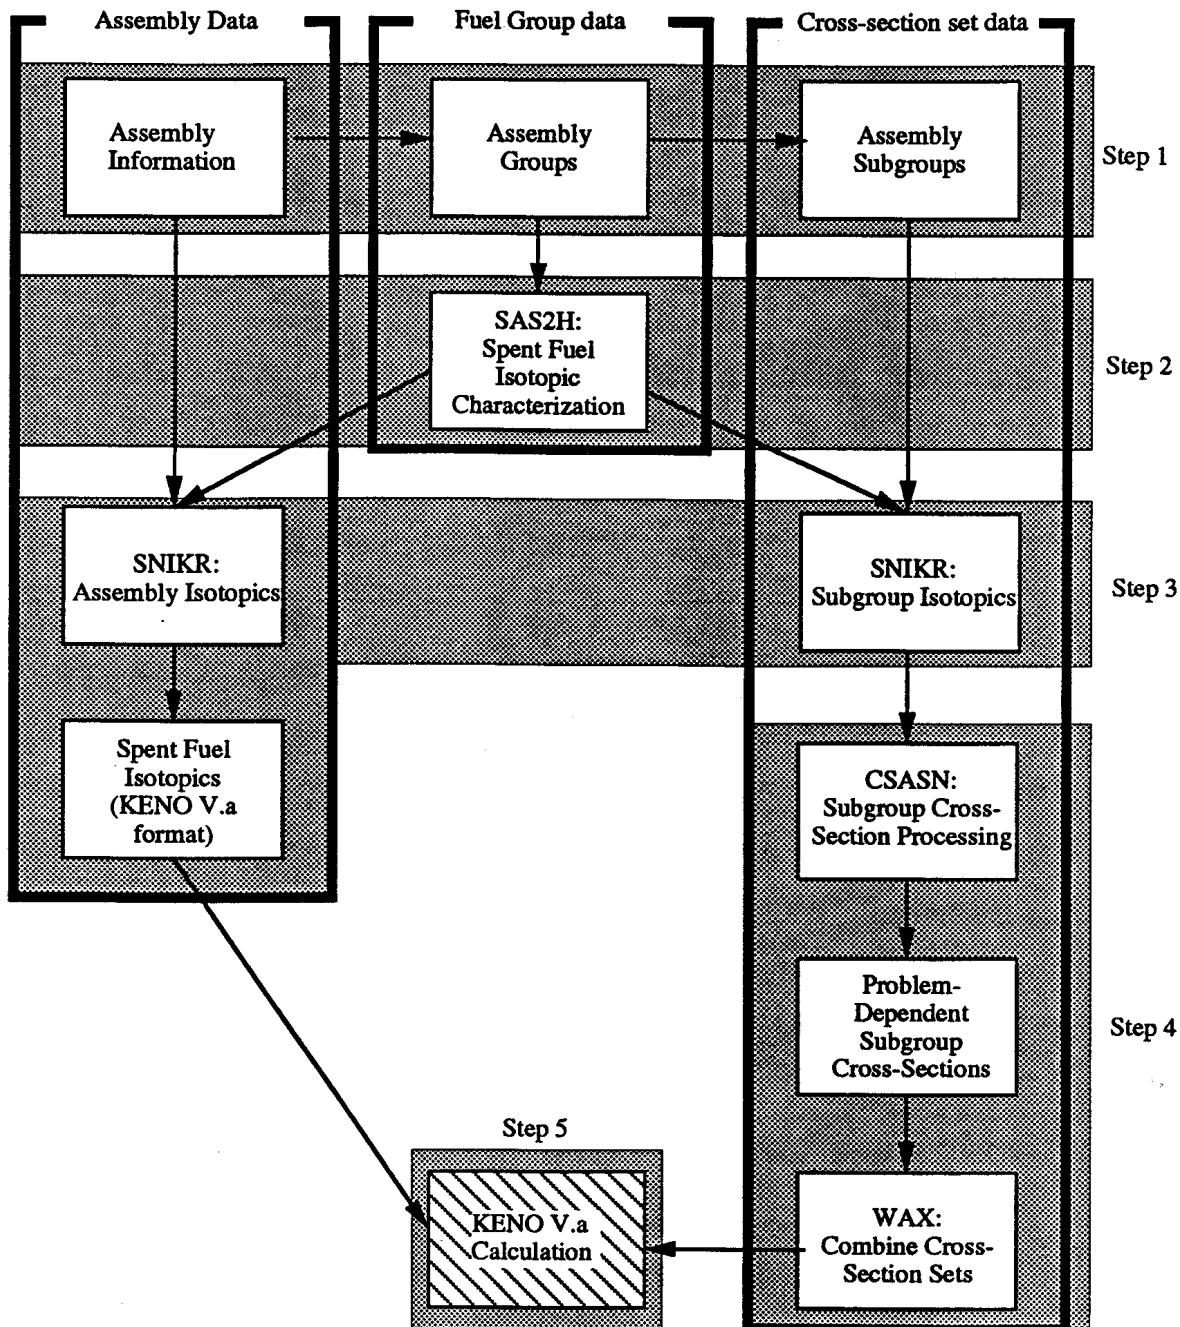


Fig. 1. Overview of the reactor critical calculation procedure.

Calculations are then performed to determine the value of k_{eff} for the reactor model, and to verify that the solution has converged.

The specifics of each of the steps described above are discussed in detail in each of the following sections.

2.1 FUEL ASSEMBLY GROUPS

To minimize the number of depletion calculations required to model the entire core, fuel assemblies are "grouped" (i.e., collected into sets that are of identical initial composition) and have been subjected to roughly the same exposure history. It is assumed that at a given level of burnup in an exposure history, all assemblies within a group will have the same isotopic content. If the isotopic content of a group is known as a function of burnup, then one can interpolate to obtain the specific isotopes for a given assembly based on the burnup of the assembly. This interpolation is discussed further in Sect. 2.3.

A minimum granularity for group partitioning is to collect fuel assemblies by reactor fuel batch. In the nomenclature generally applied by commercial LWR core designers, a fuel batch is comprised of a single enrichment fuel, all loaded at the same time, and all residing in-core for the same fuel cycles. Hence a given batch of assemblies has experienced identical operating periods, downtimes, and roughly the same exposure. This approach meets the minimum requirements for grouping. However, within a given fuel batch, additional grouping is required when significant materials (i.e., burnable poisons, control rods, or vacant positions) are found only in certain assemblies within a fuel batch.

As mentioned previously, within a fuel group it is possible to interpolate between a series of burnups to determine the isotopic concentrations corresponding to a specific burnup. Based on these isotopes, it is possible to generate a content-specific cross-section set for each assembly. However, in order to simplify cross-section processing, representative cross sections for a set of similar assemblies are desirable. Because it is felt that cross-section weighting is not strongly coupled to burnup, then for the purpose of determining microscopic cross sections for a fuel group it is possible to represent the contents of a group by an average content based on an average burnup. Unfortunately, even within a single fuel batch or group, it is possible to have a wide range of burnups. Thus it may be necessary to divide fuel groups into subgroups based on burnup such that all assemblies included in a subgroup are within a specific range of burnups; the number of subgroups will depend on the range of burnup contained in the entire group. Previous work⁸ has indicated that assemblies grouped with a maximum range of no more than 2 GWd/MTU can be adequately represented by the average value of burnup within the subgroup.

2.2 DEPLETION CALCULATIONS

Depletion calculations are performed using the SAS2H⁹ sequence of the SCALE-4 code system. The SAS2H sequence invokes the ORIGEN-S¹⁰ code to perform depletion and decay calculations, based on cross sections computed from a 1-D pin cell model, for each of any number of input specified burnup steps. At the end of each burnup step, cross sections for default and any

user-specified isotopes are reevaluated based on the new isotopic composition. The purpose of these calculations is to predict the isotopic content of each group and subgroup at the end of the final burn cycle as a function of the operating history of the constituent fuel. Thus such calculations are necessary only for fuel that has been exposed in-core prior to a critical condition. The contents of fresh fuel assemblies are already known. If one or more groups are comprised of fresh fuel at the time of the critical measurements, SAS2H calculations are not necessary for those groups; the isotopic content is based on that of the fresh fuel specifications.

Since within a fuel group it is assumed that isotopic content is a function only of burnup, it is possible to approximate the content of the fuel at a given burnup by interpolation between SAS2H/ORIGEN-S isotopics provided at each burnup step. The manner of interpolation is discussed in the following subsection. SAS2H provides the capability to obtain the isotopic composition of a fuel at specified burnup intervals given the initial composition of the fuel, clad, and moderator, design parameters of the fuel rod and lattice, and burnup/downtime history. To provide sufficient points for interpolation, the burnup history was broken into steps of less than 5 MWd/MTU. (This interval should not be confused with the 2-GWd/MTU interval used to establish assembly subgroups. The 5-GWd/MTU interval represents an interpolation range over which isotopic concentrations are assumed to vary smoothly.) The burnup history was calculated to more than 1.2 times the maximum burnup (B_{\max}) in the fuel group. Note that it is generally sufficient to calculate exposures out to the maximum exposure in a fuel group, as this will bound all exposures in the group. A value of $1.2*B_{\max}$ was used in this and previous burnup credit criticals to allow for the capability of modeling axial power variations, where length-averaged center-region power densities may be up to 1.2 times larger than the rod average. However, axial power variations are not included in the model presented in this report.

To make it possible to interpolate between burnup steps, a simplification must be made in the modeling of assembly burnups. It must be assumed that differences in burnup occur only in the most recent burn cycle (i.e., it is assumed that each assembly in a group experienced identical burn/downtime cycles during previous cycles), and differences in burnup between assemblies are the result of different lengths of burn in the final burn cycle. Assembly-specific burnups may then be obtained via interpolation between specific calculated states in the final burn cycle. This approach is illustrated in Fig. 2. The top portion of the picture shows the "actual" burnup histories for two hypothetical assemblies in a single fuel group. Note that in this example the number of cycles and downtimes are the same, but that the burnup in each assembly is different within each cycle. The lower portion of the figure demonstrates how the burnup of each assembly is represented in a SAS2H model, using a single calculation to represent the entire fuel group. Each cycle is broken down into multiple-burn intervals, followed by a downtime (for the first two cycles). The final cycle is calculated with sufficient burn steps to exceed the maximum burnup (31 MWd/MTU in assembly A of Fig. 2) by 20%. The isotopics are then available at fixed time intervals, from which interpolation can be performed for assembly-specific burnups. Note that the burnup in each of the first two cycles is selected to represent average cycle burnups for the group. Any downtime immediately before the reactor critical conditions was not included in the SAS2H depletion calculation, but was explicitly modeled as described in Sect. 2.3.

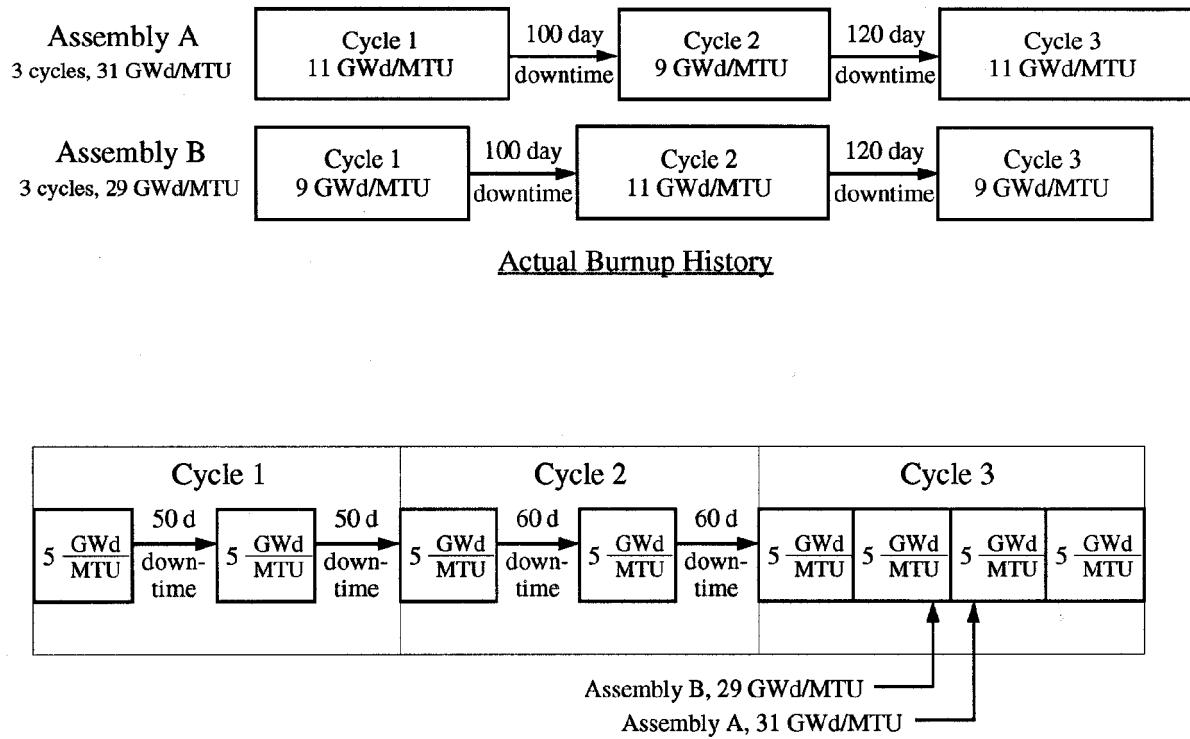


Fig. 2. SAS2H burnup model of assemblies with a fuel group.

Table 1. Nuclides updated by SAS2H

$^{234}\text{U}^a$	$^{243}\text{Am}^a$	^{94}Nb	^{132}Xe	^{145}Nd
$^{235}\text{U}^a$	$^{242}\text{Cm}^a$	$^{16}\text{O}^b$	$^{135}\text{Xe}^a$	^{147}Nd
$^{236}\text{U}^a$	$^{243}\text{Cm}^a$	^{99}Tc	^{136}Xe	^{147}Pm
$^{238}\text{U}^a$	$^{244}\text{Cm}^a$	^{101}Ru	$^{133}\text{Cs}^a$	^{148}Pm
$^{237}\text{Np}^a$	^{83}Kr	^{106}Ru	^{134}Cs	^{147}Sm
$^{238}\text{Pu}^a$	^{85}Kr	^{103}Rh	^{135}Cs	^{149}Sm
$^{239}\text{Pu}^a$	^{90}Sr	^{105}Rh	^{137}Cs	^{150}Sm
$^{240}\text{Pu}^a$	^{89}Y	^{105}Pd	^{136}Ba	^{151}Sm
$^{241}\text{Pu}^a$	^{95}Mo	^{108}Pd	^{139}La	^{152}Sm
$^{242}\text{Pu}^a$	^{93}Zr	^{109}Ag	^{144}Ce	^{153}Eu
$^{241}\text{Am}^a$	^{94}Zr	^{124}Sb	^{141}Pr	^{154}Eu
$^{242\text{m}}\text{Am}^a$	^{95}Zr	^{131}Xe	^{143}Pr	^{155}Eu
			^{143}Nd	^{155}Gd

^a Automatically updated by SAS2H.

^b Not an actinide or fission product, but present in UO_2 fuel.

As discussed earlier, group-weighted cross sections are calculated as a function of burnup within the SAS2H sequence using flux weighting performed by XSDRNP for each specified burnup step. Cross sections are updated for a default set of isotopes built into the SAS2H sequence, plus any additional nuclides specified by the user. Table 1 shows the default set plus 44 additional actinides and fission products specified for reactor depletion cases. Also included is oxygen, which is present in significant quantities in UO_2 fuel. These nuclides represent a combination of the most important nuclides for burnup credit calculations and for reactor physics calculations. The selection of burnup credit nuclides is based on the availability of experimentally measured isotopic concentrations and on sensitivity studies performed for a large number of nuclides under various spent fuel transportation/storage conditions, as described in ref. 11. The reactor physics nuclides are additional isotopes that are not important in a transportation sense, but have been determined to be important for depletion, decay, and criticality calculations under reactor operating conditions (e.g., ^{135}Xe builds up rapidly during reactor operation, but decays away with a 9.1-h half-life, and is therefore unimportant in 5-year-cooled spent fuel). These nuclides were identified in earlier work.^{12,13}

Any additional cross sections required for depletion calculations are obtained from the more than 1000 nuclides available within the ORIGEN-S 1-group LWR library and are adjusted with burnup using the ORIGEN-S spectral parameters (THERM, RES, and FAST)¹⁰ calculated using fluxes calculated by XSDRNP. The ORIGEN-S 1-group LWR library available in SCALE-4 has been updated to use cross sections from the SCALE-4 27-group burnup library for all 193 nuclides in that library, by extracting 1-group cross sections from the output of a low-burnup LWR-type fuel model using all burnup library nuclides as input.

Note that ORIGEN-S tracks all decay chains and does not account for the loss of volatile isotopes; however, this is not felt to have a significant effect on isotopic calculations.

2.3 BURNUP-DEPENDENT NUCLIDE CONCENTRATIONS

As has been indicated in previous sections, the isotopic content at the end of the final burn cycle may be determined for each assembly or fuel subgroup by interpolating between burnups for which ORIGEN-S depletion calculations have been performed, based on the final burnup of the fuel. The nuclide concentrations output at this point then represent the composition at the end of the last burnup cycle. For a criticality condition obtained later than the end of the burnup cycle, it is necessary to perform decay calculations to account for the change in composition caused by radioactive decay during the downtime prior to criticality.

The actual number densities used in the criticality calculations are derived from the SAS2H calculation for a given fuel batch using a newly developed interface module, SAS2H Nuclide Inventories for KENO Runs (SNIKR). This module was developed to enable the user to interpolate number densities from a SAS2H calculation as a function of burnup and to perform the necessary decay calculations to model cooling time for use in spent fuel critical calculations. SNIKR is not part of the SCALE system; hence, a sample driver script, sample output, and code listings are provided in Appendix B. SNIKR input is described in Sect. 3.5 of this volume.

The current version of SNIKR has been written to be executed as a sequence of computational routines. In the first phase, SNIKR1, burnup-dependent nuclide inventories are read from a dataset produced from a SAS2H calculation. SNIKR1 uses a Lagrangian interpolation scheme to calculate nuclide concentrations for a specified burnup. In the Lagrangian interpolation scheme, a polynomial of degree one less than the number of data points to be fit is used to represent the number density for each nuclide as a function of burnup. Comparisons have been made against results using nuclide concentrations calculated directly from SAS2H for a specified burnup to examine the effect of the interpolation procedure on pin-cell k_{∞} (i.e., 1-D infinite-lattice calculation) values. The results of these comparisons indicated agreement to within 0.1% Δk in the k_{∞} values calculated using isotopics derived from the two methods.

Upon completing interpolation, SNIKR1 sets up the input needed to decay the burnup-specific isotopics to the requested cooling time using the ORIGEN-S point-depletion code. The second phase of SNIKR executes the ORIGEN-S module in the SCALE code system. Phase three, SNIKR3, reads the number densities produced by ORIGEN-S for the requested cooling time and extracts the nuclides to be used in the depleted fuel for burnup credit criticality analysis. Number densities for these nuclides are then written to output files in SCALE standard composition input format and KENO V.a mixing table data format for use in CSASN and KENO V.a calculations, respectively. Typically, the term "SNIKR" is used to refer to the three-step sequence of calculations described above.

SNIKR extracts concentrations for the set of nuclides specified by the user. The set of nuclides selected for the reactor critical benchmark calculations consist of the 48 nuclides listed in Table 2. These nuclides are a subset of those in Table 1, with the exception of ^{103}Ru , ^{135}I , ^{148}Nd , and ^{149}Pm . The cross sections of these four nuclides are small enough or change slowly enough with burnup that omitting them from the cross-section update in SAS2H has a negligible effect and are therefore not needed in the SAS2H calculation. In addition to the 25 nuclides selected for use in

Table 2. Set of fuel nuclides used in KENO V.a calculations

$^{234}\text{U}^a$	$^{83}\text{Kr}^d$	$^{141}\text{Pr}^b$
$^{235}\text{U}^a$	$^{93}\text{Zr}^b$	$^{143}\text{Nd}^a$
$^{236}\text{U}^a$	$^{95}\text{Mo}^a$	$^{145}\text{Nd}^a$
$^{238}\text{U}^a$	$^{99}\text{Tc}^a$	$^{147}\text{Nd}^c$
$^{237}\text{Np}^b$	$^{101}\text{Ru}^b$	$^{148}\text{Nd}^c$
$^{238}\text{Pu}^a$	$^{103}\text{Ru}^c$	$^{147}\text{Pm}^b$
$^{239}\text{Pu}^a$	$^{103}\text{Rh}^a$	$^{148}\text{Pm}^c$
$^{240}\text{Pu}^a$	$^{105}\text{Rh}^c$	$^{149}\text{Pm}^c$
$^{241}\text{Pu}^a$	$^{105}\text{Pd}^b$	$^{147}\text{Sm}^a$
$^{242}\text{Pu}^a$	$^{108}\text{Pd}^b$	$^{149}\text{Sm}^a$
$^{241}\text{Am}^a$	$^{109}\text{Ag}^b$	$^{150}\text{Sm}^a$
$^{243}\text{Am}^b$	$^{135}\text{I}^c$	$^{151}\text{Sm}^a$
$^{244}\text{Cm}^b$	$^{131}\text{Xe}^d$	$^{152}\text{Sm}^a$
O ^a	$^{135}\text{Xe}^c$	$^{153}\text{Eu}^a$
	$^{133}\text{Cs}^a$	$^{154}\text{Eu}^b$
	$^{134}\text{Cs}^d$	$^{155}\text{Eu}^b$
	$^{135}\text{Cs}^a$	$^{155}\text{Gd}^a$

^a The 25 nuclides to be used in burnup credit analysis (ref. 4).

^b Additional burnup credit nuclides from ref. 1.

^c Additional reactor physics nuclides from Virginia Power's PDQ calculations (ref. 12).

^d Additional reactor physics nuclides from Yankee Atomic's CASMO-3/SIMULATE-3 calculations (ref. 13).

burnup credit analysis in ref. 4, the list in Table 2 includes the other nuclides included in an earlier burnup credit feasibility study¹ together with nuclides modeled explicitly in the burnup credit work of refs. 12 and 13.

2.4 SUBGROUP CROSS-SECTION PROCESSING

The CSASN⁶ sequence of the SCALE system is used to compute weighted fuel pin cross sections based on the content and geometry of a representative fuel cell. Based on a 1-D fuel cell model, CSASN invokes BONAMI-S¹⁴ to perform resonance shielding calculations using Bondarenko factors, followed by NITAWL-II¹⁵ calculations to perform resolved resonance range cross-section processing for any nuclides possessing resonance parameter data.

CSASN cross-section processing is applied only to subgroup-averaged nuclide concentrations. As discussed earlier in Sect. 2.1, effective microscopic cross sections are not strongly coupled to burnup; hence it is sufficient to compute cross sections for a subgroup-based average assembly, provided the range of burnups in the subgroup is not too large (subgroup "width" was addressed earlier in the discussion of the creation of subgroups). Nuclide concentrations for use in the CSASN

calculation are provided in standard composition form from the output of SNIKR subgroup calculations.

Because they represent only a small fraction of the total volume of the fuel, fission-product cross sections are essentially independent of location and need only be calculated for one subgroup. This situation is also true of many fuel-activation products; however, cross sections for seven actinides are known to have a significant burnup dependence. These isotopes, referred to as the "seven burnup-dependent actinides," are ^{234}U , ^{235}U , ^{236}U , ^{238}U , ^{239}Pu , ^{240}Pu , and ^{241}Pu . CSASN subgroup fuel-pin models include the appropriate SNIKR-computed concentrations for each of these isotopes; the remaining activation and fission products are included only in the highest burnup subgroup. The highest burnup is chosen because it will result in the lowest resonance absorption, and therefore results in a higher and therefore more conservative k_{eff} ; however, the effect is extremely small (<0.1% K).

Once effective cross sections are computed for each subgroup, the SCALE utility module WAX¹⁶ is used to combine all CSASN subgroup working libraries into a single working library for subsequent use by KENO V.a. All cross sections from the highest burn subgroup (containing all fission and activation isotopes) are copied into the combined library. For each of the remaining subgroup libraries, only the seven burnup-dependent actinides are copied. In addition, for each actinide in each subzone, the cross-section ID number is modified by prefixing the subgroup number to the cross-section ID so that the KENO V.a core model can reference the appropriate cross section for each subgroup. The cross sections with modified IDs are then copied into the combined library.

2.5 PREPARATION OF THE KENO V.a CORE MODEL

The geometry of the core model is based on the technical specifications of the core geometry available from several sources;¹⁷⁻²³ the detailed mechanics of the geometry model are not discussed here. Using the one-eighth core symmetry of the TMI core, it is possible to build a full-core model using a relatively small number of unique assemblies. For each assembly type, nuclide concentrations are obtained from assembly-specific SNIKR output in mixing table form; thus there is a unique mixing table for each assembly type in the model. Within each mixing table, the nuclide ID number of each of the seven burnup-dependent actinides is prefixed by the subgroup that represents the assembly type (this can be done automatically by SNIKR) so that the effective cross sections computed for the corresponding subgroup are utilized. These cross sections are located in the working library prepared as described in the previous subsection.

3. PREPARATION OF THE TMI-1 CORE MODEL

The previous section has given an overview of the technical procedure used in setting up the TMI-1 HZP critical calculation in order to provide a broad overview of the entire process before concentrating on the details. This section describes the TMI-1 beginning of cycle 5 (BOC-5) core, then details the specifics of each step used to set up a model for this core, based on the geometry, contents, and operating history of the core up to the beginning of the fifth cycle. Rather than follow the five steps used previously to outline the procedure, this section will describe each distinct aspect of the process, as illustrated by the individual boxes in Fig. 1.

Discussion of the KENO V.a criticality calculation and its results will be provided in Sect. 4 of this volume.

3.1 CORE DESCRIPTION

The TMI-1 core consists of 177 Babcock and Wilcox fuel assemblies, each comprised of a 15×15 lattice containing 208 fuel rods, 16 control/safety rod guide tubes, and one instrument tube. The core configuration is shown in Fig. 3, where each square represents an assembly position. At-power reactivity control is maintained using 24 full-length Ag-In-Cd control rod clusters and soluble boron. Additional shutdown margin is provided using 37 additional clusters. Eight partial-length Ag-In-Cd axial power shape rods (APSRs) are used to control the axial power distribution. Within each assembly, control rod positions are located as illustrated in Fig. 4. The positions are vacant (control rods are withdrawn) during operation.

The critical condition modeled in this report is based on HZP start-up testing for BOC-5. All core components were assumed to be at a constant temperature of 551 K, based on nominal HZP conditions. All full-length control and safety rod clusters were fully withdrawn, with APSRs at a 34.5% withdrawn position. Criticality was obtained with a soluble boron concentration of 1182 ppm. No burnable poisons were present in the core.

For BOC-5, two fuel assembly enrichments were present. Fuel batch 4B was manufactured with 2.64 wt % ^{235}U , but the remaining fuel batches (5, 6, and 7) contained 2.85 wt % ^{235}U . However, the geometries of the two designs were identical. Figure 4 illustrates this assembly configuration, showing the positions of fuel rods, control rod guide tubes, and instrument positions in each assembly. Table 3 provides a physical description of the significant aspects of the fuel design for all assemblies. Burnups for each assembly position were provided by the vendor¹⁸ in the form of a one-eighth core symmetric region, where the burnup for each assembly position represents the average of all assemblies lying in the corresponding position in all eighth-core regions. Figure 5 shows the location, batch, and BOC-5 burnup for all assemblies in the one-eighth core. Note that the assembly numbers given in the figure were assigned for the purposes of this set of calculations and do not correspond to the vendor's numbering scheme.

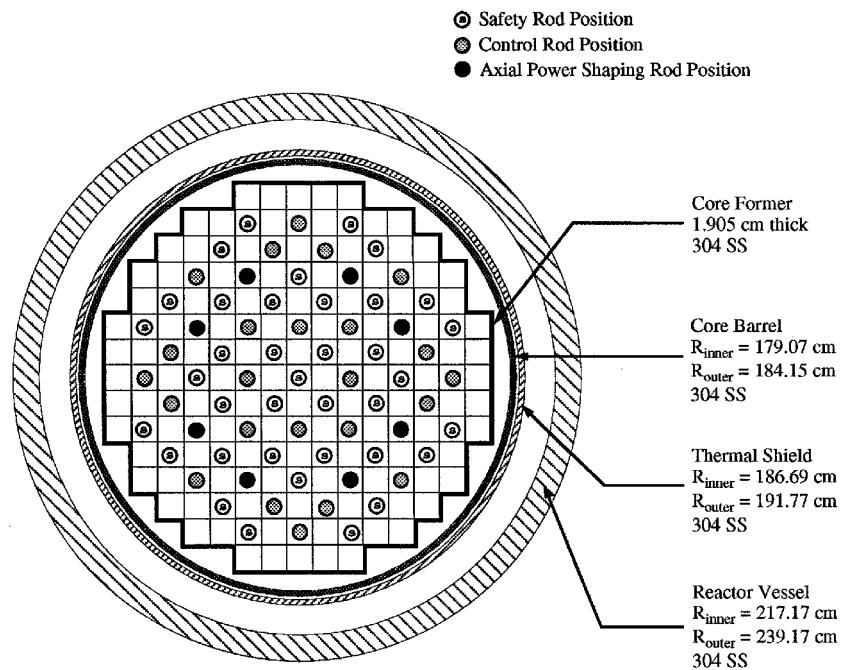


Fig. 3. TMI Unit 2 configuration.

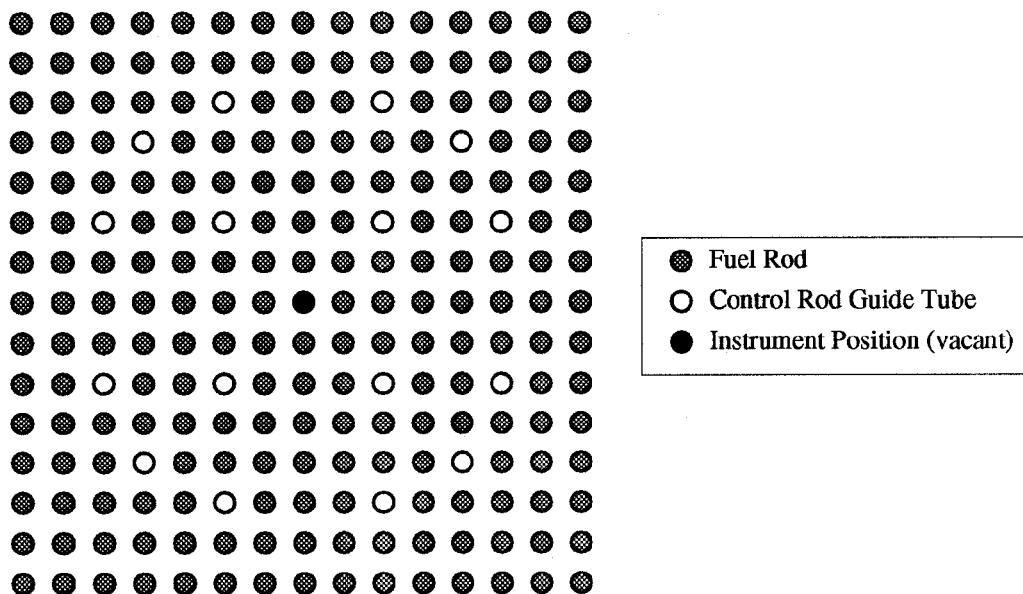


Fig. 4. TMI Unit 1 assembly geometry.

Table 3. Three Mile Island Unit 1 fuel/assembly design

Parameter	Data
Assembly data	
Number of assemblies	177
Weight of heavy metal, MTU	0.46363
Designer	Babcock & Wilcox
Lattice	15 × 15
Water temperature, K (°F)	577 (579)
Water density, g/cm ³	0.7149
Number of fuel rods	208
Number of guide tubes	16
Number of instrument tubes	1
Lattice pitch, cm (in.)	21.681 (8.536)
Fuel rod data	
Type fuel pellet	UO ₂
Pellet stack density, % TD	95
Rod pitch, cm (in.)	1.44272 (0.568)
Clad OD, cm (in.)	1.09220 (0.430)
Clad ID, cm (in.)	0.95758 (0.377)
Pellet diameter, cm (in.)	0.93624 (0.3686)
Active fuel length, cm (in.)	360.17 (141.8)
Clad material	Zircaloy-4
Guide tube data	
Tube ID, cm (in.)	1.24460 (0.490)
Tube OD, cm (in.)	1.34620 (0.530)
Tube material	Zircaloy-4

1 4B 25199	2 5 18313	3 6 6683	4 4B 23926	5 6 9540	6 5 17603	7 6 9540	8 7 0
	9 6 7969	10 5 20929	11 6 5802	12 5 18740	13 6 7090	14 4B 24728	15 7 0
		16 6 7969	17 5 16615	18 6 6012	19 4B 24900	20 7 0	21 7 0
			22 5 18203	23 5 15877	24 6 9322	25 7 0	
				26 4B 21034	27 7 0	28 7 0	
					29 5 15838		
1 4B 25199	Assembly Reference Number Assembly Type Assembly Average Burnup (MWD/MTU)						

Fig. 5. One-eighth core representation of TMI Unit 1, BOC 5.

A physical description of a partial-length control rod (i.e., APSR) is given in Fig. 6. Note that the geometry of a full-length control rod is not needed, because all full-length rods were fully withdrawn at startup and therefore need not be modeled in a criticality calculation. Axial APSR positions are specified in core reports in terms of percentage withdrawn. This value can be expressed in terms of absolute distance from the bottom of the active fuel length to the bottom of the poison region, d_{APSR} , using the following relationship:

$$d_{APSR} \text{ (cm)} = (\% \text{ withdrawn})(3.4925) + 19.495 .$$

For 34.5% withdrawn, the bottom of the poison region was located at 139.99 cm above the bottom of the fuel. Thus, the bottom of the rod itself was located 136.69 cm above the bottom of the fuel. Because the rod is partially withdrawn, the water region of the rod extends above the top of the core, and the configuration of the rod above the water region is not important. APSR locations in the core are shown in Fig. 3; in the one-eighth core geometry shown in Fig. 5, the APSR control rod cluster is located in assembly 18.

3.2 SAS2H ASSEMBLY GROUPS

A "batch" of fuel assemblies is a set of identical assemblies that have been loaded into the core at the beginning of a specific fuel cycle. Assemblies of a given batch are generally relocated within the core between cycles, resulting in a more evenly distributed burnup between assemblies. Because a batch is loaded at one time and remains in the core for its lifetime, each assembly in a batch has experienced the same uptime/downtime history. Thus, a starting point for the process of collecting similar-content assemblies, or grouping, is to begin with fuel batches. As indicated in Fig. 1, assembly group information is used in preparation of SAS2H input for depletion calculations. For BOC-5, the TMI-1 core was comprised of four fuel batches. Because there were no significant geometric differences between fuel assemblies of a given batch (e.g., burnable poison rods in certain assemblies), no additional subdivision is necessary, and the four fuel batches can be used to define similar-property fuel groups. Each group can then be modeled as a single unit in a SAS2H depletion calculation over the range of burnups represented by the assemblies in the fuel group. Table 4 provides relevant information about each fuel group.

The initial isotopic content of each group was determined from the initial enrichment of the associated assembly type. The following empirical relationship was used to determine relative isotopic content:²⁴

$$\begin{aligned} w_{234} &= 0.007731(w_{235})^{1.0837}, \\ w_{236} &= 0.0046w_{235}, \\ w_{238} &= 100 - w_{234} - w_{235} - w_{236}, \end{aligned}$$

where w is the weight percentage of the given isotope. Using this formulation, the fresh fuel isotopes for both enrichments were computed. The results are given in Table 5.

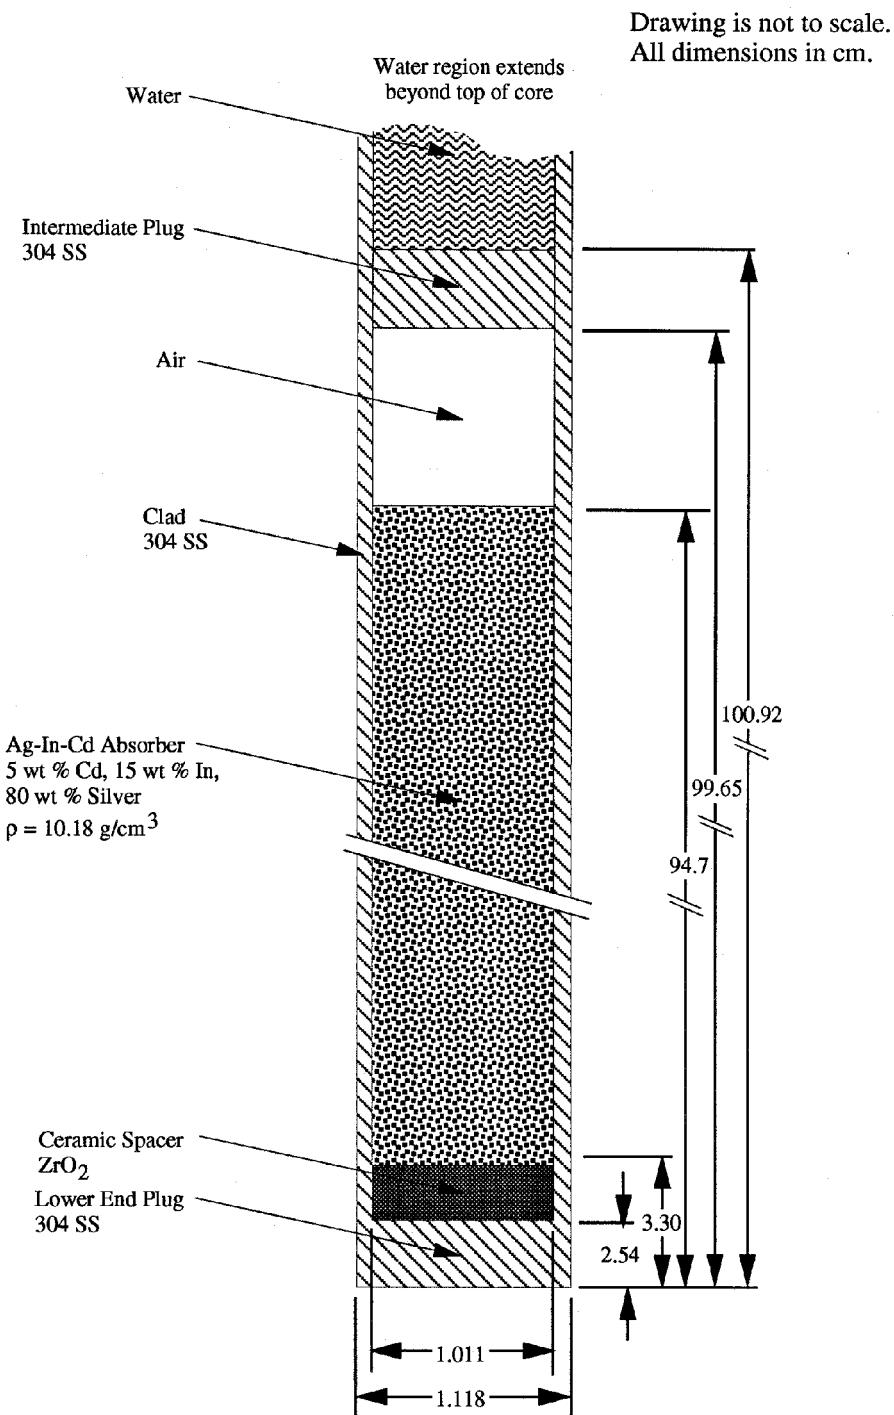


Fig. 6. Dimensions of a partial control rod (APSR).

Table 4. Assembly group data for BOC-5

Group No.	Fuel batch	Cycles in-core	Av. B/U, MWd/MTU	Max. B/U, MWd/MTU	Min. B/U, MWd/MTU	Enrichment, wt %	Av. fuel temp., K ^a	Av. clad temp., K ^a
1	4B	2,3,4	25573	28229	21034	2.64	854	621
2	5	3,4	17857	20929	15838	2.85	887	622
3	6	4	7552	9540	5802	2.85	879	619
4	7	-	0	0	0	2.85	-	-

^aOperating temperature based on average burnup and power while in-core prior to BOC-5.

Table 5. Isotopic content of fresh fuel for 2.64 and 2.85 wt % enrichments

Isotope	Isotopic composition, wt %	
	2.64 wt % ²³⁵ U (Batch 4B)	2.85 wt % ²³⁵ U (Batches 5-7)
²³⁴ U	0.022	0.024
²³⁶ U	0.012	0.013
²³⁸ U	97.326	97.113

In addition to the heavy-metal fuel material description for each group, light elements are typically present in a fuel rod, primarily in the clad. Elements whose masses are typically found to be in excess of 0.5 g/kgU, plus Mn and Co, are shown in Table 6, along with their estimated masses. These masses are required by the SAS2H module of SCALE in depletion calculations. They are not used in the neutronics model, but are applied in determining the (n,γ) fraction of energy per fission.

Each SAS2H calculation also requires specification of the temperature of each material for use in cross-section Doppler broadening corrections. However, since material and, therefore, thermal properties change with exposure, and because an assembly's peak temperature is a function of its linear heat rate, the average temperature in the fuel (and to a lesser extent the average clad temperature) will change with burnup and location. Thermal data are available, giving average fuel and clad temperatures as a function of exposure and linear heat rate. To simplify the depletion analysis, it was assumed that each fuel group could be represented by a single temperature in each of the fuel, clad, and coolant regions. Based on average burnup ([total burnup]/2) and the average power generated in each fuel group, the thermal data were used to obtain a group-average operating temperature for fuel and clad materials; these data are given in Table 4. A bulk coolant temperature of 577 K was used, based on the average of inlet and outlet coolant temperatures given in thermal-hydraulic performance data.¹⁸⁻²⁰

Table 6. Light-element masses used in SAS2H calculations

Element	Weight, g/kgU
O	135.0
Cr	5.9
Mn	0.33
Fe	12.9
Co	0.075
Ni	9.9
Zr	221.0
Nb	0.71
Sn	3.6

3.3 SIMILAR-BURNUP SUBGROUPING

Although the assemblies of a given fuel group are identical in terms of initial composition, time in core, and operating history, there is a broad range of burnups within a group. Even though effective cross sections are felt to be insensitive to minor variations in burnup, it is necessary to set a maximum range of burnup for which an average burnup is an acceptable approximation in determining cross sections. As discussed earlier, a range of no more than 2 GWd/MTU has been found to be acceptable;^{25,26} this value was used in subdividing assembly groups into similar-burnup subgroups. As shown in Fig. 1, subgroup information is provided to SNIKR for subsequent use in setting up CSASN calculations. CSASN is used to compute effective cross sections for each subgroup.

To determine subgroups for fuel groups 1 to 3, the minimum-to-maximum burnup range for each group was simply divided into three equal-size subgroups, each with a width of one-third of the range. This division ensured that no subgroup would be greater than 2 GWd/MTU in width. Subgroups whose burnup range contained no assemblies were ignored. Table 7 shows the group breakdown, with the actual burnup limits and ranges for assemblies within each subgroup, along with the mean burnup of all assemblies in each subgroup. Note that no subgrouping was performed for fuel group 4 assemblies; these assemblies are comprised of fresh fuel, thus no subdivision was necessary.

3.4 SAS2H DEPLETION CALCULATIONS

SAS2H depletion calculations were required for fuel groups 1, 2, and 3 only, since group 4 consisted of fresh fuel at the time of startup. In the standard composition section of the SAS2H input for each fuel group, isotopic contents for the fuel were as given in Table 5, at a temperature as given in Table 4. Additionally, although not initially present in the fuel, the 44 most significant fission products were included at an atom density of 1×10^{-20} (^{135}Xe was specified with an initial

Table 7. Subgroup burnups for BOC-5

Fuel subgroup	Fuel group	Max. burnup (GWd/MTU)	Min. burnup (GWd/MTU)	Av. burnup (GWd/MTU)	Width (Max.-Min.) (GWd/MTU)	Number of assemblies
1	1	25.199	23.926	24.688	1.273	4
2	1	21.034	21.034	21.034	0	1
3	2	20.929	20.929	20.929	0	1
4	2	18.740	17.603	18.215	1.137	4
5	2	16.615	15.838	16.110	0.777	3
6	3	9.540	9.322	9.467	0.218	3
7	3	7.969	7.090	7.676	0.879	3
8	3	6.683	5.802	6.166	0.881	3
9	4	0	0	0	0	7

density of 1.2×10^{-8} atoms/b-cm, since it quickly reaches this equilibrium concentration shortly after startup), indicating to SAS2H that cross sections for these isotopes should be updated at the end of each burn cycle, in addition to the default isotopes automatically updated within SAS2H. A list of these fission products is given in Table 4. The remainder of the fuel pin cell was described as Zircaloy clad in water. Temperatures were as given in Table 5; pin and lattice geometry data were as specified in Table 3. The active fuel length was specified as 776.85 cm/MTU, based on the actual fuel length of 360.17 cm divided by the total weight of heavy metal of 0.46363 MTU; this modification gives results in units of burnup per MTU rather than burnup per assembly. Since SAS2H uses a 2-D cell model, the fuel length is arbitrary and may be used as a conversion factor.

Table 8 gives the power history data used in the three fuel group models. Note that within each group model, a constant burn time per interval was used; this constant spacing is required by SNIKR when interpolating from SAS2H/ORIGEN output. To meet this requirement, the uptime for each of reactor operating cycles 2, 3, and 4 was assumed to be 300 days, representing the average cycle length. For groups 1 and 2, cycles 2 and 3 were divided into two intervals; for all groups, cycle 4 was divided into the number of intervals required so as to exceed the maximum assembly burnup by 20%.

A copy of the SAS2H input for group 1 calculations is included in Appendix A. With the exception of the uranium isotopics and the burn steps, inputs for group 2 and group 3 calculations were identical to that of group 1.

Table 8. Fuel group burn model used in SAS2H

Fuel group	Reactor cycle	Average power (MW/MTU)	Actual uptime (d)	Actual downtime (d)	Number of intervals in cycle	Modeled burn time per interval (d)	Modeled downtime per interval (d)	Cumulative burnup (GWd/MTU)
1	2	28.383	298	56	2	150	28.192	8.516
1	3	28.383	308	42	2	150	20.457	17.032
1	4	28.383	295	0	4	150	0.0	34.064
2	3	29.614	308	42	2	150	20.454	8.884
2	4	29.614	295	0	4	150	0.0	26.653
3	4	25.342	295	0	5	100	0.0	12.671

3.5 BURNUP-DEPENDENT INTERPOLATION OF ISOTOPICS

The atom density output files from each of the previous SAS2H calculations contain isotopic concentrations for the associated fuel group at each burnup step. Using the appropriate group output, SNIKR1 was used to interpolate between burn cycles to estimate the isotopic concentration corresponding to the burnup of each assembly and subgroup in the TMI model. SNIKR1 then used these isotopics (which represented nuclide concentrations at the end of the final burn cycle) and prepared an ORIGEN decay calculation to obtain the concentration of the isotopes after the 6.625 years downtime prior to the beginning of cycle 5. After ORIGEN-S was executed, SNIKR3 read the ORIGEN-S output and prepared isotopic concentration tables in both CSAS4 standard composition format and KENO V.a mixing table format, for an input-specified set of isotopes.

The SNIKR sequence consists of three codes, described earlier in Sect. 2.3, and requires two input files. The first input file describes the calculation to be performed for a specific assembly or subgroup; the second file is the SAS2H output file containing the burn cycle isotopics for the appropriate fuel group. Although SNIKR is not part of the SCALE system, SNIKR calculations can be automated somewhat in a manner similar to SCALE calculational sequences such that the multistep calling of the individual code packages is transparent to the user. Appendix B lists a UNIX script used to create a working space, copy and/or rename all necessary input and output, and execute each module in sequence. Appendix B also includes FORTRAN listings of the SNIKR1 and SNIKR3 codes invoked by this script.

Slightly different approaches are taken between the preparation of assembly isotopics and subgroup isotopics because the results are used in different applications. The following subsections describe each of the two methods.

3.5.1 Assembly Isotopics

In the KENO V.a model of the TMI one-eighth core region, assembly isotopics calculations are used to provide the nuclide concentrations for each assembly position. The assembly isotopics are based on the average burnup for the assembly, and all fuel rods within the assembly are assumed to possess the same isotopic composition. Hence material numbers for each fuel rod in a given assembly are the same and correspond to a specific KENO V.a mixture number. This mixture is defined based on results of SNIKR calculations for the burnup of the corresponding assembly. In the TMI KENO V.a model, mixture numbers 101 through 129 correspond to SNIKR calculations for assemblies 1 through 29, respectively. Eighth-core-averaged assembly burnups are given in Table 9, along with fuel type, group, and subgroup information.

A typical SNIKR input file is shown below, based on assembly 2 data. The first line is a text description of the calculation; the second line assigns unit numbers for various files used by SNIKR. This number assignment includes the unit number of the file containing the SAS2H output file for the fuel group appropriate for this assembly. The third line specifies the total number of burn steps in the SAS2H output file (6), the burnup (MWd/MTU) for which interpolated isotopics are desired (18313), and the number of cooling time steps for which output is desired (1). The next line specifies the single cooling time at which ORIGEN-decayed isotopics are desired (i.e., 6.625 years). Next, the number of light elements (zero—not used), the KENO V.a mixture number (102), and the

Table 9. Fuel assembly data for one-eighth core geometry

Assembly No.	Assembly type	Fuel group	Subgroup	Average burnup (MWd/MTU)
1	4B	1	1	25,199
2	5	2	4	18,313
3	6	3	8	6,683
4	4B	1	1	23,926
5	6	3	6	9,540
6	5	2	4	17,603
7	6	3	6	9,540
8	7	4	9	0
9	6	3	7	7,969
10	5	2	3	20,929
11	6	3	8	5,802
12	5	2	4	18,740
13	6	3	7	7,090
14	4B	1	1	24,728
15	7	4	9	0
16	6	3	7	7,969
17	5	2	5	16,615
18	6	4	8	6,012
19	4B	1	1	24,900
20	7	4	9	0
21	7	4	9	0
22	5	2	4	18,203
23	5	2	5	15,877
24	6	3	6	9,322
25	7	4	9	0
26	4B	1	2	21,034
27	7	4	9	0
28	7	4	9	0
29	5	2	5	15,838

cross-section ID modifier (4) are specified (fuel materials in assemblies 1 through 29 were assigned mixture numbers 101 through 129, respectively). Finally, a value of -2 is a flag telling SNIKR to output isotopes for the 48 most important nuclides for burnup credit applications.

```
Batch 5 (Group 2 Subgroup 4), Assembly H9, Burnup=18313 MWd/MTU
72 70 74 71 75 73
6 18313 1
6.625
0 102 4
-2
```

The KENO V.a mixture number and the cross-section ID modifier are not essential for the calculation and are present simply to preprocess input for its use in the subsequent calculation. The mixture number simply allows SNIKR to prepare KENO V.a input with the 'mix=###' label appropriate for the mixture. The cross-section ID modifier is a number indicating the subgroup from which cross sections are to be used for certain isotopes. As discussed earlier in Sect. 2.4, subgroup-dependent cross sections are required only for the seven burnup-dependent actinides. SNIKR places the cross-section ID modifier in front of the default cross-section ID for each of these isotopes (e.g., ^{238}U , with ID number 92238, would be described as 292238 for all assemblies located in subzone 2).

The SNIKR output file consists of three sections: a summary of the input and coarsely formatted ORIGEN results; isotopic concentrations in SCALE standard composition format; and isotopic concentrations in KENO V.a mixing table format. For an assembly calculation, only the latter is of interest; this section can be edited out and placed directly into KENO V.a input to describe the isotopic composition for the burnup of a specific assembly. A sample SNIKR output, corresponding to the above sample input, is listed in Appendix B.

3.5.2 Subgroup Isotopes

Burnup-dependent cross sections were required for the seven burnup-dependent actinides. As was previously mentioned, subgroup calculations are performed to obtain the cross sections for these actinides as a function of a subgroup-averaged burnup. Subgroups are shown in Table 9 and were selected based on the burnup range criterion of 2 GWd/MTU discussed earlier. SNIKR calculations were required for subgroups 1 to 8; no calculation was required for subgroup 9 because it is comprised of fresh fuel assemblies only.

A typical SNIKR input file is shown below for a subgroup-type calculation, based on subgroup 1 data. The first four lines are used exactly as in the earlier assembly calculations. The burnup value is the average of all assembly burnups within the subgroup. Again, the number of light elements was not used, and was set to zero. The KENO V.a mixture number, which is also used as the fuel mixture number specification for the standard-composition-formatted data in CSASN calculations, was set to 1 for all subgroups. The cross-section modifier is not used and was set to 0. Finally, as before, a flag value of -2 was used to direct SNIKR to prepare formatted isotopes for the 48 most important nuclides for burnup credit applications.

```

Subgroup 1 (Group 1), Ave. Burnup=24688 Mwd/MTU
72 70 74 71 75 73
8 24688 1
6.625
0   1   0
-2

```

The SNIKR output file is the same format as was produced for the assembly calculations; however, the region of output data that is of interest is the SCALE standard composition format output. A sample of the output from this calculation is also included in Appendix B.

3.6 GENERATION OF SUBGROUP CROSS SECTIONS USING CSASN

Weighted cross-section libraries are produced using the CSASN sequence of SCALE; the details of this process were described in Sect. 2.4. For each subgroup, a CSASN input deck containing subgroup-specific isotopes was created. Because the physical geometries of all fuel pins were identical, input specifications differed only in the isotopic compositions specified for each subgroup. All cases were set up to use the SCALE ENDF/B-IV and ENDF/B-V based 27-group 27BURNULIB cross-section library. All calculations were LATTICECELL type, with fuel in a Zircaloy clad; dimensions are specified in Table 10. A borated-water moderator was specified, with a soluble boron concentration of 1182 ppm.²¹ All components were specified with a temperature of 551 K, corresponding to HZP conditions.

Isotopic concentrations for cross-section sets 1 to 8 were obtained from the earlier SNIKR subgroup calculations. Since only the seven burnup-dependent actinides were required for subgroups 2 through 8, all other actinides and fission products were deleted from the fuel mixture specifications for these cases. Subgroup 9, comprised only of fresh fuel, was specified using the fresh isotopic compositions given in Table 5. Additional materials contained in the APSRs (i.e., Ag-In-Cd poison, stainless steel 304, and ZrO₂) were added to subgroup 1. CSASN calculations were then performed, with the resulting subgroup-specific microscopic working-format cross-section library saved for each subgroup.

Sample input for subgroup 1 (containing the seven burnup-dependent actinides, remaining actinides and fission products, and APSR materials), subgroup 2 (containing the seven burnup-dependent actinides only), and subgroup 9 (containing 2.85% enriched fresh fuel actinides only) are included in Appendix C.

3.7 COMBINING SUBGROUP CROSS SECTIONS USING WAX

The WAX program¹⁶ was used to combine the nine individual working-format libraries into a single library to be used in the KENO V.a core calculation. For cross-section set 1, corresponding to subgroup 1, WAX copied all cross sections into the combined library. For cross-section sets 2 through 8, WAX copied only the cross sections for the seven burnup-dependent actinides. For each

Table 10. Subgroups for one-eighth core assemblies

	Assembly Nos.	Burnup (MWd/MTU)		Assembly Nos.	Burnup (MWd/MTU)
Subgroup 1	1	25,199		Subgroup 2	26
	4	23,926			21,034
	14	24,728			
	19	24,900			
Average		24,688		Average	21,034
=====	=====	=====	=====	=====	=====
Subgroup 3	10	20,929		Subgroup 4	2
					18,313
					17,603
					18,740
					18,203
Average		20,929		Average	18,215
=====	=====	=====	=====	=====	=====
Subgroup 5	17	16,615		Subgroup 6	5
	23	15,877			9,540
	29	15,838			9,540
					9,322
Average		16,110		Average	9,467
=====	=====	=====	=====	=====	=====
Subgroup 7	9	7,969		Subgroup 8	3
	13	7,090			6,683
	16	7,969			5,802
					6,012
Average		7,676		Average	6,166
=====	=====	=====	=====	=====	=====
Subgroup 9	8	0			
	15	0			
	20	0			
	21	0			
	25	0			
	27	0			
	28	0			
Average		0			

of these actinides, the cross-section ID was modified by adding the subgroup/cross-section set number as a prefix, to be consistent with the numbering scheme used in the SNIKR-produced mixing-table-format isotopes for each assembly. The WAX input listing is provided in Appendix D.

3.8 PREPARATION OF A KENO V.a CORE MODEL

The KENO V.a²⁵ model used to determine k_{eff} for the TMI-1 BOC-5 core consists of four parts. The first section of input contains KENO V.a parameter specifications. The only significant aspect of this section is the use of 2003 generations of 1000 neutrons per generation; hence the calculation was based on two million histories (a minimum of three generations are skipped by KENO V.a). Parameter specifications are followed by mixture specifications, geometry specifications, and plotting specifications. The plotting specifications are unimportant in the criticality calculation and were simply used in debugging and verifying geometry input. The following subsections describe the details of the material and geometry specifications for this model.

3.8.1 KENO V.a Mixture Specifications

In describing the composition of a fuel assembly, it has been assumed that all fuel pins in the assembly are identical and may be represented by the assembly-averaged burnup. No attempt was made to account for burnup asymmetries within an assembly, because this information was not readily available and would have little, if any, detectable effect on the computed solution.^{8,26} Thus, only a single fuel pin description is necessary to describe all fuel pins in a given assembly. In addition, in this model axial power distributions are ignored, and assemblies are represented by a model that assumes a constant (average) power distribution along the active length of the assembly. Thus the composition of fuel in an assembly is uniform and is represented by a single material specification. Based on the results of an axial end effects study,²⁷ this assumption has a minor effect (<0.1% $\Delta k/k$) that is probably conservative for the average burnup in this model. Because it is possible to take advantage of the one-eighth core symmetry of the TMI-1 core, only 29 assemblies are required to represent all 177 assembly positions in the core. Hence, only 29 material mixtures are necessary for the whole-core model. These come from the 29 assembly calculations performed earlier using SNIKR for mixtures 101 through 129. The portions of the SNIKR output edited for use in KENO V.a represent complete mixture specifications for each of the 29 materials.

Material specifications were also required for all remaining materials (i.e., clad, borated water, and APSR materials). Isotopic concentrations for each isotope were obtained from the output of the subgroup. Table 11 lists all materials included in the core model by mixture number.

3.8.2 KENO V.a Geometry Specifications

A fuel pin was defined for each of the 29 one-eighth core fuel assemblies based on the dimensions given in Table 3. Identical dimensions were used for all rod definitions. Fuel pins were assigned to unit numbers 101 to 129, respectively; the fuel region of each pin was linked to its corresponding material number (e.g., fuel pin 101 used material 101 for the fuel region). All pins

Table 11. Mixture numbers used in KENO V.a core model

Mixture No.	Description
2	Zircaloy clad
3	Water (1182 ppm boron)
4	Ag-In-Cd poison rod
5	Stainless steel 304 clad
6	Zirconium oxide
101-129	Fuel, assemblies 1-29

were specified with a void gap, Zircaloy clad, centered in a water cuboid. Fuel pins and enclosing cuboids were modeled as having a length equal to that of the active fuel length of the rod [i.e., rod end structure (and resultant end effects) were neglected].

Unit 201, representing a control rod guide tube, was created using the dimensions in Table 3, with water inside the tube and centered within a water cuboid. A similar structure was created as unit 200, except a 34.5% withdrawn APSR was put inside the tube using the dimensions as discussed in Sect. 3.1 and as shown in Fig. 6.

The 15×15 arrays were then defined for each assembly and assigned unit numbers 1 to 29. Each assembly was loaded with its corresponding fuel pin cells and water-filled control rod guide tubes, according to the assembly map shown in Fig. 4. The center instrument position was also loaded with a water-filled guide tube. Instead of vacant guide tubes, assembly 18 was loaded with the partially inserted APSR/guide tube structures in all control positions. The center instrument position was filled with a water-filled guide tube.

The core former surrounding the outermost assemblies was created as a composite of several smaller segments, comprised of four different cuboid shapes. Units 31 to 34 were used to define these shapes. Figure 7 illustrates the use of these four unit types in modeling the core former. The figure also shows assembly position numbers for the full core, based on one-eighth core symmetry and the numbering scheme shown in Fig. 5. Using these position numbers, arrays of assemblies and core former segments were used to define larger units to minimize the number of "holes" placed in the global unit. Figure 8 illustrates the clustering of assemblies used. The central array marked as unit 50 was actually the innermost component of global unit 50, which also contained the core barrel, thermal shield, and reactor vessel. All other units were placed within unit 50 using KENO V.a "holes." Note that core former components drawn in black in the figure represent individual components not included in these arrays and were entered as individual holes in the global array. Unit number assignments used in the model are given in Table 12.

This completes the geometric description of the core. As a reference, a listing of the entire KENO V.a input for the TMI-1 BOC-5 core is included in Appendix E.

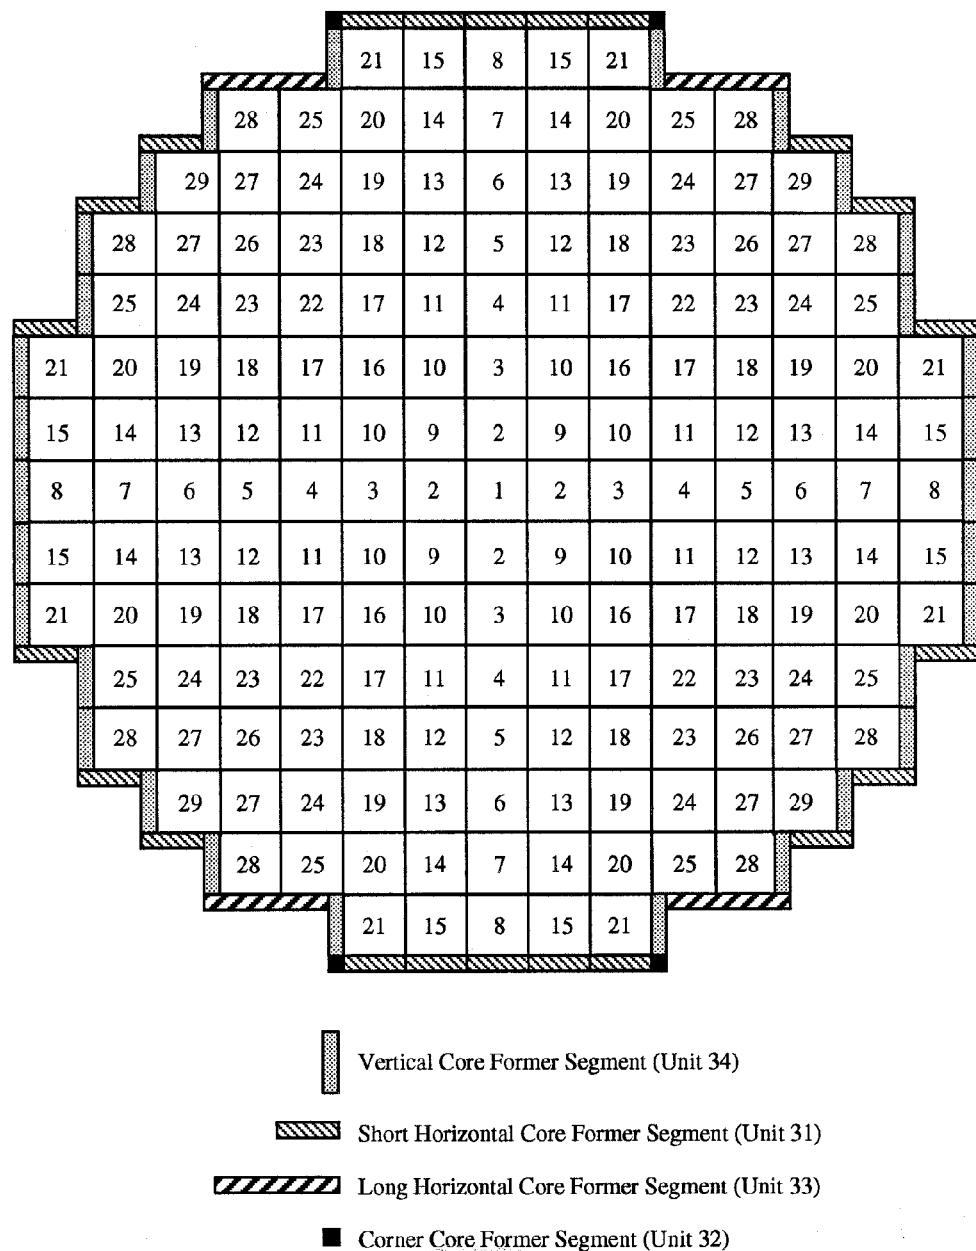


Fig. 7. Full-core assembly positions and core former configuration.

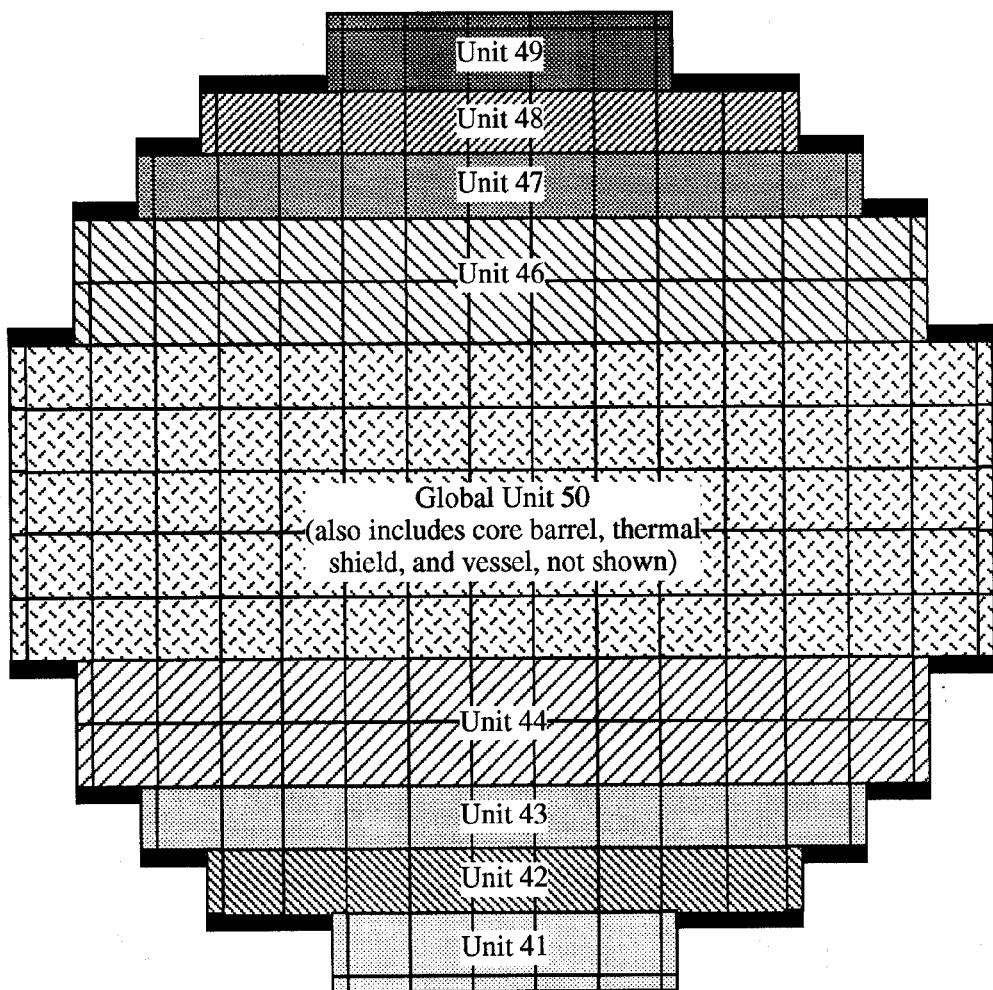


Fig. 8. Unit definitions based on assembly/core former component arrays.

Table 12. Unit numbers used in KENO V.a core model

Unit No.	Description
1-29	Fuel assemblies for positions 1 to 29, respectively
31	1.905×21.681 cm (horizontal) segment of core former
32	1.905×1.905 cm corner segment of core former
33	1.905×43.363 cm (horizontal) segment of core former
34	21.681×1.905 cm (vertical) segment of core former
41	"Bottom" of baffle + row 1 of assemblies + vertical former ends
42	Row 2 of assemblies + vertical former ends
43	Row 3 of assemblies + vertical former ends
44	Rows 4-5 of assemblies + vertical former ends
46	Rows 11-12 of assemblies + vertical former ends
47	Row 13 of assemblies + vertical former ends
48	Row 14 of assemblies + vertical former ends
49	Row 15 of assemblies + vertical former ends + "top" of former
50 (GLOBAL)	Reactor vessel + thermal shield + core barrel + rows 6-10 of assemblies + vertical former ends
101-129	Fuel rods for assemblies 1-29, respectively
200	34.5% withdrawn APSR rod inside guide tube
201	Water-filled guide tube

4. RESULTS AND CONCLUSIONS

The KENO V.a criticality calculation for the model described in this report yielded a value for k_{eff} of 0.9978 ± 0.0004 , based on 2000 generations of 1000 neutrons per generation, for a total of 2×10^6 histories. The average fission group reported by SCALE, representing the average neutron energy group at which fission occurs, was calculated to be 20.7815 ± 0.0026 . In terms of energy, for the 27-group burnup library, group 20 spans the energy range 0.4 to 0.8 eV. Numerical experiments with a different starting random number and different starting source shape and location indicate that this solution is well converged and adequate source sampling achieved. (See ref. 25 for what constitutes convergence.)

The base case above used P_3 scattering cross sections; however, a test using (default) P_1 scattering shows no significant change (within 0.1%) in k_{eff} . This effect is as would be anticipated, since angular fluxes throughout a reactor core would be expected to be relatively uniform except near the outer boundary of the core.

Fission densities computed by KENO V.a are shown in Fig. 9 for a one-eighth core region. These may be interpreted as relative power densities, and show the approximate shape expected for an operating PWR core, indicating no major anomalies in the core assembly model. At-power conditions would be expected to be more uniform over the inner-core regions due to xenon and temperature feedback mechanisms; however, these phenomena do not come into play under HZP conditions. Note that while k_{eff} , a total system parameter, is considered to be well converged, individual assembly fission distributions are based on substantially fewer histories, especially in outer-core regions, and therefore are subject to significantly higher uncertainties.

As described in Vols. 1 and 2 of this report,^{8,26} similar reactor criticality calculations have been performed for Surry Unit 1 and Sequoyah Unit 2 PWRs. Even though each reactor model is unique in its own respect, several significant differences between TMI-1 BOC-5 and the two other criticals should be considered when comparing results. First, both Surry-1 and Sequoyah-2 cores contained burnable poison rods, but no burnable poisons were present in the TMI-1 core. Also, both Surry and Sequoyah criticals were performed with all control rods withdrawn; the TMI-1 startup critical contained partial-length control-rod clusters located near the axial midplane of the core. Additionally, as a result of the use of these partial rods for shaping axial flux profiles, TMI-1 assemblies would be expected to have a more flattened axial burnup relative to the other reactor criticals. Finally, the 6.63-year downtime of TMI-1 prior to BOC-5 startup testing is significantly longer than that of other reactor criticals; hence the time-dependent fission-product inventories are significantly different for intermediate-lived isotopes and their decay products. Surry-1 BOC calculations were performed based on a 101-d downtime; Sequoyah-2 middle-of-cycle calculations were based on a 2.7-year downtime. Figure 10 shows the relative decay of four fission products, ^{134}Cs , ^{147}Pm , ^{154}Eu , and ^{155}Eu , all with decay constants on the order of roughly 1 to 4 years, as well as the relative production of two daughter products, ^{147}Sm (from ^{147}Pm) and ^{155}Gd (from ^{155}Eu). This illustrates the difference in inventories that would be expected between the different reactor configurations. The longer downtime would also magnify error contributions in fission-product decay and daughter production isotopes, resulting in varying degrees of error in the numerical models of the physical systems.

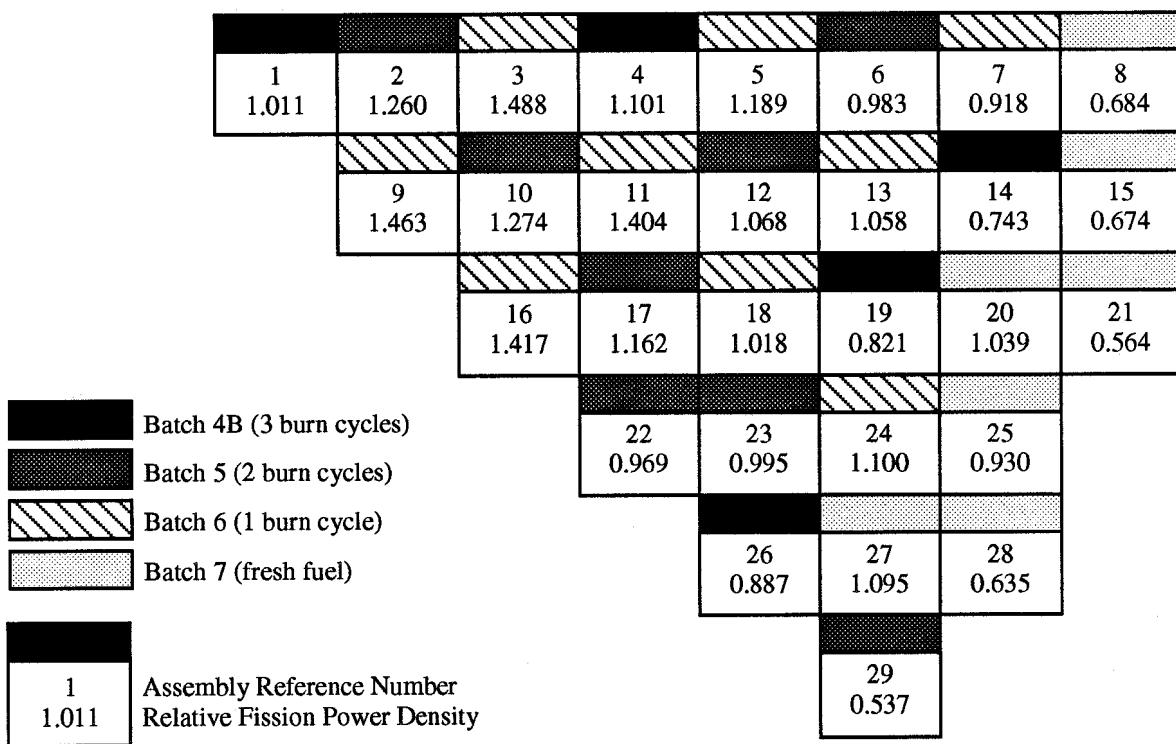


Fig. 9. KENO V.a relative fission density in TMI-1 one-eighth core.

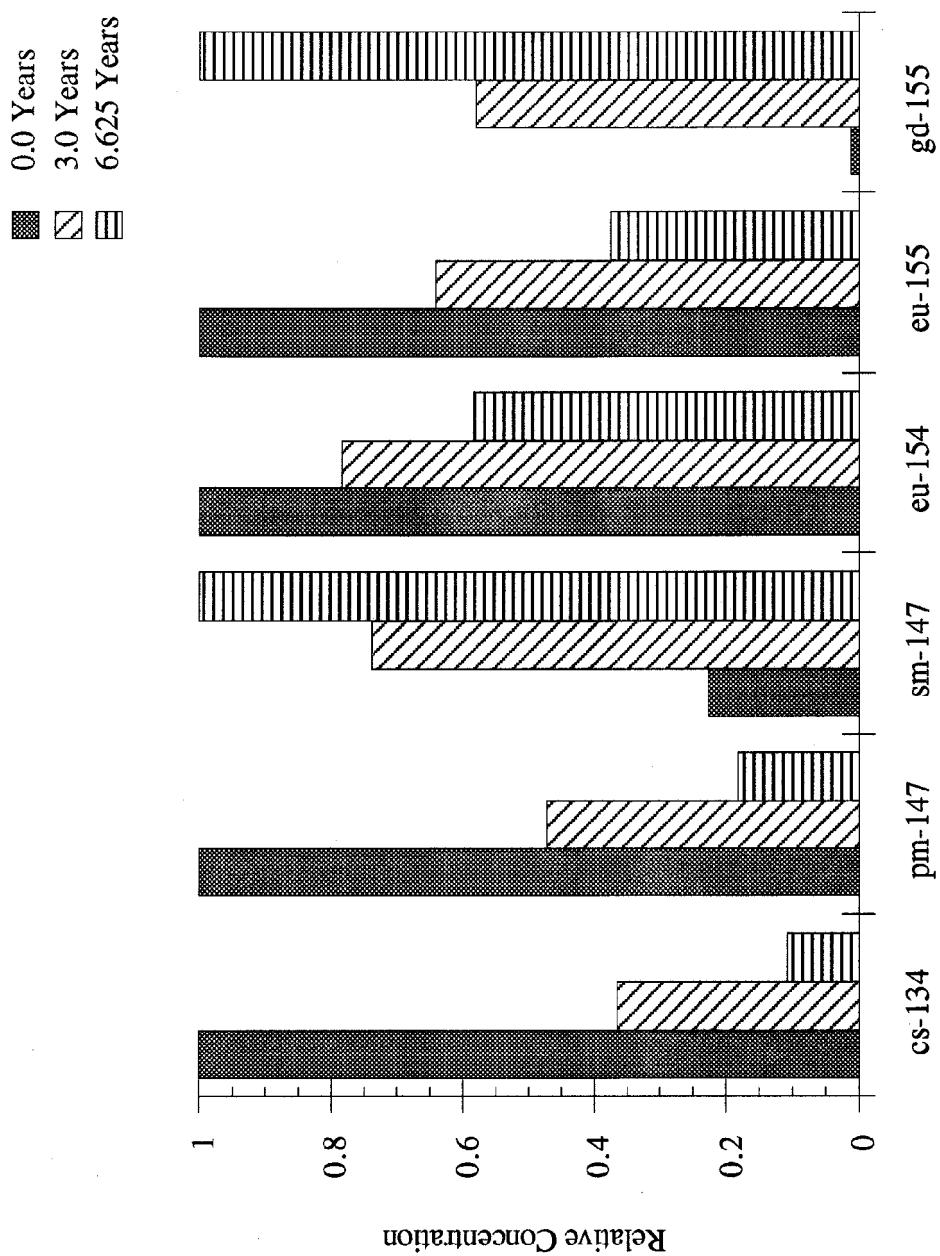


Fig. 10. Relative change in concentration for select fission products.

The results of this calculation demonstrate that even with a relatively simple core model and eighth-core and assembly-averaged exposure histories, it is possible to closely predict, in a best-estimate fashion, the critical condition after a long decay period for a lattice primarily comprised of spent fuel assemblies. Results are also consistent with SCALE validation calculations performed based on experiments using mixed-oxide fuel rods in square lattice configurations.²⁸ Hence, one may conclude that the methodology applied in performing this reactor critical calculation is valid for performing criticality safety analyses for systems with spent fuel.

REFERENCES

1. T. L. Sanders and R. M. Westfall, "Feasibility and Incentives for Burnup Credit in Spent Fuel Transport Casks," *Nucl. Sci. Eng.* **104** (1990).
2. "American National Standard for Nuclear Criticality Safety in Operations with Fissionable Materials Outside Reactors," ANSI/ANS-8.1-1983.
3. *SCALE: A Modular Code System for Performing Standardized Computer Analyses for Licensing Evaluation*, NUREG/CR-0200, Rev. 4 (ORNL/NUREG/CSD-2/R4), Vols. I, II, and III (draft November 1993). Available from Radiation Shielding Information Center as CCC-545.
4. M. C. Brady and T. L. Sanders, "A Validated Methodology for Evaluating Burnup Credit in Spent Fuel Casks," *Proc. of International Conference on Nuclear Criticality Safety*, Christ Church, Oxford, United Kingdom, September 9-31, 1991.
5. O. W. Hermann and C. V. Parks, "SAS2H: A Coupled One-Dimensional Depletion and Shielding Analysis Code," Sect. S2 of *SCALE: A Modular Code System for Performing Standardized Computer Analyses for Licensing Evaluation*, NUREG/CR-0200, Rev. 5 (ORNL/NUREG/CSD-2/R5), Vols. 1, 2 and 3 (draft November 1993). Available from Radiation Shielding Information Center as CCC-545.
6. N. F. Landers and L. M. Petrie, "CSAS4: An Enhanced Criticality Safety Analysis Module with an Optimum Pitch Search Option," Sect. C4 of *SCALE: A Modular Code System for Performing Standardized Computer Analyses for Licensing Evaluation*, NUREG/CR-0200, Rev. 5 (ORNL/NUREG/CSD-2/R5), Vols. 1, 2 and 3 (draft November 1993). Available from Radiation Shielding Information Center as CCC-545.
7. L. M. Petrie and N. F. Landers, "KENO V.a: An Improved Monte Carlo Criticality Program with Supergrouping," Sect. F11 of *SCALE: A Modular Code System for Performing Standardized Computer Analyses for Licensing Evaluation*, NUREG/CR-0200, Rev. 4 (ORNL/NUREG/CSD-2/R4), Vols. I, II, and III (draft November 1993). Available from Radiation Shielding Information Center as CCC-545.
8. J.-P. Renier and C. V. Parks, "Reactor Critical Calculations for Validation of Burnup Credit Analysis Methods," *Trans. Am. Nucl. Soc.* **62**, 308 (1990).

9. O. W. Hermann and C. V. Parks, "SAS2H: A Coupled One-Dimensional Depletion and Shielding Analysis Code," Sect. S2 of *SCALE: A Modular Code System for Performing Standardized Computer Analyses for Licensing Evaluation*, NUREG/CR-0200, Rev. 5 (ORNL/NUREG/CSD-2/R5), Vols. 1, 2 and 3 (draft November 1993). Available from Radiation Shielding Information Center as CCC-545.
10. O. W. Hermann and R. M. Westfall, "ORIGEN-S: A SCALE System Module to Calculate Fuel-Depletion, Actinide Transmutation, Fission Product Buildup and Decay, and Associated Radiation Source Terms," Sect. F7 of *SCALE: A Modular Code System for Performing Standardized Computer Analyses for Licensing Evaluation*, NUREG/CR-0200, Rev. 5 (ORNL/NUREG/CSD-2/R5), Vols. 1, 2 and 3 (draft November 1993). Available from Radiation Shielding Information Center as CCC-545.
11. B. L. Broadhead et al., *Investigation of Nuclide Importance to Functional Requirements Related to Transport and Long Term Storage of LWR Spent Fuel*, ORNL/TM-12742, Martin Marietta Energy Systems, Inc., Oak Ridge Natl. Lab. (in press).
12. B. H. Wakeman and S. A. Ahmed, *Evaluation of Burnup Credit for Dry Storage Casks*, EPRI NP-6494, Electric Power Research Institute, August 1989.
13. D. G. Napolitano and D. G. Adli, *Burnup Credit Criticality Analysis Using Advanced Nodal Techniques*, Yankee Atomic Electric Co., March 1992.
14. N. M. Greene, "BONAMI-S: Resonance Self-Shielding by the Bondarenko Method," Sect. F1 of *SCALE: A Modular Code System for Performing Standardized Computer Analyses for Licensing Evaluation*, NUREG/CR-0200, Rev. 5 (ORNL/NUREG/ CSD-2/R5), Vols. 1, 2 and 3 (draft November 1993). Available from Radiation Shielding Information Center as CCC-545.
15. N. M. Greene, L. M. Petrie, and R. M. Westfall, "NITAWL-II: SCALE System Module for Performing Resonance Shielding and Working Library Production," Sect. F2 of *SCALE: A Modular Code System for Performing Standardized Computer Analyses for Licensing Evaluation*, NUREG/CR-0200, Rev. 5 (ORNL/NUREG/ CSD-2/R5), Vols. 1, 2 and 3 (draft November 1993). Available from Radiation Shielding Information Center as CCC-545.
16. N. M. Greene, "User's Guide for Utility Modules," Sect. M15 of *SCALE: A Modular Code System for Performing Standardized Computer Analyses for Licensing Evaluation*, NUREG/CR-0200, Rev. 5 (ORNL/NUREG/ CSD-2/R5), Vols. 1, 2 and 3 (draft November 1993). Available from Radiation Shielding Information Center as CCC-545.
17. T. A. Coleman and P. B. McCanna, *Core Operation Report (End of Cycle 1) Three Mile Island Unit 1, Cycle 1 Operation September 2, 1974 - February 21, 1976*, BAW-1443, Babcock and Wilcox, October 22, 1976.

18. T. A. Coleman and P. B. McCanna, *Core Operation Report: Three Mile Island Unit 1, Cycle 2 Operation May 24, 1976 - March 18, 1977*, BAW-1459, Babcock and Wilcox, April 1976.
19. W. Bojduj, *Core Operation Report: Three Mile Island Unit 1, Cycle 3 Operation May 13, 1977 - March 17, 1978*, BAW-1503, Babcock and Wilcox, August 1976.
20. W. Bojduj, *Core Operation Report: Three Mile Island Unit 1, Cycle 4 Operation April 28, 1978 - February 17, 1979*, BAW-1579, Babcock and Wilcox, September 1976.
21. J. L. Creasy, *Core Operation Report: TMI Cycle 5 October 3, 1985 (Initial Criticality) to October 31, 1986 (End-of-Cycle)*, BAW-1987, Babcock and Wilcox, April 1987.
22. U.S. Department of Energy, *Characteristics of Spent Fuel, High-Level Waste, and Other Radioactive Wastes Which May Require Long-Term Isolation*, DOE/RW-0184 Vol. 3, App. 2A, U.S. Department of Energy, December 1987.
23. U.S. Department of Energy, *Characteristics of Potential Repository Wastes*, DOE/RW-0184 Vol. 1, App. 2A, July 1992.
24. O. W. Hermann, J.-P. Renier, and C. V. Parks, *Technical Support for a Proposed Decay Heat Guide Using SAS2H/ORIGEN-S Data*, NUREG/CR-5625, ORNL/CSD-130, Martin Marietta Energy Systems, Inc., Oak Ridge Natl. Lab., 1994.
25. S. M. Bowman, O. W. Hermann, and M. C. Brady, *SCALE-4 Analysis of Pressurized Water Reactor Critical Configurations: Volume 2 - Sequoyah Unit 2 Cycle 3*, ORNL/TM-12294, Vol. 2, Martin Marietta Energy Systems, Inc., Oak Ridge Natl. Lab., 1995.
26. S. M. Bowman and O. W. Hermann, *SCALE-4 Analysis of Pressurized Water Reactor Critical Configurations: Volume 3 - Surry Unit 1 Cycle 2*, ORNL/TM-12294/V3, Martin Marietta Energy Systems, Inc., Oak Ridge Natl. Lab., 1995.
27. S. E. Turner, "An Uncertainty Analysis-Axial Burnup Distribution Effects," *Proc. Workshop Use of Burnup Credit in Spent Fuel Transport Casks*, Washington, DC, February 21-22, 1988, SAND89-0018, TTC-0884, UC-820, T. L. Sanders, Ed., Sandia Natl. Lab., October 1989.
28. S. M. Bowman and M. D. DeHart, "Validation of SCALE-4 for Burnup Credit Applications," Accepted for publication in *Nuclear Technology*.

APPENDIX A

SAS2H CASE INPUT EXAMPLE

This appendix gives an example of the input for one of the three SAS2H cases. This input is used for zone 1 fuel.

```

=sas2      parm='halt08,skipshipdata'
TMI-1, cycles 2-4, zone 1 (4B fuel), burnup credit critical mdd 8/2/93
27burn      latticecell
'
'   mixtures of fuel-pin-unit-cell:
'
uo2  1  0.95  854  92234  0.022  92235  2.64  92236  0.012  92238  97.326  end
kr-83  1  0  1-20  854  end
kr-85  1  0  1-20  854  end
sr-90  1  0  1-20  854  end
y-89   1  0  1-20  854  end
mo-95  1  0  1-20  854  end
zr-93  1  0  1-20  854  end
zr-94  1  0  1-20  854  end
zr-95  1  0  1-20  854  end
nb-94  1  0  1-20  854  end
tc-99  1  0  1-20  854  end
rh-103 1  0  1-20  854  end
rh-105 1  0  1-20  854  end
ru-101 1  0  1-20  854  end
ru-106 1  0  1-20  854  end
pd-105 1  0  1-20  854  end
pd-108 1  0  1-20  854  end
ag-109 1  0  1-20  854  end
sb-124 1  0  1-20  854  end
xe-131 1  0  1-20  854  end
xe-132 1  0  1-20  854  end
xe-135 1  0  1.2-8  854  end
xe-136 1  0  1-20  854  end
cs-134 1  0  1-20  854  end
cs-135 1  0  1-20  854  end
cs-137 1  0  1-20  854  end
ba-136 1  0  1-20  854  end
la-139 1  0  1-20  854  end
pr-141 1  0  1-20  854  end
pr-143 1  0  1-20  854  end
ce-144 1  0  1-20  854  end
nd-143 1  0  1-20  854  end
nd-145 1  0  1-20  854  end
pm-147 1  0  1-20  854  end
pm-148 1  0  1-20  854  end
nd-147 1  0  1-20  854  end
sm-147 1  0  1-20  854  end
sm-149 1  0  1-20  854  end
sm-150 1  0  1-20  854  end
sm-151 1  0  1-20  854  end
sm-152 1  0  1-20  854  end
gd-155 1  0  1-20  854  end
eu-153 1  0  1-20  854  end
eu-154 1  0  1-20  854  end
eu-155 1  0  1-20  854  end
zircalloy 2  1  621  end
h2o  3  den=0.7149  1  577 end
end comp
'
' - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - -
'
'   fuel-pin-cell geometry:
'
squarepitch 1.44272 .936244 1  3  1.0922 2  .95758 0  end
'
' - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - - -
'
more data  szf=0.6  end
'
'   assembly and cycle parameters:
'
npin/assm=208 fuelnght=776.85 ncycles=8  nlib/cyc=1

```

```
printlevel=4 lightel=9  inplevel=1 ortube=0.6731 srtube=0.6223
numinstr=1  facmesh=0.65    end
'
power=28.383 burn=150.02 down=28.192    end
power=28.383 burn=150.02 down=28.192    end
power=28.383 burn=150.02 down=20.457    end
power=28.383 burn=150.02 down=20.457    end
power=28.383 burn=150.02 down=0.0      end
power=28.383 burn=150.02 down=0.0      end
power=28.383 burn=150.02 down=0.0      end
'
o 135 cr 5.9 mn 0.33
fe 12.9 co 0.075 ni 9.9
zr 221 nb 0.71 sn 3.6
'
----- -
'
       ....end of input.....
end
```


APPENDIX B

SNIKR EXECUTION AND OUTPUT

This appendix contains five listings:

- B.1: Automated SNIKR Execution Script.** A UNIX script which can be used to automate the SNIKR calling sequence and data transfer requirements.
- B.2: Sample SNIKR Output - Assembly Calculation.** Output listing from a SNIKR assembly calculation.
- B.3: Sample SNIKR Output - Subzone Calculation.** Output listing from a SNIKR subzone calculation.
- B.4: SNIKR1 Source Listing.** FORTRAN source listing of the file snikr1.f
- B.5: SNIKR3 Source Listing.** FORTRAN source listing of the file snikr3.f

B.1: Automated SNIKR Execution Script.

```
#!/bin/csh
##### shell script to execute the SNIKR sequence #####
#
# define current and new temporary working directories
#
set RTNDIR='pwd'
setenv TMPDIR /var/tmp/$USER.$$
mkdir $TMPDIR
#
# set up working directory links to snikr1 and snikr3 source code
#
if (!(-e snikr1))    ln -s ~udq/snikr/snikr1  $TMPDIR/snkr1
if (!(-e snikr3))    ln -s ~udq/snikr/snikr3  $TMPDIR/snkr3
#
# copy SAS2H output (specified by user) to temp directory as input
# for snikr1.  copy snikr1 input file snikr.in to temp dir.
#
cp $1 $TMPDIR/fort.72
cp snikr.in $TMPDIR
#
# change to temp directory, execute snikr1, and save (rename) snikr1
# output.
#
cd $TMPDIR
snikr1 <snikr.in >& snikr1.msg
mv fort.70 snikr1.out
#
# execute scale (origen) using the fort.74 file written by snikr1
#
~x4s/cmds/scale4 fort.74 origen.out >& origen.msg
#
# rename the unit 71 origen output file to the form expected by snikr3.
# execute snikr3.
#
mv ft71f001 fort.71
snikr3 >& snikr3.msg
#
# assemble all output & message files and copy back to home directory
#
#echo "***** SNIKR1 Output *****" > output
cat fort.73 > output
#
# Go home and clean up your room
#
cd $RTNDIR
cp $TMPDIR/output $1_snikout
rm -r $TMPDIR
```

B.2: Sample SNIKR Output - Assembly Calculation.

(Note: the shaded region below represents the section extracted from this output for use in the KENO core model.)

```

Batch 5 (Zone 2 Sub-zone 4), Assembly H9 , Burnup=18313 MWD/MTU
burn=      18313.
nltl=       1
nfis=      -2
mixf=      102
idmod=      4
92234 92235 92236 92238 93237 94238 94239 94240 94241 94242
95241 95243 96244 8016 36083 40093 42095 43099 44101 44103
45103 45105 46105 46108 47109 53135 54131 54135 55133 55134
55135 59141 60143 60145 60147 60148 61147 61148 61149 62147
62149 62150 62151 62152 63153 63154 63155 64155 99999
1697   689   129   879   1     .00
1697   689   129   879   2     .10
1697   689   129   879   3     .30
1697   689   129   879   4     1.00
1697   689   129   879   5     2.00
1697   689   129   879   6     4.00
1697   689   129   879   7     6.62
  2004  2.6176E-07  81206  2.0537E-30  81207  4.3944E-22  81208  3.2037E-19
  81209  2.1940E-26  82206  2.4687E-19  82207  1.1980E-16  82208  3.7894E-13
  82209  9.2683E-23  82210  4.3437E-18  82211  3.3348E-21  82212  1.8636E-16
  82214  1.1909E-22  83208  0.0000E+00  83209  9.8431E-19  0     0.0000E+00
  83210  2.6739E-21  83211  1.9768E-22  83212  1.7677E-17  83213  2.1647E-23
  83214  8.8429E-23  84210  6.1314E-20  0     0.0000E+00  84211  2.1847E-27
  84212  9.2887E-28  84213  3.2544E-32  84214  1.2166E-29  84215  2.7405E-27
  84216  7.0553E-22  84218  1.3778E-23  85217  2.5568E-28  86218  0.0000E+00
  86219  6.0968E-24  86220  2.7054E-19  86222  2.4475E-20  87221  2.3272E-24
  87223  2.7753E-23  88222  0.0000E+00  88223  1.5210E-18  88224  1.5386E-15
  88225  1.0124E-20  88226  3.7401E-15  88228  2.1359E-21  89225  6.8391E-21
  89227  1.0563E-15  89228  2.6070E-25  90226  0.0000E+00  90227  2.4552E-18
  90228  2.9335E-13  90229  1.9686E-15  90230  9.8480E-11  90231  1.2591E-15
  90232  1.4973E-11  90233  0.0000E+00  90234  3.2834E-13  91231  8.6989E-12
  91232  0.0000E+00  91233  1.8020E-13  0     1.1071E-17  91234  4.9449E-18
  91235  0.0000E+00  92230  0.0000E+00  92231  0.0000E+00  92232  1.3818E-11
  92233  5.2648E-11  92234  4.3043E-06  92235  3.0440E-04  92236  6.5943E-05
  92237  3.6950E-13  92238  2.2236E-02  92239  0.0000E+00  92240  6.1821E-30
  92241  0.0000E+00  93235  1.9502E-15  0     0.0000E+00  93236  1.2121E-11
  93237  5.2161E-06  93238  1.4600E-15  93239  2.9981E-13  0     5.2760E-32
  93240  5.4280E-34  93241  0.0000E+00  94236  2.9258E-12  94237  4.9837E-29
  94238  9.3473E-07  94239  1.1159E-04  94240  3.0023E-05  94241  1.1988E-05
  94242  2.9296E-06  94243  2.1353E-23  94244  3.0789E-19  94245  0.0000E+00
  94246  3.0144E-29  95239  0.0000E+00  95240  0.0000E+00  95241  4.8360E-06
  0     7.8937E-09  95242  1.0184E-13  95243  3.4268E-07  0     0.0000E+00
  95244  0.0000E+00  95245  3.9942E-27  95246  7.5312E-32  96241  1.3204E-39
  96242  2.3098E-11  96243  1.1960E-09  96244  3.4098E-08  96245  1.0745E-09
  96246  7.0327E-11  96247  6.0432E-13  96248  2.4288E-14  96249  0.0000E+00
  96250  7.0690E-23  96251  0.0000E+00  97249  1.0318E-18  97250  2.0871E-31
  97251  0.0000E+00  98249  2.0758E-16  98250  1.4881E-17  98251  8.2544E-18
  98252  3.3902E-19  98253  0.0000E+00  98254  5.6487E-37  98255  0.0000E+00
  99253  0.0000E+00  0     0.0000E+00  99254  0.0000E+00  99255  0.0000E+00
  16250  0.0000E+00
isotopic results for cool step 7
origin-s cooling time (yrs)=      6.62

for use in csas

u-234  102  0  4.3043E-06  end

```

```

u-235 102 0 3.0440E-04 end
u-236 102 0 6.5943E-05 end
u-238 102 0 2.2236E-02 end
np-237 102 0 5.2161E-06 end
pu-238 102 0 9.3473E-07 end
pu-239 102 0 1.1159E-04 end
pu-240 102 0 3.0023E-05 end
pu-241 102 0 1.1988E-05 end
pu-242 102 0 2.9296E-06 end
am-241 102 0 4.8360E-06 end
am-243 102 0 3.4268E-07 end
cm-244 102 0 3.4098E-08 end
o 102 0 4.6454E-02 end
kr-83 102 0 1.8067E-06 end
zr-93 102 0 1.6519E-05 end
mo-95 102 0 2.6191E-05 end
tc-99 102 0 2.5747E-05 end
ru-101 102 0 2.3597E-05 end
ru-103 102 0 5.5877E-25 end
rh-103 102 0 1.5516E-05 end
rh-105 102 0 0.0000E+00 end
pd-105 102 0 9.9025E-06 end
pd-108 102 0 3.0830E-06 end
ag-109 102 0 2.0966E-06 end
i-135 102 0 0.0000E+00 end
xe-131 102 0 1.1761E-05 end
xe-135 102 0 0.0000E+00 end
cs-133 102 0 2.8329E-05 end
cs-134 102 0 1.8521E-07 end
cs-135 102 0 8.9558E-06 end
pr-141 102 0 2.4948E-05 end
nd-143 102 0 2.0684E-05 end
nd-145 102 0 1.5502E-05 end
nd-147 102 0 0.0000E+00 end
nd-148 102 0 7.6169E-06 end
pm-147 102 0 9.6606E-07 end
pm-148 102 0 5.9421E-28 end
pm-149 102 0 0.0000E+00 end
sm-147 102 0 5.9377E-06 end
sm-149 102 0 1.2173E-07 end
sm-150 102 0 6.2795E-06 end
sm-151 102 0 3.9482E-07 end
sm-152 102 0 2.8038E-06 end
eu-153 102 0 1.8347E-06 end
eu-154 102 0 2.7233E-07 end
eu-155 102 0 7.4319E-08 end
gd-155 102 0 1.2530E-07 end

```

for use when mixing in keno

```

mix= 102
492234 4.3043E-06
492235 3.0440E-04
492236 6.5943E-05
492238 2.2236E-02
93237 5.2161E-06
94238 9.3473E-07
494239 1.1159E-04
494240 3.0023E-05
494241 1.1988E-05
94242 2.9296E-06
95241 4.8360E-06
95243 3.4268E-07
96244 3.4098E-08
8016 4.6454E-02
36083 1.8067E-06
40093 1.6519E-05
42095 2.6191E-05

```

43099	2.5747E-05
44101	2.3597E-05
44103	5.5877E-25
45103	1.5516E-05
45105	0.0000E+00
46105	9.9025E-06
46108	3.0830E-06
47109	2.0966E-06
53135	0.0000E+00
54131	1.1761E-05
54135	0.0000E+00
55133	2.8329E-05
55134	1.8521E-07
55135	8.9558E-06
59141	2.4948E-05
60143	2.0684E-05
60145	1.5502E-05
60147	0.0000E+00
60148	7.6169E-06
61147	9.6606E-07
61148	5.9421E-28
61149	0.0000E+00
62147	5.9377E-06
62149	1.2173E-07
62150	6.2795E-06
62151	3.9482E-07
62152	2.8038E-06
63153	1.8347E-06
63154	2.7233E-07
63155	7.4319E-08
64155	1.2530E-07
99999	0.0000E+00

B.3: Sample SNIKR Output - Subzone Calculation.

(Note: the shaded region below represents the section extracted from this output for use in CSASN calculations.)

```

Subzone 1(Zone 1), Ave. Burnup=24688 MWD/MTU
burn=      24688.
nltl=      1
nfis=      -2
mixf=      1
idmod=     0
92234 92235 92236 92238 93237 94238 94239 94240 94241 94242
95241 95243 96244 8016 36083 40093 42095 43099 44101 44103
45103 45105 46105 46108 47109 53135 54131 54135 55133 55134
55135 59141 60143 60145 60147 60148 61147 61148 61149 62147
62149 62150 62151 62152 63153 63154 63155 64155 99999
1697 689 129 879 1 .00
1697 689 129 879 2 .10
1697 689 129 879 3 .30
1697 689 129 879 4 1.00
1697 689 129 879 5 2.00
1697 689 129 879 6 4.00
1697 689 129 879 7 6.62
2004 6.7734E-07 81206 2.2564E-30 81207 6.4870E-22 81208 6.8767E-19
81209 4.0295E-26 82206 3.4812E-19 82207 1.9198E-16 82208 8.3636E-13
82209 1.7022E-22 82210 4.7721E-18 82211 4.9227E-21 82212 4.0002E-16
82214 1.1274E-22 83208 0.0000E+00 83209 2.7535E-18 0 0.0000E+00
83210 2.9378E-21 83211 2.9182E-22 83212 3.7944E-17 83213 3.9757E-23
83214 8.3714E-23 84210 6.9237E-20 0 0.0000E+00 84211 3.2250E-27
84212 1.9938E-27 84213 5.9771E-32 84214 1.1517E-29 84215 4.0455E-27
84216 1.5144E-21 84218 1.3043E-23 85217 4.6957E-28 86218 0.0000E+00
86219 9.0000E-24 86220 5.8070E-19 86222 2.3170E-20 87221 4.2741E-24
87223 4.0965E-23 88222 0.0000E+00 88223 2.2452E-18 88224 3.3025E-15
88225 1.8594E-20 88226 3.5407E-15 88228 2.7010E-21 89225 1.2561E-20
89227 1.5591E-15 89228 3.2968E-25 90226 0.0000E+00 90227 3.6244E-18
90228 6.2966E-13 90229 3.6155E-15 90230 8.5553E-11 90231 8.0231E-16
90232 1.7955E-11 90233 0.0000E+00 90234 3.2707E-13 91231 1.1523E-11
91232 0.0000E+00 91233 2.6410E-13 0 1.1028E-17 91234 4.9258E-18
91235 0.0000E+00 92230 0.0000E+00 92231 0.0000E+00 92232 2.9442E-11
92233 5.9192E-11 92234 3.5398E-06 92235 1.9396E-04 92236 7.3742E-05
92237 5.4435E-13 92238 2.2150E-02 92239 0.0000E+00 92240 1.4340E-28
92241 0.0000E+00 93235 3.8728E-15 0 0.0000E+00 93236 2.6878E-11
93237 7.6445E-06 93238 3.1388E-15 93239 9.9217E-13 0 1.2238E-30
93240 1.2591E-32 93241 0.0000E+00 94236 6.0627E-12 94237 8.5432E-29
94238 2.0299E-06 94239 1.1939E-04 94240 4.2740E-05 94241 1.7661E-05
94242 6.7702E-06 94243 3.1681E-22 94244 7.1418E-18 94245 0.0000E+00
94246 1.2099E-27 95239 0.0000E+00 95240 0.0000E+00 95241 7.2966E-06
0 1.6970E-08 95242 2.1893E-13 95243 1.1341E-06 0 0.0000E+00
95244 0.0000E+00 95245 1.2640E-25 95246 3.0227E-30 96241 5.5408E-39
96242 5.0918E-11 96243 4.3322E-09 96244 1.7108E-07 96245 6.9596E-09
96246 7.2552E-10 96247 8.9663E-12 96248 5.5675E-13 96249 0.0000E+00
96250 2.8372E-21 96251 0.0000E+00 97249 3.2652E-17 97250 8.4353E-27
97251 2.8026E-45 98249 6.7390E-15 98250 6.1720E-16 98251 4.3665E-16
98252 3.5078E-17 98253 0.0000E+00 98254 2.1287E-34 98255 0.0000E+00
99253 0.0000E+00 0 0.0000E+00 99254 1.7326E-23 99255 2.7536E-42
16250 0.0000E+00

isotopic results for cool step 7
origen-s cooling time (yrs)= 6.62

for use in csas
u-234    1   0   3.5398E-06   end
u-235    1   0   1.9396E-04   end

```

```

u-236    1  0  7.3742E-05  end
u-238    1  0  2.2150E-02  end
np-237   1  0  7.6445E-06  end
pu-238   1  0  2.0299E-06  end
pu-239   1  0  1.1939E-04  end
pu-240   1  0  4.2740E-05  end
pu-241   1  0  1.7661E-05  end
pu-242   1  0  6.7702E-06  end
am-241   1  0  7.2966E-06  end
am-243   1  0  1.1341E-06  end
cm-244   1  0  1.7108E-07  end
o        1  0  4.6454E-02  end
kr-83    1  0  2.1542E-06  end
zr-93    1  0  2.1158E-05  end
mo-95    1  0  3.3743E-05  end
tc-99    1  0  3.3551E-05  end
ru-101   1  0  3.1763E-05  end
ru-103   1  0  5.8017E-25  end
rh-103   1  0  2.0281E-05  end
rh-105   1  0  0.0000E+00  end
pd-105   1  0  1.5271E-05  end
pd-108   1  0  5.3048E-06  end
ag-109   1  0  3.3890E-06  end
i-135    1  0  0.0000E+00  end
xe-131   1  0  1.4856E-05  end
xe-135   1  0  0.0000E+00  end
cs-133   1  0  3.6801E-05  end
cs-134   1  0  3.1880E-07  end
cs-135   1  0  1.1736E-05  end
pr-141   1  0  3.2960E-05  end
nd-143   1  0  2.4846E-05  end
nd-145   1  0  1.9841E-05  end
nd-147   1  0  0.0000E+00  end
nd-148   1  0  1.0206E-05  end
pm-147   1  0  1.0230E-06  end
pm-148   1  0  6.2838E-28  end
pm-149   1  0  0.0000E+00  end
sm-147   1  0  7.0185E-06  end
sm-149   1  0  1.1882E-07  end
sm-150   1  0  8.7331E-06  end
sm-151   1  0  4.3137E-07  end
sm-152   1  0  3.7387E-06  end
eu-153   1  0  2.8292E-06  end
eu-154   1  0  5.2182E-07  end
eu-155   1  0  1.2753E-07  end
gd-155   1  0  2.1492E-07  end

```

for use when mixing in keno

```

mix= 1
92234  3.5398E-06
92235  1.9396E-04
92236  7.3742E-05
92238  2.2150E-02
93237  7.6445E-06
94238  2.0299E-06
94239  1.1939E-04
94240  4.2740E-05
94241  1.7661E-05
94242  6.7702E-06
95241  7.2966E-06
95243  1.1341E-06
96244  1.7108E-07
8016   4.6454E-02
36083  2.1542E-06
40093  2.1158E-05
42095  3.3743E-05

```

43099	3.3551E-05
44101	3.1763E-05
44103	5.8017E-25
45103	2.0281E-05
45105	0.0000E+00
46105	1.5271E-05
46108	5.3048E-06
47109	3.3890E-06
53135	0.0000E+00
54131	1.4856E-05
54135	0.0000E+00
55133	3.6801E-05
55134	3.1880E-07
55135	1.1736E-05
59141	3.2960E-05
60143	2.4846E-05
60145	1.9841E-05
60147	0.0000E+00
60148	1.0206E-05
61147	1.0230E-06
61148	6.2838E-28
61149	0.0000E+00
62147	7.0185E-06
62149	1.1882E-07
62150	8.7331E-06
62151	4.3137E-07
62152	3.7387E-06
63153	2.8292E-06
63154	5.2182E-07
63155	1.2753E-07
64155	2.1492E-07
99999	0.0000E+00

B.4: SNIKR1 Source Listing.

```

program snikr1
c
c new version july, 1993.
c
c common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
c common /index/ nburn,ncrit,nlitl,ile,iact,ifp,itol,ncyc,nfis
c common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
c common /ident/ idlittl(40),idcrit(200),iddk(2000)
c common /adens/ addltl(40),ltyp(40),adcrit(200),addk(2000)
c common /title/ ittl(20),lttl(20),crittl(20)
c dimension tstep(10),tcool(20),ncool(20)
c data tstep/0.1,0.3,1.0,2.0,4.0,7.0,10.,13.,16.,20./
c nstep=76
c nall=0
c
c      read all control data
c
c      call rdall(tcool)
c
c      write input to nout
c
c      nout=nout1
c      write(nout,120)ittl
c      write(nout,130)n72
c      write(nout,140)nout
c      write(nout,150)burn
c      write(nout,160)bconv
c      write(nout,170)ncyc
c      write(nout,140)nors
c      write(nout,180) (tcool(i), i=1,ntcool)
c      write(nout,190)nlitl
c120 format(20a4)
c130 format(4x,i2)
c140 format(5x,i2)
c150 format(5x,f8.1)
c160 format(6x,f6.4)
c170 format(5x,i2)
c180 format(10(1x,f6.2))
c190 format(8x,i2)
c
c      retrieve number densities from sas2h output (n72) for burn
c
c      call density
c      write(nout,110)(iddk(i),addk(i),i=1,itol)
c110 format(4(i8,2x,1p,e10.4))
c
c      call litel(0)
c
c      if the requested burnup is zero, bypass origin-s calculations.
c
c      if(burn.eq.0.0) go to 1000
c
c      prepare an origin-s run to calculate decay for requested
c      cooling times
c
c      call tymstp(tstep,tcool,ncool)
c
c      call wrtors(tstep)
c
c      write data for transfer to step 3.
c
c      call wrtall(ncool)
c      go to 2000
c
c      for the special case of burn=0, prepare ice and keno input here

```

```

c  (i.e. not in step 3)
c
1000 continue
    nout=nout3
    call rdctin1
    call clect(1)
    call wrtice
c
c  write number densities for mixing in keno to file nout3
c
    call wrtkeno
c
c  write a record for scale indicating that it abort origen step
c
    write(nors,210)
210 format('#origens'/'1t'/' //'$3 2t'/'4t'/'56$$ f0 5t'/'end')
c
c  write a record for transfer to step 3 indicating that
c  snikr3 exit immediately
c
    write(nstep) (ittl(i),i=1,20)
    n72=-1000
    write(nstep) n72,nout1,nors,n71,nice,nout3
c
2000 stop
end
c-----
subroutine rdall(tcool)
c
c  read all data needed for snikr1 and for snikr3.
c
c  wrtall will write this data to a temporary file (76)
c  for transfer to step 3.
c
common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
common /index/ nburn,ncrit,nlitl,ile,iact,ifp,itot,ncyc,nfis
common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
common /ident/ idlittl(40),idcrit(200),iddk(2000)
common /adens/ adlittl(40),lttyp(40),adcrit(200),addk(2000)
common /title/ ittl(20),lttl(20),crittl(20)
dimension tcool(20)
character*6 ichk
n5=5
c
c  read title card
c
    read(n5,120) ittl
c
c  read device numbers
c
    read(n5,*) n72,nout1,nors,n71,nice,nout3
    read(n5,*) ncyc,burn,ntcool
c
c  read ntcool values of tcool
c
    read(n5,*) (tcool(i), i=1,ntcool)
    read(n5,*) nlitl,mixf,idmod
c
c  read in light element data if nlitl > 0.
c
    if(nlitl.le.0) go to 1000
    read(n5,120) lttl
    read(n5,*) (idlittl(i),adlittl(i),lttyp(i), i=1,nlitl)
1000 continue
c
c  read in criticality data if nfis .gt. 0
c
    read(n5,*) nfis

```

```

if(nfis.gt.0) then
  ncrit=nfis
  read(n5,120) crittl
  read(n5,*) (idcrit(i), i=1,ncrit)
endif

c   write input to nout
c
c   write(nout,120) ittl
c   write(nout,130)n72
c   write(nout,140)nout
c   write(nout,150)burn
c   write(nout,160)bconv
c   write(nout,170)ncyc
c   write(nout,140)nors
c   write(nout,180)cool
c   write(nout,190)nlitl
  return
110  format(a6)
120  format(20a4)
130  format(4x,i2)
140  format(5x,i2)
150  format(5x,f8.1)
160  format(6x,f6.4)
170  format(5x,i2)
180  format(8x,f6.2)
190  format(8x,i2)
c 195 format(1x,i5,e10.4,2x,i1)
end

c-----
c----- subroutine density
c
c  get the iddk and addk arrays for the burnup times.
c  rdf72 is called and it reads the sas2h data.
c  lagint interpolates for each nuclide.
c
c      common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
c      common /index/ nburn,ncrit,nlitl,ile,iact,ifp,itot,ncyc,nfis
c      common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
c      common /ident/ idlitl(40),idcrit(200),iddk(2000)
c      common /adens/ adlitl(40),ltyp(40),adcrit(200),addk(2000)
c      common /title/ ittl(20),lttl(20),crittl(20)
c      dimension rdburn(10),a(2000),b(2000),ad(2000,10)

c
c      nc=-1
c      nbn=0
1000  nc=nc+1
      nbn=nbn+1
      call rdf72(nc,ad,rdbrn)

c   convert rdbrn from mwd/assy to mwd/mtu
c
      rdbrn=rdbrn/bconv
      write(nout,130)rdbrn
      rdburn(nbn)=rdbrn
      if(burn.eq.0.0) go to 40
      if(nc.lt.ncyc)go to 1000

c
40  smact0=0.
      i1=ile+1
      i2=ile+iact
      do 31 i=i1,i2
31  smact0=smact0+ad(i,1)
      write(nout,105)smact0
105 format('smact0=',1pe10.4)
      if(burn.eq.0.0)then
        ibn=1

```

```

    go to 1500
    end if
    if(burn.ge.rdburn(2))go to 15
    write(nout,110)
    write(nout,120)burn,rdburn(2)
    ibn=2
    go to 1500
15  continue
    if(burn.gt.rdburn(nbn))then
    ibn=nbn
    write(nout,110)
    write(nout,140)burn,rdburn(nbn)
    go to 1500
    end if
    do 20 i=1,nbn
    bdiff=abs(rdburn(i)-burn)/burn
    if(bdiff.lt.0.01)then
    ibn=i
    go to 1500
    end if
    if(rdburn(i).gt.burn)go to 1250
    ilow=i
20  continue
1250 continue
    ihi=ilow+1
c
c   lagrangian interpolation
c
    do 27 i=1,itot
    do 26 j=2,nbn
26  a(j-1)=ad(i,j)
    do 28 k=2,nbn
28  b(k-1)=rdburn(k)
    nbint=nbn-1
    call lagint(b,a,nbint,burn,conc)
27  addk(i)=conc
c
    return
1500 continue
c   write(nout,160)
c   write(nout,150)(iddk(i),ad(i,ibn),i=1,itot)
    do 30 j=1,itot
30  addk(j)=ad(j,ibn)
c   write(nout,150)(iddk(i),addk(i),i=1,itot)
    return
110 format('$$warning -----')
120 format('requested burnup of ',f10.3,' gwd/mtu is less than first'
     &/'cycle burnup of ',f10.3,'. first cycle burnup has been used')
130 format('rdbrn=',f10.3)
140 format('requested burnup of ',f10.3,' gwd/mtu is greater than last'
     &/'cycle burnup of ',f10.3,'. final cycle burnup has been used')
c 150 format(4(i8,2x,1p,e10.4))
c 160 format('past 1500')
    end
c-----
c----- subroutine rdf72(nc,ad,rdburn)
common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
common /index/ nburn,ncrit,nlitr,ile,iact,ifp,itot,ncyc,nfis
common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
common /ident/ idlitl(40),idcrit(200),iddk(2000)
common /adens/ adlitl(40),ltyp(40),adcrit(200),addk(2000)
common /title/ ittl(20),lttl(20),crittl(20)
dimension ad(2000,10)
character*4 itest,ttl72(20)
nct=nc+1
ind=3
c
c   read the following quantities from file 72 in addition to nuclide

```

```

c id and number density
c   1) lpass, library pass no. used for origin-s case
c   2) mtime, position no. of data from unit no. 71
c   3) tw, time from start of assembly burnup, d
c   4) dum1
c   5) rdburn, accumulated burnup at tw, mwd/assembly
c   6) spwr, specific power of cycle, kw/kg u
c   7) dum3
c   8) bconv, initial metric ton u weight per assembly
c
c      read(n72,100,end=2000)lpass,mtime,tw,dum1,rdburn,spwr,dum3,bconv
c      if(nct.eq.1)write(nout,99)
99  format(/,
&/'1) lpass, library pass no. used for origin-s case',
&/'2) mtime, position no. of data from unit no. 71',
&/'3) tw, time from start of assembly burnup, d',
&/'4) dum1',
&/'5) rdburn, accumulated burnup at tw, mwd/assembly',
&/'6) spwr, specific power of cycle, kw/kg u',
&/'7) dum3',
&/'8) bconv, initial metric ton u weight per assembly')
c      write(nout,100) lpass,mtime,tw,dum1,rdburn,spwr,dum3,bconv
c      if(lpass.eq.ncyc)ind=1
c      if(lpass.ne.nc)then
c         write(nout,101)nc,lpass,ncyc
101  format('nc=',i2,' lpass=',i2,' ncyc=',i2,' mtime=',i2,' ind=',i2)
c         stop 7210
c      end if
c      if(mtime.ne.ind)then
c         write(nout,101)nc,lpass,ncyc,mtime,ind
c         if(nc.eq.ncyc.and.mtime.eq.3)go to 5
c         stop 7220
c      end if
c      5 continue
c      read(n72,110) itot,ile,iact,ifp
c      isum=ile+iact+ifp
c      if(isum.ne.itot)stop 7230
c      do 10 i=1,4
10   read(n72,140)
c      read(n72,120)(iddk(i),ad(i,nct),i=1,itot)
c      write(nout,102)nct,lpass,ncyc
c 102  format('nct=',i2,' lpass=',i2,' ncyc=',i2,' ad array')
c      write(nout,120)(iddk(i),ad(i,nct),i=ile,ile+16)
c      read(n72,125)ttl72
c      write(nout,125)ttl72
c      write(nout,160)rdburn,nct
c 1000 read(n72,130)itest
c      if(itest.ne.'----')go to 1000
c      return
c 2000 continue
c      write(nout,150)
c      return
100  format(2i10,6(1x,1p,e9.3))
110  format(4i10)
120  format(4(i8,2x,1p,e10.4))
125  format(20a4)
130  format(a4)
140  format( )
150  format('***eof error reading file 72***')
c 160 format('rdburn(f72)=',f10.3,' nct=',i2)
c      end
c-----
c      subroutine lagint(x,y,n,xint,yout)
c
c this subroutine performs lagrangian interpolation within a set of
c (x,y) pairs to give the y value corresponding to xint. the degree of
c the interpolating polynomial is one less than the number of points
c supplied. taken from gerald's "applied numerical analysis" pg 181

```

```

c parameters are:
c   x - array of values of the independent variable
c   y - array of function values corresponding to x
c   n - number of points
c   xint - the x-value for which estimate of y is desired
c   yout - the y-value returned to caller
c           dimension x(10),y(10)
c
c check for zero or near-zero number densities.
c
      nc0=0
      nm1=n-1
      do 5 i=1,n
      if(y(i).gt.1.0e-25)go to 5
      nc0=nc0+1
  5  continue
      if(nc0.lt.nm1)go to 8
      yout=0.0
      return
  8  continue
c
      yout=0.0
      do 20 i=1,n
      term=y(i)
      do 10 j=1,n
      if(i.eq.j)go to 10
      term=term*(xint-x(j))/(x(i)-x(j))
  10 continue
      yout=yout+term
  20 continue
      if(yout.le.1.0e-25)yout=0.0
      return
      end
c-----
      subroutine tymstp(tstep,tcool,ncool)
      common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
      common /index/ nburn,ncrit,nlitr,ile,iact,ifp,itol,ncyc,nfis
      common /untrns/ n72,nout,nout1,nout3,n71,nors,nice,nstep
      common /ident/ idlitr(40),idcrit(200),iddk(2000)
      common /adens/ adlitr(40),ltyp(40),adcrit(200),addk(2000)
      common /title/ ittl(20),lttl(20),crittl(20)
      dimension tstep(10),tcool(20),ncool(20)
c
c if the maximum cooling time is .le. 20 yrs. do the following:
c
c for each requested cooling time, see if it corresponds to
c a value in the default tstep array and if not, adjust the
c nearest element in tstep to conform to requested time.
c
c however, if the maximum requested cooling time is greater
c than 20 years, we do the following:
c
c ten new time steps are generated that are evenly spaced in
c a logarithmic sense. depending on the final decay time needed
c the first few of the old time steps may be retained.
c
c these generated time steps are now the defaults. the
c last one corresponds to the maximum requested one and
c the others will be adjusted as explained above, so that
c all the requested times are contained in tstep.
c
      if(tcool(1).lt.0.0) then
      nall=1
      tcool(1)=abs(tcool(1))
      endif
c
      if(tcool(ntcool).gt.20.0) then
      tot=tcool(ntcool)

```

```

j=3
if(tot.gt.5000.0) j=1
totl=log(tot)-log(tstep(j))
ratio=exp(totl/(10-j))

c
do 50 i=j+1,10
tstep(i)=ratio*tstep(i-1)
50 continue

c
do 60 i=j+1,10
ts=tstep(i)
if(ts.gt.5000.0) tstep(i)=anint(ts)
60 continue
endif

c
if(nall.eq.1) go to 2000
if(tcool(1).lt.tstep(1)) tstep(1)=tcool(1)

k=0
do 1000 j=1,ntcool
cool=tcool(j)

c
do 100 i=1,10
if(cool.ne.tstep(i)) go to 100
k=k+1
ncool(k)=i
go to 1000
100 continue

c
do 110 i=1,9
if(tstep(i).lt.cool.and.cool.lt.tstep(i+1)) then
icool=i
go to 120
endif
110 continue

c
120 f1=cool-tstep(icool)
f2=tstep(icool+1)-cool
if(f1.gt.f2) icool=icool+1
if(j.eq.1) go to 125
if(tcool(j-1).eq.tstep(icool)) icool=icool+1
125 continue

c
tstep(icool)=cool
k=k+1
ncool(k)=icool
1000 continue

c
2000 continue

c
return
end

c----- subroutine litel(iflag)
c
c this subroutine checks to see if any light elements have been
c requested by the user; if oxygen was not explicitly requested
c it will be added.

c
common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
common /index/ nburn,ncrit,nlitl,ile,iact,ifp,itot,ncyc,nfis
common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
common /ident/ idlitl(40),idcrit(200),iddk(2000)
common /adens/ adlitl(40),ltyp(40),adcrit(200),addk(2000)
common /title/ ittl(20),lttl(20),crittl(20)

c
if(nlitl.ne.0)go to 10
nlitl=1

```

```

      idlitl(1)=8016
      ltyp(1)=1
      go to 30
10    continue
      do 20 i=1,nlitl
      if(idlitl(i).eq.8016)go to 35
20    continue
      nlitl=nlitl+1
      idlitl(nlitl)=8016
      ltyp(nlitl)=1
30    continue
      if(iflag.eq.1)go to 45
      adlitl(nlitl)=2.0*smact0
      write(nout,110)adlitl(nlitl)
110   format('adlitl(nlitl)=',1pe10.4)
35    continue
      do 40 i=1,nlitl
      do 40 j=1,ile
      idlt=idlitl(i)*10
      if(idlt.ne.iddk(j))go to 40
      write(nout,150)iddk(j),addk(j)
      if(ltyp(i).eq.1)addk(j)=adlitl(i)
      if(ltyp(i).eq.2.and.addk(j).eq.0.)addk(j)=adlitl(i)
      if(ltyp(i).eq.3.and.addk(j).ne.0.)addk(j)=addk(j)+adlitl(i)
      write(nout,140)idlt,adlitl(i)
      write(nout,150)iddk(j),addk(j)
40    continue
45    continue
      do 50 i=1,nlitl
50    if(idlitl(i).eq.8016)write(nout,120)adlitl(i)
      do 60 j=1,itot
60    if(iddk(j).eq.80160)write(nout,130)j,iddk(j),addk(j)
      return
120   format('adlitl for 8016= ',1pe10.4)
130   format(i2,i10,' addk for 8016=',1pe10.4)
140   format('litel array',2x,i6,2x,1pe10.4)
150   format('decay array',2x,i6,2x,1pe10.4)
      end
c-----
      subroutine wrtors(tstep)
c
c  aburn is the assembly burnup (mwd/assembly), n71 is the
c  file that the binary output is to be written to, tstep
c  is the array containing the decay time intervals, and
c  tburn is the total burnup (gwd/mtu)
c
c
c  this routine writes the input to the origen-s
c  decay case - ***presently in card image form to
c  unit 'nors' for input to ors, will change to write
c  binary input for driver to call origen-s
c
      common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
      common /index/ nburn,ncrit,nlitl,ile,iact,ifp,itet,ncyc,nfis
      common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
      common /ident/ idlitl(40),idcrit(200),iddk(2000)
      common /adens/ adlitl(40),ltyp(40),adcrit(200),addk(2000)
      common /title/ ittl(20),lttl(20),crittl(20)
      dimension tstep(10)
c  convert burnup to gwd/mtu - tburn
      tburn=burn/1000.
c  convert burnup to mwd/assembly - aburn
      aburn=burn*bconv
      write(nors,203) n71
      write(nors,204) aburn
      write(nors,205)
      write(nors,206) itot
      write(nors,207) tburn

```

```

write(nors,208)
write(nors,309)(tstep(k),k=1,10)
write(nors,211)
write(nors,201)
write(nors,220)(iddk(k),addk(k),k=1,itot)
write(nors,202)
write(nors,220)(iddk(k),addk(k),k=1,itot)
write(nors,212)ile,iact,ifp
write(nors,214)
write(nors,213)
return
201 format('73u'' (3(i8,12x))')
202 format('74u'' (3(10x,1p,e10.4))')
203 format('#origens'/'0$$ a11 ',i2,' e 1t')
204 format('decay only cases for snikr at burnup ',1p,e9.3,
&' mwd/assembly')
205 format('2t'/'35$$ 0 4t')
206 format('56$$ a5 1 1 a13 ',i4,' 5 3 0 4 e 5t')
207 format('burnup - ',1p,e9.3,' gwd/mtu')
208 format('units - atoms/barn-cm')
209 format('60** ',10(1x,f5.2))
309 format('60** ', 6(1x,1p,e9.2))
211 format('65$$ 1 a22 1 a43 1 e')
212 format('75$$ ',i3,'r1 ',i3,'r2 ',i3,'r3'/'6t')
213 format('56$$ f0 t'/'end')
214 format('56$$ 0 -10 a10 0 e t')
220 format(3(i8,2x,1p,e10.4))
end
c-----
      subroutine wrtall(ncool)
c
c   write all data that may be needed for step 3 to a temporary file
c
      common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
      common /index/ nburn,ncrit,nlitol,ile,iact,ifp,itol,ncyc,nfis
      common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
      common /ident/ idlitl(40),idcrit(210),iddk(2000)
      common /adens/ adlitl(40),ltyp(40),adcrit(200),addk(2000)
      common /title/ ittl(20),lttl(20),crittl(20)
      dimension ncool(20)

c
c   we have not yet decided whether we should read in the value of nstep
c   or , rather, let it be a predetermined value (e.g. 76).
c
      nstep=76
      write(nstep) (ittl(i), i=1,20)
      write(nstep) n72,nout1,nors,n71,nice,nout3
      write(nstep) ncyc,burn,ntcool,nall
      write(nstep) (ncool(i),i=1,ntcool)
      write(nstep) nlitol,mixf,idmod,nfis
c
      if(nlitol.le.0) go to 1000
      write(nstep) (idlitol(i),adlitl(i),ltyp(i), i=1,nlitol)
1000  continue
      if(nfis.le.0) go to 2000
      write(nstep) (idcrit(i), i=1,ncrit)
2000  continue
      return
      end
c-----
      subroutine rdctin1
c
      common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
      common /index/ nburn,ncrit,nlitol,ile,iact,ifp,itol,ncyc,nfis
      common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
      common /ident/ idlitl(40),idcrit(210),iddk(2000)
      common /adens/ adlitl(40),ltyp(40),adcrit(200),addk(2000)
      common /title/ ittl(20),lttl(20),crittl(20)

```

```

character*6 ichk
dimension idat1(25),idat2(37),idat3(49),idat4(193)
data idat1/92234,92235,92236,92238,94238,94239,94240,94241,
&94242,95241,8016,42095,43099,45103,55133,55135,60143,60145,
&62147,62149,62150,62151,62152,63153,64155/
  data idat2/92234,92235,92236,92238,93237,94238,94239,94240,94241,
&94242,95241,95243,96244,8016,40093,42095,43099,44101,45103,46105,
&46108,47109,55133,55135,59141,60143,60145,61147,62147,62149,
&62150,62151,62152,63153,63154,63155,64155/
  data idat3/92234,92235,92236,92238,93237,94238,94239,94240,94241,
&94242,95241,95243,96244,8016,36083,40093,42095,43099,
&44101,44103,45103,45105,46105,46108,47109,53135,54131,54135,
&55133,55134,55135,59141,60143,60145,60147,60148,61147,61148,
&61149,62147,62149,62150,62151,62152,63153,63154,63155,64155,
&99999/
  data idat4/ 32072,32073,32074,32076,33075,34076,34077,34078,34080,
&34082,35079,35081,36080,36082,36083,36084,36085,36086,37085,37086,
&37087,38086,38087,38088,38089,38090,39089,39090,39091,40090,40091,
&40092,40093,40094,40095,40096,41093,41094,41095, 8016,42095,42096,
&42097,42098,42099,42100,43099,44099,44100,44101,44102,44104,44105,
&44106,46104,46105,46106,46107,46108,46110,47107,47109,47111,48108,
&48110,48111,48112,48113,48114, 48116,49113,49115,50115,50116,
&50117,50118,50119,50120,50122,50123,50124,50125,50126,51121,51123,
&51124,51125,51126,52122,52123,52124,52125,52126, 52128,
&52130,52132,53127,53129,53130,53131,54128,54129,54130,54131,54132,
&54133,54134,54136,55133,55134,55135,55136,55137,56134,56135,56136,
&56137,56138,56140,57139,57140,58140,58141,58142,58143,58144,59141,
&59142,59143,60142,60143,60144,60145,60146,60150,61151,62147,62148,
&62150,62151,62152,62153,62154,63151,63152,63156,63157,64154,64156,
&64157,64158,64160,65159,65160,66160,66161,66162,66163,66164,67165,
&68166,68167,44103,45103,45105,53135,54135,60147,60148,61147,61148,
&62149,61149,63153,63154,63155, 64155,90232,91233,92233,92234,
&92235,92236,92238,93237,94238,94239,94240,94241,94242,95241,
&95243,96244/
n5=5

c
c this routine puts in place the ids of the criticality nuclides.
c this is normally done by rdstp3 in step 3. it is done here
c when burn=0.
c
c check flag nfis to determine which fuel nuclides will be used in
c keno calculations:
c      =0 use ttc713 intersection with sid bierman's nucs
c      =-1 use ttc713
c      =-2 use ttc713 u sid u vepco u casmo
c      =-3 use all 27burnuplib nuclides
c      =n read in user's choice of nuclides
if(nfis.eq.0)then
  ncrit=25
  do 10 i=1,ncrit
  10  idcrit(i)=idat1(i)
  go to 500
  end if
  if(nfis.eq.-1)then
  ncrit=37
  do 20 i=1,ncrit
  20  idcrit(i)=idat2(i)
  go to 500
  end if
  if(nfis.eq.-2)then
  ncrit=49
  do 21 i=1,ncrit
  21  idcrit(i)=idat3(i)
  go to 500
  end if
  if(nfis.eq.-3)then
  ncrit=193
  do 31 i=1,ncrit

```

```

31  idcrit(i)=idat4(i)
    go to 500
    end if
    if(nfis.gt.0)ncrit=nfis
500  continue
c
c  write input to nout
c
    write(nout,120)ittl
    write(nout,130)n71
    write(nout,140)nice
    write(nout,140)nout
    write(nout,150)nfis
    write(nout,160)mixf
    write(nout,145)idmod
    write(nout,170)(idcrit(i),i=1,ncrit)
110  format(a6)
120  format(20a4)
130  format(4x,i2)
140  format(5x,i2)
145  format(6x,i2)
150  format(8x,i3)
160  format(5x,i4)
170  format(10(1x,i5))
    return
end
c-----
subroutine clect(iflag)
common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
common /index/ nburn,ncrit,nlitl,ile,iact,ifp,itol,ncyc,nfis
common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
common /ident/ idltl(40),idcrit(200),iddk(2000)
common /adens/ adltl(40),ltyp(40),adcrit(200),addk(2000)
common /title/ ittl(20),lttl(20),crittl(20)
dimension idlfp(165)
data idlfp/ 32072,32073,32074,32076,33075,34076,34077,34078,34080,
&34082,35079,35081,36080,36082,36083,36084,36085,36086,37085,37086,
&37087,38086,38087,38088,38089,38090,39089,39090,39091,40090,40091,
&40092,40093,40094,40095,40096,41093,41094,41095,42094,42095,42096,
&42097,42098,42099,42100,43099,44099,44100,44101,44102,44104,44105,
&44106,46104,46105,46106,46107,46108,46110,47107,47109,47111,48108,
&48110,48111,48112,48113,48114,48115,48116,49113,49115,50115,50116,
&50117,50118,50119,50120,50122,50123,50124,50125,50126,51121,51123,
&51124,51125,51126,52122,52123,52124,52125,52126,52127,52128,52129,
&52130,52132,53127,53129,53130,53131,54128,54129,54130,54131,54132,
&54133,54134,54136,55133,55134,55135,55136,55137,56134,56135,56136,
&56137,56138,56140,57139,57140,58140,58141,58142,58143,58144,59141,
&59142,59143,60142,60143,60144,60145,60146,60150,61151,62147,62148,
&62150,62151,62152,62153,62154,63151,63152,63156,63157,64154,64156,
&64157,64158,64160,65159,65160,66160,66161,66162,66163,66164,67165,
&68166,68167/
nlp=165
c
c  extract nuclides needed for criticality calculations for this
c  burnup and cooling time.  take requested light elements from
c  the light element library (1st ile entries in iddk/addk),
c  actinides from the actinide data (next iact entries in iddk/addk),
c  and fission products from the final ifp entries in iddk/addk)
c
c  nltl will be at least 1, to account for oxygen.  the only
c  situation that will allow it to be larger than 1 is if the
c  user has chosen to input a set of isotopics different from
c  the burnup credit nuclides (ie., ttc-0713 or bierman's) and
c  has chosen to enter more light elements than just oxygen
c
c  if iflag=1 change all iddk by factor of 10 (from 72 not 71)
    if(iflag.eq.0)go to 20
    do 10 i=1,itol

```

```

10  iddk(i)=iddk(i)/10
20  continue
    do 40 i=1,nlitl
    do 30 j=1,ile
      if(iddk(j).ne.idlitl(i)) go to 30
      adlitl(i)=addk(j)
      go to 40
30  continue
    write(nout,102)idlitl(i),n71
102 format('0'/'****error, no match for light element ',i8,
  &' was found on unit ',i2)
    stop 7102
40  continue
    nlp1=ile+1
    do 70 i=1,ncrit
      if(idcrit(i).eq.99999)go to 70
      adcrit(i)=0.0
      do 60 j=nlp1,itot
        if(iddk(j).ne.idcrit(i)) go to 60
        adcrit(i)=addk(j)
        go to 70
60  continue
    do 65 k=1,nlitl
      if(idcrit(i).eq.idlitl(k))go to 70
65  continue
    write(nout,103)idcrit(i),n71
103 format('0'/'****error, no match for nuclide ',i8,
  &' was found on unit ',i2)
    stop 7103
70  continue
c add contribution from light element and actinide/fission product libr
    do 80 i=1,nlitl
    do 80 j=1,ncrit
      if(idcrit(j).ne.idlitl(i))go to 80
      adcrit(j)=adcrit(j)+adlitl(i)
80  continue
c
    return
end
c-----
c----- subroutine wrtice
  common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
  common /index/ nburn,ncrit,nlitl,ile,iact,ifp,itet,ncyc,nfis
  common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
  common /ident/ idlitl(40),idcrit(200),iddk(2000)
  common /adens/ adlitl(40),ltyp(40),adcrit(200),addk(2000)
  common /title/ ittl(20),lttl(20),crittl(20)
  dimension i2(200),i5(200),i11(201),idact(7)
  character*4 dum,t,ice,end
  data idact/92234,92235,92236,92238,94239,94240,94241/
c
  t = ' t '
  ice = '#ice'
  end = 'end '
  mix=1
c
  write(nice,110)ice
  write(nice,110)ittl
110  format(20a4)
c
  dum = '1$$ '
  write(nice,110)dum
  ii = 0
  i4 = 10
  kopt = 4
  write(nice,120)mix,ncrit,ii,ii,ii,i4,kopt
120  format(6i12)
  write(nice,110)t

```

```

c
      do 10 i=1,ncrit
10   i2(i)=1
c
      dum = '2$$ '
      write(nice,110)dum
      write(nice,120)(i2(i),i=1,ncrit)
c
      if(idmod.eq.0)go to 35
      do 30 j=1,7
      do 30 i=1,ncrit
      if(idcrit(i).ne.idact(j))go to 30
      idcrit(i)=idcrit(i)+100000*idmod
      idact(j) =idact(j) +100000*idmod
30   continue
35   continue
c
      dum = '3$$ '
      write(nice,110)dum
      write(nice,120)(idcrit(i),i=1,ncrit)
c
      dum = '4** '
      write(nice,110)dum
      write(nice,130)(adcrit(i),i=1,ncrit)
130  format(1p,6e12.4)
c
      i5(1)=4
      dum = '5$$ '
      write(nice,110)dum
      write(nice,120)(i5(i),i=1,mix)
      write(nice,110)t
c
      dum= '7$$ '
      write(nice,110)dum
      write(nice,140)
      write(nice,110)t
140  format(' a8 2 e')
c
      i11(1)=1
      i11(2)=mixf
      dum = '11$$'
      write(nice,110)dum
      write(nice,120)(i11(i),i=1,mix+1)
      write(nice,110)t
      write(nice,110)end
c
      if(idmod.eq.0)go to 45
      do 40 j=1,7
      do 40 i=1,ncrit
      if(idcrit(i).ne.idact(j))go to 40
      idcrit(i)=idcrit(i)-100000*idmod
      idact(j) =idact(j) -100000*idmod
40   continue
45   continue
c
      return
end
c-----
subroutine wrtkeno
  common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
  common /index/ nburn,ncrit,nlitr,ile,iact,ifp,itol,ncyc,nfis
  common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
  common /ident/ idlitr(40),idcrit(200),iddk(2000)
  common /adens/ adlitr(40),ltyp(40),adcrit(200),addk(2000)
  common /title/ ittl(20),lttl(20),crittl(20)
  character*2 iname(105),ics(200)
  dimension mass(200),idact(7)
  data idact/92234,92235,92236,92238,94239,94240,94241/
  data iname/' h','he','li','be',' b',' c',' n',' o',' f',' ne',' na',
& 'mg','al','si',' p',' s',

```

```

&'cl','ar',' k','ca','sc','ti',' v','cr','mn','fe','co',
&'ni','cu','zn','ga','ge','as','se','br','kr','rb',
&'sr',' y','zr','nb','mo','tc','ru','rh','pd','ag','cd',
&'in','sn','sb','te',' i','xe','cs','ba','la','ce',
&'pr','nd','pm','sm','eu','gd','tb','dy','ho','er',
&'tm','yb','lu','hf','ta',' w','re','os','ir','pt',
&'au','hg','tl','pb','bi','po','at','rn','fr','ra',
&'ac','th','pa',' u','np','pu','am','cm','bk','cf',
&'es','fm','md','no','lr','rf','ha'
    do 15 k=1,ncrit
    if(idcrit(k).eq.99999)go to 15
    iz=idcrit(k)/1000
    mass(k)=idcrit(k)-iz*1000
    idff=iz/100
    if(idff.gt.0)iz=iz-idff*100
    ics(k)=iname(iz)
15   continue
    do 20 i=1,4
20   write(nout,101)
    write(nout,202)
    write(nout,101)
    do 30 j=1,ncrit
    if(idcrit(j).eq.99999)go to 30
    if(ics(j).eq.' o')then
    write(nout,206)ics(j),mixf,adcrit(j)
    go to 30
    end if
    if(mass(j).lt.10)write(nout,203)ics(j),mass(j),mixf,adcrit(j)
    if(mass(j).ge.10.and.mass(j).lt.100)write(nout,204)ics(j),
    &mass(j),mixf,adcrit(j)
    if(mass(j).ge.100)write(nout,205)ics(j),mass(j),mixf,adcrit(j)
30   continue
c
      if(idmod.eq.0)go to 5
      do 3 j=1,7
      do 3 i=1,ncrit
      if(idcrit(i).ne.idact(j))go to 3
      idcrit(i)=idcrit(i)+100000*idmod
      idact(j) =idact(j) +100000*idmod
3   continue
5   continue
c
      do 10 i=1,4
10   write(nout,101)
    write(nout,102)
    write(nout,101)
    write(nout,104)mixf
    write(nout,103)(idcrit(j),adcrit(j),j=1,ncrit)
c
      if(idmod.eq.0)go to 25
      do 23 j=1,7
      do 23 i=1,ncrit
      if(idcrit(i).ne.idact(j))go to 23
      idcrit(i)=idcrit(i)-100000*idmod
      idact(j) =idact(j) -100000*idmod
23   continue
25   continue
c
      return
101  format(a4)
102  format(' for use when mixing in keno')
103  format(i9,2x,1p,e10.4)
104  format(' mix=',i4)
202  format(' for use in csas')
203  format(2x,a2,'-,i1,4x,i3,2x,'0',2x,1p,e10.4,' end')
204  format(2x,a2,'-,i2,3x,i3,2x,'0',2x,1p,e10.4,' end')
205  format(2x,a2,'-,i3,2x,i3,2x,'0',2x,1p,e10.4,' end')
206  format(2x,a2,6x,i3,2x,'0',2x,1p,e10.4,' end')
      end

```

B.5: SNIKR3 Source Listing.

```

program snikr3
c new version, july, 1993.
c
c common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
c common /index/ nburn,ncrit,nlitr,ile,iact,ifp,itot,ncyc,nfis
c common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
c common /ident/ idlitr(40),idcrit(210),iddk(2000)
c common /adens/ adlitr(40),ltyp(40),adcrit(200),addk(2000)
c common /title/ ittl(20),lttl(20),crittl(20)
c dimension tym(20),ncool(20)
c
c read material to be transferred from step 1.
c
c     call rdstp3(ncool)
c
c     if(n72.eq.-1000) go to 2000
c
c     if(nall.eq.1) then
c       ntcool=11
c       do 10 k=1,11
c         ncool(k)=k-1
c 10   continue
c     endif
c
c loop through designated cooling times
c
c     do 1000 i=1,ntcool
c       npos=ncool(i)+1
c       call rdf71(npos,tym)
c       rewind n71
c       call clect(0)
c
c       write(nout,107)npos
c       write(nout,108)tym(npos)
c       write(nice,107)npos
c       write(nice,108)tym(npos)
c
c       call wrtice
c
c use mixed cross sections written on unit nice in keno calc
c
c 107 format('isotopic results for cool step ',i2)
c 108 format('origen-s cooling time (yrs)=',f10.2)
c
c     call wrtkeno
c 1000 continue
c
c 2000 continue
c
c     stop
c   end
c-----
c----- subroutine rdstp3(ncool)
c
c this module reads the data that were written to a temporary file
c (nstep) in step 1 and that may be needed in step 3.
c
c having read the data being passed from step 1, this routine then
c determines the criticality nuclide id numbers. it may read them
c from nstep or it may choose one of the sets in the data statements.
c
c common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
c common /index/ nburn,ncrit,nlitr,ile,iact,ifp,itot,ncyc,nfis
c common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep

```

```

common /ident/ idlitt(40),idcrit(210),iddk(2000)
common /adens/ adlitt(40),ltyp(40),adcrit(200),addk(2000)
common /title/ ittl(20),lttl(20),crittl(20)
character*6 ichk
dimension ncool(20)
dimension idat1(25),idat2(37),idat3(49),idat4(193)
data idat1/92234,92235,92236,92238,94238,94239,94240,94241,
&94242,95241,8016,42095,43099,45103,55133,55135,60143,60145,
&62147,62149,62150,62151,62152,63153,64155/
  data idat2/92234,92235,92236,92238,93237,94238,94239,94240,94241,
&94242,95241,95243,96244,8016,40093,42095,43099,44101,45103,46105,
&46108,47109,55133,55135,59141,60143,60145,61147,62147,62149,
&62150,62151,62152,63153,63154,63155,64155/
  data idat3/92234,92235,92236,92238,93237,94238,94239,94240,94241,
&94242,95241,95243,96244,8016,36083,40093,42095,43099,
&44101,44103,45103,45105,46105,46108,47109,53135,54131,54135,
&55133,55134,55135,59141,60143,60145,60147,60148,61147,61148,
&61149,62147,62149,62150,62151,62152,63153,63154,63155,64155,
&99999/
  data idat4/ 32072,32073,32074,32076,33075,34076,34077,34078,34080,
&34082,35079,35081,36080,36082,36083,36084,36085,36086,37085,37086,
&37087,38086,38087,38088,38089,38090,39089,39090,39091,40090,40091,
&40092,40093,40094,40095,40096,41093,41094,41095, 8016,42095,42096,
&42097,42098,42099,42100,43099,44099,44100,44101,44102,44104,44105,
&44106,46104,46105,46106,46107,46108,46110,47107,47109,47111,48108,
&48110,48111,48112,48113,48114, 48116,49113,49115,50115,50116,
&50117,50118,50119,50120,50122,50123,50124,50125,50126,51121,51123,
&51124,51125,51126,52122,52123,52124,52125,52126, 52128,
&52130,52132,53127,53129,53130,53131,54128,54129,54130,54131,54132,
&54133,54134,54136,55133,55134,55135,55136,55137,56134,56135,56136,
&56137,56138,56140,57139,57140,58140,58141,58142,58143,58144,59141,
&59142,59143,60142,60143,60144,60145,60146,60150,61151,62147,62148,
&62150,62151,62152,62153,62154,63151,63152,63156,63157,64154,64156,
&64157,64158,64160,65159,65160,66160,66161,66162,66163,66164,67165,
&68166,68167,44103,45103,45105,53135,54135,60147,60148,61147,61148,
&62149,61149,63153,63154,63155, 64155,90232,91233,92233,92234,
&92235,92236,92238,93237,94238,94239,94240,94241,94242,95241,
&95243,96244/
n5=5
nstep=76
c
c  read data from step 1.
c
read(nstep) (ittl(i), i=1,20)
read(nstep) n72,nout1,nors,n71,nice,nout3
if(n72.eq.-1000) return
read(nstep) ncyc,burn,ntcool,nall
read(nstep) (ncool(i),i=1,ntcool)
read(nstep) nlitl,mixf,idmod,nfis
nout=nout3
c
c  at this point nlitl will be at least one.
c
read(nstep) (idlittl(i),adlittl(i),ltyp(i), i=1,nlitl)
c
c  check flag nfis to determine which fuel nuclides will be used in
c  keno calculations:
c      =0  use ttc713 intersection with sid bierman's nucs
c      =-1 use ttc713
c      =-2 use ttc713 u sid u vepco u casmo
c      =-3 use all 27burnuplib nuclides
c      =n  read in user's choice of nuclides (from step 1)
c
if(nfis.eq.0)then
ncrit=25
do 10 i=1,ncrit
10 idcrit(i)=idat1(i)
go to 500

```

```

end if
if(nfis.eq.-1)then
  ncrit=37
  do 20 i=1,ncrit
20  idcrit(i)=idat2(i)
  go to 500
  end if
  if(nfis.eq.-2)then
    ncrit=49
    do 21 i=1,ncrit
21  idcrit(i)=idat3(i)
  go to 500
  end if
  if(nfis.eq.-3)then
    ncrit=193
    do 31 i=1,ncrit
31  idcrit(i)=idat4(i)
  go to 500
  end if
  if(nfis.gt.0)ncrit=nfis
500  continue
  if(nfis.le.0)go to 1000
  read(nstep) (idcrit(i), i=1,nfis)
1000 continue
c
c  write input to nout
c
      write(nout,120)ittl
      write(nout,130)burn
      write(nout,140)nltl
      write(nout,150)nfis
      write(nout,160)mixf
      write(nout,165)idmod
      write(nout,170)(idcrit(i),i=1,ncrit)
110  format(a6)
120  format(20a4)
130  format(4x,'burn= ',f10.0)
140  format(4x,'nltl= ',i5)
150  format(4x,'nfis= ',i5)
160  format(4x,'mixf= ',i5)
165  format(4x,'idmod= ',i5)
170  format(10(1x,i5))
      return
      end
c-----  

c----- subroutine rdf71(npos,tym)
c
c  this routine reads atom densities from the binary output
c  file on unit 'n71' written from origin-s for the decay time
c  corresponding to the position, npos(equal to ncool+1), where
c  ncool is returned from subroutine tymstp, and at the
c  requested burnup, burn.
c
      common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
      common /index/ nburn,ncrit,nltl,ile,iact,ifp,itol,ncyc,nfis
      common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
      common /ident/ idltl(40),idcrit(210),iddk(2000)
      common /adens/ adltl(40),ltyp(40),adcrit(200),addk(2000)
      common /title/ ittl(20),lttl(20),crittl(20)
      dimension tym(20)
c
c  iddk and addk are arrays containing the id's and number densities for
c  all nuclides used in the origin-s decay
c  case.  in this routine they are used to retrieve data from unit n71
c  before it is condensed into the adcrit array which will contain number
c  densities corresponding to the id's given in idcrit.  idcrit contains
c  ids for the nuclides to be used in the criticality analysis.  the
c  densities stored in adcrit are burnup dependent.

```

```

c
c   files needed in this subroutine should be opened by the main program
c
10    read(n71,end=100) itot,ile,iact,ifp,nd1,nd2,nstep,
      &n1,n2,n3,n4,n5,n6,n7,n8,n9,n10,n11,n12,n13,n14,n15,
      &n16,n17,n18,n19,n20,n21,n22,n23,r1,r2,r3,r4,tym(npos)
      write(nout,102) itot,ile,iact,ifp,nstep,tym(npos)
      if(nstep.eq.npos) then
        read(n71,end=100) (iddk(i),i=1,itot), (addk(i),i=1,itot)
        do 15 i=1,itot
c
c   added the following single line to eliminate double entry problem
c   caused by metastable isotopes (e.g., gd-155m) when dividing by
c   ten.  mdd 8/27/93 (as per smb change in old version of snikr3 6/16/93)
c   if(mod(iddk(i),10).gt.0) iddk(i) = 0
c
15    iddk(i)=iddk(i)/10
      ia1=ile+1
      ia2=ile+iact
      write(nout,103)(iddk(i),addk(i),i=ia1,ia2)
      go to 20
    endif
  read(n71,end=100) idumy
  go to 10
100   write(nout,101)n71
101   format('0'//****error reading unit ',i2)
      stop 7101
20    continue
102   format(5(1x,i4),f10.2)
103   format(4(i8,2x,1p,e10.4))
      return
    end
c-----
c----- subroutine clect(iflag)
common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
common /index/ nburn,ncrit,nlitl,ile,iact,ifp,itol,ncyc,nfis
common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
common /ident/ idlittl(40),idcrit(210),iddk(2000)
common /adens/ adlittl(40),ltyp(40),adcrit(200),addk(2000)
common /title/ ittl(20),lttl(20),crittl(20)
dimension idlfp(165)
data idlfp/ 32072,32073,32074,32076,33075,34076,34077,34078,34080,
  &34082,35082,35081,36080,36082,36083,36084,36085,36086,37085,37086,
  &37087,38086,38087,38088,38089,38090,39089,39090,39091,40090,40091,
  &40092,40093,40094,40095,40096,41093,41094,41095,42094,42095,42096,
  &42097,42098,42099,42100,43099,44099,44100,44101,44102,44104,44105,
  &44106,46104,46105,46106,46107,46108,46110,47107,47109,47111,48108,
  &48110,48111,48112,48113,48114,48601,48116,49113,49115,50115,50116,
  &50117,50118,50119,50120,50122,50123,50124,50125,50126,51121,51123,
  &51124,51125,51126,52122,52123,52124,52125,52126,52601,52128,52611,
  &52130,52132,53127,53129,53130,53131,54128,54129,54130,54131,54132,
  &54133,54134,54136,55133,55134,55135,55136,55137,56134,56135,56136,
  &56137,56138,56140,57139,57140,58140,58141,58142,58143,58144,59141,
  &59142,59143,60142,60143,60144,60145,60146,60150,61151,62147,62148,
  &62150,62151,62152,62153,62154,63151,63152,63156,63157,64154,64156,
  &64157,64158,64160,65159,65160,66160,66161,66162,66163,66164,67165,
  &68166,68167/
      nlfp=165
c
c   extract nuclides needed for criticality calculations for this
c   burnup and cooling time.  take requested light elements from
c   the light element library (1st ile entries in iddk/addk),
c   actinides from the actinide data (next iact entries in iddk/addk),
c   and fission products from the final ifp entries in iddk/addk)
c
c   nlitl will be at least 1, to account for oxygen.  the only
c   situation that will allow it to be larger than 1 is if the
c   user has chosen to input a set of isotopics different from

```

```

c  the burnup credit nuclides (ie., ttc-0713 or bierman's) and
c  has chosen to enter more light elements than just oxygen
c
c  if iflag=1 change all iddk by factor of 10 (from 72 not 71)
c
c      if(iflag.eq.0)go to 20
c          do 10 i=1,itol
c 10    iddk(i)=iddk(i)/10
c 20    continue
c          do 40 i=1,nlitl
c          do 30 j=1,ile
c            if(iddk(j).ne.idlitl(i)) go to 30
c            adlitl(i)=addk(j)
c            go to 40
c 30    continue
c            write(nout,102)idlitl(i),n71
c 102   format('0'/'****error, no match for light element ',i8,
c &' was found on unit ',i2)
c            stop 7102
c 40    continue
c          nlp1=ile+1
c          do 70 i=1,ncrit
c            if(idcrit(i).eq.99999)go to 70
c            adcrit(i)=0.0
c            do 60 j=nlp1,itol
c              if(iddk(j).ne.idcrit(i)) go to 60
c              adcrit(i)=addk(j)
c              go to 70
c 60    continue
c          do 65 k=1,nlitl
c            if(idcrit(i).eq.idlitl(k))go to 70
c 65    continue
c            write(nout,103)idcrit(i),n71
c 103   format('0'/'****error, no match for nuclide ',i8,
c &' was found on unit ',i2)
c            stop 7103
c 70    continue
c
c  add contribution from light element and actinide/fission product libr
c      do 80 i=1,nlitl
c      do 80 j=1,ncrit
c        if(idcrit(j).ne.idlitl(i))go to 80
c        adcrit(j)=adcrit(j)+adlitl(i)
c 80    continue
c
c      return
c      end
c-----
c----- subroutine wrtice
c----- common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
c----- common /index/ nburn,ncrit,nlitl,ile,iact,ifp,itol,ncyc,nfis
c----- common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
c----- common /ident/ idlitl(40),idcrit(210),iddk(2000)
c----- common /adens/ adlitl(40),ltyp(40),adcrit(200),addk(2000)
c----- common /title/ ittl(20),lttl(20),crittl(20)
c----- dimension i2(200),i5(200),i11(201),idact(7)
c----- character*4 dum,t,ice,end
c----- data idact/92234,92235,92236,92238,94239,94240,94241/
c
c      t = ' t '
c      ice = '#ice'
c      end = 'end '
c      mix=1
c
c      write(nice,110)ice
c      write(nice,110)ittl
c 110  format(20a4)
c
c      dum = '1$$ '

```

```

write(nice,110)dum
ii = 0
i4 = 10
kopt = 4
write(nice,120)mix,ncrit,ii,ii,ii,i4,kopt
120 format(6i12)
write(nice,110)t
c
do 10 i=1,ncrit
10 i2(i)=1
c
dum = '2$$ '
write(nice,110)dum
write(nice,120)(i2(i),i=1,ncrit)
c
if(idmod.eq.0)go to 35
do 30 j=1,7
do 30 i=1,ncrit
if(idcrit(i).ne.idact(j))go to 30
idcrit(i)=idcrit(i)+100000*idmod
idact(j) =idact(j) +100000*idmod
30 continue
35 continue
c
dum = '3$$ '
write(nice,110)dum
write(nice,120)(idcrit(i),i=1,ncrit)
c
dum = '4** '
write(nice,110)dum
write(nice,130)(adcrit(i),i=1,ncrit)
130 format(1p,6e12.4)
c
i5(1)=4
dum = '5$$ '
write(nice,110)dum
write(nice,120)(i5(i),i=1,mix)
write(nice,110)t
c
dum= '7$$ '
write(nice,110)dum
write(nice,140)
write(nice,110)t
140 format(' a8 2 e')
c
i11(1)=1
i11(2)=mixf
dum = '11$$'
write(nice,110)dum
write(nice,120)(i11(i),i=1,mix+1)
write(nice,110)t
write(nice,110)end
c
if(idmod.eq.0)go to 45
do 40 j=1,7
do 40 i=1,ncrit
if(idcrit(i).ne.idact(j))go to 40
idcrit(i)=idcrit(i)-100000*idmod
idact(j) =idact(j) -100000*idmod
40 continue
45 continue
c
return
end
c-----
subroutine wrtkeno
common /const/ bconv,burn,cool,mixf,idmod,smact0,ntcool,nall
common /index/ nburn,ncrit,nlitr,ile,iact,ifp,itol,ncyc,nfis

```

```

common /untnos/ n72,nout,nout1,nout3,n71,nors,nice,nstep
common /ident/ idlilit(40),idcrit(210),iddk(2000)
common /adens/ adlilit(40),ltyp(40),adcrit(200),addk(2000)
common /title/ ittl(20),lttl(20),crittl(20)
character*2 iname(105),ics(200)
dimension mass(200),idact(7)
data idact/92234,92235,92236,92238,94239,94240,94241/
data iname/' h','he','li','be',' b',' c',' n',' o',' f',' ne',' na',
&' mg','al','si',' p',' s',
&' cl','ar',' k','ca','sc','ti',' v','cr','mn','fe','co',
&' ni','cu','zn','ga','ge','as','se','br','kr','rb',
&' sr',' y','zr','nb','mo','tc','ru','rh','pd','ag','cd',
&' in','sn','sb','te',' i','xe','cs','ba','la','ce',
&' pr','nd','pm','sm','eu','gd','tb','dy','ho','er',
&' tm','yb','lu','hf','ta',' w','re','os','ir','pt',
&' au','hg','tl','pb','bi','po','at','rn','fr','ra',
&' ac','th','pa',' u','np','pu','am','cm','bk','cf',
&' es','fm','md','no','lr','rf','ha'
do 15 k=1,ncrit
if(idcrit(k).eq.99999)go to 15
iz=idcrit(k)/1000
mass(k)=idcrit(k)-iz*1000
idff=iz/100
if(idff.gt.0)iz=iz-idff*100
ics(k)=iname(iz)
15 continue
do 20 i=1,4
20 write(nout,101)
write(nout,202)
write(nout,101)
do 30 j=1,ncrit
if(idcrit(j).eq.99999)go to 30
if(ics(j).eq.' o')then
write(nout,206)ics(j),mixf,adcrit(j)
go to 30
end if
if(mass(j).lt.10)write(nout,203)ics(j),mass(j),mixf,adcrit(j)
if(mass(j).ge.10.and.mass(j).lt.100)write(nout,204)ics(j),
&mass(j),mixf,adcrit(j)
if(mass(j).ge.100)write(nout,205)ics(j),mass(j),mixf,adcrit(j)
30 continue
c
if(idmod.eq.0)go to 5
do 3 j=1,7
do 3 i=1,ncrit
if(idcrit(i).ne.idact(j))go to 3
idcrit(i)=idcrit(i)+100000*idmod
idact(j) =idact(j) +100000*idmod
3 continue
5 continue
c
do 10 i=1,4
10 write(nout,101)
write(nout,102)
write(nout,101)
write(nout,104)mixf
write(nout,103)(idcrit(j),adcrit(j),j=1,ncrit)
c
if(idmod.eq.0)go to 25
do 23 j=1,7
do 23 i=1,ncrit
if(idcrit(i).ne.idact(j))go to 23
idcrit(i)=idcrit(i)-100000*idmod
idact(j) =idact(j) -100000*idmod
23 continue
25 continue
c
return

```

```
101 format(a4)
102 format(' for use when mixing in keno')
103 format(i9,2x,1p,e10.4)
104 format(' mix=',i4)
202 format(' for use in csas')
203 format(2x,a2,'-',i1,4x,i3,2x,'0',2x,1p,e10.4,' end')
204 format(2x,a2,'-',i2,3x,i3,2x,'0',2x,1p,e10.4,' end')
205 format(2x,a2,'-',i3,2x,i3,2x,'0',2x,1p,e10.4,' end')
206 format(2x,a2,6x,i3,2x,'0',2x,1p,e10.4,' end')
end
```

APPENDIX C

SCALE CSASN-SEQUENCE INPUT LISTINGS

This appendix contains three listings:

- C.1: **TMISUBZ1 Listing.** Input listing for a CSASN case used to compute AMPX working format microscopic cross-sections for subzone 1 fuel, including all 48 actinides and fission products plus APSR materials.
- C.2: **TMISUBZ2 Listing.** Input listing for a CSASN case used to compute AMPX working format microscopic cross-sections for subzone 2 fuel, including only the seven most important actinides in the fuel mixture.
- C.3: **TMISUBZ9 Listing.** Input listing for a CSASN case used to compute AMPX working format microscopic cross-sections for subzone 9 fuel, including only the four uranium isotopes present in fresh fuel.

C.1: TMISUBZ1 Listing

```
=csasn
Subzone 1(Zone 1), Ave. Burnup=24688 MWD/MTU
27burnup latticecell
  u-234    1  0  3.5398E-06  551  end
  u-235    1  0  1.9396E-04  551  end
  u-236    1  0  7.3742E-05  551  end
  u-238    1  0  2.2150E-02  551  end
  np-237   1  0  7.6445E-06  551  end
  pu-238   1  0  2.0299E-06  551  end
  pu-239   1  0  1.1939E-04  551  end
  pu-240   1  0  4.2740E-05  551  end
  pu-241   1  0  1.7661E-05  551  end
  pu-242   1  0  6.7702E-06  551  end
  am-241   1  0  7.2966E-06  551  end
  am-243   1  0  1.1341E-06  551  end
  cm-244   1  0  1.7108E-07  551  end
  o        1  0  4.6454E-02  551  end
  kr-83    1  0  2.1542E-06  551  end
  zr-93    1  0  2.1158E-05  551  end
  mo-95    1  0  3.3743E-05  551  end
  tc-99    1  0  3.3551E-05  551  end
  ru-101   1  0  3.1763E-05  551  end
  ru-103   1  0  5.8017E-25  551  end
  rh-103   1  0  2.0281E-05  551  end
  rh-105   1  0  0.0000E+00  551  end
  pd-105   1  0  1.5271E-05  551  end
  pd-108   1  0  5.3048E-06  551  end
  ag-109   1  0  3.3890E-06  551  end
  i-135    1  0  0.0000E+00  551  end
  xe-131   1  0  1.4856E-05  551  end
  xe-135   1  0  0.0000E+00  551  end
  cs-133   1  0  3.6801E-05  551  end
  cs-134   1  0  3.1880E-07  551  end
  cs-135   1  0  1.1736E-05  551  end
  pr-141   1  0  3.2960E-05  551  end
  nd-143   1  0  2.4846E-05  551  end
  nd-145   1  0  1.9841E-05  551  end
  nd-147   1  0  0.0000E+00  551  end
  nd-148   1  0  1.0206E-05  551  end
  pm-147   1  0  1.0230E-06  551  end
  pm-148   1  0  6.2838E-28  551  end
  pm-149   1  0  0.0000E+00  551  end
  sm-147   1  0  7.0185E-06  551  end
  sm-149   1  0  1.1882E-07  551  end
  sm-150   1  0  8.7331E-06  551  end
  sm-151   1  0  4.3137E-07  551  end
  sm-152   1  0  3.7387E-06  551  end
  eu-153   1  0  2.8292E-06  551  end
  eu-154   1  0  5.2182E-07  551  end
  eu-155   1  0  1.2753E-07  551  end
  gd-155   1  0  2.1492E-07  551  end
zircalloy 2 1  551  end
h2o 3 den=0.7700 1  551 end
boron 3 den=0.7700 1182.0E-6 551 end
ag-107      4  den=10.18 .5184 551 end
ag-109      4  den=10.181 .4816 551 end
in-113      4  den=10.18 0.043 551 end
in-115      4  den=10.18 0.957 551 end
cd          4  den=10.18 1.0 551 end
ss304      5  1.0 551 end
arb mzro2 5.5899 2  0 1 0  40000 1 8016 2 6  1.0 551 end
end comp
squarepitch 1.44272 .936244 1  3  1.0922 2  .95758 0  end
end
```

C.2: TMISUBZ2 Listing

```
=csasn
Subzone 2(Zone 1), Ave. Burnup=21034 MWD/MTU
27burnup latticecell
  u-234    1  0  3.7539E-06  551  end
  u-235    1  0  2.3563E-04  551  end
  u-236    1  0  6.7794E-05  551  end
  u-238    1  0  2.2227E-02  551  end
  pu-239   1  0  1.1468E-04  551  end
  pu-240   1  0  3.6105E-05  551  end
  pu-241   1  0  1.4586E-05  551  end
  o       1  0  4.6454E-02  551  end
zircalloy 2 1  551  end
h2o  3 den=0.7700  1  551 end
boron 3 den=0.7700  1182.0E-6  551 end
end comp
squarepitch 1.44272 .936244 1  3  1.0922 2  .95758 0  end
end
```

C.3: TMISUBZ9 Listing

```
=csasn
Subzone 9(Zone 4), Ave. Burnup=0 MWD/MTU
27burnup latticecell
  u-234    1  0  5.6679E-06  551  end
  u-235    1  0  6.7019E-04  551  end
  u-236    1  0  3.0441E-05  551  end
  u-238    1  0  2.2548E-02  551  end
  o        1  0  4.6454E-02  551  end
zircalloy 2 1  551  end
h2o 3 den=0.7700 1  551 end
boron 3 den=0.7700 1182.0E-6 551 end
end comp
squarepitch 1.44272 .936244 1  3  1.0922 2  .95758 0  end
end
```

APPENDIX D

WAX INPUT LISTING

This appendix lists the input used in the WAX calculation used to create a single working library for KENO.

```

=wax
'write final library to unit 4 / biggest input lib is on unit 31
0$$ 4 31
'input xsec's from 10 libs
1$$ 9 t
'input xsec's for fuel subzone 1. this contains all fission prods
2$$ 31 0 t
'input xsec's for fuel subzone 2
2$$ 32 7 t
3$$ 92234 92235 92236 92238 94239 94240 94241
4$$ 292234 292235 292236 292238 294239 294240 294241 t
'input xsec's for fuel subzone 3
2$$ 33 7 t
3$$ 92234 92235 92236 92238 94239 94240 94241
4$$ 392234 392235 392236 392238 394239 394240 394241 t
'input xsec's for fuel subzone 4
2$$ 34 7 t
3$$ 92234 92235 92236 92238 94239 94240 94241
4$$ 492234 492235 492236 492238 494239 494240 494241 t
'input xsec's for fuel subzone 5
2$$ 35 7 t
3$$ 92234 92235 92236 92238 94239 94240 94241
4$$ 592234 592235 592236 592238 594239 594240 594241 t
'input xsec's for fuel subzone 6
2$$ 36 7 t
3$$ 92234 92235 92236 92238 94239 94240 94241
4$$ 692234 692235 692236 692238 694239 694240 694241 t
'input xsec's for fuel subzone 7
2$$ 37 7 t
3$$ 92234 92235 92236 92238 94239 94240 94241
4$$ 792234 792235 792236 792238 794239 794240 794241 t
'input xsec's for fuel subzone 8
2$$ 38 7 t
3$$ 92234 92235 92236 92238 94239 94240 94241
4$$ 892234 892235 892236 892238 894239 894240 894241 t
'input xsec's for fuel subzone 9. this subzone contains fresh fuel only.
2$$ 39 4 t
3$$ 92234 92235 92236 92238
4$$ 992234 992235 992236 992238 t
end

```

APPENDIX E

KENO V.a INPUT LISTING

This appendix lists the input used in the KENO V.a k_{eff} calculation for the TMI Unit 1 Core at BOC-5 under HZP conditions.

```

=kenov
TMI Unit 1, Cycle 5, BOC, HZP, ARO, 1/8 core symmetry
'
' *** * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * *
' *** *
' *** *          Full core KENO V.a reactor configuration      * ***
' *** *          for TMI Unit-1 BOC-5, HZP conditions        * ***
' *** *          1 plane model                            * ***
' *** *
' *** *          by                                * ***
' *** *          Mark D. DeHart                      * ***
' *** *          Oak Ridge National Laboratory       * ***
' *** *
' *** *          August 1993                         * ***
' *** * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * * *
'

read parm
run=yes plt=yes nub=yes fdn=yes tme=240.0 gen=1003 npg=1000
wrs=34 res=50
lib=4 nb8=2400 nl8=880 end parm
read mixt
sct=2
mix=101
'Batch 4B (Zone 1 Sub-zone 1), Assembly H8 , Burnup=25199 MWD/MTU
 92234 3.5219E-06
 92235 1.9062E-04
 92236 7.4198E-05
 92238 2.2143E-02
 93237 7.7749E-06
 94238 2.0951E-06
 94239 1.1971E-04
 94240 4.3292E-05
 94241 1.7913E-05
 94242 6.9845E-06
 95241 7.4040E-06
 95243 1.1868E-06
 96244 1.8217E-07
 8016 4.6454E-02
 36083 2.1719E-06
 40093 2.1403E-05
 42095 3.4139E-05
 43099 3.3953E-05
 44101 3.2191E-05
 44103 5.8298E-25
 45103 2.0514E-05
 45105 0.0000E+00
 46105 1.5550E-05
 46108 5.4215E-06
 47109 3.4528E-06
 53135 0.0000E+00
 54131 1.5008E-05
 54135 0.0000E+00
 55133 3.7236E-05
 55134 3.2658E-07
 55135 1.1891E-05
 59141 3.3382E-05
 60143 2.5057E-05
 60145 2.0066E-05
 60147 0.0000E+00
 60148 1.0343E-05
 61147 1.0269E-06
 61148 6.3103E-28
 61149 0.0000E+00
 62147 7.0677E-06
 62149 1.1900E-07
 62150 8.8669E-06
 62151 4.3417E-07
 62152 3.7844E-06

```

```

63153 2.8805E-06
63154 5.3582E-07
63155 1.3064E-07
64155 2.2016E-07
mix=102
'Batch 5 (Zone 2 Sub-zone 4), Assembly H9 , Burnup=18313 MWD/MTU
492234 4.3043E-06
492235 3.0440E-04
492236 6.5943E-05
492238 2.2236E-02
93237 5.2161E-06
94238 9.3473E-07
494239 1.1159E-04
494240 3.0023E-05
494241 1.1988E-05
94242 2.9296E-06
95241 4.8360E-06
95243 3.4268E-07
96244 3.4098E-08
8016 4.6454E-02
36083 1.8067E-06
40093 1.6519E-05
42095 2.6191E-05
43099 2.5747E-05
44101 2.3597E-05
44103 5.5877E-25
45103 1.5516E-05
45105 0.0000E+00
46105 9.9025E-06
46108 3.0830E-06
47109 2.0966E-06
53135 0.0000E+00
54131 1.1761E-05
54135 0.0000E+00
55133 2.8329E-05
55134 1.8521E-07
55135 8.9558E-06
59141 2.4948E-05
60143 2.0684E-05
60145 1.5502E-05
60147 0.0000E+00
60148 7.6169E-06
61147 9.6606E-07
61148 5.9421E-28
61149 0.0000E+00
62147 5.9377E-06
62149 1.2173E-07
62150 6.2795E-06
62151 3.9482E-07
62152 2.8038E-06
63153 1.8347E-06
63154 2.7233E-07
63155 7.4319E-08
64155 1.2530E-07
mix=103
'Batch 6 (Zone 3 Sub-zone 8), Assembly H10, Burnup= 6683 MWD/MTU
892234 5.1368E-06
892235 5.0602E-04
892236 3.2194E-05
892238 2.2441E-02
93237 1.2979E-06
94238 7.9321E-08
894239 6.5339E-05
894240 7.9780E-06
894241 1.9053E-06
94242 1.4377E-07
95241 7.3797E-07
95243 5.2456E-09

```

```

96244 1.6331E-10
8016  4.6454E-02
36083 7.8706E-07
40093 6.5330E-06
42095 1.0222E-05
43099 9.9976E-06
44101 8.6071E-06
44103 3.9041E-25
45103 5.7569E-06
45105 0.0000E+00
46105 2.6895E-06
46108 5.9830E-07
47109 4.3415E-07
53135 0.0000E+00
54131 4.7032E-06
54135 0.0000E+00
55133 1.0974E-05
55134 2.6988E-08
55135 3.6328E-06
59141 9.3939E-06
60143 8.9193E-06
60145 6.1422E-06
60147 0.0000E+00
60148 2.8072E-06
61147 5.1914E-07
61148 2.8756E-28
61149 0.0000E+00
62147 2.7293E-06
62149 9.4849E-08
62150 2.0317E-06
62151 2.6678E-07
62152 9.6003E-07
63153 4.3927E-07
63154 3.0961E-08
63155 2.0080E-08
64155 3.3914E-08
mix=104
'Batch 4B (Zone 1 Sub-zone 1), Assembly H11, Burnup=23926 MWD/MTU
92234 3.5809E-06
92235 2.0171E-04
92236 7.2671E-05
92238 2.2165E-02
93237 7.3487E-06
94238 1.8858E-06
94239 1.1860E-04
94240 4.1469E-05
94241 1.7080E-05
94242 6.2947E-06
95241 7.0489E-06
95243 1.0199E-06
96244 1.4780E-07
8016  4.6454E-02
36083 2.1132E-06
40093 2.0601E-05
42095 3.2840E-05
43099 3.2635E-05
44101 3.0794E-05
44103 5.7359E-25
45103 1.9748E-05
45105 0.0000E+00
46105 1.4644E-05
46108 5.0437E-06
47109 3.2452E-06
53135 0.0000E+00
54131 1.4508E-05
54135 0.0000E+00
55133 3.5810E-05
55134 3.0144E-07

```

```

55135 1.1385E-05
59141 3.2002E-05
60143 2.4358E-05
60145 1.9327E-05
60147 0.0000E+00
60148 9.8956E-06
61147 1.0137E-06
61148 6.2209E-28
61149 0.0000E+00
62147 6.9034E-06
62149 1.1840E-07
62150 8.4303E-06
62151 4.2499E-07
62152 3.6345E-06
63153 2.7132E-06
63154 4.9058E-07
63155 1.2061E-07
64155 2.0328E-07
mix=105
'Batch 6 (Zone 3 Sub-zone 6), Assembly H12, Burnup= 9540 MWD/MTU
 692234 4.9208E-06
 692235 4.4833E-04
 692236 4.2181E-05
 692238 2.2393E-02
 93237 2.1162E-06
 94238 1.8762E-07
 694239 8.1972E-05
 694240 1.3274E-05
 694241 3.9711E-06
 94242 4.4897E-07
 95241 1.5598E-06
 95243 2.4750E-08
 96244 1.1336E-09
 8016 4.6454E-02
 36083 1.0743E-06
 40093 9.1241E-06
 42095 1.4336E-05
 43099 1.4090E-05
 44101 1.2295E-05
 44103 4.1867E-25
 45103 8.2426E-06
 45105 0.0000E+00
 46105 4.2259E-06
 46108 1.0621E-06
 47109 7.6709E-07
 53135 0.0000E+00
 54131 6.5803E-06
 54135 0.0000E+00
 55133 1.5459E-05
 55134 5.4013E-08
 55135 5.1889E-06
 59141 1.3296E-05
 60143 1.2217E-05
 60145 8.5796E-06
 60147 0.0000E+00
 60148 3.9935E-06
 61147 6.6689E-07
 61148 3.8440E-28
 61149 0.0000E+00
 62147 3.6780E-06
 62149 1.0140E-07
 62150 3.0383E-06
 62151 3.0499E-07
 62152 1.4349E-06
 63153 7.2089E-07
 63154 6.6692E-08
 63155 2.9464E-08
 64155 4.9775E-08

```

```

mix=106
'Batch 5 (Zone 2 Sub-zone 4), Assembly H13, Burnup=17603 MWD/MTU
 492234 4.3512E-06
 492235 3.1444E-04
 492236 6.4362E-05
 492238 2.2249E-02
 93237 4.9434E-06
 94238 8.4781E-07
 494239 1.1002E-04
 494240 2.8697E-05
 494241 1.1341E-05
 94242 2.6398E-06
 95241 4.5653E-06
 95243 2.9520E-07
 96244 2.7977E-08
 8016 4.6454E-02
 36083 1.7552E-06
 40093 1.5949E-05
 42095 2.5273E-05
 43099 2.4828E-05
 44101 2.2685E-05
 44103 5.5285E-25
 45103 1.4958E-05
 45105 0.0000E+00
 46105 9.3941E-06
 46108 2.8898E-06
 47109 1.9770E-06
 53135 0.0000E+00
 54131 1.1376E-05
 54135 0.0000E+00
 55133 2.7324E-05
 55134 1.7218E-07
 55135 8.6161E-06
 59141 2.4023E-05
 60143 2.0080E-05
 60145 1.4971E-05
 60147 0.0000E+00
 60148 7.3249E-06
 61147 9.4956E-07
 61148 5.8295E-28
 61149 0.0000E+00
 62147 5.7866E-06
 62149 1.2097E-07
 62150 6.0009E-06
 62151 3.8808E-07
 62152 2.6982E-06
 63153 1.7344E-06
 63154 2.5047E-07
 63155 6.9630E-08
 64155 1.1740E-07

mix=107
'Batch 6 (Zone 3 Sub-zone 6), Assembly H14, Burnup= 9540 MWD/MTU
 692234 4.9208E-06
 692235 4.4833E-04
 692236 4.2181E-05
 692238 2.2393E-02
 93237 2.1162E-06
 94238 1.8762E-07
 694239 8.1972E-05
 694240 1.3274E-05
 694241 3.9711E-06
 94242 4.4897E-07
 95241 1.5598E-06
 95243 2.4750E-08
 96244 1.1336E-09
 8016 4.6454E-02
 36083 1.0743E-06
 40093 9.1241E-06

```

```

42095 1.4336E-05
43099 1.4090E-05
44101 1.2295E-05
44103 4.1867E-25
45103 8.2426E-06
45105 0.0000E+00
46105 4.2259E-06
46108 1.0621E-06
47109 7.6709E-07
53135 0.0000E+00
54131 6.5803E-06
54135 0.0000E+00
55133 1.5459E-05
55134 5.4013E-08
55135 5.1889E-06
59141 1.3296E-05
60143 1.2217E-05
60145 8.5796E-06
60147 0.0000E+00
60148 3.9935E-06
61147 6.6689E-07
61148 3.8440E-28
61149 0.0000E+00
62147 3.6780E-06
62149 1.0140E-07
62150 3.0383E-06
62151 3.0499E-07
62152 1.4349E-06
63153 7.2089E-07
63154 6.6692E-08
63155 2.9464E-08
64155 4.9775E-08
mix=108
'Batch 7 (Zone 4 Sub-zone 9), Assembly H15, Burnup=0 MWD/MTU
992234 5.6679E-06
992235 6.7019E-04
992236 3.0441E-06
992238 2.2548E-02
8016 4.6454E-02
mix=109
'Batch 6 (Zone 3 Sub-zone 7), Assembly K9 , Burnup= 7969 MWD/MTU
792234 5.0387E-06
792235 4.7927E-04
792236 3.6847E-05
792238 2.2419E-02
93237 1.6508E-06
94238 1.2111E-07
794239 7.3411E-05
794240 1.0315E-05
794241 2.7696E-06
94242 2.5485E-07
95241 1.0796E-06
95243 1.1413E-08
96244 4.2523E-10
8016 4.6454E-02
36083 9.1964E-07
40093 7.7125E-06
42095 1.2092E-05
43099 1.1854E-05
44101 1.0268E-05
44103 4.0399E-25
45103 6.8811E-06
45105 0.0000E+00
46105 3.3579E-06
46108 7.9396E-07
47109 5.7604E-07
53135 0.0000E+00
54131 5.5596E-06

```

```

54135 0.0000E+00
55133 1.3009E-05
55134 3.8126E-08
55135 4.3341E-06
59141 1.1158E-05
60143 1.0439E-05
60145 7.2521E-06
60147 0.0000E+00
60148 3.3422E-06
61147 5.9017E-07
61148 3.3402E-28
61149 0.0000E+00
62147 3.1707E-06
62149 9.8015E-08
62150 2.4790E-06
62151 2.8511E-07
62152 1.1748E-06
63153 5.5975E-07
63154 4.5199E-08
63155 2.4099E-08
64155 4.0708E-08
mix=110
'Batch 5 (Zone 2 Sub-zone 3), Assembly K10, Burnup=20929 MWD/MTU
392234 4.1364E-06
392235 2.6965E-04
392236 7.1296E-05
392238 2.2187E-02
93237 6.2389E-06
94238 1.2977E-06
394239 1.1650E-04
394240 3.4792E-05
394241 1.4303E-05
94242 4.1246E-06
95241 5.8139E-06
95243 5.6068E-07
96244 6.5837E-08
8016 4.6454E-02
36083 1.9855E-06
40093 1.8579E-05
42095 2.9509E-05
43099 2.9079E-05
44101 2.6950E-05
44103 5.7563E-25
45103 1.7516E-05
45105 0.0000E+00
46105 1.1837E-05
46108 3.8345E-06
47109 2.5499E-06
53135 0.0000E+00
54131 1.3126E-05
54135 0.0000E+00
55133 3.1960E-05
55134 2.3607E-07
55135 1.0203E-05
59141 2.8335E-05
60143 2.2784E-05
60145 1.7415E-05
60147 0.0000E+00
60148 8.6901E-06
61147 1.0166E-06
61148 6.2885E-28
61149 0.0000E+00
62147 6.4531E-06
62149 1.2403E-07
62150 7.3091E-06
62151 4.1869E-07
62152 3.1848E-06
63153 2.2133E-06

```

```

63154 3.5983E-07
63155 9.3204E-08
64155 1.5713E-07
mix=111
'Batch 6 (Zone 3 Sub-zone 8), Assembly K11, Burnup= 5802 MWD/MTU
892234 5.2049E-06
892235 5.2514E-04
892236 2.8848E-05
892238 2.2455E-02
93237 1.0723E-06
94238 5.6652E-08
894239 5.9168E-05
894240 6.4462E-06
894241 1.3894E-06
94242 8.9587E-08
95241 5.3580E-07
95243 2.7747E-09
96244 7.5534E-11
8016 4.6454E-02
36083 6.9297E-07
40093 5.7114E-06
42095 8.9226E-06
43099 8.7126E-06
44101 7.4687E-06
44103 3.7883E-25
45103 4.9832E-06
45105 0.0000E+00
46105 2.2550E-06
46108 4.7735E-07
47109 3.4547E-07
53135 0.0000E+00
54131 4.1059E-06
54135 0.0000E+00
55133 9.5642E-06
55134 2.0375E-08
55135 3.1520E-06
59141 8.1770E-06
60143 7.8437E-06
60145 5.3690E-06
60147 0.0000E+00
60148 2.4396E-06
61147 4.6579E-07
61148 2.5286E-28
61149 0.0000E+00
62147 2.4124E-06
62149 9.2457E-08
62150 1.7313E-06
62151 2.5218E-07
62152 8.1307E-07
63153 3.6305E-07
63154 2.2885E-08
63155 1.7465E-08
64155 2.9493E-08
mix=112
'Batch 5 (Zone 2 Sub-zone 4), Assembly K12, Burnup=18740 MWD/MTU
492234 4.2764E-06
492235 2.9849E-04
492236 6.6868E-05
492238 2.2228E-02
93237 5.3813E-06
94238 9.8938E-07
494239 1.1248E-04
494240 3.0815E-05
494241 1.2374E-05
94242 3.1112E-06
95241 4.9978E-06
95243 3.7354E-07
96244 3.8242E-08

```

```

 8016  4.6454E-02
36083  1.8371E-06
40093  1.6859E-05
42095  2.6739E-05
43099  2.6297E-05
44101  2.4146E-05
44103  5.6207E-25
45103  1.5849E-05
45105  0.0000E+00
46105  1.0211E-05
46108  3.2014E-06
47109  2.1693E-06
53135  0.0000E+00
54131  1.1989E-05
54135  0.0000E+00
55133  2.8929E-05
55134  1.9320E-07
55135  9.1598E-06
59141  2.5504E-05
60143  2.1040E-05
60145  1.5819E-05
60147  0.0000E+00
60148  7.7923E-06
61147  9.7540E-07
61148  6.0060E-28
61149  0.0000E+00
62147  6.0262E-06
62149  1.2216E-07
62150  6.4473E-06
62151  3.9881E-07
62152  2.8669E-06
63153  1.8955E-06
63154  2.8588E-07
63155  7.7231E-08
64155  1.3021E-07
mix=113
'Batch 6 (Zone 3 Sub-zone 7), Assembly K13, Burnup= 7090 MWD/MTU
 792234  5.1056E-06
 792235  4.9741E-04
 792236  3.3696E-05
 792238  2.2434E-02
 93237  1.4067E-06
 94238  9.1387E-08
 794239  6.8008E-05
 794240  8.7066E-06
 794241  2.1655E-06
 94242  1.7461E-07
 95241  8.4046E-07
 95243  6.8259E-09
 96244  2.2507E-10
 8016  4.6454E-02
36083  8.2963E-07
40093  6.9088E-06
42095  1.0817E-05
43099  1.0587E-05
44101  9.1328E-06
44103  3.9500E-25
45103  6.1135E-06
45105  0.0000E+00
46105  2.8967E-06
46108  6.5783E-07
47109  4.7753E-07
53135  0.0000E+00
54131  4.9763E-06
54135  0.0000E+00
55133  1.1621E-05
55134  3.0326E-08
55135  3.8548E-06

```

```

59141  9.9539E-06
60143  9.4066E-06
60145  6.4959E-06
60147  0.0000E+00
60148  2.9767E-06
61147  5.4248E-07
61148  3.0280E-28
61149  0.0000E+00
62147  2.8717E-06
62149  9.5891E-08
62150  2.1722E-06
62151  2.7288E-07
62152  1.0281E-06
63153  4.7624E-07
63154  3.5148E-08
63155  2.1322E-08
64155  3.6014E-08
mix=114
'Batch 4B (Zone 1 Sub-zone 1), Assembly K14, Burnup=24728 MWD/MTU
92234  3.5377E-06
92235  1.9356E-04
92236  7.3797E-05
92238  2.2149E-02
93237  7.6600E-06
94238  2.0376E-06
94239  1.1943E-04
94240  4.2805E-05
94241  1.7691E-05
94242  6.7955E-06
95241  7.3095E-06
95243  1.1403E-06
96244  1.7237E-07
8016   4.6454E-02
36083  2.1563E-06
40093  2.1187E-05
42095  3.3789E-05
43099  3.3599E-05
44101  3.1814E-05
44103  5.8048E-25
45103  2.0309E-05
45105  0.0000E+00
46105  1.5304E-05
46108  5.3186E-06
47109  3.3966E-06
53135  0.0000E+00
54131  1.4874E-05
54135  0.0000E+00
55133  3.6853E-05
55134  3.1973E-07
55135  1.1754E-05
59141  3.3010E-05
60143  2.4871E-05
60145  1.9868E-05
60147  0.0000E+00
60148  1.0222E-05
61147  1.0235E-06
61148  6.2871E-28
61149  0.0000E+00
62147  7.0243E-06
62149  1.1885E-07
62150  8.7490E-06
62151  4.3170E-07
62152  3.7442E-06
63153  2.8353E-06
63154  5.2348E-07
63155  1.2790E-07
64155  2.1554E-07
mix=115

```

```

'Batch 7 (Zone 4 Sub-zone 9), Assembly K15, Burnup=0 MWD/MTU
 992234  5.6679E-06
 992235  6.7019E-04
 992236  3.0441E-06
 992238  2.2548E-02
 8016    4.6454E-02
mix=116
'Batch 6 (Zone 3 Sub-zone 7), Assembly L10, Burnup= 7969 MWD/MTU
 792234  5.0387E-06
 792235  4.7927E-04
 792236  3.6847E-05
 792238  2.2419E-02
 93237  1.6508E-06
 94238  1.2111E-07
 794239  7.3411E-05
 794240  1.0315E-05
 794241  2.7696E-06
 94242  2.5485E-07
 95241  1.0796E-06
 95243  1.1413E-08
 96244  4.2523E-10
 8016    4.6454E-02
 36083  9.1964E-07
 40093  7.7125E-06
 42095  1.2092E-05
 43099  1.1854E-05
 44101  1.0268E-05
 44103  4.0399E-25
 45103  6.8811E-06
 45105  0.0000E+00
 46105  3.3579E-06
 46108  7.9396E-07
 47109  5.7604E-07
 53135  0.0000E+00
 54131  5.5596E-06
 54135  0.0000E+00
 55133  1.3009E-05
 55134  3.8126E-08
 55135  4.3341E-06
 59141  1.1158E-05
 60143  1.0439E-05
 60145  7.2521E-06
 60147  0.0000E+00
 60148  3.3422E-06
 61147  5.9017E-07
 61148  3.3402E-28
 61149  0.0000E+00
 62147  3.1707E-06
 62149  9.8015E-08
 62150  2.4790E-06
 62151  2.8511E-07
 62152  1.1748E-06
 63153  5.5975E-07
 63154  4.5199E-08
 63155  2.4099E-08
 64155  4.0708E-08
mix=117
'Batch 5 (Zone 2 Sub-zone 5), Assembly L11, Burnup=16615 MWD/MTU
 592234  4.4175E-06
 592235  3.2885E-04
 592236  6.2068E-05
 592238  2.2268E-02
 93237  4.5683E-06
 94238  7.3499E-07
 594239  1.0762E-04
 594240  2.6832E-05
 594241  1.0431E-05
 94242  2.2621E-06

```

```

95241  4.1866E-06
95243  2.3680E-07
96244  2.0906E-08
8016   4.6454E-02
36083  1.6812E-06
40093  1.5148E-05
42095  2.3984E-05
43099  2.3538E-05
44101  2.1414E-05
44103  5.4383E-25
45103  1.4170E-05
45105  0.0000E+00
46105  8.6991E-06
46108  2.6291E-06
47109  1.8133E-06
53135  0.0000E+00
54131  1.0829E-05
54135  0.0000E+00
55133  2.5914E-05
55134  1.5467E-07
55135  8.1422E-06
59141  2.2728E-05
60143  1.9217E-05
60145  1.4224E-05
60147  0.0000E+00
60148  6.9181E-06
61147  9.2457E-07
61148  5.6591E-28
61149  0.0000E+00
62147  5.5679E-06
62149  1.1981E-07
62150  5.6148E-06
62151  3.7856E-07
62152  2.5497E-06
63153  1.5973E-06
63154  2.2147E-07
63155  6.3425E-08
64155  1.0694E-07
mix=118
'Batch 6 (Zone 4 Sub-zone 8), Assembly L12, Burnup= 6012 MWD/MTU
892234  5.1886E-06
892235  5.2052E-04
892236  2.9657E-05
892238  2.2452E-02
93237  1.1248E-06
94238  6.1642E-08
894239  6.0689E-05
894240  6.8050E-06
894241  1.5062E-06
94242  1.0102E-07
95241  5.8144E-07
95243  3.2592E-09
96244  9.1860E-11
8016   4.6454E-02
36083  7.1564E-07
40093  5.9083E-06
42095  9.2337E-06
43099  9.0199E-06
44101  7.7401E-06
44103  3.8185E-25
45103  5.1678E-06
45105  0.0000E+00
46105  2.3568E-06
46108  5.0518E-07
47109  3.6593E-07
53135  0.0000E+00
54131  4.2491E-06
54135  0.0000E+00

```

```

55133 9.9015E-06
55134 2.1874E-08
55135 3.2666E-06
59141 8.4677E-06
60143 8.1027E-06
60145 5.5543E-06
60147 0.0000E+00
60148 2.5273E-06
61147 4.7887E-07
61148 2.6134E-28
61149 0.0000E+00
62147 2.4891E-06
62149 9.3043E-08
62150 1.8024E-06
62151 2.5585E-07
62152 8.4802E-07
63153 3.8074E-07
63154 2.4689E-08
63155 1.8081E-08
64155 3.0534E-08
mix=119
'Batch 4B (Zone 1 Sub-zone 1), Assembly L13, Burnup=24900 MWD/MTU
92234 3.5219E-06
92235 1.9062E-04
92236 7.4198E-05
92238 2.2143E-02
93237 7.7749E-06
94238 2.0951E-06
94239 1.1971E-04
94240 4.3292E-05
94241 1.7913E-05
94242 6.9845E-06
95241 7.4040E-06
95243 1.1868E-06
96244 1.8217E-07
8016 4.6454E-02
36083 2.1719E-06
40093 2.1403E-05
42095 3.4139E-05
43099 3.3953E-05
44101 3.2191E-05
44103 5.8298E-25
45103 2.0514E-05
45105 0.0000E+00
46105 1.5550E-05
46108 5.4215E-06
47109 3.4528E-06
53135 0.0000E+00
54131 1.5008E-05
54135 0.0000E+00
55133 3.7236E-05
55134 3.2658E-07
55135 1.1891E-05
59141 3.3382E-05
60143 2.5057E-05
60145 2.0066E-05
60147 0.0000E+00
60148 1.0343E-05
61147 1.0269E-06
61148 6.3103E-28
61149 0.0000E+00
62147 7.0677E-06
62149 1.1900E-07
62150 8.8669E-06
62151 4.3417E-07
62152 3.7844E-06
63153 2.8805E-06
63154 5.3582E-07

```

```

 63155  1.3064E-07
 64155  2.2016E-07
mix=120
'Batch 7 (Zone 4 Sub-zone 9), Assembly L14, Burnup=0 MWD/MTU
 992234  5.6679E-06
 992235  6.7019E-04
 992236  3.0441E-06
 992238  2.2548E-02
 8016    4.6454E-02
mix=121
'Batch 7 (Zone 4 Sub-zone 9), Assembly L15, Burnup=0 MWD/MTU
 992234  5.6679E-06
 992235  6.7019E-04
 992236  3.0441E-06
 992238  2.2548E-02
 8016    4.6454E-02
mix=122
'Batch 5 (Zone 2 Sub-zone 4), Assembly M11, Burnup=18203 MWD/MTU
 492234  4.3115E-06
 492235  3.0594E-04
 492236  6.5702E-05
 492238  2.2238E-02
 93237  5.1737E-06
 94238  9.2094E-07
 494239  1.1135E-04
 494240  2.9818E-05
 494241  1.1888E-05
 94242  2.8837E-06
 95241  4.7940E-06
 95243  3.3501E-07
 96244  3.3088E-08
 8016    4.6454E-02
 36083  1.7988E-06
 40093  1.6431E-05
 42095  2.6049E-05
 43099  2.5606E-05
 44101  2.3456E-05
 44103  5.5788E-25
 45103  1.5430E-05
 45105  0.0000E+00
 46105  9.8232E-06
 46108  3.0528E-06
 47109  2.0780E-06
 53135  0.0000E+00
 54131  1.1701E-05
 54135  0.0000E+00
 55133  2.8174E-05
 55134  1.8317E-07
 55135  8.9032E-06
 59141  2.4806E-05
 60143  2.0592E-05
 60145  1.5421E-05
 60147  0.0000E+00
 60148  7.5716E-06
 61147  9.6358E-07
 61148  5.9252E-28
 61149  0.0000E+00
 62147  5.9145E-06
 62149  1.2162E-07
 62150  6.2363E-06
 62151  3.9378E-07
 62152  2.7875E-06
 63153  1.8191E-06
 63154  2.6888E-07
 63155  7.3580E-08
 64155  1.2406E-07
mix=123
'Batch 5 (Zone 2 Sub-zone 5), Assembly M12, Burnup=15877 MWD/MTU

```

```

592234 4.4678E-06
592235 3.3995E-04
592236 6.0281E-05
592238 2.2281E-02
93237 4.2921E-06
94238 6.5682E-07
594239 1.0568E-04
594240 2.5427E-05
594241 9.7459E-06
94242 1.9997E-06
95241 3.9030E-06
95243 1.9868E-07
96244 1.6594E-08
8016 4.6454E-02
36083 1.6243E-06
40093 1.4542E-05
42095 2.3012E-05
43099 2.2565E-05
44101 2.0464E-05
44103 5.3668E-25
45103 1.3575E-05
45105 0.0000E+00
46105 8.1897E-06
46108 2.4406E-06
47109 1.6932E-06
53135 0.0000E+00
54131 1.0414E-05
54135 0.0000E+00
55133 2.4850E-05
55134 1.4207E-07
55135 7.7873E-06
59141 2.1758E-05
60143 1.8554E-05
60145 1.3659E-05
60147 0.0000E+00
60148 6.6140E-06
61147 9.0437E-07
61148 5.5213E-28
61149 0.0000E+00
62147 5.3979E-06
62149 1.1887E-07
62150 5.3280E-06
62151 3.7135E-07
62152 2.4376E-06
63153 1.4968E-06
63154 2.0093E-07
63155 5.9029E-08
64155 9.9527E-08
mix=124
'Batch 6 (Zone 3 Sub-zone 6), Assembly M13, Burnup= 9322 MWD/MTU
692234 4.9370E-06
692235 4.5252E-04
692236 4.1463E-05
692238 2.2396E-02
93237 2.0496E-06
94238 1.7731E-07
694239 8.0862E-05
694240 1.2858E-05
694241 3.7964E-06
94242 4.1793E-07
95241 1.4896E-06
95243 2.2433E-08
96244 9.9984E-10
8016 4.6454E-02
36083 1.0532E-06
40093 8.9301E-06
42095 1.4027E-05
43099 1.3782E-05

```

```

44101 1.2014E-05
44103 4.1669E-25
45103 8.0546E-06
45105 0.0000E+00
46105 4.1022E-06
46108 1.0230E-06
47109 7.3950E-07
53135 0.0000E+00
54131 6.4404E-06
54135 0.0000E+00
55133 1.5121E-05
55134 5.1663E-08
55135 5.0704E-06
59141 1.3000E-05
60143 1.1975E-05
60145 8.3972E-06
60147 0.0000E+00
60148 3.9033E-06
61147 6.5686E-07
61148 3.7781E-28
61149 0.0000E+00
62147 3.6096E-06
62149 1.0096E-07
62150 2.9599E-06
62151 3.0233E-07
62152 1.3990E-06
63153 6.9765E-07
63154 6.3433E-08
63155 2.8684E-08
64155 4.8457E-08
mix=125
'Batch 7 (Zone 4 Sub-zone 9), Assembly M14, Burnup=0 MWD/MTU
 992234 5.6679E-06
 992235 6.7019E-04
 992236 3.0441E-06
 992238 2.2548E-02
   8016 4.6454E-02
mix=126
'Batch 4B (Zone 1 Sub-zone 2), Assembly N12, Burnup=21034 MWD/MTU
 292234 3.7539E-06
 292235 2.3563E-04
 292236 6.7794E-05
 292238 2.2227E-02
  93237 6.1577E-06
  94238 1.3573E-06
 294239 1.1468E-04
 294240 3.6105E-05
 294241 1.4586E-05
  94242 4.5273E-06
  95241 5.9828E-06
  95243 6.3192E-07
  96244 7.6921E-08
   8016 4.6454E-02
 36083 1.9339E-06
 40093 1.8302E-05
 42095 2.9122E-05
 43099 2.8865E-05
 44101 2.6872E-05
 44103 5.4906E-25
 45103 1.7519E-05
 45105 0.0000E+00
 46105 1.2183E-05
 46108 4.0390E-06
 47109 2.6737E-06
 53135 0.0000E+00
 54131 1.3029E-05
 54135 0.0000E+00
 55133 3.1720E-05

```

```

55134 2.3556E-07
55135 9.9571E-06
59141 2.8105E-05
60143 2.2234E-05
60145 1.7198E-05
60147 0.0000E+00
60148 8.6416E-06
61147 9.7114E-07
61148 5.9302E-28
61149 0.0000E+00
62147 6.3861E-06
62149 1.1644E-07
62150 7.2242E-06
62151 3.9888E-07
62152 3.2039E-06
63153 2.2502E-06
63154 3.7204E-07
63155 9.4689E-08
64155 1.5960E-07
mix=127
'Batch 7 (Zone 4 Sub-zone 9), Assembly N13, Burnup=0 MWD/MTU
 992234 5.6679E-06
 992235 6.7019E-04
 992236 3.0441E-06
 992238 2.2548E-02
 8016 4.6454E-02
mix=128
'Batch 7 (Zone 4 Sub-zone 9), Assembly N14, Burnup=0 MWD/MTU
 992234 5.6679E-06
 992235 6.7019E-04
 992236 3.0441E-06
 992238 2.2548E-02
 8016 4.6454E-02
mix=129
'Batch 5 (Zone 2 Sub-zone 5), Assembly O13, Burnup=15838 MWD/MTU
 592234 4.4705E-06
 592235 3.4055E-04
 592236 6.0184E-05
 592238 2.2282E-02
 93237 4.2776E-06
 94238 6.5284E-07
 594239 1.0558E-04
 594240 2.5352E-05
 594241 9.7096E-06
 94242 1.9863E-06
 95241 3.8880E-06
 95243 1.9679E-07
 96244 1.6388E-08
 8016 4.6454E-02
 36083 1.6212E-06
 40093 1.4510E-05
 42095 2.2960E-05
 43099 2.2514E-05
 44101 2.0414E-05
 44103 5.3627E-25
 45103 1.3543E-05
 45105 0.0000E+00
 46105 8.1630E-06
 46108 2.4308E-06
 47109 1.6870E-06
 53135 0.0000E+00
 54131 1.0391E-05
 54135 0.0000E+00
 55133 2.4793E-05
 55134 1.4142E-07
 55135 7.7685E-06
 59141 2.1706E-05
 60143 1.8518E-05

```

```

60145  1.3629E-05
60147  0.0000E+00
60148  6.5979E-06
61147  9.0328E-07
61148  5.5139E-28
61149  0.0000E+00
62147  5.3888E-06
62149  1.1882E-07
62150  5.3129E-06
62151  3.7096E-07
62152  2.4316E-06
63153  1.4915E-06
63154  1.9987E-07
63155  5.8804E-08
64155  9.9147E-08
mix=2
'zircaloy
 40302  4.25156E-02
mix=3
'borated water
 308016  2.48763E-02
   1001  4.97526E-02
   5010  9.68023E-06
   5011  3.92988E-05
mix=4
'Ag/Cd/In absorber rod
 47107  2.97279E-02
 447109  2.71133E-02
 49113  2.33484E-03
 49115  5.10593E-02
 48000  5.45296E-02
mix=5
'SS304
 24304  1.74286E-02
 25055  1.73633E-03
 26304  5.93579E-02
 28304  7.72074E-03
mix=6
'zirconium oxide (ZrO2)
 40000  2.73217E-02
 608016  5.46433E-02
mix=7
'50% Borated Water, 50% SS304
 705010  5.00926E-06
 705011  2.03361E-05
 701001  2.57456E-02
 708016  1.28728E-02
 724304  8.71429E-03
 725055  8.68166E-04
 726304  2.96790E-02
 728304  3.86037E-03
end mixt

read geom
*****
' Unit number designations:
'
'    1 - 29  Fuel assemblies for positions 1 - 29
'          31  1.905 x 21.68144 (horizontal) segment of core baffle
'          32  1.905 x 1.905 corner segment of core baffle
'          33  1.905 x 43.36288 long (horizontal) segment of core baffle
'          34  21.68144 x 1.905 (vertical) segment of core baffle
'          41  "Bottom" of baffle + row 1 of assemblies w/ vertical baffle ends
'          42  Row 2 of assemblies w/ vertical baffle ends
'          43  Row 3 of assemblies w/ vertical baffle ends
'          44  Rows 4-5 of assemblies w/ vertical baffle ends
'          46  Rows 11-12 of assemblies w/ vertical baffle ends
'          47  Row 13 of assemblies w/ vertical baffle ends

```

```

'      48 Row 14 of assemblies w/ vertical baffle ends
'      49 Row 15 of assemblies w/ vertical baffle ends + "top" of baffle
'      50 Reactor vessel and all internals (global)
' 101 - 129 Fuel rods for assemblies positions 1 - 29
'      200 APSR rod inside guide tube
'      201 Water filled guide tube
'
'*****define the 29 different fuel pin types.
unit 101
cylinder 0101 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0
cuboid   3 1 2p0.72136 2p0.72136 360.17 0.0
unit 102
cylinder 0102 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0
cuboid   3 1 2p0.72136 2p0.72136 360.17 0.0
unit 103
cylinder 0103 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0
cuboid   3 1 2p0.72136 2p0.72136 360.17 0.0
unit 104
cylinder 0104 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0
cuboid   3 1 2p0.72136 2p0.72136 360.17 0.0
unit 105
cylinder 0105 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0
cuboid   3 1 2p0.72136 2p0.72136 360.17 0.0
unit 106
cylinder 0106 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0
cuboid   3 1 2p0.72136 2p0.72136 360.17 0.0
unit 107
cylinder 0107 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0
cuboid   3 1 2p0.72136 2p0.72136 360.17 0.0
unit 108
cylinder 0108 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0
cuboid   3 1 2p0.72136 2p0.72136 360.17 0.0
unit 109
cylinder 0109 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0
cuboid   3 1 2p0.72136 2p0.72136 360.17 0.0
unit 110
cylinder 0110 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0
cuboid   3 1 2p0.72136 2p0.72136 360.17 0.0
unit 111
cylinder 0111 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0
cuboid   3 1 2p0.72136 2p0.72136 360.17 0.0
unit 112
cylinder 0112 1 0.46812 360.17 0.0
cylinder 0 1 0.47879 360.17 0.0
cylinder 2 1 0.54610 360.17 0.0

```

cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 113						
cylinder	0113	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 114						
cylinder	0114	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 115						
cylinder	0115	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 116						
cylinder	0116	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 117						
cylinder	0117	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 118						
cylinder	0118	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 119						
cylinder	0119	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 120						
cylinder	0120	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 121						
cylinder	0121	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 122						
cylinder	0122	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 123						
cylinder	0123	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 124						
cylinder	0124	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 125						
cylinder	0125	1	0.46812	360.17	0.0	
cylinder	0	1	0.47879	360.17	0.0	
cylinder	2	1	0.54610	360.17	0.0	
cuboid	3	1	2p0.72136	2p0.72136	360.17	0.0
unit 126						
cylinder	0126	1	0.46812	360.17	0.0	

cylinder 0 1 0.47879 360.17 0.0
 cylinder 2 1 0.54610 360.17 0.0
 cuboid 3 1 2p0.72136 2p0.72136 360.17 0.0
 unit 127
 cylinder 0127 1 0.46812 360.17 0.0
 cylinder 0 1 0.47879 360.17 0.0
 cylinder 2 1 0.54610 360.17 0.0
 cuboid 3 1 2p0.72136 2p0.72136 360.17 0.0
 unit 128
 cylinder 0128 1 0.46812 360.17 0.0
 cylinder 0 1 0.47879 360.17 0.0
 cylinder 2 1 0.54610 360.17 0.0
 cuboid 3 1 2p0.72136 2p0.72136 360.17 0.0
 unit 129
 cylinder 0129 1 0.46812 360.17 0.0
 cylinder 0 1 0.47879 360.17 0.0
 cylinder 2 1 0.54610 360.17 0.0
 cuboid 3 1 2p0.72136 2p0.72136 360.17 0.0

'APSR rod - contains Ag/Cd/In poison in a 36" slug
 unit 200

' ZrO₂ spacer
 cylinder 6 1 0.5055 139.99 139.23
 ' Ag/Cd/In Poison
 cylinder 4 1 0.5055 231.39 139.23
 ' Air (void) region
 cylinder 0 1 0.5055 236.34 139.23
 ' Upper SS304 plug
 cylinder 5 1 0.5055 237.61 139.23
 ' Water above plug, to top of core
 cylinder 3 1 0.5055 360.17 139.23
 ' Stainless clad and bottom end plug
 cylinder 5 1 0.5588 360.17 136.69
 ' Water inside guide tube
 cylinder 3 1 0.6223 360.17 0.0
 ' Zircaloy guide tube
 cylinder 2 1 0.6731 360.17 0.0
 ' Water cuboid surrounding guide tube
 cuboid 3 1 2p0.72136 2p0.72136 360.17 0.0

'Water filled guide tube

unit 201
 cylinder 3 1 0.6223 360.17 0.0
 cylinder 2 1 0.6731 360.17 0.0
 cuboid 3 1 2p0.72136 2p0.72136 360.17 0.0

'Assembly 1

unit 1
 array 0101 2r-21.6408 0.0
 cuboid 3 1 0.0 -21.6810000 0.0 -21.6810000 360.17 0.0
 'Assembly 2
 unit 2
 array 0102 2r-21.6408 0.0
 cuboid 3 1 0.0 -21.6810000 0.0 -21.6810000 360.17 0.0
 'Assembly 3
 unit 3
 array 0103 2r-21.6408 0.0
 cuboid 3 1 0.0 -21.6810000 0.0 -21.6810000 360.17 0.0
 'Assembly 4
 unit 4
 array 0104 2r-21.6408 0.0
 cuboid 3 1 0.0 -21.6810000 0.0 -21.6810000 360.17 0.0
 'Assembly 5
 unit 5
 array 0105 2r-21.6408 0.0
 cuboid 3 1 0.0 -21.6810000 0.0 -21.6810000 360.17 0.0
 'Assembly 6
 unit 6

```

array      0106 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 7
unit 7
array      0107 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 8
unit 8
array      0108 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 9
unit 9
array      0109 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 10
unit 10
array     0110 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 11
unit 11
array     0111 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 12
unit 12
array     0112 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 13
unit 13
array     0113 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 14
unit 14
array     0114 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 15
unit 15
array     0115 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 16
unit 16
array     0116 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 17
unit 17
array     0117 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 18
unit 18
array     0118 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 19
unit 19
array     0119 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 20
unit 20
array     0120 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 21
unit 21
array     0121 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 22
unit 22
array     0122 2r-21.6408  0.0
cuboid   3 1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 23
unit 23

```

```

array      0123 2r-21.6408  0.0
cuboid   3  1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 24
unit 24
array      0124 2r-21.6408  0.0
cuboid   3  1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 25
unit 25
array      0125 2r-21.6408  0.0
cuboid   3  1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 26
unit 26
array      0126 2r-21.6408  0.0
cuboid   3  1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 27
unit 27
array      0127 2r-21.6408  0.0
cuboid   3  1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 28
unit 28
array      0128 2r-21.6408  0.0
cuboid   3  1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0
'Assembly 29
unit 29
array      0129 2r-21.6408  0.0
cuboid   3  1  0.0 -21.6810000 0.0 -21.6810000 360.17  0.0

'Baffle components
'short horizontal segment
unit 31
cuboid   5  1  2p10.84050 2p0.95250  360.17  0.0
'corner segment
unit 32
cuboid   5  1  2p0.95250  2p0.95250  360.17  0.0
'long horizontal segment
unit 33
cuboid   5  1  2p21.681  2p0.95250  360.17  0.0
'vertical segment
unit 34
cuboid   5  1  2p0.95250  2p10.84050 360.17  0.0

'Rows of assemblies w/ baffle components
'Bottom of baffle + row 1
unit 41
array  1  -56.1086  -12.74572  0.0
'Row 2
unit 42
array  2  -99.47148  -10.84072  0.0
'Row 3
unit 43
array  3  -121.15292  -10.84072  0.0
'Rows 4&5
unit 44
array  4  -142.83436  -21.68144  0.0
'Rows 11&12
unit 46
array  6  -142.83436  -21.68144  0.0
'Row 13
unit 47
array  7  -121.15292  -10.84072  0.0
'Row 14
unit 48
array  8  -99.47148  -10.84072  0.0
'Row 15 + top of baffle
unit 49
array  9  -56.1086  -10.84072  0.0

'Reactor vessel and all components

```

```

' In this global coordinate system, the bottom center of the cylindrical
' vessel is the origin.
global unit 50
'Rows 6-10 of assemblies
array 5 -164.51580 -54.20360 0.0
'Water inside core barrel
cylinder 3 1 179.07 360.17 0.0
'Row 1 of assemblies
hole 41 0.0 -151.77008 0.0
'Row 2 of assemblies
hole 42 0.0 -130.08864 0.0
'Row 3 of assemblies
hole 43 0.0 -108.40720 0.0
'Rows 4&5 of assemblies
hole 44 0.0 -75.88504 0.0
'Rows 11&12 of assemblies
hole 46 0.0 75.88504 0.0
'Row 13 of assemblies
hole 47 0.0 108.40720 0.0
'Row 14 of assemblies
hole 48 0.0 130.08864 0.0
'Row 15 of Assemblies
hole 49 0.0 151.77008 0.0
'Long baffle segment at upper right (above row 14)
hole 33 77.79005 141.88187 0.0
'Long baffle segment at upper left (above row 14)
hole 33 -77.79005 141.88187 0.0
'Long baffle segment at lower right (below row 2)
hole 33 77.79005 -141.88187 0.0
'Long baffle segment at lower left (below row 2)
hole 33 -77.79005 -141.88187 0.0
'Short horizontal baffle segments in upper right quadrant, above rows 13, 12
'and 10, respectively.
hole 31 110.312201 120.200421 0.0
hole 31 131.993641 98.518981 0.0
hole 31 153.675081 55.156101 0.0
'Short horizontal baffle segments in upper left quadrant, above rows 13, 12
'and 10, respectively.
hole 31 -110.312201 120.200421 0.0
hole 31 -131.993641 98.518981 0.0
hole 31 -153.675081 55.156101 0.0
'Short horizontal baffle segments in lower right quadrant, below rows 3, 4,
'and 6, respectively.
hole 31 110.312201 -120.200421 0.0
hole 31 131.993641 -98.518981 0.0
hole 31 153.680000 -55.160000 0.0
'Short horizontal baffle segments in lower left quadrant, below rows 3, 4,
'and 6, respectively.
hole 31 -110.312201 -120.200421 0.0
hole 31 -131.993641 -98.518981 0.0
hole 31 -153.680000 -55.160000 0.0
'top and bottom "structure" beyond active core
cylinder 7 1 179.07 385.17 -25.0
'core barrel
cylinder 5 1 184.15 385.17 -25.0
'Water between core barrel and thermal shield
cylinder 3 1 186.69 385.17 -25.0
'Thermal shield
cylinder 5 1 191.77 385.17 -25.0
'Water between thermal shield and reactor vessel
cylinder 3 1 217.17 385.17 -25.0
'Reactor vessel
cylinder 5 1 239.17 385.17 -25.0
'Bounding cuboid (void)
cuboid 0 1 2p245.0 2p245.0 385.17 -25.0
end geom

read array

```

```

***** Array number designations:
'   1 Bottom of baffle + row 1 of fuel assemblies + r & 1 baffle segs.
'   2 Row 2 of fuel assemblies + r & 1 baffle segments
'   3 Row 3 of fuel assemblies + r & 1 baffle segments
'   4 Rows 4 & 5 of fuel assemblies + r & 1 baffle segments
'   5 Rows 6 - 10 of fuel assemblies + r & 1 baffle segments
'   6 Rows 11 & 12 of fuel assemblies + r & 1 baffle segments
'   7 Row 13 of fuel assemblies + r & 1 baffle segments
'   8 Row 14 of fuel assemblies + r & 1 baffle segments
'   9 Row 15 of fuel assemblies + r & 1 baffle segs. + top of baffle
' 101 - 129 Fuel assemblies for positions 1 - 29
*****
ara=1 nux=7 nuy=2 nuz=1 fill
  32 31 31 31 1b3
  34 21 15 8 1b3 end fill
ara=2 nux=11 nuy=1 nuz=1 fill
  34 28 25 20 14 7 1b5 end fill
ara=3 nux=13 nuy=1 nuz=1 fill
  34 29 27 24 19 13 6 1b6 end fill
ara=4 nux=15 nuy=2 nuz=1 fill
  34 28 27 26 23 18 12 5 1b7
  34 25 24 23 22 17 11 4 1b7 end fill
ara=5 nux=17 nuy=5 nuz=1 fill
  34 21 20 19 18 17 16 10 3 1b8
  34 15 14 13 12 11 10 9 2 1b8
  34 8 7 6 5 4 3 2 1 1b8
  34 15 14 13 12 11 10 9 2 1b8
  34 21 20 19 18 17 16 10 3 1b8 end fill
ara=6 nux=15 nuy=2 nuz=1 fill
  34 25 24 23 22 17 11 4 1b7
  34 28 27 26 23 18 12 5 1b7 end fill
ara=7 nux=13 nuy=1 nuz=1 fill
  34 29 27 24 19 13 6 1b6 end fill
ara=8 nux=11 nuy=1 nuz=1 fill
  34 28 25 20 14 7 1b5 end fill
ara=9 nux=7 nuy=2 nuz=1 fill
  34 21 15 8 1b3
  32 31 31 31 1b3 end fill
'Individual fuel assemblies
'assembly 1
ara=101 nux=15 nuy=15 nuz=1 fill
f101
  a36 201  a40 201  a49 201  a57 201  a78 201  a81 201
  a85 201  a88 201  a113 201  a138 201  a141 201  a145 201
  a148 201  a169 201  a177 201  a186 201  a190 201 end fill
'assembly 2
ara=102 nux=15 nuy=15 nuz=1 fill
f102
  a36 201  a40 201  a49 201  a57 201  a78 201  a81 201
  a85 201  a88 201  a113 201  a138 201  a141 201  a145 201
  a148 201  a169 201  a177 201  a186 201  a190 201 end fill
'assembly 3
ara=103 nux=15 nuy=15 nuz=1 fill
f103
  a36 201  a40 201  a49 201  a57 201  a78 201  a81 201
  a85 201  a88 201  a113 201  a138 201  a141 201  a145 201
  a148 201  a169 201  a177 201  a186 201  a190 201 end fill
'assembly 4
ara=104 nux=15 nuy=15 nuz=1 fill
f104
  a36 201  a40 201  a49 201  a57 201  a78 201  a81 201
  a85 201  a88 201  a113 201  a138 201  a141 201  a145 201
  a148 201  a169 201  a177 201  a186 201  a190 201 end fill
'assembly 5
ara=105 nux=15 nuy=15 nuz=1 fill
f105

```

```

a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201   end fill
'assembly 6
ara=106 nux=15 nuy=15 nuz=1   fill
f106
a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201   end fill
'assembly 7
ara=107 nux=15 nuy=15 nuz=1   fill
f107
a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201   end fill
'assembly 8
ara=108 nux=15 nuy=15 nuz=1   fill
f108
a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201   end fill
'assembly 9
ara=109 nux=15 nuy=15 nuz=1   fill
f109
a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201   end fill
'assembly 10
ara=110 nux=15 nuy=15 nuz=1   fill
f110
a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201   end fill
'assembly 11
ara=111 nux=15 nuy=15 nuz=1   fill
f111
a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201   end fill
'assembly 12
ara=112 nux=15 nuy=15 nuz=1   fill
f112
a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201   end fill
'assembly 13
ara=113 nux=15 nuy=15 nuz=1   fill
f113
a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201   end fill
'assembly 14
ara=114 nux=15 nuy=15 nuz=1   fill
f114
a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201   end fill
'assembly 15
ara=115 nux=15 nuy=15 nuz=1   fill
f115
a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201   end fill
'assembly 16
ara=116 nux=15 nuy=15 nuz=1   fill
f116
a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
a85 201   a88 201   a113 201   a138 201   a141 201   a145 201

```

```

a148 201 a169 201 a177 201 a186 201 a190 201 end fill
'assembly 17
ara=117 nux=15 nuy=15 nuz=1 fill
f117
a36 201 a40 201 a49 201 a57 201 a78 201 a81 201
a85 201 a88 201 a113 201 a138 201 a141 201 a145 201
a148 201 a169 201 a177 201 a186 201 a190 201 end fill
'assembly 18 - contains APSRs in all but center position
ara=118 nux=15 nuy=15 nuz=1 fill
f118
a36 200 a40 200 a49 200 a57 200 a78 200 a81 200
a85 200 a88 200 a113 201 a138 200 a141 200 a145 200
a148 200 a169 200 a177 200 a186 200 a190 200 end fill
'assembly 19
ara=119 nux=15 nuy=15 nuz=1 fill
f119
a36 201 a40 201 a49 201 a57 201 a78 201 a81 201
a85 201 a88 201 a113 201 a138 201 a141 201 a145 201
a148 201 a169 201 a177 201 a186 201 a190 201 end fill
'assembly 20
ara=120 nux=15 nuy=15 nuz=1 fill
f120
a36 201 a40 201 a49 201 a57 201 a78 201 a81 201
a85 201 a88 201 a113 201 a138 201 a141 201 a145 201
a148 201 a169 201 a177 201 a186 201 a190 201 end fill
'assembly 21
ara=121 nux=15 nuy=15 nuz=1 fill
f121
a36 201 a40 201 a49 201 a57 201 a78 201 a81 201
a85 201 a88 201 a113 201 a138 201 a141 201 a145 201
a148 201 a169 201 a177 201 a186 201 a190 201 end fill
'assembly 22
ara=122 nux=15 nuy=15 nuz=1 fill
f122
a36 201 a40 201 a49 201 a57 201 a78 201 a81 201
a85 201 a88 201 a113 201 a138 201 a141 201 a145 201
a148 201 a169 201 a177 201 a186 201 a190 201 end fill
'assembly 23
ara=123 nux=15 nuy=15 nuz=1 fill
f123
a36 201 a40 201 a49 201 a57 201 a78 201 a81 201
a85 201 a88 201 a113 201 a138 201 a141 201 a145 201
a148 201 a169 201 a177 201 a186 201 a190 201 end fill
'assembly 24
ara=124 nux=15 nuy=15 nuz=1 fill
f124
a36 201 a40 201 a49 201 a57 201 a78 201 a81 201
a85 201 a88 201 a113 201 a138 201 a141 201 a145 201
a148 201 a169 201 a177 201 a186 201 a190 201 end fill
'assembly 25
ara=125 nux=15 nuy=15 nuz=1 fill
f125
a36 201 a40 201 a49 201 a57 201 a78 201 a81 201
a85 201 a88 201 a113 201 a138 201 a141 201 a145 201
a148 201 a169 201 a177 201 a186 201 a190 201 end fill
'assembly 26
ara=126 nux=15 nuy=15 nuz=1 fill
f126
a36 201 a40 201 a49 201 a57 201 a78 201 a81 201
a85 201 a88 201 a113 201 a138 201 a141 201 a145 201
a148 201 a169 201 a177 201 a186 201 a190 201 end fill
'assembly 27
ara=127 nux=15 nuy=15 nuz=1 fill
f127
a36 201 a40 201 a49 201 a57 201 a78 201 a81 201
a85 201 a88 201 a113 201 a138 201 a141 201 a145 201
a148 201 a169 201 a177 201 a186 201 a190 201 end fill
'assembly 28

```

```

ara=128 nux=15 nuy=15 nuz=1 fill
f128
 a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
 a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201 end fill
'assembly 29
ara=129 nux=15 nuy=15 nuz=1 fill
f129
 a36 201   a40 201   a49 201   a57 201   a78 201   a81 201
 a85 201   a88 201   a113 201   a138 201   a141 201   a145 201
a148 201   a169 201   a177 201   a186 201   a190 201 end fill
end array

read plot
ttl=! TMI Unit 1, BOC-5 Full Core by UNIT !
pic=unit
xul=-200 yul=200 xlr=200 ylr=-200 uax=1 vdn=-1 nax=130 end
ttl=! TMI Unit 1, BOC-5 Full Core by MIX !
pic=mix nch!= 23456ABCDEFIGHIJKLMNOPQRSTUVWXYZ*@%$!
xul=-200 yul=200 xlr=200 ylr=-200 uax=1 vdn=-1 nax=130 end
end plot
end data
end

```


INTERNAL DISTRIBUTION

- | | |
|---------------------|---|
| 1. C. W. Alexander | 24-28. C. V. Parks |
| 2-3. S. M. Bowman | 29. L. M. Petrie |
| 4. B. L. Broadhead | 30. R. T. Primm |
| 5. J. A. Bucholz | 31. J.-P. Renier |
| 6. R. D. Dabbs | 32. J. W. Roddy |
| 7-8. M. D. DeHart | 33. R. W. Roussin |
| 9. M. B. Emmett | 34. J. C. Ryman |
| 10. N. M. Greene | 35. C. H. Shappert |
| 11. O. W. Hermann | 36. R. M. Westfall |
| 12. M. Kuliasha | 37. B. A. Worley |
| 13. L. C. Leal | 38. R. Q. Wright |
| 14. S. B. Ludwig | 39-40. Laboratory Records Dept. |
| 15. S. K. Martin | 41. Laboratory Records, ORNL-RC
Document Reference Section |
| 16. G. E. Michaels | 42. ORNL Y-12 Research Library |
| 17. B. D. Murphy | 43. Central Research Library |
| 18-22. L. F. Norris | 44. ORNL Patent Section |
| 23. J. V. Pace | |

EXTERNAL DISTRIBUTION

45. R. Anderson, General Nuclear Systems, Inc., 220 Stoneridge Dr., Columbia, SC 29210
46. M. G. Bailey, Office of Nuclear Material Safety & Safeguards, U.S. Nuclear Regulatory Commission, MS TWFN 8F5, Washington, DC 20555
47. L. Barrett, Office of Civilian Radioactive Waste Management, RW-232 20545, U.S. Department of Energy, Washington, DC 20545
48. P. Baylor, Office of Civilian Radioactive Waste Management, RW-36, U.S. Department of Energy, Washington, DC 20545
49. C. J. Benson, Bettis Atomic Power Laboratory, P.O. Box 79, West Mifflin, PA 15122
50. J. Bickel, U.S. Department of Energy, Albuquerque Operations Office, P.O. Box 5400, Albuquerque, NM 87115
51. L. Blalock, U.S. Department of Energy, M-261 Quince Orchard, Washington, DC 20585-0002
52. J. Boshoven, GA Technologies, Inc., P.O. Box 85608, 10955 John J. Hopkins Dr., San Diego, CA 92121
53. M. C. Brady, Sandia National Laboratories, 101 Convention Center Drive, Suite 880, Las Vegas, NV 89109
54. P. Bunton, U.S. Department of Energy, RW-1, Washington, DC 20545
55. R. J. Caciapouti, Yankee Atomic Electric Co., 1617 Worcester Rd., Framington, MA 01701
56. R. Carlson, Lawrence Livermore National Laboratory, P.O. Box 808, Livermore, CA 94550
57. C. R. Chappell, U.S. Nuclear Regulatory Commission, Office of Nuclear Materials Safety and Safeguards, TWFN 8F5, Washington, DC 20555
58. J. S. Choi, Lawrence Livermore National Laboratory, P.O. Box 808, Livermore, CA 94550
59. J. Clark, 2650 Park Tower Drive, Suite 800, Vienna, VA 22180
60. J. Conde, Consejo de Seguridad Nuclear, Justo Dorado, 11, 28040 Madrid, Spain

61. D. R. Conners, Bettis Atomic Power Laboratory, P.O. Box 79, West Mifflin, PA 15122
62. M. Conroy, U.S. Department of Energy, M-261 Quince Orchard, Washington, DC 20585-0002
63. P. J. Cooper, Sandia National Laboratories, P.O. Box 5800, Albuquerque, NM 87185-0716
64. W. Davidson, Los Alamos National Laboratory, Group A4, MSF-611, Los Alamos, NM 87845
- 65-67. F. J. Davis, Sandia National Laboratories, P.O. Box 5800, Div. 6302, MS 1333, Albuquerque, NM 87185-0716
68. D. Dawson, Transnuclear, Inc., 2 Skyline Dr., Hawthorne, NY 10532-2120
69. T. W. Doering, TESS, B&W Fuel Co., MS 423, Suite 527, P.O. Box 98608, 101 Convention Center Drive, Las Vegas, NV 89109
70. R. Doman, Nuclear Packaging, Inc., 1010 S. 336th St., Suite 220, Federal Way, WA 98003
71. E. Easton, U.S. Nuclear Regulatory Commission, Office of Nuclear Materials Safety and Safeguards, Washington, DC 20555
72. R. C. Ewing, Sandia National Laboratories, P.O. Box 5800, Div. 6643, MS 0716, Albuquerque, NM 87185-0716
73. C. Garcia, U.S. Department of Energy, Albuquerque Operations Office, P.O. Box 5400, Albuquerque, NM 87115
74. S. Hanauer, U.S. Department of Energy, RW-22, Washington, DC 20545
75. C. Haughney, U.S. Nuclear Regulatory Commission, Office of Nuclear Materials Safety and Safeguards, TWFN 8F5, Washington, DC 20555
76. L. Hassler, Babcock & Wilcox, P.O. Box 10935, Lynchburg, VA 24506-0935
77. E. Johnson, E. R. Johnson Associates, Inc., 9302 Lee Hwy, Suite 200, Fairfax, VA 22031
78. R. Kelleher, International Atomic Energy Agency, Division of Publications, Wagramerstrasse 5, P.O. Box 100, Vienna, Austria A-1400
79. R. Kidman, Los Alamos National Laboratory, Group A4, MSF-611, Los Alamos, NM 87845
80. C. Kouts, Office of Civilian Radioactive Waste Management, RW-36, U.S. Department of Energy, Washington, DC 20545
81. S. Kraft, Nuclear Energy Institute, 1776 I Street, Suite 400, Washington, DC 20086
82. P. Krishna, TRW Environmental Safety Systems, 600 Maryland Ave. S.W., Suite 695, Washington, DC 20024
83. A. Kubo, 2650 Park Tower Drive, Suite 800, Vienna, VA 22180
84. W. H. Lake, Office of Civilian Radioactive Waste Management, U.S. Department of Energy, RW-46, Washington, DC 20585
- 85-87. R. Lambert, Electric Power Research Institute, 3412 Hillview Ave., Palo Alto, CA 94304
- 88-90. D. Lancaster, 2650 Park Tower Drive, Suite 800, Vienna, VA 22180
91. D. Langstaff, U.S. Department of Energy, Richland Operations Office, P.O. Box 550, Richland, WA 99352
92. D. Lillian, U.S. Department of Energy, M-261 Quince Orchard, Washington, DC 20585-0002
93. C. Marotta, 1504 Columbia Ave., Rockville, MD 20850
94. M. Mason, Transnuclear, Two Skyline Drive, Hawthorne, NY 10532-2120
95. J. Massey, Sierra Nuclear Corporation, 5619 Scotts Valley Drive, Number 240, Scotts Valley, CA 95066
96. W. Mings, U.S. Department of Energy, Idaho Operations Office, 550 2nd St., Idaho Falls, ID 83401
97. A. Mobshevan, Roy F. Weston, Inc., 955 L'Enfant Plaza, SW, 8th Floor, Washington, DC 20024
98. R. Morgan, 2650 Park Tower Drive, Suite 800, Vienna, VA 22180
99. P. K. Nair, Manager, Engineered Barrier System, Center for Nuclear Waste Regulatory Analyses, Southwest Research Institute, 6220 Culebra Road, San Antonio, TX 78238-5166

100. D. Napolitano, Nuclear Assurance Corp., 5720 Peachtree Parkway, Norcross, GA 30092
101. C. W. Nilsen, Office of Nuclear Material Safety and Safeguards, U.S. Nuclear Regulatory Commission, MS TWFN-9F29, Washington, DC 20555
102. D. J. Nolan, 2650 Park Tower Drive, Suite 800, Vienna, VA 22180
- 103-104. Office of Scientific and Technical Information, U.S. Department of Energy, P.O. Box 62, Oak Ridge, TN 37831
105. Office of the Assistant Manager for Energy Research and Development, Department of Energy Oak Ridge Operations (DOE-ORO), P.O. Box 2008, Oak Ridge, TN 37831
106. C. E. Olson, Sandia National Laboratories, P.O. Box 5800, Div. 6631, MS 0715, Albuquerque, NM 87185-0716
107. N. Osgood, U.S. Nuclear Regulatory Commission, Office of Nuclear Materials Safety and Safeguards, TWFN 8F5, Washington, DC 20555
108. O. Ozer, Electric Power Research Institute, 3412 Hillview Ave., Palo Alto, CA 94304
109. P. Pacquin, General Nuclear Systems, Inc., 220 Stoneridge Dr., Columbia, SC 29210
110. T. Parish, Department of Nuclear Engineering, Texas A & M University, College Station, TX 77843-3313
- 111-113. M. Rahimi, 2650 Park Tower Drive, Suite 800, Vienna, VA 22180
114. B. Rasmussen, Duke Power Co., P.O. Box 33189, Charlotte, NC 28242
115. T. L. Sanders, Sandia National Laboratories, P.O. Box 5800, Div. 6609, MS 0720, Albuquerque, NM 87185-0716
116. K. D. Seager, Sandia National Laboratories, P.O. Box 5800, Div. 6643, MS 0716, Albuquerque, NM 87185-0716
117. M. Smith, U.S. Department of Energy, Yucca Mountain Project Office, 101 Convention Center Dr., Las Vegas, NV 89190
118. M. Smith, Virginia Power Co., P.O. Box 2666, Richmond, VA 23261
119. K. B. Sorenson, Sandia National Laboratories, P.O. Box 5800, Div. 6643, MS 0716, Albuquerque, NM 87185-0716
120. F. C. Sturz, Office of Nuclear Material Safety & Safeguards, U.S. Nuclear Regulatory Commission, MS TWFN 8F5, Washington, DC 20555
121. J. Sun, Florida Power & Light Co., P.O. Box 029100, Miami, FL 33102
122. T. Suto, Power Reactor and Nuclear Fuel Development Corp., 1-9-13, Akasaka, Minato-Ku,, Tokyo, Japan
123. R. J. Talbert, Battelle Pacific Northwest Laboratory, P.O. Box 999, Richland, WA 99352
124. T. Taylor, INEL, P.O. Box 4000, MS 3428, Idaho Falls, ID 83403
125. B. Thomas, VECTRA Technologies, Inc., 6203 San Ignacio Ave., Suite 100, San Jose, CA 95119
126. D. A. Thomas, B&W Fuel Co., 101 Convention Center Drive, Suite 527, MS 423, Las Vegas, NV 89109
127. J. R. Thornton, TRW Environmental Safety Systems, 2650 Park Tower Dr., Suite 800, Vienna, VA 22180
128. G. Walden, Duke Power Co., P.O. Box 33189, Charlotte, NC 28242
129. M. E. Wangler, U.S. Department of Energy, EH-33.2, Washington, DC 20585-0002
130. R. Weller, U.S. Nuclear Regulatory Commission, TWFN 7J9, Washington, DC 20555
131. A. Wells, 2846 Peachtree Walk, Duluth, GA 30136
132. W. Weyer, Wissenschaftlich-Technische Ingenieurberatung GMBH, Mozartstrasse 13, 5177 Titz-Rodingen, Federal Republic of Germany
133. B. H. White, Office of Nuclear Material Safety & Safeguards, U.S. Nuclear Regulatory Commission, MS TWFN 8F5, Washington, DC 20555
134. J. Williams, Office of Civilian Radioactive Waste Management, U.S. Department of Energy, RW-46, Washington, DC 20545

135. M. L. Williams, LSU Nuclear Science Center, Baton Rouge, LA 70803
136. C. J. Withee, Office of Nuclear Material Safety & Safeguards, U.S. Nuclear Regulatory Commission, MS TWFN 8F5, Washington, DC 20555
137. R. Yang, Electric Power Research Institute, 3412 Hillview Ave., Palo Alto, CA 94304