

May 2006 • NREL/TP-550-38238

Building America Performance Analysis Procedures for Existing Homes



Robert Hendron
National Renewable Energy Laboratory



U.S. Department of Energy
Energy Efficiency and Renewable Energy
Bringing you a prosperous future where energy is clean, abundant, reliable, and affordable


Building Technologies Program

Building America Performance Analysis Procedures for Existing Homes

R. Hendron

Prepared under Task No. BET6.8004

Technical Report
NREL/TP-550-38238
May 2006

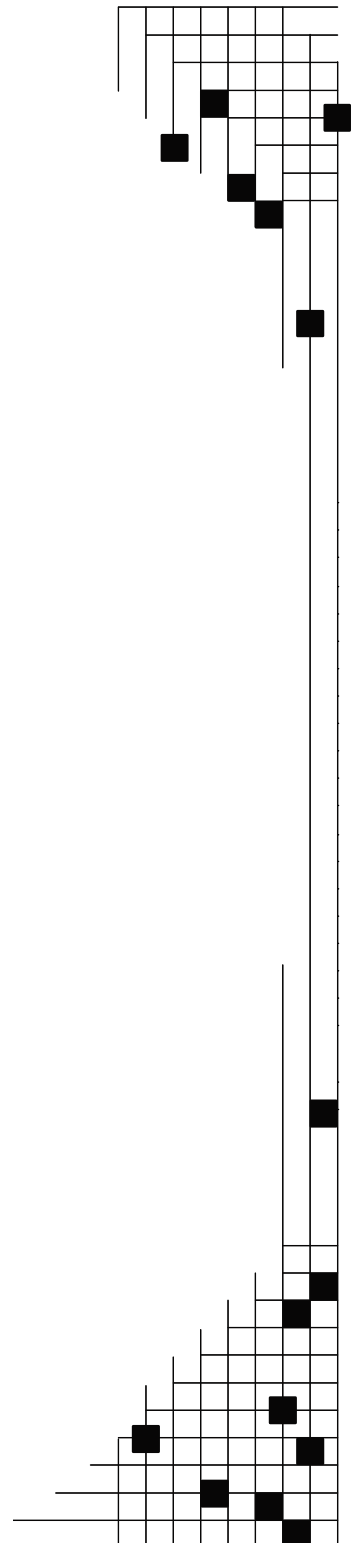

National Renewable Energy Laboratory
1617 Cole Boulevard, Golden, Colorado 80401-3393
303-275-3000 • www.nrel.gov

Operated for the U.S. Department of Energy
Office of Energy Efficiency and Renewable Energy
by Midwest Research Institute • Battelle

Contract No. DE-AC36-99-GO10337

NOTICE

This report was prepared as an account of work sponsored by an agency of the United States government. Neither the United States government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States government or any agency thereof.

Available electronically at <http://www.osti.gov/bridge>

Available for a processing fee to U.S. Department of Energy and its contractors, in paper, from:

U.S. Department of Energy
Office of Scientific and Technical Information
P.O. Box 62
Oak Ridge, TN 37831-0062
phone: 865.576.8401
fax: 865.576.5728
email: <mailto:reports@adonis.osti.gov>

Available for sale to the public, in paper, from:

U.S. Department of Commerce
National Technical Information Service
5285 Port Royal Road
Springfield, VA 22161
phone: 800.553.6847
fax: 703.605.6900
email: orders@ntis.fedworld.gov
online ordering: <http://www.ntis.gov/ordering.htm>



Table of Contents

Background	1
Purpose of the Report	1
Analysis Tools	2
Modeling of the Pre-Retrofit Case	3
General	3
Building Envelope	3
Space-Conditioning / Air-Distribution Equipment	6
Domestic Hot Water	13
Air Infiltration and Ventilation	19
Lighting Equipment and Usage	19
Appliances and Miscellaneous Electric Loads	21
Site Generation	30
Modeling the Post-Retrofit Case	30
Operating Conditions	32
Reporting Energy Use and Energy Savings	35
References	40

List of Figures

Figure 1. Clothes washer hot water use profile	16
Figure 2. Dishwasher hot water use profile	17
Figure 3. Shower, bath, and sink hot water use profile.....	17
Figure 4. Combined domestic hot water use profile	18
Figure 5. Annual average interior lighting profile (built up from detailed profiles)	21
Figure 6. Example of a detailed lighting profile (expressed as fraction of peak daily lighting energy)	21
Figure 7. Total combined residential equipment profile	26
Figure 8. Refrigerator and freezer normalized energy use profile.....	27
Figure 9. Clothes washer normalized machine energy use profile	27
Figure 10. Clothes dryer normalized energy use profile	28
Figure 11. Dishwasher normalized energy use profile	28
Figure 12. Range / oven normalized energy use profile	29
Figure 13. Miscellaneous electric load normalized energy use profile	29
Figure 14. Average hourly load profile from occupants for all day-types and family types (16.5 hours/day/person total)	34
Figure 15. Detailed hourly load profiles resulting from occupants being in different parts of the house on weekdays (WD) and weekends (WE).....	34

List of Tables

Table 1.	Default R-Values for Wall Cavity Insulation	4
Table 2.	Default R-Values for Floors above Unconditioned Space.....	4
Table 3.	Default R-Values for Common Insulation Types	4
Table 4.	Default Solar Adsorptances for Common Roofing Surfaces.....	5
Table 5.	Default Wood-framing Factors.....	6
Table 6.	Default Furnace and Boiler System Efficiencies, “Gas” refers to either Natural Gas or Propane.....	8
Table 7.	Default Heating-System Blower and Auxiliary Electricity Consumption	9
Table 8.	Default Air Conditioning and Heat-Pump Efficiencies.....	10
Table 9.	Default DHW Energy Factors, Known Equipment Characteristics. “Gas” Refers to Either Natural Gas or Propane.....	14
Table 10.	Default Domestic Hot Water Consumption by End Use.....	15
Table 11.	Default Dishwasher Characteristics.....	15
Table 12.	Default Standard Size (~2.5 ft ³) Clothes Washer Characteristics	16
Table 13.	Default Lighting Operating Hours for Common Room Types.....	20
Table 14.	Default Gas Clothes Dryer Characteristics (Assumes Typical 1990 Clothes Washer Capacity and Remaining Moisture Content).....	22
Table 15.	Default Electric Clothes Dryer Characteristics (Assumes Typical 1990 Clothes Washer Capacity and Remaining Moisture Content).....	23
Table 16.	Default Gas Over / Cooktop Characteristics	23
Table 17.	Default Electric Oven / Cooktop Characteristics	24
Table 18.	Default Internal Loads from Appliances and Small Electric End-Uses in the Pre-Retrofit Case	25
Table 19.	Peak Sensible and Latent Heat Gain from Occupants	33

Table 20. Example Summary of Site Energy Consumption by End-Use for an Existing Homes Project.....	36
Table 21. Example Summary of Source Energy Consumption by End-Use for an Existing Homes Project	37
Table 22. End-Use Categories	38
Table 23. Example Measure Savings Report for an Existing Homes Project	39

Definitions

ACH	air changes per hour
AFUE	Annual Fuel Utilization Efficiency
ASHRAE	American Society of Heating, Refrigerating and Air-Conditioning Engineers
ASTM	American Society for Testing and Materials
BA	Building America
BESTEST	A benchmark for building energy simulation: Building Energy Simulation Test and Diagnostic Method
CA _{AFUE}	combined appliance AFUE
CFA	conditioned floor area
DOE	U.S. Department of Energy
DOE-2	building energy analysis program that can predict the energy use and cost for all types of buildings
DHW	domestic hot water
DSE	distribution system efficiency
DUF	dryer usage factor
ECM	electronically commutated motor
EER	energy efficiency ratio
EF	efficiency factor
EIA	Energy Information Administration
ELCAP	End-Use Load and Consumer Assessment Program
EPA	U.S. Environmental Protection Agency
EPRI	Electric Power Research Institute
EPS	expanded polystyrene
FFA	finished floor area
H	height of one story
HERS	Home Energy Rating System developed by RESNET
HSPF	heating seasonal performance factor
LBNL	Lawrence Berkeley National Laboratory
M	maintenance factor
MAT	monthly average temperatures

MEF	modified energy factor
MEL	miscellaneous electric loads
NAECA	National Appliance Energy Conservation Act
NREL	National Renewable Energy Laboratory
OA	outdoor air
RECS	EIA Residential Energy Consumption Survey
RESNET	Residential Energy Service Network
SDT	summer design temperatures
SEER	seasonal energy efficiency ratio
SHGC	solar heat gain coefficient
TMY2	Typical Meteorological Year weather data (1961-90)
TREAT	Building energy software that performs hourly simulations for single-family, multi-family, and mobile homes
TRNSYS	The Transient Energy System Simulation Tool is software designed to simulate the transient performance of thermal energy systems
TXV	thermostatic expansion valve
U-values	The thermal transmittance of a material, incorporating the thermal conductance of the structure along with heat transfer resulting from convection and radiation
UA	heat loss coefficient
WDT	winter design temperatures
XPS	extruded polystyrene

Building America Performance Analysis Procedures for Existing Homes

Background

Because there are more than 101 million residential households in the United States today, it is not surprising that existing residential buildings represent an extremely large source of potential energy savings. Because thousands of these homes are renovated each year, the U.S. Department of Energy's (DOE's) Building America program is investigating the best ways to make existing homes more energy-efficient, based on lessons learned from research in new homes. The Building America research goals target a 20% reduction in energy use in existing homes by 2015 and a 30% reduction by 2025.

The strategy for the existing homes project of Building America is to establish technology pathways that reduce energy consumption cost-effectively in American homes. The existing buildings project focuses on finding ways to adapt the results from the new homes research to retrofit applications in existing homes. Research activities include a combination of computer modeling, field demonstrations, and long-term monitoring to support the development of integrated approaches to reduce energy use in existing residential buildings. Analytical tools are being developed to guide designers and builders in selecting the best approaches for each application. Also, DOE partners with the U.S. Environmental Protection Agency (EPA) to increase energy efficiency in existing homes through the Home Performance with ENERGY STAR® program (www.energystar.gov/index.cfm?c=home_improvement.hm_improvement_hpwes).

Purpose of the Report

This report provides a proposed set of guidelines for estimating the energy savings achieved by a package of retrofits or an extensive rehabilitation of an existing home. Building America has developed a set of typical operating conditions that will be used for the purpose of using a building simulation model to objectively compare energy use before and after a series of retrofits are completed. Actual occupant behavior is extremely important for the purpose of determining the cost-effectiveness of a retrofit package, especially if the homeowner is paying the bills. But for the purpose of tracking progress toward programmatic goals, and for comparing the performance of one house to another, it is essential to use a hypothetical set of occupants with typical behavioral patterns. These typical operating conditions are fully consistent with those used in the Building America Research Benchmark for new construction (which we will refer to simply as the Benchmark) (Hendron 2005).

Certain field test and audit methods are also described in this report. These tests help establish accurate building system performance characteristics that are needed for a meaningful simulation of whole-house energy use. Several sets of default efficiency values have also been developed for certain older appliances that cannot be easily tested and for which published specifications are not readily available.

Analysis Tools

A key issue in any building energy analysis is which tool or program should be chosen to estimate energy consumption. An hourly simulation is often necessary to fully evaluate the time-dependent energy impacts of advanced systems used in Building America houses. Thermal mass, solar heat gain, and wind-induced air infiltration are examples of time-dependent effects that can be accurately modeled only by using a model that calculates heat transfer and temperature in short time intervals. In addition, an hourly simulation program is necessary to accurately estimate peak energy loads. Because of the large number of users, public availability, and level of technical support, DOE-2 is the hourly simulation tool recommended for systems analysis studies performed under the DOE Building America program.

EnergyGauge¹ is a frequently used interface for DOE-2 because it has been tailored specifically to residential buildings. However, it was not designed with existing homes as the top priority, so retrofits must be analyzed by comparing separate runs. Team analysts are encouraged to use other simulation tools when appropriate for specialized building simulation analysis, provided the tool has met the requirements of BESTEST in accordance with the software certification sections of the RESNET/HERS Guidelines (RESNET 2002). Regardless of the tool selected, teams should present complete analysis results, in accordance with the reporting guidelines described later in this section.

Most of the simulation tools that are useful for new residential construction are also applicable to residential retrofit analysis. Certain tools, such as TREAT, offer additional features such as side-by-side comparisons, automated efficiency package recommendations, and utility bill analysis/reconciliation. Further information about TREAT and a number of other useful tools for retrofit analysis of both residential and commercial buildings can be found in the DOE Energy Software Tools Directory (www.eere.energy.gov/buildings/tools_directory).

NREL does not recommend that utility bills be heavily relied upon as a tool for model validation, except as an approximate check of model accuracy. There are two important reasons for this position:

- It is extremely difficult to accurately determine occupant behavior during the time period reflected in the utility bills.
- The large number of uncertain input parameters allows multiple ways to reconcile the model with the small number of utility bills, and no reliable methodology exists for performing this calibration because the problem is fundamentally mathematically underdetermined.

Instead, detailed inspections, short-term testing, and long-term monitoring should be utilized to the greatest extent possible to minimize the uncertainty in model inputs. Default values may be used when certain building features are inaccessible (wall insulation) or efficiency characteristics cannot be readily determined through inspection or short-term testing (furnace AFUE). The effects of maintenance and repairs should always be considered when using default values for equipment efficiency or the amount of insulation.

Throughout the remainder of this section, the term “Pre-Retrofit Case” refers to the state of an existing house immediately before it undergoes a series of upgrades, repairs, additions, or

¹ This is available for purchase from the Florida Solar Energy Center (<http://energygauge.com/>).

renovations. These measures may be limited to a focused set of energy efficiency improvements to the house or may be part of a larger remodeling or gut rehabilitation effort. The terms “Post-Retrofit Case” and “Prototype” refer to the same existing house after the package of improvements is complete.

Modeling the Pre-Retrofit Case

General

Any element of the Pre-Retrofit Case that is not specifically addressed in the following sections, or is not changed as part of the package of energy efficiency measures, is assumed to be the same as the Post-Retrofit Case.

Building Envelope

To the extent possible, all building envelope components (including walls, windows, foundation, roof, and floors) for the Pre-Retrofit Case shall be based on physical inspections, audits, design specifications, or measured data. Co-heating (Judkoff et al. 2000), or infrared imaging during cold weather can provide useful information about the insulation quality of the house without damaging the building envelope. A Short-Term Monitoring Tests (STEM) can provide the overall building loss coefficient and thermal mass (Judkoff et al. 2000), but in most retrofit scenarios a STEM test is overly expensive and would not provide data that could be easily factored into a building simulation.

If detailed envelope characteristics cannot be obtained, the following default specifications may be used:

- R-values for cavity insulation in exterior 2x4 or 2x6 wood frame walls from Table 1
- R-values for cavity insulation in floors over unconditioned space from Table 2
- Insulation thickness in all other locations shall be measured, and the default R-values per inch in Table 3 shall be applied
- Default U-values for vertical fenestration, including windows and sliding glass doors, from Table 4 in Chapter 31 of the 2005 ASHRAE Handbook of Fundamentals (ASHRAE 2005)
- Total assembly SHGC for vertical fenestration from Table 13 in Chapter 31 of the 2005 ASHRAE Handbook of Fundamentals
- Default solar absorptivity equal to 0.50 for opaque areas of exterior walls and from Table 4 for opaque areas of roofs
- Default total infrared emittance of exterior walls and roofs equal to 0.90
- The default framing factors in Table 5 may be used for houses using wood construction.

Table 1. Default R-values for Wall Cavity Insulation (Based in Part on Huang & Gu 2002)

Wall Construction Type	Year of Construction			
	1990+	1980-89	1950-79	Pre 1950
2x4, 16 in. o.c.	13	11	9	7
2x6, 24 in. o.c.	19	17	15	13

Table 2. Default R-Values for Floors above Unconditioned Space (Based in Part on Huang & Gu 2002)

Building America Climate Region	Year of Construction			
	1990+	1980-89	1950-79	Pre 1950
Cold, Very Cold, Subarctic, Marine	19	17	15	13
All Others	0	0	0	0

Table 3. Default R-value for Common Insulation Types (DOE 2003, E-Star Colorado 2005)

Insulation Material	Year of Construction	
	1990 or after	Before 1990
High-Density Fiberglass Batt	3.8 / in.	3.0 / in.
Low-Density Fiberglass Batt	2.7 / in.	2.0 / in.
Loose-Fill Fiberglass	3.2 / in.	2.5 / in.
Cellulose (Blown, Wet, or Dry)	3.7 / in.	3.4 / in.
Expanded Polystyrene (EPS)	4.0 / in.	3.8 / in.
Extruded Polystyrene (XPS)	5.0 / in.	4.8 / in.
Open-Cell Polyurethane Foam	3.6 / in.	3.3 / in.
Closed-Cell Polyurethane Foam	6.5 / in.	5.9 / in.
Rigid Polyisocyanurate	7.2 / in.	5.8 / in.

Table 4. Default Solar Absorptances for Common Roofing Surfaces (Parker et al. 2000)

Roof Material	Absorptance	Roof Material	Absorptance
<i>Composition Shingles</i>		<i>Wood Shingles</i>	
Dark	0.92	Dark	0.90
Medium	0.85	Medium	0.80
Light	0.75		
		Concrete/Cement	
<i>Tile/Slate</i>		<i>Dark</i>	<i>0.90</i>
Dark	0.90	Medium	0.75
Medium	0.75	Light	0.60
Terra cotta	0.65	White	0.30
Light	0.60		
White	0.30	Membrane	
		Dark	0.90
<i>Metal</i>		<i>Medium</i>	<i>0.75</i>
Dark	0.90	Light	0.60
Medium	0.75	White	0.30
Galvanized, unfinished	0.70		
Light	0.60	Built-up (gravel surface)	
Galvalum, unfinished	0.35	Dark	0.92
White	0.30	Medium	0.85
		Light	0.75

Table 5. Default Wood-framing Factors

Enclosure Element	Frame Spacing (in. o.c.)	Framing Fraction (% area)
Walls	16	23%
Floors	16	13%
Ceilings	24	11%

Space Conditioning / Air-Distribution Equipment

To the extent possible, the performance characteristics (efficiency and capacity) of all space-conditioning components (including heating system, cooling system, dehumidification, air handler, and ducts) for the Pre-Retrofit Case shall be based on physical inspections, audits, design specifications, and measured data. An estimate of Annual Fuel Utilization Efficiency (AFUE) for a furnace or Heating Seasonal Performance Factor (HSPF) for a heat pump can be estimated by performing a co-heating test to determine the building loss coefficient (Judkoff et al. 2000), then measuring the gas or electricity input over a period of time with known inside and outside temperatures. Because thermal mass and solar effects complicate this approach, it should ideally be conducted under near steady-state conditions at night. Field-audit procedures for heating equipment have also been developed by LBNL (Szydlowski and Cleary 1988). Cooling efficiency is much more difficult to measure directly; in most cases, the manufacturers published data must be used—or default values if published performance data are not available.

Default furnace or boiler system efficiency may be calculated using Equation 1 in conjunction with the parameters in Table 6 if the actual efficiency of the equipment is unknown and cannot be readily obtained through field-testing (for example, if the audit is conducted in the summer, the heating system is broken, or testing would be cost-prohibitive). Typical base values for AFUE were obtained from the ASHRAE HVAC Systems and Equipment Handbook (ASHRAE 2004a), the 1987 EPRI Technical Assessment Guide (EPRI 1987), and the Technical Support Documents for the NAECA appliance standards (DOE 2004a). Default AFUE values for system configurations not listed in Table 6 may be estimated using these references. Estimates of degradation rates are partly based on the E-Source Space Heating Technology Atlas (E-Source 1993).

Equation 1: $AFUE = (Base\ AFUE) * (1-M)^{age}$

Where:

Base AFUE = Typical efficiency of Pre-Retrofit equipment when new

M = Maintenance Factor

Age = Age of equipment in years.

For example, the default AFUE for a 10-year-old, poorly maintained, oil furnace with a conventional burner would be calculated as follows:

$$\text{AFUE} = (71) * (1-0.025)^{10} = 55\%.$$

Auxiliary electricity use for furnaces and boilers, including blowers and controls, shall be measured directly if possible. If accurate measurements cannot be made, the default values of auxiliary electricity use in Table 7 may be used.

The default air-conditioner and heat-pump efficiencies in Table 8 may be used if the actual efficiency cannot be calculated or measured. Base values for SEER, EER, and HSPF were obtained from the engineering analysis of appliance standards for air conditioners and heat pumps (DOE 2002), and from the LBNL Energy Data Sourcebook (Wenzel et al. 1997). Default efficiencies for equipment not listed in the table may either be interpolated or estimated by referring to the original references. Adjustments to efficiency related to age and quality of maintenance shall be applied in accordance with Equation 2. Performance degradation rates for cooling systems are based in part on a study done by LBNL for the California Energy Commission (Matson et al. 2002).

Equation 2: $\text{EFF} = (\text{Base EFF}) * (1-M)^{\text{age}}$

Where:

Base EFF = Typical efficiency of Pre-Retrofit equipment when new (SEER, EER, or HSPF)

M = Maintenance Factor

Age = Age of equipment in years.

**Table 6. Default Furnace and Boiler System Efficiencies;
“Gas” Refers to Either Natural Gas or Propane**

Type of Space-Heating Equipment	Base AFUE*	Maintenance Factor (M)	
		<i>Annual Professional Maintenance</i>	<i>Seldom or Never Maintained</i>
Condensing gas furnace	90	0.005	0.015
Gas furnace, direct-vent or forced-draft combustion, electronic ignition, in conditioned space	80	0.005	0.015
Gas furnace, natural-draft combustion, vent damper, electronic ignition, in conditioned space	78	0.005	0.015
Gas furnace, natural-draft combustion, standing pilot light, in conditioned space	75	0.005	0.015
Gas furnace, natural-draft combustion, standing pilot light, no vent damper, in unconditioned space	64	0.005	0.015
Gas hot water boiler, natural-draft combustion, standing pilot light	80	0.005	0.015
Gas steam boiler	81	0.005	0.015
Condensing gas boiler	90	0.005	0.015
Gas hot water / fan-coil combo system	80	0.005	0.015
Gas boiler / tankless coil combo system	80	0.005	0.015
Gas space heater, fan type	73	0.005	0.015
Gas space heater, gravity type	60	0.005	0.015
Oil furnace, flame-retention burner, vent dampers, in conditioned space	81	0.01	0.025

**Table 6 continued. Default Furnace and Boiler System Efficiencies;
“Gas” Refers to Either Natural Gas or Propane**

Type of Space-Heating Equipment	Base AFUE*	Maintenance Factor (M)	
		Annual Professional Maintenance	Seldom or Never Maintained
Oil furnace, conventional burner, no vent dampers, in conditioned space	71	0.01	0.025
Oil hot water boiler, forced-draft combustion	80	0.01	0.025
Oil steam boiler	82	0.01	0.025
Electric-resistance furnace or boiler, conditioned space	100	0	0
Electric-resistance furnace or boiler, unconditioned space	98	0.001	0.001
Electric-resistance baseboard heating	100	0	0
Electric space heater	100	0	0

* Combined Appliance AFUE (CA_{AFUE}) for combo systems

Table 7. Default Heating-System Blower and Auxiliary Electricity Consumption

Type of Heating Equipment	Electricity/Capacity
Gas furnace (including mobile-home furnace)	9.2 (kWh/yr)/(kBtu/hr)
Gas hot water boiler with hydronic distribution	1.1 (kWh/yr)/(kBtu/hr)
Gas boiler with forced-air distribution	9.2 (kWh/yr)/(kBtu/hr)
Oil furnace	8.0 (kWh/yr)/(kBtu/hr)
Oil hot water boiler with hydronic distribution	2.3 (kWh/yr)/(kBtu/hr)
Electric furnace	Included in AFUE

Table 8. Default Air-Conditioning and Heat-Pump Efficiencies

Type of Air-Conditioning or Heat-Pump Equipment	Base SEER	Base EER	Base HSPF	Maintenance Factor (M)	
				<i>Annual Professional Maintenance</i>	<i>Seldom or Never Maintained</i>
Split central air conditioner, two-speed reciprocating compressor, electronically commutated air handler motor (ECM), thermostatic expansion valve (TXV), fan coil	14	10.5		0.01	0.02
Split central air conditioner, single-speed scroll compressor, ECM air handler motor, cased coil	12	10.8		0.01	0.03
Split central air conditioner, single-speed reciprocating compressor, PSC air-handler motor, cased coil (after 1991)	10	9.3		0.01	0.03
Split central air conditioner, single-speed reciprocating compressor, PSC air-handler motor, cased coil (1981-1991)	8	7.7		0.01	0.03
Split central air conditioner, single-speed reciprocating compressor, PSC air-handler motor, cased coil (before 1981)	6.5	6.4		0.01	0.03
Split heat pump, single-speed scroll compressor, ECM air handler motor, TXV valve	14	10.5	8.0	0.01	0.03

Table 8 continued. Default Air Conditioning and Heat-Pump Efficiencies

Type of Air-Conditioning or Heat-Pump Equipment	Base SEER	Base EER	Base HSPF	Maintenance Factor (M)	
				<i>Annual Professional Maintenance</i>	<i>Seldom or Never Maintained</i>
Split heat pump, single-speed reciprocating compressor, PSC air-handler motor (after 1991)	10	9.3	7.1	0.01	0.03
Split heat pump, single-speed reciprocating compressor, PSC air-handler motor (1981-1991)	8	7.7	6.6	0.01	0.03
Split heat pump, single-speed reciprocating compressor, PSC air-handler motor (before 1981)	6.5	6.4	6.0	0.01	0.03
Packaged central air conditioner, single-speed reciprocating compressor, PSC air-handler motor	10	9.1		0.01	0.03
Packaged heat pump, single-speed reciprocating compressor, PSC air-handler motor	10	9.1	6.8	0.01	0.03
Room air conditioner, louvered sides, cooling only, single-speed compressor, PSC fan motor, <20,000 Btu/hr (after 1991)		9.75		0.01	0.03
Room air conditioner, louvered sides, cooling only, single-speed compressor, PSC fan motor, ≥20,000 Btu/hr (after 1991)		8.5		0.01	0.03

Table 8 continued. Default Air Conditioning and Heat-pump Efficiencies

Type of Air-Conditioning or Heat-Pump Equipment	Base SEER	Base EER	Base HSPF	Maintenance Factor (M)	
				<i>Annual Professional Maintenance</i>	<i>Seldom or Never Maintained</i>
Room air conditioner, louvered sides, cooling only, single-speed compressor, PSC fan motor, (1981-1991)		7.5		0.01	0.03
Room air conditioner, louvered sides, cooling only, single-speed compressor, PSC fan motor, (before 1981)		6.5		0.01	0.03
Room electric heat pump, louvered sides, single-speed compressor, PSC fan motor, <20,000 Btu/hr		9		0.01	0.03
Room electric heat pump, louvered sides, single-speed compressor, PSC fan motor, ≥20,000 Btu/hr		8.5		0.01	0.03
Direct evaporative cooling		25		0.02	0.05

For houses with air ducts, the Pre-Retrofit Case shall be modeled using data collected through visual inspections, physical measurements, and duct-leakage testing. Default values for duct leakage shall not be used. Duct-blast testing shall be conducted in accordance with ASTM E1554 (ASTM 1994). Tracer gas testing of the air distribution system is encouraged when possible, and shall be conducted in accordance with NREL Performance Test Practices for duct systems (Hancock et al. 2002).

If the simulation tool does not permit the input of detailed duct specifications, then two values (one for heating, one for cooling) of seasonal distribution system efficiency (DSE) shall be estimated and applied to the heating and cooling system efficiencies to represent expected energy losses from ducts. The DSE values shall be estimated using the procedures in the Draft ASHRAE Standard 152P (ASHRAE 2001).

For houses with hydronic space-heating or space-cooling systems, a distribution efficiency of 95% shall be applied to the appliance efficiency, representing a small amount of energy loss through the pipes.

Domestic Hot Water

To the extent possible, the specifications of the domestic hot water system in the Pre-Retrofit Case shall be based on audits, design specifications, physical measurements, and test data. Published data from the manufacturer provides the most reliable estimate of energy factor, because in-situ testing introduces several uncontrolled variables (such as water use and ambient temperature) that usually make a reliable measurement of standby loss impossible. The procedures to measure recovery efficiency and standby losses described by LBNL (Szydlowski and Cleary 1988) may be used in conjunction with the NREL tank loss spreadsheet (www.eere.energy.gov/buildings/building_america/docs/tankloss.xls) to give a rough estimate of the energy factor (EF). If EF of the equipment cannot be determined through measurement or examination of the published performance data, the default specifications in Table 9 may be used, with age and maintenance adjustments in accordance with Equation 3. These defaults were largely derived from technical support documents for the federal appliance standard for water heaters (DOE 2000a).

Equation 3: $EF = (\text{Base EF}) * (1-M)^{\text{age}}$

Where:

Base EF = Typical efficiency of Pre-Retrofit equipment when purchased

M = Maintenance Factor

Age = Age of equipment in years.

**Table 9. Default DHW Energy Factors, Known Equipment Characteristics;
“Gas” Refers to Either Natural Gas or Propane**

Type of Water-Heating Equipment	Base Energy Factor (EF)	Maintenance Factor (M)	
		Annual Professional Maintenance	Seldom or Never Maintained
Gas water heater, 40-gallon tank, pilot light, natural-draft combustion, poorly insulated, no heat traps, poor heat recovery from flue	0.45	0.005	0.01
Gas water heater, 40-gallon tank, pilot light, natural-draft combustion, 1-in. insulation, no heat traps, standard flue baffling	0.54	0.005	0.01
Gas water heater, 40-gallon tank, intermittent ignition, forced draft combustion, 3-in. insulation, heat traps, enhanced flue baffling, flue/vent dampers	0.64	0.005	0.01
Gas instantaneous water heater	0.80	0.005	0.01
Oil water heater, 32-gallon tank, intermittent ignition, forced-draft combustion, poorly insulated, no heat traps, poor heat recovery from flue	0.53	0.005	0.01
Oil water heater, 32-gallon tank, interrupted ignition, forced-draft combustion, 3-in. insulation, heat traps, enhanced flue baffling	0.61	0.005	0.01
Electric water heater, 50-gallon tank, poorly insulated, no heat traps	0.79	0.001	0.002
Electric water heater, 50-gallon tank, 1.5-in. insulation, heat traps.	0.87	0.001	0.002
Electric water heater, 50-gallon tank, 3-in. insulation, heat traps.	0.90	0.001	0.002
Electric instantaneous water heater	1.00	0	0

The NREL Performance Analysis Spreadsheet calculates the correct DHW inputs for the TRNSYS computer program, including standby heat loss coefficient (UA), given basic equipment characteristics (EF, RE, etc) (Burch and Erickson 2004). It can be found on the Building America Web site in the section for building scientists (www.eere.energy.gov/buildings/building_america/pa_resources.html).

Four major end uses have been identified for domestic hot water: showers, sinks, dishwasher, and clothes washer (Table 10). For showers and sinks, the specified volume is the same as the value defined for the Benchmark and represents the combined volume of hot and cold water. For clothes washers and dishwashers, the Appliance and DHW Spreadsheet developed by NREL shall be used to estimate the Pre- and Post-Retrofit hot water consumption based on standard operating conditions and information listed on the EnergyGuide label. If no EnergyGuide label is available, then the default values of energy factor for dishwashers (Table 11) or modified energy factor (MEF) for clothes washers (Table 12) shall be used for the Pre-Retrofit Case.

Table 10. Default Domestic Hot Water Consumption by End-use

End Use	End-Use Water Temperature	Default Water Usage
Dishwasher	N/A	Calculated using EF in Table 10
Clothes Washer	N/A	Calculated using MEF in Table 11
Shower and Bath	105°F	$17.5 + 5.83 \times N_{br}$ gal/day (Hot + Cold)
Sinks	105°F	$12.5 + 4.16 \times N_{br}$ gal/day (Hot + Cold)

Table 11. Default Dishwasher Characteristics

Equipment Characteristics	Energy Factor (load/kWh)
Power dry optional, multi-tier spray device, load-size and soil-level controls	0.6
Power dry optional, multi-tier spray device, no load-size or soil-level controls	0.43
Power dry always, single-tier spray device, no load-size or soil-level controls	0.24

Table 12. Default Standard Size (~2.5 ft³) Clothes Washer Characteristics

Equipment Characteristics	Modified Energy Factor (ft ³ /kWh)
Horizontal axis, cold rinse option, automatic fill, thermostatically controlled mixing valve, improved water extraction	1.62
Vertical axis, cold rinse option, automatic fill, thermostatically controlled mixing valve, improved water extraction	1.02
Vertical axis, cold rinse option, water level option, standard mixing valve	0.64
Vertical axis, no cold rinse option, no water level option	0.47

The hourly hot water use profiles for individual end-uses in existing homes (Figures 1 through 3) are the same as the profiles recommended by Building America for analyzing new construction (Hendron 2005). For software tools that do not accept this level of detail, or if no DHW end-use improvements have been made to the house, then the combined hourly hot water profile may be used (Figure 4).

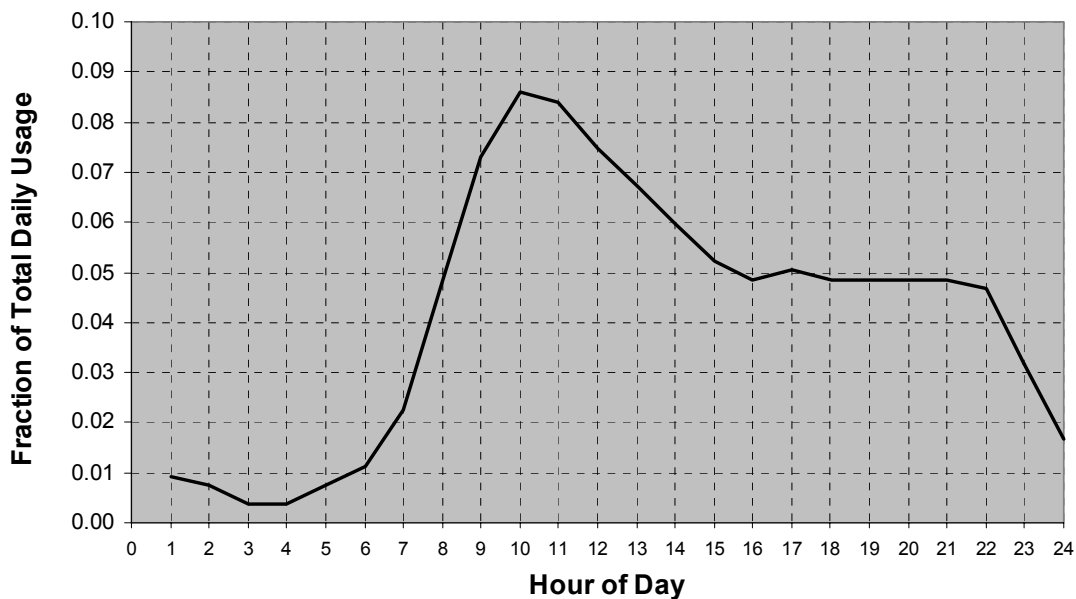


Figure 1. Clothes washer hot water use profile

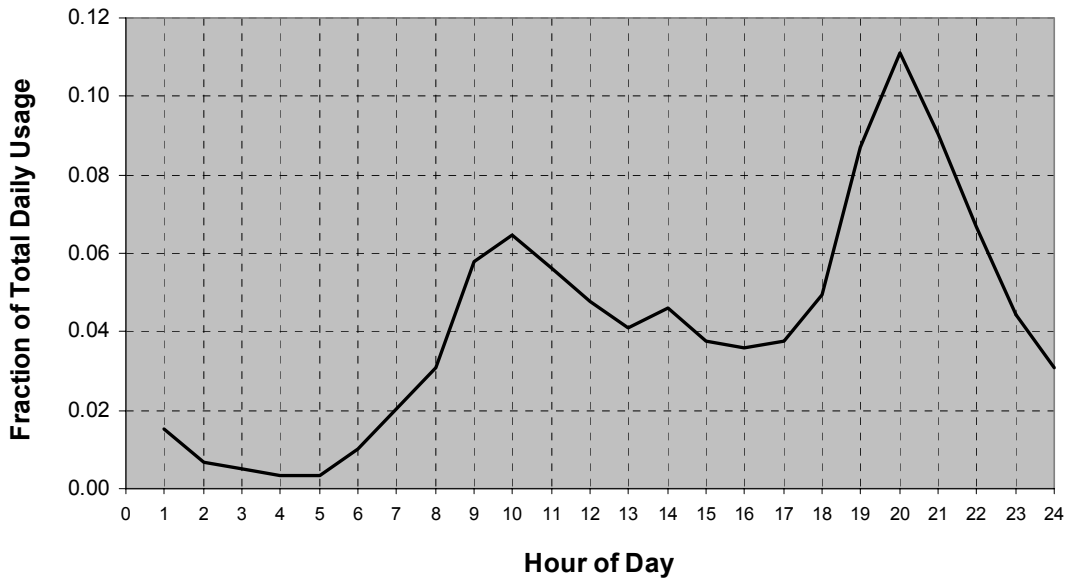


Figure 2. Dishwasher hot water use profile

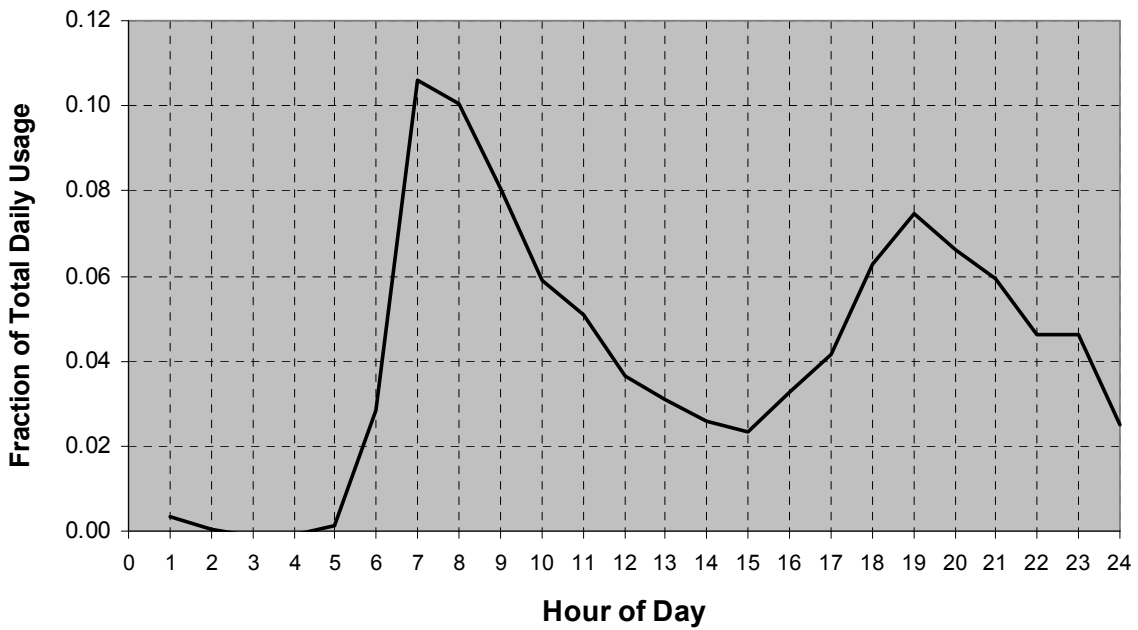


Figure 3. Shower, bath, and sink hot water use profile

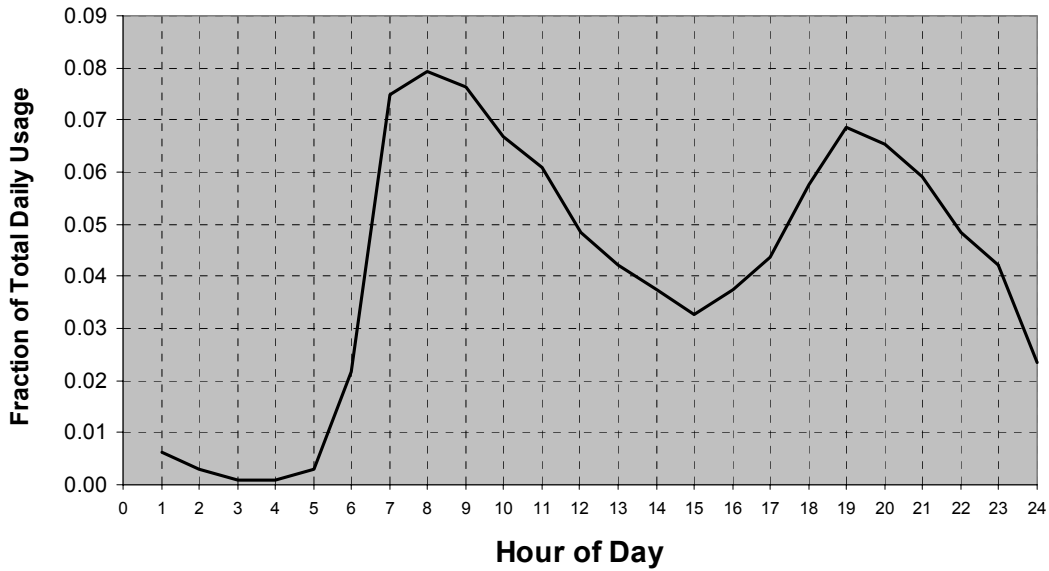


Figure 4. Combined domestic hot water use profile

The mains water temperature, which is an important driver of water-heating energy, varies significantly depending on the location and time of year. Equation 4, based on TMY2 data for the geographic location of the existing house, shall be used to estimate the daily mains water temperature for both the Pre- and Post-Retrofit Cases. Because temperature changes between the mains and the DHW inlet and/or cold water fixtures are not factored into this equation, it is currently assumed that the mains temperature and the cold water temperature inside the house are approximately the same. The derivation of the mains temperature equation is discussed in more detail in the Benchmark report (Hendron 2005).

Equation 4: $T_{\text{mains}} = (T_{\text{amb,avg}} + \text{offset}) + \text{ratio} * (\Delta T_{\text{amb,max}} / 2) * \sin (0.986 * (\text{day\#} - 15 - \text{lag}) - 90)$

where:

- T_{mains} = mains temperature (°F), assumed equal to the cold water supply temperature
- $T_{\text{amb,avg}}$ = annual average ambient air temperature (°F)
- $\Delta T_{\text{amb,max}}$ = maximum difference between monthly average ambient temperatures (e.g., $T_{\text{amb,avg,july}} - T_{\text{amb,avg,january}}$) (°F)
- 0.986 = degrees/day (360/365)
- day# = Julian day of the year (1-365)
- offset = 6°F
- ratio = $0.4 + 0.01 (T_{\text{amb,avg}} - 44)$
- lag = $35 - 1.0 (T_{\text{amb,avg}} - 44)$.

Air Infiltration and Ventilation

The effective leakage area for the Pre-Retrofit Case shall be calculated based on blower door testing conducted in accordance with ASTM E779-03 (ASTM 2003). If the whole-house simulation tool being used cannot calculate hourly infiltration based on effective leakage area, an annual average natural infiltration rate may be used based on the guidelines in ASHRAE Standard 119 (ASHRAE 1988), Section 5, and ASHRAE Standard 136 (ASHRAE 1993), Section 4. It is recommended that blower door measurements be supplemented with tracer gas testing when possible.

Additional air exchange resulting from mechanical ventilation shall be assumed for the model of the Pre-Retrofit Case, if it does not meet the ventilation guidelines of ASHRAE Standard 62.2-2004 (ASHRAE 2004b) for existing homes based on natural infiltration plus any existing mechanical ventilation system. This “supplemental” mechanical ventilation shall be calculated using Equation 5, which is based on a simple continuous exhaust fan designed to raise the total ventilation rate to the minimum values specified in Equation 4.1a of ASHRAE Standard 62.2-2004, taking into account any infiltration credit allowed under Section 4.1.3. Supplemental mechanical ventilation shall be combined with the actual ventilation and natural infiltration in accordance with Section 4.4 of ASHRAE Standard 136 to determine an approximate combined effective air-change rate. The fan energy use associated with supplemental mechanical ventilation for the Pre-Retrofit shall be calculated using Equation 6 and added to the energy used by any actual ventilation fan present in the house.

$$\text{Equation 5: } Q_{\text{sup}} = [0.01 \times \text{FFA} + 7.5 \times (\text{Nbr} + 1)] - [\text{AI} \times \text{CFA} \times \text{H} / 60 - 2 \times \text{FFA} / 100] / 2$$

where:

- Q_{sup} = supplemental mechanical ventilation assumed for the Pre-Retrofit Case (cfm) not including interactions with natural infiltration
- FFA = finished floor area (ft²)
- CFA = conditioned floor area, including directly or indirectly conditioned basements (ft²)
- H = average height of one story (ft)
- A_I = annual average air changes per hour resulting from natural infiltration (ACH)
- N_{br} = number of bedrooms.

$$\text{Equation 6: Supplemental ventilation fan energy (kWh/yr)} = 3.942 \times Q_{\text{sup}}.$$

Lighting Equipment and Usage

The total annual lighting budget for the Pre-Retrofit case shall be determined by conducting a detailed audit of light fixtures and bulbs inside and outside the house. Operating hours may be determined through long-term monitoring or by conducting occupant interviews or surveys. If

reliable estimates of operating hours cannot be obtained or calculated, then the default operating hours estimated in the Navigant study may be used (Table 13).

Table 13. Default Lighting Operating Hours for Common Room Types (Navigant 2002)

Room Type	Operation (Hours/day/room)	Room Type	Operation (Hours/day/room)
Bathroom	1.8	Kitchen	3.0
Bedroom	1.1	Living Room	2.5
Closet	1.1	Office	1.7
Dining Room	2.5	Outdoor	2.1
Family Room	1.8	Utility Room	2.0
Garage	1.5	Other	0.8
Hall	1.5		

The annual average normalized daily load shape for interior lighting use is shown in Figure 5 and is the same profile used by Building America in the context of new construction. This load shape is also used for exterior and garage lighting. Monthly variations in load shape and lighting energy use resulting from changes in the length of days can be accounted for, as long as the variation is applied to all the simulation models and total annual energy use remains the same. Other factors may also be considered, including day types (weekday vs. weekend), occupancy types (day-use vs. non-day-use or “nuclear” vs. “yuppie”), season (summer vs. winter), and room types (living area vs. bedroom area). Individual normalized profiles can be “rolled up” to various levels of detail appropriate to the simulation model. An example of one detailed set of profiles developed by NREL is shown in Figure 6. Other profiles are included in spreadsheets available on the Building America Web site (www.eere.energy.gov/buildings/building_america/pa_resources.html).

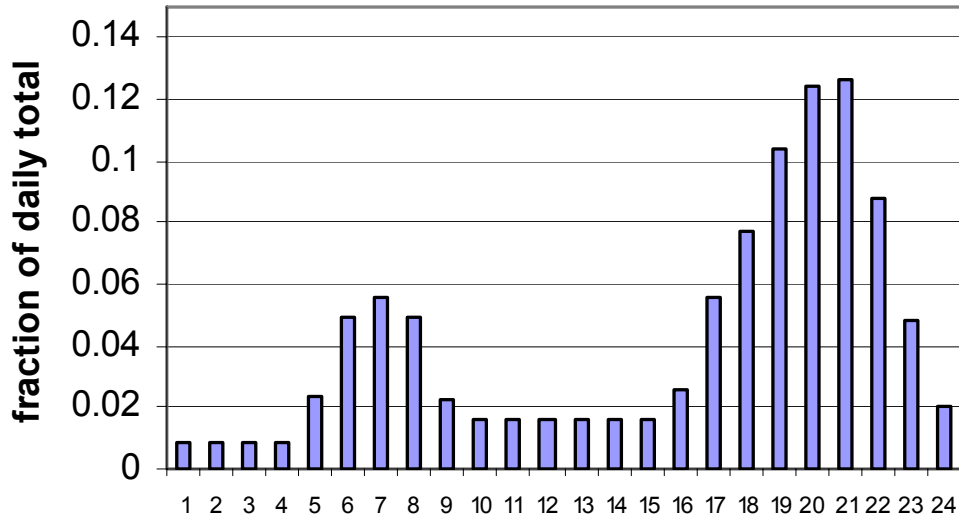


Figure 5. Annual average interior lighting profile (built up from detailed profiles)

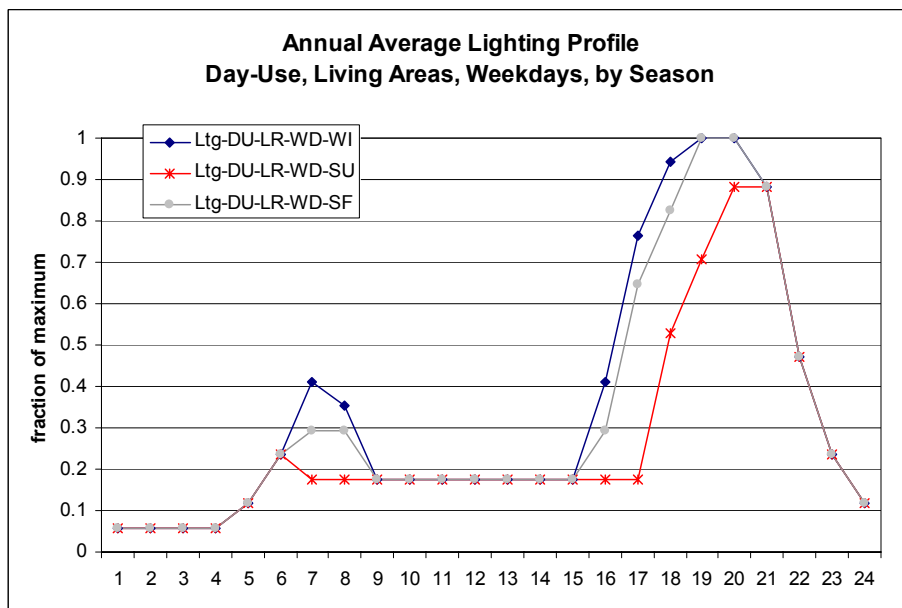


Figure 6. Example of a detailed lighting profile (expressed as fraction of peak daily lighting energy)

Appliances and Miscellaneous Electric Loads

As with lighting, several characteristics must be defined for appliances and miscellaneous electric loads (MELs): the amount of the load, the schedule of the load, the location of the load, the fraction of the load that becomes a sensible heat gain, and the fraction of the load that becomes a latent heat gain.

To the extent possible, actual specifications for all major appliances should be obtained through inspection. Spot electricity measurements may be performed for loads that are relatively constant when operating, such as refrigerators and freezers. A more standardized procedure for calculating average daily electricity use for refrigerators was developed by LBNL (Szydlowski and Cleary 1988). If EnergyGuide labels are not used, it is important that the same refrigerator audit procedures are used for both the Pre- and Post-Retrofit cases to ensure a fair comparison.

If EnergyGuide labels are available for dishwashers or clothes washers, then the BA Analysis Spreadsheet shall be used to estimate annual energy use. If EnergyGuide labels cannot be located or do not exist for certain major appliances (e.g., ovens and clothes dryers), the default energy factors in Tables 11 through 12 and 14 through 17 shall be used. These defaults were derived from historical appliance efficiency studies (Wenzel et al. 1997, DOE 2004b, EPRI 1986) and technical support documents for recent changes to Federal appliance standards (DOE 1993, DOE 2000b). If the specific equipment type is not listed in the default tables, the efficiency may either be interpolated based on listed equipment or estimated using the original reference sources. The default efficiencies must be used in conjunction with the BA Analysis Spreadsheet to estimate annual electricity and hot water use.

Operating hours estimated through occupant surveys or interviews may be useful for determining the cost-effectiveness of replacing certain appliances and electronic equipment for a particular homeowner. However, the standard operating conditions specified for the Benchmark shall be used for the purpose of calculating and reporting whole-house energy savings for the Post-Retrofit Case.

Table 14. Default Gas Clothes Dryer Characteristics (Assumes Typical 1990 Clothes Washer Capacity and Remaining Moisture Content)

Equipment Characteristics	Energy Factor (lb/kWh)
Cool-down mode, intermittent ignition, automatic termination control, improved door seal, well insulated	2.67
Cool-down mode, intermittent ignition, timer control, improved door seal, well insulated	2.40
No cool-down mode, pilot light, timer control, poor door seal, poorly insulated	2.00

Table 15. Default Electric Clothes Dryer Characteristics (Assumes Typical 1990 Clothes Washer Capacity and Remaining Moisture Content)

Equipment Characteristics	Energy Factor (lb/kWh)
Cool-down mode, automatic termination control, improved door seal, well insulated	2.75
No cool-down mode, timer control, poor door seal, poorly insulated	2.60

Table 16. Default Gas Oven / Cooktop Characteristics

Equipment Characteristics	Energy Factor	Annual Gas Energy (therms/yr)
Cooktop: intermittent ignition, sealed burner Oven: spark ignition, not self cleaning, improved door seals, reduced vent rate, high-density insulation	Cooktop: 42.0% Oven: 6.2%	Cooktop: 17 Oven: 18
Cooktop: intermittent ignition, open burner Oven: electric glo-bar ignition, self cleaning	Cooktop: 40.0% Oven: 5.8%	Cooktop: 18 Oven: 19 (+80 kWh)
Cooktop: pilot lights Oven: pilot light, not self-cleaning, standard door seals, standard vent rate, standard insulation	Cooktop: 18.8% Oven: 3.5%	Cooktop: 39 Oven: 36

Table 17. Default Electric Oven / Cooktop Characteristics

Equipment Characteristics	Energy Factor	Annual Electric Energy (kWh/yr)
Cooktop: reflective pans, flat coil elements Oven: self-cleaning, improved door seals	Cooktop: 77.7% Oven: 10.2%	Cooktop: 270 Oven: 349
Cooktop: solid disc elements Oven: not self-cleaning, improved door seals, reduced vent rate, high-density insulation	Cooktop: 74.2% Oven: 12.1%	Cooktop: 282 Oven: 293
Cooktop: non-reflective pans, rounded coil elements Oven: not self-cleaning, standard door seals, standard vent rate, standard insulation	Cooktop: 73.7% Oven: 10.9%	Cooktop: 284 Oven: 326

In most cases, Miscellaneous Electric Loads (MELs) shall be treated as a constant function of finished floor area, regardless of the actual MELs present in the Pre-Retrofit Case (Equation 7). A multiplier is applied if the house is located in one of the four most populated states as determined in the EIA Residential Energy Consumption Survey (RECS) (DOE 2001). Multipliers for these four states were estimated based on the final electric end-use regression equations developed for the 2001 RECS, substituting national average values for known housing characteristics and physical traits of the occupants (such as number of bedrooms, number of ceiling fans, and age of homeowner) and removing end-uses that are treated separately in this report (such as lighting and clothes dryer). The multiplier is 1.0 for most states because insufficient information is available about the magnitude of MELs in those states.

Equation 7: $MEL = (2803 + 0.316 \times FFA + 194 \times N_{br}) \times F_s$,

where:

MEL = miscellaneous electric loads for the Pre-Retrofit Case (kWh/yr)

FFA = finished floor area (ft²)

N_{br} = number of bedrooms

F_s = state multiplier (New York = 0.82, California = 0.77, Florida = 0.94, Texas = 1.11, all others = 1.00).

Alternatively, if MEL improvements are included in the retrofit package, analysts may use the more detailed methodology developed for new construction (Hendron and Eastment 2006), which allows energy savings credit for replacement of small appliances and reduction of standby losses. This methodology is automated in the BA MEL Analysis Spreadsheet (www.eere.energy.gov/buildings/building_america/pa_resources.html).

The fraction of end-use energy converted into internal sensible and latent load is shown in Table 18. Not all of the energy consumed by appliances is converted into internal load; much of the waste heat is exhausted to the outside or released down the drain in the form of hot water.

Table 18. Default Internal Loads from Appliances and Small Electric End-uses in the Pre-Retrofit Case

Appliance	Sensible Load Fraction	Latent Load Fraction
Refrigerator	1.00	0.00
Freezer	1.00	0.00
Clothes Washer	0.80	0.00
Clothes Dryer (Electric)	0.15	0.05
Clothes Dryer (Gas)	1.00 (Electric) 0.10 (Gas)	0.00 (Electric) 0.05 (Gas)
Dishwasher (eight place settings)	0.60	0.15
Range (Electric)	0.40	0.30
Range (Gas)	0.30	0.20
Plug-In Lighting	1.00	0.00
Miscellaneous Electric Loads	0.66	0.02

The hourly, normalized load shape for combined residential equipment (Figure 7) is based on the results of the End-Use Load and Consumer Assessment Program (ELCAP) study of household electricity use in the Pacific Northwest (Pratt et al. 1989). In most situations this profile is adequate for simulating all electric and gas end-uses except space conditioning and hot water. However, because some individual end-use profiles are nearly constant (such as refrigerator and transformer loads) and some are highly dependent on time of day (such as the range and dishwasher), we have also developed a series of normalized hourly profiles for major appliances and MELs (Figures 8 through 13). Numerical values associated with these profiles can be found in the BA Analysis Spreadsheet posted on the Building America web site (www.eere.energy.gov/buildings/building_america/pa_resources.html). The hourly profiles for machine energy usage in the clothes washer and dishwasher are identical to those provided earlier in the section on DHW (Figures 1 and 2). The profile for plug-in lighting is the same as the profile for hard-wired lighting presented in Figure 5.

All hourly end-use profiles were taken from the ELCAP study, except the profile for Miscellaneous Electric Loads, which was derived by subtracting the energy consumption profiles for the major appliances from the combined profile for all equipment, assuming an all-electric, 1800-ft², three-bedroom house in Memphis, Tennessee. Because the MEL profile is based on a residual, it is susceptible to greater systematic errors and may be less realistic than the profiles for major appliances. These end-use profiles are the same as those used for analyzing new construction. Internal sensible and latent heat gains from appliances and plug loads shall be modeled using the same profiles used for end-use consumption. Appliance loads may be modeled in either the living spaces or bedroom spaces, depending on their location in the house.

Large end uses in the Pre-Retrofit Case that are not part of typical houses (such as swimming pools, Jacuzzis, and workshops) should not be explicitly included in the models for either the Pre- or Post-Retrofit Case. The efficiency of these end uses should be addressed in a separate analysis.

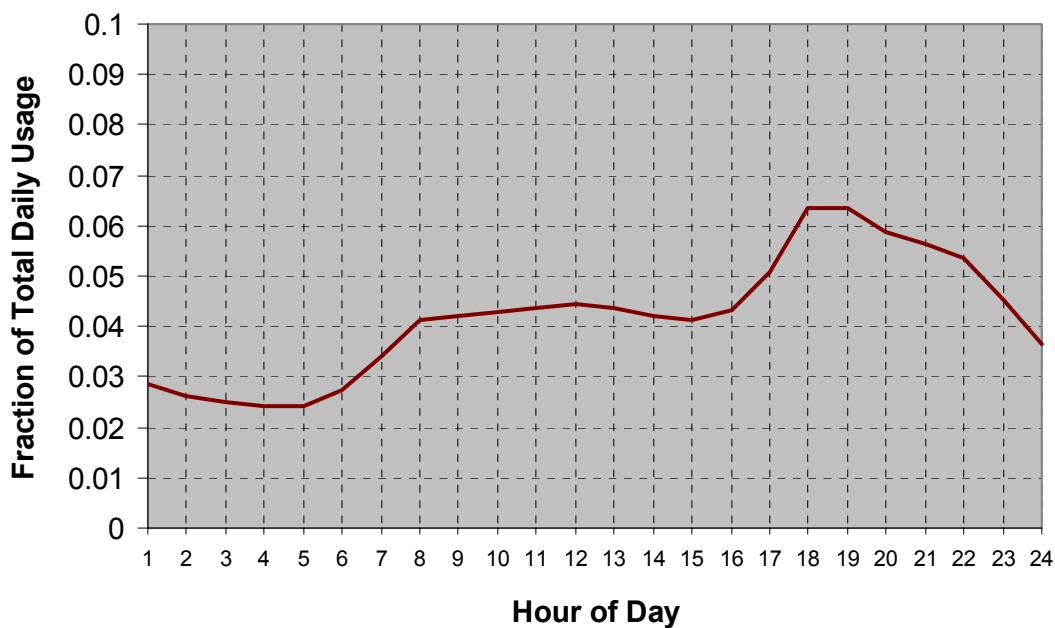


Figure 7. Total combined residential equipment profile (Pratt et al. 1989)

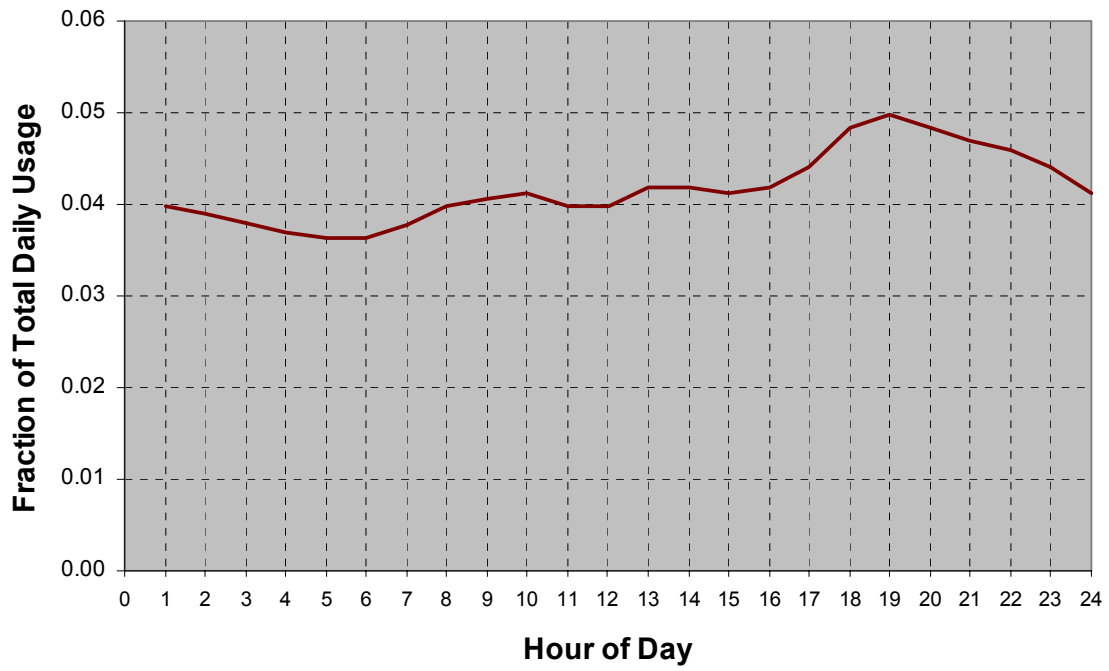


Figure 8. Refrigerator and freezer normalized energy-use profile (Pratt et al. 1989)

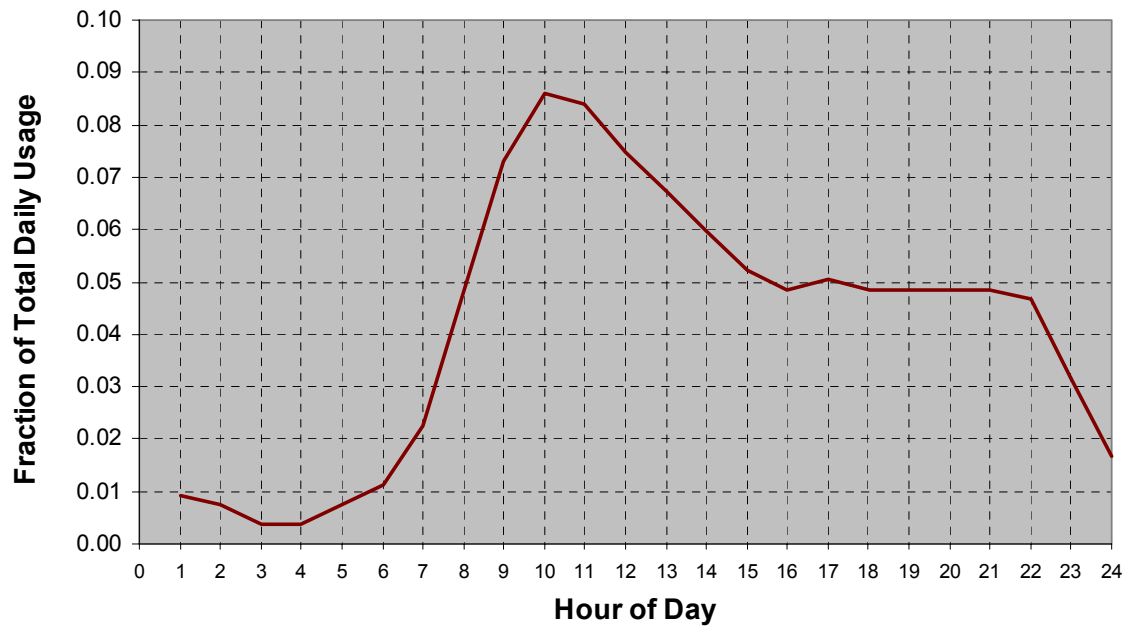


Figure 9. Clothes washer normalized machine energy-use profile (Pratt et al. 1989)

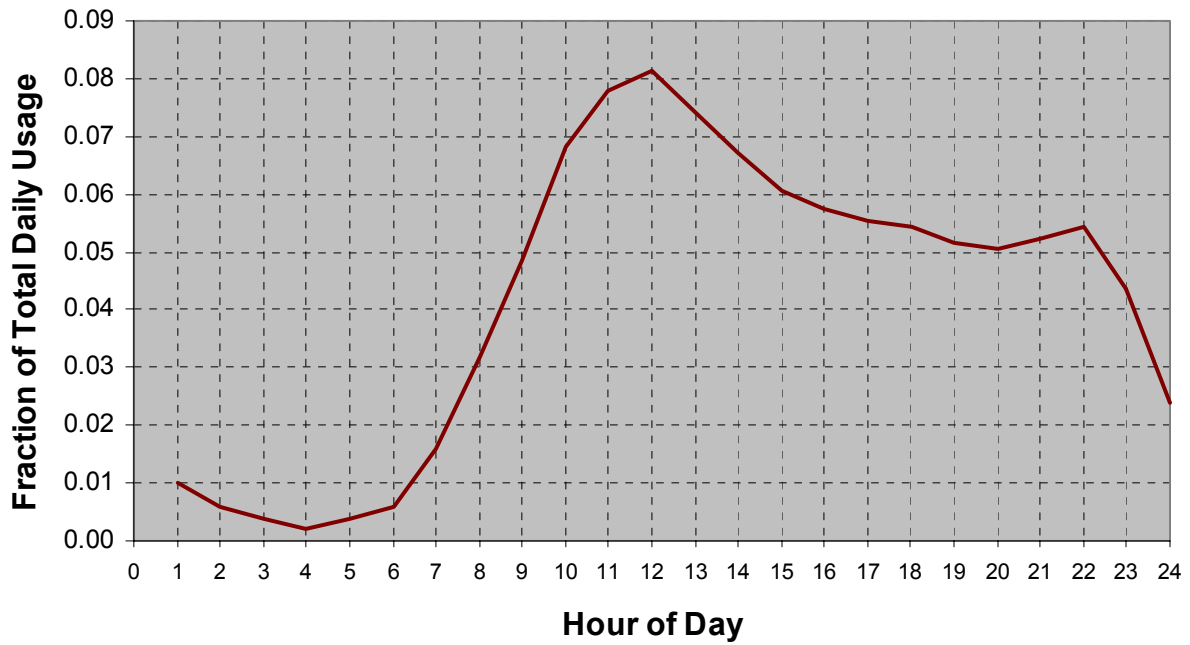


Figure 10. Clothes dryer normalized energy use profile (Pratt et al. 1989)

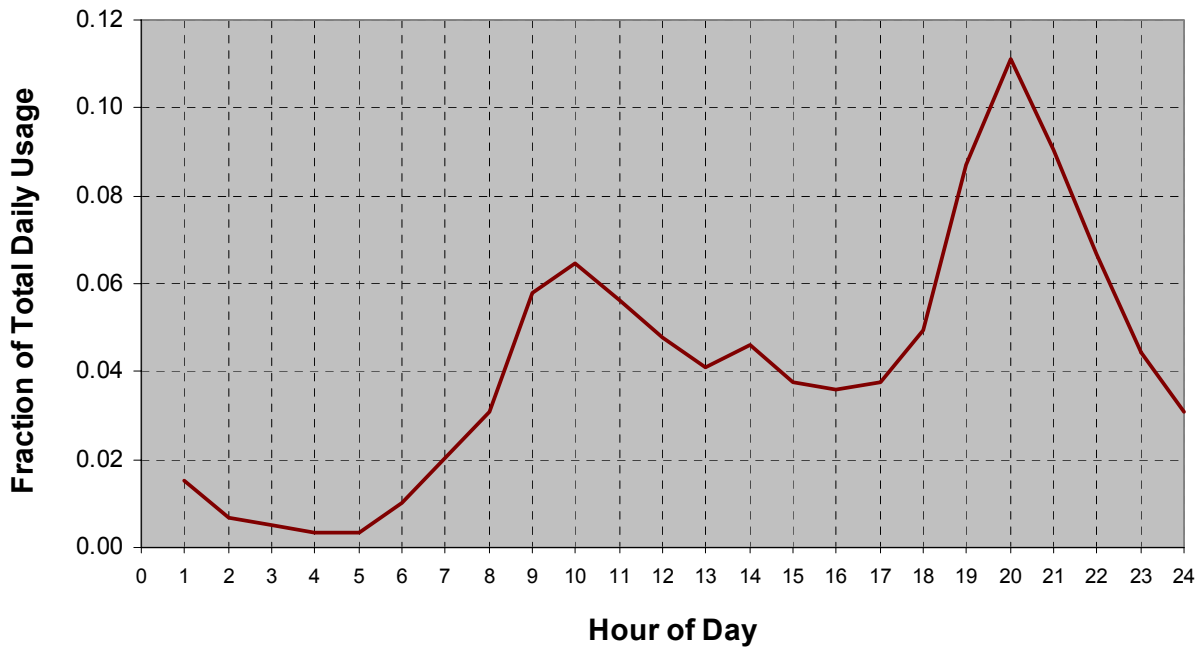


Figure 11. Dishwasher normalized energy use profile (Pratt et al. 1989)

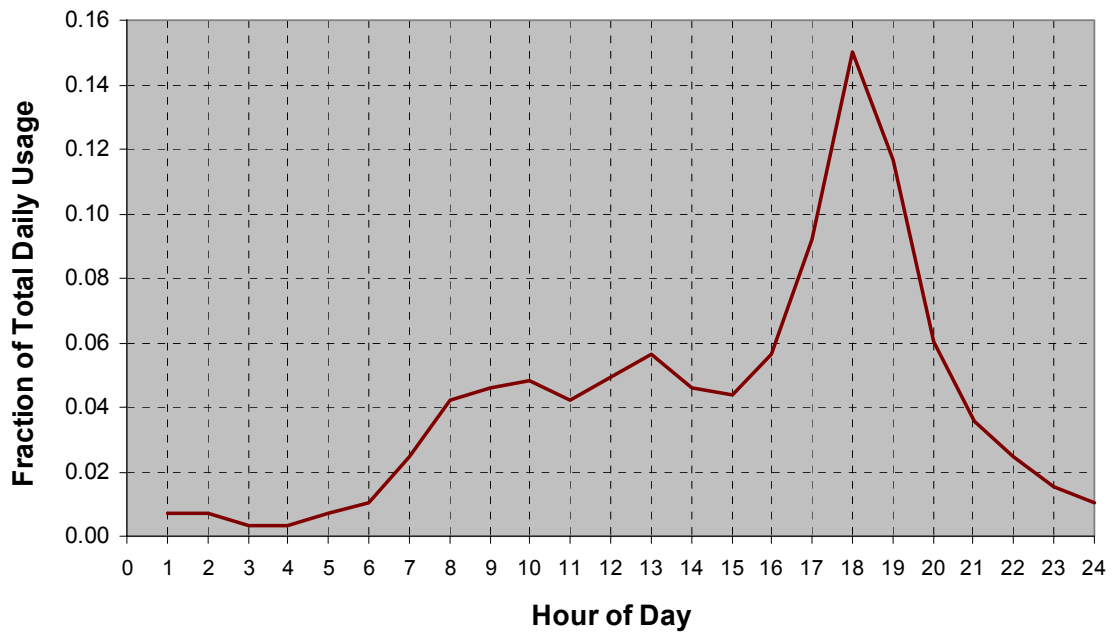


Figure 12. Range / oven normalized energy-use profile (Pratt et al. 1989)

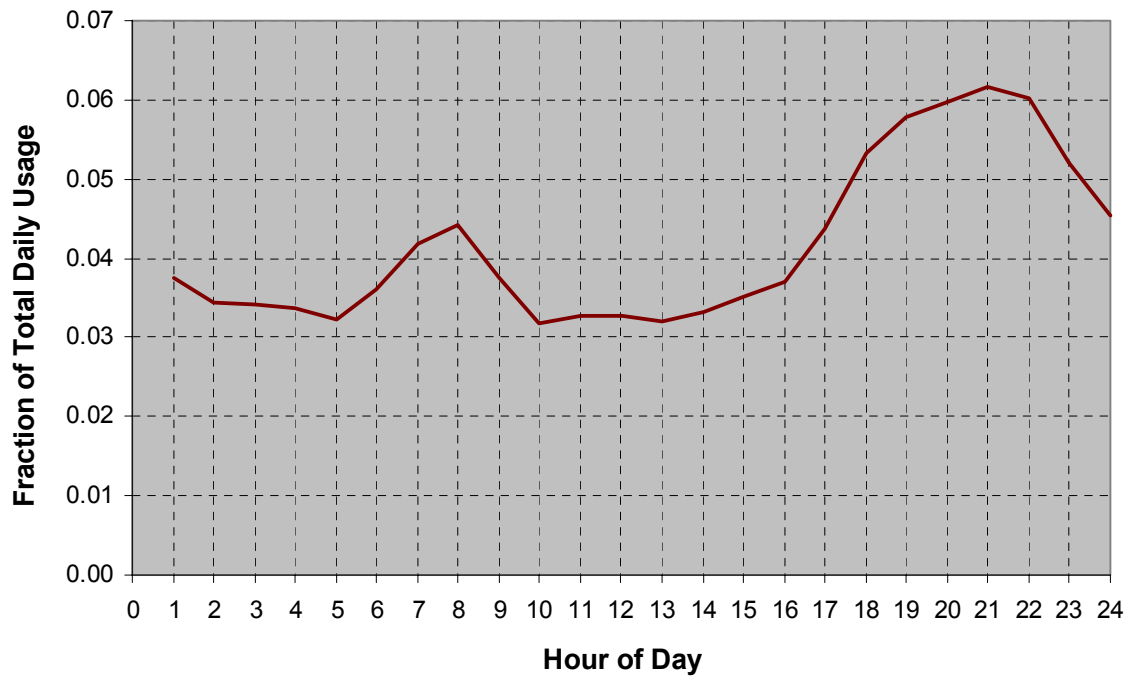


Figure 13. Miscellaneous electric load normalized energy-use profile

Site Generation

If the Pre-Retrofit Case includes site electricity generation equipment, such as a fuel cell, photovoltaic system, or wind turbine, then the total energy production shall be calculated using a generally accepted engineering methodology.

Modeling the Post-Retrofit Case

The Post-Retrofit Case is modeled either as-designed or as-built, depending on the status of the project. All parameters for the Post-Retrofit model shall be based on final design specifications or measured data, with the following exceptions and clarifications:

- Any house characteristics that are unknown or not part of the package of energy efficiency improvements shall be the same as the Pre-Retrofit Case.
- The effective leakage area for the Post-Retrofit Case shall be calculated based on blower-door testing conducted in accordance with ASTM E779. If the whole-house simulation tool cannot calculate hourly infiltration based on effective leakage area, an annual average natural infiltration rate may be used based on the guidelines in ASHRAE Standard 119, Section 5, and ASHRAE Standard 136, Section 4. It is recommended that blower-door measurements be supplemented with tracer-gas testing when possible.
- In order to treat mechanical ventilation in a neutral manner, additional air exchange resulting from mechanical ventilation shall be assumed for the model of the Post-Retrofit Case if it does not meet the ventilation guidelines of ASHRAE Standard 62.2-2004 (ASHRAE 2004b) for existing homes based on natural infiltration plus any existing mechanical ventilation system. The same approach used for Pre-Retrofit Case shall be used to calculate “supplemental” mechanical ventilation (Equation 5) based on a simple continuous exhaust fan designed to raise the total ventilation rate to the minimum values specified in Equation 4.1a of ASHRAE Standard 62.2-2004, taking into account any infiltration credit allowed under Section 4.1.3 and the actual mechanical ventilation system (if any) present in the house. Mechanical ventilation shall be combined with natural infiltration in accordance with Section 4.4 of ASHRAE Standard 136 to determine an approximate combined effective air change rate. The additional fan energy use associated with supplemental mechanical ventilation for the Post-Retrofit Case shall be calculated by multiplying the supplemental ventilation rate by 3.942 kWh/cfm (Equation 6). This energy shall be added to the energy used by any ventilation fan present in the house.
- For cooling equipment, the energy efficiency ratio (EER) along with part-load performance characteristics should be used in the annual simulation whenever possible. SEER is less desirable for an annual simulation, but is often the only information that is publicly available about a cooling system. If the actual EER for the Post-Retrofit Case is not readily available, Equation 8 may be used to make an approximate conversion from SEER to EER (Wassmer 2003).

$$\text{Equation 8: } \text{EER} = -0.02 \times \text{SEER}^2 + 1.12 \times \text{SEER}$$

- The installation of energy-saving appliances or other equipment may reduce hot water consumption for certain end uses, reduce the internal sensible and latent loads, or affect the hourly operating profiles. Energy-savings calculations for the Post-Retrofit Case must take

these effects into account using operating conditions based on rules developed for DOE residential appliance standards (DOE 1999) and the actual performance characteristics of the appliances. The number of cycles per year specified in the appliance standard for clothes washers is adjusted according to the number of bedrooms and the clothes washer capacity, using Equation 9:

$$\text{Equation 9: Clothes washer cycles per year} = (392) \times (\frac{1}{2} + N_{br}/6) \times 12.5 \text{ lb} / W_{\text{test}}$$

where:

$$W_{\text{test}} = \text{maximum clothes washer test load weight found in 10 CFR part 430, Subpt B, Appendix J1, as a function of the washer capacity in ft}^3.$$

A dryer usage factor (DUF) is applied to the clothes washer cycles to determine the number of annual dryer cycles, using Equation 10:

$$\text{Equation 10: Clothes dryer cycles per year} = \text{DUF} \times \text{Clothes washer cycles per year}$$

where:

$$\text{DUF} = 0.84.$$

The dishwasher annual operating cycles are similarly calculated, using Equation 11:

$$\text{Equation 11: Dishwasher cycles per year} = (215) \times (\frac{1}{2} + N_{br}/6).$$

The BA Analysis Spreadsheet posted on the Building America Web site automates these calculations and is strongly recommended for the analysis of water-consuming appliances. The spreadsheet includes tabs to help analysts calculate energy savings for efficient clothes washers, clothes dryers, and dishwashers. It calculates the split between hot water and machine energy based on the EnergyGuide label, estimates dryer energy savings for clothes washers that reduce remaining moisture content, adjusts energy use for the assumption that both hot water and cold water temperatures for the house are different from the test values (140°F and 60°F/50°F), and adjusts for the type of controls present (thermostatic control valves, boost heating, cold water only). Both annual average and monthly average hot water usage are calculated in the spreadsheet.

- Energy savings for a new range/oven may only be credited if an energy factor has been determined in accordance with the DOE test procedures for cooking appliances (DOE 1993). Annual energy consumption is then estimated as the product of the energy factor and the annual useful cooking energy output as defined in the same test procedure. If the energy factor is unknown for a new range/oven, then it shall be assumed that the Post-Retrofit energy use for cooking is the same as the Pre-Retrofit case.
- Modifications to the Pre-Retrofit lighting profile and operating hours because of occupancy sensors or other controls may be considered for the Post-Retrofit Case, but negative and/or positive effects on space conditioning load must also be calculated, assuming 100% of interior lighting energy contributes to the internal sensible load.
- Large end uses that are not part of typical houses (such as swimming pools, Jacuzzis, workshops, etc.) shall not be explicitly included in the models for either the Pre- or Post-Retrofit Case. The efficiency of these end uses should be addressed in a separate analysis.

- For the Post-Retrofit Case, all site electricity generation is credited regardless of energy source. Residential-scale photovoltaic systems, wind turbines, fuel cells, and micro-cogeneration systems are all potential sources of electricity generated on the site. An offset must be applied to this electricity credit equal to the amount of purchased energy used in the on-site generation process. The credit for site generation shall be tracked separately from the whole-house energy analysis and reported as a separate line in the summary tables (discussed later in this report).

Operating Conditions

For consistency within Building America, operating conditions and other assumptions for existing homes shall be the same as those documented in the Benchmark for new construction (www.eere.energy.gov/buildings/building_america/pa_resources.html). The Benchmark guidelines will be updated occasionally (every 2 or 3 years), so the most recent release posted on the BA web site should be consulted before developing the existing homes model.

The following operating conditions and other assumptions, based on the 2005 Benchmark Update, shall apply to both the Pre- and Post-Retrofit Cases. They are intended to represent the behavior of a typical set of occupants, not the current occupants of the house, because Building America is interested in estimating long-term energy savings of improvements to existing homes. The operating conditions are the same for both existing homes and new construction and are based on the cumulative experience of the authors through their work on Building America, HERS, Codes and Standards, and other residential energy efficiency programs.

- The following standard thermostat set points shall be used:

Set point for cooling: 76°F with no setup period

Set point for heating: 71°F with no setback period.

Actual thermostat set points used by the occupants may be used for the purpose of cost-benefit analysis, but not as part of the formal energy-savings analysis reported to Building America.

- The natural ventilation schedule shall be set to reflect windows being opened occasionally. In situations in which there is a cooling load, the outdoor temperature is below the indoor temperature, and the windows are not already open, then the probability of the windows being opened shall be set at a constant 50%. The natural ventilation rate shall be 5 ACH unless each living area and bedroom provides at least two openings on different orientations and the net area of openings exceeds 12% of the floor area of the house (cross-ventilation), in which case a natural ventilation rate of 7 ACH shall be used. If there are local circumstances that would tend to discourage window operation (pollution, security, community standards, etc), then it is acceptable to use a lower probability than 50%, as long as the same natural ventilation schedule is applied to both the Pre- and Post-Retrofit Cases.
- Interior shading multiplier = 0.7 during the cooling season and 0.85 during the heating season and during swing seasons when both cooling and heating occur. Specific guidelines for defining seasons are presented later in this section.
- Internal loads from lighting, appliances, and other equipment were discussed in previous sections. These loads are not necessarily the same for the Pre- and Post-Retrofit Cases;

therefore, they are not considered operating conditions for the purposes of Building America performance analysis.

- The occupancy schedule is defined with the same level of detail as other internal load profiles. For typical Building America houses, the number of occupants shall be estimated based on the number of bedrooms using Equation 12.

Equation 12: Number of occupants = $0.5 \times N_{br} + 1.5$

where:

N_{br} = Number of bedrooms.

Sensible and latent gains from occupants shall be accounted for separately, and different loads shall be applied in different space types for multi-zone models (Table 19). The occupant heat gains are based on ASHRAE recommendations (ASHRAE 2005). The average hourly occupancy profile is shown in Figure 14, and an example set of detailed hourly occupancy curves is shown in Figure 15. Detailed occupancy profiles based on different day and room types are available in spreadsheet format on the Building America Web site (www.eere.energy.gov/buildings/building_america/pa_resources.html). These profiles, which were developed by NREL, are based on the basic ASHRAE occupancy schedule combined with engineering judgment.

- The internal mass of furniture and contents shall be equal to 8 lbs/ft² of conditioned floor space. For solar distribution purposes, lightweight furniture covering 40% of the floor area shall be assumed. The actual thermal mass present in the house is not used for Building America existing homes analysis.

Table 19. Peak Sensible and Latent Heat Gain from Occupants (ASHRAE 2005)

Multiple Zones	Internal Load (Btu/person/hr)
Living Area Sensible Load	230
Living Area Latent Load	190
Bedroom Area Sensible Load	210
Bedroom Area Latent Load	140
Single Zone	Internal Load (Btu/person/hr)
Sensible Load	220
Latent Load	164

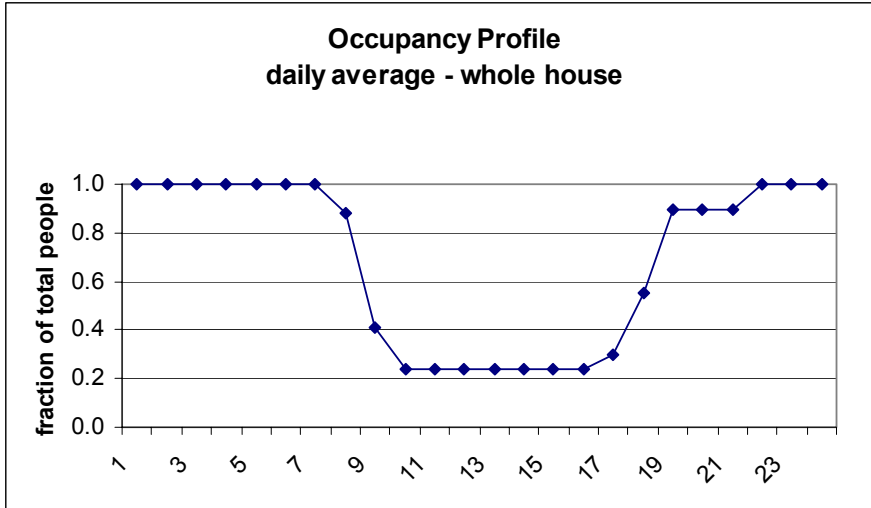


Figure 14. Average hourly load profile from occupants for all day-types and family types (16.5 hours/day/person total)

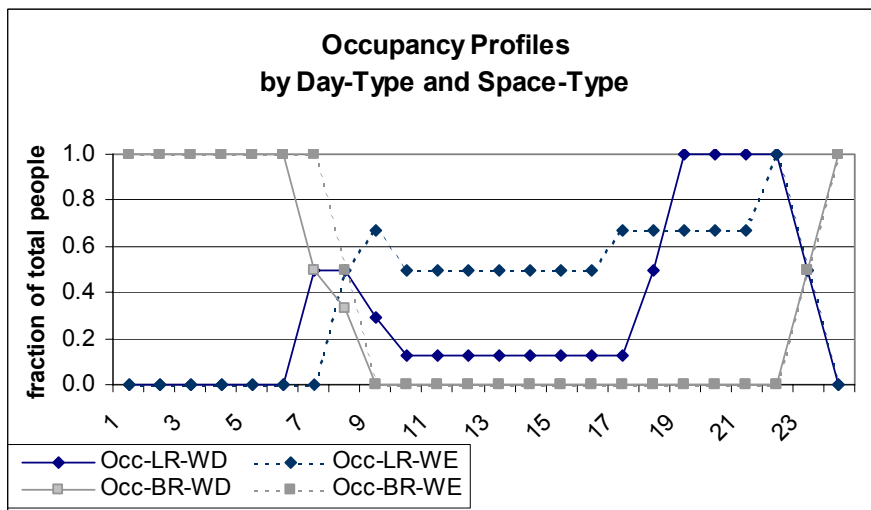


Figure 15. Detailed hourly load profiles resulting from occupants being in different parts of the house on weekdays (WD) and weekends (WE)

- Weather data shall be based on typical meteorological year (TMY2) data (NREL 1995) from 1961 through 1990 or equivalent data for the nearest weather station.
- Heating and cooling shall only occur during certain months of the year in accordance with the guidelines presented below. Alternate operating profiles may be acceptable with sufficient justification. The heating and cooling seasons shall be determined on the basis of the monthly average temperatures (MAT) and the 99% (annual, not seasonal) winter design temperatures (WDT) based on TMY2 data or the 2005 ASHRAE Handbook of Fundamentals for the nearest location, in accordance with the following procedures:

Step 1. MAT Basis

- (I) The heating system shall be enabled for a month in which the MAT is less than 71.5°F.
- (II) The cooling system shall be enabled for a month in which the MAT is greater than 66°F.

Step 2. WDT and SDT

- (I) The heating system shall be enabled in December and January if the WDT is less than or equal to 59°F, regardless of the outcome in Step 1 above.
- (II) The cooling system shall be enabled in July and August regardless of the outcome in Step 1 above.

Step 3. Swing Season Adjustment

- (I) If, based on Steps 1 and 2 above, there are two consecutive months in which the heating system is enabled the first month and the cooling system is enabled the following month, or vice versa, then both the heating system and the cooling system shall be enabled for both of these months.

These heating and cooling season procedures are automated in the BA Analysis Spreadsheet (www.eere.energy.gov/buildings/building_america/pa_resources.html).

Reporting Energy Use and Energy Savings

Reporting energy use and energy savings in a consistent format is an important component of Building America analysis. The following tables shall be supplied with the analysis report for every existing homes project.

Table 20 shows an example of a site energy consumption report for a hypothetical project, before and after the retrofits are performed. Similar information based on source energy is presented in Table 21, along with percent energy savings for each end use. End uses are described in more detail in Table 22.

The “Percent of End Use” column in Table 21 shows the Post-Retrofit energy savings for each end use as a fraction of the energy use in the Pre-Retrofit Case. The “Percent of Total” columns show the contribution of each end use toward an overall energy-reduction goal.

Source energy is determined using Equation 13. The site to source multiplier for energy sources other than electricity or natural gas is assumed to be 1.0.

$$\text{Equation 13: Source MBtu} = \text{kWh} \bullet 3.412 \bullet M_e / 1000 + \text{therms} \bullet M_g / 10$$

where:

$M_e = 3.16$ = site to source multiplier for electricity (DOE 2002)

$M_g = 1.02$ = site to source multiplier for natural gas (DOE 1995).

Table 20. Example Summary of Site Energy Consumption by End-use for an Existing Homes Project

<i>End Use</i>	Annual Site Energy			
	Pre-Retrofit		Post-Retrofit	
	(kWh)	(therms)	(kWh)	(therms)
Space Heating	11,225	0	4,397	0
Space Cooling	2,732	0	902	0
DHW	4,837	0	1,351	0
Lighting	3,110		1,204	
Appliances + MEL	7,646	0	7,436	0
OA Ventilation	400		400	
Total Usage	29,950	0	15,690	0
Site Generation	0		7,402	
Net Energy Use	29,950	0	8,289	0

Table 21. Example Summary of Source Energy Consumption by End-use for an Existing Homes Project

<i>End Use</i>	<i>Estimated Annual Source Energy</i>		<i>Source Energy Savings</i>	
	Pre-Retrofit (MBtu/yr)	Post-Retrofit (MBtu/yr)	Percent of End-Use	Percent of Total
Space Heating	115	45	61%	23%
Space Cooling	28	9	67%	6%
DHW	50	14	72%	12%
Lighting	32	12	61%	6%
Appliances + MEL	78	76	3%	1%
OA Ventilation	4	4	0%	0%
Total Usage	307	161	48%	48%
Site Generation	0	-76		25%
Net Energy Use	307	85	72%	72%

Table 22. End-Use Categories

End Use	Potential Electric Usage	Potential Gas Usage
Space Heating	Supply fan during space heating, heat pump, heat-pump supplemental heat, water-boiler heating elements, water-boiler circulation pump, electric-resistance heating, heat-pump crankcase heat, heating-system auxiliary	Gas furnace, gas boiler, gas back-up heat-pump supplemental heat, gas ignition stand-by
Space Cooling	Central split-system A/C, packaged A/C (window or through-the-wall), supply-an energy during space cooling, A/C crankcase heat, cooling-system auxiliary	Gas absorption chiller (rare)
DHW	Electric hot water heater, heat-pump water heater, hot water circulation pumps	Gas hot water heater
Lighting	Indoor lighting, outdoor lighting	None
Appliances & MEL	Refrigerator, electric clothes dryer, gas clothes dryer (motor), cooking, miscellaneous electric loads	Cooking, gas clothes dryer
OA Ventilation	Ventilation fans, supply-air fan during ventilation mode	None
Site Generation	Photovoltaic electric generation	None

Table 23 reports energy savings for individual energy efficiency measures applied to the Pre-Retrofit Case, in terms of site energy, source energy, and energy cost. “Source Energy Savings %” is determined by comparing the source energy for each measure increment to the source energy for the Pre-Retrofit Case (i.e., the first row). In this column, the incremental savings for each measure are added to the savings for all the previous measures. The final row of the column is the overall energy savings achieved for the Post-Retrofit Case.

When available, actual energy tariffs for the house shall be used to determine whole-building energy costs. Peak hourly energy consumption should also be reported Pre- and Post-Retrofit for every project. Peak energy is based on the hour with the greatest gas or electric energy consumption during the course of 1 year, as determined by the hourly simulation.

Table 23. Example Measure Savings Report for an Existing Homes Project²

Increment					National Average		Economics (Local Costs)			
	Site Energy		Source Energy		Energy Cost		Energy Cost		Measure Package	
	(kWh)	(therms)	(MBtu)	Savings (%)	(\$/yr)	Savings (%)	(\$/yr)	Savings (%)	Value (\$/yr)	Savings (\$/yr)
Pre-Retrofit	29,950	0	306.9		\$ 2,995		\$ 2,950			
+ Improved walls	27,779	0	284.6	7%	\$ 2,778	7%	\$ 2,736	7%	\$ 190.4	\$ 190
++ Low-E Windows	25,810	0	264.5	14%	\$ 2,581	14%	\$ 2,542	13%	\$ 193.9	\$ 384
++ Smaller A/C (5≥ 4 tons)	25,420	0	260.5	15%	\$ 2,542	15%	\$ 2,504	14%	\$ 38.4	\$ 423
++ Including Basement Wall Insulation	25,170	0	257.9	16%	\$ 2,517	16%	\$ 2,479	15%	\$ 24.6	\$ 447
++ Ground Source HP (+DHW)	19,331	0	198.1	35%	\$ 1,933	35%	\$ 1,904	35%	\$ 575.1	\$1,023
++ Solar DHW	17,718	0	181.5	41%	\$ 1,772	41%	\$ 1,745	40%	\$ 158.9	\$1,181
++ Lighting, Appliances and Plug	15,690	0	160.8	48%	\$ 1,569	48%	\$ 1,545	47%	\$ 199.8	\$ 1,381
++ PV (Post-Retrofit)	8,288	0	84.9	72%	\$ 829		\$ 816	72%	\$ 729.0	\$ 2,110

Acknowledgments

The author thanks the NREL staff for their ideas and inputs on this project, especially Ren Anderson, Paul Torcellini, Ali Jalalzedah, Mark Eastment, and Nancy Wells. The author also acknowledges the resources and guidance provided by Ed Pollock and George James of the U.S. Department of Energy Building America Program.

² Calculated using national average electric cost = \$0.10/kWh and national average gas cost = \$0.50/therm.

References

- ASTM (American Society for Testing and Materials). 2003. *Standard Test Method for Determining Air Leakage Rate by Fan Pressurization*. ASTM E779-03. Conshohocken, PA: American Society for Testing and Materials.
- ASTM (American Society for Testing and Materials). 1994. *Standard Test Methods for Determining External Air Leakage of Air Distribution Systems by Fan Pressurization*. ASTM E1554-94. Conshohocken, PA: American Society for Testing and Materials.
- ASHRAE (American Society of Heating, Refrigerating, and Air-Conditioning Engineers). 2004a. *HVAC Systems and Equipment Handbook*. Atlanta, GA: American Society of Heating, Refrigerating, and Air-Conditioning Engineers.
- ASHRAE (American Society of Heating, Refrigerating, and Air-Conditioning Engineers). 2004b. *Ventilation and Acceptable Indoor Air Quality in Low-Rise Residential Buildings*, ASHRAE Standard 62.2-2004, Atlanta, GA: American Society of Heating, Refrigerating, and Air-Conditioning Engineers
- ASHRAE (American Society of Heating, Refrigerating, and Air-Conditioning Engineers). 2005. *Fundamentals Handbook*. Atlanta, GA: American Society of Heating, Refrigerating, and Air-Conditioning Engineers.
- ASHRAE (American Society of Heating, Refrigerating, and Air-Conditioning Engineers). 1988. *Air Leakage Performance for Detached Single-Family Residential Buildings*, ASHRAE Standard 119-1988, Atlanta, GA: American Society of Heating, Refrigerating, and Air-Conditioning Engineers.
- ASHRAE (American Society of Heating, Refrigerating, and Air-Conditioning Engineers). 1993. *A Method of Determining Air Change Rates in Detached Dwellings*, ASHRAE Standard 136-1993, Atlanta, GA: American Society of Heating, Refrigerating, and Air-Conditioning Engineers.
- ASHRAE (American Society of Heating, Refrigerating, and Air-Conditioning Engineers). 2001. *Method of Test for Determining the Design and Seasonal Efficiencies of Residential Thermal Distribution Systems*, Proposed ASHRAE Standard 152P, Atlanta, GA: American Society of Heating, Refrigerating, and Air-Conditioning Engineers.
- Burch, J., and Erickson, P. 2004. "Using Ratings Data to Derive Simulation-Model Inputs for Storage-Tank Water Heaters." 2004 National Solar Energy Conference. Boulder, CO: American Solar Energy Society.
- DOE (U.S. Department of Energy). July 1993. Technical Support Document for Residential Cooking Products. Volume 2. Available online at www.eere.energy.gov/buildings/appliance_standards/residential/cooking_products_0998_r.html (accessed July 2005). Washington, D.C.: U.S. Department of Energy.
- DOE (U.S. Department of Energy). December 1995. Measuring Energy Efficiency in the United States Economy: A Beginning. Chapter 7. Available online at www.eia.doe.gov/emeu/efficiency/ee_report_html.htm (accessed May 2004). Washington, D.C.: U.S. Department of Energy.

- DOE (U.S. Department of Energy). 1999. *Code of Federal Regulations Title 10, Energy, Part 430, Subpart B, Appendices C, D, J and JI*, Washington, D.C.: U.S. Department of Energy.
- DOE (U.S. Department of Energy). 2000a. *Technical Support Document: Energy Efficiency Standards for Consumer Products: Residential Water Heaters*. Appendix D-2. Available online at www.eere.energy.gov/buildings/appliance_standards/residential/waterheat_0300_r.html (accessed May 2004). Washington, D.C.: U.S. Department of Energy.
- DOE (U.S. Department of Energy). 2000b. *Final Rule Technical Support Document: Energy Efficiency Standards for Consumer Products: Clothes Washers*. Available online at www.eere.energy.gov/buildings/appliance_standards/residential/clwash_0900_r.html (accessed July 2005). Washington, D.C.: U.S. Department of Energy.
- DOE (U.S. Department of Energy). 2001. *Residential Energy Consumption Survey*. Washington, DC: U.S. Department of Energy.
- DOE (U.S. Department of Energy). 2002. *Technical Support Document: Energy Efficiency Standards for Consumer Products: Residential Central Air Conditioners and Heat Pumps*. Available online at www.eere.energy.gov/buildings/appliance_standards/residential/central_ac_hp.html (accessed August 2005). Washington, D.C.: U.S. Department of Energy.
- DOE (U.S. Department of Energy). 2003. *New and Alternative Insulation Materials and Products*. Energy Savers Fact Sheet. Available online at www.eere.energy.gov/consumerinfo/factsheets/eb9.html (accessed August 2005). Washington, D.C.: U.S. Department of Energy.
- DOE (U.S. Department of Energy). 2004a. *Technical Support Document: Energy Efficiency Program for Consumer Products: Energy Conservation Standards for Residential Furnaces and Boilers*. Available online at www.eere.energy.gov/buildings/appliance_standards/residential/furnaces_boilers_1113_r.html (accessed August 2005). Washington, D.C.: U.S. Department of Energy.
- DOE (U.S. Department of Energy). 2004b. *2004 Buildings Energy Databook*. Available online at <http://btscoredatabook.eren.doe.gov/> (accessed August 2005). Washington, D.C.: U.S. Department of Energy.
- EPRI (Electric Power Research Institute). 1986. *Trends in the Energy Efficiency of Residential Electric Appliances*. EM-4539, Research Project 2034-9. Palo Alto, CA: Electric Power Research Institute.
- EPRI (Electric Power Research Institute). 1987. *TAG Technical Assessment Guide: Volume 2: Electricity End Use*. EPRI P-4463-SR. Palo Alto, CA: Electric Power Research Institute.
- E-Source. 1993. *Space Heating Technology Atlas*. Boulder, CO: E-Source Inc.
- E-Star Colorado. 2005. *R-Value Table*. Available at www.e-star.com/ecalcs/table_rvalues.html (accessed August 2005).

- Hancock, E., Norton, P., and Hendron, R. 2002. *Building America System Performance Test Practices: Part 2, Air-Exchange Measurements*. NREL/TP-550-30270. Golden, CO: National Renewable Energy Laboratory.
- Hendron, R. 2005. *Building America Research Benchmark Definition, Updated December 29, 2004*. NREL/TP-550-37529. Golden, CO: National Renewable Energy Laboratory.
- Hendron, R., and Eastment, M. 2006. "Development of an Energy-Savings Calculation Methodology for Residential Miscellaneous Electric Loads." ACEEE Summer Study on Energy Efficiency in Buildings. Washington, D.C.: American Council for an Energy-Efficient Economy (ACEEE).
- Huang, J.; and Gu, L. 2002. *Prototype Residential Buildings to Represent the U.S. Housing Stock*. Draft LBNL Report. Berkeley, CA: Lawrence Berkeley National Laboratory.
- Judkoff, R.; Balcomb, J. D.; Hancock, C. E.; Barker, G.; and Subbarao, K. 2000. *Side-By-Side Thermal Tests of Modular Offices: A Validation Study of the STEM Method*. NREL Technical Report TP-550-23940. Golden, CO: National Renewable Energy Laboratory.
- Matson, N., Wray, C., Walker, I., and Sherman, M. 2002. *Potential Benefits of Commissioning California Homes*. LBNL-48258. Berkeley, CA: Lawrence Berkeley National Laboratory.
- National Renewable Energy Laboratory (NREL). 1995. *Solar Radiation Data Manual for Buildings*. NREL/TP-463-7904. Golden, CO: NREL.
- Parker, D., McIlvaine, J., Barkaszi, S., Beal, D., and Anello, M. 2000. *Laboratory Testing of the Reflectance Properties of Roofing Material*. FSEC-CR670-00. Cocoa, FL: Florida Solar Energy Center.
- Pratt, R., Conner, C., Richman, E., Ritland, K., Sandusky, W., and Taylor, M. 1989. *Description of Electric Energy Use in Single-Family Residences in the Pacific Northwest – End-Use Load and Consumer Assessment Program (ELCAP)*, DOE/BP-13795-21. Richland, WA: Pacific Northwest National Laboratory.
- Residential Energy Services Network (RESNET). 2002. *Mortgage Industry National Home Energy Rating Systems Accreditation Standards*. Chapter 3, pp. 29-54. San Diego, CA: Residential Energy Services Network.
- Szydlowski, R., and Cleary, P. 1988. "In-Situ Appliance Efficiency Audit Procedures." ASHRAE Transactions, v.94, pt.1, p.1107-1023.
- Wassmer, M. 2003. *A Component-Based Model for Residential Air Conditioner and Heat Pump Energy Calculations*. Masters Thesis, University of Colorado at Boulder.
- Wenzel, T., Kooney, J., Rosenquist, G., Sanchez, M., and Hanford, J. 1997. *Energy Data Sourcebook for the U.S. Residential Sector*. LBL-40297. Berkeley, CA: Lawrence Berkeley National Laboratory.

REPORT DOCUMENTATION PAGE

Form Approved
OMB No. 0704-0188

The public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing the burden, to Department of Defense, Executive Services and Communications Directorate (0704-0188). Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to any penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number.

PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ORGANIZATION.

1. REPORT DATE (DD-MM-YYYY) May 2006		2. REPORT TYPE Technical Report		3. DATES COVERED (From - To)		
4. TITLE AND SUBTITLE Building America Performance Analysis Procedures for Existing Homes			5a. CONTRACT NUMBER DE-AC36-99-GO10337			
			5b. GRANT NUMBER			
			5c. PROGRAM ELEMENT NUMBER			
6. AUTHOR(S) R. Hendron			5d. PROJECT NUMBER NREL/TP-550-38238			
			5e. TASK NUMBER BET6.8004			
			5f. WORK UNIT NUMBER			
7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) National Renewable Energy Laboratory 1617 Cole Blvd. Golden, CO 80401-3393				8. PERFORMING ORGANIZATION REPORT NUMBER NREL/TP-550-38238		
9. SPONSORING/MONITORING AGENCY NAME(S) AND ADDRESS(ES)				10. SPONSOR/MONITOR'S ACRONYM(S) NREL		
				11. SPONSORING/MONITORING AGENCY REPORT NUMBER		
12. DISTRIBUTION AVAILABILITY STATEMENT National Technical Information Service U.S. Department of Commerce 5285 Port Royal Road Springfield, VA 22161						
13. SUPPLEMENTARY NOTES						
14. ABSTRACT (Maximum 200 Words) With more than 101 million residential households in the United States today, existing residential buildings represent a large potential energy savings. Thousands of these homes are renovated each year, Building America is investigating the ways to make existing homes more energy-efficient, based on lessons learned from research in new homes. The Building America program is aiming for a 20%–30% reduction in energy use in existing homes by 2020. The strategy is to establish technology pathways that reduce energy consumption cost-effectively. The existing buildings project focuses on finding ways to adapt the results from the new homes research to retrofit applications in existing homes. Research activities include a combination of computer modeling, field demonstrations, and long-term monitoring to support the development of integrated approaches to reduce energy use. Analytical tools are being developed to guide designers and builders in selecting the best approaches. DOE partners with the EPA to increase energy efficiency in existing homes through the Home Performance with ENERGY STAR® program.						
15. SUBJECT TERMS Building America; existing homes; performance analysis procedures; residential buildings; energy efficiency						
16. SECURITY CLASSIFICATION OF:			17. LIMITATION OF ABSTRACT UL	18. NUMBER OF PAGES	19a. NAME OF RESPONSIBLE PERSON	
a. REPORT Unclassified	b. ABSTRACT Unclassified	c. THIS PAGE Unclassified			19b. TELEPHONE NUMBER (Include area code)	

A Strong Energy Portfolio for a Strong America

Energy efficiency and clean, renewable energy will mean a stronger economy, a cleaner environment, and greater energy independence for America. Working with a wide array of state, community, industry, and university partners, the U.S. Department of Energy's Office of Energy Efficiency and Renewable Energy invests in a diverse portfolio of energy technologies.

Research and Development of Buildings

Our nation's buildings consume more energy than any other sector of the U.S. economy, including transportation and industry. Fortunately, the opportunities to reduce building energy use—and the associated environmental impacts—are significant.

DOE's Building Technologies Program works to improve the energy efficiency of our nation's buildings through innovative new technologies and better building practices. The program focuses on two key areas:

• Emerging Technologies

Research and development of the next generation of energy-efficient components, materials, and equipment

• Technology Integration

Integration of new technologies with innovative building methods to optimize building performance and savings

For more information contact:

EERE Information Center
1-877-EERE-INF (1-877-337-3463)
www.eere.energy.gov



U.S. Department of Energy
**Energy Efficiency
and Renewable Energy**

An electronic copy of this publication is available on the Building America Web site at www.buildingamerica.gov

Visit our Web sites at:

www.buildingamerica.gov

www.pathnet.org

www.energystar.gov



Building America Program

George S. James • New Construction • 202-586-9472 • fax: 202-586-8134 • e-mail: George.James@ee.doe.gov
Terry Logee • Existing Homes • 202-586-1689 • fax: 202-586-4617 • e-mail: terry.logee@ee.doe.gov
Lew Pratsch • Integrated Onsite Power • 202-586-1512 • fax: 202-586-8185 • e-mail: Lew.Pratsch@hq.doe.gov
Building America Program • Office of Building Technologies, EE-2J • U.S. Department of Energy • 1000 Independence Avenue, S.W. • Washington, D.C. 20585-0121 • www.buildingamerica.gov

Building Industry Research Alliance (BIRA)

Robert Hammon • ConSol • 7407 Tam O'Shanter Drive #200 • Stockton, CA 95210-3370 • 209-473-5000 • fax: 209-474-0817 • e-mail: Rob@consol.ws • www.bira.ws

Building Science Consortium (BSC)

Betsy Pettit • Building Science Consortium (BSC) • 70 Main Street • Westford, MA 01886 • 978-589-5100 • fax: 978-589-5103 • e-mail: Betsy@building-science.com • www.buildingscience.com

Consortium for Advanced Residential Buildings (CARB)

Steven Winter • Steven Winter Associates, Inc. • 50 Washington Street • Norwalk, CT 06854 • 203-857-0200 • fax: 203-852-0741 • e-mail: swinter@swinter.com • www.carb-swa.com

Davis Energy Group

David Springer • Davis Energy Group • 123 C Street • Davis, CA 95616 • 530-753-1100 • fax: 530-753-4125 • e-mail: springer@davisenergy.com • deg@davisenergy.com • www.davisenergy.com/index.html

IBACOS Consortium

Brad Oberg • IBACOS Consortium • 2214 Liberty Avenue • Pittsburgh, PA 15222 • 412-765-3664 • fax: 412-765-3738 • e-mail: boberg@ibacos.com • www.ibacos.com

Industrialized Housing Partnership (IHP)

Subrato Chandra • Florida Solar Energy Center • 1679 Clearlake Road • Cocoa, FL 32922 • 321-638-1412 • fax: 321-638-1439 • e-mail: subrato@fsec.ucf.edu • www.baihp.org

National Association of Home Builders (NAHB) Research Center

Tom Kenney • National Association of Home Builders (NAHB) Research Center • 400 Prince George's Boulevard • Upper Marlboro, MD 20774 • 301-430-6246 • fax: 301-430-6180 • toll-free: 800-638-8556 • www.nahbrc.org/

National Renewable Energy Laboratory

Ren Anderson • 1617 Cole Boulevard, MS-2722 • Golden, CO 80401 • 303-384-7433 • fax: 303-384-7540 • e-mail: ren_anderson@nrel.gov • www.nrel.gov

Tim Merrigan • 1617 Cole Boulevard, MS-2722 • Golden, CO 80401 • 303-384-7349 • fax: 303-384-7540 • e-mail: tim_merrigan@nrel.gov • www.nrel.gov

Oak Ridge National Laboratory

Pat M. Love • P.O. Box 2008 • One Bethel Valley Road • Oak Ridge, TN 37831 • 865-574-4346 • fax: 865-574-9331 • e-mail: lovepm@ornl.gov • www.ornl.gov

Produced for the U.S. Department of Energy (DOE) by the National Renewable Energy Laboratory, a DOE national laboratory.

May 2006 • NREL/TP-550-38238

Printed with a renewable-source ink on paper containing at least 50% wastepaper, including 10% postconsumer waste.

Bringing you a prosperous future where energy is clean, abundant, reliable, and affordable