


# Exploratory Reliability and Performance R&D

C.R. Osterwald

*Presented at the 2005 DOE Solar Energy Technologies  
Program Review Meeting  
November 7–10, 2005  
Denver, Colorado*

**Conference Paper**  
**NREL/CP-520-38933**  
**November 2005**

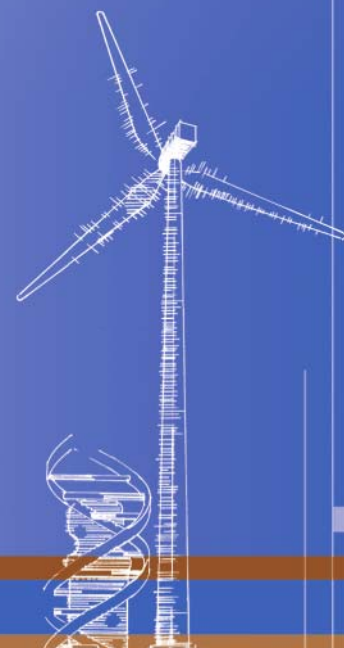

NREL is operated by Midwest Research Institute • Battelle Contract No. DE-AC36-99-GO10337



## NOTICE

The submitted manuscript has been offered by an employee of the Midwest Research Institute (MRI), a contractor of the US Government under Contract No. DE-AC36-99GO10337. Accordingly, the US Government and MRI retain a nonexclusive royalty-free license to publish or reproduce the published form of this contribution, or allow others to do so, for US Government purposes.

This report was prepared as an account of work sponsored by an agency of the United States government. Neither the United States government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States government or any agency thereof.

Available electronically at <http://www.osti.gov/bridge>

Available for a processing fee to U.S. Department of Energy and its contractors, in paper, from:

U.S. Department of Energy  
Office of Scientific and Technical Information  
P.O. Box 62  
Oak Ridge, TN 37831-0062  
phone: 865.576.8401  
fax: 865.576.5728  
email: <mailto:reports@adonis.osti.gov>

Available for sale to the public, in paper, from:

U.S. Department of Commerce  
National Technical Information Service  
5285 Port Royal Road  
Springfield, VA 22161  
phone: 800.553.6847  
fax: 703.605.6900  
email: [orders@ntis.fedworld.gov](mailto:orders@ntis.fedworld.gov)  
online ordering: <http://www.ntis.gov/ordering.htm>



# Exploratory Reliability and Performance R&D

C.R. Osterwald

National Renewable Energy Laboratory, Golden, Colorado, [carl\\_osterwald@nrel.gov](mailto:carl_osterwald@nrel.gov)

## ABSTRACT

This paper presents a brief overview of the status and accomplishments during fiscal year (FY) 2005 of the Photovoltaic (PV) Exploratory Reliability and Performance R&D Subtask, which is part of the PV Module Reliability R&D Project (a joint NREL-Sandia project).

### 1. Objectives

The objectives of this project, as stated in the FY 2005 Solar Program Annual Operating Plan (AOP), are to provide "...the accelerated indoor, accelerated outdoor, and a portion (outdoor testing at NREL) of the long-term outdoor testing elements of the project. Corresponding analyses, modeling, and characterization of performance and degradation rates, along with general reliability, are performed in collaboration with SNL [Sandia National Laboratories] and the industry partners."

### 2. Technical Approach

Long-term testing of PV modules on an ongoing basis, both indoors and outdoors, is the most important technical approach used for determination of reliability and performance. An important adjunct to long-term testing is indoor environmental stress testing, which is used to uncover susceptibility to known failure mechanisms.

### 2. Results and Accomplishments

#### 3.1 Accelerated Indoor Stress Testing

Thermal cycling was performed on a prototype copper indium gallium diselenide (CIGS) thin-film roofing shingle product for Solar Roofing Systems (SRS). SRS is a small U.S. manufacturer engaged in product development, so this provided testing they otherwise might not have been able to obtain. Results of this testing were communicated directly to the manufacturer.

We initiated a cooperative testing program on SunPower's high-efficiency crystalline-Si modules, including light soaking, thermal cycling, and damp heat exposure indoors, and real-time outdoor exposure. At this time, the program is geared toward helping SunPower improve the fabrication of their solar cells. Results of this testing are communicated directly to the manufacturer.

Indoor stress testing of SBM Solar's prototype crystalline-Si modules that feature a polymer superstrate instead of glass was performed in FY

2005. The testing included damp heat, thermal cycling, UV exposure, humidity-freeze, and the standard module surface cut test. This test program is helping SBM Solar advance their module design toward full qualification and eventually production, and the results are communicated directly to the manufacturer.

In cooperation with the other two subprojects of the Module Reliability R&D NREL/SNL joint project, a major U.S. thin-film manufacturer was assisted with diagnosing a serious degradation problem that developed suddenly in this manufacturer's product line. The cause of the degradation was determined, and recommendations were provided for elimination of the problem.

#### 3.2 Thin-Film Module Hot & Humid Support

This task directly supports the Thin-Film PV Partnership through ongoing efforts. All data and reports received from the two hot & humid exposure subcontractors (Florida Solar Energy Center and Texas A&M University) are archived, and data are analyzed for indications of performance changes in the exposed modules. This project is also responsible for advising the subcontractors concerning the details of their experimental setups. Site visits by task personnel provided data acquisition system calibrations and advice on improvements to their array exposure designs.

A journal article was written that documents the implications of using fixed resistive loads for long-term PV module exposure testing.<sup>1</sup> This study showed that identical degradation rates can be observed with resistive loads compared with maximum-power tracking loads, provided the resistance values are chosen correctly, and helped fulfill an FY 2005 milestone.

#### 3.3 High Voltage Stress Testing

A novel high voltage array experiment commenced operation in the High Voltage Stress Testbed (HVST) of the Outdoor Test Facility (OTF).<sup>2</sup> The array consists of both positive and negative strings of Shell Solar Inc. CIGS ST-40 modules, featuring a maximum voltage for each string of  $\pm 300$  volts DC. Such high-voltage applications are envisioned as necessary for future scale-up for utility-scale electric power generation.

#### 3.4 Long-Term Si Cell Degradation

The controlled light soaking experiment designed to determine the cause of the slow degradation of short-circuit current previously observed in crystalline-Si modules that was initiated in FY 2003 continues. At

the time of this writing, a total UV dose of about 3,600 MJ/m<sup>2</sup> has been accumulated, and the goal of this testing is to accumulate at least 5,000 MJ/m<sup>2</sup> (about 18 years equivalent exposure). Preliminary results were presented at the 31st IEEE PV Specialists Conference in January 2005.<sup>3</sup>

### 3.5 Ref. Meteorological and Irradiance System (RMIS)

Work continued during FY 2005 toward development of an in-situ calibration procedure for pyranometers at latitude tilt. This calibration procedure, which will utilize a new tilted diffuse radiation measurement installed in the RMIS, will allow pyranometers used with the grid-tied PV systems in the OTF array field to be calibrated in place.

### 3.6 Outdoor Accelerated Solar Weathering

A solar weathering experiment that includes crystalline-Si, CdTe, and Cu-In-Ga-S-Se modules installed in the Outdoor Accelerated-weathering Test System continued during FY 2005 (Fig. 1). In December 2004 the last four old mirrors in this two-axis concentrator system were replaced.

### 3.7 Performance and Energy Ratings Testbed (PERT)

All available historical data generated by the PERT dating back to 1994 have been transferred from magneto-optical discs to the Engineering & Technology Validation Team file server. It is anticipated that the new central location of these data will allow determination of individual module degradation rates in FY 2006, and that these results can be published in the open literature.

An internal National Center for Photovoltaics module test report on CIGS module stability was generated and communicated to the module manufacturers. Analysis of 7.5 and 2.5 years of real-time outdoor performance data formed the basis of this report, which concluded that performance degradation rates on two CIGS modules are less than 2% per year.<sup>4</sup>

## 4. Conclusions

Long-term module testing has been performed at the OTF for more than 15 years, and during FY 2005 this testing has continued and has been expanded and enhanced. All milestones that were identified in the AOP have been achieved.

## ACKNOWLEDGEMENTS

The bulk of the work on this subtask was performed by members of the Engineering and Technology Validation Team: Jill Adelstein, Joe del Cueto, Bob Hansen, Bill Marion, Peter McNutt, Jim Pruet, Bill Sekulic, and Dave Trudell. Members of the PV Measurements and Characterization Group generate many I-V curves that are an integral part of this work: Steve Rummel, Allan Anderberg, and Larry Ottoson. This work was supported by the U.S. Department of Energy under contract DE-AC36-99GO10337.

## REFERENCES

- <sup>1</sup>C.R. Osterwald, J. Adelstein, J.A. del Cueto, W. Sekulic, D. Trudell, P. McNutt, R. Hansen, S. Rummel, A. Anderberg, and T. Moriarty, "Resistive Loading of Photovoltaic Modules and Arrays for Long-Term Exposure Testing," accepted for publication in *Prog. Photovolt: Res. Appl.*, Oct. 2005.
- <sup>2</sup>J. del Cueto, "Capabilities of the High Voltage Stress Test System at the Outdoor Test Facility," *Proc. of the DOE Solar Energy Tech. Prog. Review Meeting*, Denver, CO, Nov. 7-10, 2005.
- <sup>3</sup>C.R. Osterwald, J. Pruet, and T. Moriarty, "Crystalline Silicon Short-Circuit Current Degradation Study: Initial Results," *Proc. 31st IEEE PV Spec. Conf.*, Jan. 3-7, 2005, 1335-1338.
- <sup>4</sup>J. del Cueto, "Stability of Two CIGS Modules from Outdoor Measurements," Internal National Center for Photovoltaics Module Test Report MTR05CIGSAB.001, March 2, 2005.

## MAJOR FY 2005 PUBLICATIONS

- B. Marion, S. Rummel, and A. Anderberg, "Current-Voltage Curve Translation by Bilinear Interpolation," *Prog. Photovolt: Res. Appl.* 2004; 12:593-607.
- J.A. del Cueto and B. von Roedern, "Long-Term Transient and Metastable Effects in Cadmium Telluride Photovoltaic Modules," submitted to *Prog. Photovolt: Res. Appl.*, July 2005.
- Ricardo R ther, G. Tamizh-Mani, J. del Cueto, J. Adelstein, M.M. Dacoregio, and B. von Roedern, "Performance Test Of Amorphous Silicon Modules In Different Climates — Year Three: Higher Minimum Operating Temperatures Lead To Higher Performance Levels," *Proc. 31st IEEE PV Spec. Conf.*, Jan. 3-7, 2005, 1635-1638.



Fig. 1. The Outdoor Accelerated-weathering Test System at the NREL Outdoor Test Facility.

# REPORT DOCUMENTATION PAGE

Form Approved  
OMB No. 0704-0188

The public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing the burden, to Department of Defense, Executive Services and Communications Directorate (0704-0188). Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to any penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number.

**PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ORGANIZATION.**

1. REPORT DATE (DD-MM-YYYY) November 2005		2. REPORT TYPE Conference Paper		3. DATES COVERED (From - To)	
4. TITLE AND SUBTITLE Exploratory Reliability and Performance R&D				5a. CONTRACT NUMBER DE-AC36-99-GO10337	
				5b. GRANT NUMBER	
				5c. PROGRAM ELEMENT NUMBER	
6. AUTHOR(S) C.R. Osterwald				5d. PROJECT NUMBER NREL/CP-520-38933	
				5e. TASK NUMBER PVB6.7101	
				5f. WORK UNIT NUMBER	
7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) National Renewable Energy Laboratory 1617 Cole Blvd. Golden, CO 80401-3393				8. PERFORMING ORGANIZATION REPORT NUMBER NREL/CP-520-38933	
9. SPONSORING/MONITORING AGENCY NAME(S) AND ADDRESS(ES)				10. SPONSOR/MONITOR'S ACRONYM(S) NREL	
				11. SPONSORING/MONITORING AGENCY REPORT NUMBER	
12. DISTRIBUTION AVAILABILITY STATEMENT National Technical Information Service U.S. Department of Commerce 5285 Port Royal Road Springfield, VA 22161					
13. SUPPLEMENTARY NOTES					
14. ABSTRACT (Maximum 200 Words) This paper presents a brief overview of the status and accomplishments during fiscal year (FY) 2005 of the Photovoltaic (PV) Exploratory Reliability and Performance R&D Subtask, which is part of the PV Module Reliability R&D Project (a joint NREL-Sandia project).					
15. SUBJECT TERMS Photovoltaics; solar; module reliability; PV; NREL					
16. SECURITY CLASSIFICATION OF:			17. LIMITATION OF ABSTRACT UL	18. NUMBER OF PAGES	19a. NAME OF RESPONSIBLE PERSON
a. REPORT Unclassified	b. ABSTRACT Unclassified	c. THIS PAGE Unclassified			19b. TELEPHONE NUMBER (Include area code)