

DOE FG02-05CH11294
Ionic Liquids for Utilization of Waste Heat from Distributed Power Generation Systems

Final Report
8/1/05-7/31/08

Joan F. Brennecke, Mihir Sen, Edward J. Maginn, Samuel Paolucci and Mark A. Stadtherr
Department of Chemical and Biomolecular Engineering
Department of Aerospace and Mechanical Engineering
University of Notre Dame

Peter T. Dissler and Mike Zdyb
NiSource Energy Technologies

Objectives

The objective of this research project was the development of *ionic liquids* to capture and utilize waste heat from distributed power generation systems. Ionic Liquids (ILs) are organic salts that are liquid at room temperature and they have the potential to make fundamental and far-reaching changes in the way we use energy. In particular, the focus of this project was fundamental research on the potential use of IL/CO₂ mixtures in absorption-refrigeration systems. Such systems can provide cooling by utilizing waste heat from various sources, including distributed power generation. The basic objectives of the research were to design and synthesize ILs appropriate for the task, to measure and model thermophysical properties and phase behavior of ILs and IL/CO₂ mixtures, and to model the performance of IL/CO₂ absorption-refrigeration systems.

Accomplishments

All of the milestones for this project have been achieved. This includes those for Year 1 (8/1/05-7/31/06) and Year 2 (8/1/06-7/31/07) of the project. Note that the project was given a one-year no-cost extension so the completion date was 7/31/08. The emphasis of Year 1 is the IL/CO₂ systems and the emphasis of Year 2 is the IL/water systems.

Task 1 Milestones

- We selected, synthesized, purified and analyzed four ionic liquids for this project.
- 1-hexyl-3-methylimidazolium bis(trifluoromethyl)sulfonylimide ([hmim][Tf₂N]) is immiscible with water but has a high CO₂ solubility. Therefore, it was considered for the IL/CO₂ absorption refrigeration system.
- 1-ethyl-3-methylimidazolium ethylsulfate ([emim][EtSO₄]), 1-ethyl-3-methylimidazolium triflate ([emim][TfO]), and 1-ethyl-3-methylimidazolium trifluoroacetate ([emim][TFA]) are totally miscible with water and were investigated for IL/water absorption refrigeration systems.

Task 2 Milestones

- We measured pure component properties for all of the ILs investigated. This included pure component densities, melting points, glass transition temperatures, heat capacities, thermal decomposition temperatures, viscosities and thermal conductivities. The corrosivity of the ILs (with and without water and CO₂) were measured by an outside laboratory.
- Molecular simulation was used to predict some of the properties. A new method for prediction melting points from molecular simulation was developed.
- The results from these measurements and simulations can be found in many of the progress reports and in the publications that resulted from this project. All of the pure component properties were reasonable. The corrosivity was acceptably low, except with copper.
- The molecular simulations gave good values for many of the pure component properties, agreeing well with the experimental results.

Task 3 Milestones

- Measurements were made of mixture properties (IL + water and IL + CO₂), including heats of mixing, densities, and viscosities.
- Diffusivities were measured by PGNMR for the IL + water systems by an outside laboratory.
- We determined that molecular simulations of the IL + water systems were generally not sufficiently quantitative so experimental measurements were the primary results used for those systems.
- Although not in the original proposal, we also measured the vapor-liquid equilibrium of the IL + water systems. This was necessary to determine the liquid phase nonideality (i.e., activity coefficient) which, in turn, was needed to calculate the enthalpies and coefficients of performance for the IL + water absorption refrigeration systems.

Task 4 Milestones

- We developed simple correlations for all of the thermodynamic data.
- We found that the NRTL equation provided an adequate representation of the IL + water liquid phase nonideality.
- Conventional equation of state models were not able to adequately represent all of the necessary thermodynamic data.
- Reliable computational techniques were developed for parameter estimation.
- Using a combination of experiments data, simulation data, correlations and models, we assembled tables of all the thermodynamics necessary to analyze the absorption refrigeration systems.

Task 5 Milestones

- We developed a mathematical model of the conventional lithium bromide/water and ammonia/water absorption refrigeration systems.
- We developed equivalent mathematical models for both steady state and transient operation of the IL + water and IL + CO₂ absorption refrigeration systems.

Task 6 Milestones

- Using all the thermodynamic information collected, simulated, modeled and tabulated, we calculated the ideal coefficient of performance (COP) of an absorption refrigeration cycle for three different ionic liquid/H₂O pairs over a variety of operating temperatures and compared to the ideal COP of a traditional LiBr/H₂O absorption refrigeration cycle. As can be seen in Figure 1 and 2, there are two important observations that can be made.

(a) Firstly, all three ionic liquid/H₂O pairs produce a **more efficient absorption refrigeration cycle** than LiBr/H₂O.

(b) Secondly, it is also of note that the COPs for the IL/H₂O pairs do not decrease as quickly with increasing generator temperature compared to that of LiBr/H₂O. This flatter curve allows for much higher COP than the LiBr system as the generator temperature is increased. This allows for a much more efficient cycle for higher waste heat temperatures.

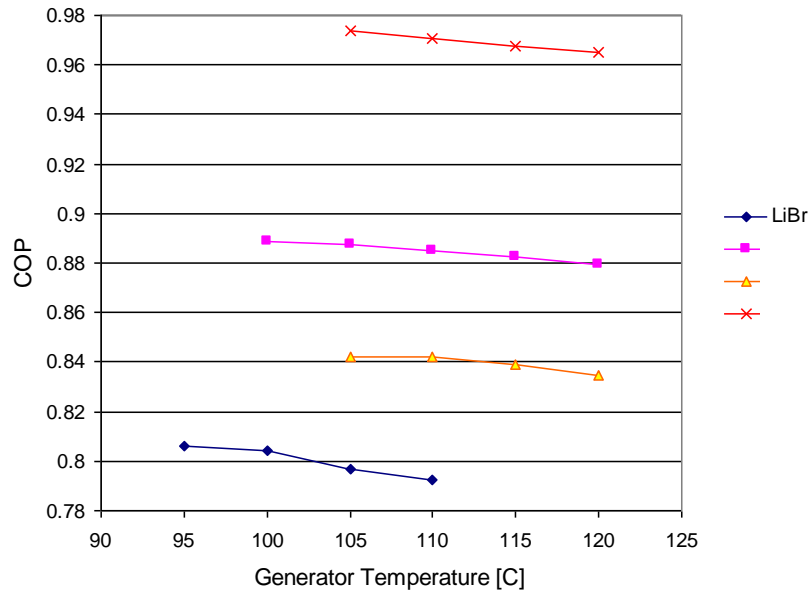


Figure 1 Coefficient of Performance of a heat-operated absorption refrigeration cycle for various generator temperatures, with evaporation, condensation, and absorption occurring at $T_e = 5\text{ }^\circ\text{C}$, $T_c = 50\text{ }^\circ\text{C}$, and $T_a = 40\text{ }^\circ\text{C}$, respectively. The three different ionic liquids are compared with LiBr/water and all function as the absorbent while H₂O is used as the refrigerant.

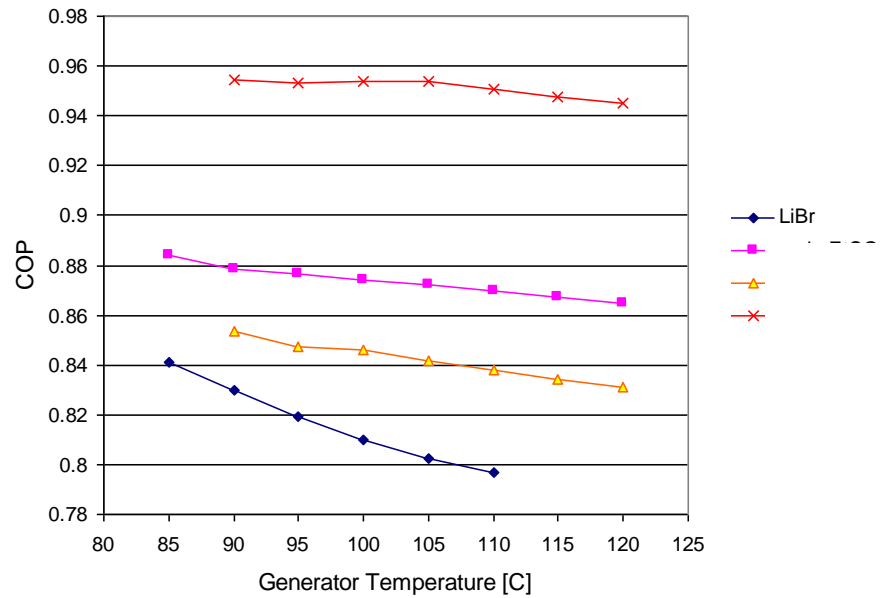


Figure 2 Coefficient of Performance of a heat-operated absorption refrigeration cycle for various generator temperatures, with evaporation, condensation, and absorption occurring at $T_e = 5\text{ }^\circ\text{C}$, $T_c = 50\text{ }^\circ\text{C}$, and $T_a = 30\text{ }^\circ\text{C}$, respectively. The three different ionic liquids are compared with LiBr/water and all function as the absorbent while H_2O is used as the refrigerant.

- Using all the thermodynamic information collected, simulated, modeled and tabulated, we calculated the ideal COP of an absorption refrigeration cycle for the ionic liquid – CO_2 system. For the calculations, appropriate condenser, evaporator, and absorber temperatures were chosen and the generator temperature was varied to demonstrate its effect on the system's COP.

For specific operating conditions, the evaporator was maintained at $T_e = 270\text{ K}$ to allow for sub-zero chilling, a condition not possible using the typical LiBr/ H_2O or IL/ H_2O systems. The absorber was maintained at $T_a = 300\text{ K}$, the lowest temperature at which the IL/ CO_2 mixture data was available. Together, the absorber and evaporator form the low-pressure side of the absorption refrigeration system and, for these operating temperatures, operate at a pressure of $\sim 32\text{ bar}$ (determined by the evaporator temperature).

The high pressure side consists of the generator and condenser and the pressure is dictated by the condenser temperature. In this simulation, a condenser temperature of $T_c = 282\text{ K}$ was chosen to allow for sub-critical operation (using pure CO_2 as the refrigerant) as well as to maintain a reasonable operating pressure of $\sim 44\text{ bar}$. The COP results are shown below in Figure 3.

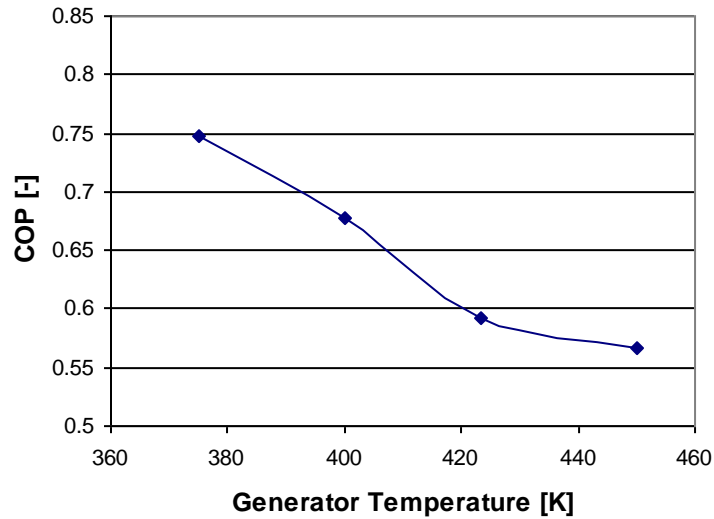


Figure 3: COP for an IL/CO₂ absorption refrigeration loop, with $T_a = 300$ K, $T_c = 282$ K, and $T_e = 270$ K.

The COP data behaves as is expected with performance decreasing with increasing generator temperature. Performance is lower than that of a traditional LiBr/H₂O system or the alternative IL/H₂O system and seems to decrease much more quickly with increasing generator temperature. Additionally, the system operates at fairly high pressures of approximately 32 and 44 bar, for the low and high pressure sides, respectively. However, the benefit of an IL/CO₂ system is its ability to chill to below 273 K using an environmentally friendly absorber/refrigerant pair, a task not possible using the standard LiBr/H₂O and H₂O/NH₃ systems or the alternative IL/H₂O system.

Task 7 milestones

- Since it was clear that we would not receive a third year of funding to build and operate a mini-scale plant, it was determined that design of this unit was not necessary for the project.

Conclusions

In this project we determined that **absorption refrigeration systems using ionic liquid/water have higher theoretical COPs than any commercially available systems**. The ionic liquid/CO₂ system had lower COPs and we do not recommend further development of that system. Numerous publications resulted from this work, as detailed below. Unfortunately, several other groups submitted patent applications prior to our application so we do not own the intellectual property on this invention. Nonetheless, the results of this project are extremely useful to advancing this highly promising technology. We continue to communicate with several companies, including Evoniks and DuPont, who are working to commercialize the technology.

Publications (chronological)

- S. Paolucci and M. Sen, "Use of Ionic Liquids in Absorption Refrigeration," Proceedings of the ASME/ATI Conference on Energy: Production, Distribution and Conservation, pp.701-710, Milan, Italy, May 14-17, 2006.
- M. Sen and S. Paolucci, "Using Carbon Dioxide and Ionic Liquids for Absorption Refrigeration," Proceedings of the 7th IIR Gustav Lorentzen Conference on Natural Working Fluids, pp. 160-163, Trondheim, Norway, May 28-31, 2006.
- M. Sen and S. Paolucci, "The Use of Ionic Liquids in Refrigeration," Proceedings of the 2006 ASME International Mechanical Engineering Congress and Exposition, Paper No. IMECE2006-14712, Chicago, IL, November 5-10, 2006.
- Y. Lin and M. A. Stadtherr, "Validated Solution of Initial Value Problems for ODEs with Interval Parameters," Proceedings 2nd NSF Workshop on Reliable Engineering Computing: Modeling Errors and Uncertainty in Engineering Computations (eds. R. L. Muhanna and R. L. Mullen), Georgia Institute of Technology, pp. 155-168 (2006).
- Y. Lin and M. A. Stadtherr, "Validated Solution of ODEs with Parametric Uncertainties," *Computer-Aided Chemical Engineering*, **21**, 167-172 (2006).
- A. E. Ayala, L. D. Simoni, Y. Lin, J. F. Brennecke and M. A. Stadtherr, "Process Design Using Ionic Liquids: Physical Property Modeling," *Computer-Aided Chemical Engineering*, **21**, 463-468 (2006).
- Y. Lin and M. A. Stadtherr, "Deterministic Global Optimization for Parameter Estimation of Dynamic Systems," *Ind. Eng. Chem. Res.*, **45**, 8438-8448 (2006).
- H. Rodríguez and J. F. Brennecke, "Temperature and Composition Dependence of the Density and Viscosity of Binary Mixtures of Water + Ionic Liquid," *J. Chem. Eng. Data*, **51**(6), 2006, 2145-2155.
- M. Sen, W. Liu and S. Paolucci, "Análisis de Circuitos de Enfriamiento con Líquidos Iónicos," Proceedings of the Eighth Iberoamerican Congress of Mechanical Engineering, Cusco, Peru, Oct. 23-25, 2007.
- W. Liu, M. Sen and S. Paolucci, "Analysis of the Performance of Ionic Liquids in Cooling Loops," Proceedings of the 2007 ASME International Mechanical Engineering Congress and Exposition, Paper No. IMECE2007-42225, Seattle, WA, November 11-15, 2007.
- W. Cai, M. Sen and S. Paolucci, "Dynamic Modeling of an Absorption Refrigeration System Using Ionic Liquids," Proceedings of the 2007 ASME International Mechanical Engineering Congress and Exposition, Paper No. IMECE2007-41335, Seattle, WA, November 11-15, 2007.

- Y. Lin and M. A. Stadtherr, "Validated Solutions of Initial Value Problems for Parametric ODEs," *Appl. Numer. Math.*, **58**, 1145-1162 (2007).
- Y. Lin and M. A. Stadtherr, "Deterministic Global Optimization of Nonlinear Dynamic Systems," *AIChE J.*, **53**, 866-875 (2007).
- M. A. Stadtherr, G. Xu, G. I. Burgos-Solórzano and W. D. Haynes, "Reliable Computation of Phase Stability and Equilibrium Using Interval Methods," *Int. J. Reliability and Safety*, **1**, 465-488 (2007).
- Y. Lin and M. A. Stadtherr, "Guaranteed State and Parameter Estimation for Nonlinear Continuous-Time Systems with Bounded-Error Measurements," *Ind. Eng. Chem. Res.*, **46**, 7198-7207 (2007).
- Y. Lin and M. A. Stadtherr, "Fault Detection in Continuous-Time Systems with Uncertain Parameters," Proceedings 2007 American Control Conference, IEEE, 3216-3221 (2007).
- Y. Lin and M. A. Stadtherr, "Deterministic Global Optimization for Dynamic Systems Using Interval Analysis," Proceedings 12th GAMM-IMACS International Symposium on Scientific Computing, Computer Arithmetic and Validated Numerics (SCAN 2006) (eds. W. Luther and W. Otten), IEEE, 38 (2007).
- Y. Lin and M. A. Stadtherr, "Reliable Safety Analysis with Continuous-Time Models," *Proc. Appl. Math. Mech.*, **7**, 1022903-1022904 (2007).
- L. D. Simoni, Y. Lin, J. F. Brennecke and M. A. Stadtherr, "Modeling Liquid-Liquid Equilibrium of Ionic Liquid Systems with NRTL, Electrolyte-NRTL, and UNIQUAC," *Ind. Eng. Chem. Res.*, **47**, 256-272 (2008).
- Y. Lin, J. A. Enszer and M. A. Stadtherr, "Enclosing All Solutions of Two-Point Boundary Value Problems for ODEs," *Comput. Chem. Eng.*, **32**, 1714-1725 (2008).
- J. A. Enszer, Y. Lin, S. Ferson, G. F. Corliss and M. A. Stadtherr, "Propagating Uncertainties in Modeling Nonlinear Dynamic Systems," Proceedings 3rd NSF Workshop on Reliable Engineering Computing: Imprecise Probability in Engineering Analysis and Design (eds. R. L. Muhanna and R. L. Mullen), Georgia Institute of Technology, pp. 889-105 (2008).
- Y. Lin and M. A. Stadtherr, "Fault Detection in Nonlinear Continuous-Time Systems with Uncertain Parameters," *AIChE J.*, **54**, 2335-2345 (2008).
- C.-C. Chen, L. D. Simoni, J. F. Brennecke and M. A. Stadtherr, "Correlation and Prediction of Phase Behavior of Organic Compounds in Ionic Liquids Using NRTL-SAC," *Ind. Eng. Chem. Res.*, **47**, 7081-7093 (2008).

- M. S. Kelkar, W. Shi, and E. J. Maginn, "Determining the Accuracy of Classical Force Fields for Ionic Liquids: Atomistic Simulation of the Thermodynamic and Transport Properties of 1-Ethyl-3-methylimidazolium Ethylsulfate ([emim][EtSO₄]) and Its Mixtures with Water," *Ind. Eng. Chem. Res.* 2008, *47*, 9115–9126 9115.
- W. Shi and E. J. Maginn, "Atomistic Simulation of the Absorption of Carbon Dioxide and Water in the Ionic Liquid 1-*n*-Hexyl-3-methylimidazolium Bis(trifluoromethylsulfonyl)imide ([hmim][Tf₂N]," *J. Phys. Chem. B* 2008, *112*, 2045-2055.
- L. E. Ficke, H. Rodriguez and J. F. Brennecke, "Heat Capacities and Excess Enthalpies of 1-Ethyl-3-methylimidazolium Based Ionic Liquids and Water," *J. Chem. Eng. Data*, *53*(9), 2008, 2112-2119.
- A. E. Ayala and M. A. Stadtherr, "Modeling Properties of Ionic Liquid/CO₂ Mixtures: Parameterization of Cubic Equations Of State," submitted for publication (2008).
- Y. Lin and M. A. Stadtherr, "Rigorous Model-Based Safety Analysis for Nonlinear Continuous-Time Systems," *Comput. Chem. Eng.*, accepted for publication, in press (2009).
- W. Shi and E. J. Maginn, "Molecular Simulation of NH₃ Absorption in the Ionic Liquid 1-ethyl-3-methylimidazolium bis(trifluoromethylsulfonyl)imide," submitted for publication to *AIChE J.*, 2008.
- W. Cai, M. Sen and S. Paolucci, "Direct Simulation of an Ammonia-Water Absorption Refrigeration System," manuscript in preparation, 2009.
- J.K.K. Ibrahim, M. Sen and S. Paolucci, "Analysis of Ionic Liquid Performance in Cooling Loops," manuscript in preparation, 2009.