

Purdue University Purdue e-Pubs

International Refrigeration and Air Conditioning
Conference

School of Mechanical Engineering

2014

An Improved Moving Boundary Heat Exchanger Model with Pressure Drop

Hongtao Qiao

University of Maryland, United States of America, htqiao@umd.edu

Vikrant Aute

University of Maryland, United States of America, vikrant@umd.edu

Reinhard Radermacher

University of Maryland, United States of America, raderm@umd.edu

Follow this and additional works at: <http://docs.lib.purdue.edu/iracc>

Qiao, Hongtao; Aute, Vikrant; and Radermacher, Reinhard, "An Improved Moving Boundary Heat Exchanger Model with Pressure Drop" (2014). *International Refrigeration and Air Conditioning Conference*. Paper 1414.
<http://docs.lib.purdue.edu/iracc/1414>

This document has been made available through Purdue e-Pubs, a service of the Purdue University Libraries. Please contact epubs@purdue.edu for additional information.

Complete proceedings may be acquired in print and on CD-ROM directly from the Ray W. Herrick Laboratories at <https://engineering.purdue.edu/Herrick/Events/orderlit.html>

An Improved Moving Boundary Heat Exchanger Model with Pressure Drop

Hongtao QIAO^{1*}, Vikrant AUTE², Reinhard RADERMACHER³

Center for Environmental Energy Engineering
 Department of Mechanical Engineering, University of Maryland
 College Park, MD 20742 USA
^{1,2}Tel: 301-405-8726, ³Tel: 301-405-5286
 Email: ¹htqiao@umd.edu, ²vikrant@umd.edu, ³raderm@umd.edu

*Corresponding Author

ABSTRACT

A literature review indicates that almost all moving boundary heat exchanger models used in dynamic simulations of heat pumps rely on the common hypothesis that the refrigerant pressure drop is negligible. In fact, it is important to include the momentum balance in some applications, such as electronics cooling where microchannels are commonly used and significant pressure drop is observed and large-scale heat exchangers in solar thermal plants where tube length can be longer than several hundred meters. In addition, a comprehensive and robust switching approach is needed to handle transitions between different model states due to phase change. It is found that the current switching methods in the literature exhibit several shortcomings which may cause serious errors and stability issues when simulating cycling transients of vapor compression systems. The objective of this paper is to propose an improved moving boundary formulation that aims to fill in the above research gaps. Specifically, two different approaches are presented to account for the refrigerant pressure drop across the heat exchanger. A novel and comprehensive switching scheme is introduced to ensure smooth transition between different model representations under large disturbances. The proposed model is validated using measured data. The validation shows that the proposed heat exchanger model along with other supporting component models can reasonably capture the start-up transients of a flash tank vapor injection heat pump system.

1. INTRODUCTION

Transient simulation is a key step in the design and optimization of vapor compression cycles for first cost, operating costs and energy consumption. Heat exchangers are a major component in vapor compression systems and have a significant impact on the cycle transients. Transient heat exchanger models generally fall into one of two categories: namely phase-dependent moving boundary models and phase-independent distributed models. Moving boundary models are characterized by dividing the heat exchanger into control volumes, each of which exactly encompasses a particular fluid phase (superheated vapor, two-phase flow or subcooled liquid). The control volumes are separated by a moving interface where the refrigerant phase transition occurs between the single-phase regime and the two-phase regime. In contrast to the distributed models, the number of control volumes in moving boundary models may vary depending on phases currently present within the heat exchanger. The objective of these models is to capture the thermodynamic behavior inside these control volumes and the time-varying positions of phase boundaries.

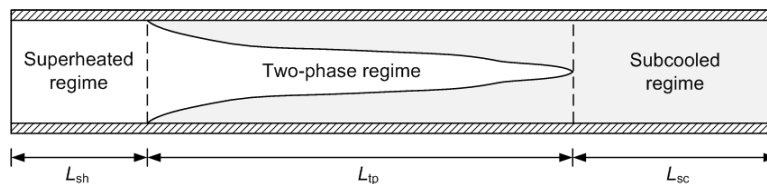


Figure 1: Moving boundary heat exchanger model

In moving boundary models, as shown in Figure 1, each control volume is analyzed with the lumped parameter approach. To integrate the conservation equations over the control volume, it is necessary to make reasonable assumptions about the distribution of mass and energy inside the volume. A common practice is to assume a linear

profile for the enthalpy along the length of each control volume so that the overall mass and energy storage inside control volume can be readily evaluated. Hence, mean enthalpy for the single-phase control volume can be computed as the arithmetic average of the instantaneous enthalpy that enters and leaves the control volume. However, a more sophisticated approach is needed to handle the case where the control volume is occupied by two-phase refrigerant. The two-phase mean void fraction model, originated by Wedekind and Stoecker (1968) to study the transient response of the mixture-vapor transition point in horizontal evaporating flow, can be applied to calculate the overall mass and energy of the two-phase flow. This concept, which has been demonstrated to successfully predict a variety of transient two-phase flow phenomena (Wedekine *et al.*, 1978; Beck and Wedekine, 1981), greatly facilitates the development of various moving boundary models by possibly simulating the two-phase region in lumped fashion. However, a key simplification in these studies is that the time-varying effect of mean void fraction has been neglected because its change tends to be small during transients, and also because its time dependence is related to dynamic modes that are faster than the dominant system dynamics (Rasmussen, 2006). It turns out that this simplification may result in numerical discontinuities when single-phase zones appear or disappear (Zhang and Zhang, 2006). Therefore, some recent publications discard this simplification and include the time derivatives of mean void fraction in the model formulations (Zhang and Zhang, 2006; Eldredge *et al.*, 2008; Li and Alleyne, 2010).

One of the distinctions between different moving boundary models lies in the assumption of the wall temperature at the boundary between neighboring regions. Unlike the assumption of a continuous distribution for the enthalpy along the heat exchanger, the corresponding tube wall temperature associated with each region is spatially independent and uniform within the region. Therefore, the wall temperature is discontinuous at the boundaries, which causes stability issues during simulation. Some commonly adopted methods to calculate the wall temperature at the boundaries can be summarized as follows: 1) the wall temperature at the boundary equals the wall temperature in the two-phase region (Rasmussen and Alleyne, 2004); 2) take the average of the temperatures of adjacent walls (Jensen, 2003); 3) the wall temperature at the boundary is chosen based on the boundary velocity (McKinley and Alleyne, 2008); and 4) a weighted mean temperature based on the length ratio of the neighboring regions (Zhang and Zhang, 2006). Of these four different formulations, the last two are more commonly used because they capture the underlying physics very well.

Another key to simplifying moving boundary models is the assumption of the uniform pressure distribution throughout the heat exchanger given the fact that the pressure loss results in minor influences on the system performance compared to heat transfer. Although it causes deviations from real systems, this simplification is universally applied because the equation of momentum is not required in the analysis and thus modeling complexity can be substantially reduced. A couple of exceptions are found in Tian and Li (2005), Tian *et al.* (2005) and Yebra *et al.* (2005). In Tian's work, static pressure loss is assumed to concentrate at the end of each region. However, this approach only works fine when there is no creation or destruction of fluid phases, otherwise, a mathematical discontinuity in pressure will be experienced. While following the staggered grid scheme and finite volume method, Yebra *et al.* (2005) presented a general moving boundary model containing the momentum conservation. But their work can be further enhanced with four control volume analysis.

There are a variety of model reduction techniques to further simply the moving boundary paradigm. Common practices include neglecting the dynamics in the superheated region and lumping the wall and fluid temperature to set them equal to each other (Jensen, 2003). These model reduction techniques are often applied for different applications.

As stated previously, the number of available fluid phases in heat exchangers may vary under large disturbances. Fluid phases can form or disappear. For instance, the condenser may experience transitions twice during the start-up operation, vapor \rightarrow vapor & two-phase \rightarrow vapor, two-phase & liquid. Early models often have a fixed number of zones and hence they are suitable for modeling large transients. Recent research efforts for this type of models are focused on providing switching schemes to ensure smooth transition between different model representations when fluid phases appear or disappear (Li and Alleyne, 2010). However, these type of models are inherently not as robust as distributed models (Bendapudi *et al.*, 2008) because of the resulting potential numerical failures associated with model transition, such as chattering and numerical singularities.

A thorough review of literature indicates that the existing moving boundary models (Grald & MacArthur, 1992; He *et al.*, 1996; Willatzen *et al.*, 1998; Pettit *et al.*, 1998; Jensen & Tummescheit, 2002; Leducq *et al.*, 2003;

Rasmussen, 2006; Zhang & Zhang, 2006; Diaz, 2007; Kumar *et al.*, 2008; McKinley & Alleyne, 2008; Bendapudi *et al.*, 2008; Eldredge *et al.*, 2008; Liang *et al.*, 2010; Li & Alleyne, 2010; Cecchinato & Mancini, 2012) have the following limitations:

- (1) Most models do not account for pressure drop. In fact, it is important to include the momentum balance in some applications, such as electronics cooling where microchannels are commonly used and significant pressure drop is observed in micro-scale heat exchangers (Kandlikar *et al.*, 2006), and large-scale heat exchangers in solar thermal plants (the length can be more than several hundred meters) where pressure drop must be considered.
- (2) Models are not able to work under cyclic conditions except the one presented by Li and Alleyne (2010). Moreover, even in Li & Alleyne's work, there is still room for improvement. More details are given in the section for the switching criteria.
- (3) A clear distinction between these models lies in whether the time-varying effect of mean void fraction is taken into account or not. Based on this, these models can be classified into two categories: the category including mean void fraction in the state vector and the category including the outlet enthalpy in the state vector. Both approaches have advantages and disadvantages.

When mean void fraction is a state variable, mass can be well conserved during model switching. However, it needs to solve an implicit transcendental equation to obtain the outlet enthalpy. That is the reason why Thermosys (McKinley & Alleyne, 2008; Li & Alleyne, 2010) uses huge look-up tables correlating mean void fraction, the refrigerant pressure, and the outlet vapor quality before conducting the simulation in order to improve computational efficiency. However, establishing such huge look-up tables is very tedious and time-consuming since they are refrigerant dependent and application specific.

When the outlet enthalpy is a state variable instead, there is no need to solve an implicit transcendental equation. However, the refrigerant mass cannot be conserved during mode switch.

In order to address the above research gaps, this paper aims at presenting an improved moving boundary model that has the following features:

- (1) A comprehensive and robust switching approach handling transitions between different model representations.
- (2) Be capable of accounting for refrigerant pressure drop across the heat exchanger.
- (3) Both mean void fraction and outlet enthalpy are state variables. By doing this, refrigerant mass can be conserved and the need to solve the transcendental equation is eliminated at the same time.

Utilizing the developed model, the start-up transients of a flash tank vapor injection heat pump system are investigated and validated using experimental data. For the sake of brevity, this paper will not present the modeling details of other components in the system. Interested readers are referred to Qiao *et al.* (2012 & 2014).

2. MATHEMATICAL MODELS

In this section, two different approaches (Figure 1) are proposed to account for pressure drop in moving boundary models. The conventional moving boundary models without pressure drop use the inlet mass flow rate, inlet enthalpy and outlet mass flow rate as the boundary conditions. However, in the proposed models, the outlet pressure is used in place of the outlet mass flow rate to maintain model consistency. Readers are referred to Qiao *et al.* (2014) for details.

For brevity, we only show the formulations for the V_TP_L mode of the condenser model in the paper. The formulations of other modes of the condenser and the evaporator can be derived similarly.

Approach #1:

Assume that refrigerant pressure is uniform within the heat exchanger. The pressure drop is concentrated at the outlet of the heat exchanger. In this case, only one additional equation is required to account for the global momentum balance. In this approach, the state vector is defined as $\left[p \ \bar{\gamma} \ h_{r,out} \ L_1 \ L_2 \ T_{w,1} \ T_{w,2} \ T_{w,3} \right]$.

Superheated region

$$A_c L_1 \frac{d\bar{\rho}_1}{dt} + A_c (\bar{\rho}_1 - \rho_g) \frac{dL_1}{dt} = \dot{m}_{r,in} - \dot{m}_{r,12} \quad (1)$$

$$A_c L_1 \left(\bar{\rho}_1 \frac{d\bar{h}_1}{dt} - \frac{dp}{dt} \right) + A_c \rho_g (\bar{h}_1 - h_g) \frac{dL_1}{dt} \quad (2)$$

$$= \dot{m}_{r,in} (h_{r,in} - \bar{h}_1) - \dot{m}_{r,12} (h_g - \bar{h}_1) + q_{r,1} \\ \frac{dT_{w,1}}{dt} = \frac{q_{a,1} - q_{r,1}}{c_{p,w} \rho_w A_{c,w} L_1} + \frac{T_{w,2} - T_{w,1}}{L_2} \frac{dL_1}{dt} \quad (3)$$

Two-phase region

$$A_c (L_2 - L_1) \left[(1 - \bar{\gamma}) \frac{d\rho_f}{dp} + \bar{\gamma} \frac{d\rho_g}{dp} \right] \frac{dp}{dt} + A_c (\rho_g - \rho_f) \bar{\gamma} \frac{dL_2}{dt} \quad (4)$$

$$- A_c (\rho_g - \rho_f) (\bar{\gamma} - 1) \frac{dL_1}{dt} + A_c (\rho_g - \rho_f) (L_2 - L_1) \frac{d\bar{\gamma}}{dt} = \dot{m}_{r,12} - \dot{m}_{r,23}$$

$$A_c (L_2 - L_1) \left[(1 - \bar{\gamma}) \frac{d(\rho_f h_f)}{dp} + \bar{\gamma} \frac{d(\rho_g h_g)}{dp} \right] \frac{dp}{dt} + A_c (\rho_g h_g - \rho_f h_f) \bar{\gamma} \frac{dL_2}{dt}$$

$$- A_c (\rho_g h_g - \rho_f h_f) (\bar{\gamma} - 1) \frac{dL_1}{dt} + A_c (\rho_g h_g - \rho_f h_f) (L_2 - L_1) \frac{d\bar{\gamma}}{dt} \quad (5)$$

$$= \dot{m}_{r,12} h_f - \dot{m}_{r,23} h_g + q_{r,2} \\ \frac{dT_{w,2}}{dt} = \frac{q_{a,2} - q_{r,2}}{c_{p,w} A_{c,w} \rho_w (L_2 - L_1)} + \frac{T_{w,2} - T_{w,1}}{L_2} \frac{dL_1}{dt} + \frac{T_{w,3} - T_{w,2}}{L_t - L_1} \frac{dL_2}{dt} \quad (6)$$

Early models (He *et al.*, 1995; Willatzen *et al.*, 1998; Jensen & Tummescheit, 2002) generally neglect the time-varying effect of mean void fraction $\bar{\gamma}$ and hence the term including $\frac{d\bar{\gamma}}{dt}$ in Equation (4) & (5) is cancelled out.

Later on, McKinley & Alleyne (2008) and Li & Alleyne (2010) found that it is advantageous to include this term for switching purposes by establishing a first-order filter on the difference between $\bar{\gamma}$ and $\bar{\gamma}_{total}$ (the equilibrium value for complete condensation or evaporation). One of the drawbacks of this approach is that $\bar{\gamma}$ is never strictly equal to $\bar{\gamma}_{total}$ and there is an inevitable delay for $\bar{\gamma}$ to catch up with $\bar{\gamma}_{total}$. Moreover, the following transcendental equation needs to be solved for $x_{o,tp}$ (if the outlet state is two-phase) to determine the refrigerant enthalpy leaving the heat exchanger.

$$\bar{\gamma} = \frac{c}{(x_{o,tp} - x_{i,tp})(c-1)^2} \ln \left[\frac{x_{i,tp}(c-1) - c}{x_{o,tp}(c-1) - c} \right] + \frac{1}{c-1} \quad (7)$$

where

$$c = \left(\frac{\rho_g}{\rho_f} \right)^{2/3}$$

Equation (7) is derived by using Zivi void fraction model and assuming a linear refrigerant enthalpy profile in two-phase region.

In the proposed model, Equation (8) is used to calculate $\frac{d\bar{\gamma}}{dt}$. When the outlet state is single-phase, $\left. \frac{\partial x_{o,tp}}{\partial p} \right|_{h_{o,tp}}$ and

$\left. \frac{\partial x_{o,tp}}{\partial h_{o,tp}} \right|_p$ are both zero since $x_{o,tp}$ is either one or zero. When the outlet state is two-phase, $h_{o,tp}$ is actually equal to

$h_{r,out}$ ($h_{r,out}$ is a state variable being calculated by integration). Another advantage of applying Equation (8) is that there is no delay in calculating $\bar{\gamma}$.

$$\begin{aligned} \frac{d\bar{\gamma}}{dt} = & \left(\left. \frac{\partial \bar{\gamma}}{\partial c} \right|_{x_{i,tp}, x_{o,tp}} \frac{dc}{dp} + \left. \frac{\partial \bar{\gamma}}{\partial x_{i,tp}} \right|_{c, x_{o,tp}} \frac{\partial x_{i,tp}}{\partial p} \Big|_{h_{i,tp}} + \left. \frac{\partial \bar{\gamma}}{\partial x_{o,tp}} \right|_{c, x_{i,tp}} \frac{\partial x_{o,tp}}{\partial p} \Big|_{h_{o,tp}} \right) \frac{dp}{dt} \\ & + \left. \frac{\partial \bar{\gamma}}{\partial x_{i,tp}} \right|_{c, x_{o,tp}} \frac{\partial x_{i,tp}}{\partial h_{i,tp}} \Big|_p \frac{dh_{i,tp}}{dt} + \left. \frac{\partial \bar{\gamma}}{\partial x_{o,tp}} \right|_{c, x_{i,tp}} \frac{\partial x_{o,tp}}{\partial h_{o,tp}} \Big|_p \frac{dh_{o,tp}}{dt} \end{aligned} \quad (8)$$

Since $\bar{\gamma}$ is a state variable and can be integrated through Equation (8), there is no need to use Equation (7) to calculate $\bar{\gamma}$ in Equation (4) & (5) anymore. Equation (7) is used to calculate the partial derivatives in Equation (8) only.

Subcooled region

$$A_c (L_t - L_2) \frac{d\bar{\rho}_3}{dt} - A_c (\bar{\rho}_3 - \rho_f) \frac{dL_2}{dt} = \dot{m}_{r,23} - \dot{m}_{r,out} \quad (9)$$

$$A_c (L_t - L_2) \left(\bar{\rho}_3 \frac{d\bar{h}_3}{dt} - \frac{dp}{dt} \right) - A_c \rho_f (\bar{h}_3 - h_f) \frac{dL_2}{dt} \quad (10)$$

$$= \dot{m}_{r,23} (h_f - \bar{h}_3) - \dot{m}_{r,out} (h_{r,out} - \bar{h}_3) + q_{r,3}$$

$$\frac{dT_{w,3}}{dt} = \frac{q_{a,3} - q_{r,3}}{c_{p,w} A_{c,w} \rho_w (L_t - L_2)} + \frac{T_{w,3} - T_{w,2}}{L_t - L_1} \frac{dL_2}{dt} \quad (11)$$

Momentum balance

Since the pressure is assumed to be uniform within the entire heat exchanger, an equation accounting for global momentum balance is required to calculate the mass flow rate leaving the heat exchanger. Recall that the outlet pressure is the boundary condition.

As suggested by Brasz and Koenig (1983), dynamic pressure waves are of minor importance for a heat transfer analysis and they can be neglected while still preserving the physical integrity. Therefore, we can obtain the following equation. The pressure drop is entirely due to the frictional loss.

$$(p - p_{out}) A_c = \sum_{i=1}^N F_{w,i} \quad (12)$$

The pressure loss within each region can be calculated using empirical correlations based on the average of inlet and outlet mass flow rates.

Approach #2:

Assume that refrigerant pressure varies linearly within the entire heat exchanger. Similarly, only one additional equation is required to account for the global momentum balance. In this case, the state vector is defined as $\left[p_{in} \bar{\gamma} h_{r,out} L_1 L_2 T_{w,1} T_{w,2} T_{w,3} \right]$.

The mean pressure of each region is defined as the pressure at the midpoint of the corresponding region, i.e.

$$\begin{aligned} p_1 &= p_{in} - \frac{p_{in} - p_{out}}{L_t} \frac{L_1}{2} \\ p_2 &= p_{in} - \frac{p_{in} - p_{out}}{L_t} \frac{L_1 + L_2}{2} \\ p_3 &= p_{in} - \frac{p_{in} - p_{out}}{L_t} \frac{L_2 + L_t}{2} \end{aligned} \quad (13)$$

The mean pressure in individual regions is used to calculate the related refrigerant properties. For instance, mean refrigerant density of the superheated region should be calculated using p_1 and \bar{h}_1 .

Pressure at boundaries is required to calculate the density at the bubble point and dew point, i.e. ρ_g and ρ_f .

$$\begin{aligned} p(L_1) &= p_{in} - \frac{p_{in} - p_{out}}{L_t} L_1 \\ p(L_2) &= p_{in} - \frac{p_{in} - p_{out}}{L_t} L_2 \end{aligned} \quad (14)$$

The governing equations are essentially the same as those in Approach #1 and thus not repeated here for brevity.

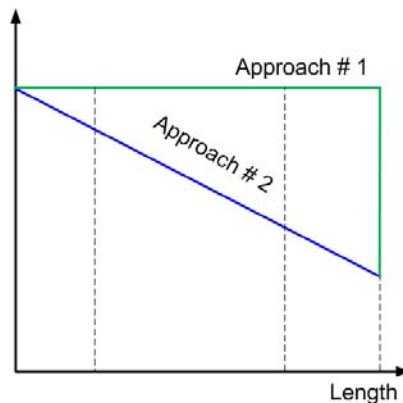


Figure 1: Two different approaches to calculate pressure drop

Switching criteria

As pointed out earlier, the switching methods presented in the literature have flaws and may cause serious instabilities when it comes to the simulation of cycling transients. This paper proposes a consistent, comprehensive and robust switching scheme to handle transitions between different model representations. All the possible model modes of the studied system under cycling conditions and the switching criteria between different modes are shown

in Figure 3. The minimum threshold ϵ_{\min} can be adjusted based on the application. The pseudo length is determined based on the mass conservation as follows:

$$L_{pseudo} = \frac{\bar{\rho}_{new\ zone\ \&\ adjacent\ zone} - \bar{\rho}_{adjacent\ zone}}{\bar{\rho}_{new\ zone} - \bar{\rho}_{adjacent\ zone}} L_{adjacent\ zone} \quad (15)$$

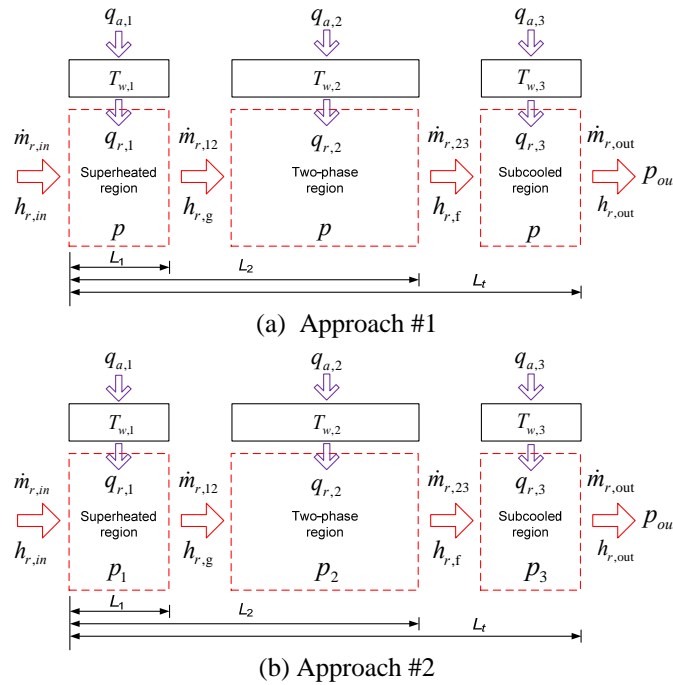


Figure 2: Moving boundary condenser model


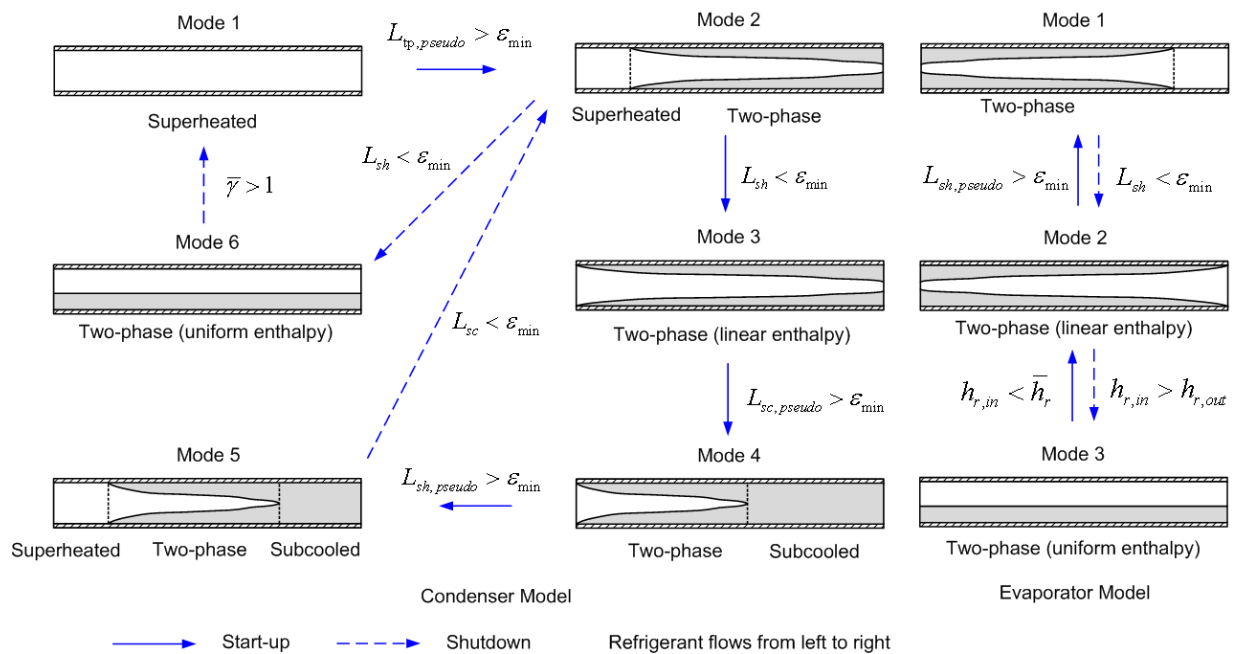


Figure 3: Modes of moving boundary heat exchanger models of the studied FTVI system


3. CASE STUDY AND SIMULATION RESULTS

Utilizing the developed models based on Approach #1, the start-up transients of a flash tank vapor injection (FTVI) heat pump system is investigated. Detailed description about the system configuration and the modeling techniques for other components are presented in Qiao *et al.* (2012 & 2014). All the results are presented in Figure 4. It can be seen that the simulation results agree with experimental data. Since all the simulation results are obtained by conducting a similar analysis to what is performed in Qiao *et al.* (2014) except that the proposed moving boundary heat exchanger models are used in the presented paper, detailed explanations for the following figures will not be provided for brevity. Readers are referred to Qiao *et al.* (2014).

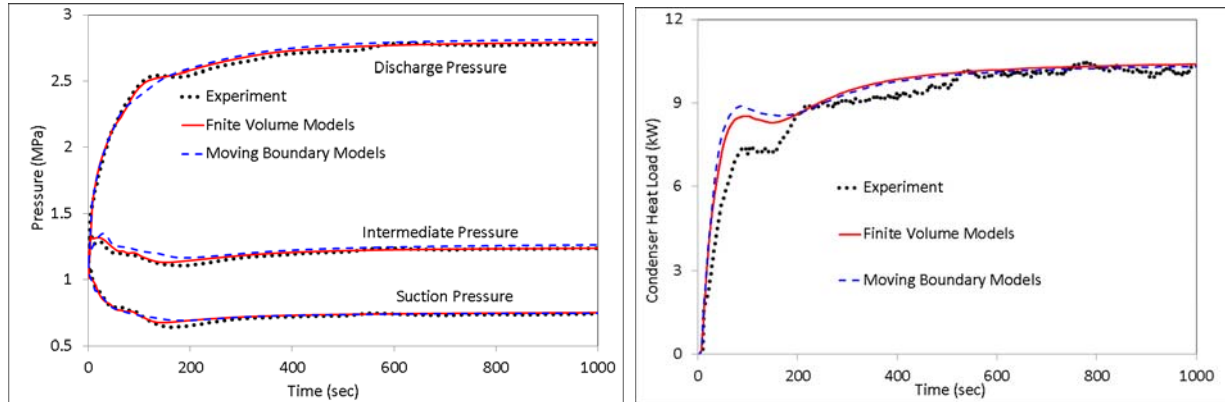

(a)

(b)

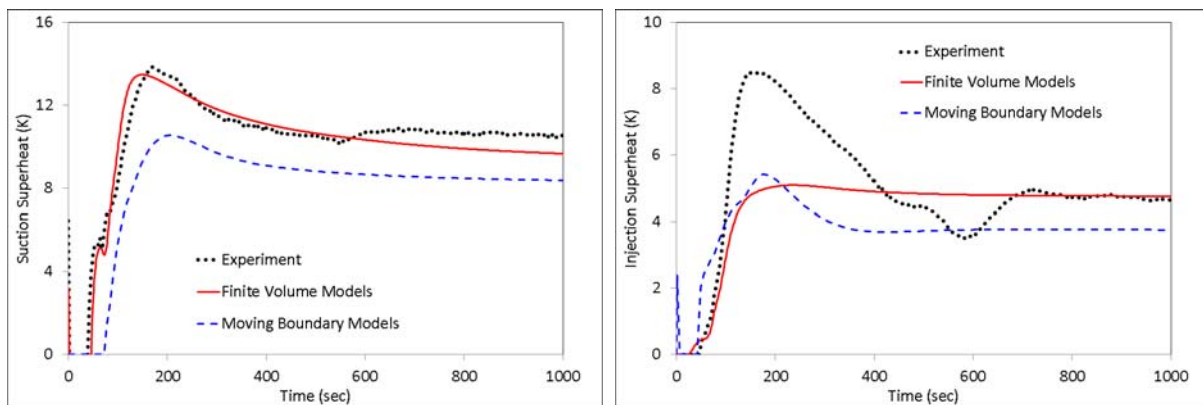

(c)

(d)

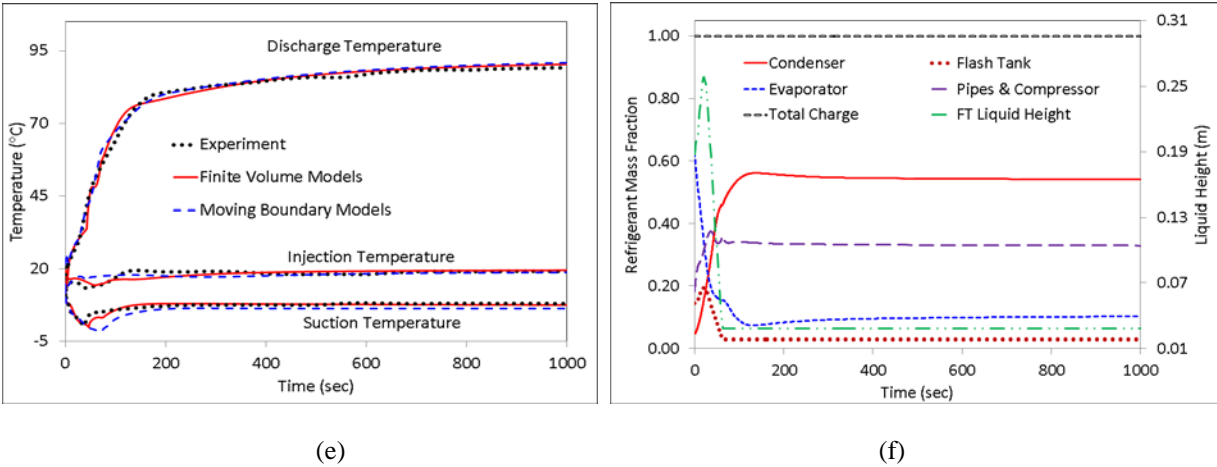


Figure 4: Start-up transients: (a) pressure response; (b) condenser heat load response; (c) suction superheat response; (d) injection superheat response; (e) temperature response; (f) simulated refrigerant charge distribution and liquid height in flash tank

4. CONCLUSIONS

An improved moving boundary heat exchanger model for use in dynamic simulations is proposed in the paper. Specifically, two different approaches are presented to account for the refrigerant pressure drop across the heat exchanger. A comprehensive switching scheme is introduced to ensure smooth transition between different model representations under large disturbances. A validation case based on experimental data is presented, showing that the proposed heat exchanger model along with other supporting component models can reasonably capture the start-up transients of a flash tank vapor injection system. Future work includes the investigation of system transients under shutdown and other operating conditions.

NOMENCLATURE

<i>Symbol</i>		<i>Subscript</i>	
A	area [m ²]	a	moist air
c_p	specific heat [J/kg-K]	adj	adjacent zone
F	force [N]	c	cross section
h	enthalpy [J/kg]	f	saturated liquid
L	length [m]	g	saturated vapor
\dot{m}	mass flow rate [kg/s]	i	inlet
p	pressure [Pa]	in	inlet
q	heat transfer rate [W]	mid	middle point
T	temperature [K]	new	new zone
x	vapor quality [-]	o	outlet
ε	minimum length [m]	out	outlet
γ	void fraction [-]	pseudo	pseudo
ρ	density [kg/m ³]	r	refrigerant
Δ	difference [-]	sc	subcooled region
		sh	superheated region
		total	total
		tp	two-phase region
		w	tube wall

REFERENCES

- Beck, B.T. and Wedekind, G.L., 1981. A generalization of the system mean void fraction model for transient two-phase evaporating flows. *J. of Heat Transfer* 103, 81-85.
- Bendapudi, S., Braun, J. E., Groll, E. A., 2008. A Comparison of Moving-Boundary and Finite-Volume Formulation for Transients in Centrifugal Chillers. *Int. J. Refrigeration* 31, 1437-1452.
- Brasz, J.J., Koenig, K., 1983. Numerical methods for the transient behavior of two-phase flow heat transfer in evaporators and condensers. *Numerical Properties and Methodologies in Heat Transfer*, ed. T.M. Shih, Springer Verlag, Berlin, 461-476.
- Cecchinato, L., Mancini, F., 2012. An intrinsically mass conservative switched evaporator model adopting the moving-boundary method. *Int. J. Refrigeration* 35, 349-364.
- Diaz, G., 2007. Controllability of cross-flow two-phase heat exchangers. *Int. J. Heat Mass Transfer* 50, 4559-4567.
- Eldredge, B.D., Rasmussen, B.P., Alleyne, A.G., 2008. Moving-boundary heat exchanger models with variable outlet phase. *Journal of Dynamic Systems, Measurement, and Control* 130 (6), 1003–1012.
- Grald, E.W., MacArthur, J.W., 1992. A moving-boundary formulation for modeling time-dependent two-phase flows. *Int. J. Heat and Fluid Flow* 13, 266-272.
- He, X. 1996. Dynamic Modeling and Multivariable Control of Vapor Compression Cycles in Air- Conditioning systems. *Ph.D. Thesis, MIT, Cambridge, MA*.
- Jensen, J.M., 2003. Dynamic modeling of thermo-fluid systems with focus on evaporators for refrigeration. *Ph.D Thesis, Technical University of Denmark, Department of Mechanical Engineering*.
- Jensen, J.M. and Tummescheit, H., 2002. Moving boundary models for dynamic simulations of two-phase flows, *2nd International Modelica Conference, Oberpfaffenhofen, Germany, 235-244*.
- Kandlikar, S., Garimell, S., Li, D., Colin, S., King, M.R., 2006. Heat transfer and fluid flow in minichannels and microchannels. Elsevier.
- Kumar, M., Kar, I., and Ray, A. (2008). State space based modeling and performance evaluation of an air conditioning system. *HVAC&R Res.*, 14(5), 797-816.
- Leducq, D., Guilpart, J., Trystram, G., 2003. Low order dynamic model of a vapor compression cycle for process control design. *J. Food Process Eng.* 26(1), 67-91.
- Li, B. and Alleyne, A.G., 2010. A Dynamic Model of a Vapor Compression Cycle with Shut-down and Start-up Operations. *Int. J. Refrigeration* 33, 538-552.
- Liang, N., Shao, S., Tian, C., Yan, Y., 2010. Dynamic simulation of variable capacity refrigeration systems under abnormal conditions. *Applied Thermal Engineering* 30(10), 1205-1214.
- McKinley, T. and Alleyne, A., 2008. An Advanced Nonlinear Switched Heat Exchanged Model for Vapor Compression Cycles using the Moving Boundary Method. *Int. J. Refrigeration* 31(7), 1253-1264.
- Pettit, N.B.O.L., Willatzen, M., Ploug-Sørensen, L., 1998. A general dynamic simulation model for evaporators and condensers in refrigeration. Part II: simulation and control of an evaporator. *Int. J. Refrigeration* 21 (5), 404–414.
- Qiao, H., Aute, V., Radermacher, R., 2014. Transient modeling of a flash tank vapor injection heat pump system. Part I - model development. *Int. J. Refrigeration*. (Under review)
- Qiao, H., Xu, X., Aute, V., Radermacher, R., 2012. Modelica-based transient modeling of a flash tank vapor injection system. *14th International Refrigeration and Air Conditioning Conference at Purdue*, West Lafayette, IN, USA, Paper No. 2186.
- Rasmussen, B. and Alleyne, A., 2004. Control-Oriented Modeling of Transcritical Vapor Compression Systems. *ASME Journal of Dynamic Systems, Measurement, and Control* 126 (1), 54-64.
- Tian, C., C. Dou, X. Yang, and X. Li. 2005. Instability of automotive air conditioning system with a variable displacement compressor. Part 2. Numerical simulation. *Int. J. Refrigeration* 28(7):1111–23.
- Tian, C., and Li, X., 2005. Transient behavior evaluation of an automotive air conditioning system with a variable displacement compressor. *Applied Thermal Engineering* 25(13):1922–48.
- Wedekind, G.L., Bhatt, B.L., Beck, B.T., 1978. A system mean void fraction model for predicting various transient phenomena associated with two phase evaporating and condensing flows. *Int. J. Multiphase Flow* 4, 97–114.
- Willatzen, M., Pettit, N.B.O.L., Ploug-Sørensen, L., 1998. A general dynamic simulation model for evaporators and condenser in refrigeration. Part I: moving boundary formulation of two phase flows with heat exchange. *Int. J. Refrigeration* 21 (5), 398–403.
- Yebra, L.J., Berenguel, M., Dormido, S., 2005. Extended moving boundary model for two-phase flows. *16th IFAC World Congress*.
- Zhang, W.J., Zhang, C.L., 2006. A generalized moving-boundary model for transient simulation of dry-expansion evaporators under larger disturbances. *Int. J. Refrigeration* 29, 1119-1127.