

# A Computer Model of the Evaporator for the Development of an Automatic Control System

K A Kozin, E V Efremov, O P Kabrysheva and M I Grachev

Institute of Physics and Technology, Tomsk Polytechnic University, 30 Lenin Avenue, Tomsk, 634050, Russian Federation

E-mail: [efremov@tpu.ru](mailto:efremov@tpu.ru)

**Abstract.** For the implementation of a closed nuclear fuel cycle it is necessary to carry out a series of experimental studies to justify the choice of technology. In addition, the operation of the radiochemical plant is impossible without high-quality automatic control systems. In the technologies of spent nuclear fuel reprocessing, the method of continuous evaporation is often used for a solution conditioning. Therefore, the effective continuous technological process will depend on the operation of the evaporation equipment. Its essential difference from similar devices is a small size. In this paper the method of mathematic simulation is applied for the investigation of one-effect evaporator with an external heating chamber. Detailed modelling is quite difficult because the phase equilibrium dynamics of the evaporation process is not described. Moreover, there is a relationship with the other process units. The results proved that the study subject is a MIMO plant, nonlinear over separate control channels and not self-balancing. Adequacy was tested using the experimental data obtained at the laboratory evaporation unit.


## 1. Introduction

Implementation of a closed nuclear fuel cycle requires substantiation of spent nuclear fuel (SNF) technology through studies at the experimental and pilot equipment. At the same time creation of an effective radiochemical production with regard to its high radioactive, nuclear and environmental hazards is impossible without the use of automatic control systems (ACS) [1].

For conditioning solutions in spent fuel reprocessing technologies the method of evaporation, which is conditioning of liquid waste and concentration of the desired products, is often applied. Therefore, the effective continuous operation of the technological process will depend on the operation of the evaporation equipment. Its essential difference from similar devices is a small size due to a relatively small-scale production for safety assurance [1].

Such devices are MIMO plants, nonlinear over separate control channels and they are not self-balancing. Therefore, to study various ACS using a one-effect evaporator with an external heating chamber for evaporation of uranyl nitrates solution (see figure 1), it is necessary to create a mathematical model describing the dynamic relationships between key process variables. At the same time, according to a general engineering rule, for the synthesis of ACS 10% accuracy is quite acceptable, due to the approximate formulas for analytical calculations of the controller parameters [2].



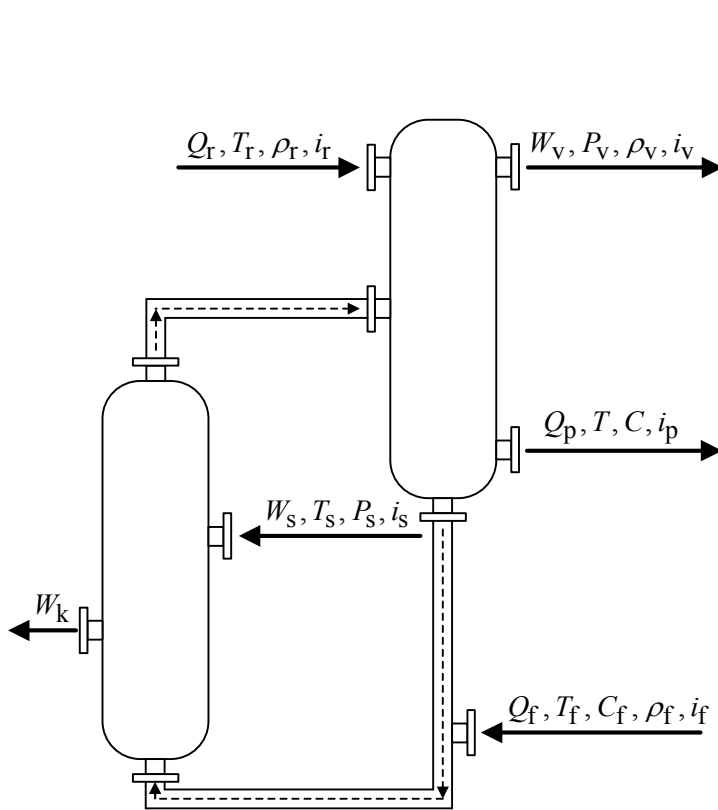

$Q_r, Q_p, Q_f$  – the volume flow of reflux, the evaporated uranium re-extract and feed solution of uranium re-extract, respectively,  $m^3/h$ ;  
 $T_r, T, T_f, T_s$  – the temperature of reflux, solution in the unit, feed solution of uranium re-extract and heating steam respectively,  $^{\circ}C$ ;  
 $\rho, \rho_v, \rho_r, \rho_f$  – the density of the solution in the unit, secondary steam, reflux, feed solution of uranium re-extract respectively,  $kg/m^3$ ;  
 $W_k, W_s, W_v$  – the mass flow of the condensate, heating and secondary steam respectively,  $kg/h$ ;  
 $P_s, P_v$  – the pressure of the heating and secondary steam respectively,  $kPa$ ;  
 $i, i_s, i_f, i_r, i_v, i_p$  – the enthalpy of the solution in the unit, the heating steam, the feed solution, reflux, secondary steam and the evaporated uranium re-extract respectively,  $J/kg$ ;  
 $C, C_f$  – the concentration of the evaporated uranium re-extract and the feed solution of uranium re-extract respectively,  $kg/m^3$

**Figure 1.** Evaporator scheme

## 2. Mathematical model

A mathematical model of uranium re-extract evaporation should represent the following:

- time history of the solution level in the unit according to the flow of feed solution of uranium re-extract, evaporated uranium re-extract, reflux and heating steam flow;
- time history of concentration / density of evaporated solution, depending on the flow rate and the concentration / density of the feed solution and the reflux, flow of the evaporated uranium re-extract and heating steam;
- time history of the solution temperature in the unit depending on the temperature of feed solution, reflux, heating steam and its pressure.

In addition, the model should take into account mutual influence of the controlled parameters, mentioned above.

As a rule, in analytical models of chemical units, mathematical formulation comes to generation of equations of mass and heat balance of the system, based on the fundamental laws of nature: the laws of conservation of mass and energy [3–6].

Mathematical formulation had to be simplified due to the lack of data on the thermodynamic properties of the evaporated product, physical and thermodynamic parameters of the heating and juice steam, as well as the necessary data for the description of the heat lost to the environment, etc.

As a result, time history of the material, element and heat flows in the unit is described by the following system of equations (1), where  $A$  – cross sectional area of the evaporator,  $m^2$ ;  $c_f$  – specific

thermal capacity of the feed solution, kJ/(°C·kg);  $\rho_w$  – water density, kg/m<sup>3</sup> and the mass flow of secondary steam  $W_v$  is calculated by the following algebraic expression (2).

$$\begin{cases} \frac{dh}{dt} = \frac{1}{A} \left( Q_f + Q_r - Q_p - \frac{W_v}{\rho_w} \right) \\ \frac{d\rho}{dt} = \frac{1}{Ah} \left( W_v \left( \frac{\rho}{\rho_w} - 1 \right) - Q_f \rho_f \left( \frac{\rho}{\rho_f} - 1 \right) \right) \\ \frac{dT}{dt} = \frac{[W_s(i_s - i_c) + Q_f \rho_f (i_f - i) + Q_r \rho_r (i_r - i) + W_v (i_v - i) - L(T - T_{ar})]}{\rho_f c_f Ah} \end{cases}, \quad (1)$$

$$W_v = \frac{Q_f \rho_f c_f T_f - Q_p \rho c T + Q_r \rho_r i_r + W_s i_s}{i_v}. \quad (2)$$

Enthalpy of heating steam, secondary steam, and dew is determined using the expression obtained by fitting the tabular data:

$$\begin{aligned} i_{s,v} &= 2.5 \cdot 10^6 + 1813 \cdot T_{sat} + 0.417 \cdot T_{sat}^2 - 0.11 \cdot T_{sat}^3 + 2090 \cdot (T_{s,v} - T_{sat}) \\ T_{sat} &= \frac{2147}{(10.76 - \lg(P_s))} - 273.2 \\ i_c &= (-0.0051 \cdot T_s^2 - 1.5595 \cdot T_s + 2467.1) \cdot 10^3 \end{aligned} \quad (3)$$

The developed approach and mathematical description of the evaporator as a controlled object was implemented as a computer model in the MATLAB / Simulink package. For testing qualitative adequacy of the model, research results of the evaporators presented in [7] were used. One of the study subjects there was a two-stage vacuum evaporator "Edinstvo" [8].

### 3. Simulation results

Figure 2 shows the transition processes of the solution level in the second device of "Edinstvo" evaporator and in the developed model of uranium re-extract evaporator. The flow of the feed solution  $\Delta S_f = 1700$  kg/h to the unit was changed up to 62%.

As it is seen from the graphs, the behavior of the level in both cases is identical, and the channel of the controlled object can be regarded as an astatic link.

Figure 3 shows the transient responses of the concentration in the first device of "Edinstvo" evaporator and the appropriate transitional process in the developed computer model of the evaporator. The fluid flow from the unit  $\Delta S_p = -250$  kg/h was changed up to 30%.

The above graphs show that transient responses of concentration obtained at the evaporator and the simulation results are qualitatively equal. In addition, this channel of the controlled object can be regarded as a first order aperiodic link.

Figure 4 shows the transient responses of the temperature of the solution in the first device of "Edinstvo" evaporator and the appropriate transitional process in the developed computer model of the evaporator. The heating steam flow from the unit  $\Delta S_p = 480$  kg/h was changed up to 17%.

The above graphs show that the transient responses of temperature, obtained at the evaporation unit and the simulation results are qualitatively equal.

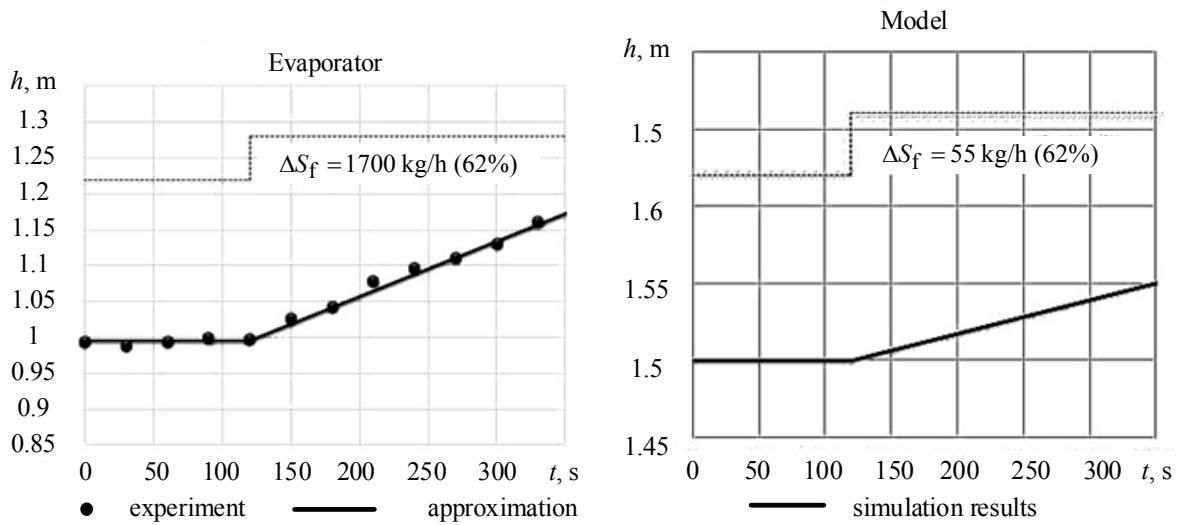


Figure 2. Transition process in the level

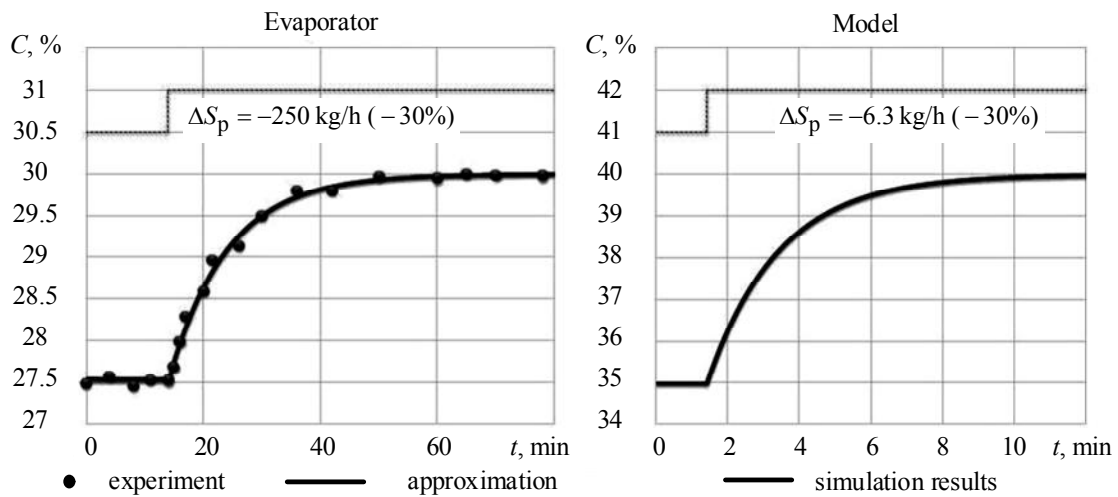


Figure 3. Transition process in concentration

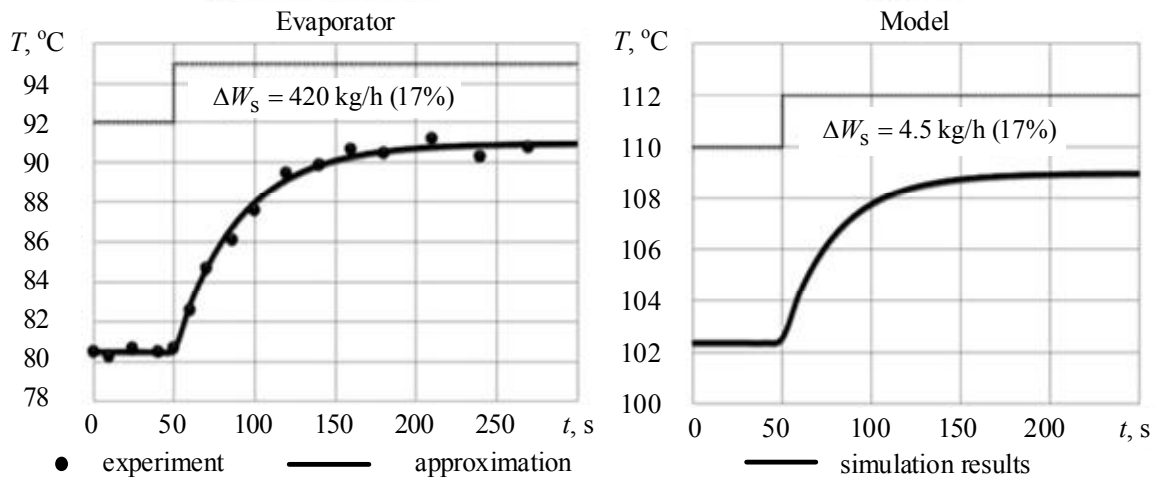


Figure 4. Transition process in temperature

Furthermore, similar to the transient responses of concentration, it can be seen that the object of the present channel can be regarded as a first order aperiodic link. Comparison of simulation results with the data [9] shows their qualitative agreement.

The analysis of the given above transient responses shows that the time constant of the evaporators for concentration / density is substantially higher than time constant for the level and temperature. This fact should be considered when developing ACS of an evaporation unit.

Qualitative adequacy of the developed model was tested using the experimental data obtained at a laboratory evaporator at V.G. Khlopin Radium Institute, St. Petersburg.

This unit is equipped with an automated control system, based on two control algorithms.

The first algorithm is designed for evaporation mode with a required density. The level of the solution in the still is maintained constant by controlling the flow of feed solution. In the transient mode (to achieve the desired density) the solution in the still was not drained. In the continuous mode, the solution was drained in proportion to the average flow of the feed solution.

The second algorithm provides required density of the solution at the output of the evaporation unit in a continuous mode. The desired density of the solution in the still was maintained by the flow of feed solution, while the level was maintained by draining the solution in the still.

The following experiment was carried out at the laboratory evaporator. In the starting mode, after initial filling with the feed solution and beginning of the evaporation process control was maintained by the first algorithm in the transient mode. After reaching a required value of density  $\rho = 1400 \text{ kg/m}^3$ , that is, tapering off to a steady-state regime, control was maintained by the second algorithm. If the measured density of the solution in the still was greater than  $\rho$ , the maximum flow rate of feed solution was set. If it was less than that, the minimum flow rate was set. That is, the control was maintained according to the relay rules.

After tapering off to a steady-state regime, transition process was recorded while set point of density was changed from  $\rho = 1400 \text{ kg/m}^3$  to  $\rho = 1500 \text{ kg/m}^3$ .

A similar experiment was carried out on the developed computer model of the evaporation unit. The experimental data and simulation results are shown in figure 5.

Another experiment was carried out at the laboratory evaporator. After reaching a required density value of  $\rho = 1315 \text{ kg/m}^3$ , it was decreased to  $\rho = 1285 \text{ kg/m}^3$ . The results of the experiment are presented in figures 6b–6d.

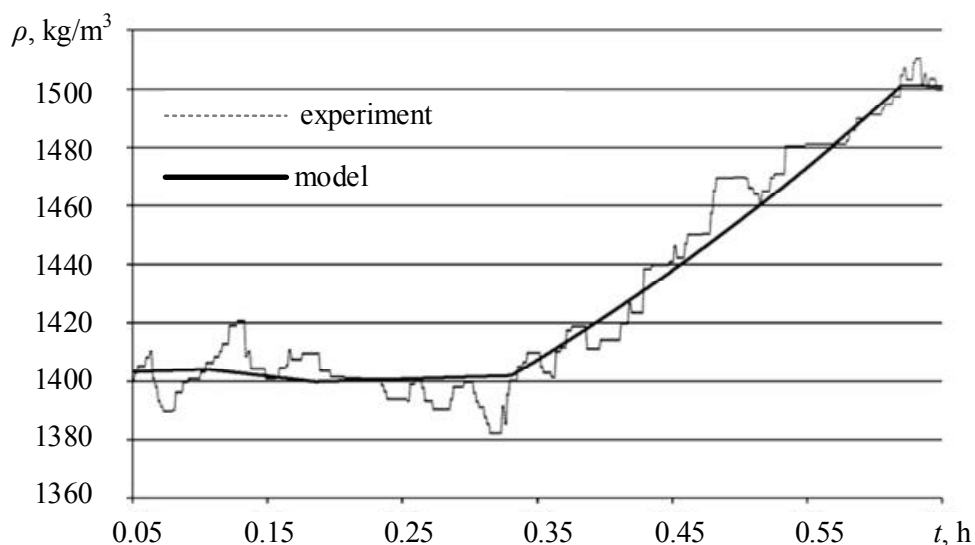
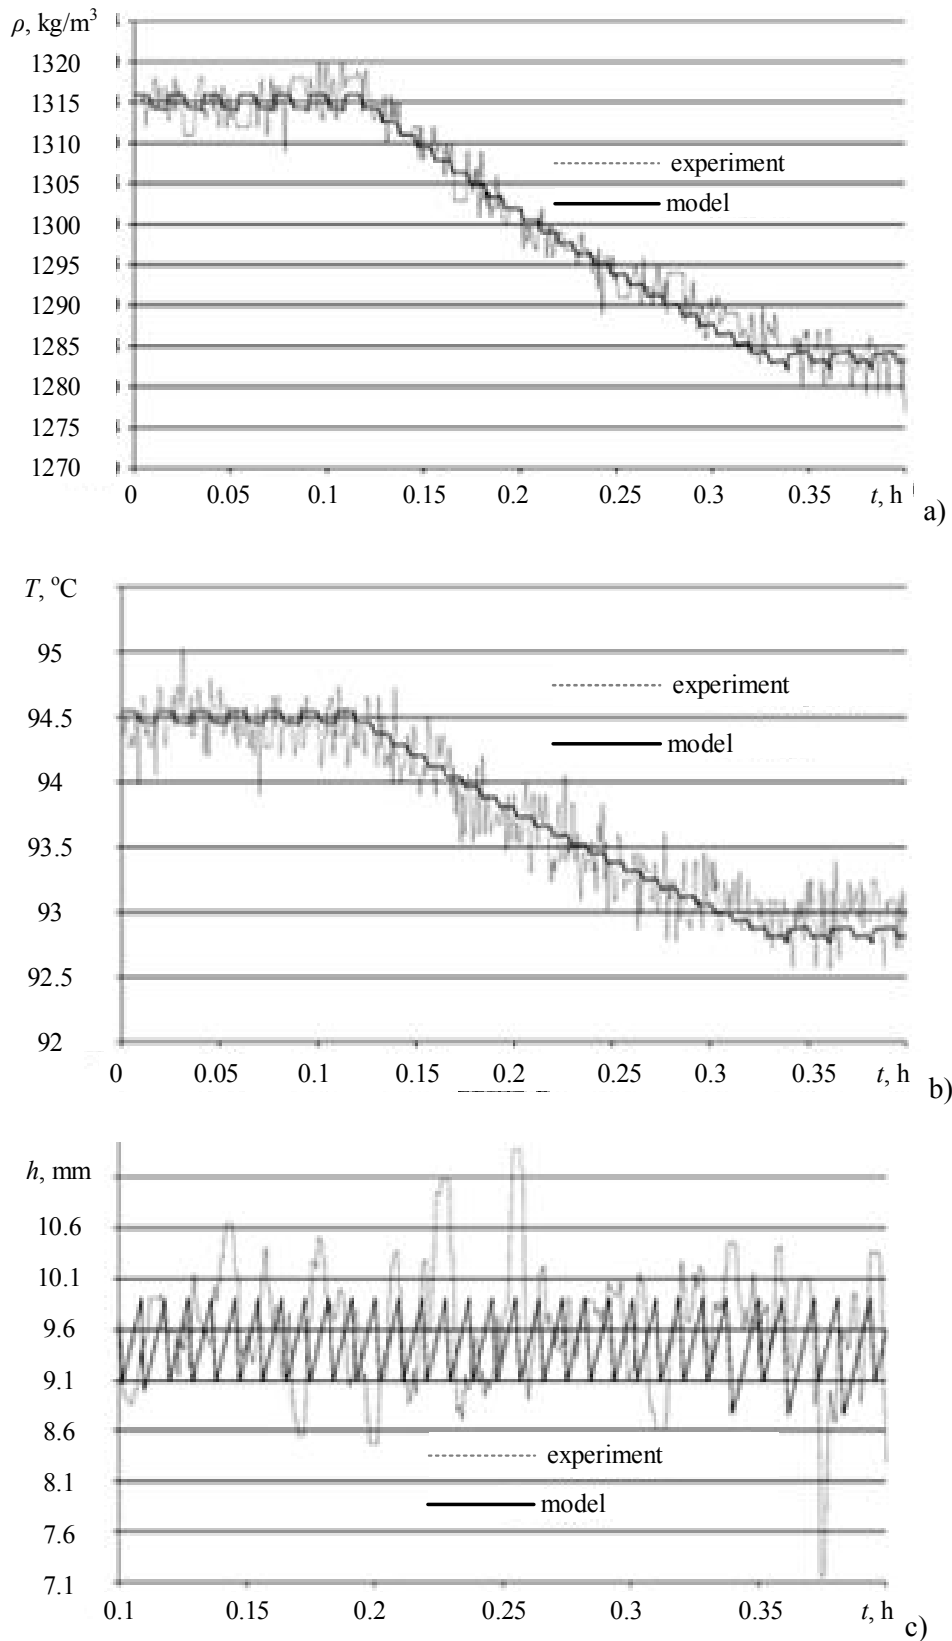


Figure 5. Transition process in density



**Figure 6.** Transition process in density (a), temperature (b), level (c) at a laboratory evaporator and in the computer model

#### 4. Conclusion

The relative standard errors of simulation in the level, density and temperature of the solution were less than 9%, 5% and 7%, respectively, which satisfy the required specification.

Thus, in the course of this work the qualitative and quantitative adequacy of the developed computer model was proved, which allows its application for the development of ACS an evaporation unit.

#### References

- [1] Sheviakov I Y, Kozin K A, Goryunov A G, Hoffman F E, Zilberman B J and Ryabkov D V 2014 *Proc. Int. Conf. "Physical and technical problems of nuclear science, energy and industry"* (Tomsk: Tomsk Polytechnic University Press) p 52.
- [2] Sovetov B J and Yakovlev S A 1998 *Modelling of systems: Textbook for universities* (Moscow: Visshaja shk.)
- [3] Gafarov V V and Glebov M B 1991 *Mathematical modeling of the basic processes of chemical industry* (Moscow: Visshaja shk.)
- [4] Lutsenko V A and Finyakin L N 1984 *Mathematical modeling of chemical-technological processes on analog computers* (Moscow: Chemistry)
- [5] Lutsenko V A and Finyakin L N 1979 *Analog computers in chemistry of chemical technology* (Moscow: Chemistry)
- [6] Samarskii A A and Mikhailov A P 2001 *Mathematical modeling: the Ideas. Methods.Examples* (Moscow: FIZMATLIT)
- [7] Taubman E I 1970 *Calculation and simulation of evaporators* (Moscow: Chemistry)
- [8] Egorova O V, Liventsova N V, Efremov E V and Grachev M I 2014 *Procedia Chemistry* **11** 139–46
- [9] Kiew M. Kam, Prabirkumar Saha, Moses O. Tadel and Rangaiah G P 2002 Models of an Industrial Evaporator System for Education and Research in Process Control *Developments in Chemical Engineering and Mineral Processing* **10** 105–27.