



Strathprints Institutional Repository

Freund, S. and Kummert, M. (2003) *New TRNSYS types to simulate air-to-air energy recovery*. In: TRNSYS Users day and Training, 2003-03-24 - 2003-03-26, Sophia-Antipolis, France.

Strathprints is designed to allow users to access the research output of the University of Strathclyde. Copyright © and Moral Rights for the papers on this site are retained by the individual authors and/or other copyright owners. You may not engage in further distribution of the material for any profitmaking activities or any commercial gain. You may freely distribute both the url (<http://strathprints.strath.ac.uk/>) and the content of this paper for research or study, educational, or not-for-profit purposes without prior permission or charge.

Any correspondence concerning this service should be sent to Strathprints administrator: <mailto:strathprints@strath.ac.uk>



Freund, S. and Kummert, M.* (2003) New TRNSYS types to simulate air-to-air energy recovery. In: TRNSYS Users day and Training, 24-26 March 2003, Sophia-Antipolis, France.




<http://eprints.cdlr.strath.ac.uk/6589/>

Strathprints is designed to allow users to access the research output of the University of Strathclyde. Copyright © and Moral Rights for the papers on this site are retained by the individual authors and/or other copyright owners. You may not engage in further distribution of the material for any profitmaking activities or any commercial gain. You may freely distribute both the url (<http://eprints.cdlr.strath.ac.uk>) and the content of this paper for research or study, educational, or not-for-profit purposes without prior permission or charge. You may freely distribute the url (<http://eprints.cdlr.strath.ac.uk>) of the Strathprints website.

Any correspondence concerning this service should be sent to The Strathprints Administrator: eprints@cis.strath.ac.uk



New TRNSYS Types to simulate Air-To-Air Energy Recovery

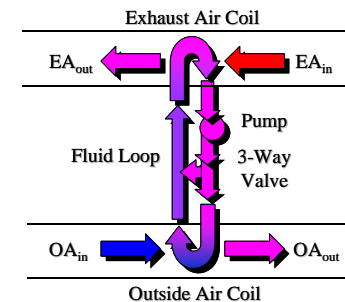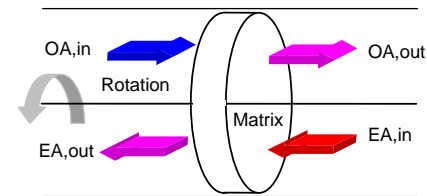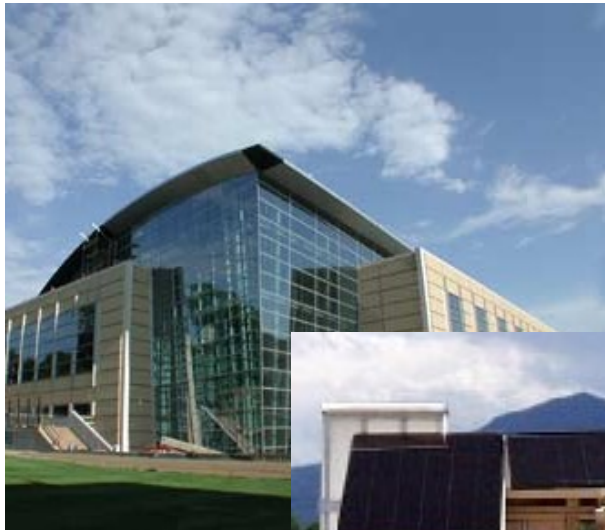

- Why Air-To-Air Energy Recovery?
 - Heat recovery
 - Humidity Recovery
- 2 different approaches
 - Enthalpy Exchanger
 - Runaround Loop
- New Types
 - Modeling
 - Integrated Controls
- Application Example



- Modern buildings:
 - Well insulated
 - IAQ becomes more important
 - Strict ventilation standards
 - Often more than $30 \text{ m}^3 \text{ h}^{-1} \text{ pers}^{-1}$
 - Comfort → Temperature AND humidity
 - Ventilation is responsible for a large fraction of HVAC energy use

- Solution: Energy recovery
 - Heat exchanger between inlet air and exhaust air
 - Humidity and Temperature: Enthalpy exchanger




TRNSYS 



- Enthalpy exchanger
 - Rotary heat and mass exchanger (regenerative)
 - Requires exhaust and inlet flows to cross each other
 - Well adapted to new buildings
 - “Total solution”: Heat and mass transfer

- Runaround loop
 - Two air/water heat exchangers + water loop
 - Well adapted to existing building where ventilation ducts cannot be modified
 - No “humidity recovery”
 - No cross-contamination is possible




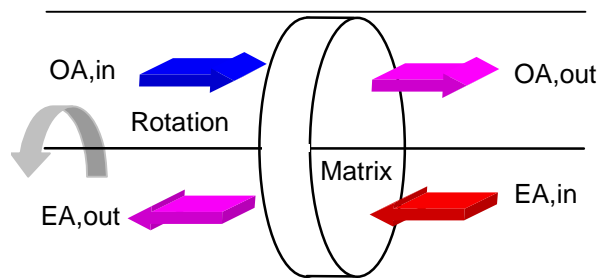

- Cylindrical Wheel
 - Numerous parallel channels
 - Each half works intermittently in each flow (regenerative)



- Matrix:
 - Desiccant coated Aluminum foil
 - Polymer membrane with desiccant substance (e.g. silicagel or molecular sieve)

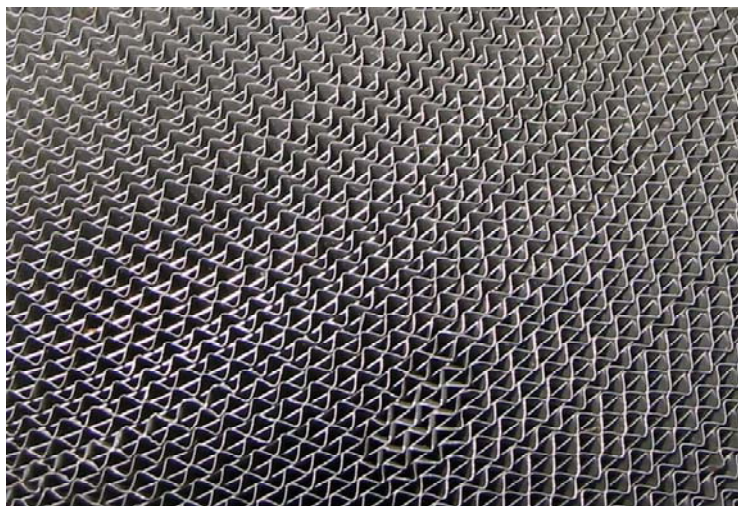


- corrugated aluminum coated with a molecular sieve





- Polystyrene membrane coated with silicagel



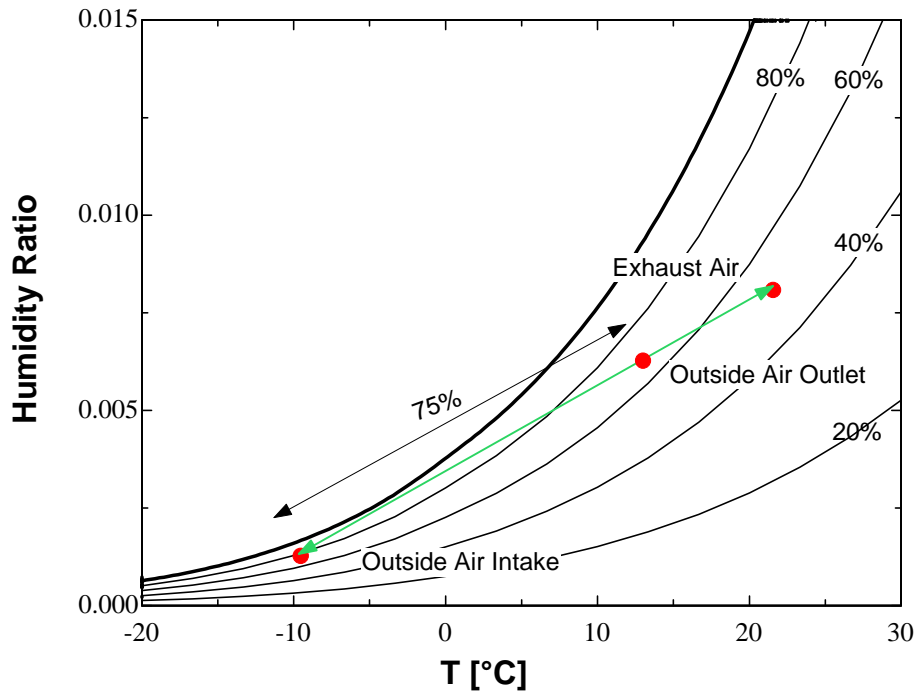

Heating

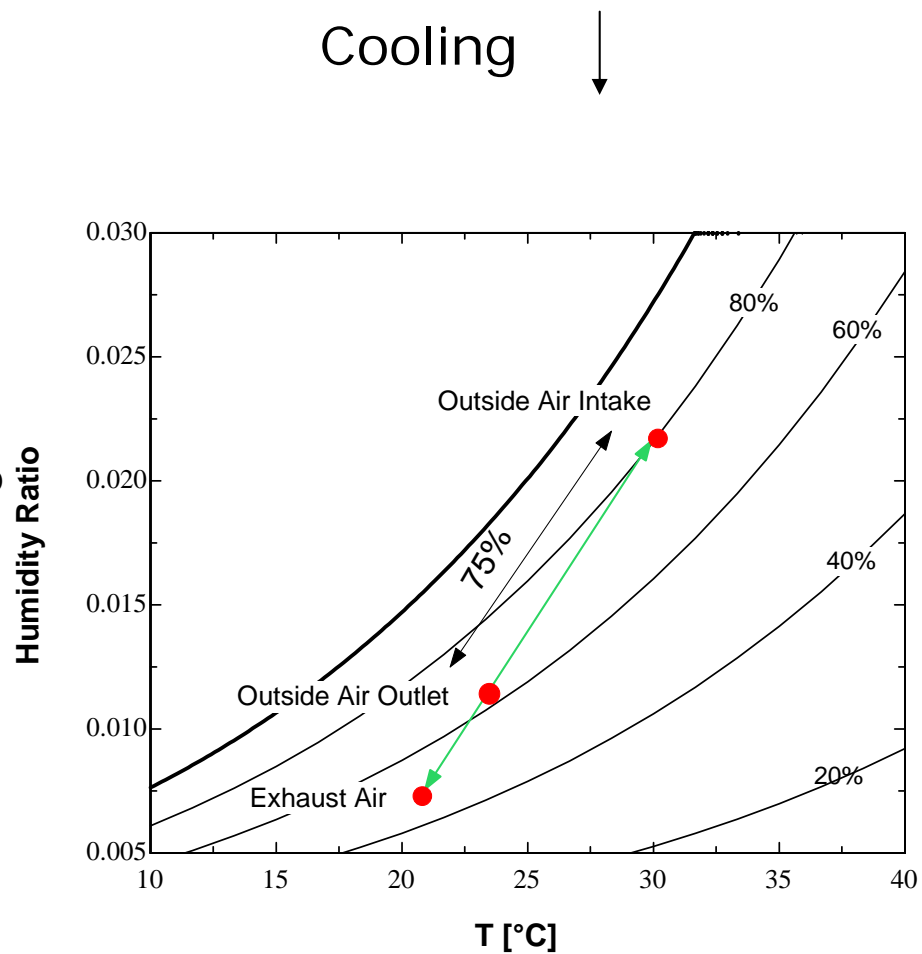

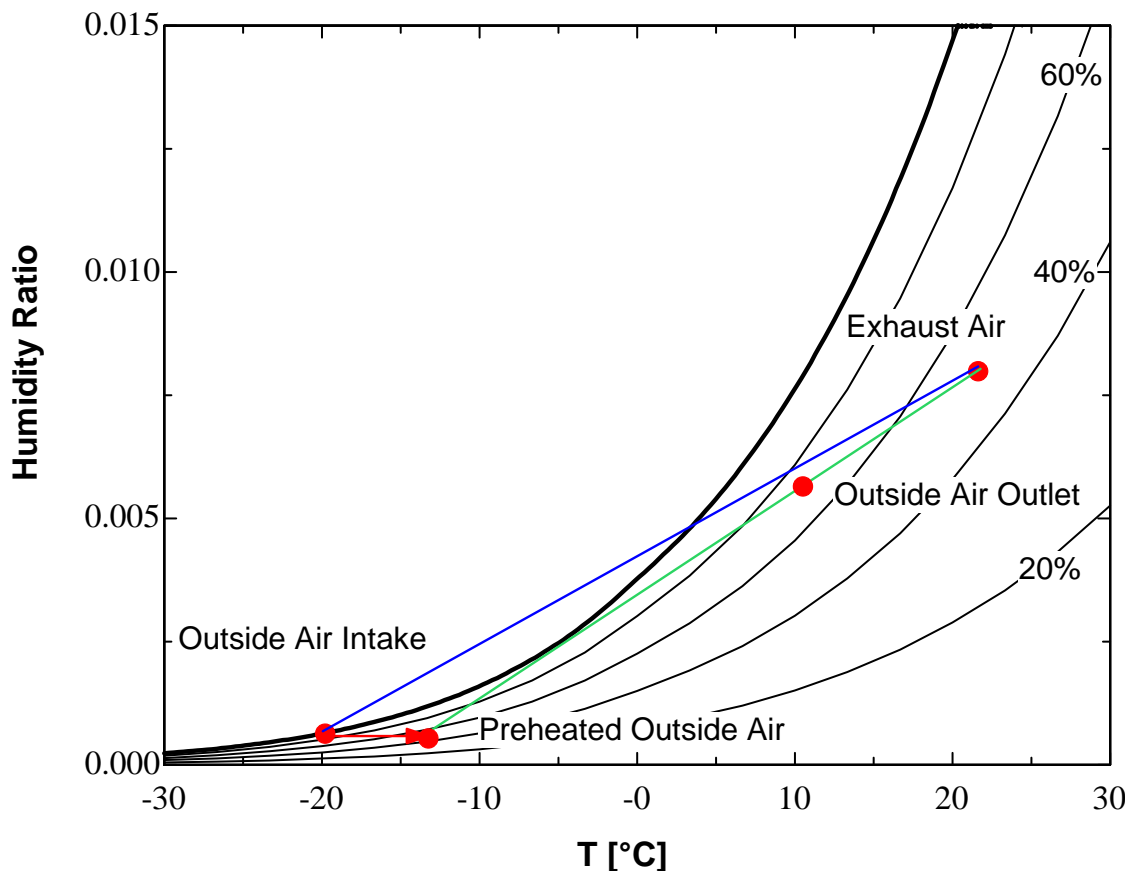

- Solutions
 - Lower rotation speed (lower effectiveness)
 - Preheat outside air (preferred option)


- Usually happens for $T_{amb} < -10^{\circ}\text{C}$



- Effectiveness (Heat and Mass transfer)

$$\varepsilon_T = \frac{T_{OA, in} - T_{OA, out}}{T_{OA, in} - T_{EA, in}}$$

$$\varepsilon_w = \frac{W_{OA, in} - W_{OA, out}}{W_{OA, in} - W_{EA, in}}$$

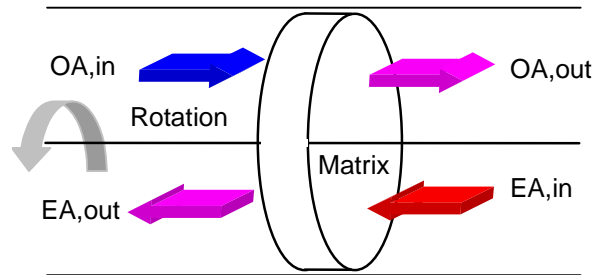

- Counter-flow Heat exchanger with a correction factor

$$\varepsilon = C \frac{1 - e^{(-NTU (1-C_r))}}{1 - C_r e^{(-NTU (1-C_r))}}$$

c: correction factor

Note: one effectiveness for Temperature, one for humidity




- What do you need?
 - 2 experimental data points
 - catalog data
 - ARI tests (Air Conditioning and Refrigeration Institute)
 - Not “just” a curve fit (c is adapted for unbalanced flows)


- Limitations
 - Not usable to design an enthalpy exchanger
 - Flow rates close to experimental data range
 - Implicit assumption that UA is constant (laminar flow rate at all times)
 - Sufficient rotation speed
 - Recommended rotation speed for enthalpy exchangers
 - Lower speed would significantly decrease ϵ



- 2 problems
 - When cooling is required with $T_{amb} < T_{bldg}$
 - “Economizer” mode (bypass the enthalpy exchanger)
 - Take humidity into account!
 - Freezing
 - Preheating or reduced effectiveness (choice in the model)
- Extra inputs for economizer mode
 - Building “heating point”
 - Building “balance point”
 (see manual and proforma for details!)
- Other output: pressure drop
 - based on 2 data points



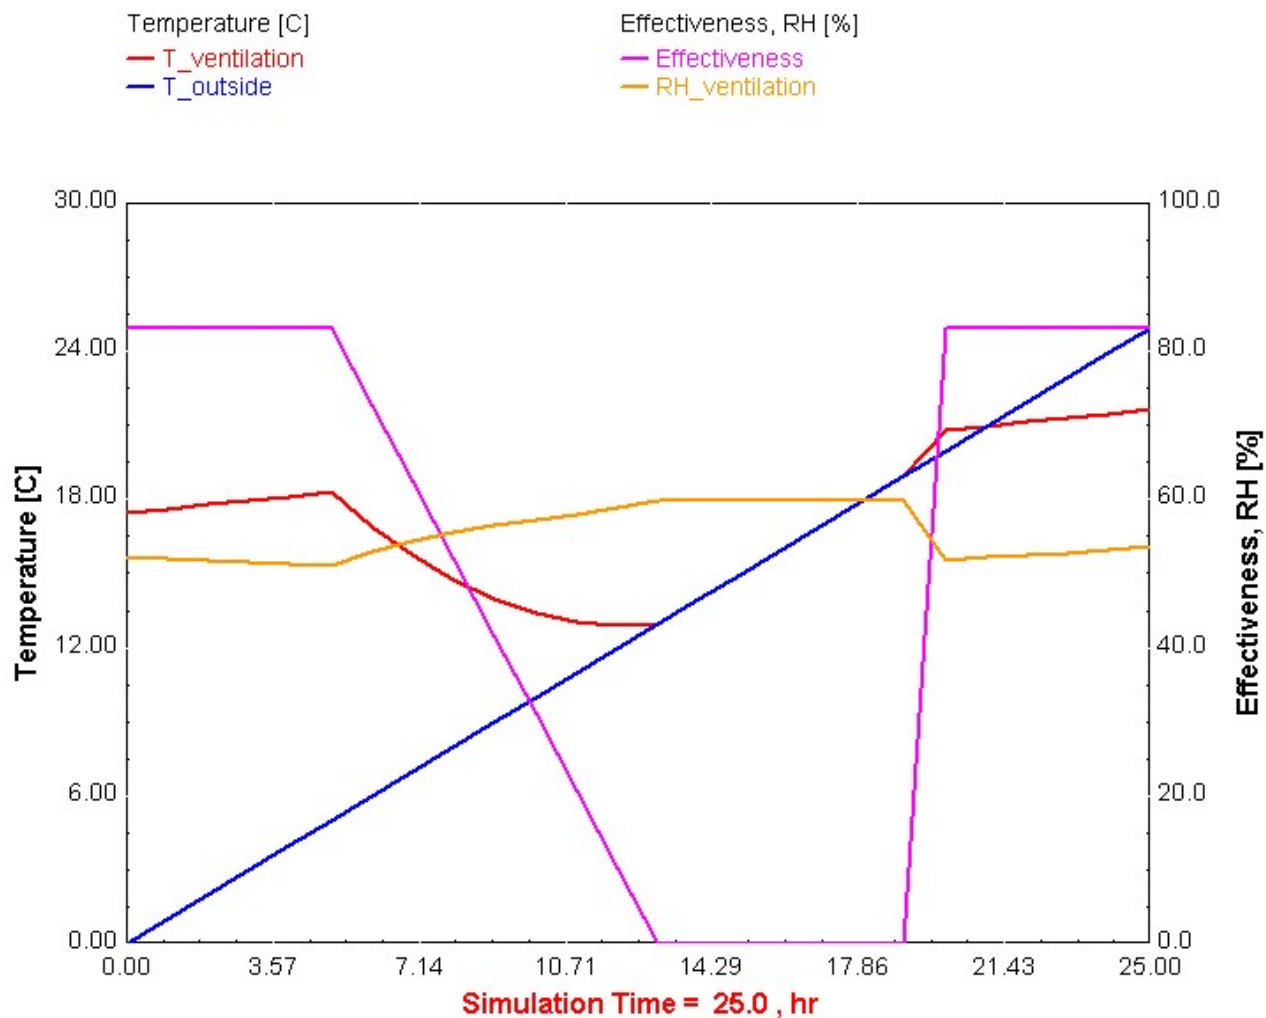

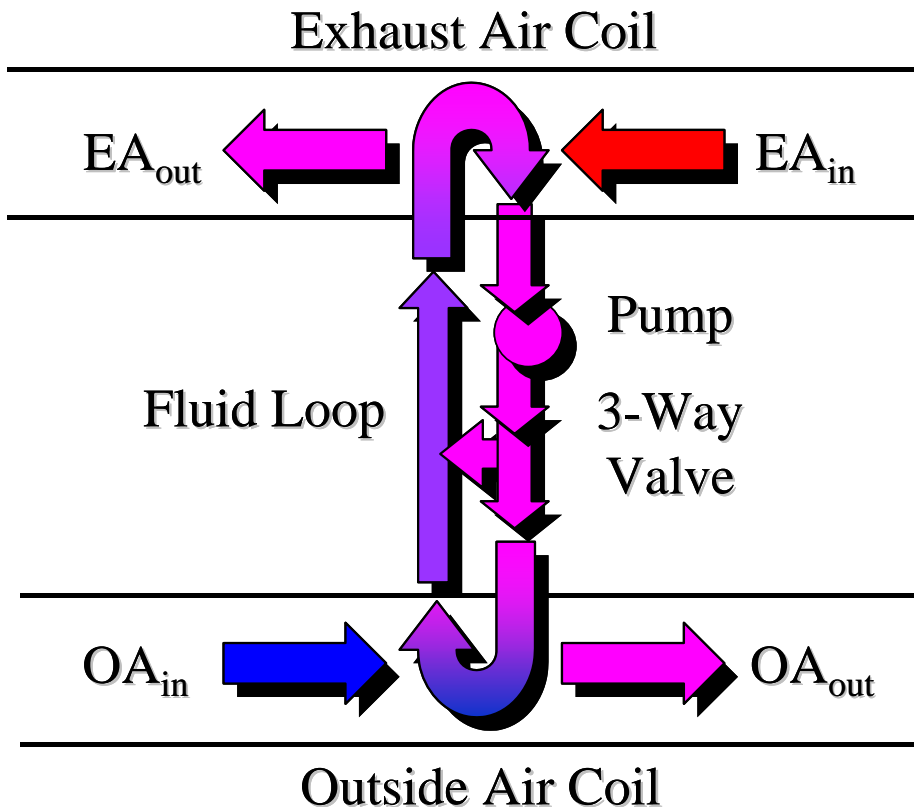



- Heat exchange only
 - Preheating (wintertime)
 - Precooling (summertime)
 - Reheat (summertime)
- Replaces long air ducts by long water pipes (more efficient)
- 2 Heating / Cooling coils
- Control variables
 - Water flow rate (pump or bypass)
 - Air bypass

- Effectiveness approach


$$\varepsilon_o = \frac{1}{\frac{\dot{C}_{\min}}{\dot{C}_{\min,1}\varepsilon_1} + \frac{\dot{C}_{\min}}{\dot{C}_{\min,2}\varepsilon_2} + \frac{\dot{C}_{\min}}{\dot{C}_{liq}}}$$
- $\varepsilon_1, \varepsilon_2$: effectiveness of each coil
- Model data:
 - Geometrical coil data
 - Design conditions
- The model
 - Computes heat exchange coefficients (air / liquid)
 - Takes condensation into account: wet coil operation
 - Computes Pump and fan power (needs 1 data point)



- Economizer mode and frost protection
 - Similar to Enthalpy exchanger controls


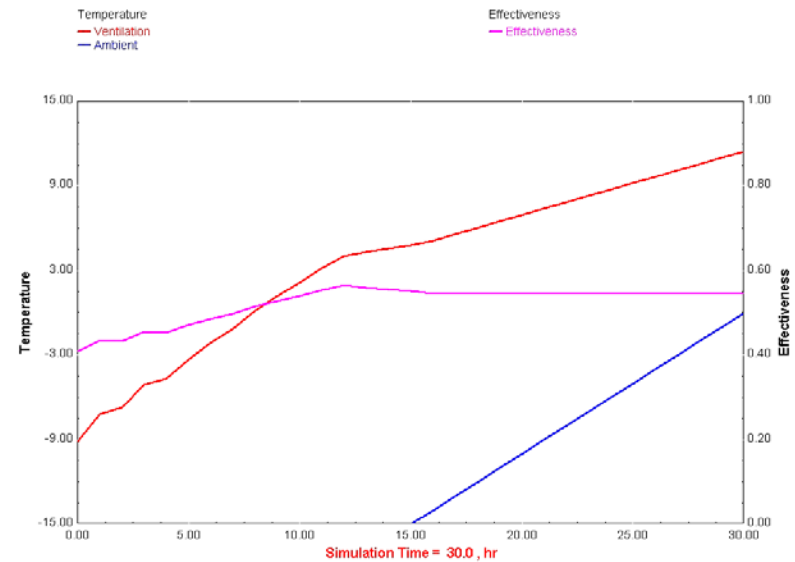
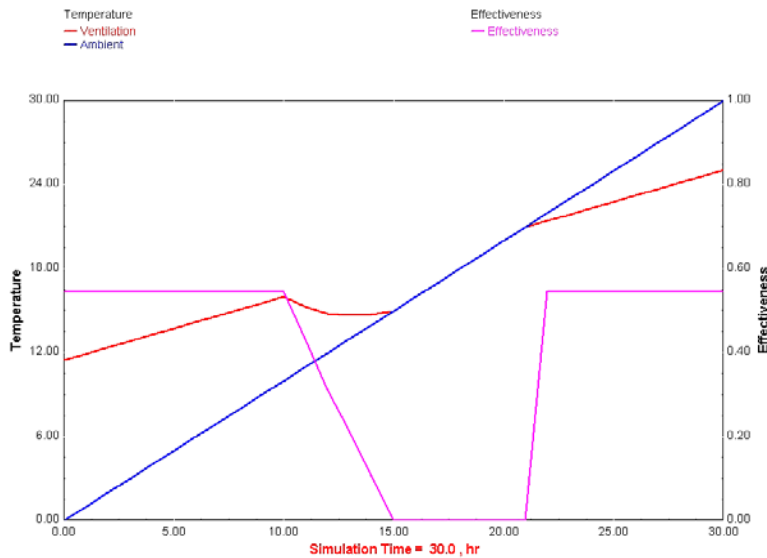


- Madison zoo

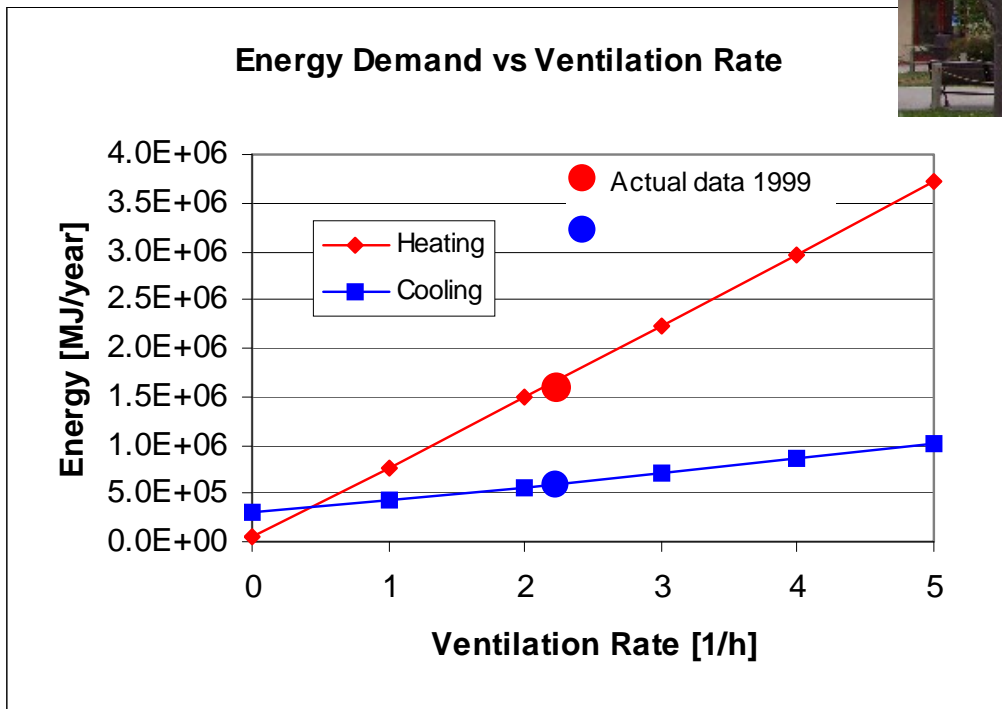

- High ventilation rate
- 4 zones
- Unusual internal gains (sensible and latent)



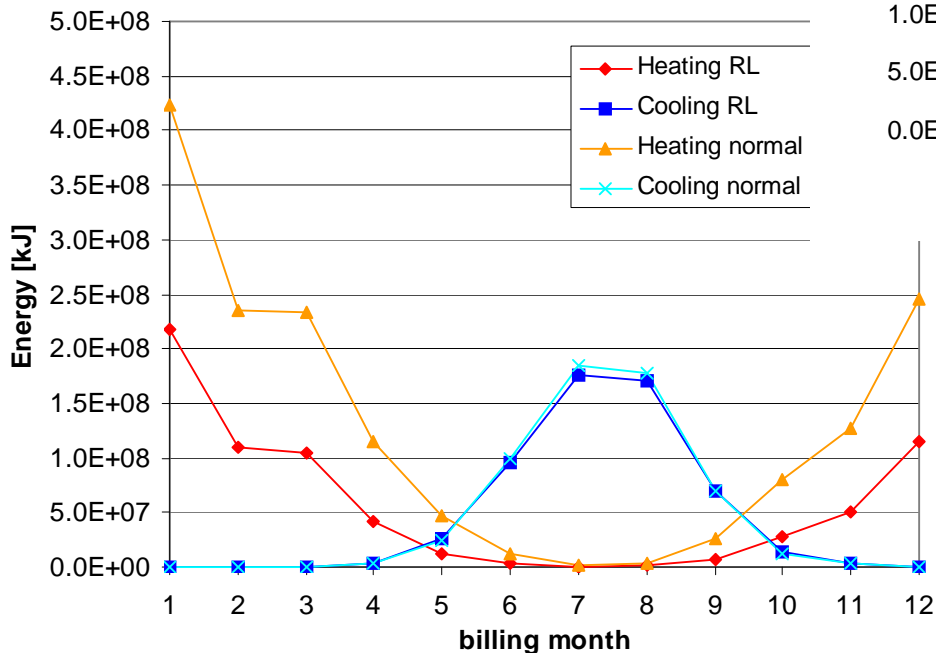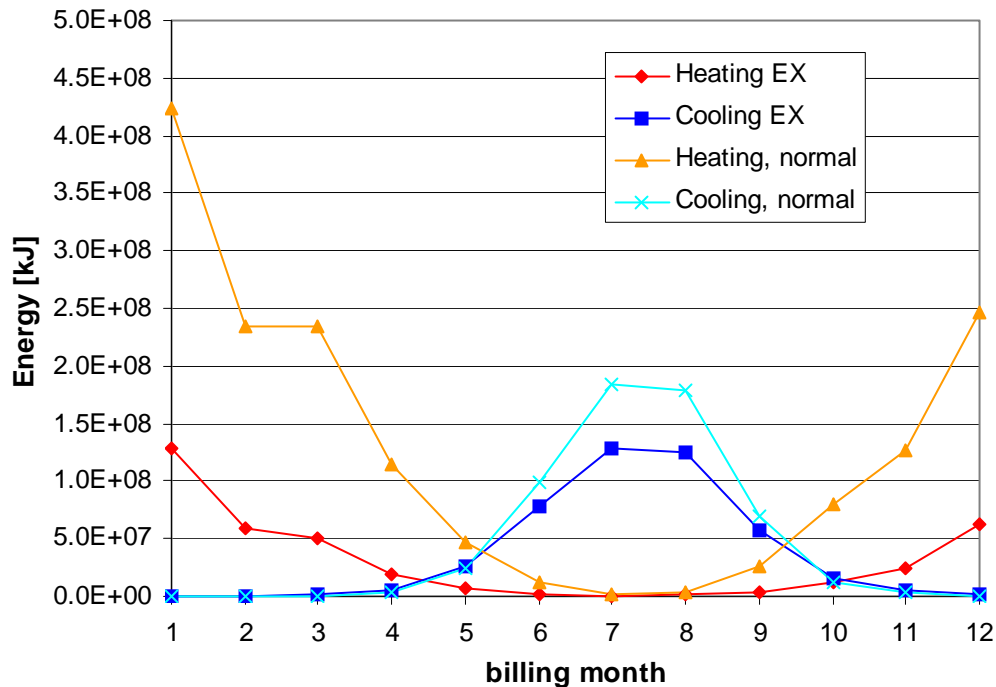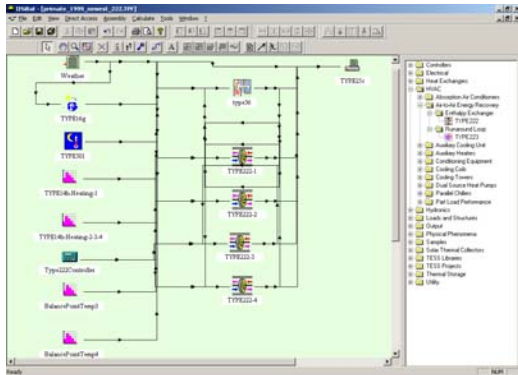

Savings

EEEx: 75% Heat, 25% Cooling

RL: 55% Heat, 5% Cooling

EEEx also reduces Peak Power from 65% (H) and 45%(C)



- 2 Types are included in TRNLIB
 - Available on the website: <http://sel.me.wisc.edu/trnsys>
(Go to TRNLIB)
 - Code, Manual + IISiBat Proforma
- More details?
 - Sebastian Freund's MS (available on the SEL website)
<http://sel.me.wisc.edu/> (Go to "Publications")



TRNSYS 

