



## IEB Working Paper 2016/30

WIND, STORAGE, INTERCONNECTION AND THE COST OF ELECTRICITY

**Valeria Di Cosmo, Laura Malaguzzi Valeri**

**Energy Sustainability**

# IEB Working Paper

**WIND, STORAGE, INTERCONNECTION  
AND THE COST OF ELECTRICITY**

Valeria Di Cosmo, Laura Malaguzzi Valeri

The Barcelona Institute of Economics (IEB) is a research centre at the University of Barcelona (UB) which specializes in the field of applied economics. The IEB is a foundation funded by the following institutions: Applus, Abertis, Ajuntament de Barcelona, Diputació de Barcelona, Gas Natural, La Caixa and Universitat de Barcelona.

Within the IEB framework, the **Chair of Energy Sustainability** promotes research into the production, supply and use of the energy needed to maintain social welfare and development, placing special emphasis on economic, environmental and social aspects. There are three main research areas of interest within the program: energy sustainability, competition and consumers, and energy firms. The energy sustainability research area covers topics as energy efficiency, CO2 capture and storage, R+D in energy, green certificate markets, smart grids and meters, green energy and biofuels. The competition and consumers area is oriented to research on wholesale markets, retail markets, regulation, competition and consumers. The research area on energy firms is devoted to the analysis of business strategies, social and corporative responsibility, and industrial organization. Disseminating research outputs to a broad audience is an important objective of the program, whose results must be relevant both at national and international level.

The **Chair of Energy Sustainability of the University of Barcelona-IEB** is funded by the following enterprises ACS, CEPSA, CLH, Enagas, Endesa, FCC Energia, HC Energia, Gas Natural Fenosa, and Repsol) through FUNSEAM (Foundation for Energy and Environmental Sustainability).

Postal Address:

Chair in Energy Sustainability  
Institut d'Economia de Barcelona  
Facultat d'Economia i Empresa  
Universitat de Barcelona  
C/John M Keynes, 1-11  
(08034) Barcelona, Spain  
Tel.: + 34 93 403 46 46  
[ieb@ub.edu](mailto:ieb@ub.edu)  
<http://www.ieb.ub.edu>

The IEB working papers represent ongoing research that is circulated to encourage discussion and has not undergone a peer review process. Any opinions expressed here are those of the author(s) and not those of IEB.

**WIND, STORAGE, INTERCONNECTION  
AND THE COST OF ELECTRICITY \***

Valeria Di Cosmo, Laura Malaguzzi Valeri

**ABSTRACT:** We evaluate how increasing wind generation affects wholesale electricity prices, balancing payments and the cost of subsidies using the Irish Single Electricity Market (SEM) as a test system, with hourly data from 1 January 2008 to 28 August 2012. We measure the effect of wind on the marginal cost of generating electricity using a system of seemingly unrelated regressions (SUR) where the regressions are the 24 hours of the day. Wind has a negative impact on the system marginal price. In particular, every MWh increase in wind generation (equal to about 0.2% of the average wind generation in our sample) leads to a decrease of the system marginal price of €0.018/MWh, or about 0.3% of its average value in our sample. Using time series models we show that wind generation increases balancing payments, as do the forecast errors of demand and wind. Lack of storage significantly increases the impact of wind on balancing payments whereas the lack of interconnection has no effect. Overall, wind decreases costs through its effect on the electricity price more than it increases constraint payments, even when storage is on outage. The effect of wind remains positive after including the subsidies given to wind generation.

JEL Codes: L94, Q42

Keywords: Wind generation, constraints, storage, interconnection, wind subsidies

Valeria Di Cosmo  
Fondazione Enrico Mattei  
Milano, Italy  
E-mail: [valeria.dicosmo@feem.it](mailto:valeria.dicosmo@feem.it)

Laura Malaguzzi Valeri  
Economic and Social Research Institute  
Dublin, Ireland

---

\* This project has received funding from the European Union's Horizon 2020 research and innovation programme under the Marie Skłodowska-Curie grant agreement No 703382, and from Science Foundation Ireland under Grant No. 09/SRC/E1780. The opinions, findings and conclusions or recommendations expressed in this material are those of the authors and do not necessarily reflect the views of the Science Foundation Ireland. Funding from the ESRI Energy Policy Research Centre is gratefully acknowledged.

# 1 Introduction

As the share of renewable electricity increases worldwide, it will have a growing impact on electricity system prices and costs. The direct effect of renewables on wholesale prices (the merit order effect) is typically negative as they provide generation at very low or zero marginal cost and displace more costly generation. Renewables can also decrease prices indirectly by lowering market power in systems where generators bid strategically, as highlighted by Browne et al. (2015) and Ben-Moshe and Rubin (2015). At the same time, integrating generation that is intermittent and difficult to predict has costs. Plants with predictable generation have to be ready for back up if there is a sudden drop in wind or solar production (Currie et al., 2006) and renewables do not easily provide frequency and voltage control (Romero Martinez and Hughes, 2015; EirGrid and SONI, 2014).

This paper first contributes to the literature evaluating the effect of wind on spot prices. Second, it adds to the limited literature analysing the effect of wind on balancing costs, defined as the costs associated with balancing electricity supply with demand in real time. Third, it evaluates the impact of renewable support on the final cost of electricity to consumers. Finally, it addresses the impact of storage and interconnection on the effect of wind, taking advantage of a natural experiment.

The literature on the effect of renewables on electricity prices is vast and growing. Earlier papers relied on simulations (see e.g. Traber and Kemfert, 2011; Holttinen et al., 2011; Garcia-Gonzalez et al., 2008; Rehman et al., 2015). Since renewable penetration has grown, papers have started measuring the effect of renewables using historical data (Würzburg et al., 2013; Cludius et al., 2014, for Germany and Austria) (Gelabert et al., 2011; Gil et al., 2012, for Spain) (Forrest and MacGill, 2013, for Australia). These studies use econometric approaches to determine the effect of renewables on electricity prices but do not analyse balancing markets.

As highlighted by Ciarreta et al. (2014) for the Spanish market and by Munksgaard and Morthorst (2008) for the Danish market, feed-in tariffs can significantly impact final consumers' bills, making wind generation on net costly to consumers. Neither of these studies include balancing costs in their analysis.

Several papers describe how changes in market design could decrease balancing costs by incentivising the renewable sources to minimize their forecast errors. Holttinen (2005) analysed the Nord Pool balancing market, arguing that wind should be balance responsible. Swinand and Godel (2012) and Bueno-Lorenzo et al. (2013) study how payments could be imposed on renewable generators to reduce their forecast errors. Batalla-Bejerano and Trujillo-Baute (2016) estimate the impact of renewable energy on the adjustment service costs (that include both balancing costs and capacity payments). The authors find a positive and significant impact of renewable generation (solar and wind) on these costs for Spain.

We study the Irish Single Electricity Market (SEM), using hourly data from 1 January 2008 to 28 August 2012. The dataset for the island of Ireland is particularly well-suited to

our analysis. First, extensive data on the system are available from the beginning of the SEM in November 2007. The compulsory nature of the SEM means that every generator with a capacity larger than 10MW has to offer electricity on the market. Similarly, all buyers have to buy from the pool. We are therefore able to base our analysis on complete system data, which is not possible for jurisdictions where generators and consumers engage in bilateral contracts outside of the main market. Second, the island has limited interconnection with other systems allowing us to identify the effect of wind more easily. Third, it has experienced a large increase in wind capacity, more than doubling from about 900MW at the end of 2007 to almost 2100MW at the end of August 2012, the period chosen for this analysis. Finally, unexpected and persistent outages at the main storage plant in the SEM and at the interconnector between the SEM and BETTA provide natural experiments for the evaluation of the effect of storage and interconnection on system prices both directly and via their interaction with wind generation.

As expected, we find a negative correlation between the system marginal price (SMP) and wind generation. When large-scale storage is not available the marginal effect of wind on the spot price increases at night. When interconnection is not available the effect of wind decreases for a few hours of the day.

On the other hand wind generation is positively correlated with the constraint payments provided to generators, our measure of balancing costs. The effect of wind on constraint payments increases when storage is not available. As expected, forecast errors of both demand and wind increase constraint payments.

Our results show that the overall effect of wind on system prices is positive, as its dampening effect on marginal prices is stronger than the effect on constraint payments and the costs associated to the subsidies given to wind generators. When storage is significantly reduced, the cost of wind on constraint payments more than doubles, but the net effect of wind generation stays positive. The existence (or absence) of interconnection has a much weaker effect on wind's propensity to affect system costs.

The rest of the paper is organised as follows. Section 2 depicts the SEM in more detail. Section 3 describes the data. Section 4 explains our methodology and describes the estimation of the effect of wind on the system marginal price. Section 5 presents the results for constraint payments. Section 6 describes the subsidies accorded to wind and estimates their size while Section 7 concludes.

## 2 The SEM

The Irish electricity market encompasses the electricity systems of both the Republic of Ireland and Northern Ireland, making it a cross-jurisdiction, cross-currency system.

The contribution of renewable electricity to overall electricity demand was about 20% in 2013 for the Republic of Ireland (Dineen et al., 2015) and 19% for Northern Ireland in 2014 (Department of Enterprise Trade and Investment, 2015). Renewable penetration in electricity generation is expected to reach 40% by 2020 if the two jurisdictions are to

meet their renewable energy targets under the European Directive (2009/28/EC) (DETI, 2010; DCENR, 2012).<sup>1</sup> The electricity mix in the SEM changed between 2008 to 2012. Installed wind capacity increased from about 12.5% in 2008 to 18.5% of total generation capacity (excluding interconnection capacity). Combined-Cycle Gas Turbine generators (CCGTs) increased their share of capacity from 32.8% in 2008 to 37.7% in 2012. Capacity of open-cycle gas turbines, natural gas combustion turbines, distillate and oil was 32.6% of the total in 2008, decreasing to 24.7% in 2012. Coal and peat were 14.5% of the total capacity installed in 2012, down from 16.9% in 2008. Hydro remained constant during the period at 3% of total capacity.<sup>2</sup>

The SEM is a compulsory pool system, where plants bid in the day-ahead market and are called to generate on the basis of the merit order: plants with lower bids are called to generate ahead of more expensive plants until total generation equals total demand. Each plant's bid reflects its short run marginal costs and includes the cost of fuel and carbon dioxide emission permits needed to generate a megawatt-hour (MWh) of electricity, in addition to operation costs. Generators submit up to 10 price-quantity pairs that apply to all 48 half hours during a 24-hour period, but can change every 24 hours. The System Marginal Price (SMP) reflects the bid of the marginal plant, or the cost of generating the most expensive unit of electricity needed to meet demand.

The regulation authority monitors the market through the market monitoring unit. Power plants are required to bid their short run marginal cost in line with the bidding code of practice available from the regulator's website (<http://www.semcommittee.com>). As an additional check of market power there is a system of future contracts in the form of contracts for differences (CfD). Existing evidence suggests that this regulation is successful, leading to limited market power (Gorecki, 2013; Market Monitoring Unit, 2009; Walsh et al., 2016).

In addition to the short-run payments, power plants also receive capacity payments, designed to cover additional capital costs.

It's useful to highlight some of the characteristics of the SEM SMP:

- It has never been censored from above, due to the upper bound for the price being set high (at €1000/MWh) and firms' bidding behavior being regulated.
- There are no negative prices, despite negative prices being theoretically possible. At the moment wind companies are price takers and do not therefore bid a price in the system. Since 2011 they have priority dispatch, in line with EU rules.<sup>3</sup>

---

<sup>1</sup>The Directive is available at (<http://eur-lex.europa.eu/LexUriServ/LexUriServ.do?uri=OJ:L:2009:140:0016:0062:en:PDF>).

<sup>2</sup>Information elaborated from SONI and EirGrid reports, including SONI (2008), EirGrid (2008, 2009); EirGrid and SONI (2010, 2011, 2013b).

<sup>3</sup>The SEM has always included wind generation when available since it dispatches plants based on their marginal cost SEM (2011). Priority dispatch of renewables is addressed in article 16 of EU Directive 2009/28/EC and was transposed into law in the Republic of Ireland by Statutory Instrument 147 of 2011 and in Northern Ireland by Statutory Rule 385 of 2012.

- Electricity consumers do not bid directly in the market, except for a few virtual plants that can bid in decreases of demand. The SMP is calculated on the basis of the supply curve (based on the merit order of day-ahead bids from generators) and actual demand in every period. The SMP is finalised ex post, after actual levels of demand are verified.
- All bidders and all consumers (represented by suppliers) obtain and pay the same uniform wholesale price of electricity in every period.
- In the short run electricity demand is not elastic to price, given the limited bidding on the demand side.
- During our period of analysis the Transmission System Operators (TSO) curtailed wind if it exceeded 50% of demand at any given time, to ensure system stability, i.e. voltage and frequency control.<sup>4</sup>

Table 1: SEM: changes in Bidding Code of Practice, 2007-2012

| Date         | Decision  | Notes   | Reference                       |
|--------------|---|---|---------------------------------|
| Nov. 2007    | SEM starts  |   |                                 |
| 12 Jun. 2008 | How to bid  | Start-up costs should include cycling; incremental costs should not. Bids can deviate from spot price for 'good reason' (e.g. use it or lose it). | SEM-08-069                      |
| 18 Dec. 2008 | How to include Transmission and Combined Loss Adj. Factor (TLAF and CLAF) into bids | Generators to include loss factors in price, no-load and start-up costs.  | SEM-11-010; SEM-11-010a         |
| 10 Feb. 2009 | Start-up costs  | Should not depend on plant status (off versus on).  | SEM-09-014                      |
| 8 Oct. 2010  | Exclusion of carbon levy costs from bids  | Gov. tries to recover windfall gains from free allocation of $CO_2$ permits.  | Modification of Electricity Act |
| 23 Feb. 2012 | Supreme Court ruling on carbon levy costs   | Generators can include levy costs in bids.  |                                 |
| 1 Mar. 2012  | Regulators allow carbon levy costs in bids  |   | SEM-12-015                      |
| May 2012     | Modification of Electricity Act overturned  | Carbon levy costs eliminated from bids.   |                                 |

Bidding rules in the SEM have been modified and clarified over time. Table 1 summarises the main changes to the Bidding Code of Practice. In 2010 the government tried to recover windfall gains to thermal generators that came from the free allocation of carbon dioxide permits. It instituted a 'carbon levy' and stated that it could not be included in bids and therefore passed on to consumers. In 2012 the Supreme Court ruled that

<sup>4</sup>Since our study period, the system has been accommodating more wind. During the 2014-2015 winter, wind has generated up to 63% of instantaneous demand, see: [http://www.eirgrid.com/media/All-Island-Wind-and-Fuel-Mix-Report-December-2014\(2\).pdf](http://www.eirgrid.com/media/All-Island-Wind-and-Fuel-Mix-Report-December-2014(2).pdf).

the carbon levy could be passed onto consumers, causing its repeal within a few months. During those months generators were allowed to include the cost of carbon twice in their bids, once for the European Trading System and once for the carbon levy.

We highlight these changes since they may have systematically affected bidding behaviour and therefore market prices although, as discussed later, we find no structural breaks associated with these dates.

### 3 Data

We build a dataset of hourly information for electricity generation, demand, plant availability and daily data on fuel and carbon costs from 1 January 2008 to 28 August 2012.

Most of the data on the SEM is downloaded directly from the system operator, SEMO, with the exception of wind generation and electricity demand. Quarter-hour wind generation for the Republic of Ireland comes from EirGrid and half-hour wind generation for Northern Ireland comes from SONI, the system operators of the Republic of Ireland and Northern Ireland respectively as these sources include both wind farms registered with the SEM and generation estimates for smaller wind farms not registered with the SEM. Unregistered wind accounts for 20% to 25% of total wind generation, during the 2008-2012 period.<sup>5</sup> We aggregate the series to hourly levels. We also take demand data from EirGrid and SONI to obtain all-island demand, gross of transmission and distribution losses. We think it is a better measure of demand than the load variable provided by SEMO. The SEMO load variable is net of imports and exports to the system, nets demand by the amount of electricity produced by wind that is not registered directly with SEMO and includes electricity used by pumped storage.

We also measure wind and demand forecast errors, as they affect constraint payments. We define the forecast errors as actual levels minus the day-ahead expected value. The day-ahead expected value is only available from SEMO and therefore refers to wind farms registered with SEMO and the SEMO definition of load. This is not a big problem for the wind forecast error, as the correlation between the wind reported in SEMO and the series built from EirGrid and SONI data is 0.996. The day-ahead information for wind is available from 6 a.m. on 1 January 2009, leading to 8766 fewer observations. Over the years there are another approximately 200 observations missing, for a final 31,843 observations. The day-ahead information on load is available from 1 November 2009 at 6 a.m., leading to 16,036 fewer observations for the demand forecast error. The correlation between SEMO's load variable and the demand built using EirGrid and SONI information is 0.986 from 1 November 2009 to 28 August 2012. While still high, the differences could be systematic, leading to estimate differences (see Di Cosmo and Malaguzzi Valeri, 2014). We limit this concern by including forecast errors (i.e. changes in the variables) rather than forecasts in levels.

---

<sup>5</sup>We obtain this estimate by comparing wind generation of the wind farms registered with SEMO with total wind generation estimated by EirGrid and SONI.



For all series we have to decide how to address the time changes associated with Daylight Saving Time. For the spring change in time we set the values for 1 a.m. equal to their level the prior hour. For the autumn, we eliminate the additional hour that occurs when moving the clock back.

Information on prices comes from Datastream. Specifically, coal prices are represented by the API2 price traded on the London market, converted in euro using daily exchange rates also from Datastream. Gas prices are from the UK hub (NBP). Carbon dioxide prices are spot prices, taken from BlueNext (www.bluenext.eu). In cases where Bluenext values are missing, they are supplemented with carbon spot prices from Reuters. All information on prices is on a daily basis. Since fuel and carbon dioxide permits are not traded on weekends, we set their weekend value equal to the previous Friday's level.

Table 2: Summary statistics, 1 Jan 2008- 28 Aug 2012

| Variable                                    | Obs   | Mean     | Std. Dev. | Min       | Max       |
|---|-------|----------|-----------|-----------|-----------|
| SMP (€/MWh)                                 | 40842 | 60.18    | 32.85     | 0.00      | 695.79    |
| <i>Demand</i> (MW)                          | 40842 | 4060.56  | 885.12    | 2163.78   | 6773.67   |
| <i>Wind</i> (MW)                            | 40842 | 447.43   | 370.15    | 1.68      | 1833.22   |
| <i>Cap.Margin</i>                           | 40842 | 3033.89  | 914.43    | 228.78    | 5716.73   |
| <i>Gas</i> <sub><i>t</i>-24</sub> (€/MWh)   | 40824 | 19.65    | 5.81      | 4.57      | 31.78     |
| <i>Coal</i> <sub><i>t</i>-24</sub> (€/MWh)  | 40824 | 4.36     | 1.18      | 2.48      | 8.11      |
| <i>Brent</i> <sub><i>t</i>-24</sub> (€/MWh) | 40824 | 42.47    | 10.88     | 17.12     | 62.14     |
| Constraint payments (€)                     | 40820 | 19030.94 | 13722.37  | -37482.20 | 210321.00 |
| <i>Wind</i> <sub><i>FE</i></sub> (MW)       | 31844 | -168.52  | 168.82    | -1081.34  | 282.19    |
| <i>Demand</i> <sub><i>FE</i></sub> (MW)     | 24689 | -167.60  | 193.53    | -1309.60  | 732.96    |

Table 2 reports summary statistics for our dataset, based on hourly data. Wind generation represents 11% of demand on average in the data.

We check the stationarity of the price series. If the SMP series were non-stationary, the estimated coefficients in our analysis could be picking up a spurious relation between the SMP and other regressors, due to a potentially common trend over time. In our case, the Augmented Dickey-Fuller (ADF) test rejects the hypothesis of unit root in our endogenous variable, the SMP, at the 1% level.<sup>6</sup> The Im-Pesaran-Shin test for panel data (Im et al. 2003) rejects the null hypothesis of unit root in our endogenous variables at the 1% level, confirming that the series is stationary.<sup>7</sup> We therefore analyse the relation between the system marginal price and its possible determinants in levels.


Fig.1 shows how the SMP and the main fuel prices used in electricity generation change over time. The SMP series displays a downturn at the beginning of 2009, following the collapse of oil (and gas) prices in the summer of 2008. However, neither the Clemente et al. (1998) test nor the Chow test find evidence of structural breaks in the SMP.<sup>8</sup>

<sup>6</sup>The associated test statistic is equal to -101.245, with the 1% critical value equal to -3.430.

<sup>7</sup>The  $\chi^2$  associated to the statistic is equal to -23.46, with a test statistic equal to -1.920.

<sup>8</sup>The Clemente and Rao Test rejects the presence of structural break with a t-statistic equal to -32.607,

Figure 1: *System marginal price and generation fuels, January 2008-August 2012, €/MWh*

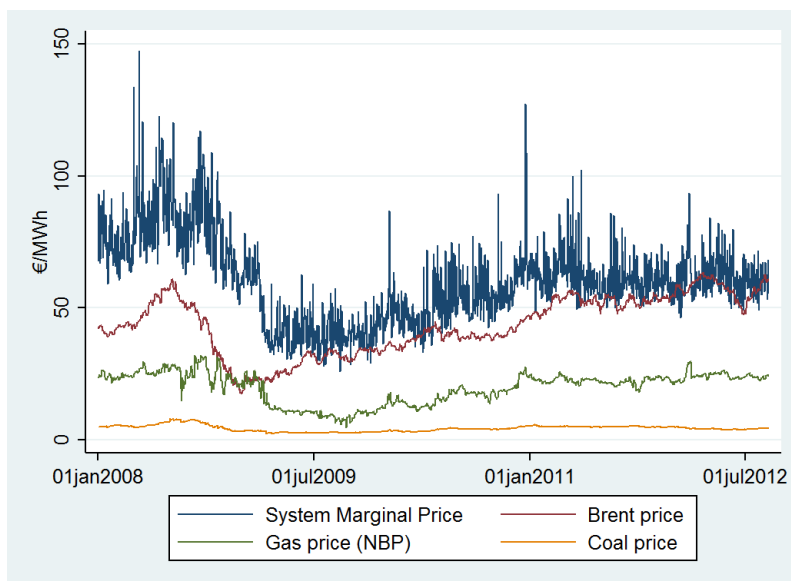

Source: SMP - SEMO (hourly); fuel prices lagged 24 hours: Bloomberg

The SMP follows the price of natural gas. Natural gas plants, or more specifically Combined Cycle Gas Turbine plants (CCGT), are frequently the marginal plant, therefore setting the SMP. Differences between SMP and natural gas prices are due to losses during conversion of energy, transport, operation and maintenance costs, the cost of carbon emission permits and the cost of turning plants on and off.


We also test potential breaks in the SMP series for the dates associated with SEM rule changes, highlights in Table 1, but the Clemente and Rao tests for structural breaks show no effect for these dates.

Figure 2 shows how prices and demand vary by hour over the average week. The largest variation is by time of day, although weekends display lower demand and lower prices.

---

with a critical value equal to -4.270. The Chow test verifies that all the variables in our model do not change significantly before and after the potential structural break. We also investigated whether single hours have structural breaks. The Chow tests rejected this hypothesis for all the hours. Results of the tests are available from the authors upon request.

Figure 2: *SMP and demand by day of week and hour of day, 1 Jan 2008- 28 Aug 2012*

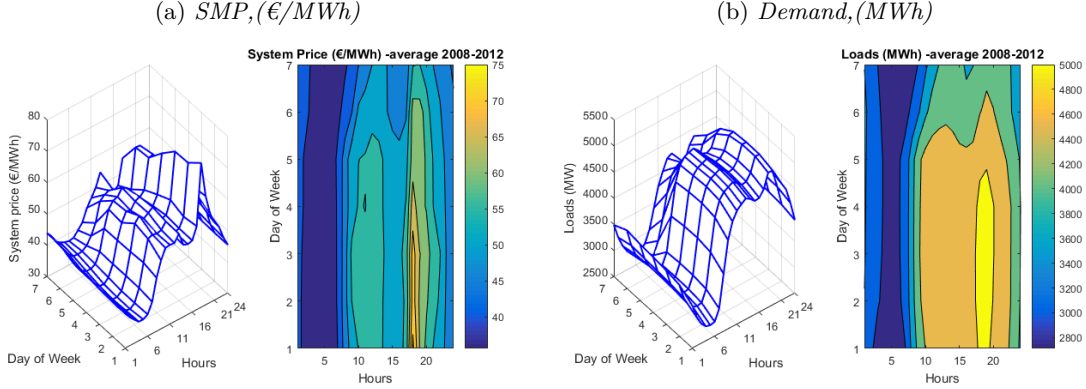

## 4 System marginal price: model and results

### 4.1 Estimation

Wind generates electricity at a low marginal price, since wind itself is free. As the amount of wind generation increases, we expect it to dampen the system marginal price. In this section we measure the extent of this effect and explore if it varies nonlinearly with wind.

Generators bid for blocks of 24 hours. Härdle and Trück (2010), Huisman et al. (2007), Guthrie and Videbeck (2007) and Weron (2008) show that in an electricity system with day-ahead bidding, hourly prices can be considered as separate contracts stipulated during the same day. Maciejowska (2014) highlights the importance of allowing flexibility in the specification of the spot price response to fuel price shocks, since the effect varies during peak and off-peak hours. Considering the hourly prices separately allows a flexible specification, where the impact of demand, wind and the other relevant variables can vary during the different hours of the day. This does not mean that prices in one hour can be analysed independently from those in adjacent hours as prices across hours will be correlated. We estimate the SMP regression as a system of seemingly unrelated regressions (SUR), as proposed by Zellner (1962), with one equation per hour of the day and residuals correlated across the hours of the day.

We identify the effect of wind generation  $W$  on prices  $P$  by taking advantage of the hourly information on wind generation and SMP. We rely on the high variability of wind, demand and net imports, which jointly determine how much electricity is generated in each hour. We assume that demand  $L$  is exogenous, which is reasonable in this market where demand is highly inelastic to price (in part because retail prices do not vary at high frequency) and demand varies substantially during the day. This implies that in practice we do not have to worry about simultaneity problems.

We do however have to represent supply-side effects carefully. Some supply-side variables affect the marginal price directly, for example the fuel prices. We include the price

of natural gas and the cost of  $CO_2$  emission permits, represented by  $F^j$ , where  $j$  indexes the type of price. Other variables affect the price through the merit order, for example the level of plant outages and net imports.

Net imports ( $I$ ) can be considered exogenous in our analysis: transmission rights to trade power along the Moyle interconnector are acquired ahead of time during our period of analysis. Moreover, McInerney and Bunn (2013) show that interconnector flows do not respond to contemporaneous electricity prices. The capacity margin  $mar$  measures the effect of both forced and unforced outages. It is defined as the difference between available capacity in every period (excluding wind, which is not predictable) and demand. The more plants are available relative to demand (the larger the capacity margin  $mar$ ), the lower the system price, as cheaper plants will enter the merit order. We also measure specific outages. During the study period the pumped storage plant, Turlough Hill, and the interconnector between Northern Ireland and Scotland, Moyle, were on extended outages, especially in 2011. Pumped storage is a very flexible generation technology that does not actively bid in the market and is often used to balance the system and might be used to compensate for wind fluctuations (Meibom et al., 2011). Without pumped storage, the system operator has to rely more on other plants to balance supply with demand, potentially changing wind's effect on the SMP. We include dummies to account for the outages of the Moyle interconnector and Turlough Hill and their interaction with wind.

The dummy variables  $D^s$  account for several factors. For three months in 2012 (from the 27th of February to the 25th of May) generators were allowed to double the level of  $CO_2$  prices in their bids (for details see Table 1). We control for the higher prices during this period by including a  $CO_2fee$  dummy variable. Finally, the long period of our analysis (4 years) means that we have to control for other aspects of the market that change over time, including the commissioning or decommissioning of plants and regulatory changes, although on the latter see the discussion of Table 1.

For every hour  $i$ , we wish to estimate the following equation:

$$P_{i,d} = \alpha_i + \sum_h^3 [\beta_i^h L_{i,d}^h + \gamma_i^h W_{i,d}^h + \theta_i^h mar_{i,d}] + \sum_j \zeta_i^j F_{i,d-1}^j + \sum_s \kappa^s D_i^s + \chi I_{i,d} + \epsilon_{i,d} \quad (1)$$

We are not interested in the coefficients for the month-year dummy variables, so we transform Eq.(1) by taking the difference of the variables with respect to their month-year mean. This allows us to estimate the following system of equations (where the constant has also been differenced out), where each variable is defined as the difference of its levels from its month-year mean:

$$\begin{cases}
P_{1,d} = \sum_h^3 [\beta_1^h L_{1,d}^h + \gamma_1^h W_{1,d}^h + \theta_1^h mar_{1,d}^h] + \sum_j \zeta_1^j F_{1,d-1}^j + \sum_s \kappa^s D_1^s + \chi I_{1,d} + \epsilon_{1,d} \\
\dots \\
P_{i,d} = \sum_h^3 [\beta_i^h L_{i,d}^h + \gamma_i^h W_{i,d}^h + \theta_i^h mar_{i,d}^h] + \sum_j \zeta_i^j F_{i,d-1}^j + \sum_s \kappa^s D_i^s + \chi I_{i,d} + \epsilon_{i,d} \\
\dots \\
P_{n,d} = \sum_h^3 [\beta_n^h L_{n,d}^h + \gamma_n^h W_{n,d}^h + \theta_n^h mar_{n,d}^h] + \sum_j \zeta_n^j F_{n,d-1}^j + \sum_s \kappa^s D_n^s + \chi I_{n,d} + \epsilon_{n,d}
\end{cases} \quad (2)$$

where:  $corr(\epsilon_{i,d}, \epsilon_{-i,d}) \neq 0$ ;  $corr(\epsilon_{i,d}, \epsilon_{i,d-1}) \neq 0$ ;  $\epsilon \sim N(\mu, \sigma^2 V)$  and  $V$  is the variance-covariance matrix.

There are  $n = 24$  equations in the system, one for every hour of the day, with  $i$  indexing hours and  $d$  days. We allow wind, demand and capacity margin to have a flexible specification by including them in levels, squared and cubed ( $h = 1-3$ ). We expect the system price to be affected more than proportionally by changes in demand when demand is already high, because significantly more expensive plants may enter the merit order. The opposite holds for high wind levels, as we expect higher levels of wind to affect the system price less.

Cross-sectional dependence is a problem in macro panels with long time series (Baltagi, 2008). Ignoring possible correlations of regression disturbances over time and between subjects can lead to biased coefficients. We test for the presence of heteroscedasticity in the residuals in Eq. (2) with the Breusch-Pagan test, a Lagrange Multiplier (LM) test. We reject the null hypothesis of no heteroscedasticity between the residuals, with a  $\chi^2$  equal to 21114 and an associated p-value of 0. We therefore use robust standard errors.

We follow the methodology proposed by Zellner (1962) to account for the correlation between the residuals of each equation and use a two step procedure. In the first step, the system of equations described by Eq (2) is estimated by OLS. The second step estimates the parameters of the system using Feasible Generalised Least Squares (FGLS), with the variance-covariance matrix estimated in the first step.

We also test for the presence of autocorrelation in the residuals within each equation, possible as the  $T$  dimension of our system is quite high (we have 1460 observations for each hour). Using the `xtserial` test suggested by Wooldridge (2002) we reject the null hypothesis of no autocorrelation between the residuals and model the system with autocorrelation in the error term to avoid underestimating the standard errors of the coefficients.<sup>9</sup> The autocorrelation is accounted for by implementing a Prais-Winsten transformation with FGLS.<sup>10</sup> As a robustness check, we estimate Eq. (2) with a time-series approach. We use

<sup>9</sup>The Wooldridge test to detect autocorrelation of residuals is based on a model estimated in first differences. In this model, the underlying assumption tested is that  $cov(\Delta\epsilon_{j,d}, \Delta\epsilon_{j,d-1}) = -0.5$ . The  $\chi^2$  associated with the statistic is equal to 55.67. A detailed explanation of the `xtserial` test implemented by STATA is available at [http://ageconsearch.umn.edu/bitstream/116069/2/sjart\\_st0039.pdf](http://ageconsearch.umn.edu/bitstream/116069/2/sjart_st0039.pdf).

<sup>10</sup>The autocorrelated process of the residuals means that the estimation in levels with month-year dummy

the ADF and the PAC of the residuals to determine the appropriate correlation structure of the model. This analysis highlights that the residuals are both correlated between hours and days. In particular, we find that the first 5 hours of the residuals are autocorrelated, as well as the hours 22 to 26. The results of this specification are reported in the Appendix.

## 4.2 Estimation: results

Results for a subset of hours are shown in Table 3. Complete results for all the hours are reported in Table A1. All energy is expressed in GWh for ease of reporting.

Table 3 shows a significant and negative effect of wind generation on the system marginal price, as expected. The effect is larger during the day than at night, as it displaces more expensive plants during the day.

In the SEM, day-time peak demand occurs between 10 a.m. and 12 p.m. and the evening peak is between 5 and 7 p.m. (corresponding to hours 17 to 19 in our analysis). The evening peak is the overall daily peak in the winter, whereas the day-time peak is the daily peak during summer months.

The coefficients on the square and cube wind term are both significant for several hours, including during early morning hours, confirming that the effect of wind is non-linear, at least for a few hours of the day.

The outage at Turlough Hill increases the effect of wind on the SMP at night, possibly because wind generation cannot be used to pump water back up to the upper storage. Extended outages at the Moyle interconnector do not impact wind's effect at night, whereas they decrease the effect of wind for a few hours during the day.

Full results are in the appendix in Table A1. Other variables behave as expected. Demand has a generally positive effect on SMP and has a distinct non-linear effect. The price of natural gas is positively related to electricity prices. The capacity margin has negative effect on SMP: when demand decreases or more generation is available, electricity prices tend to be lower all else being equal.

---

variables and the estimation in first differences from the month-year mean are not identical. The AR(1) process involves lagging all explanatory variables. Since dummy variables do not appear explicitly in the differenced version, they are not lagged in the AR(1) adjustment. In practice the difference between the estimates is small.

Table 3: *Effect of wind on the SMP, 1 January 2008- 28 August 2012*

|    | <i>Wind</i>          | <i>Wind</i> <sup>2</sup> | <i>Wind</i> <sup>3</sup> | <i>TH</i> <sub>Out</sub> | <i>Moyle</i> <sub>Out</sub> | Wind*Moyle        | Wind*TH             |
|----|----------------------|--------------------------|--------------------------|--------------------------|-----------------------------|-------------------|---------------------|
| 1  | 0.86<br>(3.02)       | -12.69**<br>(4.77)       | 6.32**<br>(2.13)         | 1.8<br>(1.43)            | 1.78<br>(2.59)              | 1.76<br>(1.69)    | -1.85<br>(1.29)     |
| 2  | 3.53<br>(3.50)       | -16.54**<br>(5.69)       | 7.85**<br>(2.63)         | 2.25<br>(1.48)           | 1.08<br>(2.83)              | 2.04<br>(1.96)    | -4.88***<br>(1.47)  |
| 3  | 6.67*<br>(3.16)      | -28.39***<br>(5.11)      | 14.44***<br>(2.40)       | 2.19<br>(1.66)           | 1.27<br>(2.99)              | -1.42<br>(1.97)   | -6.73***<br>(1.45)  |
| 4  | 13.99***<br>(3.40)   | -45.42***<br>(5.65)      | 23.09***<br>(2.75)       | 3.28<br>(1.76)           | 0.67<br>(3.22)              | -1.54<br>(2.18)   | -9.72***<br>(1.55)  |
| 5  | 15.35***<br>(3.51)   | -48.53***<br>(5.89)      | 24.75***<br>(2.90)       | 3.43<br>(1.78)           | 2.65<br>(3.23)              | -1.91<br>(2.28)   | -10.53***<br>(1.59) |
| 6  | 14.84***<br>(4.40)   | -44.91***<br>(7.64)      | 22.32***<br>(3.84)       | 2.83<br>(1.94)           | 0.91<br>(3.50)              | -2.11<br>(2.66)   | -10.86***<br>(1.84) |
| 7  | -5.77<br>(8.89)      | -7.23<br>(15.91)         | 4.83<br>(7.97)           | -1.03<br>(3.00)          | 1.49<br>(5.45)              | 0.4<br>(4.48)     | -0.46<br>(3.27)     |
| 8  | -7.53<br>(4.34)      | -3.04<br>(7.46)          | 2.13<br>(3.55)           | 1.04<br>(1.65)           | 0.29<br>(3.14)              | 2.67<br>(2.26)    | -0.63<br>(1.70)     |
| 9  | -24.71**<br>(9.32)   | 20.03<br>(15.76)         | -7.91<br>(7.32)          | -0.38<br>(3.45)          | -4.19<br>(6.74)             | 7.5<br>(4.93)     | 0.63<br>(3.65)      |
| 10 | -20.51*<br>(9.39)    | 1.56<br>(15.62)          | 1.16<br>(7.13)           | -3.91<br>(3.44)          | -10.86<br>(6.88)            | 5.58<br>(4.96)    | 0.54<br>(3.67)      |
| 11 | -30.62***<br>(7.65)  | 13.81<br>(12.45)         | -4.15<br>(5.59)          | -1.83<br>(2.88)          | -11.41<br>(5.88)            | 6.43<br>(4.02)    | 3.22<br>(2.97)      |
| 12 | -43.96***<br>(9.95)  | 31.67*<br>(15.95)        | -8.64<br>(7.08)          | -4.8<br>(3.81)           | -13.42<br>(7.86)            | 8.5<br>(5.12)     | -4.4<br>(3.74)      |
| 13 | -57.31***<br>(12.20) | 45.72*<br>(19.50)        | -11.98<br>(8.60)         | -1.15<br>(4.71)          | -28.55**<br>(9.17)          | 16.66**<br>(6.16) | -8.82*<br>(4.43)    |
| 14 | -28.08***<br>(7.00)  | 7<br>(10.99)             | 3.52<br>(4.79)           | -5.48*<br>(2.64)         | -8.95<br>(5.84)             | 8.92*<br>(3.69)   | -3.53<br>(2.53)     |
| 15 | -29.40***<br>(4.75)  | 18.94**<br>(7.34)        | -6.75*<br>(3.18)         | -1.77<br>(1.61)          | -5.51<br>(4.34)             | 7.90**<br>(2.62)  | 1.92<br>(1.71)      |
| 16 | -28.67***<br>(4.99)  | 18.36*<br>(7.75)         | -6.54<br>(3.39)          | -3.02<br>(1.67)          | -5.49<br>(4.39)             | 7.06**<br>(2.73)  | 2.19<br>(1.77)      |
| 17 | -14.04<br>(8.12)     | -13.27<br>(12.81)        | 8.99<br>(5.63)           | -0.86<br>(3.06)          | 2.36<br>(6.45)              | -1.05<br>(4.25)   | 0.78<br>(2.91)      |
| 18 | 4.37<br>(18.88)      | -76.11*<br>(29.79)       | 34.82**<br>(13.05)       | -0.51<br>(7.98)          | 14.64<br>(17.02)            | -20.09*<br>(9.89) | 8.79<br>(7.09)      |
| 19 | -26.77<br>(15.18)    | -6.96<br>(24.11)         | 6.46<br>(10.59)          | 15.31*<br>(6.36)         | -21.3<br>(12.93)            | -7.75<br>(7.80)   | -12.66*<br>(5.74)   |
| 20 | -40.68**<br>(14.42)  | 14.66<br>(23.02)         | -2.14<br>(10.15)         | -11.74<br>(6.26)         | -17.51<br>(13.77)           | -9.19<br>(7.37)   | -7.15<br>(5.59)     |
| 21 | -38.57***<br>(11.26) | 28.49<br>(18.30)         | -11.24<br>(8.18)         | -6.66<br>(4.59)          | -15.92<br>(8.99)            | 2.65<br>(5.66)    | 1.26<br>(4.29)      |
| 22 | -18.72*<br>(8.23)    | 4.7<br>(13.40)           | -0.8<br>(5.99)           | 1.28<br>(3.32)           | 1.99<br>(6.43)              | 0.88<br>(4.10)    | 2.07<br>(3.13)      |
| 23 | -17.69***<br>(5.18)  | 10.93<br>(8.45)          | -3.18<br>(3.79)          | -0.31<br>(2.03)          | 2.77<br>(3.91)              | 0.65<br>(2.59)    | 1.32<br>(1.95)      |
| 24 | -10.29*<br>(4.54)    | 4.67<br>(7.47)           | -1.94<br>(3.41)          | -0.77<br>(1.81)          | 1.06<br>(3.43)              | 2.44<br>(2.29)    | 0.84<br>(1.71)      |

Standard errors in parentheses. \*\*\* p<0.01, \*\* p<0.05, \* p<0.1

Includes all variables listed in Equation 2. Wind is measured in GWh.

### 4.3 Marginal Effects

We calculate the marginal effect to assess the overall impact of wind, demand and capacity margin on the system marginal price and compare our results to papers that do not analyse the relations separately for each hour or model the relations as linear.

Equation 3 summarises the calculation:

$$\text{Marginal Effect}_i = \alpha_i + 2\beta_i\bar{i} + 3\gamma_i\bar{i}^2 + \delta_w \cdot \bar{TH} \cdot I^w + \zeta_w \cdot \bar{M} \cdot I^w \quad (3)$$

where  $i$  is the variable of interest (wind, demand or capacity margin),  $\bar{i}$  is its mean value;  $\alpha$  is the coefficient of the variable in the linear form (i.e. *Wind*),  $\beta$  is the coefficient of the quadratic term, and  $\gamma$  is the coefficient of the cube. For wind, we also include in the marginal effects of the interaction between the dummies for Moyle and Turlough Hill outages, with  $I^w$  equal to 1 when  $i$  is wind and 0 otherwise.

The standard errors of the marginal effects in Table 4 are calculated using the delta method.<sup>11</sup> Significance of the hourly marginal effects reflects the joint significance of the linear, squared and cubic approximation of the considered variables (wind, loads, and capacity margin), which may differ from the significance of the variables considered separately in Table 3. The coefficient of the marginal effect of wind on the SMP, averaged over the 24 hours, is equal to -17.25. When the average is weighted by the level of average demand for each hour, the average is -18.17. For every MWh increase in wind generation (equal to about 0.2% of the average wind generation in our sample) the system marginal price decreases by €0.018/MWh, or about 0.03% of its average value in our sample, equivalent to an elasticity of -0.13 calculated at the mean. At the demand average of 4061MWh, this corresponds to an average reduction of total wholesale costs equal to €73.78.

We replicate the analysis for the period starting on 1 November 2009, to be consistent with the results we find for constraint payments (where the dataset is shorter). This leads to a demand-weighted average effect of 1MWh of wind equal to €-15.37. The average hourly demand for this period is 4014MWh, leading to a total reduction in average hourly costs of €61.68 per MWh of wind for the period.

---

<sup>11</sup>This is implemented with the STATA12 `lincom` command. The delta method takes the first order Taylor approximation of the mean of the considered variables, and then calculates their variance.



Table 4: *Marginal effects, 1 Jan 2008-28 Aug 2012*


| Hour                  | Wind                 | Loads                | Cap.Margin           |
|-----------------------|----------------------|----------------------|----------------------|
| 1                     | -7.216***<br>(0.78)  | 3.644***<br>(1.22)   | 1.648**<br>(0.65)    |
| 2                     | -8.213***<br>(0.89)  | 6.116***<br>(1.49)   | 1.326*<br>(0.71)     |
| 3                     | -12.515***<br>(0.85) | 6.099***<br>(1.39)   | -0.028<br>(0.67)     |
| 4                     | -15.892***<br>(0.91) | 8.424***<br>(1.51)   | -0.162<br>(0.71)     |
| 5                     | -16.489***<br>(0.94) | 8.954***<br>(1.5)    | -0.491<br>(0.7)      |
| 6                     | -15.428***<br>(1.12) | 11.343***<br>(1.67)  | -0.967<br>(0.82)     |
| 7                     | -9.437***<br>(2.11)  | 4.072*<br>(2.45)     | -4.993***<br>(1.46)  |
| 8                     | -8.986***<br>(1.08)  | 8.598***<br>(0.96)   | -3.468***<br>(0.85)  |
| 9                     | -11.039***<br>(2.34) | 11.888***<br>(2.1)   | -4.663**<br>(2.01)   |
| 10                    | -17.784***<br>(2.36) | 6.887***<br>(2.16)   | -10.62***<br>(1.97)  |
| 11                    | -18.808***<br>(1.92) | 5.017***<br>(1.85)   | -10.127***<br>(1.6)  |
| 12                    | -21.167***<br>(2.47) | -0.322<br>(2.56)     | -14.613***<br>(2.08) |
| 13                    | -23.826***<br>(3.03) | -10.049***<br>(3.19) | -18.73***<br>(2.45)  |
| 14                    | -19.337***<br>(1.76) | -3.875*<br>(2.03)    | -10.253***<br>(1.49) |
| 15                    | -14.14***<br>(1.21)  | 6.487***<br>(1.36)   | -7.959***<br>(1.05)  |
| 16                    | -13.837***<br>(1.25) | 7.499***<br>(1.32)   | -7.741***<br>(1.09)  |
| 17                    | -20.347***<br>(1.99) | 14.276***<br>(1.97)  | -9.667***<br>(1.72)  |
| 18                    | -42.702***<br>(4.61) | 42.714***<br>(4.92)  | -20.636***<br>(4.41) |
| 19                    | -34.94***<br>(3.66)  | 35.443***<br>(3.89)  | -8.537**<br>(3.45)   |
| 20                    | -32.433***<br>(3.5)  | 29.67***<br>(4.1)    | -11.722***<br>(3.58) |
| 21                    | -19.206***<br>(2.71) | 19.641***<br>(2.83)  | -6.897***<br>(2.5)   |
| 22                    | -14.124***<br>(1.98) | 6.956***<br>(2.13)   | -7.449***<br>(1.78)  |
| 23                    | -9.353***<br>(1.24)  | 0.405<br>(1.5)       | -4.378***<br>(1.04)  |
| 24                    | -6.75***<br>(1.1)    | 1.934<br>(1.47)      | -0.738<br>(0.9)      |
| Average               | -17.249              | 10.943               | -8.394               |
| Load weighted average | -18.169              | 10.136               | -7.501               |

Standard errors in parentheses. \*\*\* p<0.01, \*\* p<0.05, \* p<0.1

All reported variables measured in GWh.

Averages calculated on marginal effects significantly different from 0 at the 10% level.

Figure 3: *Marginal effect of wind on SMP, €/GWh of wind*

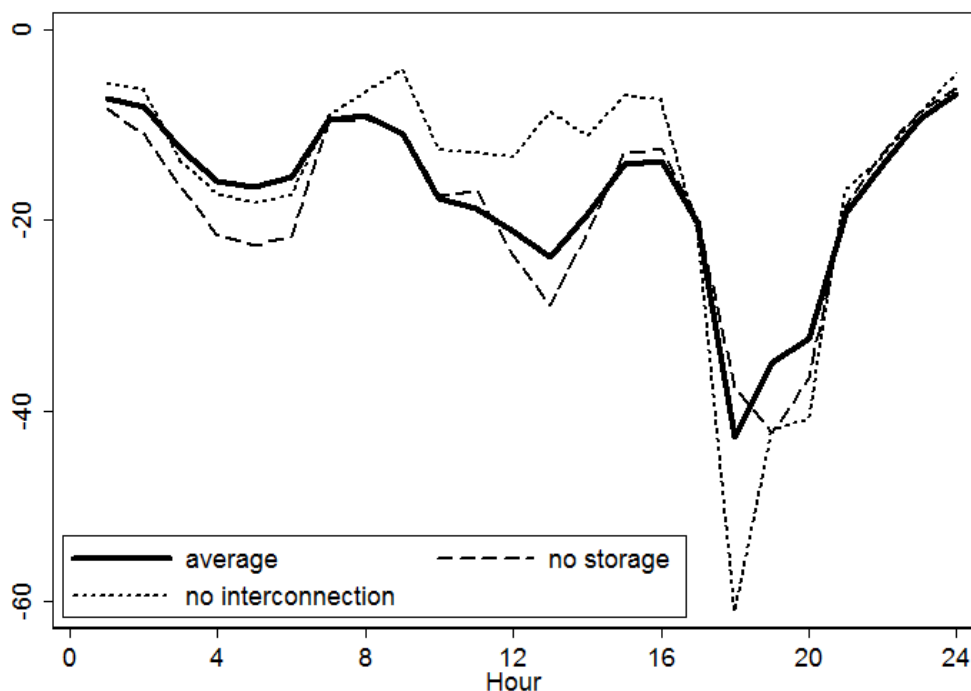

The no storage and no interconnection scenarios set the relevant outage dummy to 1.

Figure 3 shows how the marginal effect of wind on the SMP would change if we assumed that the pumped storage plant and the interconnector were on outage for the whole period of analysis. To calculate the effect of wind in this scenario we set the Turlough Hill (Moyle interconnector) outage dummy to 1 and consider all other variables at their hourly average. The demand-weighted average effect of 1MWh of wind when the pumped storage plant is on outage is €-18.67/GWh and when the interconnector is on outage is €-17.28/GWh. These are similar to the -18.17 shown in Table 4. There are however some changes in the hourly effects. Without storage, the effect of wind during early morning hours is stronger. These are times when wind tends to blow more. In the absence of storage, the additional wind cannot be used to pump water up to the upper basin. During the day, the pattern without interconnection shows a weaker effect of wind on the SMP perhaps because on average the interconnection flow is displacing less expensive rather than more expensive generation in the SMP during the day, so in the absence of interconnection the SMP is smaller and the effect of wind is also smaller.

Figure 4 shows how these results compare to a few recent estimates for the effect of wind on spot prices. For each paper, we calculate the implied percentage change in spot price due to a 1MWh increase in wind generation and present its absolute value (all papers estimate a negative relation between wind generation and spot price change). We caution that comparing across studies is difficult, given differences in market design, generation

mix and estimation strategies. In particular, not all transactions occur in the spot market in some jurisdictions (e.g. Germany and the Netherlands). Moreover some jurisdictions display a concurrent increase in solar generation, which may depress spot prices on its own in addition to limiting wind's impact. In the SEM during this period there was essentially no solar power, which is also true for the Netherlands. In Germany solar generation increased from 1% to 5% in the 2008-2012 period. In Italy the solar share increased even more, going from essentially 0 to more than 6% of demand. Finally, markets in continental Europe are more interconnected, which may affect the impact of wind generation.

Figure 4: % spot price change with 1MWh increase in wind generation

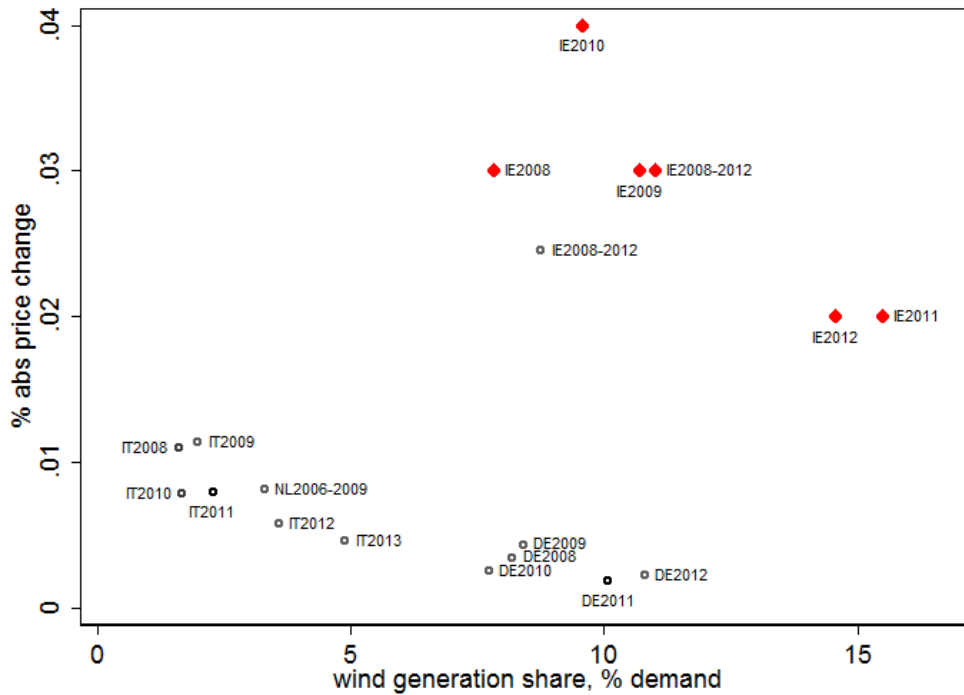


Table C3 in the Appendix reports the underlying data. DE=Germany; IE=Ireland; IT=Italy; NL=Netherlands.

We can make 2 observations. First, our estimates (red diamonds) are the largest in absolute terms. Second, within each study (country) the size of the effect tends to decrease over time as wind penetration increases, suggesting a non-linear and decreasing impact of wind generation. Our result is slightly higher than the value found for Ireland by Swinand and O'Mahoney (2015), which uses a different specification and approach.<sup>12</sup>

For a review of both simulation and econometric studies (prior to 2011) see Gelabert et al. (2011).

<sup>12</sup>In particular, it focuses on wind in the Republic of Ireland alone, use a different All-Ireland demand variable, includes the wind forecast error as a determinant of the spot price and uses a different specification.


## 5 Constraint payments: model and results

In the SEM, initial dispatch is determined in the day ahead and is based on the day-ahead bids, forecast wind, demand and plant availability and a simplified representation of generators' technical constraints. It abstracts from transmission and distribution constraints.

There are four main reasons why actual dispatch may differ from the day-ahead plans and give rise to constraint payments. First, system operators do not have perfect foresight. There will therefore be real-time adjustments to account for unexpected changes in supply or demand, for example when capacity is not able to deliver. Second, in the presence of transmission constraints, some plants will have to generate less and others more than the market schedule to avoid surcharging transmission and distribution lines. Third, the system operator has to meet other system constraints, for example the maintenance of voltage and frequency stability throughout the system, which may change which plants actually generate. Finally, the cost-minimizing algorithm in the day-ahead market does not take into account all possible technical characteristics of the generators, whereas during actual dispatch the TSOs (and generators) are meeting all the technical requirements.

Constraint payments in the SEM have been growing over time, as shown in Figure 5, from about 4% of system costs in 2008, calculated as the sum of the system marginal price times demand, constraint payments and capacity payments, to 6% in 2011 before falling back to 5% in 2012.

Figure 5: *Constraint Payments as percentage of total system costs, 2008-2012*

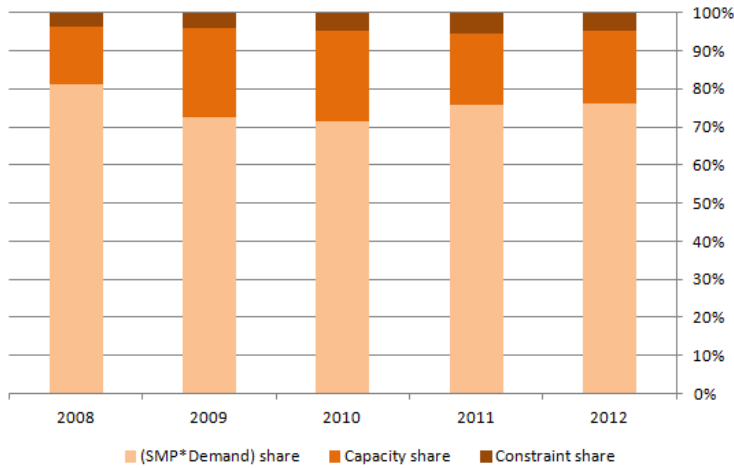

Total System Costs are:  $TSC = \text{Constraint Payments} + \text{Capacity payments} + \text{SMP} \cdot \text{Demand}$

### 5.1 Constraint payments: model

In this section we explore the effect of wind generation on constraint payments. We have to control for several factors: the increase in constraint payments could be in part due to the outage of the Turlough Hill power plant. Operation of the pumped storage plant is

particularly relevant to this analysis, since it is used heavily to compensate for short-run imbalances in the system. The interconnector is also at times used by system operators to balance demand, although most of the evidence suggests that the Moyle interconnector is not used to optimise short-run operations (McInerney and Bunn, 2013).

The determinants of constraint payments  $CP$  at time  $t$  would ideally include indicators for transmission constraints  $TC$ , forced outages at predictable generation plants (such as thermal plants)  $ForOut$ , wind and demand forecast errors and underlying fuel prices  $\mathbf{P}_t$ .

$$CP_t = f(TC_t, ForOut_t, WindFE_t, DemandFE_t, \mathbf{P}_t) \quad (4)$$

Unfortunately, we do not have detailed information for all the explanatory variables in Equation 4. We are unable to account directly for transmission constraints, although we know that some plants are constrained on to avoid chronic transmission constraints that also affect system stability.<sup>13</sup> There are also three main system-wide constraints. The first is a voltage constraint for the Dublin area involving three plants: Poolbeg combined cycle, Dublin Bay Power and Huntstown combined cycle. The second is a system inertial stability constraint, which requires 5 large units on at all times and affects large inflexible units like the Moneypoint coal power plant. The last constraint requires some plants (like the CCGT plants at Whitegate and Tynagh) to be kept on as operating reserve. In order to control for the constraint payments associated with these constraints, which are independent of wind generation, we set the constraint payments associated with these particular plants equal to 0 when they are negative (i.e. when the plant was slated to run but did not because the transmission or system constraint did not take place).

We do not have hourly information on forced outages separately from planned maintenance, but we account for large periods of well-documented forced outages at two plants, the pumped storage plant at Turlough Hill and the Moyle interconnector.

To model the lack of perfect foresight by the system operator, we include both wind and demand forecast errors. We focus on the forecast error from the day-ahead market (24 hours ahead), as it is the most relevant in the case of the SEM. The forecast error variables are the difference between the actual outturn and the values expected in the day-ahead market, or  $x_t - x_{t-24}$ , where  $x$  is either wind generation or demand.


Both the demand and the wind forecast errors are asymmetric. Wind is forecasted to be larger than its actual outturn for 29018 observations (91% of the total), against the 2825 periods when it is forecast to be lower (9% of the cases). Demand is forecasted to be higher than actual outturn 20335 times (82% of the cases) and lower only 4356 times, or 18% of the cases. As a result, it appears that the day-ahead market systematically over-estimates both system demand and wind generation available in the system, as shown in Figure 6. This may result in increasing balancing costs. Mauch et al. (2013) report a similar asymmetry for US wind forecasts. At times of low wind, forecasts tend to underestimate

---

<sup>13</sup>More details available at: <http://www.eirgrid.com/media/Power%20System%20Seminar%204.pdf>, pg.52.

wind generation, whereas the forecasts tend to overestimate wind generation when it blows strongly, thereby overestimating wind generation on average since the errors are proportional to the amount of wind.

Figure 6: *Duration curve of the forecast errors, 1 Nov 2009- 28 Aug 2012*

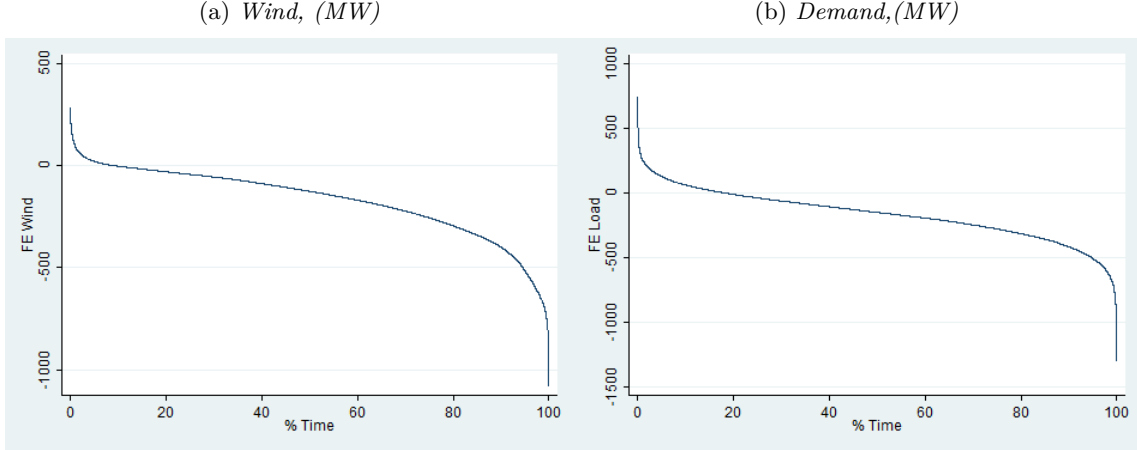

Forecast errors are defined as:  $FE_{w,t} = Actual_{w,t} - Forecasted_{w,t}$

Plants that are constrained down return their unrealised costs to the system, while keeping the period's system marginal price. In other words, they keep the inframarginal rent for every period they were scheduled to run in the day ahead market, but were told not to run due to system constraints. Plants that are constrained up receive payments for their costs, but no additional payments. Typically the cheaper plants are scheduled in the day ahead, so there are positive costs to the system when the dispatch changes.

Over time we expect positive constraint payments to be larger than negative constraint payments, although in any given period we might observe negative constraint payments, for example if demand turns out to be lower than expected (some plants will be returning their unrealised costs and no plants will generate in their place) or wind generation turns out to be higher than expected as wind's generation costs are close to zero.

Based on data availability, as discussed above, we measure the effect of wind (and the associated wind forecast errors) on the size of constraint payments and estimate the following specification (reported as Model 1 in Table 5), using autocorrelated residuals to account for system dynamics. Here we also include month-year dummy variables. We therefore estimate the following equation, where each variable is the first difference from its month-year mean:

$$\begin{aligned}
 CP_t = & \beta_1 L_t + \beta_2 W_t + \beta_3 Wind_{FE_t} + \beta_4 Demand_{FE_t} \\
 & + \beta_5 mar_t + \beta_6 \mathbf{P}_t + \beta_7 Out^n + \sum \kappa^s D_t^s + \epsilon_t
 \end{aligned} \tag{5}$$

where  $\epsilon_t = \sum_{i=1}^4 \rho_i \epsilon_{i,t} + \sum_{i=21}^{24} \rho_i \epsilon_{i,t}$ .

$CP_t$  are the system constraint payments that arise each hour, calculated as the sum of each plant's constraint payments and adjusted for system constraints as discussed earlier;  $L_t$  represents system demand. We expect that the larger the demand, the higher the probability for congestion on transmission lines and so the larger the constraint payments. The more wind  $W_t$  on the system, the larger the forecast errors and the higher the probability of congestion, so we expect wind to have a positive effect on constraint payments.  $\mathbf{P}_t$  includes the price of natural gas, which is the most frequent marginal fuel, and the price of carbon dioxide permits. The larger these prices the higher we expect constraint payments to be. The set of dummy variables  $D$  include the outages of the Moyle interconnector and the Turlough Hill pumped storage plant and their interaction with wind generation. When the capacity margin  $mar$  is high, there are many plants available to increase generation. We therefore expect that if the dispatch changes, it will likely be at lower cost to the system, so we expect the capacity margin to have a negative effect on constraint payments.

We use the autocorrelation and partial autocorrelation graphs to determine that the first 4 hours and the day ahead residuals are autocorrelated, as well as the hours 21 to 24. The autocorrelated residuals capture some of the inertia of the system, as it takes plants a few hours to turn on or shut down.<sup>14</sup>

## 5.2 Estimation results

Results for Model 1 in Table 5 shows that neither demand nor capacity margin are significantly different from zero, suggesting that the tightness of the market is not a significant driver of constraint payments. Higher natural gas prices are associated with higher constraint payments, as expected.

The demand forecast error is significant and positive. When demand in the system is higher than expected, more plants will need to generate and be paid to match demand. The coefficient on the wind forecast error is negative: when actual wind generation is higher than forecasted, constraint payments will be lower. When unexpected wind generation enters the system it displaces plants with a marginal cost of generation higher than wind. When the unrealised costs of more expensive plants are returned to the market, they lower constraint payments. The opposite is true when the wind is lower than forecasted.

---

<sup>14</sup>We account for autocorrelation of the residuals using Stata 12's ARMA command, which uses a Kalman filter specification. Including an AR specification of the residuals is equivalent to a common factor specification of the dynamics (see e.g. Greene, 2003, page 609 and following).

Table 5: *Effect on constraint payments(€), 1 Nov. 2009- 28 Aug. 2012*

| Variable                        | Model1                 | Model2                 |
|---------------------------------|------------------------|------------------------|
| $Gas_{t-24}$ , €/MWh            | 388.79*<br>(178.36)    | 403.78*<br>(179.29)    |
| Demand, MWh                     | -0.69<br>(0.50)        | -0.71<br>(0.51)        |
| Wind, MWh                       | 2.35*<br>(0.95)        | 1.82<br>(0.95)         |
| $Demand_{FE}$                   | 4.00***<br>(0.91)      | -                      |
| $Wind_{FE}$                     | -4.37***<br>(0.74)     | -                      |
| $Wind_{FE}^{Negative}$          | -                      | -4.82***<br>(0.81)     |
| $Wind_{FE}^{Positive}$          | -                      | 3.45<br>(6.34)         |
| $Demand_{FE}^{Negative}$        | -                      | 2.85**<br>(0.97)       |
| $Demand_{FE}^{Positive}$        | -                      | 0.23<br>(2.12)         |
| <i>Tur. Hill Out * Wind.Gen</i> | 2.99***<br>(0.87)      | 2.99***<br>(0.87)      |
| Tur.Hill Outage dummy           | -2330.10*<br>(1074.70) | -2281.51*<br>(1076.32) |
| Moyle Outage dummy              | 819.31<br>(1508.58)    | 674.89<br>(1525.64)    |
| <i>Moyle Out * Wind.Gen</i>     | 0.30<br>(0.73)         | 0.38<br>(0.74)         |
| Generation Margin (€/MW)        | 0.85<br>(0.44)         | 0.80<br>(0.44)         |
| $CO_2$ Price, €/tonne           | 53.92<br>(285.09)      | 47.01<br>(287.31)      |
| AR(1)                           | 0.175***<br>(0.003)    | 0.176***<br>(0.003)    |
| AR(2)                           | 0.090***<br>(0.004)    | 0.090***<br>(0.004)    |
| AR(3)                           | 0.036***<br>(0.006)    | 0.037***<br>(0.006)    |
| AR(4)                           | 0.039***<br>(0.007)    | 0.039***<br>(0.007)    |
| AR(21)                          | 0.018***<br>(0.005)    | 0.018***<br>(0.005)    |
| AR(22)                          | 0.009*<br>(0.004)      | 0.010*<br>(0.004)      |
| AR(23)                          | 0.094***<br>(0.003)    | 0.095***<br>(0.003)    |
| AR(24)                          | 0.161***<br>(0.003)    | 0.162***<br>(0.003)    |
| Constant                        | 12823.74***<br>(18.73) | 12824.97***<br>(19.43) |
| Observations                    | 24499                  | 24499                  |

Standard errors in parentheses. \*\*\* p<0.01, \*\* p<0.05, \* p<0.1  
Variables are included as deviation from their month-year mean.



As a robustness check we estimate with model 2, allowing the forecast errors to have a separate effect if they are negative or positive. Both the demand and the wind forecast errors are significant only when they are negative (when the realised value is smaller than the forecast). In this case the coefficient on the demand forecast error is 2.85. The smaller the realised demand relative to its forecast, the smaller the capacity payments. The opposite holds for the wind forecast error. The forecast error for wind is equal to -4.82: when wind generation is smaller than its forecast level capacity payments increase. The other results remain essentially the same. More wind increases constraint payments, all else being equal and the outage at the pumped storage plant also increases the effect of wind on constraint payments.

The analysis shows that wind generation is positively related to constraint payments, all other things being equal (including the level of wind forecast error). After controlling for other variables, every MWh of additional wind generation is associated with an increase in constraints payments of €2.35 in our Model 1 estimation, corresponding to about 0.012% of hourly constraint payments. This possibly occurs because when wind blows strongly across the SEM area, there may be transmission and distribution congestion. The wind series we use in the estimation is net of wind curtailment, but wind curtailment tends to be associated with periods of high wind generation.<sup>15</sup>

Finally, Table 5 shows that the outage of the interconnector has no effect on constraint payments, whereas when Turlough Hill is on outage, constraint payments decrease. This is counter intuitive. It may be that at times when the pumped storage plant is not on line, more thermal plants are dispatched in the day-ahead market, leading to a higher probability that thermal plants are constrained down in the real market. On the other hand, when Turlough Hill is on outage, wind generation has an effect that is both stronger in statistical terms and more than twice as large, implying that at these times a MWh of wind generation increases constraint payments by €5.3.

Batalla-Bejerano and Trujillo-Baute (2016) find that the short run elasticity of the sum of balancing and capacity payments to renewable generation (wind and solar) in Spain is between 1% and 5%. Our estimates suggest that a 0.2% increase in wind leads to a 0.012% increase in constraint payments, for an elasticity of about 5%. When storage is on outage the elasticity increases to 13%.

## 6 Wind subsidies

Energy policy in both the Republic of Ireland and Northern Ireland includes subsidies for electricity generated by wind. In Ireland this takes the form of a feed in tariff, called REFIT, which applies for 15 years to each renewable generator. Northern Ireland uses

---

<sup>15</sup>During this period some wind was dispatched down for both system-wide reasons and local grid congestion, although we are unable to distinguish between the two reasons. For 2012, EirGrid and SONI (2013a) reports that 2.1%, or 110GWh, were curtailed, similar to the 2.2% and 119GWh curtailed in 2011 (EirGrid and SONI, 2012).

renewable obligation certificates (ROCs), designed to help the UK meet its renewable energy targets. These are granted to renewable generators for 20 years.

Wind support in Ireland has changed over time. We calculate the cost of wind support by calculating the REFIT payments to onshore wind generation during our period of analysis. The REFIT scheme was introduced in 2006 and provides a guaranteed price to renewable generators (or suppliers they enter into long term contracts with). The 2006 version of the program, that we focus on here, offered different levels of guaranteed prices, depending on the size of wind farms. For wind farms with less than 5MW export capacity, the guaranteed payments were slightly higher, as shown in Table 6.<sup>16</sup>

Table 6: REFIT guaranteed price, €/MWh (nominal)

| Fiscal year | Large Wind | Small wind |
|-------------|------------|------------|
| 2008        | 63.739     | 65.976     |
| 2009        | 66.353     | 68.681     |
| 2010        | 66.353     | 68.681     |
| 2011        | 66.353     | 68.681     |
| 2012        | 68.078     | 70.467     |

Small wind has export capacity  $\leq$  5MW

Source: DCENR

Fiscal year is from 1 Oct. of prior year until 30 Sep.

The REFIT regime provides a fixed payment equal to 15% of the guaranteed price of electricity for large wind farms, plus a top up if the average yearly price wind generators receive from the market (equal to the sum of the SMP and capacity payments) is below the guaranteed price.

The value of REFIT over the whole 2 January 2008 to August 28 2012 period per MWh of onshore wind is about €15.3/MWh. These payments are passed on to final consumers through the public service obligation (PSO), assessed by the Commission for Energy Regulation each fiscal year. Appendix D gives the details on the data and the calculation of the average REFIT cost per MWh.

ROCs in Northern Ireland work differently. Each renewable generator is assigned a number of ROCs based on its generation. During our period of analysis, wind generators in Northern Ireland were allocated 1 ROC per MWh of generation. Companies that supply electricity to consumers have to buy a minimum share of renewable energy and they can comply either by turning over an appropriate number of ROCs to the regulatory body or by paying a buy-out fee for every MWh of renewable generation needed to reach the minimum level and not covered by ROCs.<sup>17</sup> The cost of the ROCs is passed on to final consumers. Here we consider the buy-out fee as the cost paid by consumers.<sup>18</sup> Table 7

<sup>16</sup>DCENR source accessed July 2016 at <http://www.dcenr.gov.ie/energy/SiteCollectionDocuments/Renewable-Energy/RefitReferencePrices.pdf>

<sup>17</sup>The initial legislation on ROCs in Northern Ireland was passed in 2006 with the Renewables Obligation Order (Northern Ireland) 2006. Details on ROCs in Northern Ireland can be found at <https://www.economy-ni.gov.uk/articles/northern-ireland-renewables-obligation>

<sup>18</sup>For an explanation of why the buy-out fee is reasonable approximation of the cost of ROCs to con-

reports the buy-out fee in each fiscal year during the period of our study. It is more than 3.5 times larger than the cost of REFIT per MWh. This is consistent with other analyses comparing the renewable subsidy costs in the two jurisdictions (Deane et al., 2015) and may be one of the reasons the UK is moving to a feed-in-tariff support system starting in 2017.

Table 7: Buy-out fee for Northern Ireland ROCs, nominal

|                | £/MWh | exchange rate | €/MWh |
|----------------|-------|---------------|-------|
| 2008/09        | 35.76 | 0.9308        | 38.42 |
| 2009/10        | 37.19 | 0.8898        | 41.80 |
| 2010/11        | 36.99 | 0.8837        | 41.86 |
| 2011/12        | 38.69 | 0.8339        | 46.40 |
| 2012/13        | 40.71 | 0.8469        | 48.07 |
| Average        | 37.87 |               | 43.31 |
| Avg. from 2009 | 38.40 |               | 44.53 |

Source: Ofgem (2012); fiscal year in the UK is from 1 April to 31 March.

Exchange rates for March 31 from [www.ecb.europa.eu](http://www.ecb.europa.eu)

This cost should be interpreted as the cost to consumers of an additional MWh of wind generation, rather than the average cost of wind generation subsidies. Over time the subsidy expires (after 15 years for REFITs and 20 years for ROCs) whereas the wind farms may continue generating.

We calculate an average cost of wind subsidies across the two jurisdictions. We implicitly assume that new wind capacity would be located in Northern Ireland and Ireland according to its historical share, with 80% of wind generation taking place in Ireland and the remaining 20% in Northern Ireland. A weighted average of the ROC and the REFIT costs to consumers gives an average subsidy equal to  $44.53 \cdot 0.2 + 15.14 \cdot 0.8 = 21.02$ , expressed in €/MWh.

To summarise, for the period starting November 1 2009, an additional MWh of wind generation increases constraint payments by an estimated €2.35 (or €5.3 when the pumped storage plant is on outage), but decreases total electricity purchase costs by about €61.68. Consumers pay an average €21/MWh for this wind, suggesting a positive net effect of about €38.33/MWh of wind generation, decreasing to €35.38/MWh when storage is not available.

These results contrast with results for Spain after 2010 (Ciarreta et al., 2014) where wind reportedly increases net costs to consumers. The average subsidy in Spain is about €75 per MWh of wind or higher from 2009 onward, which is significantly larger than both the subsidy in Ireland and in Northern Ireland. Our findings are more aligned with the results for Denmark between 2000 and 2006 (Munksgaard and Morthorst, 2008). Munksgaard and Morthorst (2008) state that the subsidy in Denmark decreased from €66 in 2000 to €12 per MWh of wind in 2006, leading to a slight net cost to consumers by sumers, see for example Bryan et al. (2015).

2006 between €3 and €7 per MWh of wind.

## 7 Conclusion

This paper analyses how wind generation influences the price and constraint payments in the Irish Single Electricity Market and compares it to the wind subsidy paid by consumers.

To define the impact on the system price, we estimate a system of hourly equations and find a consistent negative effect of wind. We show that the effect is not linear and is affected by the presence (or rather, absence) of storage. When Turlough Hill, the largest storage facility in the SEM, is on outage, the impact of wind on prices increases at night, possibly because wind cannot be used to pump water back of to the upper storage. Outages at the interconnector between the island of Ireland and Great Britain lead to a decreased impact during some hours of the day. We calculate the average effect of wind on prices and show that a MWh increase in wind generation (equal to about 0.2% of the average wind generation in our sample) leads to a decrease of the system marginal price equal to €0.018/MWh, or about 0.03% of its average value in our sample.

Second, we investigate if and how wind affects constraint payments. Our prior is that larger amounts of wind will lead to higher constraint payments, all else being equal. This is confirmed by our findings that show that wind generation is positively linked to constraint payments both directly and through the wind forecast error. The larger the errors in forecasting the level of wind and demand, the larger the constraint payments. In periods when storage is unavailable, the impact of wind generation on constraint payments more than doubles. We find no systematic effect of outages at the interconnector between the island of Ireland and Great Britain.

Finally, we calculate the cost of subsidies for wind generation, which differ in Northern Ireland than in Ireland. We calculate a weighted average of the subsidies in the two jurisdictions to measure the subsidy effect per MWh of wind generation. Once we consider the cumulative effect of changes in spot price, changes in constraint payments and cost of subsidies, we conclude that the net effect of wind generation is positive for the SEM during our period of analysis. When pumped storage is on outage the constraint payments increase significantly, but the net effect remains positive.

## References

- Baltagi, B. H. (2008). *Econometric Analysis of Panel Data*. Wiley.
- Batalla-Bejerano, J. and Trujillo-Baute, E. (2016). Impacts of intermittent renewable generation on electricity system costs. *Energy Policy*, 94:411 – 420.
- Ben-Moshe, O. and Rubin, O. D. (2015). Does wind energy mitigate market power in deregulated electricity markets? *Energy*, 85:511 – 521.
- Browne, O., Poletti, S., and Young, D. (2015). How does market power affect the impact of large scale wind investment in 'energy only' wholesale electricity markets? *Energy Policy*, 87:17 – 27.
- Bryan, J., Lange, I., and MacDonald, A. (2015). Estimating the price of {ROCs}. *The Electricity Journal*, 28(1):49 – 57.
- Bueno-Lorenzo, M., Moreno, M. Á., and Usaola, J. (2013). Analysis of the imbalance price scheme in the Spanish electricity market: A wind power test case. *Energy Policy*, 62:1010 – 1019.
- Ciarreta, A., Espinosa, M. P., and Pizarro-Irizar, C. (2014). Is green energy expensive? empirical evidence from the Spanish electricity market. *Energy Policy*, 69:205 – 215.
- Clemente, J., Montanes, A., and Reyes, M. (1998). Testing for a unit root in variables with a double change in the mean. *Economics Letters*, 59(2):175–182.
- Clò, S., Cataldi, A., and Zoppoli, P. (2015). The merit-order effect in the Italian power market: The impact of solar and wind generation on national wholesale electricity prices. *Energy Policy*, 77:79–88.
- Cludius, J., Hermann, H., Matthes, F. C., and Graichen, V. (2014). The merit order effect of wind and photovoltaic electricity generation in Germany 2008-2016: Estimation and distributional implications. *Energy Economics*, 44:302 – 313.
- Currie, R. A. F., Ault, G. W., and McDonald, J. R. (2006). Methodology for determination of economic connection capacity for renewable generator connections to distribution networks optimised by active power flow management. *IEE Proceedings - Generation, Transmission and Distribution*, 153(4):456–462.
- DCENR (2012). Strategy for renewable energy: 2012 - 2020. Technical report, Department of Communication, Energy and Natural Resources.
- Deane, P., FitzGerald, J., Malaguzzi Valeri, L., Tuohy, A., and Walsh, D. (2015). Irish and British electricity prices: what recent history implies for future prices. *Economics of Energy and Environmental Policy*, 4(1).

- Department of Enterprise Trade and Investment (2015). Electricity consumption and renewable generation in Northern Ireland: year ending December 2014. Technical Report 2, Northern Ireland Statistics and Research Agency.
- DETI (2010). Energy: a strategic framework for Northern Ireland. Technical report, Department of Enterprise Trade and Investment.
- Di Cosmo, V. and Malaguzzi Valeri, L. (2014). The incentive to invest in thermal plants in the presence of wind generation. *Energy Economics*, 43(C):306 – 315.
- Dineen, D., Howley, M., and Holland, M. (2015). Renewable energy in Ireland 2013. Technical report, Sustainable Energy Authority of Ireland.
- EirGrid (2008). Generation adequacy report, 2009-2015. Technical report, EirGrid.
- EirGrid (2009). Generation adequacy report, 2010-2016. Technical report, EirGrid.
- EirGrid and SONI (2010). All-island generation capacity statement 2011-2020. Technical report, EirGrid.
- EirGrid and SONI (2011). All-island generation capacity statement 2012-2021. Technical report, EirGrid.
- EirGrid and SONI (2012). 2011 curtailment report. Technical report, EirGrid and SONI.
- EirGrid and SONI (2013a). 2012 curtailment report. Technical report, EirGrid and SONI.
- EirGrid and SONI (2013b). All-island generation capacity statement 2013-2022. Technical report, EirGrid.
- EirGrid and SONI (2014). Annual wind constraint and curtailment report 2013. Technical report, EirGrid and SONI.
- Forrest, S. and MacGill, I. (2013). Assessing the impact of wind generation on wholesale prices and generator dispatch in the Australian national electricity market. *Energy Policy*, 59:120 – 132.
- Garcia-Gonzalez, J., de la Muela, R., Santos, L., and Gonzalez, A. (2008). Stochastic joint optimization of wind generation and pumped-storage units in an electricity market. *IEEE TRANSACTIONS ON POWER SYSTEMS*, 23(2):460 – 468.
- Gelabert, L., Labandeira, X., and Linares, P. (2011). An ex-post analysis of the effect of renewables and cogeneration on Spanish electricity prices. *Energy Economics*, 33, Supplement 1:S59 – S65. Supplemental Issue: Fourth Atlantic Workshop in Energy and Environmental Economics.
- Gil, H. A., Gomez-Quiles, C., and Riquelme, J. (2012). Large-scale wind power integration and wholesale electricity trading benefits: Estimation via an ex post approach. *Energy Policy*, 41:849 – 859. Modeling Transport (Energy) Demand and Policies.

- Gorecki, P. K. (2013). Ensuring compatibility of the all-island electricity system with the target model: Fitting a square peg into a round hole? *Energy Policy*, 52:677–688.
- Greene, W. H. (2003). *Econometric analysis*. Pearson Education India.
- Guthrie, G. and Videbeck, S. (2007). Electricity spot price dynamics: Beyond financial models. *Energy Policy*, 35(11):5614 – 5621.
- Härdle, W. K. and Trück, S. (2010). The dynamics of hourly electricity prices. SFB 649 Discussion Paper 2010-013, Sonderforschungsbereich 649, Humboldt Universität zu Berlin, Germany. available at <http://sfb649.wiwi.hu-berlin.de/papers/pdf/SFB649DP2010-013.pdf>.
- Holttinen, H. (2005). Optimal electricity market for wind power. *Energy Policy*, 33(16):2052 – 2063.
- Holttinen, H., Meibom, P., Orths, A., Lange, B., O’Malley, M., Tande, J. O., Estanqueiro, A., Gomez, E., SÄüder, L., Strbac, G., Smith, J. C., and van Hulle, F. (2011). Impacts of large amounts of wind power on design and operation of power systems, results of IEA collaboration. *Wind Energy*, 14(2):179–192.
- Huisman, R., Huurman, C., and Mahieu, R. (2007). Hourly electricity prices in day-ahead markets. *Energy Economics*, 29(2):240 – 248.
- Im, K. S., Pesaran, M. H., and Shin, Y. (2003). Testing for unit roots in heterogeneous panels. *Journal of Econometrics*, 115:53–74.
- Maciejowska, K. (2014). Fundamental and speculative shocks, what drives electricity prices? In *11th International Conference on the European Energy Market (EEM14)*, pages 1–5.
- Market Monitoring Unit (2009). Single electricity market, public report 2009. Technical Report SEM/09/039, SEM.
- Mauch, B., Apt, J., Carvalho, P. M. S., and Small, M. J. (2013). An effective method for modeling wind power forecast uncertainty. *Energy Systems*, 4(4):393–417.
- McInerney, C. and Bunn, D. (2013). Valuation anomalies for interconnector transmission rights. *Energy Policy*, 55(0):565 – 578. Special section: Long Run Transitions to Sustainable Economic Structures in the European Union and Beyond.
- Meibom, P., Barth, R., Hasche, B., Brand, H., Weber, C., and O’Malley, M. (2011). Stochastic optimization model to study the operational impacts of high wind penetrations in ireland. *Power Systems, IEEE Transactions on*, 26(3):1367–1379.
- Munksgaard, J. and Morthorst, P. E. (2008). Wind power in the danish liberalised power markets. policy measures, price impact and investor incentives. *Energy Policy*, 36(10):3940 – 3947.

- Nieuwenhout, F. and Brand, A. (2011). The impact of wind power on day-ahead electricity prices in the netherlands. In *2011 8th International Conference on the European Energy Market (EEM)*, pages 226–230.
- Ofgem (2012). Information note: The renewables obligation buy-out price and mutualisation ceiling 2012-13. Technical report, Ofgem.
- Rehman, S., Al-Hadhrani, L. M., and Alam, M. M. (2015). Pumped hydro energy storage system: A technological review. *Renewable and Sustainable Energy Reviews*, 44:586 – 598.
- Romero Martinez, S. and Hughes, W. (2015). Bringing variable renewable energy up to scale : options for grid integration using natural gas and energy storage. Technical report, World Bank.
- SEM (2011). Principles of dispatch and design of the market schedule in the trading and settlement code. SEM Committeel Decision Paper SEM-11-062, SEM Committee Decision Paper.
- SONI (2008). Seven year generation capacity statement 2009-2015. Technical report, System Operator of Northern Ireland.
- Swinand, G. P. and Godel, M. (2012). Estimating the impact of wind generation on balancing costs in the GB electricity markets. In *2012 9th International Conference on the European Energy Market*, pages 1–8.
- Swinand, G. P. and O’Mahoney, A. (2015). Estimating the impact of wind generation and wind forecast errors on energy prices and costs in ireland. *Renewable Energy*, 75(0):468 – 473.
- Traber, T. and Kemfert, C. (2011). Gone with the wind? electricity market prices and incentives to invest in thermal power plants under increasing wind energy supply. *Energy Economics*, 33(2):249 – 256.
- Walsh, D., Malaguzzi Valeri, L., and Di Cosmo, V. (2016). Strategic bidding, wind ownership and regulation in a decentralised electricity market. *MPRA Working Paper*, (71502).
- Weron, R. (2008). Market price of risk implied by Asian-style electricity options and futures. *Energy Economics*, 30(3):1098–1115.
- Wooldridge, J. M. (2002). *Econometric Analysis of Cross Section and Panel Data*. Cambridge, Massachusetts: The MIT Press.
- Würzburg, K., Labandeira, X., and Linares, P. (2013). Renewable generation and electricity prices: Taking stock and new evidence for Germany and Austria. *Energy Economics*,



40, Supplement 1:S159 – S171. Supplement Issue: Fifth Atlantic Workshop in Energy and Environmental Economics.

Zellner, A. (1962). An efficient method of estimating seemingly unrelated regression equations and tests for aggregation bias. *Journal of the American Statistical Association*, 57:348–368.

## Appendix A Estimation results

Table A1 below shows results for all estimated hours for estimated equation 2.  $CO_2$  price and  $CO_2$  fee (measured in €/tonne) are not presented due to space limitations; complete results are available from the authors upon request. Wind, demand, capacity margin and imports are in GWh. Price of gas is in €/MWh.

Table A1: SMP (€/MWh): 1 January 2008- 28 August 2012

|    | Wind     | Wind <sup>2</sup> | Wind <sup>3</sup> | TH <sub>Out</sub> | Moyle <sub>Out</sub> | Wind*Moyle | Wind*TH  | Loads   | Load <sup>2</sup> | Load <sup>3</sup> | Cap.Margin | Cap.Margin <sup>2</sup> | Cap.Margin <sup>3</sup> | Gas <sub>t-24</sub> | Imports  |
|----|----------|-------------------|-------------------|-------------------|----------------------|------------|----------|---------|-------------------|-------------------|------------|-------------------------|-------------------------|---------------------|----------|
| 1  | 0.86     | -12.69**          | 6.32**            | 1.8               | 1.78                 | 1.76       | -1.85    | -40.33  | 11.7              | -1.03*            | -93.41***  | 26.72***                | -2.50***                | 0.89***             | 0.00     |
| 2  | 3.53     | -16.54**          | 7.85**            | 2.25              | 1.08                 | 2.04       | -4.88*** | (26.75) | (6.40)            | (0.50)            | (0.81)     | (3.05)                  | (0.32)                  | (0.18)              | (1.43)   |
| 3  | 3.50     | (5.69)            | (2.63)            | (1.48)            | (2.83)               | (1.96)     | (1.47)   | (24.05) | (6.17)            | (0.51)            | (0.13)     | (3.06)                  | (0.30)                  | (0.19)              | (1.80)   |
| 4  | 6.67*    | -28.39***         | 14.44***          | 2.19              | 1.27                 | -28.39***  | -6.73*** | -17.12  | 7.44              | -0.8              | -70.94***  | 16.67***                | -1.30***                | 0.78***             | -4.72*** |
| 5  | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 6  | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 7  | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 8  | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 9  | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 10 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 11 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 12 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 13 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 14 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 15 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 16 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 17 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 18 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 19 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 20 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 21 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 22 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 23 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |
| 24 | 13.99*** | (5.11)            | (2.40)            | (1.66)            | (2.99)               | (1.97)     | (1.45)   | (20.02) | (5.37)            | (0.46)            | (9.61)     | (2.78)                  | (0.27)                  | (0.20)              | (1.19)   |

Regression includes day-month dummy variables, a CO<sub>2</sub> fee dummy and the price of CO<sub>2</sub> permits. Demand, wind, capacity margin, net imports in GWh, P<sub>Gas</sub> in €/MWh.

## Appendix B Robustness check

Table B2 shows the results for the time series estimation. Here again, we take the difference of the variables from their month-year mean and estimate the following regression:

$$P_t = \sum_h^3 [\beta^h L_t^h + \gamma^h W_t^h + \theta^h mar_t] + \sum_j \zeta^j F_{t-24}^j + \sum_s \kappa^s D^s + \chi I_t + \epsilon_t \quad (6)$$

We control for the autocorrelation of the residuals by including lags 1-5 and 22-26, after verifying the autocorrelation and partial-autocorrelation graphs of the residuals. The marginal effect of wind on system marginal price is equal to -18.33, which is very close to the average of the marginal effects found with the panel estimate (-18.17).

The results of the time series estimates do not disentangle the impact of the wind, the interconnector and the storage during the different hours of the day. The results in Table 3 show that wind generation does not affect the system price homogeneously during the hours. In particular, wind is particularly significant during the night and the first hours of the afternoon, and this effect is not captured in the time series specification. Finally, storage and interconnector are not significant in Table B2, but Table 3 shows that they are statistically different from zero for several hours of the day.

Table B2: Effect of wind on SMP (€/MWh), hourly data, 2008-2012

| Variables            | Coeff.                 |
|----------------------|------------------------|
| Loads, GWh           | 167.300***<br>(11.312) |
| $Loads^2$ , GWh      | -41.403***<br>(2.519)  |
| $Loads^2$ , GWh      | 3.625***<br>(0.184)    |
| Wind Generation, GWh | -19.756***<br>(3.011)  |
| $Wind^2$ GWh         | 2.11<br>(4.565)        |
| $Wind^3$ GWh         | 0.825<br>(1.949)       |
| $Gas_{t-24}$ (€/MWh) | 0.414*<br>(0.206)      |
| $CO_2$ (€/tonne)     | 0.222<br>(0.264)       |
| Net Imports, GWh     | -23.971***<br>(2.19)   |
| Capacity Margin, GWh | -97.157***<br>(3.157)  |
| $Cap.Marg.^2$ GWh    | 24.136***<br>(1.303)   |
| $Cap.Marg.^3$ GWh    | -1.959***<br>(0.168)   |
| $TH_{Out}$           | -1.045<br>(1.317)      |
| $Moyle_{Out}$        | -4.657<br>(2.872)      |
| Wind*TH              | -1.898<br>(1.321)      |
| Wind*Moyle           | 1.21<br>(1.394)        |
| AR(1)                | 0.344***<br>(0.001)    |
| AR(2)                | 0.044***<br>(0.003)    |
| AR(3)                | 0.035***<br>(0.004)    |
| AR(4)                | 0.020***<br>(0.005)    |
| AR(5)                | 0.023***<br>(0.004)    |
| AR(22)               | -0.015***<br>(0.004)   |
| AR(23)               | 0.035***<br>(0.003)    |
| AR(24)               | 0.281***<br>(0.002)    |
| AR(25)               | -0.077***<br>(0.003)   |
| AR(26)               | -0.036***<br>(0.004)   |

Standard errors in parentheses. \*\*\* p<0.01, \*\* p<0.05, \* p<0.1  
Includes  $CO_2$  fee.

## Appendix C Comparison with other studies

Table C3: Percent change in spot price associated with 1MWh change in wind

| Name                         | Country     | Year      | Wind share | $\frac{\Delta P}{P}$ |
|------------------------------|-------------|-----------|------------|----------------------|
| Nieuwenhout and Brand (2011) | Netherlands | 2006-2009 | 3%         | -0.008               |
| Swinand and O'Mahoney (2015) | Ireland     | 2008-2012 | 9%         | -0.025               |
| Cludius et al. (2014)        | Germany     | 2008      | 8%         | -0.003               |
|                              |             | 2009      | 8%         | -0.004               |
|                              |             | 2010      | 8%         | -0.003               |
|                              |             | 2011      | 10%        | -0.002               |
|                              |             | 2012      | 11%        | -0.002               |
| Clò et al. (2015)            | Italy       | 2008      | 2%         | -0.011               |
|                              |             | 2009      | 2%         | -0.011               |
|                              |             | 2010      | 2%         | -0.008               |
|                              |             | 2011      | 2%         | -0.008               |
|                              |             | 2012      | 4%         | -0.006               |
| This paper                   | Ireland     | 2008-2012 | 11%        | -0.030               |
|                              |             | 2008      | 8%         | -0.029               |
|                              |             | 2009      | 11%        | -0.033               |
|                              |             | 2010      | 10%        | -0.039               |
|                              |             | 2011      | 15%        | -0.025               |
|                              |             | 2012      | 15%        | -0.022               |

Wind share from Eurostat nrg105a when not available from paper.

% change in price calculated based on data provided in the papers cited.

Table C3 includes studies that calculate the marginal effect of wind on spot prices. The units of measure vary, but we create a common measure that identifies the change in the spot price (in €/MWh) given a 1MWh increase in wind generation. We then calculate the size of that change with respect to the average spot price. This is what we report in the right-most column of Table C3. The average penetration or share of wind is calculated as the share of demand covered by wind generation and comes from each paper when it is reported. For papers that do not report average hourly demand or average hourly wind generation, the average penetration of wind is calculated using Eurostat data, specifically database nrg105a and the summary information on renewables reported in the SHARES tool (<http://ec.europa.eu/eurostat/web/energy/data/shares>).

## Appendix D REFIT calculations

We calculate the average cost of REFIT per MWh using half-hourly information on wind generation at the plant level, SMP and capacity payments to generators, downloaded from the market operator's website. We limit the analysis to wind generators in the Republic of Ireland, since REFIT applies only to companies in Ireland.

As stated in the main text, each plant is guaranteed a fixed price that varies by fiscal year, which starts on October 1 and ends on September 30 (shown in Table 6). The payment to wind generators is composed by a fixed portion (15% of the reference price for large wind) and a portion that depends on how much the plants make on the market. The plants receive the SMP and capacity payments from the market (wind generators did not receive constraint payments during this period). The feed in tariff (FIT) amount is calculated every year  $y$  for each wind generator  $i$  generating electricity  $Elec$ :

$$FIT_{i,y} = FixFIT_{i,y} + \max\left[P_y^{FIT} - \frac{\sum_{t \in y} (SMP_t + CapPay_{i,t}) \cdot Elec_{i,t}}{\sum_{t \in y} Elec_{i,t}}, 0\right] \cdot \sum_{t \in y} Elec_{i,t} \quad (7)$$

The first term is the fixed amount and is defined as  $0.15 \cdot P_y^{FIT} \cdot \sum_{t \in y} Elec_{i,t}$ . The second term shows that a positive REFIT payment is paid only if the generator does not receive at least the REFIT price on its average sales during the year. The REFIT payment is paid for all generation during the fiscal year in question.

Table D4 summarises the information we have for the 57 wind farms that bid directly into the market during the January 2008 to August 2012 period. The majority of these wind generators (49) are large, while 8 have an export capacity smaller than 5MW. These are much fewer than the total number of wind farms that receive REFIT support. The Electricity Act 2011 lists 118 wind farms with REFIT support, with 71 being large and 47 small.<sup>19</sup> Small wind farms represent about 9% of total capacity, with large wind farms responsible for the remaining 91%. We implicitly assume that all the small wind farms have a similar generation pattern and the same for large wind farms.

In the hourly data for firms registered with the SEM there is one observation where generation is reported as negative and one where capacity payments are negative. We set these observations as missing.

Table D4: Summary Statistics on hourly data, 1 January 2008 to 28 August 2012

|                               | Obs.      | Mean  | Std. Dev. | Min | Max        |
|-------------------------------|-----------|-------|-----------|-----|------------|
| <b>Large wind (49 plants)</b> |           |       |           |     |            |
| Generation (MWh)              | 1,504,160 | 7.46  | 9.68      | 0   | 85.03      |
| Capacity Payments (€)         | 1,504,160 | 52.97 | 120.18    | 0   | 8,146.73   |
| Capacity Payments/MWh         | 1,342,477 | 12.34 | 185.34    | 0   | 100,482.00 |
| SMP (€/MWh)                   | 1,504,166 | 59.40 | 32.34     | 0   | 695.79     |
| <b>Small wind (8 plants)</b>  |           |       |           |     |            |
| Generation (MWh)              | 192,553   | 0.73  | 0.88      | 0   | 4.61       |
| Capacity Payments (€)         | 192,553   | 5.16  | 11.16     | 0   | 367.18     |
| Capacity Payments/MWh         | 165,021   | 12.30 | 200.99    | 0   | 60,110.00  |
| SMP (€/MWh)                   | 192,553   | 57.70 | 31.34     | 0   | 695.79     |

Small wind farms have export capacity up to 5MW.

Data range: 1 January 2008 06:00 to 28 August 2012 23:00.

<sup>19</sup>The Electricity Regulation Act is published in Statutory Instrument No. 513 of 2011.

The average REFIT payments by fiscal year and type of wind farm are reported in Table D5. As expected, the average subsidy to small wind farms is larger than to large wind farms. Note that in 2008 there was no variable REFIT paid due to the large SMP. In general, the size of the average REFIT payment is inversely correlated with the SMP. The average presented in the last line is weighted by the number of periods in each year, but not by plant generation in each year.

Table D5: REFIT avg per MWh, by fiscal year, €/MWh

| Year          | Large wind |         |          | Small wind |          |       |
|---------------|------------|---------|----------|------------|----------|-------|
|               | FIT fix    | FIT var | Tot. FIT | FIT var    | Tot. FIT | SMP   |
| 2008          | 9.56       | 0       | 9.56     | 0          | 9.56     | 83.25 |
| 2009          | 9.95       | 8.28    | 18.23    | 11.39      | 21.34    | 51.47 |
| 2010          | 9.95       | 13.56   | 23.51    | 15.71      | 25.66    | 48.78 |
| 2011          | 9.95       | 0.84    | 10.79    | 2.97       | 12.92    | 62.11 |
| 2012          | 10.21      | 2.09    | 12.31    | 5.29       | 15.50    | 61.13 |
| Average       | 9.97       | 5.14    | 15.11    | 7.45       | 17.49    |       |
| Avg from 2009 | 10.04      | 4.93    | 14.96    | 6.86       | 16.91    |       |

Data range: 1 January 2008 06:00 to 28 August 2012 23:00.

Fiscal year goes from October 1 of prior year to 30 September.

Average from 2009 is calculated from 1 November 2009.

To calculate the REFIT cost of the average MWh generated by wind under REFIT, we weigh the average REFIT cost by the capacity share of large and small wind farms on the system.

This leads to an average REFIT payment per MWh of  $15.11 \cdot 0.91 + 17.49 \cdot 0.09 = 15.32$ . To compare to other costs and benefits of wind in our analysis, we also calculate the average REFIT payment for the period starting on November 1 2009, with a value of  $14.96 \cdot 0.91 + 16.91 \cdot 0.09 = 15.14$ . This is the number that we report as the REFIT cost of 1MWh of wind in the main text.



2012

- 2012/1, **Montolio, D.; Trujillo, E.:** "What drives investment in telecommunications? The role of regulation, firms' internationalization and market knowledge"
- 2012/2, **Giesen, K.; Suedekum, J.:** "The size distribution across all "cities": a unifying approach"
- 2012/3, **Foremny, D.; Riedel, N.:** "Business taxes and the electoral cycle"
- 2012/4, **García-Estévez, J.; Duch-Brown, N.:** "Student graduation: to what extent does university expenditure matter?"
- 2012/5, **Durán-Cabré, J.M.; Esteller-Moré, A.; Salvadori, L.:** "Empirical evidence on horizontal competition in tax enforcement"
- 2012/6, **Pickering, A.C.; Rockey, J.:** "Ideology and the growth of US state government"
- 2012/7, **Vergolini, L.; Zanini, N.:** "How does aid matter? The effect of financial aid on university enrolment decisions"
- 2012/8, **Backus, P.:** "Gibrat's law and legacy for non-profit organisations: a non-parametric analysis"
- 2012/9, **Jofre-Monseny, J.; Marín-López, R.; Viladecans-Marsal, E.:** "What underlies localization and urbanization economies? Evidence from the location of new firms"
- 2012/10, **Mantovani, A.; Vandekerckhove, J.:** "The strategic interplay between bundling and merging in complementary markets"
- 2012/11, **García-López, M.A.:** "Urban spatial structure, suburbanization and transportation in Barcelona"
- 2012/12, **Revelli, F.:** "Business taxation and economic performance in hierarchical government structures"
- 2012/13, **Arqué-Castells, P.; Mohnen, P.:** "Sunk costs, extensive R&D subsidies and permanent inducement effects"
- 2012/14, **Boffa, F.; Piolatto, A.; Ponzetto, G.:** "Centralization and accountability: theory and evidence from the Clean Air Act"
- 2012/15, **Cheshire, P.C.; Hilber, C.A.L.; Kaplanis, I.:** "Land use regulation and productivity – land matters: evidence from a UK supermarket chain"
- 2012/16, **Choi, A.; Calero, J.:** "The contribution of the disabled to the attainment of the Europe 2020 strategy headline targets"
- 2012/17, **Silva, J.I.; Vázquez-Grenno, J.:** "The ins and outs of unemployment in a two-tier labor market"
- 2012/18, **González-Val, R.; Lanaspa, L.; Sanz, F.:** "New evidence on Gibrat's law for cities"
- 2012/19, **Vázquez-Grenno, J.:** "Job search methods in times of crisis: native and immigrant strategies in Spain"
- 2012/20, **Lessmann, C.:** "Regional inequality and decentralization – an empirical analysis"
- 2012/21, **Nuevo-Chiquero, A.:** "Trends in shotgun marriages: the pill, the will or the cost?"
- 2012/22, **Piil Damm, A.:** "Neighborhood quality and labor market outcomes: evidence from quasi-random neighborhood assignment of immigrants"
- 2012/23, **Ploeckl, F.:** "Space, settlements, towns: the influence of geography and market access on settlement distribution and urbanization"
- 2012/24, **Algan, Y.; Hémet, C.; Laitin, D.:** "Diversity and local public goods: a natural experiment with exogenous residential allocation"
- 2012/25, **Martínez, D.; Sjögren, T.:** "Vertical externalities with lump-sum taxes: how much difference does unemployment make?"
- 2012/26, **Cubel, M.; Sanchez-Pages, S.:** "The effect of within-group inequality in a conflict against a unitary threat"
- 2012/27, **Andini, M.; De Blasio, G.; Duranton, G.; Strange, W.C.:** "Marshallian labor market pooling: evidence from Italy"
- 2012/28, **Solé-Ollé, A.; Viladecans-Marsal, E.:** "Do political parties matter for local land use policies?"
- 2012/29, **Buonanno, P.; Durante, R.; Prarolo, G.; Vanin, P.:** "Poor institutions, rich mines: resource curse and the origins of the Sicilian mafia"
- 2012/30, **Anghel, B.; Cabrales, A.; Carro, J.M.:** "Evaluating a bilingual education program in Spain: the impact beyond foreign language learning"
- 2012/31, **Curto-Grau, M.; Solé-Ollé, A.; Sorribas-Navarro, P.:** "Partisan targeting of inter-governmental transfers & state interference in local elections: evidence from Spain"
- 2012/32, **Kappeler, A.; Solé-Ollé, A.; Stephan, A.; Väilä, T.:** "Does fiscal decentralization foster regional investment in productive infrastructure?"
- 2012/33, **Rizzo, L.; Zanardi, A.:** "Single vs double ballot and party coalitions: the impact on fiscal policy. Evidence from Italy"
- 2012/34, **Ramachandran, R.:** "Language use in education and primary schooling attainment: evidence from a natural experiment in Ethiopia"
- 2012/35, **Rothstein, J.:** "Teacher quality policy when supply matters"
- 2012/36, **Ahlfeldt, G.M.:** "The hidden dimensions of urbanity"
- 2012/37, **Mora, T.; Gil, J.; Sicras-Mainar, A.:** "The influence of BMI, obesity and overweight on medical costs: a panel data approach"
- 2012/38, **Pelegrín, A.; García-Quevedo, J.:** "Which firms are involved in foreign vertical integration?"

2012/39, Agasisti, T.; Longobardi, S.: "Inequality in education: can Italian disadvantaged students close the gap? A focus on resilience in the Italian school system"

---

**2013**

---

2013/1, Sánchez-Vidal, M.; González-Val, R.; Viladecans-Marsal, E.: "Sequential city growth in the US: does age matter?"

2013/2, Hortas Rico, M.: "Sprawl, blight and the role of urban containment policies. Evidence from US cities"

2013/3, Lampón, J.F.; Cabanelas-Lorenzo, P.; Lago-Peñas, S.: "Why firms relocate their production overseas? The answer lies inside: corporate, logistic and technological determinants"

2013/4, Montolio, D.; Planells, S.: "Does tourism boost criminal activity? Evidence from a top touristic country"

2013/5, García-López, M.A.; Holl, A.; Viladecans-Marsal, E.: "Suburbanization and highways: when the Romans, the Bourbons and the first cars still shape Spanish cities"

2013/6, Bosch, N.; Espasa, M.; Montolio, D.: "Should large Spanish municipalities be financially compensated? Costs and benefits of being a capital/central municipality"

2013/7, Escardíbul, J.O.; Mora, T.: "Teacher gender and student performance in mathematics. Evidence from Catalonia"

2013/8, Arqué-Castells, P.; Viladecans-Marsal, E.: "Banking towards development: evidence from the Spanish banking expansion plan"

2013/9, Asensio, J.; Gómez-Lobo, A.; Matas, A.: "How effective are policies to reduce gasoline consumption? Evaluating a quasi-natural experiment in Spain"

2013/10, Jofre-Monseny, J.: "The effects of unemployment benefits on migration in lagging regions"

2013/11, Segarra, A.; García-Quevedo, J.; Teruel, M.: "Financial constraints and the failure of innovation projects"

2013/12, Jerrim, J.; Choi, A.: "The mathematics skills of school children: How does England compare to the high performing East Asian jurisdictions?"

2013/13, González-Val, R.; Tirado-Fabregat, D.A.; Viladecans-Marsal, E.: "Market potential and city growth: Spain 1860-1960"

2013/14, Lundqvist, H.: "Is it worth it? On the returns to holding political office"

2013/15, Ahlfeldt, G.M.; Maennig, W.: "Homevoters vs. leasevoters: a spatial analysis of airport effects"

2013/16, Lampón, J.F.; Lago-Peñas, S.: "Factors behind international relocation and changes in production geography in the European automobile components industry"

2013/17, Guío, J.M.; Choi, A.: "Evolution of the school failure risk during the 2000 decade in Spain: analysis of Pisa results with a two-level logistic model"

2013/18, Dahlby, B.; Rodden, J.: "A political economy model of the vertical fiscal gap and vertical fiscal imbalances in a federation"

2013/19, Acacia, F.; Cubel, M.: "Strategic voting and happiness"

2013/20, Hellenstein, J.K.; Kutzbach, M.J.; Neumark, D.: "Do labor market networks have an important spatial dimension?"

2013/21, Pellegrino, G.; Savona, M.: "Is money all? Financing versus knowledge and demand constraints to innovation"

2013/22, Lin, J.: "Regional resilience"

2013/23, Costa-Campi, M.T.; Duch-Brown, N.; García-Quevedo, J.: "R&D drivers and obstacles to innovation in the energy industry"

2013/24, Huisman, R.; Stradnic, V.; Westgaard, S.: "Renewable energy and electricity prices: indirect empirical evidence from hydro power"

2013/25, Dargaud, E.; Mantovani, A.; Reggiani, C.: "The fight against cartels: a transatlantic perspective"

2013/26, Lambertini, L.; Mantovani, A.: "Feedback equilibria in a dynamic renewable resource oligopoly: pre-emption, voracity and exhaustion"

2013/27, Feld, L.P.; Kalb, A.; Moessinger, M.D.; Osterloh, S.: "Sovereign bond market reactions to fiscal rules and no-bailout clauses – the Swiss experience"

2013/28, Hilber, C.A.L.; Vermeulen, W.: "The impact of supply constraints on house prices in England"

2013/29, Revelli, F.: "Tax limits and local democracy"

2013/30, Wang, R.; Wang, W.: "Dress-up contest: a dark side of fiscal decentralization"

2013/31, Dargaud, E.; Mantovani, A.; Reggiani, C.: "The fight against cartels: a transatlantic perspective"

2013/32, Saarimaa, T.; Tukiainen, J.: "Local representation and strategic voting: evidence from electoral boundary reforms"

2013/33, Agasisti, T.; Murtinu, S.: "Are we wasting public money? No! The effects of grants on Italian university students' performances"

2013/34, Flacher, D.; Harari-Kermadec, H.; Moulin, L.: "Financing higher education: a contributory scheme"

2013/35, Carozzi, F.; Repetto, L.: "Sending the pork home: birth town bias in transfers to Italian municipalities"

2013/36, Coad, A.; Frankish, J.S.; Roberts, R.G.; Storey, D.J.: "New venture survival and growth: Does the fog lift?"

2013/37, Giuliotti, M.; Grossi, L.; Waterson, M.: "Revenues from storage in a competitive electricity market: Empirical evidence from Great Britain"

---

## 2014

---

2014/1, Montolio, D.; Planells-Struse, S.: "When police patrols matter. The effect of police proximity on citizens' crime risk perception"

2014/2, García-López, M.A.; Solé-Ollé, A.; Viladecans-Marsal, E.: "Do land use policies follow road construction?"

2014/3, Piolatto, A.; Rablen, M.D.: "Prospect theory and tax evasion: a reconsideration of the Yitzhaki puzzle"

2014/4, Cuberes, D.; González-Val, R.: "The effect of the Spanish Reconquest on Iberian Cities"

2014/5, Durán-Cabré, J.M.; Esteller-Moré, E.: "Tax professionals' view of the Spanish tax system: efficiency, equity and tax planning"

2014/6, Cubel, M.; Sanchez-Pages, S.: "Difference-form group contests"

2014/7, Del Rey, E.; Racionero, M.: "Choosing the type of income-contingent loan: risk-sharing versus risk-pooling"

2014/8, Torregrosa Hetland, S.: "A fiscal revolution? Progressivity in the Spanish tax system, 1960-1990"

2014/9, Piolatto, A.: "Itemised deductions: a device to reduce tax evasion"

2014/10, Costa, M.T.; García-Quevedo, J.; Segarra, A.: "Energy efficiency determinants: an empirical analysis of Spanish innovative firms"

2014/11, García-Quevedo, J.; Pellegrino, G.; Savona, M.: "Reviving demand-pull perspectives: the effect of demand uncertainty and stagnancy on R&D strategy"

2014/12, Calero, J.; Escardíbul, J.O.: "Barriers to non-formal professional training in Spain in periods of economic growth and crisis. An analysis with special attention to the effect of the previous human capital of workers"

2014/13, Cubel, M.; Sanchez-Pages, S.: "Gender differences and stereotypes in the beauty"

2014/14, Piolatto, A.; Schuett, F.: "Media competition and electoral politics"

2014/15, Montolio, D.; Trillas, F.; Trujillo-Baute, E.: "Regulatory environment and firm performance in EU telecommunications services"

2014/16, Lopez-Rodriguez, J.; Martinez, D.: "Beyond the R&D effects on innovation: the contribution of non-R&D activities to TFP growth in the EU"

2014/17, González-Val, R.: "Cross-sectional growth in US cities from 1990 to 2000"

2014/18, Vona, F.; Nicolli, F.: "Energy market liberalization and renewable energy policies in OECD countries"

2014/19, Curto-Grau, M.: "Voters' responsiveness to public employment policies"

2014/20, Duro, J.A.; Teixidó-Figueras, J.; Padilla, E.: "The causal factors of international inequality in CO<sub>2</sub> emissions per capita: a regression-based inequality decomposition analysis"

2014/21, Fleten, S.E.; Huisman, R.; Kilic, M.; Pennings, E.; Westgaard, S.: "Electricity futures prices: time varying sensitivity to fundamentals"

2014/22, Afcha, S.; García-Quevedo, J.: "The impact of R&D subsidies on R&D employment composition"

2014/23, Mir-Artigues, P.; del Río, P.: "Combining tariffs, investment subsidies and soft loans in a renewable electricity deployment policy"

2014/24, Romero-Jordán, D.; del Río, P.; Peñasco, C.: "Household electricity demand in Spanish regions. Public policy implications"

2014/25, Salinas, P.: "The effect of decentralization on educational outcomes: real autonomy matters!"

2014/26, Solé-Ollé, A.; Sorribas-Navarro, P.: "Does corruption erode trust in government? Evidence from a recent surge of local scandals in Spain"

2014/27, Costas-Pérez, E.: "Political corruption and voter turnout: mobilization or disaffection?"

2014/28, Cubel, M.; Nuevo-Chiquero, A.; Sanchez-Pages, S.; Vidal-Fernandez, M.: "Do personality traits affect productivity? Evidence from the LAB"

2014/29, Teresa Costa, M.T.; Trujillo-Baute, E.: "Retail price effects of feed-in tariff regulation"

2014/30, Kilic, M.; Trujillo-Baute, E.: "The stabilizing effect of hydro reservoir levels on intraday power prices under wind forecast errors"

2014/31, Costa-Campi, M.T.; Duch-Brown, N.: "The diffusion of patented oil and gas technology with environmental uses: a forward patent citation analysis"

2014/32, Ramos, R.; Sanromá, E.; Simón, H.: "Public-private sector wage differentials by type of contract: evidence from Spain"

2014/33, Backus, P.; Esteller-Moré, A.: "Is income redistribution a form of insurance, a public good or both?"

2014/34, Huisman, R.; Trujillo-Baute, E.: "Costs of power supply flexibility: the indirect impact of a Spanish policy change"

- 2014/35, Jerrim, J.; Choi, A.; Simancas Rodríguez, R.: "Two-sample two-stage least squares (TSTSLS) estimates of earnings mobility: how consistent are they?"
- 2014/36, Mantovani, A.; Tarola, O.; Vergari, C.: "Hedonic quality, social norms, and environmental campaigns"
- 2014/37, Ferraresi, M.; Galmarini, U.; Rizzo, L.: "Local infrastructures and externalities: Does the size matter?"
- 2014/38, Ferraresi, M.; Rizzo, L.; Zanardi, A.: "Policy outcomes of single and double-ballot elections"

## 2015

- 2015/1, Foremny, D.; Freier, R.; Moessinger, M-D.; Yeter, M.: "Overlapping political budget cycles in the legislative and the executive"
- 2015/2, Colombo, L.; Galmarini, U.: "Optimality and distortionary lobbying: regulating tobacco consumption"
- 2015/3, Pellegrino, G.: "Barriers to innovation: Can firm age help lower them?"
- 2015/4, Hémet, C.: "Diversity and employment prospects: neighbors matter!"
- 2015/5, Cubel, M.; Sanchez-Pages, S.: "An axiomatization of difference-form contest success functions"
- 2015/6, Choi, A.; Jerrim, J.: "The use (and misuse) of Pisa in guiding policy reform: the case of Spain"
- 2015/7, Durán-Cabré, J.M.; Esteller-Moré, A.; Salvadori, L.: "Empirical evidence on tax cooperation between sub-central administrations"
- 2015/8, Batalla-Bejerano, J.; Trujillo-Baute, E.: "Analysing the sensitivity of electricity system operational costs to deviations in supply and demand"
- 2015/9, Salvadori, L.: "Does tax enforcement counteract the negative effects of terrorism? A case study of the Basque Country"
- 2015/10, Montolio, D.; Planells-Struse, S.: "How time shapes crime: the temporal impacts of football matches on crime"
- 2015/11, Piolatto, A.: "Online booking and information: competition and welfare consequences of review aggregators"
- 2015/12, Boffa, F.; Pingali, V.; Sala, F.: "Strategic investment in merchant transmission: the impact of capacity utilization rules"
- 2015/13, Slemrod, J.: "Tax administration and tax systems"
- 2015/14, Arqué-Castells, P.; Cartaxo, R.M.; García-Quevedo, J.; Mira Godinho, M.: "How inventor royalty shares affect patenting and income in Portugal and Spain"
- 2015/15, Montolio, D.; Planells-Struse, S.: "Measuring the negative externalities of a private leisure activity: hooligans and pickpockets around the stadium"
- 2015/16, Batalla-Bejerano, J.; Costa-Campi, M.T.; Trujillo-Baute, E.: "Unexpected consequences of liberalisation: metering, losses, load profiles and cost settlement in Spain's electricity system"
- 2015/17, Batalla-Bejerano, J.; Trujillo-Baute, E.: "Impacts of intermittent renewable generation on electricity system costs"
- 2015/18, Costa-Campi, M.T.; Paniagua, J.; Trujillo-Baute, E.: "Are energy market integrations a green light for FDI?"
- 2015/19, Jofre-Monseny, J.; Sánchez-Vidal, M.; Viladecans-Marsal, E.: "Big plant closures and agglomeration economies"
- 2015/20, Garcia-López, M.A.; Hémet, C.; Viladecans-Marsal, E.: "How does transportation shape intrametropolitan growth? An answer from the regional express rail"
- 2015/21, Esteller-Moré, A.; Galmarini, U.; Rizzo, L.: "Fiscal equalization under political pressures"
- 2015/22, Escardíbul, J.O.; Afcha, S.: "Determinants of doctorate holders' job satisfaction. An analysis by employment sector and type of satisfaction in Spain"
- 2015/23, Aidt, T.; Asatryan, Z.; Badalyan, L.; Heinemann, F.: "Vote buying or (political) business (cycles) as usual?"
- 2015/24, Albæk, K.: "A test of the 'lose it or use it' hypothesis in labour markets around the world"
- 2015/25, Angelucci, C.; Russo, A.: "Petty corruption and citizen feedback"
- 2015/26, Moriconi, S.; Picard, P.M.; Zanj, S.: "Commodity taxation and regulatory competition"
- 2015/27, Brekke, K.R.; Garcia Pires, A.J.; Schindler, D.; Schjelderup, G.: "Capital taxation and imperfect competition: ACE vs. CBIT"
- 2015/28, Redonda, A.: "Market structure, the functional form of demand and the sensitivity of the vertical reaction function"
- 2015/29, Ramos, R.; Sanromá, E.; Simón, H.: "An analysis of wage differentials between full-and part-time workers in Spain"
- 2015/30, Garcia-López, M.A.; Pasidis, I.; Viladecans-Marsal, E.: "Express delivery to the suburbs the effects of transportation in Europe's heterogeneous cities"
- 2015/31, Torregrosa, S.: "Bypassing progressive taxation: fraud and base erosion in the Spanish income tax (1970-2001)"

- 2015/32, Choi, H.; Choi, A.: "When one door closes: the impact of the hagwon curfew on the consumption of private tutoring in the republic of Korea"
- 2015/33, Escardíbul, J.O.; Helmy, N.: "Decentralisation and school autonomy impact on the quality of education: the case of two MENA countries"
- 2015/34, González-Val, R.; Marcén, M.: "Divorce and the business cycle: a cross-country analysis"
- 2015/35, Calero, J.; Choi, A.: "The distribution of skills among the European adult population and unemployment: a comparative approach"
- 2015/36, Mediavilla, M.; Zancajo, A.: "Is there real freedom of school choice? An analysis from Chile"
- 2015/37, Daniele, G.: "Strike one to educate one hundred: organized crime, political selection and politicians' ability"
- 2015/38, González-Val, R.; Marcén, M.: "Regional unemployment, marriage, and divorce"
- 2015/39, Foremny, D.; Jofre-Monseny, J.; Solé-Ollé, A.: "'Hold that ghost': using notches to identify manipulation of population-based grants"
- 2015/40, Mancebón, M.J.; Ximénez-de-Embún, D.P.; Mediavilla, M.; Gómez-Sancho, J.M.: "Does educational management model matter? New evidence for Spain by a quasiexperimental approach"
- 2015/41, Daniele, G.; Geys, B.: "Exposing politicians' ties to criminal organizations: the effects of local government dissolutions on electoral outcomes in Southern Italian municipalities"
- 2015/42, Ooghe, E.: "Wage policies, employment, and redistributive efficiency"

## 2016

- 2016/1, Galletta, S.: "Law enforcement, municipal budgets and spillover effects: evidence from a quasi-experiment in Italy"
- 2016/2, Flatley, L.; Giuliotti, M.; Grossi, L.; Trujillo-Baute, E.; Waterson, M.: "Analysing the potential economic value of energy storage"
- 2016/3, Calero, J.; Murillo Huertas, I.P.; Raymond Bara, J.L.: "Education, age and skills: an analysis using the PIAAC survey"
- 2016/4, Costa-Campi, M.T.; Daví-Arderius, D.; Trujillo-Baute, E.: "The economic impact of electricity losses"
- 2016/5, Falck, O.; Heimisch, A.; Wiederhold, S.: "Returns to ICT skills"
- 2016/6, Halmenschlager, C.; Mantovani, A.: "On the private and social desirability of mixed bundling in complementary markets with cost savings"
- 2016/7, Choi, A.; Gil, M.; Mediavilla, M.; Valbuena, J.: "Double toil and trouble: grade retention and academic performance"
- 2016/8, González-Val, R.: "Historical urban growth in Europe (1300–1800)"
- 2016/9, Guio, J.; Choi, A.; Escardíbul, J.O.: "Labor markets, academic performance and the risk of school dropout: evidence for Spain"
- 2016/10, Bianchini, S.; Pellegrino, G.; Tamagni, F.: "Innovation strategies and firm growth"
- 2016/11, Jofre-Monseny, J.; Silva, J.I.; Vázquez-Grenno, J.: "Local labor market effects of public employment"
- 2016/12, Sanchez-Vidal, M.: "Small shops for sale! The effects of big-box openings on grocery stores"
- 2016/13, Costa-Campi, M.T.; García-Quevedo, J.; Martínez-Ros, E.: "What are the determinants of investment in environmental R&D?"
- 2016/14, García-López, M.A.; Hémet, C.; Viladecans-Marsal, E.: "Next train to the polycentric city: The effect of railroads on subcenter formation"
- 2016/15, Matas, A.; Raymond, J.L.; Dominguez, A.: "Changes in fuel economy: An analysis of the Spanish car market"
- 2016/16, Leme, A.; Escardíbul, J.O.: "The effect of a specialized versus a general upper secondary school curriculum on students' performance and inequality. A difference-in-differences cross country comparison"
- 2016/17, Scandurra, R.I.; Calero, J.: "Modelling adult skills in OECD countries"
- 2016/18, Fernández-Gutiérrez, M.; Calero, J.: "Leisure and education: insights from a time-use analysis"
- 2016/19, Del Rio, P.; Mir-Artigues, P.; Trujillo-Baute, E.: "Analysing the impact of renewable energy regulation on retail electricity prices"
- 2016/20, Taltavull de la Paz, P.; Juárez, F.; Monllor, P.: "Fuel Poverty: Evidence from housing perspective"
- 2016/21, Ferraresi, M.; Galmarini, U.; Rizzo, L.; Zanardi, A.: "Switch towards tax centralization in Italy: A wake up for the local political budget cycle"
- 2016/22, Ferraresi, M.; Migali, G.; Nordi, F.; Rizzo, L.: "Spatial interaction in local expenditures among Italian municipalities: evidence from Italy 2001-2011"
- 2016/23, Daví-Arderius, D.; Sanin, M.E.; Trujillo-Baute, E.: "CO2 content of electricity losses"
- 2016/24, Arqué-Castells, P.; Viladecans-Marsal, E.: "Banking the unbanked: Evidence from the Spanish banking expansion plan"
- 2016/25 Choi, Á.; Gil, M.; Mediavilla, M.; Valbuena, J.: "The evolution of educational inequalities in Spain: Dynamic evidence from repeated cross-sections"

**2016/26, Brutti, Z.:** “Cities drifting apart: Heterogeneous outcomes of decentralizing public education”

**2016/27, Backus, P.; Cubel, M.; Guid, M.; Sánchez-Pages, S.; Lopez Manas, E.:** “Gender, competition and performance: evidence from real tournaments”

**2016/28, Costa-Campi, M.T.; Duch-Brown, N.; García-Quevedo, J.:** “Innovation strategies of energy firms”

**2016/29, Daniele, G.; Dipoppa, G.:** “Mafia, elections and violence against politicians”



UNIVERSITAT DE  
BARCELONA

 **IEB**  
Institut  
d'Economia  
de Barcelona

[ieb@ub.edu](mailto:ieb@ub.edu)  
[www.ieb.edu](http://www.ieb.edu)

Energy Sustainability

IEB Working Paper