

SERBIAN JOURNAL OF ELECTRICAL ENGINEERING  
Vol. 9, No. 3, October 2012, 393-401

UDK: 621.316.99

DOI: 10.2298/SJEE1203393V

## Study on a Standard for Grounding Systems Realization

Dragan D. Vučković<sup>1</sup>, Nenad N. Cvetković<sup>1</sup>, Miodrag S. Stojanović<sup>1</sup>

**Abstract:** Grounding systems of objects inside power facilities are very often realized as structures consisting of protective electrodes' system placed in the object foundation, and neutral electrodes' system placed at a specified distance from the object. Official standards and publications recommend a minimal value for the distance between the protective and the neutral part of grounding structures, so that the influence of one on another can be neglected. We analyze several practical implementations of grounding structures and demonstrate that the minimal distance is actually much smaller than that recommended by the standards.

**Keywords:** Grounding electrode, Grounding system, Method of Moments, Power station, Resistance.

### 1 Introduction

The power stations' grounding system usually consists of the protective and the neutral electrodes' system. Official publications as [1] include standards dealing with the recommended value of the minimal distance between those two parts of the grounding system. It is assumed that at distances larger than recommended, the mutual (undesirable) influence between the parts of the grounding system can be neglected. This practically means that less than 40% of the total voltage is transmitted between two electrode systems. The degree of this influence corresponds to the ratio between the values of the mutual resistance between the systems and the total resistance of the grounding system.

The grounding system has been analyzed using the Method of Moments [2], and the approach applied in [3 – 13]. Quasi-stationary regime and constant leakage currents from electrodes' surfaces are assumed. The proposed approach can be also applied to other wire electrodes' systems. Because of that, the procedure is first introduced for two wire electrodes' system. Afterwards, the method is applied on analysis of particular typical grounding system with the protective electrodes' system consisting of a square-shaped contour and straight wires, and the neutral electrodes' system formed of three straight wires.

---

<sup>1</sup>University of Niš, Faculty of Electronic Engineering, A. Medvedeva 14, 18000 Niš, Serbia; E-mails: dragan.vuckovic@elfak.ni.ac.rs; nenad.cvetkovic@elfak.ni.ac.rs; miodrag.stojanovic@elfak.ni.ac.rs


Based on the obtained results, one can conclude that distances between two parts of the grounding system may have smaller values than the recommended ones. Note that official standards do not provide rationale for choosing the recommended values for minimal distances.

The aim of this paper is not an ambition to unconditionally change recommended distances. The idea is to put this question into the public and try to get somewhat more detailed explanation that would justify the recommended values.

## 2 Theoretical Background

### 2.1 General problem

We consider a system consisting of the total of  $N = N_1 + N_2$  linear conductors, where  $N_1$  conductors are fed by common isolated earthing conductor with a current  $I_{g1}$ , and  $N_2$  conductors are fed with common supplying current  $I_{g2}$ . The system is depicted in Fig. 1.

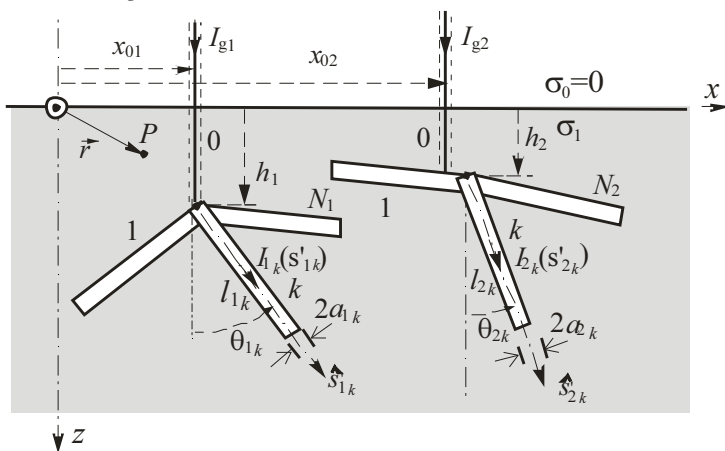

**Fig. 1** – Illustration of two coupled linear grounding systems.

The linear ground conductors of length  $l_{ik}$  and circular cross-section radius  $a_{ik}$ ,  $a_{ik} \ll l_{ik}$ ,  $k = 1, 2, \dots, N_i$ ,  $i = 1, 2$  are placed in homogeneous ground.

The ground is treated as isotropic media having known electrical conductivity  $\sigma_1$ . We use the following reflection and transmission coefficients:

$$R_{10} = (\sigma_1 - \sigma_0) / (\sigma_1 + \sigma_0) \quad (1)$$

and

$$T_{10} = 2\sigma_1 / (\sigma_1 + \sigma_0) \quad (2)$$

are reflection and transmission coefficients, respectively.

Electric scalar potential of the system at the ground point P, defined by vector  $\vec{r}$ , is

$$\begin{aligned} \phi_1(\vec{r}) &= \phi_{10}(\vec{r}) + \phi_{11}(\vec{r}) = \\ &= \frac{1}{4\pi\sigma_1} \left[ \sum_{i=1}^2 \frac{T_{10} I_{gi}}{|\vec{r} - x_{0i} \hat{x}|} + \sum_{i=1}^2 \sum_{k=0}^{N_i} \int_{s'_{ik}=0}^{l_{ki}} I_{ik}(s'_{ik}) \frac{\partial}{\partial s'_{ik}} K(\vec{r}, s'_{ik}) ds'_{ik} \right], \end{aligned} \quad (3)$$

where  $x_{0i}$ ,  $i=1,2$  denote the positions of the supplying points at the ground surface,  $I_{ik}(s'_{ik})$  is longitudinal current distribution and  $K(\vec{r}, s'_{ik})$  is a kernel of the form,

$$K(\vec{r}, s'_{ik}) = (1/r_{1k}) + (R_{10}/r_{2k}). \quad (4)$$

In (2),  $r_{1k}$  and  $r_{2k}$  are distances between the point P and conductor current element, and its image in modified flat mirror, respectively.

Matching the electric scalar potential value (1) at the conductors surface points  $P_n$ ,  $\phi_1 \cong U_n$ , the following system of integral equations is obtained:

$$U_n = \frac{1}{4\pi\sigma_1} \left\{ \sum_{i=1}^2 \sum_{k=1}^{N_i} [I_{ik}(l_{ik})K(s_n, l_{ik}) - \int_{s'_{ik}=0}^{l_{ik}} I'_{ik}(s'_{ik})K(s_n, s'_{ik}) ds'_{ik}] \right\}, \quad n=1,2, \quad (5)$$

where:  $I_{ik}(l_{ik})$  are currents at endings of ground electrodes,  $I'_{ik}(s'_{ik}) = -\partial I_{ik} / \partial s'_{ik}$  are leakage currents density per unit length and  $s_n$  denotes distance between the matching point  $P_n$  at the  $n$ -th conductor surface and its origin.

The solution of the equation system (5) is current distribution along the conductors  $I_{ik}(s'_{ik})$ ,  $k=1,2,\dots,N_i$ ,  $i=1,2$ , where feeding currents satisfy conditions

$$\sum_{k=1}^{N_i} I_{ik}(0) = I_{gi}, \quad i=1,2. \quad (6)$$

Assuming polynomial form of the current distribution [14]:

$$I_{ik}(s'_{ik}) = \sum_{m=0}^{M_k} I_{ikm} (s'_{ik} / l_{ik})^m, \quad k=1,2,\dots,N_i, \quad i=1,2, \quad (7)$$

where  $I_{km}$ ,  $k=1,2,\dots,N_i$ ,  $m=0,1,\dots,M_k$  are unknown coefficients (dimensionally equal to currents), the system (5) transforms into

$$U_n = \frac{1}{4\pi\sigma_1} \left\{ \sum_{i=1}^2 \sum_{k=1}^{N_i} \sum_{m=0}^{M_k} I_{ikm} \left[ K(s_n, l_{ik}) - \frac{m}{l_{ik}} \int_{s'_{ik}=0}^{l_{ik}} \left( \frac{s'_{ik}}{l_{ik}} \right)^{m-1} K(s_n, s'_{ik}) ds'_{ik} \right] \right\}, \quad n=1,2. \quad (8)$$

The total number of unknown coefficients in (8) is  $N_u = \sum_{i=1}^2 \sum_{k=1}^{N_i} (M_k + 1)$  and there are  $N_1 + N_2$  boundary conditions for currents:

$$I_{ik}(s'_{ik} = l_{ik}) = 0, \quad k = 1, 2, \dots, N_i, \quad i = 1, 2. \quad (9)$$

The rest of the linear equations is formed by matching voltages from (8) at the conductors surfaces points defined with

$$s_{nj} = \frac{j}{M_k + 1} I_{ik}, \quad j = 1, 2, \dots, M_k, \quad k = 1, 2, \dots, N_i, \quad i = 1, 2. \quad (10)$$

After solving the system given with (8) and (9), the coefficients in (7), i.e., current distribution along the conductors are obtained.

The equation system (8) with conditions (9) is solved for two regimes of feeding: symmetric ( $U_1 = U_2 = U_s = 1$  V) and anti-symmetric ( $U_1 = U_2 = U_a = -1$  V). After determining coefficients in equation (7) the feeding currents  $I_{gk}^{s/a}$ ,  $k = 1, 2$  are obtained using equation (6). Labels “s/a” denote solution for the currents corresponding to the supplying potential  $U_s$  – symmetric, i.e.  $U_a$  – anti-symmetric.

In the general case the following relations between electrodes voltage and their feeding currents exist:

$$U_1 = R_{11}I_{g1} + R_{12}I_{g2}, \quad U_2 = R_{21}I_{g1} + R_{22}I_{g2}. \quad (11)$$

In (9),  $R_{11}$  and  $R_{22}$  are self-impedances of the electrode system 1 and 2, while  $R_{12} = R_{21}$  are mutual-impedances between two systems. “ $R$ ” parameters represent integral grounding system characteristics and measure of mutual influence level between coupled wire electrodes systems

## 2.2 Application on one standard grounding system

The analyzed grounding system, presented in Fig. 2, is placed in the linear, isotropic and homogeneous ground of specific conductivity  $\sigma_1$ , while specific conductivity of the air is  $\sigma_0 \approx 0$ . Consequently,  $R_{10} = 1$  and  $T_{10} = 2$ . The protective and the neutral electrode structures are formed of  $N_1 = 8$  straight wire electrodes, and of  $N_2 = 6$  conductors, respectively. The feeding currents corresponding to these two components of the grounding system are  $I_{g1}$  and  $I_{g2}$ , respectively. It is assumed that leakage current is constant, i.e. in (7) is  $M_1 = M_2 = 1$ .

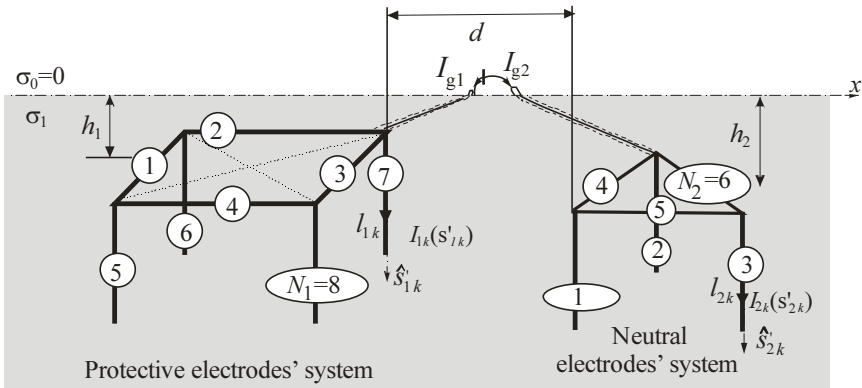


Fig. 2 – Grounding system.

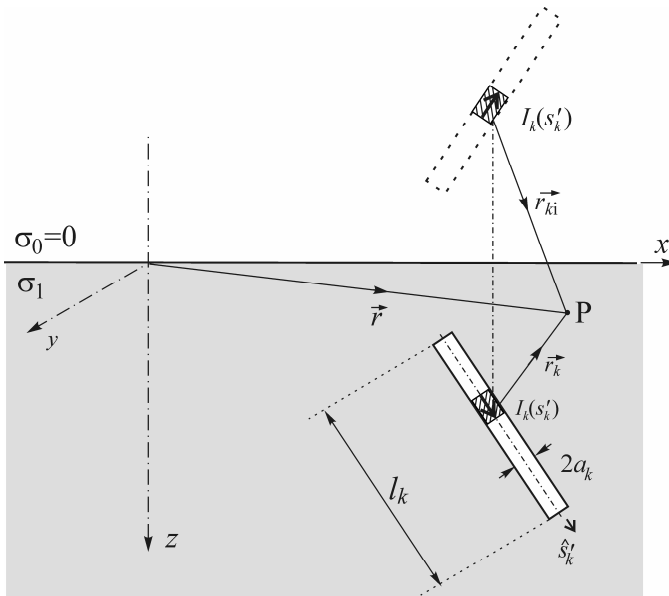


Fig. 3 – Schema for the electric scalar potential expression (12).

The potential of the system at the arbitrary point P in the ground (Fig. 3) can be expressed as

$$\phi(\vec{r}) = \sum_{j=1}^2 \sum_{k=1}^{N_j} \frac{I_{jk}}{4\pi\sigma_1 l_{jk}} \int \left( \frac{1}{r_k} + \frac{1}{r_{ki}} \right) ds'_{jk} \quad (12)$$

where  $l_{jk}$ , and  $I_{jk}$ ,  $j = 1, 2$ ,  $k = 1, 2, \dots, N_j$  are length of the wires and total leakage currents of the wires, respectively. Also in (1),  $r_k$  and  $r_{ki}$  denote distances between the current element and its image from the field point, respectively, as

it has been shown in Fig. 2. Applying the Method of Moments [2] and matching the potential value at points on the protective electrodes' system wires defined by field vectors  $\vec{r}_{pn}$ ,  $n=1,2,\dots,N_1$ , and at points on the neutral electrodes' system  $\vec{r}_{pm}$ ,  $m=1,2,\dots,N_2$ , the following system of integral equations is formed

$$\begin{aligned} \phi(\vec{r} = \vec{r}_{pn}) &\cong U_1, \quad n=1,2,\dots,N_1, \\ \phi(\vec{r} = \vec{r}_{pm}) &\cong U_2, \quad m=1,2,\dots,N_2. \end{aligned} \quad (13)$$

Total feeding currents of the parts of the grounding systems are

$$I_{g1} = \sum_{k=1}^{N_1} I_{1k} \quad \text{and} \quad I_{g2} = \sum_{k=1}^{N_2} I_{2k}. \quad (14)$$


Based on these solutions, the solution for self- ( $R_{11}$  and  $R_{22}$ ) and mutual-resistances ( $R_{12}$  and  $R_{21}$ ) of the electrode system are obtained (11).

If the electrodes are connected, i.e. they form a single grounding system, by substituting  $U_1=-U_2=1$  V in (13), grounding resistance can be determined as


$$R_T = 1 / (I_{g1} + I_{g2}) = \frac{R_{11}R_{22} - R_{12}R_{21}}{R_{11} + R_{22} - R_{12} - R_{21}}. \quad (15)$$

### 3 Numerical Results


The grounding system consisting of the protective and the neutral electrodes' systems from Fig. 2 is analyzed. The protective system is formed of four wires of length  $l_n=5$  m,  $n=1,\dots,4$ , and four vertical wires of length  $l_n=3$  m,  $n=5,\dots,8$ . The neutral system consists of three vertical wire electrodes of length  $l_m=3$  m,  $m=1,2,3$ , mutually connected with three horizontal wires of length  $l_m=10$  m,  $m=4,5,6$ . It is maximal recommended value for the distance between vertical conductors of neutral electrodes' system according to [1].

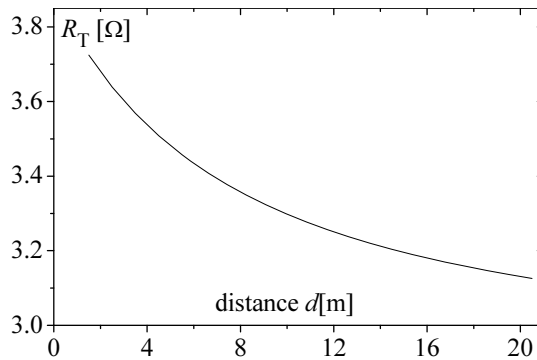

**Fig. 4** – Total resistance of the grounding system from Fig. 2 vs. distance  $d$ .

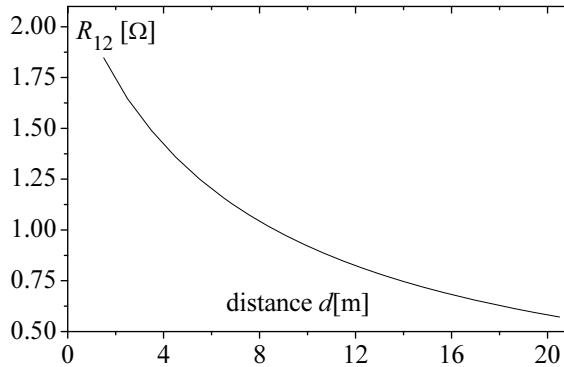

**Fig. 5** – Mutual resistance of the grounding system from Fig. 2 vs. distance  $d$ .

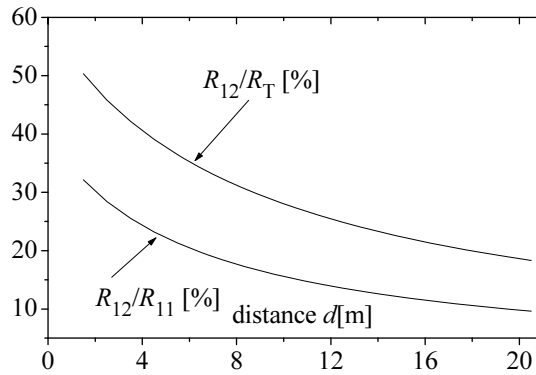

**Fig. 6** – The ratios between mutual resistance and self-resistance of protective electrodes' system, i.e. the total resistance of the grounding system vs. distance  $d$ . (Fig. 2).

Both systems are placed at depth  $h_1 = h_2 = 0.8$  m. The radius of the wires  $n = 1, \dots, 8$  and  $m = 1, 2, 3$  is 31.5 mm. The conductors  $m = 4, 5, 6$  are strip conductors (FeZn) of cross-section  $(30 \times 4) \text{ mm}^2$ . Their equivalent radius, determined using the procedure from [5] is 9.7 mm. The values correspond to the grounding system realized according to [1]. The value of  $\sigma_1 = 0.001 \text{ S/m}$  is adopted for the specific conductivity of the ground [15].

The total system resistance  $R_T$  and the mutual resistance between the systems  $R_{12}$  versus the distance between protective and neutral systems  $d$  are shown in Figs. 4 and 5 respectively.

The ratios between mutual-resistance  $R_{12}$  and self-resistance of the of the protective electrodes' system  $R_{11}$  i.e. total system resistance versus the distance

between protective and neutral systems  $d$ , are shown in Fig. 6. The results given in Fig. 6 do not depend on the specific conductivity value, since the ratios between the obtained values are presented. One can conclude that desirable ratio of the influence (less than 40 %) exists for the distances much smaller than recommended 20 m [1].

## **4 Conclusion**

The characteristics of a typical grounding system formed of the protective and the neutral electrodes' system are determined in the paper. The mutual influence of those two electrode systems is particularly analyzed. It has been shown that this influence is satisfactory small for the distances that are smaller than the ones recommended in publications available to authors. It can be assumed that authors of this publication took some other problem aspects into consideration, since simple numerical analysis based on usual procedures gave above mentioned results.

## **5 Acknowledgment**

This paper is supported in part by project grant TR33008 financed by Ministry of Education and Science Republic of Serbia.

## **6 References**

- [1] Grounding of the Power Network Pillars, TR No. 7 (Technical Recommendation of Electric Power Industry of Serbia, Belgrade, Serbia, 2000) (in Serbian). Available online at: <http://www.eps.rs/SiteCollectionDocuments/TP%207.pdf>, <http://www.eps.rs/SiteCollectionDocuments/TEHNICKA%20PREPORUKA%207%20KOMENTAR.pdf>.
- [2] R.F. Harrington: Field Computation by Moment Methods, New York, The Macmillan Company, 1969.
- [3] N.N. Cvetković, P.D. Rančić: A Simple Model for a Numerical Determination of Electrical Characteristics of a Pillar Foundation Grounding System, Engineering Analysis with Boundary Elements, Vol. 33, No. 4, April 2009, pp. 555 – 560.
- [4] N.N. Cvetković, P.D. Rančić: Model for Analyzing a Pillar Grounding System with Cylindrically-shaped Concrete Foundation, Electromagnetics, Vol. 29, No. 2, Feb. 2009, pp. 151 – 164.
- [5] N.N. Cvetković, P.D. Rančić: Influence of Foundation on Pillar Grounding System's Characteristics, COMPEL: The International Journal for Computation and Mathematics in Electrical and Electronic Engineering, Vol. 28, No. 2, 2009, pp. 471 – 492.
- [6] P.D. Rančić, N.N. Cvetković: Pillar Star-shaped Grounding System, Przegląd Elektrotehniczny (Electrical Review), Vol. 86, No. 5, May 2010, pp. 100 – 104.
- [7] N.N. Cvetković, P.D. Rančić: The Influence of Semi-spherical Inhomogeneity on the Linear Grounding System Characteristics, Facta Universitatis – Series Electronics and Energetics, Vol. 20, No. 2, Aug. 2007, pp. 147 – 161.



- [8] P.D. Rančić, N.N. Cvetković: Current Distribution and Impedance of Ring Electrode Pillar Grounding System: Quasistationary Antenna Model, 8th International Conference on Telecommunications in Modern Satellite, Cable and Broadcasting Services – TELSISKS 2007, Niš, Serbia, 26 – 28 Sept. 2007, Vol. 2, pp. 569 – 572.
- [9] P.D. Rančić, N.N. Cvetković: Square Shaped Electrode as Pillar Grounding System, 9th International Conference on Telecommunications in Modern Satellite, Cable and Broadcasting Services – TELSISKS 2009, 07-09 Oct. 2009, Niš, Serbia, Vol. 2, pp. 351 – 354.
- [10] P.D. Rančić, L.V. Stefanović, Đ.R. Đorđević: An Improved Linear Grounding System Analysis in Two-layer Earth, IEEE Transaction on Magnetics., Vol. 32, No. 5, Sept. 1996, pp. 5179 – 5187.
- [11] P.D. Rančić, S.Z. Đokić, Z.P. Stajić: Vertical Ground Rod (VGR) in Inhomogeneous Earth of Sectoral Type, Electronics Letters, Vol. 30, No. 19, Sept. 1994, pp. 1562 – 1564.
- [12] N.N. Cvetković, P.D. Rančić: Star-shaped Grounding System in the Vicinity of a Semi-spherical Inhomogeneity, 14th International IGTE Symposium, Graz, Austria, 20 – 22 Sept. 2010, pp. 124 – 129.
- [13] N.N. Cvetković: Modelling of Hemispherical Ground Inhomogeneities, 10th International Conference on Telecommunications in Modern Satellite, Cable and Broadcasting Services – TELSISKS 2011, 05 – 08 Oct. 2011, Niš, Serbia, Vol. 2, pp. 436 – 439.
- [14] B. Popović: Polynomial Approximation of Current along Thin Symmetrical Cylindrical Dipole, Proceedings of the Institution of Electrical Engineers, Vol. 117, No. 5, May 1970, pp. 873 – 878.
- [15] T. Saarenketo: Electrical Properties of Road Materials and Subgrade Soils and the use of Ground Penetrating Radar in Traffic Infrastructure Surveys, PhD Thesis, University of Oulu Finland, Nov. 2006.