

General Disclaimer

One or more of the Following Statements may affect this Document

- This document has been reproduced from the best copy furnished by the organizational source. It is being released in the interest of making available as much information as possible.
- This document may contain data, which exceeds the sheet parameters. It was furnished in this condition by the organizational source and is the best copy available.
- This document may contain tone-on-tone or color graphs, charts and/or pictures, which have been reproduced in black and white.
- This document is paginated as submitted by the original source.
- Portions of this document are not fully legible due to the historical nature of some of the material. However, it is the best reproduction available from the original submission.

DOE/NASA/10769-27
NASA TM-82909


(NASA-TM-82909) OPTIMIZATION OF THE OXIDANT
SUPPLY SYSTEM FOR COMBINED CYCLE MHD POWER
PLANTS (NASA) 14 p HC A02/MF A01

N82-26790

G3/44 Unclas
28102

Optimization of the Oxidant Supply System for Combined Cycle MHD Power Plants

Albert J. Juhasz
National Aeronautics and Space Administration
Lewis Research Center

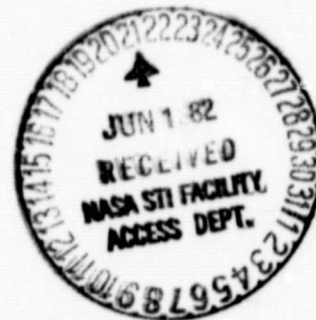

Work performed for
U.S. DEPARTMENT OF ENERGY
Fossil Energy
Office of Magnetohydrodynamics

Prepared for
Twentieth Symposium on the Engineering Aspects
of Magnetohydrodynamics
Irvine, California, June 14-16, 1982

NOTICE

This report was prepared to document work sponsored by the United States Government. Neither the United States nor its agent, the United States Department of Energy, nor any Federal employees, nor any of their contractors, subcontractors or their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product or process disclosed, or represents that its use would not infringe privately owned rights.

THIS DOCUMENT HAS BEEN
CHECKED 6-21/82
[Signature]

Optimization of the Oxidant Supply System for Combined Cycle MHD Power Plants

Albert J. Juhasz
National Aeronautics and Space Administration
Lewis Research Center
Cleveland, Ohio 44135

Work performed for
U.S. DEPARTMENT OF ENERGY
Fossil Energy
Office of Magnetohydrodynamics
Washington, D.C. 20545
Under Interagency Agreement DE-AI01-77ET10769

Prepared for
Twentieth Symposium on the Engineering Aspects
of Magnetohydrodynamics
Irvine, California, June 14-16, 1982

OPTIMIZATION OF THE OXIDANT SUPPLY SYSTEM FOR COMBINED CYCLE MHD POWER PLANTS

A. J. Juhasz
NASA-Lewis Research Center
Cleveland, Ohio

Abstract

An in-depth study was conducted, both under contract and in-house, to determine what, if any, improvements could be made on the oxidant supply system for combined cycle MHD power plants which would be reflected in higher thermal efficiency and a reduction in the cost of electricity, COE. The study included a systematic analysis of "air-separation" process variations which showed that the specific energy consumption could be minimized when the product stream oxygen concentration is about 70 mole percent. The use of advanced air compressors, having variable speed and guide vane position control, results in additional power savings. The study also led to the conceptual design of a new air separation process, sized for a 500 MW_e MHD plant, referred to as "internal compression." In addition to its lower overall energy consumption, potential capital cost savings have been identified for air separation plants using this process when constructed in a single large air separation train rather than multiple parallel trains, typical of conventional practice.

The effect of the lower energy consumption of the new air separation process on major MHD plant parameters such as thermal efficiency and magnetic energy requirement was calculated for a range of channel lengths and for various oxidant stream compositions. The process was shown to bring about an increase in overall plant thermal efficiency of 0.6 percent while allowing more favorable tradeoffs between magnetic energy and oxygen system capacity.

I. Introduction

Oxygen enrichment of the MHD combustor oxidant stream at low and intermediate preheat temperatures has been identified as a viable alternative to systems using indirectly fired high temperature air heaters.^{1,2,3} These studies identified the attractiveness of MHD/steam power plants using intermediate temperature recuperative preheat and oxygen enrichment of the combustor oxidizer for early commercial MHD power plants. Detailed MHD plant performance calculations considering oxygen enriched MHD combustion air⁴ showed that the energy consumption required for oxygen production has a significant impact on the overall results. Although energy consumption values required for oxygen production by air separation plants delivering a high purity oxygen product (above 99 mol percent O₂) range from 280 to 300 kWh/ton of pure O₂, considerable energy savings can be achieved by using a medium purity product (60 to 80 mol percent O₂) for blending with air to produce the required MHD combustor oxidant stream whose oxygen concentration may range from 25 to 40 mol percent.

Such a "medium purity" air separation plant was placed in service by Linde A.G. for the Thyssen Steel Works, Germany, in 1973.^{5,6} This plant delivers a 70,000 normal cubic meters per hour (ncmh) (43,500 scfm) product stream at near atmospheric pressure containing 60 mol percent oxygen which is blended with air to form a blast furnace stream of 283 000 ncmh (176,000 scfm) containing 30.6 mol percent oxygen. The plant's specific energy consumption (SEC) is reported at 224 kWh per ton of equivalent pure oxygen (TEPO).

The present study was managed by NASA LeRC for DOE under Interagency Agreement No. EF-77-A-01-2674. The Lotepro Co. of New York, NY a subsidiary of Linde A.G., FRG (Germany) was the main contractor under contract DEN3-165. Also supplying data were Linde A.G. and a number of industrial compressor manufacturers; notably, Demag-Mannesman Co., Dresser Industries, Inc., MAN/GHH Co., Sulzer Brothers, Inc., and Transamerica De-Laval, Inc.

The study objectives and preliminary results have been reported on previously in its early stage.⁷ The main objective was to explore process variations for their potential reduction in SEC below the 224 kWh/TEPO quoted above. The work has recently been completed, and a comprehensive report is in preparation. The present paper summarizes the main results of the study, including a brief description of a new air separation process applicable to thermodynamic cycles requiring pressurized oxidant streams, and its effect on the performance of a 500 MW_e combined cycle MHD power plant.

II. Cryogenic Air Separation Process

Before discussing the study results, a brief review of the basic cryogenic air separation process is in order.

Cryogenic air separation processes utilize the difference in boiling points of the various air components (principally N₂ and O₂) and the changes in boiling points with pressure to achieve component separation by fractional distillation. The basic process utilizes a number of auxiliary components (compressors, expanders, heat exchangers, adsorbers, switching valves) whose function is to change the state of the input air stream so that component separation can take place, and also to condition the output streams (product oxygen and nitrogen) to user requirements. The actual separation or rectification process is usually carried out in "double rectification columns" consisting of an upper compartment operated at low pressure (near atmospheric in most cases) and a lower compartment operated at higher pressure. The lower compartment is usually referred to as the medium pressure column, the upper, as the low pressure

column. Both columns are equipped with a number of perforated separation trays, the use of which brings about a series of fractional evaporations and condensations between a rising vapor, that is successively enriched in nitrogen, and a falling liquid, which is being enriched in oxygen at each stage. The process requirement for this heat and mass transfer to occur in the two phase-two component countercurrent flow environment dictates the pressure difference between the two columns and thereby specifies the process energy input required for the Air Separation Unit (ASU) air compressor. This is because nitrogen, which at atmospheric pressure has a lower boiling point than the desired product oxygen, must condense at the top of the medium pressure column in order to evaporate product oxygen at the bottom of the low pressure column. The only way this requirement can be met is for the condensation of N_2 to take place at a higher pressure than that of the evaporating product O_2 . It should be noted that the higher the desired O_2 concentration (purity) of the product, which is collecting at the bottom of the low pressure column, the greater the pressure difference requirement between the two columns and the higher the compressor power input for the same input air flow.

Basic Air Separation Plant

A schematic of a conventional air separation plant based on the process described above is shown in figure 1. Its main components are:

- Air compressor, (CP)
- Adsorbers for the removal of water and carbon dioxide, (WS, MS1, MS2)
- Expansion turbine for the production of refrigeration, (T)
- Heat exchangers for cooling the air to liquefaction temperature and warming the oxygen and nitrogen products to ambient temperature, (E)
- Rectification columns, (C1 and C2) and condenser-evaporator, (K) for the separation of air into O_2 and N_2 on the basis of vapor-to-liquid heat exchange and mass transfer

In many plants the removal of water and carbon dioxide is combined with the cooling of the air. This is done in reversing heat exchangers or regenerators. The flow paths of the air and product streams can be traced on figure 1. Filtered atmospheric air is compressed in an intercooled and aftercooled air compressor, CP, to a pressure which is determined by the requirements of the particular process, usually 4 to 6 bars. It is then passed through the water separator, WS, and adsorbers, MS, to the heat exchangers, E, and cooled to about 100°K with the aid of expansion turbine, T. The cold air is injected as a saturated vapor into the medium-pressure column, C1, where it is separated into a nitrogen fraction and the so-called rich liquid fraction, which contains about 40 percent oxygen. The separation is obtained by contacting the rising vapor with liquid nitrogen flowing down from the condenser-evaporator, K. This causes the liquid collecting in the kettle at the bottom of C1 to become enriched in oxygen while the vapor, which is condensed at the top of C1, is enriched in nitrogen. Both fractions leave C1 in

the liquid state and flow through expansion valves to the low-pressure column, C2, where additional rectification to the final product purity takes place. Both nitrogen and product oxygen leave column C2 in the gaseous state at near atmospheric pressure and are heated in heat exchanger E before being ducted to the user. Note that for applications, such as MHD, requiring lower O_2 concentrations than those of typical medium purity ASU products, the product stream is mixed with atmospheric air before compression in specially designed uncooled oxygen-enriched air compressors as indicated by oxidant compressor, OC, in figure 1. Moreover, as shown in the appendix at the end of this paper, the mixing of air separation plant product and air, to obtain mixtures containing certain mole percentages of O_2 , will result in slightly different mixture compositions than those obtained by mixing pure oxygen with air.

III. Process Study and Results

Summary of Process Variations

The approach used was to do a systematic analysis of as many as 18 process variations for an oxidant supply system sized for a 1000 MW_e MHD/steam power plant. The oxidant supply system included the air separation plant as well as the final oxidant mixing chamber and oxygen enriched air compressor. Delivery pressure of the oxidant stream to the MHD combustor was specified at 8 atm and the O_2 concentration of the oxidant stream was 30.6 mol percent. The process parameters varied in the study were product O_2 concentration which was ranged from 30.6 to 99.5 mol percent O_2 , and the upper column pressure which was varied from 1 atm to 8 atm, with the high pressure cases also providing pressurized N_2 for power recovery. For each process studied both total power consumption and relative cost figures were obtained.

Results showed that the atmospheric upper column pressure cases, in which the product is mixed with ambient air prior to compression to combustor pressure, were superior to the high pressure upper column cases, both in total power consumption and in capital cost.⁷ Figure 2 shows specific energy consumption, SEC, as a function of product purity for the atmospheric product cases. Note that the results represent a tradeoff between the ASU input air compressor pressure ratio requirement, which increases with product purity, and the ASU input air compressor flow requirement, which decreases with product purity. The SEC is shown to drop from 255 kWh/TEPO at 40 percent product purity to 195 kWh/TEPO at 70 to 80 percent purity and increase to near 240 kWh/TEPO for the high purity product. Hence the optimum (minimum compressor power) tradeoff between compressor flow and pressure ratio occurs at product purities between 70 to 80 percent. Since MHD applications require combustor oxidant O_2 concentrations (25 to 40 mole percent) well below the product purities at which compressor power is minimized, the more efficient medium purity air separation processes are compatible with MHD/steam power cycles. Based on these results a plant delivering a 70 mol percent O_2 product at one atmosphere was chosen for use in the 200 MW_e Engineering Test Facility (ETF) Conceptual Design.⁸

New Air Separation Process

Having considered the available variations of the basic process exemplified by the Thyssen Steel plant,⁵ we decided to explore the potential additional improvement in total power consumption for a process which utilizes pumping of the product in the liquid state to the final end use pressure, product vaporization at this pressure, followed by heating and mixing with a separately compressed air stream to obtain the desired oxidant O₂ concentration. Such a process may have significant advantages for end uses that require the process output stream to be delivered at a pressure which is above atmospheric. The conceptual design for such a process was developed jointly by NASA LeRC and Lotepro. The process is referred to as an "Internal Compression and Liquid Product Pumping" in an invention disclosure currently being prepared.

Process Energy Consumption and Capital Cost

To evaluate the potential advantages of the new process over the previously discussed optimized conventional process a study was conducted of two oxidant supply systems, sized for a 500 MW_e MHD/steam plant, using the new process and the optimized conventional process (195 kWh/TEPO), respectively. A comparison of power consumption results and of the main process parameters is shown in tables I and II. Also, a block diagram comparing the main features of the two oxidant supply systems is shown in figure 3.

Results in table I show that the new process, in which the product from the upper column is pumped as a liquid to the desired pressure, evaporated and heated, and then mixed with air compressed in the blend air compressor, has a lower overall energy consumption than the optimized conventional process in which an atmospheric pressure product is mixed with ambient air and the resulting oxidant stream is compressed in the oxidant compressor (see figure 3). Note that the oxidant compressor (an axial/radial machine) must be rated for oxygen enriched air service which implies a small penalty on efficiency and cost, whereas the blend air compressor used in the new process only has to compress air, which is less hazardous, and therefore can be compressed more efficiently in a multi-stage axial machine.

Even though, as is shown in table II, the SEC at product pressure for the new process is higher (267 vs. 195 kWh/TEPO), the overall energy required to produce the desired oxidant is lower. The use of the new process would be equivalent to using a conventional process, delivering product at atmospheric pressure, which has an SEC of 178 kWh/TEPO. This equivalent SEC is plotted as a triangle in figure 2. Further gains can be realized with the new process if higher end use pressures are required.

Another result of the study was that one can construct large single train air separation plants (up to 6000 tons/day of contained O₂) rather than using multiple parallel trains. The tradeoff is between column rail shippability, overall system redundancy and the need for on-site fabrication of the large columns required. Relative costs for two air separation units using

the new process to deliver the 4250 tons/day of contained O₂, required for the 500 MW_e plant, are shown in table III. One unit is based on the use of three trains and rail shippable columns of 13.5 ft diameter. The other is based on a field constructed single train with a 24.3 ft column diameter. The table shows that even though the single train requires on-site fabrication, the reduction in total number of components results in a relative capital cost savings of 11 percent.

Air Separation Plant Sizing

Care must be taken to determine the optimum O₂ content in the oxidant, as the following calculations will show, in order to minimize the oxidant plant cost. Based on preliminary calculations, the ASU was conservatively sized for 4250 tons/day of contained oxygen in order to deliver a 35 mol percent O₂ stream to the 500 MW_e MHD plant. Figure 4 is a semi-logarithmic plot, which shows how the required O₂ tonnage increases with O₂ mol fraction in the oxidant, x. The figure also shows that the required ASU capacity is directly proportional to the "percent oxygen enrichment" parameter, PCTE (congruent curve displaced by a constant). The PCTE parameter is defined and its use is explained in the appendix.

IV. Calculation of 500 MW_e MHD Power Plant Performance

The MHD plant performance was calculated following the methods described in previous papers.^{4,9} The power plant major cycle parameters are listed in table IV and the generator constraints are shown in table V. The bottom cycle performance was calculated using the PRESTO computer code.¹⁰ The bottom cycle is based on the one discussed in the AVCO CSPEC,¹¹ with steam conditions of 2400 psig/1000F/1000F. The channel was cooled using low pressure, low temperature feedwater. The oxidant compressor and ASU compressors are assumed to be driven by a single steam turbine.

The generator operating conditions were selected to optimize the performance of the overall combined cycle power plant. This procedure was carried out for oxygen concentrations of 25, 30 and 35 mol percent in the oxidant, MPO, (i.e., x*100), and channel lengths of 10 m, 15 m and 20 m.

The overall plant thermal efficiency is plotted as a function MPO for the channel lengths considered in figure 5. Results are shown (figure 5a), for an air separation plant SEC of 224 kWh/TEPO, representing the Thyssen steel plant ASU technology and also for the new process (equivalent SEC of 178 kWh/TEPO) (figure 5b). The power plant thermal efficiencies are shown to be up to 0.7 percent higher for plants using the new process (figure 5b). Also, the oxidant O₂ concentration at which the maximum efficiency occurs (dashed curve) shifts to slightly higher levels. Thus, for the conventional process and a 15 m channel the maximum efficiency is about 43.7 percent, and it occurs at an MPO of 32 mol percent, (figure 5a), whereas for the new process it rises to 44.3 percent at an MPO of 33.5 mol percent, (figure 5b). Note that use of the optimized conventional air separation process

(195 kWh/TE²⁰), incorporated in the ETF and the CSPEC studies, would result in overall thermal efficiency values that are about halfway between the values given above.

For both the higher and lower energy consumption, figure 5 shows that there are tradeoffs between plant thermal efficiency, oxidant O₂ concentration and channel length. An additional tradeoff is shown in figure 6, which is a plot of magnetic energy stored in the channel volume as a function of plant thermal efficiency for the various oxidant O₂ mole fractions and channel lengths considered. The magnetic energy is proportional to magnet costs while the MPO can be related to costs associated with the oxidant supply system, as indicated in figure 4. Therefore these parameters should be minimized in an optimally designed combined cycle MHD plant, consistent with sufficiently high thermal efficiency, in order to achieve the lowest cost of electricity, COE. Comparison of figures 6a and 6b shows that not only is the thermal efficiency higher at all conditions for the lower oxygen production energy, but also that a given decrease in magnetic energy will result in a smaller sacrifice in thermal efficiency for the plant with the lower oxygen production energy requirement. For example, the plant thermal efficiency is about 44.40 percent (figure 6b) using a 20 m channel and an oxidant O₂ mol fraction of 0.30. For these conditions the magnetic energy is about 1150 megajoules (MJ). Reducing the channel length to 15 m, but increasing the O₂ mol fraction, x , to near 0.35 (actually 0.335 as per figure 5b) will result in a thermal efficiency of 44.27 percent, a loss of only 0.13 percent from the 44.4 percent figure quoted above. But the magnetic energy decreases dramatically from 1150 MJ to 675 MJ, equivalent to a 41 percent decrease. Of course, the above tradeoff implies an increase in the oxidant supply system capacity of about 24 percent.

The same tradeoff, based on the results shown in figure 6a for the higher oxygen production energy requirement, will result in a power plant thermal efficiency drop from 43.90 to 43.60 percent, the resulting loss of 0.3 percent being more than double the value quoted above.

Final system optimization will require additional studies of the type discussed above, once the relationship between component sizes and associated dollar values can be defined more clearly. However, the results of this study point out that one can obtain higher overall thermal efficiencies by using large, advanced technology, oxidant supply systems which offer significant savings in oxygen production costs. These systems will also allow more flexibility in the overall power plant optimization and therefore contribute in the attainment of the lowest potential COE for combined cycle MHD/steam power plants.

V. Concluding Remarks

The results of this study show that the oxidant production cost for a combined cycle MHD/steam power plant can be lowered by improvements to the oxidant supply system. A new air separation process based on internal compression and liquid pumping and configured for a 500 MW_e MHD/steam

power plant with a 7.22 atm oxidant delivery pressure was shown to achieve a 20 percent drop in total energy consumption below state of the art, medium purity air separation plants operating overseas. The new process also was shown to achieve a 9 percent drop below the energy requirement of optimized conventional technology air separation plants assumed for the CSPEC study. The energy consumption can be reduced further for plants requiring higher delivery pressures.

For the 500 MW_e power plant, the reduced energy consumption for oxidant production was shown to result in an overall thermal efficiency increase of 0.6 percent which, when combined with projected capital cost savings identified in the study could bring about reasonable reductions in the plant COE. Future potential reductions in oxygen production costs will lead to additional improvements in MHD power plant performance.

References

1. Hals, F. A.: Parametric Study of Potential Early Commercial MHD Power Plants. NASA CR-159633, DOE/NASA/0051-79/1, 1979.
2. Marston, C. H.; et al.: Parametric Study of Potential Early Commercial MHD Power Plants, NASA CR-159634, DOE/NASA/0052-79/1, 1980.
3. Staiger, P. J.; and Abbott, J. M.: Summary and Evaluation of the Parametric Study of Potential Early Commercial MHD Power Plants (PSPEC). NASA TM-81497, DOE/NASA/2674-8019, 1980.
4. Pian, C. C. P.; Staiger, P. J. and Seikel, G. R.: MHD Performance Calculations with Oxygen Enrichment. NASA TM-79140, DOE/NASA/2674-79/4, 1979.
5. Schoenpflug, E.: The Blast-Furnace Oxygen Plant at Schwelgern. Linde Reports on Science and Technology, vol. 18, 1973, pp. 27-28.
6. Rueckborn, G.: Oxygen Enrichment: Cost and Effectiveness. Cryogenics and Industrial Gases, vol. 6, no. 4, July/Aug. 1971, pp. 27-30.
7. Springmann, H.; Greenberg, R.; and Juhasz, A. J.: The Optimization of Air Separation Plants for Combined Cycle MHD-Power Plant Applications. NASA TM-81510, DOE/NASA/2674-80/10, 1980.
8. Hartwig, W.; and Greenberg, R.: System Design Description (SDD-501) Oxidant Supply System of Magnetohydrodynamics Engineering Test Facility Conceptual Design - 200 MW_e Power Plant. Conceptual Design Engineering Report (CDER), DOE/NASA/0224-1, NASA CR-165452, vol. V, Sept. 1981.
9. Staiger, P. J.: Performance Calculations for 200-1000 MW_e MHD/Steam Power Plants. NASA TM-81775, DOE/NASA/10769-16, 1981.
10. Fuller, L. C.; and Stovall, T. K.: User's Manual for PRESTO - A Computer Code for the Performance of Regenerative Superheated

Steam Turbine Cycles. (ORNL-5547, Oak Ridge National Lab.; C-10669-D W-7405-Eng-26) NASA CR-159540,

11. Hals, F. A.: Conceptual Design Study of Potential Early Commercial MHD Power Plant. NASA CR-165235, DOE/NASA/0051-2, March 1981.

TABLE I: AIR SEPARATION POWER CONSUMPTION COMPARISON FOR 500 MW_e PLANT

	<u>OPTIMIZED CONVENTIONAL PROCESS*</u>	<u>NEW PROCESS</u>
INPUT AIR COMPRESSOR, KW	30,590	29,630
BOOST AIR COMPRESSOR, KW	0	13,410
EXPANSION TURBINE (POWER RECOVERY), KW	-620	-781
PRODUCT PUMP, KW	0	86
BLEND AIR COMPRESSOR, KW	0	36,135
OXIDANT COMPRESSOR, KW	52,990	0
TOTAL POWER CONSUMPTION, KW	82,960	78,480

TABLE II: AIR SEPARATION PROCESS PARAMETER COMPARISON FOR 500 MW_e PLANT

	<u>OPTIMIZED CONVENTIONAL PROCESS</u>	<u>NEW PROCESS</u>
Input Air Flow, nm ³ /sec*	154.75	154.75
Input Air Pressure, atm	3.95	3.93
Boost Air Flow, nm ³ /sec	---	63.89
Boost Air Pressure, atm	---	15.99
Boost Air Temp, K	---	455
Upper Column Pressure, atm	1.0	1.0
Product O ₂ Content, mol pct.	70	70
Product Pressure, atm	1.0	7.22
Product Flow, nm ³ /sec	44.7	44.7
Product Flow, tons O ₂ /day	4250	4250
Blend Air Flow, nm ³ /sec	111.3	111.3
Blend Air Pressure, atm	1.0	7.22
Blend Air Temperature, K	290	540
Oxidant Flow, nm ³ /sec	156.0	156.0
Oxidant O ₂ Content, mol pct	35	35
Oxidant Pressure, atm	7.22	7.22
Oxidant Temperature, K	544	515
SEC at Prod. Press, kWh/TEPO	195	267
SEC Corrected to P=1atm, T=544K, kWh/TEPO	195	178

* To convert nm³/sec to scfm, multiply by 5787.

TABLE III.: COLUMN SIZE AND CAPITAL COST COMPARISONS FOR TRIPLE VS. SINGLE TRAIN ASU FOR 500 MW_e PLANT

	Triple Train	Single Train
Column Dia,* m(ft)	4.10 (13.5)	7.40 (24.3)
Relative Turnkey Cost	1.00	0.89

*Assumed limit for rail shippability is 4270 mm (14 ft)

TABLE IV: MAJOR CYCLE PARAMETERS

Coal type	Montana Rosebud
Moisture content of coal delivered to combustor, percent	5
Oxidizer preheat temperature, K (F)	867 (1100)
Combustor pressure, atm	Selected to maximize plant efficiency
Combustor heat loss, percent HHV of coal	5
Combustor oxidizer-fuel ratio relative to stoichiometric	0.90
Combustor slag rejection, percent	80
Generator type	Faraday
Potassium-coal mass ratio	0.0859
MHD Generator inlet Mach number	0.8
Diffuser pressure recovery coefficient	0.6
Diffuser exit pressure, atm	1.0
MHD generator length, meters	10, 15, 20
Cycle compressor polytropic efficiency	0.90
Sulfur removal by seed, percent	70
Final oxidizer-fuel ratio relative to stoichiometric	1.05
Stack temperature, F	250
Air separation plant compressor power requirement, kW-hr/ton of equivalent pure oxygen added	224, 178
Pressure drop from compressor exit to combustor, percent of compressor exit pressure	0.1

TABLE V: GENERATOR CONSTRAINTS

Maximum axial electric field, kV/m	2.5
Maximum transverse electric field, kV/m	4.0
Maximum transverse current density, A/cm ²	1.0
Maximum Hall parameter	4.0
Maximum magnetic field, T	6.0

APPENDIX: OXIDANT MIXTURE COMPOSITIONS

When air is mixed with the product delivered by medium purity air separation plants the resulting compositions, even at the same O₂ mole fractions, will be different from those of pure oxygen and air mixtures. This is illustrated in tables A1 and A2 which show respective compositions in terms of the mole and mass fractions of the three major constituents, N₂, O₂, and Ar.

The reason for the increase in concentration of argon along with that of oxygen in product streams, containing up to 95 mol percent O₂, arises from the fact that the medium purity air separation process removes nitrogen, but not argon, from the product. Argon can be separated from oxygen and collected in high purity plants which use an additional argon separation column.

In MHD applications the concentration of argon in the oxidant stream has a beneficial, albeit small effect on power output, because of the slight increase in plasma conductivity. In addition to composition, tables A1 and A2 also have column tabulations for mixture molecular weight, density, the ratio of contained O₂ to equivalent pure O₂ (which excludes any O₂ contributed by air), and a parameter identified as "Percent O₂ Enrichment", or PCTE. This parameter has been defined for N₂-O₂ mixtures⁴ as

$$\text{PCTE} = 100 \times \left(1 - \frac{\text{N/O}}{3.26} \right) \quad (1)$$

where N/O is the nitrogen/oxygen mass ratio in the oxidant. Equation (1) has been redefined here for multi-component mixtures as:

$$\text{PCTE} = 100 \times \left(1 - \frac{\text{R/O}}{3.32} \right) \quad (2)$$

where R/O is the ratio of the sum of non-oxygen mass fractions to the mass fraction of O₂. Since PCTE is directly proportional to O₂ plant capacity, it is a useful parameter for scaling O₂ plant size when the O₂ mol fraction in the oxidant is changed while, keeping the product purity constant. Tables A1 and A2 show PCTE values for O₂ mol fractions ranging from 21 to 100 percent for ASU product-air and pure O₂-air mixtures, respectively. If the product purity is changed, the O₂ plant capacity scales inversely as the ratio of the new-to-old PCTE value. Alternately, for a change in product purity, the new air separation plant capacity can be computed by multiplying by the direct ratio of "Contained O₂/pure O₂" values in tables A1 or A2.

TABLE A1: AIR SEPARATION PLANT PRODUCT MIXTURE COMPOSITION

M O L E P E R C E N T			M A S S P E R C E N T			MOLECULAR WEIGHT	DENSITY KG/M*3	CONT.O2/ PURE O2	PERCENT O2 ENRICHMENT
OXYGEN	NITROGEN	ARGON	OXYGEN	NITROGEN	ARGON				
21.00	78.064	.936	23.202	75.506	1.291	28.962	1.2921	306.1240	.327
25.00	73.885	1.115	27.450	71.022	1.528	29.143	1.3002	4.8990	20.412
30.00	68.663	1.337	32.687	65.494	1.819	29.368	1.3102	2.6325	37.987
35.00	63.440	1.560	37.924	60.050	2.106	29.594	1.3203	1.9786	50.541
40.00	58.217	1.783	42.923	54.689	2.389	29.820	1.3304	1.6679	59.956
45.00	52.994	2.006	47.925	49.408	2.667	30.046	1.3405	1.4864	67.279
50.00	47.771	2.229	52.852	44.206	2.942	30.272	1.3506	1.3673	73.137
55.00	42.548	2.452	57.707	39.081	3.212	30.498	1.3606	1.2832	77.930
60.00	37.325	2.675	62.490	34.032	3.478	30.724	1.3707	1.2206	81.924
65.00	32.102	2.898	67.204	29.056	3.740	30.950	1.3808	1.1723	85.304
70.00	26.879	3.121	71.849	24.152	3.999	31.176	1.3909	1.1338	88.201
75.00	21.656	3.344	76.427	19.319	4.254	31.402	1.4009	1.1024	90.712
80.00	16.433	3.567	80.940	14.555	4.505	31.627	1.4110	1.0763	92.909
85.00	11.211	3.789	85.389	9.859	4.752	31.853	1.4211	1.0543	94.847
90.00	5.988	4.012	89.775	5.229	4.997	32.079	1.4312	1.0355	96.570
95.00	.765	4.235	94.100	.663	5.237	32.305	1.4413	1.0192	98.112
96.00	.000	4.000	95.055	.000	4.945	32.317	1.4418	1.0159	98.434
97.00	.000	3.000	96.282	.000	3.718	32.237	1.4382	1.0118	98.837
98.00	.000	2.000	97.516	.000	2.484	32.158	1.4347	1.0077	99.233
99.00	.000	1.000	98.755	.000	1.245	32.078	1.4311	1.0038	99.620
100.00	.000	.000	100.000	.000	.000	31.999	1.4276	1.0000	100.000

TABLE A2: COMPOSITION OF PURE OXYGEN AND DRY AIR MIXTURES

M O L E P E R C E N T			M A S S P E R C E N T			MOLECULAR WEIGHT	DENSITY KG/M*3	CONT.O2/ PURE O2	PERCENT O2 ENRICHMENT
OXYGEN	NITROGEN	ARGON	OXYGEN	NITROGEN	ARGON				
21.00	78.035	.933	23.198	75.466	1.287	28.967	1.2923	327.6028	.305
25.00	74.083	.886	27.472	71.267	1.216	29.120	1.2992	4.8789	20.497
30.00	69.145	.827	32.750	66.080	1.127	29.312	1.3077	2.6203	38.164
35.00	64.206	.768	37.960	60.961	1.040	29.504	1.3163	1.9691	50.784
40.00	59.267	.709	43.102	55.908	.954	29.696	1.3248	1.6598	60.248
45.00	54.328	.650	48.179	50.920	.869	29.888	1.3334	1.4791	67.610
50.00	49.389	.591	53.190	45.996	.785	30.080	1.3420	1.3606	73.499
55.00	44.450	.532	58.138	41.134	.702	30.272	1.3505	1.2769	78.317
60.00	39.511	.473	63.024	36.333	.620	30.464	1.3591	1.2146	82.333
65.00	34.572	.414	67.849	31.592	.539	30.656	1.3677	1.1665	85.730
70.00	29.633	.354	72.613	26.911	.459	30.847	1.3762	1.1281	88.642
75.00	24.694	.295	77.319	22.287	.380	31.039	1.3848	1.0969	91.166
80.00	19.756	.236	81.966	17.720	.302	31.231	1.3933	1.0710	93.375
85.00	14.817	.177	86.557	13.209	.225	31.423	1.4019	1.0491	95.323
90.00	9.878	.118	91.093	8.752	.149	31.615	1.4105	1.0303	97.055
95.00	4.939	.059	95.573	4.350	.074	31.807	1.4190	1.0141	98.605
96.00	3.951	.047	96.463	3.476	.059	31.845	1.4207	1.0112	98.896
97.00	2.963	.035	97.350	2.604	.044	31.884	1.4225	1.0083	99.180
98.00	1.976	.024	98.236	1.734	.030	31.922	1.4242	1.0054	99.459
99.00	.988	.012	99.119	.866	.015	31.961	1.4259	1.0027	99.732
100.00	.000	.000	100.000	.000	.000	31.999	1.4276	1.0000	100.000

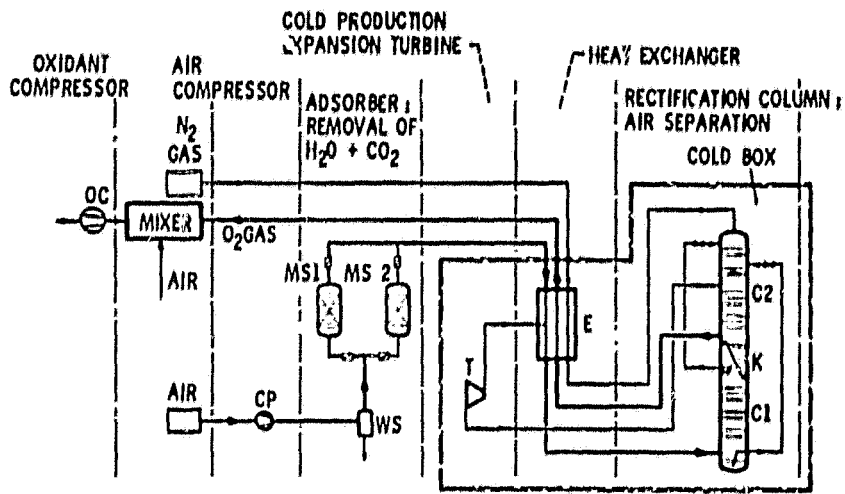


Figure 1. - Basic air separation plant delivering product O₂ at atmospheric pressure.



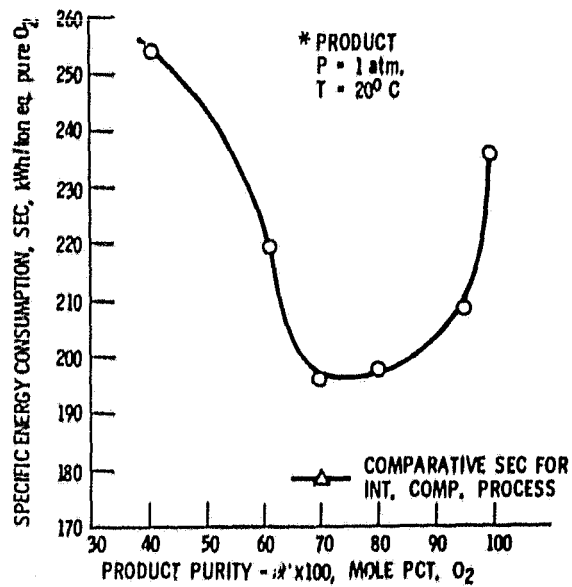


Figure 2. - Air separation process study results (Contract DEN 3-165).

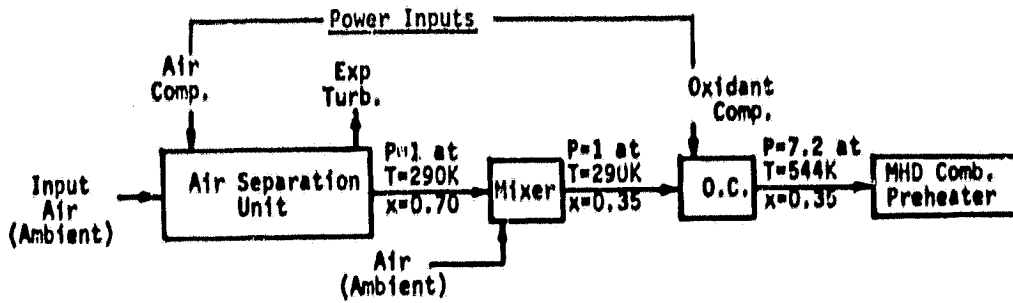

(a)

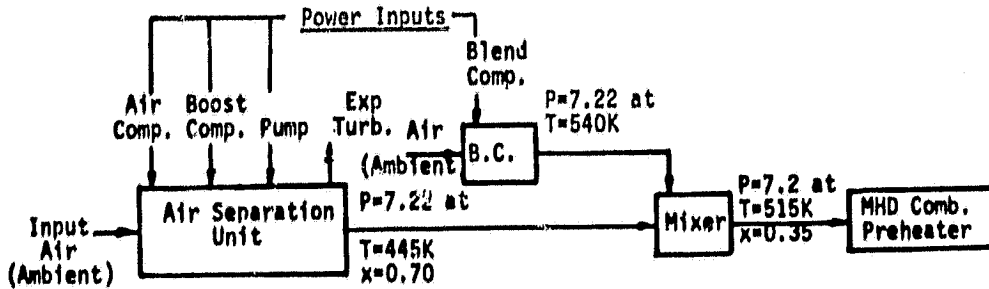

(b)

(a) Optimized conventional process

(b) New process,

Figure 3. - Comparative block diagrams for 500 MW_{th} MHD oxidant supply systems,



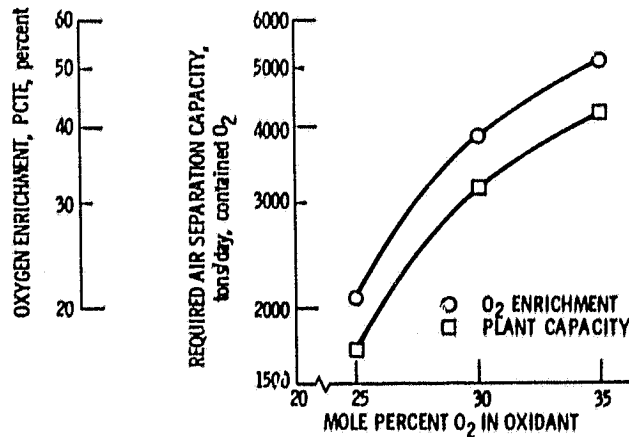


Figure 4. - Air separation plant size variation for 500 MW_{th} MHD/steam plant. Product O₂ concentration is 70 mole percent.

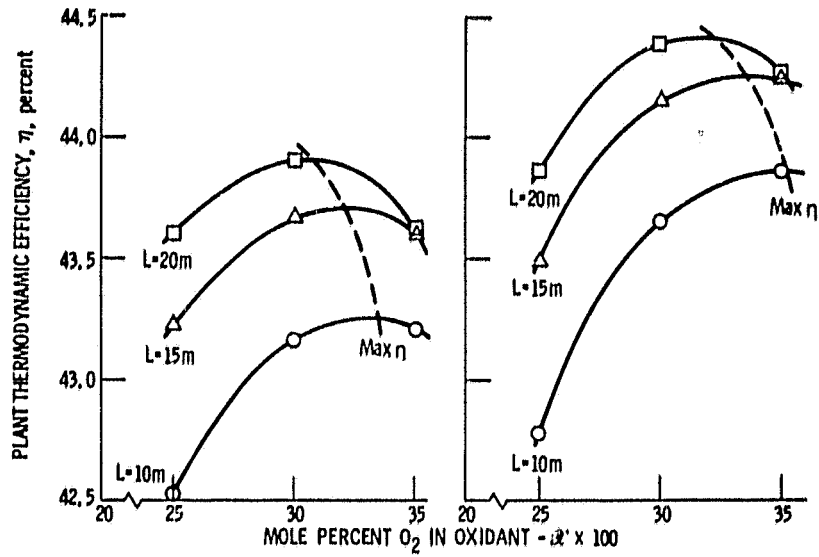

(a) Oxygen production energy is 224 kW-hr/ton of pure O₂. (b) Oxygen production energy is 178 kW-hr/ton of pure O₂.

Figure 5. - 500 MW_e MHD plant performance for various oxidant mixtures and channel lengths.

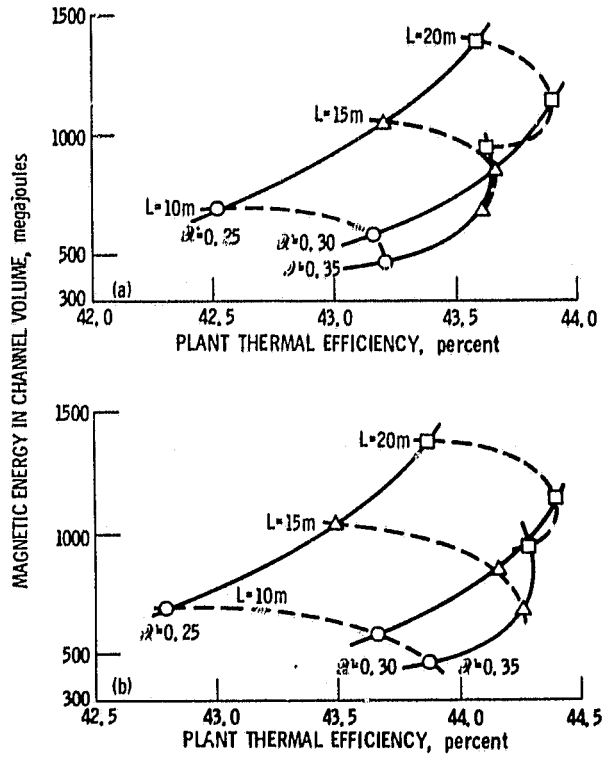

(a) Oxygen production energy is 224 kW-hr/ton of pure O₂. (b) Oxygen production energy is 178 kW-hr/ton of pure O₂.

Figure 6. - 500 MW_e MHD plant optimization considering: magnet capacity, oxidant system capacity (α'), and channel length, L.

1. Report No. NASA TM-82909	2. Government Accession No.	3. Recipient's Catalog No.	
4. Title and Subtitle OPTIMIZATION OF THE OXIDANT SUPPLY SYSTEM FOR COMBINED CYCLE MHD POWER PLANTS		5. Report Date	
		6. Performing Organization Code 778-11-05	
7. Author(s) Albert J. Juhasz		8. Performing Organization Report No. E-1294	
		10. Work Unit No.	
9. Performing Organization Name and Address National Aeronautics and Space Administration Lewis Research Center Cleveland, Ohio 44135		11. Contract or Grant No.	
		13. Type of Report and Period Covered Technical Memorandum	
12. Sponsoring Agency Name and Address U.S. Department of Energy Office of Magnetohydrodynamics Washington, D. C. 20545		14. Sponsoring Agency-Code-Report No. DOE/NASA/10769-27	
		15. Supplementary Notes Prepared under Interagency Agreement DE-AI01-77ET10769. Prepared for Twentieth Symposium on the Engineering Aspects of Magnetohydrodynamics, Irvine, California, June 14-16, 1982.	
16. Abstract An indepth study was conducted, both under contract and inhouse, to determine what, if any, improvements could be made on the oxidant supply system for combined cycle MHD power plants which would be reflected in higher thermal efficiency and a reduction in the cost of electricity (COE). The study included a systematic analysis of "air-separation" process variations which showed that the specific energy consumption could be minimized when the product stream oxygen concentration is about 70 mole percent. The use of advanced air compressors, having variable speed and guide vane control, results in additional power savings. The study also led to the conceptual design of a new air separation process, sized for a 500 MW _e MHD plant, referred to as "internal compression." In addition to its lower overall energy consumption, potential capital cost savings have been identified for air separation plants using this process when constructed in a single large air separation train, rather than multiple parallel trains, typical of conventional practice. The effect of the lower energy consumption of the new air separation process on major MHD plant parameters such as thermal efficiency and magnetic energy requirement was calculated for a range of channel lengths and for various oxidant stream compositions. The process was shown to bring about an increase in overall plant thermal efficiency of 0.6 percent while allowing more favorable tradeoffs between magnetic energy and oxygen system capacity.			
17. Key Words (Suggested by Author(s)) Magnetohydrodynamics Power plants Oxidant supply systems Air separation plants		18. Distribution Statement Unclassified - unlimited STAR Category 44 DOE Category UC-90g	
19. Security Classif. (of this report) Unclassified	20. Security Classif. (of this page) Unclassified	21. No. of Pages	22. Price*

* For sale by the National Technical Information Service, Springfield, Virginia 22161

ORIGINAL PAGE IS
OF POOR QUALITY