

Available online at [www.sciencedirect.com](http://www.sciencedirect.com)**ScienceDirect**

Energy Procedia 75 (2015) 3014 – 3026

---

---

**Energy**  
**Procedia**

---

---

The 7<sup>th</sup> International Conference on Applied Energy – ICAE2015

# Short-term forecasting of the Abu Dhabi electricity load using multiple weather variables

Luiz Friedrich, Afshin Afshari\*

*Department of Engineering Systems and Management, Masdar Institute of Science and Technology, PO Box 54224, Abu Dhabi,  
United Arab Emirates*

---

## Abstract

Short term load forecasting, ranging from a few hours ahead to a few weeks ahead has great importance in the operations and planning of the electric power system. As forecast accuracy increases, the overall system can be operated closer to its optimal point, directly affecting its profitability and stability. In this paper, measured hourly weather variables (temperature, specific humidity, Global Horizontal Irradiation and wind speed) were used for modelling and forecasting the electricity load for the city of Abu Dhabi, UAE. A Transfer Function (TF) model was developed and its average accuracy measured using 30 one-week forecasts generated every day over a period of one month. The accuracy of the TF method was compared to an Autoregressive Integrated Moving Average (ARIMA) model and to an Artificial Neural Network (ANN) model based on the same exogenous variables. When perfect knowledge of the exogenous variables over the forecasting horizon was assumed, the TF model had better accuracy for one- and two-day forecasts, while the ANN was more accurate for one-week ahead forecasts. With a more realistic scenario, where the exogenous variables are not known over the forecasting horizon and have to be forecasted before being used in the load forecast, the TF model had better accuracy than the ANN approach for all three tested forecasting horizons. Average accuracy of the preferred Transfer Function method is better than 1.5% for 24-hour horizon, better than 2.5% for 48-hour horizon and better than 4% for 168-hour horizon. With the added uncertainty of forecasted weather drivers, the accuracy of the proposed method degrades only slightly, while the neural network approach degrades rapidly and becomes unusable beyond a two-day horizon.

© 2015 The Authors. Published by Elsevier Ltd. This is an open access article under the CC BY-NC-ND license (<http://creativecommons.org/licenses/by-nc-nd/4.0/>).

Peer-review under responsibility of Applied Energy Innovation Institute

*Keywords: short-term load forecasting, time series, ARMA, transfer function, neural network*

---

---

\* Corresponding author. Tel.: +971-2-8109149; fax: +971-2-8109901.  
E-mail address: [aafshari@masdar.ac.ae](mailto:aafshari@masdar.ac.ae).

## 1. Introduction

Load forecasting has been an active area of research for over 50 years as well as a fundamental topic for operations and planning of power systems. Lack of accuracy of load forecasts has negative impact on the operating cost of power companies [1]. Based on the lead-time of the forecast, four different classes have been distinguished. Long-term forecasts, encompassing 1 to 20 years ahead, are fundamental for strategic planning and construction of new generation and transmission capacity as new projects in these areas usually take years to complete [2]. Mid-term forecast ranging from a month to 1 year are used for maintenance scheduling and planning of power sharing agreements as well as generation of ex post baseline in demand-side management measurement & verification [3]. Short-term load forecasts (STLF) from an hour ahead to a few weeks ahead have fundamental importance in plant scheduling, fuel purchase plans, security capacity, short-term maintenance as well as short-term storage usage [3]. The last category, very short-term forecasts, range from a few minutes to an hour ahead and are used for real-time control [4]. This paper focuses in modeling and forecasting short-term hourly load with a forecasting horizon of one day, two days or one week.

Two categories of methods have emerged targeting STLF, statistical methods and artificial intelligence based methods. Despite differences in model structure and forecasting, both categories rely on historical data of load and other impacting factors as seasons, day-types and weather. The main example of artificial intelligence based models are Artificial Neural Networks (ANN), usually a black-box scheme where no physical correspondence with the underlying physical systems is preserved. In other modeling approaches, expert information, system's structure and the underlying physical phenomena can be incorporated to increase the forecast's accuracy.

This paper describes the modeling process for a statistical method used for STLF. The model uses the relationship between load and weather represented by temperature, specific humidity, global solar irradiance and wind speed. The impact of each of these weather variables was analyzed individually, and they were included in the final model based on their overall cross-correlation with load. The statistical methods were then compared to an ANN model based using the same measured weather variables as inputs.

A comprehensive review of methods and model propositions applied to load forecasting is presented in [5], including techniques such as: regression, multiple regression, exponential smoothing, iterative reweighted least squares, adaptive load forecasting, stochastic time series-autoregressive, ARMA model, ARIMA model, support vector machine based, soft computing based models, genetic algorithms, fuzzy logic, neural networks and knowledge based expert systems.

Some recent work in this field have employed the combination of two or more of the aforementioned methods. [6] describes the combination of an Autoregressive Integrated Moving Average (ARIMA) model for the forecast of the daily load, combined with Support Vector Machines (SVM) to correct the deviation of former forecasting basic trend in load. Similarly, [7] uses the combination of Support Vector Regression (SVR) with Kalman Filter, and [8] combined Empirical Mode Decomposition (EMD) and Support Vector Machines (SVMs). The main disadvantage of using ARIMA models is that the important relationship to weather variables [9] is not accounted for. In order to overcome this limitation, a transfer function model (also called ARIMAX, X representing the exogenous variables) has been successfully applied in other scenarios [10] [11] and is the model developed in this study. A series of studies have been published based on artificial intelligence models. Data mining has been used in [12] to forecast weather sensitivity to load. A short-term load prediction in buildings using feedback ANN is presented in [13]. In [14] two adaptive ANN models are proposed and tested for online consumption forecasting where changes in the building and in the parameters would automatically be accounted for in the dynamic behavior of the model. Other examples of ANN applied to building electricity forecasting can be seen in

[15], [16] and [17]. A comparison study between neural networks and hybrid neuro-fuzzy system is presented in [18].

To establish a comparison between both modelling approaches, a transfer function model was developed and its performance compared to an ANN model that fits the same dataset.

## 2. Methodology

Earlier studies relied only on the autoregressive characteristics of load when dealing with load forecasts. As access to more exogenous data becomes available and computational capacity increases, load models evolve to account for the external drivers of the load. Transfer Function Models are a class of models that use the causal information represented by external drivers. This paper presents the process of data analysis and model estimation where temperature, specific humidity, GHI and wind speed data are integrated into a model for load forecasting.

### 2.1. Data

This study relied on substation-level hourly electricity data measured by the SCADA system of Abu-Dhabi Emirate's electricity utility, as well as hourly weather data, including global solar irradiance (GHI) and wind speed, monitored by Masdar City's comprehensive weather station for the second half of 2009 (July 1<sup>st</sup> – December 31<sup>st</sup>), calendar year 2010 (January 1<sup>st</sup> – December 31<sup>st</sup>) and the first half of 2011 (January 1<sup>st</sup> – June 30<sup>th</sup>). For this study, only electricity consumption within the Abu Dhabi municipality, mostly imputable to buildings (residential, commercial and institutional), is considered. A subset of substations representing the downtown area was selected, thereby eliminating industrial & agricultural loads. This subset constitutes, in aggregate, a better proxy for the total system load within the municipality. Hourly electricity consumption data from 29 low-voltage substations (11kV, 22kV and 33kV) was used. This subset includes all substations that directly supply street transformers serving final customers in residential/business areas within the Abu Dhabi municipality. The aggregate demand of the selected substations during this period peaks at 2,040 MW in 2011, presenting a growth over 2009 and 2010. Figure presents the plot of electricity demand (MW) per hour-of-year, starting from the 1<sup>st</sup> of July of 2009. This data was used for model training and testing. A plot of each exogenous variable is presented in Figure , namely, temperature, specific humidity, GHI and wind.

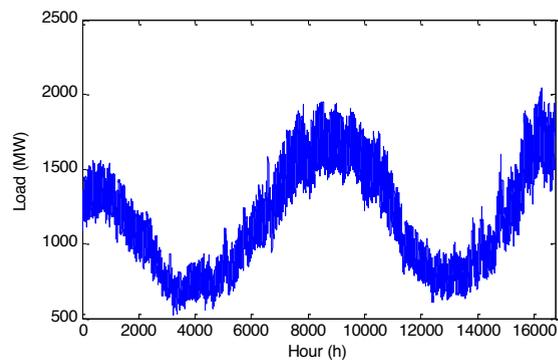


Figure 1 - Electricity demand

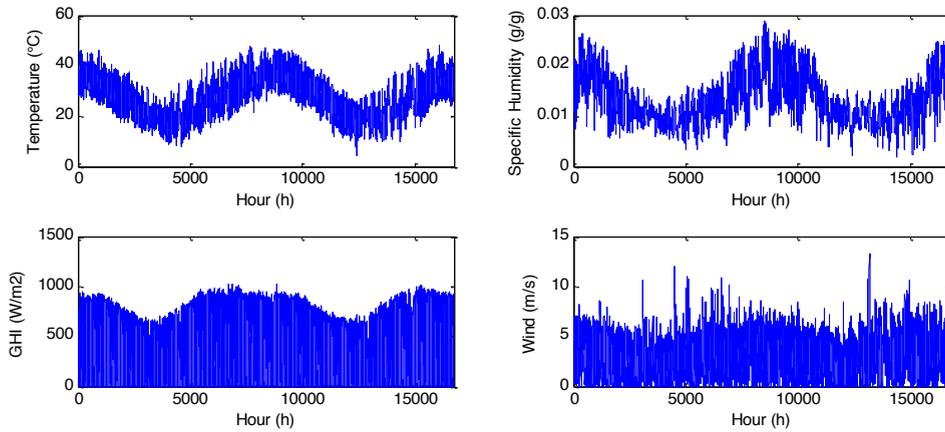


Figure 2 - Exogenous variables (temperature, specific humidity, GHI and wind speed)

## 2.2. Data Preparation

Abu Dhabi has seen steady growth in population and electricity consumption. As can be seen in Figure 1, a growth component is present, as well as daily seasonality (24-hour periodicity) and a weekly seasonality (168-hour periodicity). Following the Box - Jenkins time series modelling approach, the first step is to stationarize the time series under study. Considering  $Y_t$  the measured electricity consumption, first order differencing was used to eliminate the trend (growth). 24-hour and 168-hour differencing was applied in order to eliminate the seasonality components not driven by exogenous variables. The transformed series is represented by  $y_t$  (Equation 1). Annual differencing did not improve the model and because the annual seasonality is mostly captured by the exogenous variables and also because our longest forecasting horizon (one week) is significantly shorter than one year. Similarly, defining  $X_t$  as the matrix with the time series representing hourly measured values of temperature, specific humidity (SH), GHI and wind speed, 1-hour and 24-hour differencing was applied. Equation 2 presents this transformation, where  $x_t$  represents the transformed matrix of exogenous variables. All five time series were stationary after the differencing process.

$$y_t = (1 - B)(1 - B^{24})(1 - B^{168})Y_t \quad (1)$$

$$x_t = (1 - B)(1 - B^{24})X_t \quad (2)$$

$$\text{Where: } X_t = [X_{Temperature} \ X_{SH} \ X_{GHI} \ X_{Wind}]$$

It is often the case, that the exogenous variables (input series) are auto-correlated, therefore the direct cross-correlation function between the input and response series gives a misleading indication for the model estimation. One solution to this problem is to apply “pre-whitening”. Pre-whitening consists in fitting an ARMA model to the input series in order to account for the autocorrelation of the series and applying that same model to the response series (hourly load in this case). This analysis was conducted for all four input series. By analyzing the auto-correlation function ACF), the partial autocorrelation

function (PACF) and the inverse autocorrelation function (IACF) of the differenced series, as shown on Figure 3, an autoregressive model was fit to each of the input series reducing the residuals to white-noise, and the same model was then applied to the differenced response series.

### 2.3. Model Selection

Model selection was based on the fitting performance of typical model structures available in the literature for each exogenous variable isolated. After pre-whitening, a cross correlation analysis was performed (Figure 4). The cross correlation plots obtained after the pre-whitening were compared to the typical models structures presented in literature for transfer function models. Given  $b$  the delay (shift) term,  $s$  the order of the numerator, and  $r$  the order of the denominator in the transfer function model, Table 1 summarizes the most likely model structures for each exogenous variable being modeled.

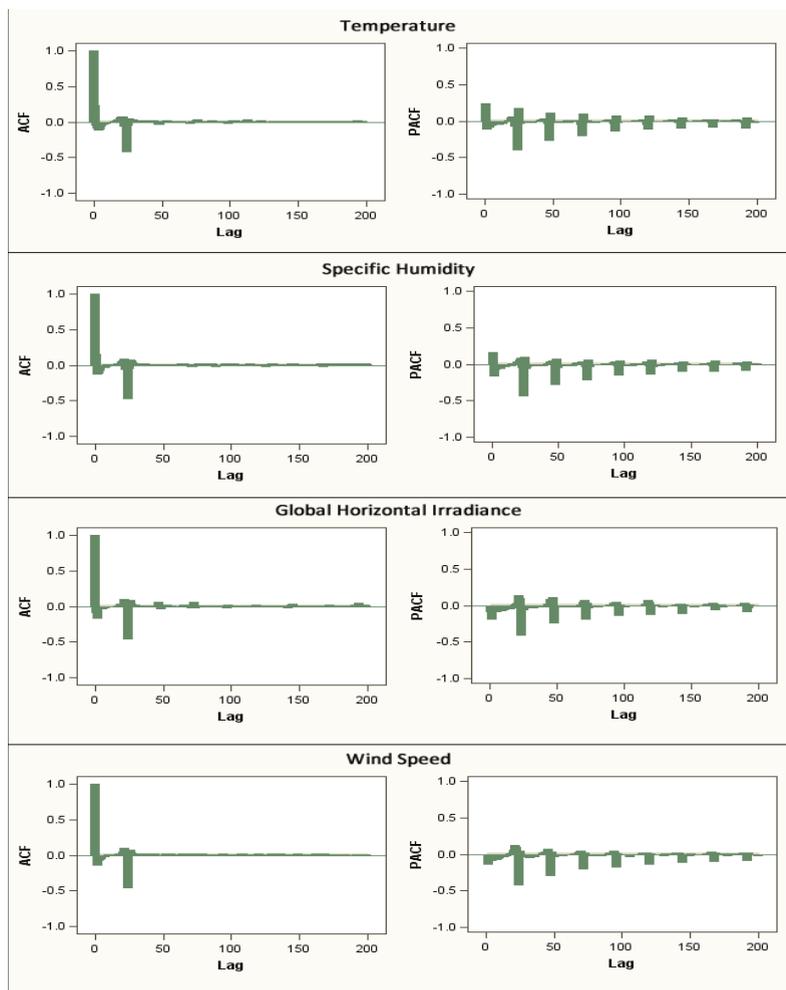


Figure 3 - Trend and correlation analysis for 1-lag/24-lag differenced temperature (a), specific humidity (b), GHI (c) and wind speed (d)

Based on the assumption that the exogenous variables are not correlated, transfer model structures were tested for each exogenous variables separately and compared based on the AIC (Akaike information criterion) and Standard Error Estimate. Table 2 presents the best transfer function model for each exogenous variable. These models were then combined to form a full transfer function model for load.

After applying the transfer function model only with the exogenous variables, the residuals (difference between the predicted and the measured data) were auto-correlated, meaning that some information presented in the data was not being fully captured by the model tested. Figure 5 presents the ACF and PACF of the residuals.

Table 1- Transfer function model structures investigated

Temperature	<i>s: 0,1</i> <i>r: 1,2</i>
Specific Humidity	<i>s: 0,1,2</i> <i>r: 1,2</i>
GHI	<i>s: 1,2</i>
Wind	<i>b: 0,1</i> <i>s: 0,1,2</i>

Table 2- Best models based on AIC and Standard Error Estimate

Input	Model	AIC	Standard Error Estimate
Temperature	$\frac{\omega_0}{1 - \delta_1 B}$	137828.3	15.52848
Specific Humidity	$\frac{\omega_0}{1 - \delta_1 B}$	137856.5	15.54216
GHI	$\omega_0 - \omega_1 B - \omega_2 B^2$	138013.7	15.61563
Wind	$(\omega_0 - \omega_1 B - \omega_2 B^2)B$	138107.4	15.6599

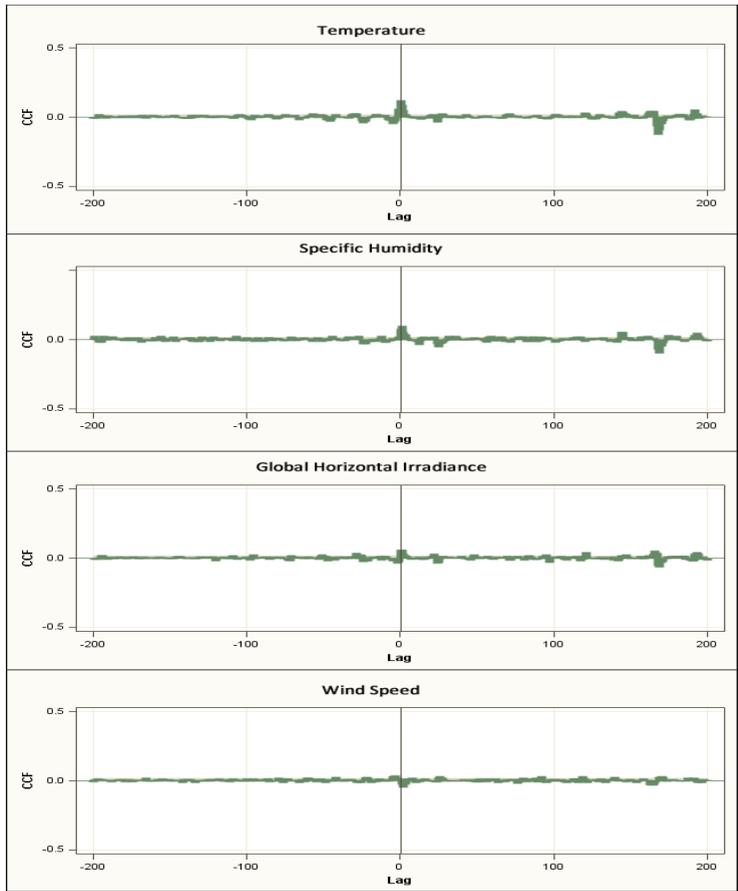


Figure 1 – Cross-correlation between 1-lag/24-lag/168-lag differenced load and 1-lag/24-lag differenced temperature (a), specific humidity (b), GHI (c) and wind speed (d)

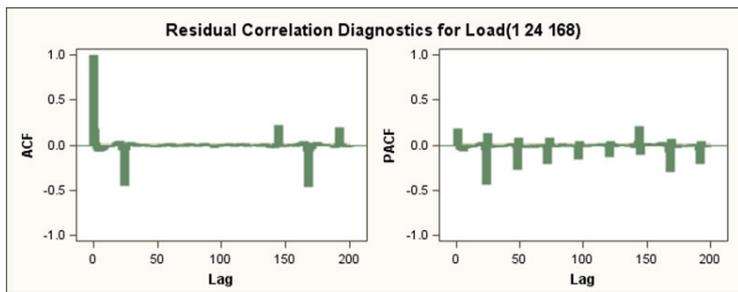


Figure 2- Residual analysis after the estimation of the transfer function model without any ARMA component

A series of ARMA models were tested in order to account for the autocorrelation of the residuals  $a(t)$  until a balance between the number of parameters (complexity of the model), significance of the

coefficients (given by the t-statistics) and the probability of white noise of the residuals after applying the ARMA model was achieved. The final model obtained for the ARMA presented in

$$\frac{(1-\theta_1B-\theta_2B^2-\theta_3B^3)(1-\theta_{24}B^{24})(1-\theta_{48}B^{48})}{(1-\phi_1B-\phi_2B^2-\phi_3B^3)(1-\phi_{24}B^{24})(1-\phi_{48}B^{48})(1-\phi_{168}B^{168})} a_t \tag{3}$$

After applying the full model (Equation 4) the residuals presented no further seasonality and no significant autocorrelation as shown in Figure 3.

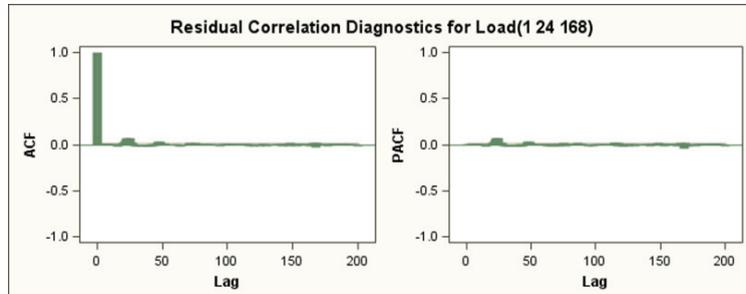


Figure 3- Residual analysis after the estimation of the transfer function model including an ARMA component

$$y_t = \frac{\omega_0}{1-\delta_1B} x_{Temperature_t} + \frac{\omega_0}{1-\delta_1B} x_{SH_t} + (\omega_0 - \omega_1B - \omega_2B^2)x_{GHI_t} + (\omega_0 - \omega_1B - \omega_2B^2)Bx_{Wind_t} + \frac{(1-\theta_1B-\theta_2B^2-\theta_3B^3)(1-\theta_{24}B^{24})(1-\theta_{48}B^{48})}{(1-\phi_1B-\phi_2B^2-\phi_3B^3)(1-\phi_{24}B^{24})(1-\phi_{48}B^{48})(1-\phi_{168}B^{168})} a_t$$

Where:

$$y_t = (1-B)(1-B^{24})(1-B^{168})Y_t$$

$$x_t = (1-B)(1-B^{24})X_t \tag{4}$$

### 3. Forecasting

#### 3.1. Forecasting accuracy

In order to test the model’s accuracy, load was forecasted from one hour ahead to one week ahead (168 hours) starting every day at midnight for 30 consecutive days, resulting in 30 forecasts of one week each. The results from each forecast  $\hat{Y}_t$  were compared against actual data  $Y_t$  and the accuracy was measured using the Mean Absolute Percentage Error (MAPE) according to Equation 5. At this stage, comparative

forecasting accuracy being the main focus, perfect knowledge of the exogenous variables was assumed over the forecasting horizon.

$$\text{MAPE} = \frac{1}{N} \sum_{t=1}^N \frac{|Y(t) - \hat{Y}(t)|}{Y(t)} * 100 \quad (5)$$

### 3.2. ANN comparison

In order to compare the proposed model's forecasting accuracy for STLF, an ANN model using the same input parameters was considered. Modeling and training was conducted using Matlab's Neural Net Time Series Application. An ANN model composed of one input layer, one hidden layer and one output layer was used similarly to [19]. Due to the strong autocorrelation and cross correlation between load and the exogenous variables, lagged variables of each series was considered for lags 1, 2, 3, 6, 12, 24 and 168. Figure 4 presents the ANN architecture used during the training period. Once the model is used for forecasting,  $\hat{Y}_t$  is fed back to the input layer so that only information prior to the start of the forecast is used, and subsequent terms in the future are based on forecasted values.

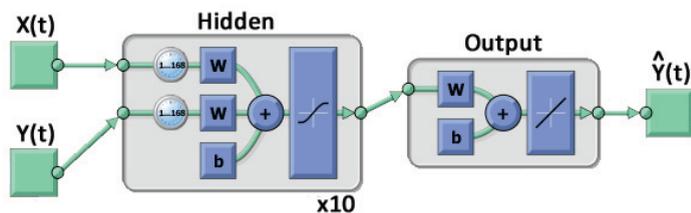


Figure 4- Artificial Neural Network architecture

## 4. Results & Discussion

### 4.1. Ex post forecast

Perfect knowledge of the weather variables over the forecast horizon (1 week) is assumed. Forecasting accuracy was compared between the ARIMA model, the TF model and the ANN model. Thirty forecast of one week each were generated, starting at midnight, for 30 consecutive days covering the period from the last week of May until the last week of June 2011. Table 3 presents the forecasting accuracy (MAPE) for the three models averaged over each of three different forecast horizons: first 24 hours (1:24), first 48 hours (1:48) and the full week (1:168). For the ANN model, due to large number of parameters to be identified, the non-convex nature of the estimation problem and the random starting parameters utilized for the training, each run produced slightly different results. The ANN model with best performing cross-validation after 10 runs was used for comparison to ARIMA and TF.

Figure presents the residuals for 30 forecasts of one week for the TF model. Residuals are centered around zero and, as expected, increase in variability as the forecasting horizon increases. For a given forecast, the residuals are often on-sided, meaning either over- or under-forecast consistently over the horizon. The TF model produced the best results for 1:24 and 1:48 hours, while the ANN gave better forecasting performance for 1:168 hours. This can be justified by the fact that the TF has a significant

autoregressive component, while the ANN is based mostly on the exogenous variables, which at this stage were considered to be known over the forecasting horizon.

Table 3 - Forecasting efficiency

	1:24	1:48	1:168
TF	1.47	1.97	3.92
ARIMA	1.53	2.06	4.13
ANN	1.97	2.48	3.18

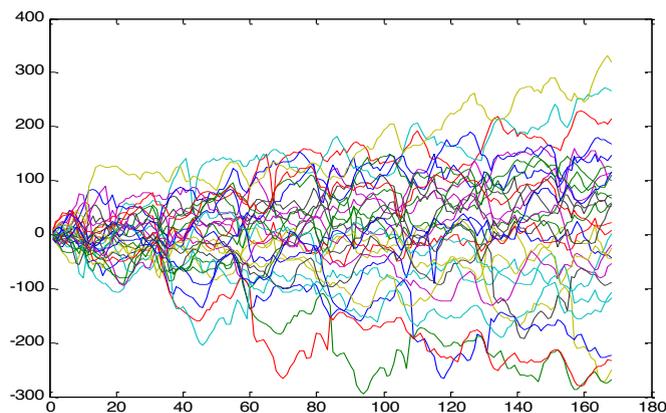


Figure 8 - Residuals for 30 forecasts of one week

#### 4.2. Ex ante forecast

In the second stage of the study, in order to analyze the applicability of the models to a more realistic scenario, where the weather information for the future is not known, an ANN model was used for forecasting the weather parameters using lags 1, 2, 3, 6, 12, 24, 48 and two hidden layers with 5 neurons each (Figure 9). For the forecasting of the weather variables, the only input to the model was past weather information, as opposed to the load forecasting case where exogenous variables are present. Forecasted values of specific humidity, GHI and wind below zero were set to zero.

Weather was forecasted for the last week of June 2011, and the forecasted values were used in the load forecasting. Figure 10 presents the forecasted weather parameters against the measured ones, only for that week.

The TF model was compared with the ANN based on the forecasting performance for the last week of June 2011, using both the measured weather data and the forecasted weather data. The forecasting results between the two models for the three time ranges are presented in Table 4. For short horizons of up to 48 hours, the TF-based load forecasts using approximate (forecasted) weather is comparable to, even slightly

better than, the one using actual (measured) weather. This is due to the good precision of the weather prediction up to two-days. Also, as mentioned previously, for a given load forecast based on actual (measured) weather, the residuals are often one-sided—either under-forecast or over-forecast, consistently over the entire horizon—so it can happen that the error of the approximate weather, itself often one-sided, accidentally cancels part of the bias of the original load forecast, resulting in a comparable or slightly better load forecast. It should be noted that we are looking, this time, only at a single forecast instance (i.e., only one week-long load forecast instead of 30 previously), so the results in Table 4 are to be interpreted only for comparative analysis. That being said, it is safe to infer that the TF-based load forecast is not very sensitive to uncertainty in the exogenous variables with a degradation of accuracy that does not exceed 0.25% over the week-long horizon. The ANN model on the other hand displays a severe lack of robustness to said uncertainties, even over a short 24-hour horizon.

Table 4 - TF and ANN model comparison for last week of June 2011

		1:24	1:48	1:168
Measured weather	TF	2.19	2.46	3.28
	ANN	1.56	3.28	2.43
Forecasted weather	TF	2.18	2.43	3.42
	ANN	4.38	10.41	11.5

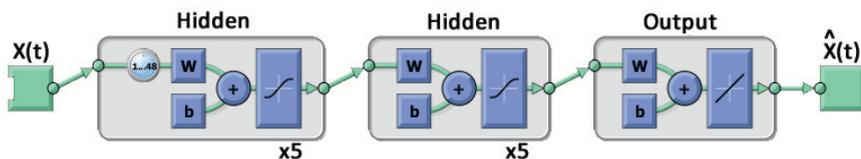


Figure 9 - ANN for weather forecast

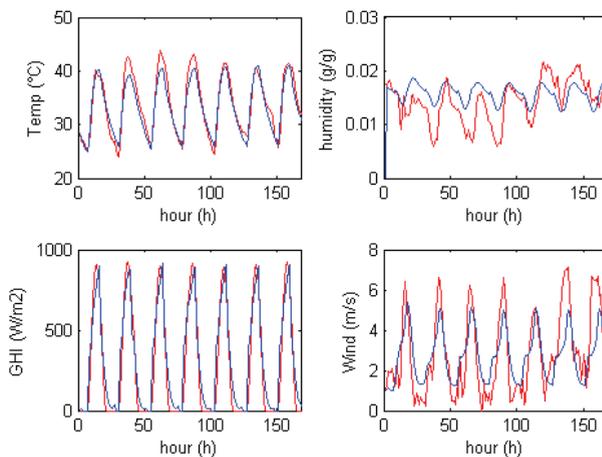


Figure 5- Predicted weather variables (blue) against measured (red)

## 5. Conclusion

A Transfer Function model was proposed for the short-term (up to one week) forecast of city-scale hourly electricity consumption. The model was validated using actual measurements of hourly system load for the city of Abu Dhabi, UAE. The influence of exogenous weather variables including not only temperature but also specific humidity, solar irradiation and wind speed was incorporated.

The performance of the TF model, assessed via the MAPE, was compared to an ARIMA model (not using exogenous variables) as well as an ANN model. The TF and ANN models had better performance than the ARIMA model in all tested forecasting horizons (1-day ahead, 2-day ahead and 1-week ahead). Considering perfect knowledge of the exogenous variables over the forecast horizon, the TF model obtained better results for up to 2 days ahead forecast (MAPE better than 1.5% for 24-hour horizon, better than 2.5% for 48-hour horizon), while the ANN model outperformed the TF model for the 1-week ahead forecast scenario (MAPE of 3.18% vs. 3.92%). The superiority of the ANN model for the 1-week ahead forecast is in part explained by the fact that the model is less dependent on previous forecasted load values, compared to TF. This results in a more stable forecast over the longer horizon, when actual values of the weather variables over the horizon are available.

We then switched to a more realistic scenario where weather variables are not known over the forecast horizon. Weather was forecasted, using ANN, over one week. All weather variables were estimated together (multivariate forecast) whereby the prediction of each variable was informed by past values of all 4 variables. These predicted values were then input to the load forecast model. The ANN approach proved superior for the forecasting of the exogenous weather variables while the TF model presented significantly better load forecasting performance for all forecast horizons. The uncertain nature of the predicted weather drivers had limited impact on the accuracy of the forecasted load.

The multivariate prediction of weather via ANN is surprisingly accurate over the horizon of interest (one week). The use of all 4 weather variables is shown to be advantageous when compared to the ARIMA model or the TF model with a single weather variable (temperature) [3]. A sophisticated TF model was derived for the forecasting of the hourly system load in Abu Dhabi using hourly values of 4 weather variables. This approach is promising and, in our opinion superior to alternatives, for this specific case.

## Nomenclature

- $B$  : Backshift operator
- $Y_t$  : Main variable (original data)
- $y_t$  : Main variable (stationarized data)
- $X_t$  : Exogenous variable (original data)
- $x_t$  : Exogenous variable (stationarized data)
- $b$  : Delay in transfer function model
- $s$  : Order of numerator in transfer function model
- $r$  : Order of denominator in transfer function model
- $\omega_i$  : Coefficients of numerator in transfer function model
- $\delta_i$  : Coefficients of denominator in transfer function model
- $\theta_i$  : MA coefficients in ARMA model
- $\phi_i$  : AR coefficients in ARMA model

## References

- [1] T. Haida and S. Muto, "Regression based peak load forecasting using a transformation technique," *Power Systems, IEEE Transactions on*, vol. 9, no. 4, pp. 1788–1794, 1994.
- [2] M. Kandil, S. M. El-Debeiky, and N. Hasanien, "Long-term load forecasting for fast developing utility using a knowledge-based expert system," *Power Systems, IEEE Transactions on*, vol. 17, no. 2, pp. 491–496, 2002.
- [3] L. Friedrich, P. Armstrong, and A. Afshari, "Mid-term forecasting of urban electricity load to isolate air-conditioning impact," *Energy and Buildings*, 2014.
- [4] J. W. Taylor, "An evaluation of methods for very short-term load forecasting using minute-by-minute British data," *International Journal of Forecasting*, vol. 24, no. 4, pp. 645–658, 2008.
- [5] A. K. Singh, I. Ibraheem, S. Khatoun, M. Muazzam, and D. Chaturvedi, "Load forecasting techniques and methodologies: A review," in *Power, Control and Embedded Systems (ICPCES), 2012 2nd International Conference on*, 2012, pp. 1–10.
- [6] H. Nie, G. Liu, X. Liu, and Y. Wang, "Hybrid of ARIMA and SVMs for short-term load forecasting," *Energy Procedia*, vol. 16, pp. 1455–1460, 2012.
- [7] C.-N. Ko and C.-M. Lee, "Short-term load forecasting using SVR (support vector regression)-based radial basis function neural network with dual extended Kalman filter," *Energy*, vol. 49, pp. 413–422, 2013.
- [8] Z. Zhu, Y. Sun, and H. Li, "Hybrid of EMD and SVMs for short-term load forecasting," in *Control and Automation, 2007. ICCA 2007. IEEE International Conference on*, 2007, pp. 1044–1047.
- [9] F. Apadula, A. Bassini, A. Elli, and S. Scapin, "Relationships between meteorological variables and monthly electricity demand," *Applied Energy*, vol. 98, pp. 346–356, 2012.
- [10] M. Cho, J. Hwang, and C. Chen, "Customer short term load forecasting by using ARIMA transfer function model," in *Energy Management and Power Delivery, 1995. Proceedings of EMPD '95., 1995 International Conference on*, vol. 1, 1995, pp. 317–322.
- [11] M. T. Hagan and S. M. Behr, "The time series approach to short term load forecasting," *Power Systems, IEEE Transactions on*, vol. 2, no. 3, pp. 785–791, 1987.
- [12] M. Torabi and S. Hashemi, "A data mining paradigm to forecast weather sensitive short-term energy consumption," in *Artificial Intelligence and Signal Processing (AISP), 2012 16th CSI International Symposium on*, 2012, pp. 579–584.
- [13] P. A. González and J. M. Zamarreño, "Prediction of hourly energy consumption in buildings based on a feedback artificial neural network," *Energy and Buildings*, vol. 37, no. 6, pp. 595–601, 2005.
- [14] J. Yang, H. Rivard, and R. Zmeureanu, "On-line building energy prediction using adaptive artificial neural networks," *Energy and buildings*, vol. 37, no. 12, pp. 1250–1259, 2005.
- [15] S. Karatasou, M. Santamouris, and V. Geros, "Modeling and predicting building's energy use with artificial neural networks: Methods and results," *Energy and Buildings*, vol. 38, no. 8, pp. 949–958, 2006.
- [16] S. L. Wong, K. K. Wan, and T. N. Lam, "Artificial neural networks for energy analysis of office buildings with daylighting," *Applied Energy*, vol. 87, no. 2, pp. 551–557, 2010.
- [17] R. Yokoyama, T. Wakui, and R. Satake, "Prediction of energy demands using neural network with model identification by global optimization," *Energy Conversion and Management*, vol. 50, no. 2, pp. 319–327, 2009.
- [18] K. Li, H. Su, and J. Chu, "Forecasting building energy consumption using neural networks and hybrid neuro-fuzzy system: A comparative study," *Energy and Buildings*, vol. 43, no. 10, pp. 2893–2899, 2011.
- [19] P. Mandal, T. Senjyu, and T. Funabashi, "Neural network models to predict short-term electricity prices and loads," in *Industrial Technology, 2005. ICIT 2005. IEEE International Conference on*, 2005, pp. 164–169.